


<b>257.83 (b) (2)</b>	<b>REPORT OF ANNUAL INSPECTION OF CCR SURFACE IMPOUNDMENT</b>		
	<b>FACILITY NAME:</b> Plant Hammond, Ash Pond 2 (AP-2)		
	<b>OWNER/OPERATOR OF FACILITY:</b> Georgia Power Company		
	<b>INSPECTION DATE:</b> October 19, 2021		
	<b>INSPECTING ENGINEER:</b> Jacob A. Jordan, P.E. (GA PE# PE028586)		
<b>(i)</b>	<b>ANY CHANGES IN GEOMETRY OF THE IMPOUNDING STRUCTURE SINCE THE PREVIOUS ANNUAL INSPECTION?</b>	NO	
	(IF YES, DESCRIBE):		
<b>(ii)</b>	<b>LOCATION AND TYPE OF EXISTING INSTRUMENTATION</b>	SEE ATTACHED PLAN	
<b>(ii)</b>	<b>MAXIMUM RECORDED READING OF EACH INSTRUMENT SINCE PREVIOUS ANNUAL INSPECTION</b>	SEE ATTACHED TABLE	
<b>(iii)</b>	<b>APPROXIMATE MINIMUM, MAXIMUM AND PRESENT DEPTH AND ELEVATION OF THE IMPOUNDED WATER SINCE PREVIOUS ANNUAL INSPECTION</b>		
	MIN. DEPTH: 0 ft	MAX. DEPTH: 23 ft	PRESENT DEPTH: See note (3)
	MIN. ELEVATION: 576	MAX. ELEVATION: 599	PRESENT. ELEVATION: < 595 <sup>(3)</sup>
<b>(iii)</b>	<b>APPROXIMATE MINIMUM, MAXIMUM AND PRESENT DEPTH AND ELEVATION OF CCR SINCE PREVIOUS ANNUAL INSPECTION.</b>		
	MIN. DEPTH: 6 ft	MAX. DEPTH: 15 ft	PRESENT DEPTH: up to 15 ft
	MIN. ELEVATION: 576	MAX. ELEVATION: 585	PRESENT ELEVATION: 585
<b>(iv)</b>	<b>APPROXIMATE STORAGE CAPACITY OF IMPOUNDING STRUCTURE AT TIME OF INSPECTION.</b>	902,000 cy <sup>(1)</sup>	
<b>(v)</b>	<b>APPROXIMATE VOLUME OF IMPOUNDED WATER AND CCR AT TIME OF INSPECTION</b>	<b>WATER:</b> <20,000 cy <sup>(2)(3)</sup>	<b>CCR:</b> Approx 582,500 cy <sup>(2)</sup>
<b>(vi)</b>	<b>ANY APPEARANCE OF AN ACTUAL OR POTENTIAL STRUCTURAL WEAKNESS OF THE CCR UNIT, IN ADDITION TO ANY EXISTING CONDITIONS THAT ARE DISRUPTING OR HAVE THE POTENTIAL TO DISRUPT THE OPERATION AND SAFETY OF THE CCR UNIT AND APPURTENANT STRUCTURES?</b>	NO	
	(IF YES, DESCRIBE):		
<b>(vii)</b>	<b>ANY OTHER CHANGE(S) WHICH MAY HAVE AFFECTED THE STABILITY OR OPERATION SINCE THE PREVIOUS ANNUAL INSPECTION?</b>	NO	
	(IF YES, DESCRIBE):		

(1) Cubic yard estimates are derived by qualified personnel from available information.

(2) Pond is divided into two operational areas in order to excavate, dry and process the ash for off-site landfilling. Volumes and depths vary continually in the ash pond based on operations (generation and removal rates).

(3) Water levels within AP-2 have dropped to well below the bottom of the staff gauge used to measure pond levels due to the fact that process and wastewaters are no longer sent to the ash pond.



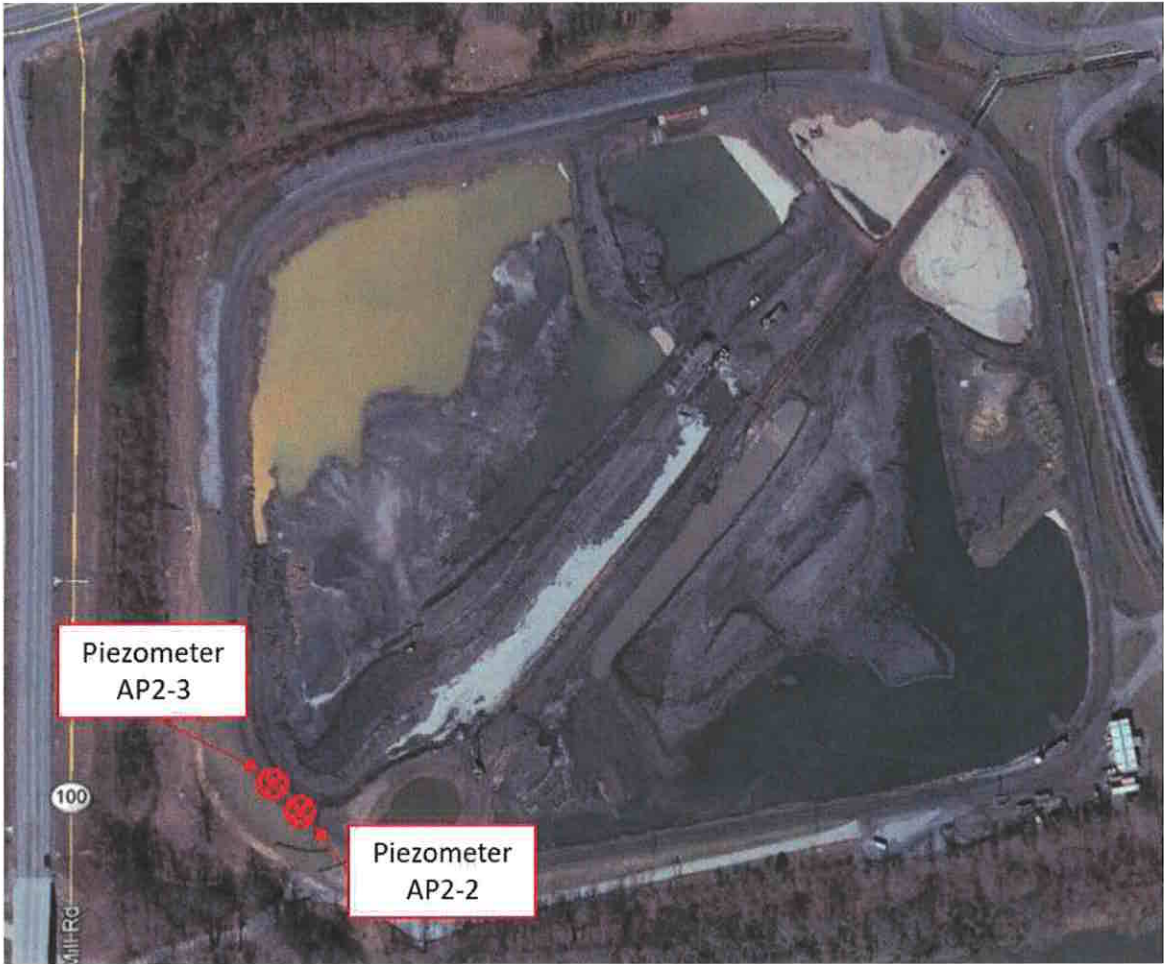

**INSTRUMENTATION PLAN  
PLANT HAMMOND ASH POND 2**

**INSTRUMENTATION READINGS  
PLANT HAMMOND ASH POND 2**

PIEZOMETER NUMBER	MAXIMUM RECORDED READING*
AP2-2	EL 583
AP2-3	EL 571

\*MAXIMUM RECORDED READING SINCE LAST ANNUAL INSPECTION; ROUNDED TO NEAREST FOOT

