


DRAFT  
ATTORNEY CLIENT PRIVILEGED WORK PRODUCT

|                           |   |                                     |                                    |
|---------------------------|---|-------------------------------------|------------------------------------|
| <b>257.83<br/>(b) (2)</b> | <b>REPORT OF ANNUAL INSPECTION OF CCR SURFACE IMPOUNDMENT</b>   |                                     |                                    |
|                           | FACILITY NAME: Plant Wansley Ash Pond   |                                     |                                    |
|                           | OWNER/OPERATOR OF FACILITY: Georgia Power Company   |                                     |                                    |
|                           | INSPECTION DATE: October 1, 2019  |                                     |                                    |
|                           | INSPECTING ENGINEER: Patrick B. Rhodes, PE (GA Reg. # PE024586)   |                                     |                                    |
| (i)                       | ANY CHANGES IN GEOMETRY OF THE IMPOUNDING STRUCTURE SINCE THE PREVIOUS ANNUAL INSPECTION?<br>(IF YES, DESCRIBE):  |                                     | No                                 |
| (ii)                      | LOCATION AND TYPE OF EXISTING INSTRUMENTATION   |                                     | SEE ATTACHED PLAN                  |
| (ii)                      | MAXIMUM RECORDED READING OF EACH INSTRUMENT SINCE PREVIOUS ANNUAL INSPECTION  |                                     | SEE ATTACHED TABLE                 |
|                           | APPROXIMATE MINIMUM, MAXIMUM AND PRESENT DEPTH AND ELEVATION OF THE IMPOUNDED WATER SINCE PREVIOUS ANNUAL INSPECTION  |                                     |                                    |
|                           | MIN. DEPTH: 0 FT (ASH DELTA PRESENT)  | MAX. DEPTH: 92 FT                   | PRESENT DEPTH: Up to 83 FT         |
|                           | MIN. ELEVATION: 783 FT  | MAX. ELEVATION: 792 FT              | PRESENT. ELEVATION: 783 FT         |
| (iii)                     | APPROXIMATE MINIMUM, MAXIMUM AND PRESENT DEPTH AND ELEVATION OF CCR SINCE PREVIOUS ANNUAL INSPECTION.   |                                     |                                    |
|                           | MIN. DEPTH: 1 FT  | MAX. DEPTH: 98 FT                   | PRESENT DEPTH: Up to 98 FT         |
|                           | MIN. ELEVATION: 730 FT  | MAX. ELEVATION: 798 FT              | PRESENT ELEVATION: 798 FT          |
| (iv)                      | APPROXIMATE STORAGE CAPACITY OF IMPOUNDING STRUCTURE AT TIME OF INSPECTION.   | 24,603,333 yd <sup>3</sup>          |                                    |
| (v)                       | APPROXIMATE VOLUME OF IMPOUNDED WATER AND CCR AT TIME OF INSPECTION   | WATER:<br>5,155,800 yd <sup>3</sup> | CCR:<br>14,571,600 yd <sup>3</sup> |
| (vi)                      | ANY APPEARANCE OF AN ACTUAL OR POTENTIAL STRUCTURAL WEAKNESS OF THE CCR UNIT, IN ADDITION TO ANY EXISTING CONDITIONS THAT ARE DISRUPTING OR HAVE THE POTENTIAL TO DISRUPT THE OPERATION AND SAFETY OF THE CCR UNIT AND APPURTENANT STRUCTURES?<br>(IF YES, DESCRIBE): |                                     | No                                 |
| (vii)                     | ANY OTHER CHANGE(S) WHICH MAY HAVE AFFECTED THE STABILITY OR OPERATION SINCE THE PREVIOUS ANNUAL INSPECTION?<br>(IF YES, DESCRIBE):   |                                     | No                                 |

- Cubic yard estimates are derived by qualified personnel from available information.

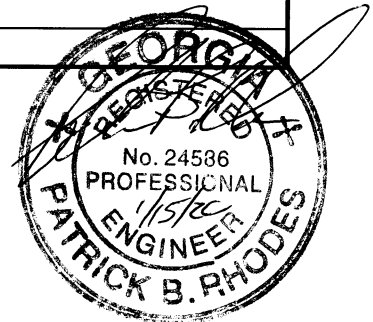

DRAFT  
ATTORNEY CLIENT PRIVILEGED WORK PRODUCT

INSTRUMENTATION READINGS  
PLANT WANSLEY ASH POND


PIEZOMETERS INSTALLED ON SEPARATOR DIKE BETWEEN ASH POND AND STORAGE POND

| PIEZOMETER NUMBER | LOCATION                     | MAXIMUM RECORDED READING* |
|-------------------|------------------------------|---------------------------|
| BB                | N 33° 24.939', W 85° 02.507' | EL 784                    |
| DD                | N 33° 25.063', W 85° 02.656' | EL 787                    |

\*MAXIMUM RECORDED READING SINCE LAST ANNUAL INSPECTION; ROUNDED TO NEAREST FOOT



DRAFT  
ATTORNEY CLIENT PRIVILEGED WORK PRODUCT

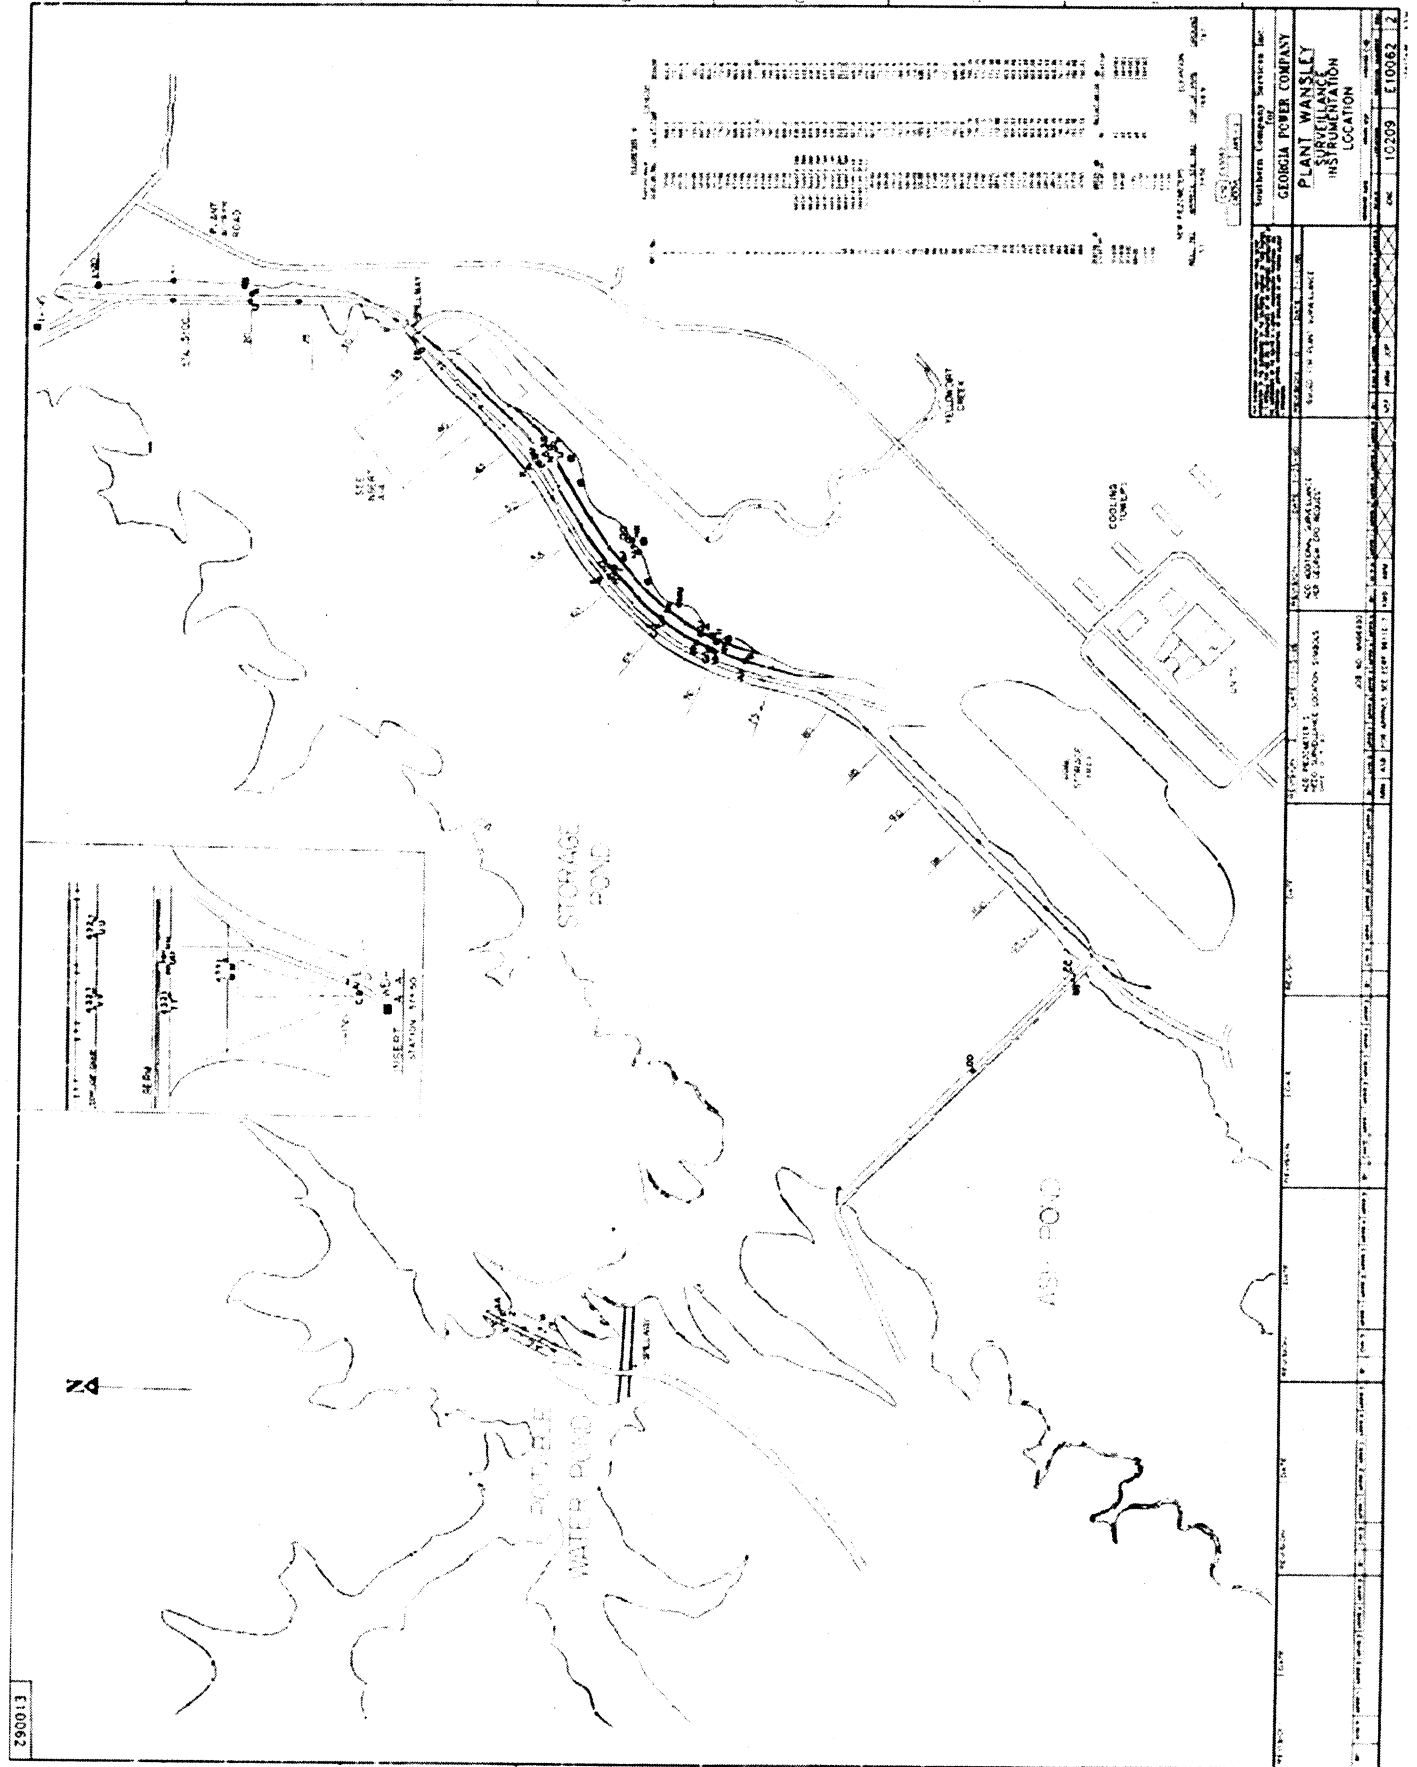

290013

|   |                                    |
|---|------------------------------------|
| Georgia Power Company<br>Plant Wansley<br>Surveillance Instrumentation Location |                                    |
| PROJECT NO. 10209<br>DATE 10/08/12  | SHEET NO. 10209<br>TOTAL SHEETS 12 |