



REPORT

2019 First Annual Groundwater Monitoring & Corrective Action Report

*Georgia Power Company - Plant McDonough-Atkinson
Ash Pond 1*

Submitted to:

Georgia Power Company

Environmental Affairs
241 Ralph McGill Boulevard
Atlanta, Georgia 30308

Submitted by:

Golder Associates Inc.

5170 Peachtree Road Building 100 Suite 300
Atlanta, Georgia, USA 30341

+1 770 496-1893

August 1, 2019

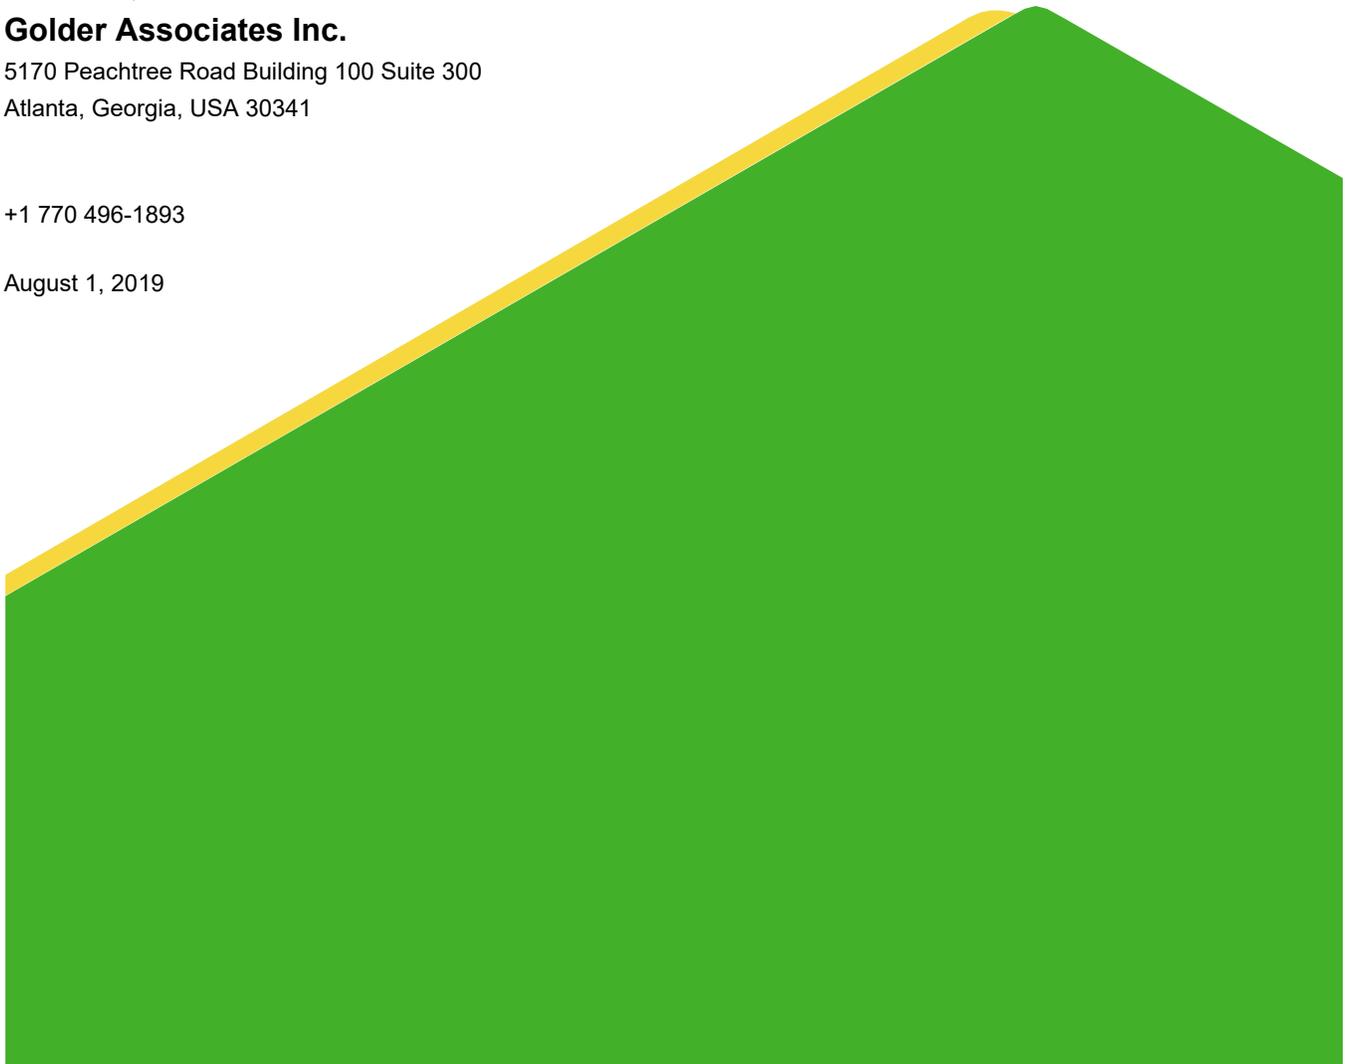


Table of Contents

1.0 INTRODUCTION	1
1.1 Site Description and Background.....	1
1.2 Regional Geology and Hydrogeologic Setting	1
1.3 Groundwater Monitoring Network	2
2.0 GROUNDWATER MONITORING ACTIVITIES	2
2.1 Monitoring Well Installation and Maintenance	2
2.1.1 Background Monitoring	3
2.1.2 Initial Detection Monitoring.....	3
3.0 SAMPLE METHODOLOGY AND ANALYSIS.....	3
3.1 Groundwater Elevation Measurement	3
3.2 Groundwater Gradient and Flow Velocity	3
3.3 Groundwater Sampling	4
3.4 Laboratory Analysis.....	5
3.5 Quality Assurance and Quality Control	5
4.0 STATISTICAL ANALYSIS	6
4.1 Statistical Method.....	6
4.2 Statistical Analysis Results	8
5.0 MONITORING PROGRAM STATUS.....	8
6.0 CONCLUSIONS AND FUTURE ACTIONS	9
7.0 REFERENCES	10

Attachments

TABLES & FIGURES

Table 1A: Monitoring Well Network Summary

Table 1B: Piezometer Summary

Table 2: Groundwater Sampling Event Summary

Table 3: Summary of Groundwater Elevations

Table 4: Horizontal Groundwater Flow Velocity Calculations – March 2019

Table 5: Analytical Data Summary, Ash Pond 1 – March 2019

Figure 1: Site Location Map

Figure 2: Ash Pond 1 (AP-1) Site Plan and Monitoring Well Location Map

Figure 3: Site Potentiometric Map

Appendices

APPENDIX A

Laboratory Analytical Data & Field Data Forms

Tables A-1 through A-12: Analytical Data Summary, Ash Pond 1 – Background Events

Level 2A Laboratory Data Validations

APPENDIX B

Statistical Analyses


Certification

This 2019 First Annual Groundwater Monitoring & Corrective Action Report, Georgia Power Company - Plant McDonough-Atkinson – Ash Pond 1 (AP-1) has been prepared in compliance with the United States Environmental Protection Agency coal combustion residual rule [40 Code of Federal Regulations (CFR) 257 Subpart D] and the Georgia Environmental Protection Division Rules for Solid Waste Management 391-3-4-.10 by a qualified groundwater scientist or engineer with Golder Associates Inc.

GOLDER ASSOCIATES INC.



Timothy I. Richards, PG
Georgia Registered Professional Geologist No. 2240

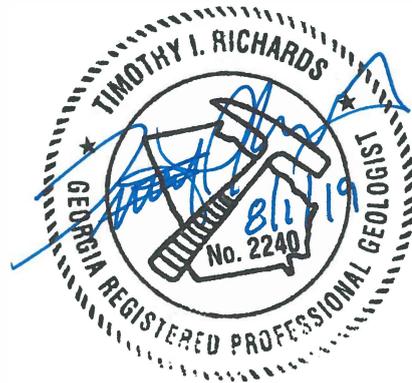

1.0 INTRODUCTION

In accordance with the United States Environmental Protection Agency (USEPA) coal combustion residual (CCR) rule (40 Code of Federal Regulations [CFR] 257 Subpart D) and the Georgia Environmental Protection Division (EPD) Rules for Solid Waste Management 391-3-4-.10, this *2019 First Annual Groundwater Monitoring and Corrective Action Report* was prepared to document groundwater monitoring activities conducted at Georgia Power Company's (GPC's) Plant McDonough Ash Pond 1 (AP-1) and satisfies the requirements of § 257.90(e). To specify groundwater monitoring requirements, GA EPD rule 391-3-4-.10(6)(a) incorporates by reference the USEPA CCR rule. For ease of reference, the US EPA CCR rules are cited within this report.

A notification of intent to initiate closure of the inactive CCR surface impoundment was certified on December 7, 2015 and posted to GPC's website. Therefore, groundwater monitoring and reporting for AP-1 are being completed in accordance with the alternate schedule in § 257.100(e)(5) of the revised USEPA CCR rule (August 5, 2016).

Groundwater monitoring and reporting for Plant McDonough AP-1 are also performed in accordance with the requirements of 40 CFR § 257.90 through 257.91 and § 257.93 through 257.98 of the USEPA CCR rule. This report documents the activities completed to establish the groundwater monitoring program and actions through June 2019.

A permit application package for AP-1 was submitted to Georgia EPD in November 2018 and is currently under review. Groundwater monitoring has been initiated in order to meet USEPA and GA EPD requirements. This report includes the background data and the initial detection monitoring data for AP-1.

1.1 Site Description and Background

Plant McDonough-Atkinson (Plant McDonough), formerly a coal-fired power generating facility, was converted to a natural gas combined-cycle power generating facility in 2011. Located approximately 7 miles northwest of Atlanta in southeast Cobb County (5551 South Cobb Dr SE, Atlanta, GA 30339), the property occupies approximately 390 acres and is bounded on the southeast by the Chattahoochee River. A site location map is included as Figure 1.

Four CCR surface impoundments are located on-site: Ash Pond 1 (AP-1), Ash Pond 2 (AP-2), Ash Pond 3 (AP-3) and Ash Pond 4 (AP-4). This report documents the groundwater monitoring program at AP-1.

1.2 Regional Geology and Hydrogeologic Setting

The following section and subsections include a general description of regional geologic and hydrogeologic characteristics of formations that occur beneath the site.

The site is located in the Piedmont/Blue Ridge geologic province, which contains some of the oldest rock formations in the southeastern United States. These late Precambrian to late Paleozoic rocks have undergone repeated cycles of igneous intrusions and extrusions, metamorphism, folding, faulting, shearing, and silicification. Rock outcrops near the site consist of biotite gneiss, porphyritic gneiss, mica schist, and quartzite.

Residual soils, primarily clayey/sandy silt, sandy silt with clay, and silty sand, occur as a variably-thick blanket overlying bedrock across most of the site. These residual saprolitic soils along with saprolitic transitionally or partially weathered rock, collectively the overburden, range between approximately 9 to 61 feet in thickness across the site, with an average thickness of approximately 38 feet. Saprolitic rock is considered to be

transitionally weathered rock or partially weathered rock (PWR). PWR is defined by Standard Penetration Test (SPT) blow counts that exceed 50 blows/six inches.

A regional, unconfined surficial aquifer system is present at the site, existing within the overburden and weathered and fractured upper bedrock (e.g., approximate first 30 feet), depending on topographic location. Recharge primarily occurs through precipitation and subsequent infiltration. Generally, groundwater flow occurs through intergranular pore spaces in the overburden and is controlled by topography and top of rock variations. However, a relatively higher transmissive zone is interpreted to occur at the base of the overburden, at the interface of weathered bedrock and competent bedrock and is believed to be the primary groundwater flow path. The overburden has an average horizontal hydraulic conductivity of 10^{-4} centimeters per second (cm/s) and is interpreted to flow south-southeast.

A limited and localized bedrock aquifer system also occurs beneath the site. The upper bedrock is fractured and weathered, connected hydraulically with the overburden groundwater, and is considered part of the upper aquifer. The overlying silt/clay-rich overburden may act to retard recharge into the bedrock aquifer system. However, deeper bedrock (i.e., approximately 30 feet into the bedrock) is unweathered with few discontinuities (e.g., fractures) available to store groundwater.

1.3 Groundwater Monitoring Network

Pursuant to § 257.91, a groundwater monitoring system was installed within the uppermost aquifer at AP-1 to monitor groundwater passing the waste boundary. Wells were located to monitor upgradient and downgradient groundwater conditions based on groundwater flow direction. The monitoring well network was certified by a Professional Engineer in Georgia on April 17, 2019, and the certification is maintained in the Operating Record pursuant to § 257.90(f).

The certified monitoring well network for AP-1 consists of three (3) upgradient monitoring wells and seven (7) downgradient monitoring wells (Figure 2). Table 1A includes well construction details for the AP-1 monitoring well network. Additionally, a series of piezometers were installed at AP-1 to measure groundwater elevations. Table 1B includes construction details for these piezometers.

2.0 GROUNDWATER MONITORING ACTIVITIES

In accordance with 40 CFR § 257.90(e), the following section describes monitoring-related activities for sampling performed August 2016 through June 2019. Because this is the first *Annual Groundwater Monitoring and Corrective Action Report*, it describes monitoring well installation and maintenance, background monitoring, and the initial detection monitoring. Groundwater sampling was performed in accordance with 40 CFR § 257.93. Samples were collected from each well in the certified monitoring network. The location of each of these monitoring wells is shown on Figure 2.

Table 2 presents a summary of groundwater sampling events completed for AP-1.

2.1 Monitoring Well Installation and Maintenance

In accordance with § 257.91, a groundwater monitoring system was installed that (1) consists of a sufficient number of wells, (2) installed at appropriate locations and depths to yield groundwater samples from the uppermost aquifer, and (3) meets the performance standards of § 257.91(a). In summary, monitoring well-related activities included the following:

- Installation of a groundwater monitoring system to adequately monitor groundwater conditions at AP-1 and installation of supplemental piezometers to gauge groundwater elevations. Monitoring well and piezometer construction details are presented on Tables 1A and 1B, respectively, and the locations of each are shown on Figures 2 and 3, respectively.
- Visual inspection and documentation of well conditions and performing exterior maintenance on wells as needed.
- Well redevelopment when well yield is reduced or turbid.

2.1.1 Background Monitoring

In accordance with § 257.94(b), a minimum of eight (8) independent samples were collected from the certified well network for AP-1 and analyzed for the constituents listed in Appendix III and IV. Pursuant to § 257.90(e)(3), data reports for the background sampling are included in Appendix A, Analytical Results & Field Data Forms. Tables A-1 through A-12 present a tabulation of the background data for each well.

2.1.2 Initial Detection Monitoring

Following completion of the minimum eight (8) independent sampling events, groundwater samples were collected in March 2019 and analyzed for Appendix III constituents as part of the first detection monitoring event. Data reports for this sampling event are included in Appendix A.

3.0 SAMPLE METHODOLOGY AND ANALYSIS

Sampling events completed during August 2016 through November 2018 for AP-1 represent the background data collection monitoring events. The March 2019 sampling event represents the first detection monitoring event for AP-1.

3.1 Groundwater Elevation Measurement

Prior to each sampling event, groundwater levels were measured at monitoring wells and piezometers. Groundwater elevations recorded during background and detection monitoring events are summarized in Table 3.

Groundwater level data from the uppermost aquifer measured in March 2019 indicate the water table elevation ranges between approximately 838 feet above mean sea level (msl) at upgradient well DGWA-71 to approximately 753 feet msl at downgradient piezometer B-63. The March 2019 groundwater elevation data were used to develop a generalized potentiometric surface map of the uppermost aquifer (Figure 3). The general direction of groundwater flow across AP-1 is west/southwest. The groundwater flow pattern interpreted using the March 2019 elevation data is consistent with previous observations.

3.2 Groundwater Gradient and Flow Velocity

Hydraulic gradient is calculated as the difference in groundwater elevation (in feet) divided by the distance between two piezometers or wells (in feet). March 2019 groundwater elevation data from three piezometer/well pairings; B-29/DGWC-68A, B-28/DWGC-37, and B-50/DWGC-39, located along the groundwater flow path and perpendicular to the potentiometric contours were used to calculate hydraulic gradients for AP-1. The hydraulic gradients for these pairings are 0.042 feet/feet (ft/ft), 0.023 ft/ft, and 0.021 ft/ft, respectively. An overall average hydraulic gradient for AP-1 derived using these individual calculated gradients is 0.029 ft/ft.

Average groundwater flow velocities at the site were calculated using hydraulic gradient data, hydraulic conductivity data generated from slug testing results, and an estimated effective porosity of the screened portion of the uppermost aquifer. Based on slug test data, the average hydraulic conductivity for the uppermost aquifer is 5.0×10^{-4} cm/s; 8.4×10^{-4} cm/s in the overburden and 1.6×10^{-4} cm/s in the upper bedrock, respectively. Assumed effective porosity of 20 percent for overburden was used based on the default values for effective porosity recommended by USEPA for a silty sand-type soil (USEPA, 1996). Assumed effective porosity of 9 percent was used for bedrock (Daniel and Dahlen, 2002; Dowd and Marshall, 1995). The hydraulic gradient was calculated between well pairs as discussed above and shown on Table 4.

Horizontal flow velocity was calculated using the commonly used derivative of Darcy's Law:

$$V = \frac{K * i}{n_e} \quad \text{Where:}$$

$V =$ Groundwater flow velocity $\left(\frac{\text{feet}}{\text{day}}\right)$

$K =$ Average hydraulic conductivity of the aquifer $\left(\frac{\text{feet}}{\text{day}}\right)$

$i =$ Horizontal hydraulic gradient $\left(\frac{\text{feet}}{\text{feet}}\right)$

$n_e =$ Effective porosity

Using this equation, groundwater flow velocities were calculated for AP-1 using March 2019 groundwater elevation data. Table 4 presents the velocities calculated using groundwater elevation data from the March 2019 sampling event.

Calculated (horizontal) flow velocities ranged from approximately 90 feet per year (ft/yr) to 183 ft/yr in the overburden and 38 ft/yr to 78 ft/yr in the upper bedrock. These estimated flow velocities are consistent with historical data observed at AP-1 and are also generally consistent with other published velocities for regolith-upper bedrock aquifers of the Piedmont (Heath, R.C., 1982).

3.3 Groundwater Sampling

Groundwater samples were collected in accordance with § 257.93(a) and using USEPA Region 4 Field Quality and Technical Procedures as a guide (USEPA, 2001). Monitoring wells were purged and sampled using low-flow sampling procedures. Non-dedicated, low-flow pneumatic bladder pumps and peristaltic pumps were used to purge and sample the wells. Field equipment was decontaminated prior to use and between wells using USEPA Science and Ecosystem Support Division (SESD) Operating Procedure for Field Equipment Cleaning and Decontamination as a guide (USEPA, 2015). A SmarTroll® (In-Situ® field instrument) was used to monitor and record field water quality parameters [temperature, specific conductance, dissolved oxygen (DO), pH, and oxidation-reduction potential (ORP)] during purging. Turbidity was monitored using a LaMotte 2020we turbidimeter. Groundwater samples were collected when the following stabilization criteria were met for a minimum of three consecutive readings:

- ± 0.1 standard units for pH
- $\pm 5\%$ for specific conductance
- $\pm 10\%$ for DO where $DO > 0.5$ mg/L; if $DO < 0.5$ mg/L, no stabilization criteria apply

- ≤10 Nephelometric Turbidity Units (NTUs) for turbidity

Any deviation from stabilization criteria, if applicable, is identified on field sampling forms. Where sample turbidity was greater than 5 NTU and all other stabilization criteria were met, samplers continued purging for up to 3 additional hours in order to reduce the turbidity to 5 NTU or less. If turbidity remained above 5 NTU, but was less than 10 NTU, and all other parameters were stabilized, the well was sampled. Where turbidity remained above 10 NTU, an unfiltered sample was collected followed by a filtered sample that passed through an in-line 0.45-micron filtered attached to the discharge (sample collection) tube. The unfiltered sample data are used for compliance monitoring and in the statistical analysis database. Filtered sample data are used to assess the impacts of turbidity on groundwater quality. Additional details regarding filtered samples are recorded on the field information form and filtered samples are clearly identified as “filtered” on the laboratory reports.

Following well stabilization, unfiltered samples were collected directly into appropriately preserved laboratory supplied sample containers, placed in ice-packed coolers, and submitted to the laboratory following standard chain-of-custody protocol. Field information forms, generated directly from the SmarTroll®, and chain-of-custody records are included in Appendix A.

3.4 Laboratory Analysis

Groundwater samples were collected for Appendix III and Appendix IV parameters during background monitoring. Groundwater samples collected in March 2019 for detection monitoring were analyzed for Appendix III monitoring parameters only. Analytical methods used for groundwater monitoring parameters can be found in the analytical data reports in Appendix A.

Laboratory analyses for all events were performed by Pace Analytical Services, LLC (Pace) in Norcross, Georgia. Pace is accredited by the National Environmental Laboratory Accreditation Program (NELAP) and maintains NELAP certification for all parameters analyzed for this project. Groundwater data, chain-of-custody records, and NELAP certifications for the monitoring events are presented in Appendix A.

3.5 Quality Assurance and Quality Control

During each sampling event, quality assurance/quality control (QA/QC) samples were collected at a rate of one sample per every 10 samples. QA/QC samples included equipment blanks (where non-dedicated sampling equipment is used), field blanks, and duplicate samples. QA/QC sample data was evaluated during data validation (as described below) and is included in Appendix A.

Groundwater quality data in this report was independently validated in accordance with USEPA guidance (USEPA, 2011) and the analytical methods. Data validation generally consisted of reviewing sample integrity, holding times, laboratory method blanks, laboratory control samples, matrix spikes/matrix spike duplicate recoveries and relative percent differences (RPDs), post digestion spikes, laboratory and field duplicate RPDs, field and equipment blanks, and reporting limits. Where appropriate, validation qualifiers and flags were applied to the data using USEPA procedures as guidance (USEPA, 2017). Flagged data are identified in the statistical analysis reports in Appendix B and described in the following section.

A value followed by a "J" flag in tables and laboratory reports indicate that the value is an estimated analyte concentration detected between the method detection limit (MDL) and the laboratory reporting limit (RL). The estimated value is positively identified but is below the lowest level that can be reliably achieved within specified

limits of precision and accuracy under routine laboratory operating conditions. “J” flagged data are used to establish background statistical limits but are not used when performing statistical analyses.

4.0 STATISTICAL ANALYSIS

Statistical analysis of Appendix III groundwater monitoring data was performed pursuant to 40 CFR § 257.93 and following the PE-certified statistical method for AP-1 (Golder, 2019; Groundwater Stats Consulting, 2019).

4.1 Statistical Method

The selected statistical method for AP-1 was developed in accordance with 40 CFR § 257.93(f), using methodology presented in Statistical Analysis of Groundwater Data at RCRA Facilities, Unified Guidance, March 2009, USEPA 530/R-09-007 (Unified Guidance; USEPA, 2009). The Sanitas™ groundwater statistical software was used to perform statistical analyses. Sanitas™ is a decision-support software package that incorporates the statistical tests required of Subtitle C and D facilities by USEPA regulations and guidance as recommended in the USEPA Unified Guidance (2009) document.

The statistical test used to evaluate the groundwater monitoring data was interwell prediction limits with an optional 1-of-2 verification resampling plan for Appendix III parameters. Using this method, upgradient well data were pooled to establish a background prediction limit (PL). An exceedance occurs when a parameter of a downgradient well exceeds the PL. If data from a sampling event initially exceed the PL, resampling is allowed to verify the result. In 1-of-2 resampling, one independent resample is allowed within 90 days to determine whether the initial exceedance is verified. If the result of the resample exceeds the PL, the initial exceedance is verified and a statistically significant increase (SSI) is determined. If the initial finding is not verified by resampling, the resampled value will replace the initial finding and there is no SSI. If resampling is not performed, the initial exceedance is a confirmed exceedance. Data from the March 2019 detection monitoring event are compared to the statistical prediction limit to determine whether any concentrations exceed background levels.

The Sen’s Slope/Mann Kendall trend test was used to statically evaluate concentration levels over time and determine whether concentrations are increasing, decreasing, or stabilizing.

The following table provides a summary of the statistical methodology used at AP-1 for the first detection monitoring event conducted in March 2019 and will be used for any future routine detection monitoring.

PLANT MCDONOUGH AP-1 STATISTICAL METHOD SUMMARY		
Monitoring Well Network	Upgradient Wells	DGWA-53, DGWA-70A, DGWA-71
	Downgradient Wells	DGWC-37, DGWC-38, DGWC-39, DGWC-40, DGWC-67, DGWC-68A, DGWC-69
CCR Monitoring Parameters	Appendix III (Detection Monitoring)	Boron, Calcium, Chloride, Fluoride, pH, Sulfate, TDS
	Appendix IV (Assessment Monitoring)	Antimony, Arsenic, Barium, Beryllium, Cadmium, Chromium, Cobalt, Fluoride, Lead, Lithium, Mercury, Molybdenum, Selenium, Thallium, Radium (226 + 228)
Statistical Methodology	Data Screening on Proposed Background	Evaluate outliers, trends, and seasonality when sufficient data are available.
	Statistical Limits	Interwell statistical limits will be applied on a constituent basis, depending on the appropriateness of the method as determined by the Analysis of Variance.
	Prediction Limits	Parametric when data follow a normal or transformed normal distribution and when less than 50% non-detects, utilizing Kaplan Meier non-detect adjustment when applicable; nonparametric when data sets contain greater than 50% non-detects or when data are not normally or transformed-normally distributed.
	Confidence Intervals	Used in Assessment and Corrective Action monitoring.
	No Statistical Testing	Statistical testing is not required for parameters with 100% non-detects.
	Verification Resample Plan (Optional)	1-of-2 with minimum of 8 samples per well for interwell testing. <ul style="list-style-type: none"> ▪ Initial statistical exceedance warrants independent resampling within 90 days. ▪ If resample passes, well/parameter is not a confirmed statistically significant increase (SSI). ▪ If resample exceeds, well/parameter has a confirmed SSI. ▪ If no resample is collected, the original result is deemed verified.

The following guidance is also applicable to the statistical analytical method:

- Statistical analyses are not performed on the analytes containing 100% non-detects (USPEA Unified Guidance, 2009, Chapter 6).
- When data contain less than or equal to 15% no-detects in background, simple substitution of one-half the RL is utilized in the statistical analysis. The RL utilized for non-detects is the practical quantitation limit (PQL) as reported by the laboratory.

- When data contain between 15-50% non-detects, a non-detect adjustment such as the Kaplan-Meier or Regression on Order Statistics (ROS) method for adjustment of the mean and standard deviation will be used prior to constructing a parametric prediction limit.
- Nonparametric prediction limits are used on data containing greater than 50% non-detects.

4.2 Statistical Analysis Results

Verification resampling to confirm initial SSIs was not performed; therefore, initial SSIs are considered verified. The statistical results of the March 2019 monitoring event are included in Appendix B.

Based on the statistical results presented in Appendix B, the following summarizes verified SSIs from the March 2019 sampling event:

AP-1 Inter-Well Prediction Limit Statistically Significant Increase Summary	
Appendix III Parameter	AP-1 Monitoring Wells
Boron	DGWC-37, DGWC-38, DGWC-39, DGWC-40, DGWC-67, DGWC-68A
Calcium	DGWC-37, DGWC-38, DGWC-39, DGWC-40, DGWC-67, DGWC-68A
Chloride	DGWC-37, DGWC-38, DGWC-39, DGWC-40, DGWC-67, DGWC-68A, DGWC-69
Fluoride	No exceedances
pH	DGWC-40, DGWC-68A
Sulfate	DGWC-37, DGWC-38, DGWC-39, DGWC-40, DGWC-67, DGWC-68A
Total Dissolved Solids	DGWC-38, DGWC-39

Pursuant to 40 CFR § 257.94(e), within 90 days from determining an SSI, GPC will either (1) prepare a demonstration that a source other than the AP-1 was the cause, or (2) implement assessment monitoring per § 257.95.

Pursuant to § 257.95, Appendix IV groundwater quality data is statistically analyzed and compared to groundwater protection standards if assessment monitoring is implemented. To date only detection monitoring per § 257.94 has been completed for the monitoring network at AP-1. As of June 30, 2019, assessment monitoring has not been implemented, and therefore, statistical analysis of Appendix IV data has not been performed.

5.0 MONITORING PROGRAM STATUS

Plant McDonough AP-1 is in detection monitoring. Table 2 presents the status of each well within the certified monitoring network for AP-1. SSIs of Appendix III parameters have been identified. GPC will address the reported SSIs in accordance with the requirements, and options, of 40 CFR § 257.94(e)(1-3) and (f).

6.0 CONCLUSIONS AND FUTURE ACTIONS

This 2019 First Annual Groundwater Monitoring and Corrective Action Report, Georgia Power Plant McDonough-Atkinson - Ash Pond 1 (AP-1) was prepared to fulfill the requirements of USEPA CCR rule 40 CFR 257 Subpart D and Georgia EPD rule 391-3-4-.10.

Statistical evaluations of the groundwater monitoring data for AP-1 identified SSIs of Appendix III groundwater monitoring parameters. In accordance with 40 CFR § 257.94(e)(1-2), GPC will prepare an alternate source demonstration or initiate an assessment monitoring program within 90 days.

The next sampling event is scheduled for August 2019.

7.0 REFERENCES

- Daniel, C. C., Dahlen, P. R., 2002, *Preliminary Hydrogeologic Assessment and Study Plan for a Regional Ground-Water Resource Investigation of the Blue Ridge and Piedmont Provinces of North Carolina*, US Geological Survey, Water-Resources Investigations Report 02-4105, Raleigh, NC.
- Dowd, J. F., Marshall, J. E., 1995, *Recharge to High Yield Wells in the Piedmont*.
- Golder, 2019, *Statistical Analysis Method Certification, 40 CFR §257.93(f), Ash Pond 1 (AP-1), Plant McDonough, Georgia Power Company*, April 2019.
- Groundwater Stats Consulting, 2019, *Georgia Power Company's Plant McDonough Ash Pond 1 (AP-1) Statistical Analysis Plan*, April 2019.
- Heath, R.C., 1982, Basic Ground-Water Hydrology. Water Supply Paper 2220. U.S. Geological Survey, Federal Center, Box 25425, Denver, Colorado.
- United States Environmental Protection Agency (USEPA), 1986, *RCRA Groundwater Monitoring Technical Enforcement Guidance Document*.
- USEPA, 1996, *Soil Guidance Manual*.
- USEPA, 2001, *Environmental Investigations Standard Operating Procedures and Quality Assurance Manual*, November 2001.
- USEPA, 2009, *Statistical Analysis of Groundwater Monitoring Data at RCRA Facilities, Unified Guidance*. Office of Resource Conservation and Recovery – Program Implementation and Information Division, March 2009.
- USEPA, 2011, *Data Validation Standard Operating Procedures*, Science and Ecosystem Support Division. Revision IV, Athens, GA, September 2011.
- USEPA, 2015, *Field Equipment Cleaning and Decontamination*, Region 4 USEPA Science and Ecosystem Support Division, Revision III, Athens, GA, December 2015.
- USEPA, 2017, *National Functional Guidelines for Inorganic Superfund Methods Data Review*, Office of Superfund Remediation and Technology Innovation. OLEM 9355.0-135 [EPA-540-R-2017-001]. Washington. DC, January 2017.

Tables & Figures

**TABLE 1A
MONITORING WELL NETWORK SUMMARY**

**Georgia Power Company - Plant McDonough
Atlanta, GA**

Well-ID	Former Well-ID	Boring ID	Hydraulic Location	Geologic Unit Screened	Northing	Easting	Top of Casing Elevation (feet msl)	Ground Surface Elevation (feet msl)	Total Depth (feet bgs)	Top of Screen Elevation (feet msl)	Bottom of Screen Elevation (feet msl)	Date of Installation
ASH POND 1 (AP-1) MONITORING WELL NETWORK												
DGWA-53	B-53	B-53	Upgradient	Upper Bedrock	1393475.82	2201668.95	850.74	847.24	28.9	830	820	9/24/2016
DGWA-70	B-70	B-70	Upgradient	Overburden	1390167.51	2201107.31	ABANDONED					
DGWA-70A	B-70A	B-70A	Upgradient	Overburden	1390481.13	2200590.67	808.60	805.45	58.9	757	747	5/10/2017
DGWA-71	B-71	B-71	Upgradient	Overburden	1393965.35	2201713.63	863.95	861.05	43.4	828	818	2/28/2017
DGWC-37	B-37	B-37	Downgradient	Overburden	1390483.94	2200919.39	766.19	763.6	39.7	734	724	11/28/2012
DGWC-38	B-38	B-38	Downgradient	Overburden	1390364.53	2201147.65	757.44	754.7	25.0	740	730	11/29/2012
DGWC-39	B-39	B-39	Downgradient	Overburden	1390303.39	2201538.45	759.67	756.9	21.2	746	736	11/6/2012
DGWC-40	B-40	B-40	Downgradient	Overburden	1390625.63	2201826.76	779.07	775.5	34.9	751	741	11/5/2012
DGWC-67	B-67	B-67	Downgradient	Overburden	1390954.46	2200828.90	766.76	766.34	56.3	720	710	3/14/2017
DGWC-68A	B-68A	B-68A	Downgradient	Overburden	1391301.86	2200732.41	765.61	765.00	29.4	746	736	4/20/2017
DGWC-69	B-69	B-69	Downgradient	Overburden	1391584.72	2200656.14	763.82	763.93	24.3	750	740	3/16/2017

Notes:

1. bgs = below ground surface; msl = mean sea level
2. DGWA-70 is not used as monitoring well due to well replacement and modifications to the proposed well network. DGWA-70 was abandoned 5/1/2017.
3. Coordinate system: NAD 1983 State Plane Georgia West (U.S. feet)

**TABLE 1B
PIEZOMETER SUMMARY**

**Georgia Power Company - Plant McDonough
Atlanta, GA**

Well-ID	Former Well-ID	Boring ID	Geologic Unit Screened	Northing	Easting	Top of Casing Elevation (feet msl)	Ground Surface Elevation (feet msl)	Total Depth (feet bgs)	Top of Screen Elevation (feet msl)	Bottom of Screen Elevation (feet msl)	Date of Installation
PIEZOMETER NETWORK											
B-3	B-3	B-3	Overburden/ Upper Bedrock	1394043.54	2202411.14	837.82	834.5	37.0	808	798	10/3/2012
B-6	B-6	B-6	Overburden	1394422.57	2203265.55	789.49	785.9	35.4	761	751	10/9/2012
B-7	B-7	B-7	Overburden	1394373.41	2203595.17	809.24	805.4	25.2	791	781	10/9/2012
B-16	B-16	B-16	Overburden	1392596.21	2203313.21	826.50	823.6	43.7	790	780	12/19/2012
B-18	B-18	B-18	Overburden	1392521.15	2202874.99	826.54	823.9	32.6	801	791	1/10/2013
B-24	B-24	B-24	Upper Bedrock	1392480.23	2201451.51	822.27	818.7	79.1	750	740	10/24/2012
B-25	B-25	B-25	Upper Bedrock	1392813.23	2201504.19	836.62	833.1	54.8	789	779	10/24/2012
B-26	DGWA-26	B-26	Upper Bedrock	1393106.18	2201551.86	853.67	850.2	49.3	811	801	10/23/2012
B-27	DGWA-27	B-27	Upper Bedrock	1393423.51	2201744.77	ABANDONED					
B-28	B-28	B-28	Overburden/ Upper Bedrock	1391970.42	2201677.59	816.10	812.8	69.4	754	744	10/31/2012
B-29	B-29	B-29	Overburden	1391891.93	2201420.25	816.45	813.5	54.4	769	759	1/11/2013
B-31	B-31	B-31	Upper Bedrock	1392035.97	2200926.82	797.42	794.8	45.1	760	750	1/22/2013
B-41	B-41	B-41	Overburden	1390922.38	2201749.84	795.22	792.4	60.0	743	733	11/14/2012
B-50	B-50	B-50	Overburden	1391656.94	2201839.72	809.78	806.28	35.2	781	771	6/24/2016
B-51	B-51	B-51	Overburden	1390501.61	2200904.19	765.93	763.00	66.0	708	698	6/27/2016
B-52	B-52	B-52	Overburden	1392309.40	2201314.05	823.22	820.07	50.0	781	771	9/28/2016
B-54	B-54	B-54	Overburden/ Upper Bedrock	1394424.75	2203140.27	785.59	782.09	34.2	758	748	9/26/2016
B-55	B-55	B-55	Overburden	1394143.23	2204146.61	825.11	821.96	52.0	781	771	9/22/2016
B-56	B-56	B-56	Overburden	1393958.64	2204186.27	823.70	820.55	45.0	786	776	10/3/2016
B-57	B-57	B-57	Upper Bedrock	1391397.46	2202735.64	789.22	785.76	50.5	746	736	9/24/2016
B-58	B-58	B-58	Overburden	1391126.84	2202425.23	788.20	784.90	45.0	750	740	9/23/2016
B-59	B-59	B-59	Overburden/ Upper Bedrock	1394349.80	2203000.17	788.16	785.30	30.2	765	755	9/23/2016
B-60	B-60	B-60	Overburden	1391101.88	2202880.57	782.12	778.87	49.8	740	730	9/29/2016
B-61	B-61	B-61	Overburden	1390958.73	2202504.81	782.03	778.58	52.4	737	727	9/29/2016
B-62	B-62	B-62	Upper Bedrock	1389828.91	2201810.02	763.34	759.94	39.9	730	720	10/4/2016
B-63	B-63	B-63	Overburden	1390999.47	2202976.11	777.15	777.45	46.0	742	732	10/6/2016
B-64	B-64	B-64	Overburden	1394383.12	2203029.71	786.02	785.85	30.4	766	756	11/2/2016
B-65	B-65	B-65	Overburden/ Upper Bedrock	1394382.64	2204049.66	822.02	822.27	45.4	788	778	11/15/2016
B-66	B-66	B-66	Overburden	1393860.16	2204276.73	815.96	813.06	55.3	768	758	11/16/2016
B-68	DGWC-68	B-68	Overburden	1391299.56	2200714.04	758.73	758.56	18.0	751	741	3/16/2017

Notes:

1. bgs = below ground surface; msl = mean sea level
2. B-26 and B-68 are not used as monitoring wells due to well replacement, proximity to closure activities, or modifications to the proposed well network.
3. B-27 was abandoned 4/4/2017.
4. Coordinate System: NAD 1983 State Plane Georgia West (U.S. feet)

TABLE 2
GROUNDWATER SAMPLING EVENT SUMMARY

Georgia Power Company - Plant McDonough
Atlanta, GA

Well ID	Hydraulic Location	Summary of Sampling Events												Status of Monitoring Well	
		August - September 2016	December 2016	March - April 2017	May 2017	June 2017	July 2017	August 2017	October - November 2017	February - March 2018	July 2018	November 2018	March 2019		
Purpose of Sampling Event		Background	Background	Background	Background	Background	Background	Background	Background	Background	Background	Background	Background	Detection	
ASH POND 1 (AP-1) MONITORING WELL NETWORK															
DGWA-53	Upgradient			BG01	BG02	BG03	BG04		BG05	BG06	BG07	BG08	D01	Detection	
DGWA-70A	Upgradient				BG01	BG02	BG03	BG04	BG05	BG06	BG07	BG08	D01	Detection	
DGWA-71	Upgradient			BG01	BG02	BG03	BG04		BG05	BG06	BG07	BG08	D01	Detection	
DGWC-37	Downgradient	BG01	BG02	BG03			BG04		BG05	BG06	BG07	BG08	D01	Detection	
DGWC-38	Downgradient	BG01	BG02	BG03			BG04		BG05	BG06	BG07	BG08	D01	Detection	
DGWC-39	Downgradient	BG01	BG02	BG03			BG04		BG05	BG06	BG07	BG08	D01	Detection	
DGWC-40	Downgradient	BG01	BG02	BG03			BG04		BG05	BG06	BG07	BG08	D01	Detection	
DGWC-67	Downgradient			BG01	BG02	BG03	BG04		BG05	BG06	BG07	BG08	D01	Detection	
DGWC-68A	Downgradient				BG01	BG02	BG03	BG04	BG05	BG06	BG07	BG08	D01	Detection	
DGWC-69	Downgradient			BG01	BG02	BG03	BG04		BG05	BG06	BG07	BG08	D01	Detection	

Notes:

1. BG## = Background Event Number
2. D## = Detection Event Number

**TABLE 3
SUMMARY OF GROUNDWATER ELEVATIONS**

**Georgia Power Company - Plant McDonough
Atlanta, GA**

Well ID	Top of Casing Elevation (feet/msl)	Groundwater Elevation (feet msl)								
		8/29/2016	12/5/2016	3/27/2017	7/10/2017	10/23/2017	2/26/2018	7/9/2018	11/5/2018	3/11/2019
ASH POND 1 (AP-1) MONITORING WELLS										
DGWA-53	850.74	NM	840.16	841.21	844.59	840.73	842.64	842.00	828.02	831.04
DGWA-70	778.20	NM	NM	752.10	ABANDONED					
DGWA-70A	808.60	NM	NM	NM	767.37	766.93	767.76	768.62	767.73	771.92
DGWA-71	863.95	NM	NM	834.8	835.84	835.32	835.56	835.70	834.78	837.74
DGWC-37	766.19	753.01	753.21	752.87	753.27	753.43	753.26	752.83	752.66	753.60
DGWC-38	757.44	751.24	751.24	750.99	751.00	751.60	751.09	750.74	750.60	753.11
DGWC-39	759.67	751.82	752.52	752.67	752.78	752.33	752.78	752.55	752.06	754.92
DGWC-40	779.07	760.98	760.74	761.80	762.95	760.69	762.45	762.90	761.06	764.26
DGWC-67	766.76	NM	NM	758.36	758.37	758.09	757.93	757.56	757.30	757.86
DGWC-68A	765.61	NM	NM	NM	756.30	756.46	755.73	755.81	755.69	756.02
DGWC-69	763.82	NM	NM	758.22	758.15	758.48	758.50	758.03	757.99	758.57
PIEZOMETERS										
B-3	837.82	811.85	810.09	811.86	811.36	808.91	807.28	806.10	804.82	805.58
B-6	789.49	787.40	786.35	786.98	787.04	786.72	786.18	785.43	785.19	785.89
B-7	809.24	799.54	797.50	796.76	797.04	795.51	792.92	791.26	791.04	792.20
B-16	826.50	802.60	802.25	802.61	804.41	800.02	800.71	799.59	798.25	800.45
B-18	826.54	809.19	808.33	808.53	811.84	810.19	810.71	809.21	808.21	810.41
B-24	822.27	806.65	804.87	807.18	808.10	804.72	806.23	805.47	803.00	809.86
B-25	836.62	821.63	822.51	823.42	823.85	822.68	824.06	822.50	821.06	824.12
B-26	853.67	829.13	827.14	829.97	831.02	827.90	829.45	828.59	826.26	833.30
B-27	850.29	830.16	828.94	836.76	ABANDONED					
B-28	816.10	793.30	792.40	792.42	792.12	789.56	791.14	790.07	787.90	791.89
B-29	816.45	790.87	790.42	792.15	792.30	789.57	791.80	790.69	788.83	793.96
B-31	797.42	764.17	764.31	764.68	766.38	763.81	765.11	765.23	763.62	766.88
B-41	795.22	774.74	773.24	772.28	772.46	770.97	771.32	771.01	770.28	771.76
B-50	809.78	783.18	781.78	781.93	782.49	781.16	782.32	782.04	781.00	783.83
B-51	765.93	753.69	753.90	753.57	753.89	754.08	753.86	753.44	753.26	754.15
B-52	823.22	NM	796.52	799.44	800.17	797.09	798.56	798.66	795.73	803.49
B-54	785.59	NM	781.24	780.81	780.91	781.23	780.67	780.09	780.28	780.44
B-55	825.11	NM	812.13	810.46	815.77	807.47	805.77	804.55	803.08	805.21
B-56	823.70	NM	805.57	804.87	810.59	802.42	799.29	797.00	795.42	798.40
B-57	789.22	NM	766.42	767.55	769.46	768.51	768.52	770.71	768.67	773.56
B-58	788.20	NM	764.20	765.36	767.61	766.40	766.63	768.59	766.37	771.75
B-59	788.16	NM	782.84	782.46	782.58	782.62	782.22	781.46	781.51	781.83
B-60	782.12	NM	748.58	748.44	749.87	749.49	749.48	751.13	749.78	755.46
B-61	782.03	NM	758.46	759.12	761.86	760.30	760.82	762.98	760.50	766.59
B-62	763.34	NM	745.89	745.33	745.89	751.03	749.15	748.04	745.82	754.34
B-63	777.15	NM	745.02	745.46	746.75	746.75	746.95	747.38	746.55	753.35
B-64	786.02	NM	781.29	781.40	781.50	781.67	781.20	780.54	780.67	781.01
B-65	822.02	NM	811.62	811.38	814.82	811.24	806.45	805.56	803.98	807.77
B-66	815.96	NM	801.50	799.86	804.66	799.91	798.36	797.80	796.43	798.14
B-68	758.73	NM	NM	755.45	NM	NM	NM	NM	NM	NM

Notes:

1. msl = mean sea level
2. NM = Not Mesured
3. DGWA-70, B-27, and B-68 are not used due to well replacement, proximity to closure activities, or modifications to the proposed well network.

TABLE 4
HORIZONTAL GROUNDWATER FLOW VELOCITY CALCULATIONS - MARCH 2019

Georgia Power Company - Plant McDonough
Atlanta, GA

Flow Paths	Groundwater Elevation (feet msl)	Δh (feet) ¹	Δl (feet) ²	Hydraulic Gradient ($\Delta h/\Delta l$) ³	Average Hydraulic Conductivity, K (centimeter per second) ⁵		Assumed Effective Porosity (n_e) ⁶		Average Linear Groundwater Velocity			
					Overburden	Upper Bedrock	Overburden	Upper Bedrock	(feet per day) ⁴		(feet per year) ⁴	
									Overburden	Upper Bedrock	Overburden	Upper Bedrock
ASH POND 1 (AP-1)												
B-29/DGWC-68A	793.96	37.94	900	0.042	0.00084	0.00016	0.2	0.09	0.50	0.21	183	78
	756.02											
B-28/DGWC-37	791.89	38.29	1700	0.023	0.00084	0.00016	0.2	0.09	0.27	0.11	98	41
	753.60											
B-50/DGWC-39	783.83	28.91	1400	0.021	0.00084	0.00016	0.2	0.09	0.25	0.10	90	38
	754.92											

Notes:


1. Δh = Change in groundwater elevation
2. Δl = Distance along flow path
3. $I = \Delta h / \Delta l$
4. Velocity = $(I * K)/n_e$
5. Hydraulic conductivity based on historic aquifer performance tests
6. Assumed effective porosities for overburden was based on the default values recommended by USEPA for a silty sand-type soil (1996). Assumed effective porosity for upper bedrock was derived from Daniel and Dahlen (2002) and Dowd and Marshall (1995).

TABLE 5
ANALYTICAL DATA SUMMARY
Ash Pond 1 - March 2019
Georgia Power Company - Plant McDonough
Atlanta, GA

Substance	MCL/ (SMCL)	Well ID										
		DGWA-53	DGWA-70A	DGWA-71	DGWC-37	DGWC-38	DGWC-39	DGWC-40	DGWC-67	DGWC-68A	DGWC-69	
		3/13/2019	3/12/2019	3/12/2019	3/13/2019	3/13/2019	3/13/2019	3/13/2019	3/13/2019	3/13/2019	3/13/2019	
APPENDIX III	Boron	N/R	0.080	ND (0.0073 J)	ND (0.0068 J)	1.8	2.9	3.4	0.80	3.5	1.9	ND (0.028 J)
	Calcium	N/R	26.7	5.1	5.5	54.8	85.3	96.3	41.0	41.2	47.5	7.6
	Chloride	(250)	3.6	2.5	3.3	6.9	9.1	8.2	19.7	6.8	4.6	6.2
	Fluoride	4	ND (0.13 J)	ND (0.039 J)	ND	ND (0.080 J)	ND (0.084 J)	ND (0.085 J)	ND (0.15 J)	ND (0.070 J)	ND (0.12 J)	ND (0.086 J)
	Sulfate	(250)	23.7	ND (0.35 J)	7.0	92.2	300	265	445	233	44.1	8.4
	TDS	(500)	201	43.0	74.0	286	487	526	351	278	267	95.0
APPENDIX IV	Antimony	0.006	Appendix IV constituents not analyzed									
	Arsenic	0.01										
	Barium	2										
	Beryllium	0.004										
	Cadmium	0.005										
	Chromium	0.1										
	Cobalt	N/R										
	Lead	0.015										
	Lithium	N/R										
	Mercury	0.002										
	Molybdenum	N/R										
	Radium	5										
	Selenium	0.05										
Thallium	0.002											


Notes:

1. MCL indicates Environmental Protection Agency (EPA) and Georgia Environmental Protection Division (EPD) maximum contaminant level.
2. (SMCL) indicates a secondary MCL that is established by EPA as a general guideline only (not enforced).
3. Results for substances are reported in milligrams per liter (mg/L).
4. ND (Not Detected) indicates the substance was not detected above the analytical method detection limit (MDL).
5. ND (value J) indicates the substance was detected at such low levels that the precision of the laboratory instruments could not produce a reliable value. Therefore, the value displayed (value J) is qualified by the laboratory as an estimated number.
6. N/R indicates a substance does not have an MCL or SMCL, but will be further evaluated statistically at the conclusion of all the background sampling events, as required by EPA's CCR rule.
7. TDS indicates total dissolved solids.
8. Appendix III = indicator parameters evaluated during Detection Monitoring; Appendix IV = parameters evaluated during Assessment Monitoring.

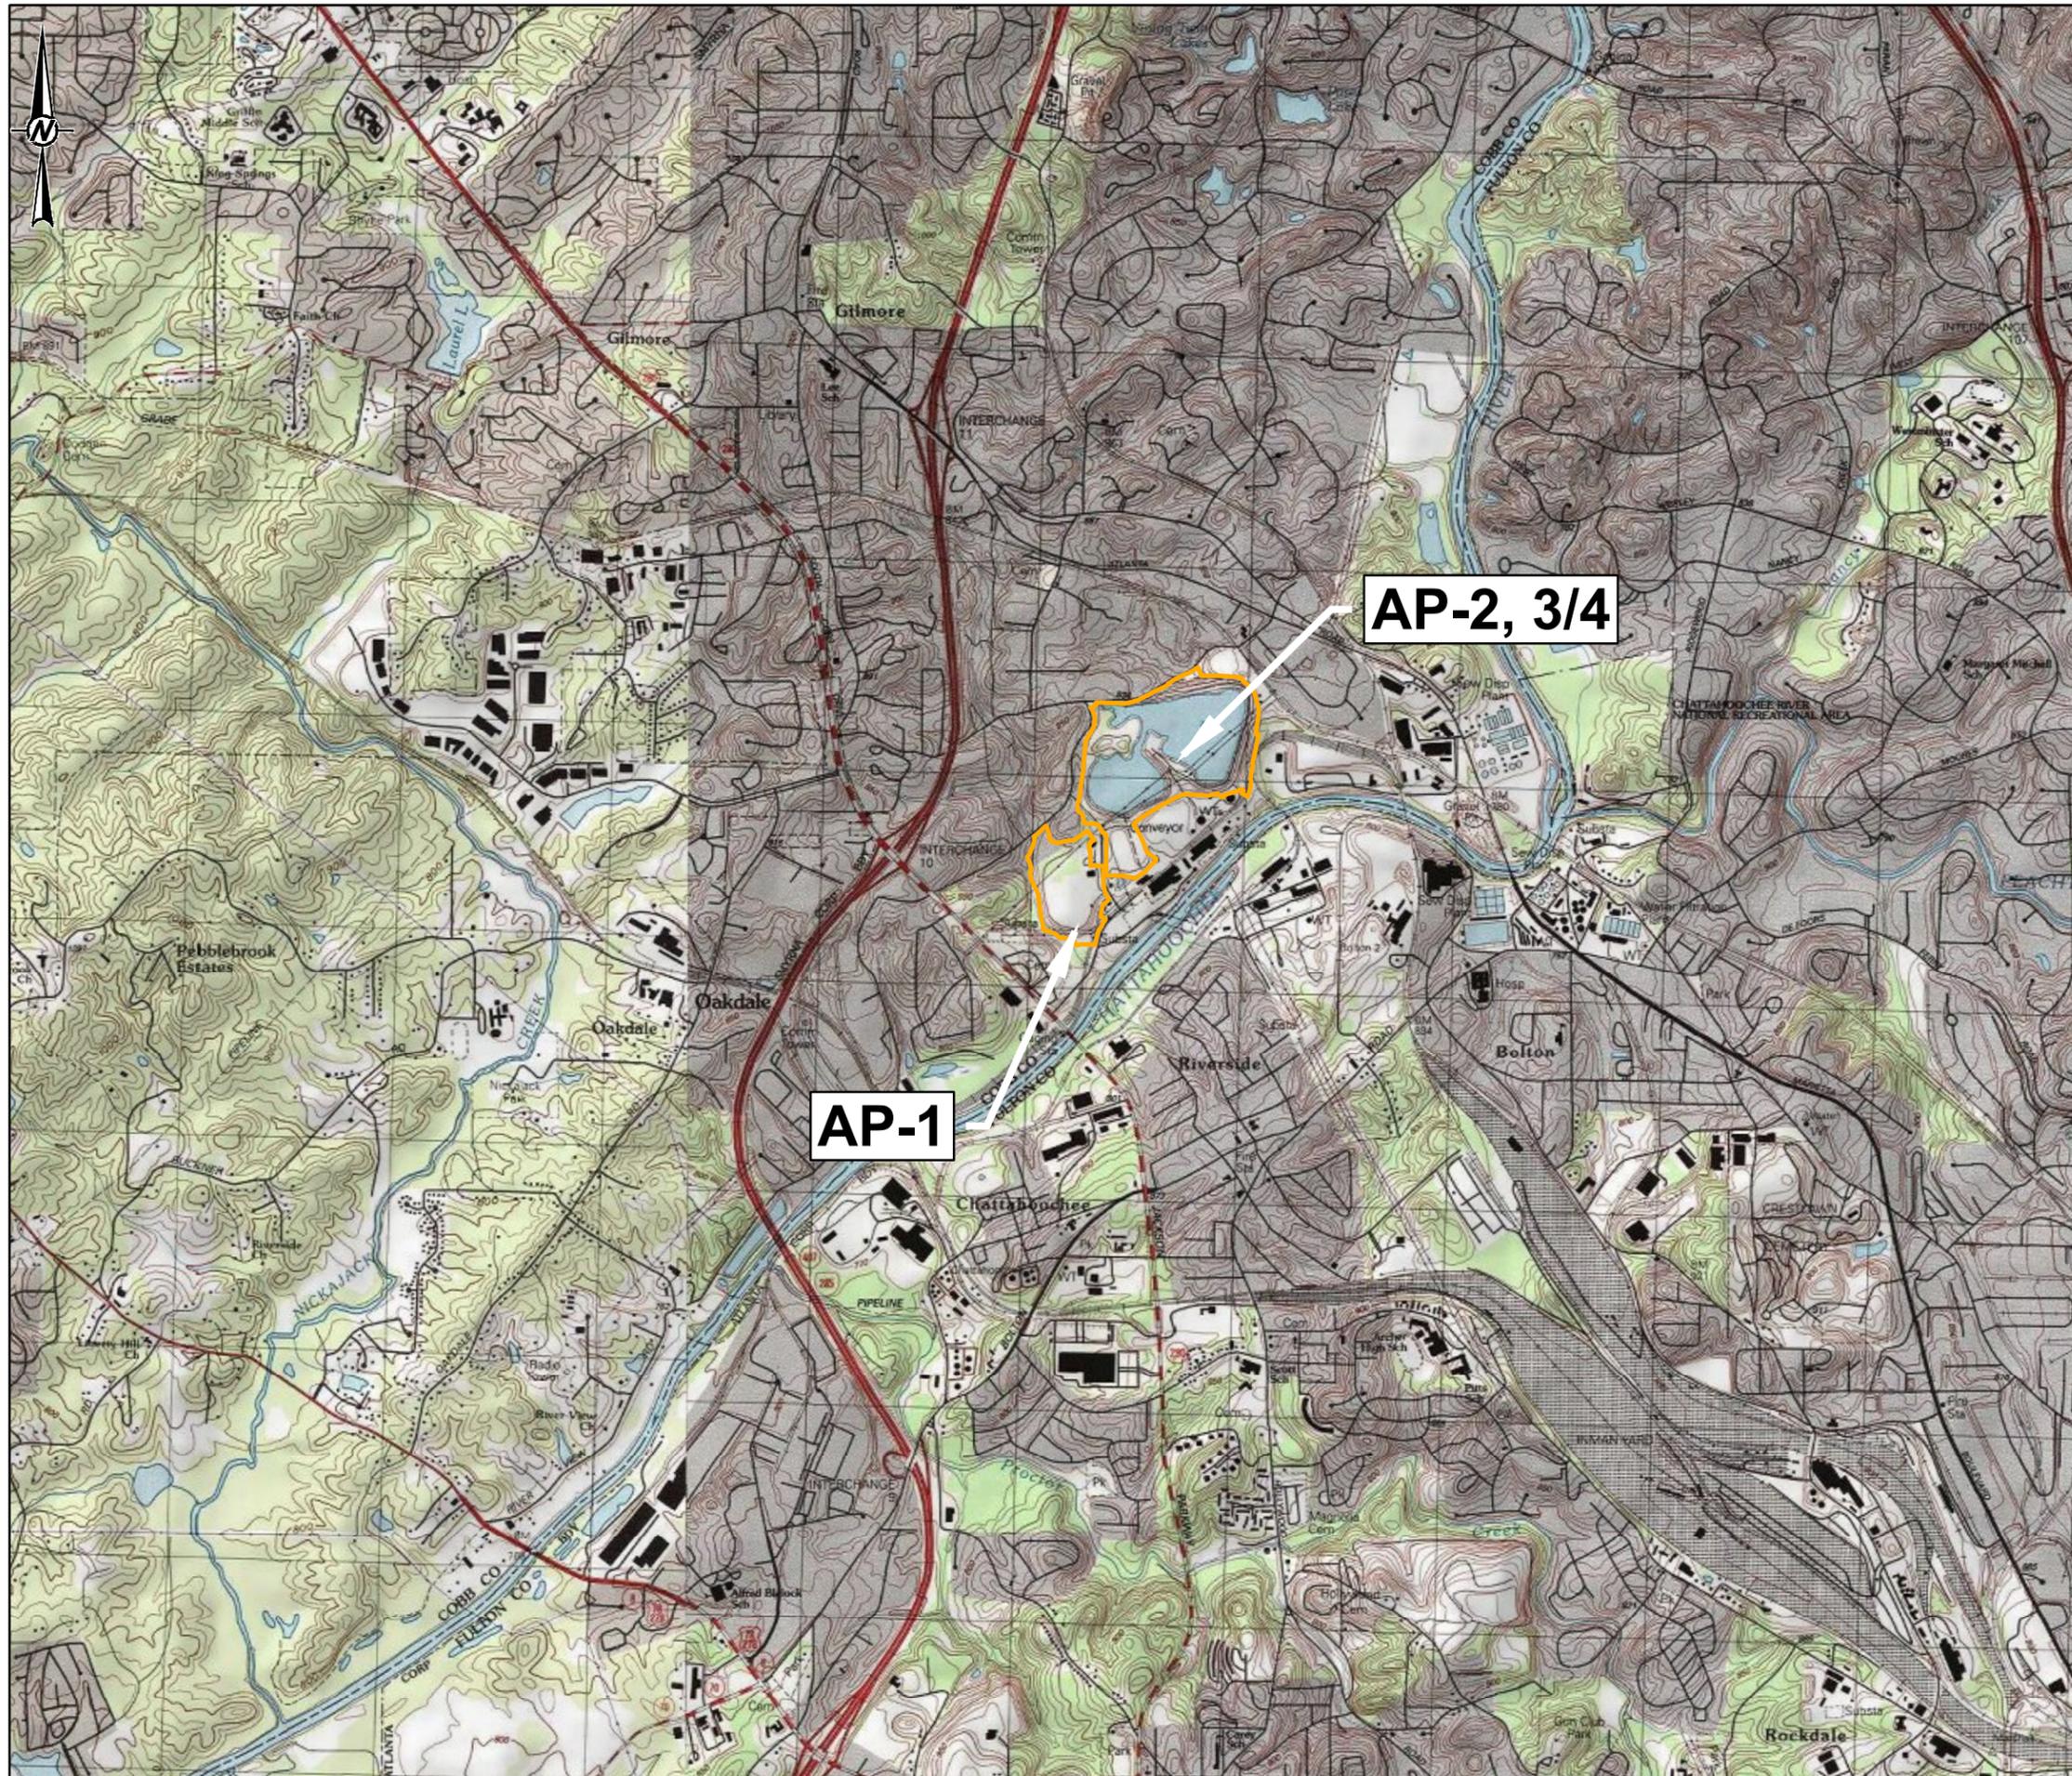

REFERENCE

SERVICE LAYER CREDITS: COPYRIGHT:© 2013 NATIONAL GEOGRAPHIC SOCIETY, I-CUBED



CLIENT
 GEORGIA POWER COMPANY
 PLANT MCDONOUGH
 PROJECT
 ANNUAL GROUNDWATER MONITORING REPORT
 PLANT MCDONOUGH

TITLE
SITE LOCATION MAP

CONSULTANT	YYYY-MM-DD	2019-1-31
	PREPARED	SEB
	DESIGN	SEB
	REVIEW	KNJ
	APPROVED	TIR

PROJECT No.
 166849618

Rev.
 0

FIGURE
 1

THIS MEASUREMENT DOES NOT MATCH WHAT IS SHOWN. THE SHEET HAS BEEN MODIFIED FROM ANS1.B



LEGEND


- ◆ UPGRADIENT WELL
- ◆ AP-1 MONITORING WELL
- AP-1 PERMIT BOUNDARY
- - - PROPERTY BOUNDARY

NOTES

1. ALL LOCATIONS AND BOUNDARIES ARE APPROXIMATE.

REFERENCE

1. SERVICE LAYER CREDITS: SOURCE: ESRI, DIGITALGLOBE, GEOEYE, EARTHSTAR GEOGRAPHICS, CNES/AIRBUS DS, USDA, USGS, AEROGRID, IGN, AND THE GIS USER COMMUNITY.
2. COORDINATE SYSTEM: NAD 1983 STATE PLANE GEORGIA WEST (U.S. FEET).
3. MONITORING WELL LOCATIONS PROVIDED BY SOUTHERN COMPANY SERVICES.
4. APPROXIMATE PROPERTY BOUNDARY PROVIDED BY SOUTHERN COMPANY (2018). DATE OF PHOTOGRAPHY 09-7-2018.



CLIENT
 GEORGIA POWER COMPANY
 PLANT MCDONOUGH

PROJECT
 ANNUAL GROUNDWATER MONITORING REPORT
 PLANT MCDONOUGH

TITLE
**ASH POND 1 (AP-1) SITE PLAN & MONITORING WELL
 LOCATION MAP**

CONSULTANT	YYYY-MM-DD	2019-1-31
	PREPARED	SEB
	DESIGN	SEB
	REVIEW	KNJ
	APPROVED	TIR

Path: Q:\GIS\Southern Company\166849618-SCS-Plant McDonough\figures\Aerial\Well_LocationMap_SEB.mxd

IF THIS MEASUREMENT DOES NOT MATCH WHAT IS SHOWN, THE SHEET HAS BEEN MODIFIED FROM ANS/B



LEGEND


- ◆ UPGRADIENT WELL
- ◆ AP-1 MONITORING WELL
- ◆ AP-2, 3/4 MONITORING WELL
- ◆ PIEZOMETER
- ◆ ABANDONED PIEZOMETER OR MONITORING WELL
- APPROXIMATE GROUNDWATER FLOW DIRECTION
- GROUNDWATER SURFACE CONTOUR (FAMSL)
- PERMIT BOUNDARY
- - - PROPERTY BOUNDARY

NOTES

1. ALL LOCATIONS AND BOUNDARIES ARE APPROXIMATE.
2. GROUNDWATER ELEVATION MEASUREMENTS OBTAINED MARCH 11, 2019 BY GOLDER ASSOCIATES.
3. GROUNDWATER ELEVATIONS DISPLAYED IN FEET ABOVE MEAN SEA LEVEL (FAMSL).
4. B-27, B-68, AND DGWA-70 ARE NOT USED DUE TO WELL REPLACEMENT, PROXIMITY TO CLOSURE ACTIVITIES, OR MODIFICATIONS TO THE PROPOSED WELL NETWORK.
5. WATER LEVEL AT B-68 NOT COLLECTED DURING MARCH 11, 2019 EVENT.

REFERENCE

1. SERVICE LAYER CREDITS: SOURCE: ESRI, DIGITALGLOBE, GEOEYE, EARTHSTAR GEOGRAPHICS, CNES/AIRBUS DS, USDA, USGS, AERGRID, IGN, AND THE GIS USER COMMUNITY.
2. COORDINATE SYSTEM: NAD 1983 STATE PLANE GEORGIA WEST (U.S. FEET).
3. MONITORING WELL/PIEZOMETER LOCATIONS PROVIDED BY SOUTHERN COMPANY SERVICES.
4. APPROXIMATE PROPERTY BOUNDARY PROVIDED BY SOUTHERN COMPANY (2018). DATE OF PHOTOGRAPHY 09-7-2018.



CLIENT
 GEORGIA POWER COMPANY
 PLANT MCDONOUGH

PROJECT
 ANNUAL GROUNDWATER MONITORING REPORT
 PLANT MCDONOUGH

TITLE
SITE POTENTIOMETRIC MAP

CONSULTANT	YYYY-MM-DD	2019-5-13
	PREPARED	SEB
	DESIGN	SEB
	REVIEW	KNJ
	APPROVED	TIR

Path: Q:\GIS\Southern Company\1668496-SCS-Plant McDonough\figures\SitePotentiometricMap_SEB.mxd

IF THIS MEASUREMENT DOES NOT MATCH WHAT IS SHOWN, THE SHEET HAS BEEN MODIFIED FROM ANSIB

APPENDIX A

Laboratory Analytical Data & Field Data Forms

TABLE A-1
ANALYTICAL DATA SUMMARY
Ash Pond 1 - Background Events
Georgia Power Company - Plant McDonough
Atlanta, GA

Substance	MCL/ (SMCL)	Well ID									
		DGWA-53	DGWA-53	DGWA-53	DGWA-53	DGWA-53	DGWA-53	DGWA-53	DGWA-53	DGWA-53	DGWA-53
		3/28/2017	5/11/2017	6/15/2017	7/12/2017	10/24/2017	11/15/2017*	3/8/2018	7/12/2018	11/8/2018	
APPENDIX III	Boron	N/R	0.0612	0.0805	0.0725	0.0735	0.0770	NS	ND (0.13 J)	0.076	0.073
	Calcium	N/R	30.8	35.8	36.0	40.3	30.3	NS	39.8	34.7	28.6
	Chloride	(250)	3.7	2.3	2.6	2.3	2.7	2.2	2.4	2.2	2.3
	Fluoride	4	ND (0.12 J)	ND (0.07 J)	ND (0.19 J)	ND (0.10 J)	ND (0.06 J)	ND (0.05 J)	ND (0.25 J)	ND (0.071 J)	ND
	Sulfate	(250)	49	21	16	10	15	3.8	9.7	8.0	12.8
	TDS	(500)	202	241	251	218	671	241	213	198	200
APPENDIX IV	Antimony	0.006	ND	ND	ND (0.0006 J)	ND	ND	NS	ND	ND	ND
	Arsenic	0.01	ND (0.0005 J)	ND (0.0005 J)	ND	ND	ND	NS	ND	ND	ND (0.00090 J)
	Barium	2	0.134	0.126	0.140	0.173	0.109	NS	0.19	0.18	0.15
	Beryllium	0.004	ND	ND	ND	ND	ND	NS	ND	ND	ND
	Cadmium	0.005	ND	ND (0.00008 J)	ND	ND	ND	NS	ND	ND (0.00013 J)	ND
	Chromium	0.1	ND	ND	ND	ND	ND	NS	ND	ND	ND
	Cobalt	N/R	0.0250	0.0281	0.0322	0.0247	0.0267	NS	0.027	0.024	0.018
	Lead	0.015	ND	ND	ND	ND	ND	NS	ND	ND	ND
	Lithium	N/R	ND (0.0108 J)	ND (0.0087 J)	ND (0.0088 J)	ND (0.0075 J)	ND (0.0103 J)	NS	ND (0.011 J)	ND (0.0084 J)	ND (0.0077 J)
	Mercury	0.002	ND	ND	ND (0.00008 J)	ND	ND	NS	ND	ND	ND
	Molybdenum	N/R	0.0242	0.0375	0.0409	0.0321	0.0227	NS	0.035	0.034	0.029
	Radium	5	6.36	3.45	4.58	4.37	4.46	NS	2.14	4.65	3.05
	Selenium	0.05	ND	ND	ND	ND	ND	NS	ND	ND	ND
Thallium	0.002	ND	ND	ND	ND	ND	NS	ND	ND	ND	

Notes:

- MCL indicates Environmental Protection Agency (EPA) and Georgia Environmental Protection Division (EPD) maximum contaminant level.
- (SMCL) indicates a secondary MCL that is established by EPA as a general guideline only (not enforced).
- Results for substances are reported in milligrams per liter (mg/L). Radium results are reported in picocuries per liter (pCi/L).
- ND (Not Detected) indicates the substance was not detected above the analytical method detection limit (MDL).
- ND (value J) indicates the substance was detected at such low levels that the precision of the laboratory instruments could not produce a reliable value. Therefore, the value displayed (value J) is qualified by the laboratory as an estimated number.
- N/R indicates a substance does not have an MCL or SMCL, but will be further evaluated statistically at the conclusion of all the background sampling events, as required by EPA's CCR rule
- TDS indicates total dissolved solids.
- U indicates the substance was detected below the Minimum Detection Concentration (MDC) and the precision of the laboratory instruments could not produce a reliable value. Therefore, the value followed by U is qualified by the laboratory as estimated.
- Appendix III = indicator parameters evaluated during Detection Monitoring; Appendix IV = parameters evaluated during Assessment Monitoring.
- Well no longer sampled as part of background monitoring due to well replacement, proximity to closure activities, or modifications to the proposed well network.
- NS indicates not sampled due to resampling for selected constituents on this date . * indicates a resample event.

TABLE A-2
ANALYTICAL DATA SUMMARY
Ash Pond 1 - Background Events
Georgia Power Company - Plant McDonough
Atlanta, GA

Substance	MCL/ (SMCL)	Well ID								
		DGWA-70A	DGWA-70A	DGWA-70A	DGWA-70A	DGWA-70A	DGWA-70A	DGWA-70A	DGWA-70A	DGWA-70A
		5/15/2017	6/15/2017	7/11/2017	8/8/2017	10/24/2017	2/27/2018	7/10/2018	11/6/2018	
APPENDIX III	Boron	N/R	ND (0.0073 J)	ND	ND	ND	ND (0.0082 J)	ND (0.0062 J)	ND (0.0077 J)	ND (0.0065 J)
	Calcium	N/R	6.50	5.38	5.96	5.20	4.93	5.6	5.0	5.5
	Chloride	(250)	2.2	2.0	2.1	2.2	2.4	2.5	1.9	2.3
	Fluoride	4	ND (0.005 J)	ND (0.02 J)	ND (0.06 J)	ND (0.04 J)	ND	ND	ND (0.082 J)	ND
	Sulfate	(250)	1.0	ND (0.86 J)	1.4	1.5	1.4	ND (0.54 J)	ND (0.25 J)	ND (0.12 J)
	TDS	(500)	88	65	25	53	49	43.0	80.0	65.0
APPENDIX IV	Antimony	0.006	ND	ND	ND	ND	ND	ND	ND	ND
	Arsenic	0.01	ND	ND	ND	ND	ND	ND	ND	ND
	Barium	2	0.0181	0.0277	0.0306	0.0277	0.0333	0.034	0.037	0.037
	Beryllium	0.004	ND	ND	ND	ND	ND	ND (0.000063 J)	ND (0.000095 J)	ND (0.00012 J)
	Cadmium	0.005	ND	ND	ND	ND	ND	ND	ND	ND
	Chromium	0.1	ND (0.0006 J)	ND (0.0006 J)	ND (0.0005 J)	ND (0.0005 J)	ND (0.0005 J)	ND	ND	ND
	Cobalt	N/R	ND (0.0024 J)	ND (0.0014 J)	ND (0.0007 J)	ND (0.0007 J)	ND	ND	ND	ND
	Lead	0.015	ND (0.0001 J)	ND (0.0002 J)	ND	ND (0.00007 J)	ND	ND	ND	ND
	Lithium	N/R	ND (0.0020 J)	ND	ND	ND	ND	ND	ND	ND
	Mercury	0.002	ND	ND (0.00007 J)	ND	ND	ND	ND	ND (0.000055 J)	ND
	Molybdenum	N/R	ND	ND	ND	ND	ND	ND	ND	ND
	Radium	5	0.288 U	1.01 U	0.254 U	1.48	0.472 U	1.22	0.362 U	0.859 U
	Selenium	0.05	ND	ND	ND	ND	ND	ND	ND	ND
Thallium	0.002	ND	ND	ND	ND	ND	ND	ND	ND	

Notes:

- MCL indicates Environmental Protection Agency (EPA) and Georgia Environmental Protection Division (EPD) maximum contaminant level.
- (SMCL) indicates a secondary MCL that is established by EPA as a general guideline only (not enforced).
- Results for substances are reported in milligrams per liter (mg/L). Radium results are reported in picocuries per liter (pCi/L).
- ND (Not Detected) indicates the substance was not detected above the analytical method detection limit (MDL).
- ND (value J) indicates the substance was detected at such low levels that the precision of the laboratory instruments could not produce a reliable value. Therefore, the value displayed (value J) is qualified by the laboratory as an estimated number.
- N/R indicates a substance does not have an MCL or SMCL, but will be further evaluated statistically at the conclusion of all the background sampling events, as required by EPA's CCR rule.
- TDS indicates total dissolved solids.
- U indicates the substance was detected below the Minimum Detection Concentration (MDC) and the precision of the laboratory instruments could not produce a reliable value. Therefore, the value followed by U is qualified by the laboratory as estimated.
- Appendix III = indicator parameters evaluated during Detection Monitoring; Appendix IV = parameters evaluated during Assessment Monitoring.
- Well no longer sampled as part of background monitoring due to well replacement, proximity to closure activities, or modifications to the proposed well network.
- NS indicates not sampled due to resampling for selected constituents on this date . * indicates a resample event.

TABLE A-3
ANALYTICAL DATA SUMMARY
Ash Pond 1 - Background Events
Georgia Power Company - Plant McDonough
Atlanta, GA

Substance	MCL/ (SMCL)	Well ID									
		DGWA-71	DGWA-71	DGWA-71	DGWA-71	DGWA-71	DGWA-71	DGWA-71	DGWA-71	DGWA-71	DGWA-71
		3/28/2017	5/12/2017	6/16/2017	7/11/2017	10/24/2017	11/15/2017*	2/27/2018	7/10/2018	11/6/2018	
APPENDIX III	Boron	N/R	ND (0.0097 J)	ND (0.0082 J)	ND (0.0085 J)	ND (0.0077 J)	ND (0.0083 J)	NS	ND (0.0069 J)	ND (0.0059 J)	ND (0.0067 J)
	Calcium	N/R	8.31	8.04	7.66	7.71	6.86	NS	6.1	5.7	5.7
	Chloride	(250)	3.6	3.8	3.4	3.1	3.2	3.1	3.2	2.5	2.6
	Fluoride	4	ND (0.06 J)	ND	ND (0.008 J)	ND (0.007 J)	ND	ND	ND	ND	ND
	Sulfate	(250)	17	17	11	11	9.6	7.8	7.4	7.2	7.3
	TDS	(500)	90	92	100	59	117	90	79.0	88.0	85.0
APPENDIX IV	Antimony	0.006	ND (0.0007 J)	ND	ND (0.0007 J)	ND	ND	NS	ND	ND	ND
	Arsenic	0.01	ND	ND (0.0004 J)	ND	ND	ND	NS	ND	ND	ND
	Barium	2	0.0378	0.0400	0.0369	0.0362	0.0313	NS	0.029	0.027	0.026
	Beryllium	0.004	ND (0.00009 J)	ND	ND (0.0001 J)	ND	ND	NS	ND (0.000092 J)	ND (0.000091 J)	ND (0.00013 J)
	Cadmium	0.005	ND	ND	ND	ND	ND	NS	ND	ND	ND
	Chromium	0.1	ND (0.0023 J)	ND (0.0004 J)	ND (0.0005 J)	ND	ND	NS	ND	ND	ND
	Cobalt	N/R	ND (0.0033 J)	ND (0.0016 J)	ND (0.0011 J)	ND (0.0008 J)	ND (0.0004 J)	NS	ND	ND	ND
	Lead	0.015	ND	ND (0.00008 J)	ND	ND	ND	NS	ND	ND	ND
	Lithium	N/R	ND (0.0025 J)	ND (0.0016 J)	ND (0.0016 J)	ND	ND	NS	ND (0.0013 J)	ND (0.0012 J)	ND (0.0014 J)
	Mercury	0.002	ND	ND (0.00006 J)	ND (0.00007 J)	ND	ND	NS	ND	ND (0.00010 J)	ND (0.000041 J)
	Molybdenum	N/R	ND (0.0009 J)	ND	ND	ND	ND	NS	ND	ND	ND
	Radium	5	0.257 U	0.165 U	0.732 U	0.461 U	0.724 U	NS	0.714 U	0.426 U	0.455 U
	Selenium	0.05	ND	ND	ND	ND	ND	NS	ND	ND	ND
Thallium	0.002	ND (0.00006 J)	ND	ND	ND	ND	NS	ND	ND	ND	

Notes:

- MCL indicates Environmental Protection Agency (EPA) and Georgia Environmental Protection Division (EPD) maximum contaminant level.
- (SMCL) indicates a secondary MCL that is established by EPA as a general guideline only (not enforced).
- Results for substances are reported in milligrams per liter (mg/L). Radium results are reported in picocuries per liter (pCi/L).
- ND (Not Detected) indicates the substance was not detected above the analytical method detection limit (MDL).
- ND (value J) indicates the substance was detected at such low levels that the precision of the laboratory instruments could not produce a reliable value. Therefore, the value displayed (value J) is qualified by the laboratory as an estimated number.
- N/R indicates a substance does not have an MCL or SMCL, but will be further evaluated statistically at the conclusion of all the background sampling events, as required by EPA's CCR rule.
- TDS indicates total dissolved solids.
- U indicates the substance was detected below the Minimum Detection Concentration (MDC) and the precision of the laboratory instruments could not produce a reliable value. Therefore, the value followed by U is qualified by the laboratory as estimated.
- Appendix III = indicator parameters evaluated during Detection Monitoring; Appendix IV = parameters evaluated during Assessment Monitoring.
- Well no longer sampled as part of background monitoring due to well replacement, proximity to closure activities, or modifications to the proposed well network.
- NS indicates not sampled due to resampling for selected constituents on this date . * indicates a resample event.

TABLE A-4
ANALYTICAL DATA SUMMARY
Ash Pond 1 - Background Events
Georgia Power Company - Plant McDonough
Atlanta, GA

Substance	MCL/ (SMCL)	Well ID								
		DGWC-37	DGWC-37	DGWC-37	DGWC-37	DGWC-37	DGWC-37	DGWC-37	DGWC-37	DGWC-37
		9/8/2016	12/7/2016	3/30/2017	7/13/2017	10/26/2017	3/1/2018	7/12/2018	11/8/2018	
APPENDIX III	Boron	N/R	1.58	2.01	1.47	2.10	1.86	1.87	1.5	1.4
	Calcium	N/R	52.5	29.7	62.6	64.1	60.8	57.0	59.1	53.6
	Chloride	(250)	6.2	6.1	6.3	6.5	6.4	6.3	5.8	5.8
	Fluoride	4	ND (0.08 J)	ND (0.21 J)	ND (0.05 J)	ND (0.06 J)	ND (0.08 J)	0.22 J	0.32	ND
	Sulfate	(250)	97	100	110	200	97	94.6	89.2	102
	TDS	(500)	279	300	273	312	340	311	290	295
APPENDIX IV	Antimony	0.006	ND	ND	ND	ND	ND	ND	ND	ND
	Arsenic	0.01	ND	ND (0.0019 J)	ND	ND	ND	ND	ND	ND
	Barium	2	0.123	0.125	0.110	0.110	0.112	0.102	0.11	0.11
	Beryllium	0.004	ND	ND	ND	ND	ND	ND (0.000067 J)	ND (0.000070 J)	ND
	Cadmium	0.005	ND (0.0002 J)	ND (0.0001 J)	ND (0.0001 J)	ND	ND	ND	ND	ND
	Chromium	0.1	ND	ND	ND	ND	ND (0.0007 J)	ND	ND	ND
	Cobalt	N/R	ND	ND (0.0005 J)	ND	ND (0.0003 J)	ND (0.0003 J)	ND	ND	ND
	Lead	0.015	ND	ND	ND (0.0014 J)	ND	ND	ND	ND	ND
	Lithium	N/R	ND	ND	ND (0.0029 J)	ND	ND (0.0018 J)	ND (0.0024 J)	ND (0.0028 J)	ND (0.0023 J)
	Mercury	0.002	ND	ND	ND (0.00006 J)	ND	ND	ND	ND (0.000044 J)	ND
	Molybdenum	N/R	ND	ND	ND	ND	ND	ND	ND	ND
	Radium	5	0.827 U	0.560 U	0.302 U	0.731 U	1.04 U	0.344 U	0.566 U	0.623 U
	Selenium	0.05	ND	ND	ND	ND	ND	ND	ND	ND
Thallium	0.002	ND	ND	ND	ND	ND	ND	ND	ND	

Notes:

- MCL indicates Environmental Protection Agency (EPA) and Georgia Environmental Protection Division (EPD) maximum contaminant level.
- (SMCL) indicates a secondary MCL that is established by EPA as a general guideline only (not enforced).
- Results for substances are reported in milligrams per liter (mg/L). Radium results are reported in picocuries per liter (pCi/L).
- ND (Not Detected) indicates the substance was not detected above the analytical method detection limit (MDL).
- ND (value J) indicates the substance was detected at such low levels that the precision of the laboratory instruments could not produce a reliable value. Therefore, the value displayed (value J) is qualified by the laboratory as an estimated number.
- N/R indicates a substance does not have an MCL or SMCL, but will be further evaluated statistically at the conclusion of all the background sampling events, as required by EPA's CCR rule.
- TDS indicates total dissolved solids.
- U indicates the substance was detected below the Minimum Detection Concentration (MDC) and the precision of the laboratory instruments could not produce a reliable value. Therefore, the value followed by U is qualified by the laboratory as estimated.
- Appendix III = indicator parameters evaluated during Detection Monitoring; Appendix IV = parameters evaluated during Assessment Monitoring.
- Well no longer sampled as part of background monitoring due to well replacement, proximity to closure activities, or modifications to the proposed well network.
- NS indicates not sampled due to resampling for selected constituents on this date . * indicates a resample event.

TABLE A-5
ANALYTICAL DATA SUMMARY
Ash Pond 1 - Background Events
Georgia Power Company - Plant McDonough
Atlanta, GA

Substance	MCL/ (SMCL)	Well ID								
		DGWC-38	DGWC-38	DGWC-38	DGWC-38	DGWC-38	DGWC-38	DGWC-38	DGWC-38	DGWC-38
		9/8/2016	12/7/2016	3/30/2017	7/13/2017	10/26/2017	3/1/2018	7/12/2018	11/8/2018	
APPENDIX III	Boron	N/R	2.69	3.08	3.19	3.09	2.92	3.08	2.8	3.4
	Calcium	N/R	70.3	38.4	80.3	90.8	81.3	81.8	86.7	86.6
	Chloride	(250)	7.4	7.4	7.7	7.5	8.2	8.1	8.0	8.1
	Fluoride	4	ND (0.10 J)	ND (0.27 J)	ND (0.12 J)	ND (0.13 J)	0.47	ND	ND (0.23 J)	ND
	Sulfate	(250)	270	250	290	270	260	242	256	291
	TDS	(500)	437	478	448	504	554	492	478	507
APPENDIX IV	Antimony	0.006	ND	ND	ND	ND	ND	ND	ND	ND
	Arsenic	0.01	ND	ND	ND	ND (0.0005 J)	ND	ND	ND	ND
	Barium	2	0.0333	0.0336	0.0325	0.0332	0.0333	0.0333	0.034	0.035
	Beryllium	0.004	ND	ND	ND	ND	ND	ND (0.000054 J)	ND	ND
	Cadmium	0.005	ND (0.0002 J)	ND (0.0002 J)	ND (0.0002 J)	ND (0.0002 J)	ND (0.0002 J)	ND (0.00018 J)	ND (0.00024 J)	ND (0.00024 J)
	Chromium	0.1	ND	ND	ND	ND	ND (0.0005 J)	ND	ND	ND
	Cobalt	N/R	ND (0.0015 J)	ND (0.0017 J)	ND (0.0016 J)	ND (0.0016 J)	ND (0.0016 J)	ND (0.0018 J)	ND (0.0015 J)	ND (0.0016 J)
	Lead	0.015	ND	ND	ND	ND	ND (0.0001 J)	ND	ND	ND
	Lithium	N/R	ND (0.0032 J)	ND (0.0035 J)	ND (0.0035 J)	ND (0.0032 J)	ND (0.0034 J)	ND (0.0033 J)	ND (0.0034 J)	ND (0.0030 J)
	Mercury	0.002	ND	ND	ND (0.00007 J)	ND	ND	ND	ND (0.000040 J)	ND
	Molybdenum	N/R	ND	ND	ND (0.0011 J)	ND (0.0012 J)	ND (0.0011 J)	ND	ND	ND
	Radium	5	1.48	0.220 U	0.519 U	1.11	1.13 U	0.985 U	0.615 U	0.580 U
	Selenium	0.05	ND	ND	ND	ND	ND	ND	ND	ND
Thallium	0.002	ND	ND	ND (0.0001 J)	ND (0.0001 J)	ND (0.0001 J)	ND	ND	ND	

Notes:

- MCL indicates Environmental Protection Agency (EPA) and Georgia Environmental Protection Division (EPD) maximum contaminant level.
- (SMCL) indicates a secondary MCL that is established by EPA as a general guideline only (not enforced).
- Results for substances are reported in milligrams per liter (mg/L). Radium results are reported in picocuries per liter (pCi/L).
- ND (Not Detected) indicates the substance was not detected above the analytical method detection limit (MDL).
- ND (value J) indicates the substance was detected at such low levels that the precision of the laboratory instruments could not produce a reliable value. Therefore, the value displayed (value J) is qualified by the laboratory as an estimated number.
- N/R indicates a substance does not have an MCL or SMCL, but will be further evaluated statistically at the conclusion of all the background sampling events, as required by EPA's CCR rule.
- TDS indicates total dissolved solids.
- U indicates the substance was detected below the Minimum Detection Concentration (MDC) and the precision of the laboratory instruments could not produce a reliable value. Therefore, the value followed by U is qualified by the laboratory as estimated.
- Appendix III = indicator parameters evaluated during Detection Monitoring; Appendix IV = parameters evaluated during Assessment Monitoring.
- Well no longer sampled as part of background monitoring due to well replacement, proximity to closure activities, or modifications to the proposed well network.
- NS indicates not sampled due to resampling for selected constituents on this date . * indicates a resample event.

TABLE A-6
ANALYTICAL DATA SUMMARY
Ash Pond 1 - Background Events
Georgia Power Company - Plant McDonough
Atlanta, GA

Substance	MCL/ (SMCL)	Well ID								
		DGWC-39	DGWC-39	DGWC-39	DGWC-39	DGWC-39	DGWC-39	DGWC-39	DGWC-39	DGWC-39
		9/8/2016	12/7/2016	3/30/2017	7/13/2017	10/26/2017	3/1/2018	7/12/2018	11/8/2018	
APPENDIX III	Boron	N/R	3.35	3.63	3.57	3.41	3.41	2.86	3.0	3.4
	Calcium	N/R	87.2	96.7	98.9	95.0	90.6	79.6	89.8	89.0
	Chloride	(250)	9.2	8.9	8.7	8.4	8.3	8.1	7.7	7.7
	Fluoride	4	ND (0.17 J)	0.33	ND (0.17 J)	ND (0.14 J)	0.54	ND (0.13 J)	ND (0.13 J)	ND (0.072 J)
	Sulfate	(250)	280	250	310	220	210	166	169	200
	TDS	(500)	522	565	496	508	532	440	463	485
APPENDIX IV	Antimony	0.006	ND	ND	ND	ND	ND	ND	ND	ND
	Arsenic	0.01	ND	ND	ND (0.0007 J)	ND (0.0009 J)	ND	ND (0.0011 J)	ND (0.00057 J)	ND
	Barium	2	0.0978	0.0844	0.0858	0.0919	0.0899	0.0742	0.094	0.10
	Beryllium	0.004	ND	ND	ND	ND	ND	ND	ND	ND
	Cadmium	0.005	ND	ND	ND	ND	ND	ND	ND	ND
	Chromium	0.1	ND	ND	ND	ND	ND	ND	ND	ND
	Cobalt	N/R	ND (0.0068 J)	ND (0.0071 J)	ND (0.0060 J)	ND (0.0063 J)	ND (0.0062 J)	ND (0.0058 J)	ND (0.0059 J)	ND (0.0062 J)
	Lead	0.015	ND	ND	ND	ND	ND	ND	ND	ND
	Lithium	N/R	ND	ND	ND	ND	ND	ND	ND	ND
	Mercury	0.002	ND	ND	ND (0.000059 J)	ND	ND	ND	ND	ND
	Molybdenum	N/R	ND	ND	ND	ND	ND	ND	ND	ND
	Radium	5	1.44	2.16	0.264 U	0.517 U	0.875 U	1.24	0.935 U	1.15 U
	Selenium	0.05	ND	ND	ND	ND	ND	ND	ND	ND
Thallium	0.002	ND	ND	ND (0.0001 J)	ND (0.00009 J)	ND (0.0001 J)	ND	ND	ND	

Notes:

- MCL indicates Environmental Protection Agency (EPA) and Georgia Environmental Protection Division (EPD) maximum contaminant level.
- (SMCL) indicates a secondary MCL that is established by EPA as a general guideline only (not enforced).
- Results for substances are reported in milligrams per liter (mg/L). Radium results are reported in picocuries per liter (pCi/L).
- ND (Not Detected) indicates the substance was not detected above the analytical method detection limit (MDL).
- ND (value J) indicates the substance was detected at such low levels that the precision of the laboratory instruments could not produce a reliable value. Therefore, the value displayed (value J) is qualified by the laboratory as an estimated number.
- N/R indicates a substance does not have an MCL or SMCL, but will be further evaluated statistically at the conclusion of all the background sampling events, as required by EPA's CCR rule.
- TDS indicates total dissolved solids.
- U indicates the substance was detected below the Minimum Detection Concentration (MDC) and the precision of the laboratory instruments could not produce a reliable value. Therefore, the value followed by U is qualified by the laboratory as estimated.
- Appendix III = indicator parameters evaluated during Detection Monitoring; Appendix IV = parameters evaluated during Assessment Monitoring.
- Well no longer sampled as part of background monitoring due to well replacement, proximity to closure activities, or modifications to the proposed well network.
- NS indicates not sampled due to resampling for selected constituents on this date . * indicates a resample event.

TABLE A-7
ANALYTICAL DATA SUMMARY
Ash Pond 1 - Background Events
Georgia Power Company - Plant McDonough
Atlanta, GA

Substance	MCL/ (SMCL)	Well ID								
		DGWC-40	DGWC-40	DGWC-40	DGWC-40	DGWC-40	DGWC-40	DGWC-40	DGWC-40	DGWC-40
		9/2/2016	12/8/2016	3/30/2017	7/13/2017	10/26/2017	3/2/2018	7/12/2018	11/8/2018	
APPENDIX III	Boron	N/R	0.895	0.841	0.937	0.933	0.873	0.974	0.92	0.80
	Calcium	N/R	39.6	37.9	43.9	46.2	41.8	43.2	47.1	43.5
	Chloride	(250)	20	18	20	21	21	19.5	19.9	19.3
	Fluoride	4	0.50	0.35	ND (0.21 J)	ND (0.20 J)	0.50	0.33	0.57	ND (0.11 J)
	Sulfate	(250)	230	270	240	220	220	219	222	273
	TDS	(500)	583	319	344	386	373	359	365	399
APPENDIX IV	Antimony	0.006	ND	ND	ND	ND	ND	ND	ND	ND
	Arsenic	0.01	ND	ND	ND (0.0006 J)	ND	ND	ND (0.0011 J)	ND	ND
	Barium	2	0.0171	0.0163	0.0177	0.0170	0.0168	0.0169	0.018	0.017
	Beryllium	0.004	ND (0.0028 J)	ND (0.0026 J)	0.0030	ND (0.0030 J)	ND (0.0027 J)	0.0033	0.0032	ND (0.0027 J)
	Cadmium	0.005	ND (0.0008 J)	ND (0.0007 J)	ND (0.0007 J)	ND (0.0008 J)	ND (0.0008 J)	ND (0.00085 J)	ND (0.00087 J)	ND (0.00076 J)
	Chromium	0.1	ND	ND	ND (0.0007 J)	ND (0.0006 J)	ND (0.0007 J)	ND	ND	ND
	Cobalt	N/R	0.0382	0.0318	0.0364	0.0394	0.0371	0.0425	0.044	0.036
	Lead	0.015	ND	ND	ND (0.00007 J)	ND	ND (0.00007 J)	ND	ND	ND
	Lithium	N/R	ND (0.0022 J)	ND	ND (0.0023 J)	ND (0.0023 J)	ND (0.0021 J)	ND (0.0023 J)	ND (0.0022 J)	ND (0.0020 J)
	Mercury	0.002	ND (0.000044 J)	ND	ND (0.00009 J)	ND	ND	ND	ND (0.000045 J)	ND
	Molybdenum	N/R	ND	ND	ND	ND	ND	ND	ND	ND
	Radium	5	1.44	2.56	0.0844 U	0.963 U	0.748 U	0.485 U	0.231 U	0.465 U
	Selenium	0.05	ND (0.0019 J)	ND (0.0022 J)	ND (0.0023 J)	ND (0.0025 J)	ND (0.0036 J)	ND (0.0045 J)	ND	ND (0.0016 J)
Thallium	0.002	ND	ND	ND (0.00006 J)	ND (0.00006 J)	ND (0.00007 J)	ND	ND	ND	

Notes:

1. MCL indicates Environmental Protection Agency (EPA) and Georgia Environmental Protection Division (EPD) maximum contaminant level.
2. (SMCL) indicates a secondary MCL that is established by EPA as a general guideline only (not enforced).
3. Results for substances are reported in milligrams per liter (mg/L). Radium results are reported in picocuries per liter (pCi/L).
4. ND (Not Detected) indicates the substance was not detected above the analytical method detection limit (MDL).
5. ND (value J) indicates the substance was detected at such low levels that the precision of the laboratory instruments could not produce a reliable value. Therefore, the value displayed (value J) is qualified by the laboratory as an estimated number.
6. N/R indicates a substance does not have an MCL or SMCL, but will be further evaluated statistically at the conclusion of all the background sampling events, as required by EPA's CCR rule.
7. TDS indicates total dissolved solids.
8. U indicates the substance was detected below the Minimum Detection Concentration (MDC) and the precision of the laboratory instruments could not produce a reliable value. Therefore, the value followed by U is qualified by the laboratory as estimated.
9. Appendix III = indicator parameters evaluated during Detection Monitoring; Appendix IV = parameters evaluated during Assessment Monitoring.
10. Well no longer sampled as part of background monitoring due to well replacement, proximity to closure activities, or modifications to the proposed well network.
11. NS indicates not sampled due to resampling for selected constituents on this date . * indicates a resample event.

TABLE A-8
ANALYTICAL DATA SUMMARY
Ash Pond 1 - Background Events
Georgia Power Company - Plant McDonough
Atlanta, GA

Substance	MCL/ (SMCL)	Well ID								
		DGWC-67	DGWC-67	DGWC-67	DGWC-67	DGWC-67	DGWC-67	DGWC-67	DGWC-67	DGWC-67
		3/31/2017	5/12/2017	6/16/2017	7/13/2017	10/26/2017	3/2/2018	7/13/2018	11/8/2018	
APPENDIX III	Boron	N/R	2.91	3.24	3.42	3.46	3.21	3.49	3.1	3.5
	Calcium	N/R	39.9	43.6	42.5	43.7	40.4	40.1	43.3	40.1
	Chloride	(250)	5.7	5.6	5.5	5.2	6.0	5.8	5.9	6.1
	Fluoride	4	ND (0.02 J)	ND	ND (0.03 J)	ND (0.03 J)	ND	ND	ND (0.25 J)	0.50
	Sulfate	(250)	110	100	100	110	100	98.5	136	118
	TDS	(500)	270	287	309	275	319	264	297	295
APPENDIX IV	Antimony	0.006	ND (0.0004 J)	ND	ND (0.0008 J)	ND	ND	ND	ND (0.0023 J)	ND
	Arsenic	0.01	ND	ND	ND	ND	ND	ND	ND	ND
	Barium	2	0.111	0.127	0.110	0.102	0.105	0.104	0.11	0.11
	Beryllium	0.004	ND	ND	ND	ND	ND	ND	ND	ND
	Cadmium	0.005	ND	ND	ND	ND	ND	ND	ND	ND
	Chromium	0.1	ND (0.0005 J)	ND (0.0007 J)	ND	ND	ND	ND	ND	ND
	Cobalt	N/R	ND (0.0064 J)	ND (0.0037 J)	ND (0.0041 J)	ND (0.0037 J)	ND (0.0022 J)	ND (0.0017 J)	ND (0.0017 J)	ND (0.0020 J)
	Lead	0.015	ND	ND (0.00009 J)	ND	ND	ND	ND	ND	ND
	Lithium	N/R	ND (0.0052 J)	ND (0.0054 J)	ND (0.0048 J)	ND (0.0044 J)	ND (0.0043 J)	ND (0.0047 J)	ND (0.0041 J)	ND (0.0039 J)
	Mercury	0.002	ND	ND	ND (0.00007 J)	ND	ND	ND	ND	ND
	Molybdenum	N/R	ND	ND	ND	ND	ND	ND	ND	ND
	Radium	5	0.404 U	0.206 U	0.966 U	0.387 U	0.619 U	1.31	0.667 U	0.911 U
	Selenium	0.05	ND	ND	ND	ND	ND	ND	ND	ND
Thallium	0.002	ND	ND	ND	ND	ND	ND	ND	ND	

Notes:

1. MCL indicates Environmental Protection Agency (EPA) and Georgia Environmental Protection Division (EPD) maximum contaminant level.
2. (SMCL) indicates a secondary MCL that is established by EPA as a general guideline only (not enforced).
3. Results for substances are reported in milligrams per liter (mg/L). Radium results are reported in picocuries per liter (pCi/L).
4. ND (Not Detected) indicates the substance was not detected above the analytical method detection limit (MDL).
5. ND (value J) indicates the substance was detected at such low levels that the precision of the laboratory instruments could not produce a reliable value. Therefore, the value displayed (value J) is qualified by the laboratory as an estimated number.
6. N/R indicates a substance does not have an MCL or SMCL, but will be further evaluated statistically at the conclusion of all the background sampling events, as required by EPA's CCR rule.
7. TDS indicates total dissolved solids.
8. U indicates the substance was detected below the Minimum Detection Concentration (MDC) and the precision of the laboratory instruments could not produce a reliable value. Therefore, the value followed by U is qualified by the laboratory as estimated.
9. Appendix III = indicator parameters evaluated during Detection Monitoring; Appendix IV = parameters evaluated during Assessment Monitoring.
10. Well no longer sampled as part of background monitoring due to well replacement, proximity to closure activities, or modifications to the proposed well network.
11. NS indicates not sampled due to resampling for selected constituents on this date . * indicates a resample event.

TABLE A-9
ANALYTICAL DATA SUMMARY
Ash Pond 1 - Background Events
Georgia Power Company - Plant McDonough
Atlanta, GA

Substance	MCL/ (SMCL)	Well ID								
		DGWC-68	DGWC-68	DGWC-68	DGWC-68	DGWC-68	DGWC-68	DGWC-68	DGWC-68	
		3/31/2017	4/12/2017*							
APPENDIX III	Boron	N/R	1.25	1.16						
	Calcium	N/R	48.2	NS						
	Chloride	(250)	3.8	NS						
	Fluoride	4	0.54	NS						
	Sulfate	(250)	38	NS						
	TDS	(500)	288	NS						
APPENDIX IV	Antimony	0.006	ND	NS						
	Arsenic	0.01	0.488	0.498						
	Barium	2	0.0796	NS						
	Beryllium	0.004	ND	NS						
	Cadmium	0.005	ND	NS						
	Chromium	0.1	ND	NS						
	Cobalt	N/R	ND (0.0025 J)	NS						
	Lead	0.015	ND	NS						
	Lithium	N/R	ND (0.0016 J)	NS						
	Mercury	0.002	ND	NS						
	Molybdenum	N/R	0.175	NS						
	Radium	5	0.358 U	NS						
	Selenium	0.05	ND	NS						
Thallium	0.002	ND (0.00008 J)	NS							

See Note 10

Notes:

1. MCL indicates Environmental Protection Agency (EPA) and Georgia Environmental Protection Division (EPD) maximum contaminant level.
2. (SMCL) indicates a secondary MCL that is established by EPA as a general guideline only (not enforced).
3. Results for substances are reported in milligrams per liter (mg/L). Radium results are reported in picocuries per liter (pCi/L).
4. ND (Not Detected) indicates the substance was not detected above the analytical method detection limit (MDL).
5. ND (value J) indicates the substance was detected at such low levels that the precision of the laboratory instruments could not produce a reliable value. Therefore, the value displayed (value J) is qualified by the laboratory as an estimated number.
6. N/R indicates a substance does not have an MCL or SMCL, but will be further evaluated statistically at the conclusion of all the background sampling events, as required by EPA's CCR rule.
7. TDS indicates total dissolved solids.
8. U indicates the substance was detected below the Minimum Detection Concentration (MDC) and the precision of the laboratory instruments could not produce a reliable value. Therefore, the value followed by U is qualified by the laboratory as estimated.
9. Appendix III = indicator parameters evaluated during Detection Monitoring; Appendix IV = parameters evaluated during Assessment Monitoring.
10. Well no longer sampled as part of background monitoring due to well replacement, proximity to closure activities, or modifications to the proposed well network.
11. NS indicates not sampled due to resampling for selected constituents on this date . * indicates a resample event.

TABLE A-10
ANALYTICAL DATA SUMMARY
Ash Pond 1 - Background Events
Georgia Power Company - Plant McDonough
Atlanta, GA

Substance	MCL/ (SMCL)	Well ID								
		DGWC-68A	DGWC-68A	DGWC-68A	DGWC-68A	DGWC-68A	DGWC-68A	DGWC-68A	DGWC-68A	DGWC-68A
		5/12/2017	6/16/2017	7/13/2017	8/8/2017	10/26/2017	3/2/2018	7/13/2018	11/8/2018	
APPENDIX III	Boron	N/R	1.80	1.88	1.97	2.10	2.05	2.05	1.7	1.8
	Calcium	N/R	51.7	47.9	52.3	46.3	48.2	48.9	52.4	46.8
	Chloride	(250)	4.2	4.2	4.4	4.2	4.4	4.2	4.0	ND
	Fluoride	4	0.37	ND (0.12 J)	ND (0.12 J)	ND (0.11 J)	ND (0.11 J)	ND (0.23 J)	ND (0.099 J)	ND (0.040 J)
	Sulfate	(250)	50	47	49	48	48	44.7	43.3	43.5
	TDS	(500)	300	271	246	278	287	252	275	277
APPENDIX IV	Antimony	0.006	ND	ND (0.0008 J)	ND	ND	ND	ND	ND	ND
	Arsenic	0.01	ND	ND	ND	ND	ND	ND	ND	ND (0.00060 J)
	Barium	2	0.0890	0.0855	0.0859	0.0852	0.0878	0.0878	0.091	0.092
	Beryllium	0.004	ND	ND	ND	ND	ND	ND	ND (0.000084 J)	ND
	Cadmium	0.005	ND (0.00008 J)	ND	ND	ND	ND	ND (0.00019 J)	ND (0.00019 J)	ND (0.00025 J)
	Chromium	0.1	ND	ND	ND (0.0005 J)	ND	ND	ND	ND	ND
	Cobalt	N/R	ND (0.0015 J)	ND (0.0003 J)	ND (0.0005 J)	ND	ND	ND	ND	ND
	Lead	0.015	ND	ND	ND	ND	ND	ND	ND	ND
	Lithium	N/R	ND (0.0016 J)	ND	ND	ND	ND	ND	ND	ND
	Mercury	0.002	ND	ND (0.00007 J)	ND	ND	ND	ND	ND	ND
	Molybdenum	N/R	0.275	0.190	0.211	0.207	0.226	0.215	0.22	0.20
	Radium	5	1.18	0.332 U	0.304 U	1.40	0.477 U	1.13	0.407 U	0.393 U
	Selenium	0.05	ND	ND	ND	ND	ND	ND	ND	ND
Thallium	0.002	ND	ND	ND	ND	ND	ND	ND (0.00015 J)	ND	

Notes:

1. MCL indicates Environmental Protection Agency (EPA) and Georgia Environmental Protection Division (EPD) maximum contaminant level.
2. (SMCL) indicates a secondary MCL that is established by EPA as a general guideline only (not enforced).
3. Results for substances are reported in milligrams per liter (mg/L). Radium results are reported in picocuries per liter (pCi/L).
4. ND (Not Detected) indicates the substance was not detected above the analytical method detection limit (MDL).
5. ND (value J) indicates the substance was detected at such low levels that the precision of the laboratory instruments could not produce a reliable value. Therefore, the value displayed (value J) is qualified by the laboratory as an estimated number.
6. N/R indicates a substance does not have an MCL or SMCL, but will be further evaluated statistically at the conclusion of all the background sampling events, as required by EPA's CCR rule.
7. TDS indicates total dissolved solids.
8. U indicates the substance was detected below the Minimum Detection Concentration (MDC) and the precision of the laboratory instruments could not produce a reliable value. Therefore, the value followed by U is qualified by the laboratory as estimated.
9. Appendix III = indicator parameters evaluated during Detection Monitoring; Appendix IV = parameters evaluated during Assessment Monitoring.
10. Well no longer sampled as part of background monitoring due to well replacement, proximity to closure activities, or modifications to the proposed well network.
11. NS indicates not sampled due to resampling for selected constituents on this date . * indicates a resample event.

TABLE A-11
ANALYTICAL DATA SUMMARY
Ash Pond 1 - Background Events
Georgia Power Company - Plant McDonough
Atlanta, GA

Substance	MCL/ (SMCL)	Well ID										
		DGWC-69	DGWC-69	DGWC-69	DGWC-69	DGWC-69	DGWC-69	DGWC-69	DGWC-69	DGWC-69	DGWC-69	DGWC-69
		3/31/2017	4/12/2017*	5/12/2017	6/16/2017	7/13/2017	10/26/2017	11/15/2017*	3/2/2018	7/13/2018	11/8/2018	
APPENDIX III	Boron	N/R	0.407	0.207	0.311	0.381	0.323	0.779	0.667	0.0478	0.043	0.054
	Calcium	N/R	ND (18.6 J)	NS	18.9	17.7	17.6	33.3	30.6	8.09	7.9	8.5
	Chloride	(250)	4.4	NS	4.4	4.7	4.7	4.2	4.7	6.4	5.3	5.9
	Fluoride	4	ND (0.16 J)	NS	ND (0.12 J)	ND (0.16 J)	ND (0.13 J)	ND (0.29 J)	ND (0.28 J)	ND (0.18 J)	ND (0.19 J)	ND (0.12 J)
	Sulfate	(250)	21	NS	17	20	17	31	29	10.1	8.6	9.7
	TDS	(500)	138	NS	243	155	122	234	188	73.0	95.0	112
APPENDIX IV	Antimony	0.006	ND	NS	ND	ND (0.0007 J)	ND	ND	ND	ND	ND	ND
	Arsenic	0.01	0.0239	0.0077	0.0097	0.0113	ND (0.0029 J)	0.114	0.164	0.0127	0.017	0.020
	Barium	2	0.0872	NS	0.0929	0.100	0.0985	0.136	0.107	0.0671	0.074	0.072
	Beryllium	0.004	ND (0.00007 J)	NS	ND	ND	ND	ND	ND	ND (0.000060 J)	ND (0.000058 J)	ND
	Cadmium	0.005	ND (0.0001 J)	NS	ND (0.0002 J)	ND (0.0002 J)	ND	ND	ND	ND (0.00016 J)	ND	ND
	Chromium	0.1	ND	NS	ND	ND	ND	ND	ND	ND	ND	ND
	Cobalt	N/R	ND (0.0022 J)	NS	ND (0.0016 J)	ND (0.0009 J)	ND (0.0004 J)	ND (0.0031 J)	ND (0.0028 J)	ND	ND	ND
	Lead	0.015	ND	NS	ND (0.0001 J)	ND	ND	ND	ND (0.00009 J)	ND	ND	ND
	Lithium	N/R	ND (0.0031 J)	NS	ND (0.0030 J)	ND (0.0031 J)	ND (0.0029 J)	ND (0.0034 J)	ND (0.0034 J)	ND (0.0028 J)	ND (0.0026 J)	ND (0.0025 J)
	Mercury	0.002	ND	NS	ND	ND (0.00007 J)	ND	ND	ND	ND	ND	ND
	Molybdenum	N/R	0.0124	NS	0.0117	ND (0.0087 J)	ND (0.0053 J)	0.0244	0.0237	ND (0.0072 J)	ND (0.0070 J)	ND (0.0059 J)
	Radium	5	1.39	NS	1.29	1.61	1.14	2.04	1.99	0.918 U	1.36 U	0.719 U
	Selenium	0.05	ND	NS	ND	ND	ND	ND	ND	ND	ND	ND
Thallium	0.002	ND	NS	ND	ND	ND	ND	ND	ND	ND	ND	

Notes:

- MCL indicates Environmental Protection Agency (EPA) and Georgia Environmental Protection Division (EPD) maximum contaminant level.
- (SMCL) indicates a secondary MCL that is established by EPA as a general guideline only (not enforced).
- Results for substances are reported in milligrams per liter (mg/L). Radium results are reported in picocuries per liter (pCi/L).
- ND (Not Detected) indicates the substance was not detected above the analytical method detection limit (MDL).
- ND (value J) indicates the substance was detected at such low levels that the precision of the laboratory instruments could not produce a reliable value. Therefore, the value display (value J) is qualified by the laboratory as an estimated number.
- N/R indicates a substance does not have an MCL or SMCL, but will be further evaluated statistically at the conclusion of all the background sampling events, as required by EPA's CC
- TDS indicates total dissolved solids.
- U indicates the substance was detected below the Minimum Detection Concentration (MDC) and the precision of the laboratory instruments could not produce a reliable value. Therefore, the value followed by U is qualified by the laboratory as estimated.
- Appendix III = indicator parameters evaluated during Detection Monitoring; Appendix IV = parameters evaluated during Assessment Monitoring.
- Well no longer sampled as part of background monitoring due to well replacement, proximity to closure activities, or modifications to the proposed well network.
- NS indicates not sampled due to resampling for selected constituents on this date . * indicates a resample event.

TABLE A-12
ANALYTICAL DATA SUMMARY
Ash Pond 1 - Background Events
Georgia Power Company - Plant McDonough
Atlanta, GA

Substance	MCL/ (SMCL)	Well ID								
		DGWA-70	DGWA-70	DGWA-70	DGWA-70	DGWA-70	DGWA-70	DGWA-70	DGWA-70	
		3/28/2017								
APPENDIX III	Boron	N/R	ND (0.0067 J)							
	Calcium	N/R	5.14							
	Chloride	(250)	3.8							
	Fluoride	4	1.2							
	Sulfate	(250)	2.7							
	TDS	(500)	39							
APPENDIX IV	Antimony	0.006	ND							
	Arsenic	0.01	ND							
	Barium	2	0.0166							
	Beryllium	0.004	ND							
	Cadmium	0.005	ND							
	Chromium	0.1	ND (0.0008 J)							
	Cobalt	N/R	ND (0.0034 J)							
	Lead	0.015	ND (0.00009 J)							
	Lithium	N/R	ND (0.0054 J)							
	Mercury	0.002	ND							
	Molybdenum	N/R	ND							
	Radium	5	0.866 U							
	Selenium	0.05	ND							
Thallium	0.002	ND								

See Note 10

Notes:

- MCL indicates Environmental Protection Agency (EPA) and Georgia Environmental Protection Division (EPD) maximum contaminant level.
- (SMCL) indicates a secondary MCL that is established by EPA as a general guideline only (not enforced).
- Results for substances are reported in milligrams per liter (mg/L). Radium results are reported in picocuries per liter (pCi/L).
- ND (Not Detected) indicates the substance was not detected above the analytical method detection limit (MDL).
- ND (value J) indicates the substance was detected at such low levels that the precision of the laboratory instruments could not produce a reliable value. Therefore, the value displayed (value J) is qualified by the laboratory as an estimated number.
- N/R indicates a substance does not have an MCL or SMCL, but will be further evaluated statistically at the conclusion of all the background sampling events, as required by EPA's CCR rule.
- TDS indicates total dissolved solids.
- U indicates the substance was detected below the Minimum Detection Concentration (MDC) and the precision of the laboratory instruments could not produce a reliable value. Therefore, the value followed by U is qualified by the laboratory as estimated.
- Appendix III = indicator parameters evaluated during Detection Monitoring; Appendix IV = parameters evaluated during Assessment Monitoring.
- Well no longer sampled as part of background monitoring due to well replacement, proximity to closure activities, or modifications to the proposed well network.
- NS indicates not sampled due to resampling for selected constituents on this date . * indicates a resample event.

LABORATORY ANALYTICAL DATA

August – September 2016



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Laboratory Report

Prepared For:

Georgia Power
2480 Maner Road
Atlanta, GA 30339

Attention: Mr. Joju Abraham

Report Number: AZI0088

September 14, 2016

Project: CCR Event

Project #: Plant McDonough

We appreciate the opportunity to provide the analytical support for your project. The analytical results in this report are based upon information supplied by you, the client, and are for your exclusive use. If you have any questions regarding this data package, please do not hesitate to call.

Approved:

A handwritten signature in black ink, appearing to read "Maya Tarko", written over a horizontal line.

Project Manager

This report may not be reproduced, except in full, without written approval from Pace Analytical Services, Inc.
All test results relate only to the samples analyzed.



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

September 14, 2016

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
DGWC-20	AZI0088-01	Ground Water	09/02/16 09:00	09/02/16 15:05
DGWC-21	AZI0088-02	Ground Water	09/02/16 10:15	09/02/16 15:05
DGWC-22	AZI0088-03	Ground Water	09/02/16 11:25	09/02/16 15:05
DGWC-40	AZI0088-04	Ground Water	09/02/16 12:45	09/02/16 15:05



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

September 14, 2016

Report No.: AZI0088

Project: CCR Event

Client ID: DGWC-20

Lab Number ID: AZI0088-01

Date/Time Sampled: 9/2/2016 9:00:00AM

Date/Time Received: 9/2/2016 3:05:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	1100	25	10	mg/L	SM 2540 C		1	09/07/16 21:25	09/07/16 21:25	6090136	JPT
Inorganic Anions											
Chloride	15	0.25	0.01	mg/L	EPA 300.0	B-01	1	09/05/16 10:11	09/06/16 02:54	6090088	RLC
Fluoride	0.66	0.30	0.02	mg/L	EPA 300.0		1	09/05/16 10:11	09/06/16 02:54	6090088	RLC
Sulfate	580	50	2.6	mg/L	EPA 300.0		50	09/05/16 10:11	09/07/16 04:19	6090088	RLC
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 18:58	6090169	CSW
Arsenic	0.0159	0.0050	0.0016	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 18:58	6090169	CSW
Barium	0.0097	0.0100	0.0004	mg/L	EPA 6020B	J	1	09/08/16 10:40	09/09/16 18:58	6090169	CSW
Beryllium	0.0026	0.0030	0.00008	mg/L	EPA 6020B	J	1	09/08/16 10:40	09/09/16 18:58	6090169	CSW
Boron	6.77	1.00	0.0642	mg/L	EPA 6020B		10	09/08/16 10:40	09/12/16 16:23	6090169	CSW
Cadmium	0.0023	0.0010	0.00007	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 18:58	6090169	CSW
Calcium	96.3	5.00	0.311	mg/L	EPA 6020B		10	09/08/16 10:40	09/12/16 16:23	6090169	CSW
Chromium	0.0017	0.0100	0.0009	mg/L	EPA 6020B	J	1	09/08/16 10:40	09/09/16 18:58	6090169	CSW
Cobalt	0.497	0.0100	0.0005	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 18:58	6090169	CSW
Lead	ND	0.0050	0.0006	mg/L	EPA 6020B	R-01	5	09/08/16 10:40	09/13/16 12:28	6090169	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 18:58	6090169	CSW
Selenium	0.0671	0.0100	0.0010	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 18:58	6090169	CSW
Thallium	ND	0.0020	0.0010	mg/L	EPA 6020B	R-01	5	09/08/16 10:40	09/13/16 12:28	6090169	CSW
Lithium	0.0021	0.0500	0.0021	mg/L	EPA 6020B	J	1	09/08/16 10:40	09/09/16 18:58	6090169	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	09/06/16 11:30	09/06/16 17:35	6090109	MTC



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

September 14, 2016

Report No.: AZI0088

Project: CCR Event

Client ID: DGWC-21

Lab Number ID: AZI0088-02

Date/Time Sampled: 9/2/2016 10:15:00AM

Date/Time Received: 9/2/2016 3:05:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	459	25	10	mg/L	SM 2540 C		1	09/07/16 21:25	09/07/16 21:25	6090136	JPT
Inorganic Anions											
Chloride	25	0.25	0.01	mg/L	EPA 300.0	B-01	1	09/05/16 10:11	09/06/16 03:15	6090088	RLC
Fluoride	0.07	0.30	0.02	mg/L	EPA 300.0	J	1	09/05/16 10:11	09/06/16 03:15	6090088	RLC
Sulfate	300	50	2.6	mg/L	EPA 300.0		50	09/05/16 10:11	09/07/16 06:02	6090088	RLC
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:15	6090169	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:15	6090169	CSW
Barium	0.0252	0.0100	0.0004	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:15	6090169	CSW
Beryllium	0.0001	0.0030	0.00008	mg/L	EPA 6020B	J	1	09/08/16 10:40	09/09/16 19:15	6090169	CSW
Boron	4.81	1.00	0.0642	mg/L	EPA 6020B		10	09/08/16 10:40	09/12/16 16:29	6090169	CSW
Cadmium	0.0006	0.0010	0.00007	mg/L	EPA 6020B	J	1	09/08/16 10:40	09/09/16 19:15	6090169	CSW
Calcium	70.2	5.00	0.311	mg/L	EPA 6020B		10	09/08/16 10:40	09/12/16 16:29	6090169	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:15	6090169	CSW
Cobalt	0.0085	0.0100	0.0005	mg/L	EPA 6020B	J	1	09/08/16 10:40	09/09/16 19:15	6090169	CSW
Lead	0.0002	0.0050	0.0001	mg/L	EPA 6020B	J	1	09/08/16 10:40	09/09/16 19:15	6090169	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:15	6090169	CSW
Selenium	ND	0.0100	0.0010	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:15	6090169	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:15	6090169	CSW
Lithium	0.0057	0.0500	0.0021	mg/L	EPA 6020B	J	1	09/08/16 10:40	09/09/16 19:15	6090169	CSW
Mercury	0.00006	0.00050	0.000041	mg/L	EPA 7470A	J	1	09/06/16 11:30	09/06/16 17:37	6090109	MTC



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

September 14, 2016

Report No.: AZI0088

Project: CCR Event

Client ID: DGWC-22

Lab Number ID: AZI0088-03

Date/Time Sampled: 9/2/2016 11:25:00AM

Date/Time Received: 9/2/2016 3:05:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	502	25	10	mg/L	SM 2540 C		1	09/07/16 21:25	09/07/16 21:25	6090136	JPT
Inorganic Anions											
Chloride	30	0.25	0.01	mg/L	EPA 300.0	B-01	1	09/05/16 10:11	09/06/16 03:36	6090088	RLC
Fluoride	0.30	0.30	0.02	mg/L	EPA 300.0		1	09/05/16 10:11	09/06/16 03:36	6090088	RLC
Sulfate	140	10	0.51	mg/L	EPA 300.0		10	09/05/16 10:11	09/07/16 06:24	6090088	RLC
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:21	6090169	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:21	6090169	CSW
Barium	0.0397	0.0100	0.0004	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:21	6090169	CSW
Beryllium	0.0002	0.0030	0.00008	mg/L	EPA 6020B	J	1	09/08/16 10:40	09/09/16 19:21	6090169	CSW
Boron	3.99	1.00	0.0642	mg/L	EPA 6020B		10	09/08/16 10:40	09/12/16 16:35	6090169	CSW
Cadmium	0.0003	0.0010	0.00007	mg/L	EPA 6020B	J	1	09/08/16 10:40	09/09/16 19:21	6090169	CSW
Calcium	61.6	5.00	0.311	mg/L	EPA 6020B		10	09/08/16 10:40	09/12/16 16:35	6090169	CSW
Chromium	0.0012	0.0100	0.0009	mg/L	EPA 6020B	J	1	09/08/16 10:40	09/09/16 19:21	6090169	CSW
Cobalt	0.0102	0.0100	0.0005	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:21	6090169	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:21	6090169	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:21	6090169	CSW
Selenium	ND	0.0100	0.0010	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:21	6090169	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:21	6090169	CSW
Lithium	0.0046	0.0500	0.0021	mg/L	EPA 6020B	J	1	09/08/16 10:40	09/09/16 19:21	6090169	CSW
Mercury	0.00005	0.00050	0.000041	mg/L	EPA 7470A	J	1	09/06/16 11:30	09/06/16 17:39	6090109	MTC



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

September 14, 2016

Report No.: AZI0088

Project: CCR Event

Client ID: DGWC-40

Lab Number ID: AZI0088-04

Date/Time Sampled: 9/2/2016 12:45:00PM

Date/Time Received: 9/2/2016 3:05:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	583	25	10	mg/L	SM 2540 C		1	09/07/16 21:25	09/07/16 21:25	6090136	JPT
Inorganic Anions											
Chloride	20	0.25	0.01	mg/L	EPA 300.0	B-01	1	09/05/16 10:11	09/06/16 03:57	6090088	RLC
Fluoride	0.50	0.30	0.02	mg/L	EPA 300.0		1	09/05/16 10:11	09/06/16 03:57	6090088	RLC
Sulfate	230	5.0	0.26	mg/L	EPA 300.0		5	09/05/16 10:11	09/07/16 06:45	6090088	RLC
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:27	6090169	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:27	6090169	CSW
Barium	0.0171	0.0100	0.0004	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:27	6090169	CSW
Beryllium	0.0028	0.0030	0.00008	mg/L	EPA 6020B	J	1	09/08/16 10:40	09/09/16 19:27	6090169	CSW
Boron	0.895	0.100	0.0064	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:27	6090169	CSW
Cadmium	0.0008	0.0010	0.00007	mg/L	EPA 6020B	J	1	09/08/16 10:40	09/09/16 19:27	6090169	CSW
Calcium	39.6	2.50	0.155	mg/L	EPA 6020B		5	09/08/16 10:40	09/12/16 16:40	6090169	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:27	6090169	CSW
Cobalt	0.0382	0.0100	0.0005	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:27	6090169	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:27	6090169	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:27	6090169	CSW
Selenium	0.0019	0.0100	0.0010	mg/L	EPA 6020B	J	1	09/08/16 10:40	09/09/16 19:27	6090169	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	09/08/16 10:40	09/09/16 19:27	6090169	CSW
Lithium	0.0022	0.0500	0.0021	mg/L	EPA 6020B	J	1	09/08/16 10:40	09/09/16 19:27	6090169	CSW
Mercury	0.000044	0.00050	0.000041	mg/L	EPA 7470A	J	1	09/06/16 11:30	09/06/16 17:42	6090109	MTC



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

September 14, 2016

Report No.: AZI0088

General Chemistry - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 6090136 - SM 2540 C											
Blank (6090136-BLK1)						Prepared & Analyzed: 09/07/16					
Total Dissolved Solids	ND	25	10	mg/L							
LCS (6090136-BS1)						Prepared & Analyzed: 09/07/16					
Total Dissolved Solids	407	25	10	mg/L	400.00		102	84-108			
Duplicate (6090136-DUP1)						Source: AZI0077-07			Prepared & Analyzed: 09/07/16		
Total Dissolved Solids	694	25	10	mg/L		702			1	10	
Duplicate (6090136-DUP2)						Source: AZI0094-01			Prepared & Analyzed: 09/07/16		
Total Dissolved Solids	228	25	10	mg/L		243			6	10	



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

September 14, 2016

Report No.: AZI0088

Inorganic Anions - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 6090088 - EPA 300.0											
Blank (6090088-BLK1)						Prepared & Analyzed: 09/05/16					
Chloride	0.05	0.25	0.01	mg/L							J
Fluoride	ND	0.30	0.02	mg/L							
Sulfate	ND	1.0	0.05	mg/L							
LCS (6090088-BS1)						Prepared & Analyzed: 09/05/16					
Chloride	10.1	0.25	0.01	mg/L	10.010		101	90-110			
Fluoride	10.0	0.30	0.02	mg/L	10.010		100	90-110			
Sulfate	10.2	1.0	0.05	mg/L	10.010		102	90-110			
Matrix Spike (6090088-MS1)						Source: AZI0050-01			Prepared & Analyzed: 09/05/16		
Chloride	466	0.25	0.01	mg/L	10.010	478	NR	90-110			QM-02
Fluoride	11.8	0.30	0.02	mg/L	10.010	0.34	114	90-110			QM-05
Sulfate	275	1.0	0.05	mg/L	10.010	291	NR	90-110			QM-02
Matrix Spike (6090088-MS2)						Source: AZI0059-03			Prepared: 09/05/16 Analyzed: 09/06/16		
Chloride	13.9	0.25	0.01	mg/L	10.010	3.33	105	90-110			
Fluoride	10.9	0.30	0.02	mg/L	10.010	0.20	107	90-110			
Sulfate	12.7	1.0	0.05	mg/L	10.010	2.66	101	90-110			
Matrix Spike Dup (6090088-MSD1)						Source: AZI0050-01			Prepared & Analyzed: 09/05/16		
Chloride	486	0.25	0.01	mg/L	10.010	478	84	90-110	4	15	QM-02
Fluoride	11.7	0.30	0.02	mg/L	10.010	0.34	114	90-110	0.4	15	QM-05
Sulfate	275	1.0	0.05	mg/L	10.010	291	NR	90-110	0.1	15	QM-02



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

September 14, 2016

Report No.: AZI0088

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 6090109 - EPA 7470A											
Blank (6090109-BLK1) Prepared & Analyzed: 09/06/16											
Mercury	ND	0.00050	0.000041	mg/L							
LCS (6090109-BS1) Prepared & Analyzed: 09/06/16											
Mercury	0.00236	0.00050	0.000041	mg/L	2.5000E-3		94	80-120			
Matrix Spike (6090109-MS1) Source: AZI0077-04 Prepared & Analyzed: 09/06/16											
Mercury	0.00236	0.00050	0.000041	mg/L	2.5000E-3	ND	95	75-125			
Matrix Spike Dup (6090109-MSD1) Source: AZI0077-04 Prepared & Analyzed: 09/06/16											
Mercury	0.00237	0.00050	0.000041	mg/L	2.5000E-3	ND	95	75-125	0.1	20	
Post Spike (6090109-PS1) Source: AZI0077-04 Prepared & Analyzed: 09/06/16											
Mercury	1.68			ug/L	1.6667	0.00330	100	80-120			
Batch 6090169 - EPA 3005A											
Blank (6090169-BLK1) Prepared: 09/08/16 Analyzed: 09/09/16											
Antimony	ND	0.0030	0.0008	mg/L							
Arsenic	ND	0.0050	0.0016	mg/L							
Barium	ND	0.0100	0.0004	mg/L							
Beryllium	ND	0.0030	0.00008	mg/L							
Boron	ND	0.100	0.0064	mg/L							
Cadmium	ND	0.0010	0.00007	mg/L							
Calcium	ND	0.500	0.0311	mg/L							
Chromium	ND	0.0100	0.0009	mg/L							
Cobalt	ND	0.0100	0.0005	mg/L							
Copper	ND	0.0050	0.0005	mg/L							
Lead	ND	0.0050	0.0001	mg/L							
Molybdenum	ND	0.0100	0.0017	mg/L							
Nickel	ND	0.0050	0.0006	mg/L							
Selenium	ND	0.0100	0.0010	mg/L							
Silver	ND	0.0050	0.0005	mg/L							
Thallium	ND	0.0010	0.0002	mg/L							
Vanadium	ND	0.0100	0.0071	mg/L							
Zinc	ND	0.0100	0.0021	mg/L							
Lithium	ND	0.0500	0.0021	mg/L							



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

September 14, 2016

Report No.: AZI0088

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 6090169 - EPA 3005A											
LCS (6090169-BS1)						Prepared: 09/08/16 Analyzed: 09/09/16					
Antimony	0.106	0.0030	0.0008	mg/L	0.10000		106	80-120			
Arsenic	0.0993	0.0050	0.0016	mg/L	0.10000		99	80-120			
Barium	0.0945	0.0100	0.0004	mg/L	0.10000		94	80-120			
Beryllium	0.0976	0.0030	0.00008	mg/L	0.10000		98	80-120			
Boron	1.02	0.100	0.0064	mg/L	1.0000		102	80-120			
Cadmium	0.103	0.0010	0.00007	mg/L	0.10000		103	80-120			
Calcium	0.979	0.500	0.0311	mg/L	1.0000		98	80-120			
Chromium	0.103	0.0100	0.0009	mg/L	0.10000		103	80-120			
Cobalt	0.0986	0.0100	0.0005	mg/L	0.10000		99	80-120			
Copper	0.0990	0.0050	0.0005	mg/L	0.10000		99	80-120			
Lead	0.102	0.0050	0.0001	mg/L	0.10000		102	80-120			
Molybdenum	0.0997	0.0100	0.0017	mg/L	0.10000		100	80-120			
Nickel	0.0987	0.0050	0.0006	mg/L	0.10000		99	80-120			
Selenium	0.0990	0.0100	0.0010	mg/L	0.10000		99	80-120			
Silver	0.100	0.0050	0.0005	mg/L	0.10000		100	80-120			
Thallium	0.100	0.0010	0.0002	mg/L	0.10000		100	80-120			
Vanadium	0.0993	0.0100	0.0071	mg/L	0.10000		99	80-120			
Zinc	0.100	0.0100	0.0021	mg/L	0.10000		100	80-120			
Lithium	0.0988	0.0500	0.0021	mg/L	0.10000		99	80-120			
Matrix Spike (6090169-MS1)						Source: AZI0077-17 Prepared: 09/08/16 Analyzed: 09/09/16					
Antimony	0.106	0.0030	0.0008	mg/L	0.10000	ND	106	75-125			
Arsenic	0.102	0.0050	0.0016	mg/L	0.10000	ND	102	75-125			
Barium	0.169	0.0100	0.0004	mg/L	0.10000	0.0759	93	75-125			
Beryllium	0.0930	0.0030	0.00008	mg/L	0.10000	ND	93	75-125			
Boron	1.94	1.00	0.0642	mg/L	1.0000	0.888	105	75-125			
Cadmium	0.0991	0.0010	0.00007	mg/L	0.10000	0.0004	99	75-125			
Calcium	96.8	5.00	0.311	mg/L	1.0000	95.9	82	75-125			
Chromium	0.105	0.0100	0.0009	mg/L	0.10000	ND	105	75-125			
Cobalt	0.0997	0.0100	0.0005	mg/L	0.10000	ND	100	75-125			
Copper	0.0960	0.0050	0.0005	mg/L	0.10000	ND	96	75-125			
Lead	0.0960	0.0050	0.0001	mg/L	0.10000	ND	96	75-125			
Molybdenum	0.125	0.0100	0.0017	mg/L	0.10000	0.0266	98	75-125			
Nickel	0.102	0.0050	0.0006	mg/L	0.10000	0.0011	101	75-125			
Selenium	0.0978	0.0100	0.0010	mg/L	0.10000	ND	98	75-125			
Silver	0.0977	0.0050	0.0005	mg/L	0.10000	ND	98	75-125			
Thallium	0.0966	0.0010	0.0002	mg/L	0.10000	ND	97	75-125			
Vanadium	0.103	0.0100	0.0071	mg/L	0.10000	ND	103	75-125			
Zinc	0.100	0.0100	0.0021	mg/L	0.10000	0.0027	98	75-125			
Lithium	0.0941	0.0500	0.0021	mg/L	0.10000	0.0024	92	75-125			



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

September 14, 2016

Report No.: AZI0088

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 6090169 - EPA 3005A											
Matrix Spike Dup (6090169-MSD1)			Source: AZI0077-17			Prepared: 09/08/16 Analyzed: 09/09/16					
Antimony	0.103	0.0030	0.0008	mg/L	0.10000	ND	103	75-125	3	20	
Arsenic	0.101	0.0050	0.0016	mg/L	0.10000	ND	101	75-125	0.8	20	
Barium	0.168	0.0100	0.0004	mg/L	0.10000	0.0759	92	75-125	0.7	20	
Beryllium	0.0960	0.0030	0.00008	mg/L	0.10000	ND	96	75-125	3	20	
Boron	1.96	1.00	0.0642	mg/L	1.0000	0.888	107	75-125	0.8	20	
Cadmium	0.0992	0.0010	0.00007	mg/L	0.10000	0.0004	99	75-125	0.09	20	
Calcium	98.6	5.00	0.311	mg/L	1.0000	95.9	263	75-125	2	20	QM-02
Chromium	0.107	0.0100	0.0009	mg/L	0.10000	ND	107	75-125	2	20	
Cobalt	0.100	0.0100	0.0005	mg/L	0.10000	ND	100	75-125	0.5	20	
Copper	0.0975	0.0050	0.0005	mg/L	0.10000	ND	97	75-125	2	20	
Lead	0.0973	0.0050	0.0001	mg/L	0.10000	ND	97	75-125	1	20	
Molybdenum	0.126	0.0100	0.0017	mg/L	0.10000	0.0266	100	75-125	1	20	
Nickel	0.100	0.0050	0.0006	mg/L	0.10000	0.0011	99	75-125	2	20	
Selenium	0.0955	0.0100	0.0010	mg/L	0.10000	ND	95	75-125	2	20	
Silver	0.0938	0.0050	0.0005	mg/L	0.10000	ND	94	75-125	4	20	
Thallium	0.0982	0.0010	0.0002	mg/L	0.10000	ND	98	75-125	2	20	
Vanadium	0.106	0.0100	0.0071	mg/L	0.10000	ND	106	75-125	3	20	
Zinc	0.104	0.0100	0.0021	mg/L	0.10000	0.0027	102	75-125	4	20	
Lithium	0.0983	0.0500	0.0021	mg/L	0.10000	0.0024	96	75-125	4	20	
Post Spike (6090169-PS1)			Source: AZI0077-17			Prepared: 09/08/16 Analyzed: 09/09/16					
Antimony	101			ug/L	100.00	0.299	101	80-120			
Arsenic	102			ug/L	100.00	0.235	101	80-120			
Barium	175			ug/L	100.00	75.9	99	80-120			
Beryllium	97.5			ug/L	100.00	0.0116	97	80-120			
Boron	1910			ug/L	1000.0	888	102	80-120			
Cadmium	101			ug/L	100.00	0.400	101	80-120			
Calcium	98600			ug/L	1000.0	95900	262	80-120			QM-02
Chromium	101			ug/L	100.00	0.306	101	80-120			
Cobalt	95.3			ug/L	100.00	0.465	95	80-120			
Copper	93.2			ug/L	100.00	0.123	93	80-120			
Lead	94.2			ug/L	100.00	0.0087	94	80-120			
Molybdenum	128			ug/L	100.00	26.6	101	80-120			
Nickel	94.4			ug/L	100.00	1.09	93	80-120			
Selenium	95.4			ug/L	100.00	-0.575	96	80-120			
Silver	97.8			ug/L	100.00	0.0070	98	80-120			
Thallium	95.3			ug/L	100.00	0.0424	95	80-120			
Vanadium	98.9			ug/L	100.00	0.409	99	80-120			
Zinc	101			ug/L	100.00	2.66	98	80-120			
Lithium	101			ug/L	100.00	2.37	98	80-120			



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

September 14, 2016

Legend

Definition of Laboratory Terms

- ND** - Not Detected at levels equal to or greater than the MDL
BRL - Not Detected at levels equal to or greater than the RL
RL - Reporting Limit **MDL** - Method Detection Limit
SOP - Method run per Pace Standard Operating Procedure
CFU - Colony Forming Units
DF - Dilution Factor **TIC** - Tentatively Identified Compound

Sample Information

N-Nitrosodiphenylamine breaks down to diphenylamine in the GCMS; both analytes are reported as N-Nitrosodiphenylamine. Pace is not NELAC certified for N-Nitrosodiphenylamine.

Phthalic acid and phthalic anhydride are reported as dimethyl phthalate

Maleic acid and maleic anhydride are reported as dimethyl malate

1,2-Diphenylhydrazine breaks down to azobenzene in the GCMS; both analytes are reported as azobenzene

Definition of Qualifiers

- R-01** Elevated reporting limit due to matrix interference.
- QM-05** The spike recovery was outside acceptance limits for the MS and/or MSD and/or PDS due to suspected matrix interference. Sample results for the QC batch were accepted based on acceptable LCS recoveries.
- QM-02** The spike recovery is outside acceptance limits due to insignificant spike amount as compared to sample concentration.
- J** Estimated value less than Reporting Limit (RL) but greater than Method Detection Limit(MDL) (CLP J-Flag).
- B-01** Analyte was detected in the associated method blank at an estimated level equal to or greater than the MDL. Sample values reported as greater than the MDL and less than 10x the method blank value are reported as estimated values.

Note: Unless otherwise noted, all results are reported on an as received basis.

CHAIN OF CUSTODY RECORD

Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

PAGE: _____ OF _____

CLIENT NAME: Georgia Power CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE 810185 Atlanta, GA 30308 404-506-7239		REPORT TO: Jiju Abraham Health McCormick		CC: Maria Padilla Health McCormick		PO #: laburch@southernco.com		PROJECT NAME/STATE: Plant McDonough AP	
PROJECT #: 1663199 Phase II CCR		ANALYSIS REQUESTED		CONTAINER TYPE PRESERVATION		CONTAINER TYPE PRESERVATION		LAB #:	
METALS App. III & IV (EPA 6020/7470) CL, F, SO ₄ & TDS (EPA 300.0 & SM 2540C) Radium 226 & 228 (SV-846 8315/9320)		P 3 P 7 P 3		P 3 P 7 P 3		P - PLASTIC A - AMBER GLASS G - CLEAR GLASS V - VOA VIAL S - STERILE O - OTHER		1 - HCl, 56°C 2 - H ₂ SO ₄ , 56°C 3 - HNO ₃ 4 - NaOH, 56°C 5 - NaOH/ZnAc, 56°C 6 - Na ₂ S ₂ O ₃ , 56°C 7 - 56°C not frozen	
CONTAINERS		CONTAINERS		MATRIX CODES: DW - DRINKING WATER WW - WASTEWATER GW - GROUNDWATER SW - SURFACE WATER ST - STORM WATER W - WATER		MATRIX CODES: S - SOIL SL - SLUDGE SD - SOLID A - AIR L - LIQUID P - PRODUCT		REMARKS/ADDITIONAL INFORMATION	
Collection DATE	Collection TIME	MATRIX CODE*	COMPARISON	SAMPLE IDENTIFICATION	# of CONTAINERS	RELINQUISHED BY:	DATE/TIME:	LAB #:	FOR LAB USE ONLY
9/2/16	0900	GW	X	D6WC-20	3	Den Hooges Feilread	9/2/16 1500	A21088	
9/2/16	1015	GW	X	D6WC-21	3				
9/2/16	1125	GW	X	D6WC-22	3				
9/2/16	1245	GW	X	D6WC-40	3				
SAMPLED BY AND TITLE: Den Hooges Feilread		DATE/TIME: 9/2/16 1500		RELINQUISHED BY:		DATE/TIME:		Entered into LIMS:	
RECEIVED BY:		DATE/TIME:		RELINQUISHED BY:		DATE/TIME:		Tracking #:	
RECEIVED BY LAB: Jiju Abraham		DATE/TIME: 9/2/16 1500		SAMPLE SHIPPED VIA: UPS		CARRIER: CLIENT		OTHER FS	
pH checked: Yes/No		Temperature: 42°C Min/44°C Max		Initial Broken		# of Coolers		Cooler ID:	

Plant McDonough COC Phase II CCR.xlsx



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

LOG-IN CHECKLIST

Printed: 9/14/2016 2:34:42PM

Attn: Mr. Joju Abraham

Client: Georgia Power

Project: CCR Event

Date Received: 09/02/16 15:05

Work Order: AZI0088

Logged In By: Mohammad M. Rahman

OBSERVATIONS

#Samples: 4

#Containers: 12

Minimum Temp(C): 4.0

Maximum Temp(C): 4.0

Custody Seal(s) Used: Yes

CHECKLIST ITEMS

- COC included with Samples YES
- Sample Container(s) Intact YES
- Chain of Custody Complete YES
- Sample Container(s) Match COC YES
- Custody seal Intact YES
- Temperature in Compliance YES
- Sufficient Sample Volume for Analysis YES
- Zero Headspace Maintained for VOA Analyses YES
- Samples labeled preserved (If Applicable) YES
- Samples received within Allowable Hold Times YES
- Samples Received on Ice YES
- Preservation Confirmed YES

Comments:



October 04, 2016

Maria Padilla
GA Power
2480 Maner Rd
Atlanta, GA 30339

RE: Project: Plant McDonough AP
Pace Project No.: 30195121

Dear Maria Padilla:

Enclosed are the analytical results for sample(s) received by the laboratory on September 06, 2016. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,

Jacquelyn Collins
jacquelyn.collins@pacelabs.com
Project Manager

Enclosures



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



CERTIFICATIONS

Project: Plant McDonough AP
Pace Project No.: 30195121

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601
L-A-B DOD-ELAP Accreditation #: L2417

Alabama Certification #: 41590

Arizona Certification #: AZ0734

Arkansas Certification

California Certification #: 04222CA

Colorado Certification

Connecticut Certification #: PH-0694

Delaware Certification

Florida/TNI Certification #: E87683

Georgia Certification #: C040

Guam Certification

Hawaii Certification

Idaho Certification

Illinois Certification

Indiana Certification

Iowa Certification #: 391

Kansas/TNI Certification #: E-10358

Kentucky Certification #: 90133

Louisiana DHH/TNI Certification #: LA140008

Louisiana DEQ/TNI Certification #: 4086

Maine Certification #: PA00091

Maryland Certification #: 308

Massachusetts Certification #: M-PA1457

Michigan/PADEP Certification

Missouri Certification #: 235

Montana Certification #: Cert 0082

Nebraska Certification #: NE-05-29-14

Nevada Certification #: PA014572015-1

New Hampshire/TNI Certification #: 2976

New Jersey/TNI Certification #: PA 051

New Mexico Certification #: PA01457

New York/TNI Certification #: 10888

North Carolina Certification #: 42706

North Dakota Certification #: R-190

Oregon/TNI Certification #: PA200002

Pennsylvania/TNI Certification #: 65-00282

Puerto Rico Certification #: PA01457

Rhode Island Certification #: 65-00282

South Dakota Certification

Tennessee Certification #: TN2867

Texas/TNI Certification #: T104704188-14-8

Utah/TNI Certification #: PA014572015-5

USDA Soil Permit #: P330-14-00213

Vermont Dept. of Health: ID# VT-0282

Virgin Island/PADEP Certification

Virginia/VELAP Certification #: 460198

Washington Certification #: C868

West Virginia DEP Certification #: 143

West Virginia DHHR Certification #: 9964C

Wisconsin Certification

Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



SAMPLE SUMMARY

Project: Plant McDonough AP
Pace Project No.: 30195121

Lab ID	Sample ID	Matrix	Date Collected	Date Received
30195121001	DGWC-20	Water	09/02/16 09:00	09/06/16 08:50
30195121002	DGWC-21	Water	09/02/16 10:15	09/06/16 08:50
30195121003	DGWC-22	Water	09/02/16 11:25	09/06/16 08:50
30195121004	DGWC-40	Water	09/02/16 12:45	09/06/16 08:50

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



SAMPLE ANALYTE COUNT

Project: Plant McDonough AP
 Pace Project No.: 30195121

Lab ID	Sample ID	Method	Analysts	Analytes Reported
30195121001	DGWC-20	EPA 9315	WRR	1
		EPA 9320	JLW	1
		Total Radium Calculation	CMC	1
30195121002	DGWC-21	EPA 9315	WRR	1
		EPA 9320	JLW	1
		Total Radium Calculation	CMC	1
30195121003	DGWC-22	EPA 9315	WRR	1
		EPA 9320	JLW	1
		Total Radium Calculation	CMC	1
30195121004	DGWC-40	EPA 9315	WRR	1
		EPA 9320	JLW	1
		Total Radium Calculation	CMC	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
 without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough AP
 Pace Project No.: 30195121

Sample: DGWC-20		Lab ID: 30195121001	Collected: 09/02/16 09:00	Received: 09/06/16 08:50	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.149 ± 0.126 (0.239) C:89% T:NA	pCi/L	09/16/16 08:19	13982-63-3	
Radium-228	EPA 9320	1.33 ± 0.411 (0.493) C:76% T:85%	pCi/L	09/23/16 01:46	15262-20-1	
Total Radium	Total Radium Calculation	1.48 ± 0.537 (0.732)	pCi/L	10/03/16 15:46	7440-14-4	

Sample: DGWC-21		Lab ID: 30195121002	Collected: 09/02/16 10:15	Received: 09/06/16 08:50	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.177 ± 0.142 (0.268) C:89% T:NA	pCi/L	09/16/16 08:19	13982-63-3	
Radium-228	EPA 9320	0.731 ± 0.402 (0.717) C:74% T:78%	pCi/L	09/23/16 01:58	15262-20-1	
Total Radium	Total Radium Calculation	0.908 ± 0.544 (0.985)	pCi/L	10/03/16 15:46	7440-14-4	

Sample: DGWC-22		Lab ID: 30195121003	Collected: 09/02/16 11:25	Received: 09/06/16 08:50	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.227 ± 0.134 (0.214) C:86% T:NA	pCi/L	09/16/16 08:20	13982-63-3	
Radium-228	EPA 9320	1.31 ± 0.483 (0.732) C:77% T:78%	pCi/L	09/23/16 01:58	15262-20-1	
Total Radium	Total Radium Calculation	1.54 ± 0.617 (0.946)	pCi/L	10/03/16 15:46	7440-14-4	

Sample: DGWC-40		Lab ID: 30195121004	Collected: 09/02/16 12:45	Received: 09/06/16 08:50	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.0392 ± 0.0966 (0.221) C:84% T:NA	pCi/L	09/16/16 08:20	13982-63-3	
Radium-228	EPA 9320	1.40 ± 0.449 (0.573) C:76% T:79%	pCi/L	09/23/16 01:46	15262-20-1	
Total Radium	Total Radium Calculation	1.44 ± 0.546 (0.794)	pCi/L	10/03/16 15:46	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
 without the written consent of Pace Analytical Services, LLC.



QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough AP
Pace Project No.: 30195121

QC Batch: 232977 Analysis Method: EPA 9315
QC Batch Method: EPA 9315 Analysis Description: 9315 Total Radium
Associated Lab Samples: 30195121001, 30195121002, 30195121003, 30195121004

METHOD BLANK: 1141794 Matrix: Water
Associated Lab Samples: 30195121001, 30195121002, 30195121003, 30195121004

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.177 ± 0.109 (0.163) C:88% T:NA	pCi/L	09/16/16 08:18	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough AP
 Pace Project No.: 30195121

QC Batch: 232983 Analysis Method: EPA 9320
 QC Batch Method: EPA 9320 Analysis Description: 9320 Radium 228
 Associated Lab Samples: 30195121001, 30195121002, 30195121003, 30195121004

METHOD BLANK: 1141811 Matrix: Water
 Associated Lab Samples: 30195121001, 30195121002, 30195121003, 30195121004

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.562 ± 0.343 (0.628) C:77% T:84%	pCi/L	09/23/16 01:56	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
 without the written consent of Pace Analytical Services, LLC.



QUALIFIERS

Project: Plant McDonough AP
Pace Project No.: 30195121

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.
ND - Not Detected at or above adjusted reporting limit.
J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.
MDL - Adjusted Method Detection Limit.
PQL - Practical Quantitation Limit.
RL - Reporting Limit.
S - Surrogate
1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.
Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.
LCS(D) - Laboratory Control Sample (Duplicate)
MS(D) - Matrix Spike (Duplicate)
DUP - Sample Duplicate
RPD - Relative Percent Difference
NC - Not Calculable.
SG - Silica Gel - Clean-Up
U - Indicates the compound was analyzed for, but not detected.
N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.
Act - Activity
Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).
Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)
(MDC) - Minimum Detectable Concentration
Trac - Tracer Recovery (%)
Carr - Carrier Recovery (%)
Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.
TNI - The NELAC Institute.

SAMPLE QUALIFIERS

Sample: 30195121001

[1] The sampler's signature was not listed on the COC and the relinquished by was not signed and dated.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CHAIN OF CUSTODY RECORD

PAGE: 1 OF 1

CLIENT NAME: Georgia Power CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185 Atlanta, GA 30308 404-506-7239		REPORT TO: Joju Abraham CC: Maria Padilla Heath McCorkle PO #: laburch@southerncco.com		PROJECT NAME/STATE: Plant McDonough AP Phase II CCR		PROJECT #: 1663199	
CONTAINER TYPE: PRESERVATION: 3 # of CONTAINERS: 3		ANALYSIS REQUESTED: Metals App. III & IV (EPA 6020/7470) Cl, F, SO ₄ & TDS (EPA 300.0 & SM 2540C) Radium 226 & 228 (5W-846 9315/9320)		CONTAINER TYPE: PRESERVATION: 3 # of CONTAINERS: 3		ANALYSIS REQUESTED: Metals App. III & IV (EPA 6020/7470) Cl, F, SO ₄ & TDS (EPA 300.0 & SM 2540C) Radium 226 & 228 (5W-846 9315/9320)	
CONTAINER TYPE: P - PLASTIC A - AMBER GLASS G - CLEAR GLASS V - VOA VIAL S - STERILE O - OTHER		PRESERVATION: 1 - HCl, 56°C 2 - H ₂ SO ₄ , 56°C 3 - HNO ₃ 4 - NaOH, 56°C 5 - NaOH/ZnAc, 56°C 6 - Na ₂ S ₂ O ₃ , 56°C 7 - 56°C not frozen		*MATRIX CODES: DW - DRINKING WATER WW - WASTEWATER GW - GROUNDWATER SW - SURFACE WATER W - WATER S - SOIL SL - SLUDGE SD - SOLID A - AIR L - LIQUID P - PRODUCT		REMARKS/ADDITIONAL INFORMATION: 001 002 003 004	
LAB #: 30195121		DATE/TIME: DATE/TIME: 2/2/16 1500 DATE/TIME: 2/2/16 1500 DATE/TIME: 2/2/16 1500		RELINQUISHED BY: Den Hodges Field Lead RECEIVED BY: [Signature] RECEIVED BY LAB: [Signature]		FOR LAB USE ONLY: LAB #: 30195121 Entered into LIMS: [Blank] Tracking #: [Blank]	
RELINQUISHED BY: DATE/TIME: 2/2/16 1500		RELINQUISHED BY: DATE/TIME: 2/2/16 1500		SAMPLE SHIPPED VIA: UPS FED-EX USPS COURIER CLIENT OTHER FS Custody Seal: Intact Broken Not Present Temperature: Min: Max:		RELINQUISHED BY: DATE/TIME: 2/2/16 1500	

Sample Condition Upon Receipt Pittsburgh



Client Name: Pace, GA Project # 30195121

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: 6812 5098 8849

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Thermometer Used N/A Type of Ice: Wet Blue None

Cooler Temperature Observed Temp _____ °C Correction Factor: _____ °C Final Temp: _____ °C

Temp should be above freezing to 6°C

Date and Initials of person examining contents: 097R 9-6-16

Comments:	Yes	No	N/A	
Chain of Custody Present:	X			1.
Chain of Custody Filled Out:	X			2.
Chain of Custody Relinquished:	X			3.
Sampler Name & Signature on COC:		X		4. <u>No Signature</u>
Sample Labels match COC: -Includes date/time/ID/Analysis Matrix: <u>WT</u>	X			5.
Samples Arrived within Hold Time:	X			6.
Short Hold Time Analysis (<72hr remaining):		X		7.
Rush Turn Around Time Requested:		X		8.
Sufficient Volume:	X			9.
Correct Containers Used: -Pace Containers Used:	X			10.
Containers Intact:	X			11.
Filtered volume received for Dissolved tests			X	12.
All containers needing preservation have been checked.	X			13. <u>pHL2</u>
All containers needing preservation are found to be in compliance with EPA recommendation.	X			
exceptions: VOA, coliform, TOC, O&G, Phenolics				Initial when completed: <u>097R</u> Date/time of preservation: _____
				Lot # of added preservative: _____
Headspace in VOA Vials (>6mm):			X	14.
Trip Blank Present:		X		15.
Trip Blank Custody Seals Present			X	
Rad Aqueous Samples Screened > 0.5 mrem/hr		X		Initial when completed: <u>097R</u> Date: <u>9-6-16</u>

Client Notification/ Resolution:

Person Contacted: _____ Date/Time: _____ Contacted By: _____

Comments/ Resolution: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

*PM review is documented electronically in LIMS. When the Project Manager closes the SRF Review schedule in LIMS. The review is in the Status section of the Workorder Edit Screen.

Quality Control Sample Performance Assessment

Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: WRR
Date: 9/21/2016
Worklist: 31359
Matrix: DW



Method Blank Assessment

MB Sample ID: 1141794
MB concentration: 0.177
M/B Counting Uncertainty: 0.106
MB MDC: 0.163
MB Numerical Performance Indicator: 3.28
MB Status vs Numerical Indicator: N/A
MB Status vs. MDC: See Comment

Laboratory Control Sample Assessment

LCS# 13369 N LCS# 13359
Count Date: 9/16/2016
Spike I.D.: 16-026
Spike Concentration (pCi/mL): 44.677
Volume Used (mL): 0.10
Aliquot Volume (L, g, F): 0.498
Target Conc. (pCi/L, g, F): 8.971
Uncertainty (Calculated): 0.422
Result (pCi/L, g, F): 8.159
LCS/LCSD Counting Uncertainty (pCi/L, g, F): 0.589
Numerical Performance Indicator: -2.19
Percent Recovery: 90.96%
Status vs Numerical Indicator: N/A
Status vs Recovery: Pass

Duplicate Sample Assessment

Sample I.D.: 30195125002
Duplicate Sample I.D.: 30195125002DUP
Sample Result (pCi/L, g, F): 0.276
Sample Duplicate Result (pCi/L, g, F): 0.203
Sample Duplicate Result (pCi/L, g, F): 0.108
Sample Duplicate Result (pCi/L, g, F): 0.241
Are sample and/or duplicate results below MDC? See Below #
Duplicate Numerical Performance Indicator: 1.049
Duplicate RPD: 87.95%
Duplicate Status vs Numerical Indicator: N/A
Duplicate Status vs RPD: Fail***

*** Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

*The method blank result is below the reporting limit for this analysis and is acceptable.

***Batch must be re-prepped due to unacceptable precision.

Handwritten signature/initials

Sample Matrix Spike Control Assessment

Sample Collection Date:
Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Spike I.D.:
MS/MSD Decay Corrected Spike Concentration (pCi/mL):
Spike Volume Used in MS (mL):
Spike Volume Used in MSD (mL):
MS Aliquot (L, g, F):
MS Target Conc.(pCi/L, g, F):
MSD Aliquot (L, g, F):
MSD Target Conc. (pCi/L, g, F):
Spike uncertainty (calculated):
Sample Result:
Sample Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Sample Matrix Spike Duplicate Counting Uncertainty (pCi/L, g, F):
MS Numerical Performance Indicator:
MSD Numerical Performance Indicator:
MS Percent Recovery:
MSD Percent Recovery:
MS Status vs Numerical Indicator:
MSD Status vs Numerical Indicator:
MS Status vs Recovery:
MSD Status vs Recovery:

Matrix Spike/Matrix Spike Duplicate Sample Assessment

Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Sample Matrix Spike Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Sample Matrix Spike Duplicate Counting Uncertainty (pCi/L, g, F):
Duplicate Numerical Performance Indicator:
MS/MSD Duplicate RPD:
MS/MSD Duplicate Status vs Numerical Indicator:
MS/MSD Duplicate Status vs RPD:

Quality Control Sample Performance Assessment

Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-228
Analyst: JLW
Date: 9/15/2016
Worklist: 31364
Matrix: DW



Method Blank Assessment	
MB Sample ID	1141811
MB Concentration:	0.562
M/B Counting Uncertainty:	0.328
MB MDC:	0.628
MB Numerical Performance Indicator:	3.36
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment		N. N.
LCS#31364		LCS#31364
Count Date:	9/23/2016	
Spike I.D.:	16-025	
Spike Concentration (pCi/mL):	25.603	
Volume Used (mL):	0.20	
Aliquot Volume (L, g, F):	0.802	
Target Conc. (pCi/L, g, F):	6.385	
Uncertainty (Calculated):	0.460	
Result (pCi/L, g, F):	7.456	
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.639	
Numerical Performance Indicator:	2.67	
Percent Recovery:	116.77%	
Status vs Numerical Indicator:	N/A	
Status vs Recovery:	Pass	

Duplicate Sample Assessment	
Sample I.D.:	30195125002
Duplicate Sample I.D.:	30195125002DUP
Sample Result (pCi/L, g, F):	1.548
Sample Result Counting Uncertainty (pCi/L, g, F):	0.474
Sample Duplicate Result (pCi/L, g, F):	2.200
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.545
Are sample and/or duplicate results below MDC?	See Below ##
Duplicate Numerical Performance Indicator:	-1.767
Duplicate RPD:	34.76%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Pass

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

Sample Matrix Spike Control Assessment	
Sample Collection Date:	Sample I.D.:
Sample MS I.D.:	Sample MSD I.D.:
Spike I.D.:	MSMSD Decay Corrected Spike Concentration (pCi/mL):
Spike Volume Used in MS (mL):	MS Aliquot (L, g, F):
MS Target Conc. (pCi/L, g, F):	MSD Aliquot (L, g, F):
MSD Target Conc. (pCi/L, g, F):	Spike Uncertainty (calculated):
Sample Result:	Sample Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Result:	Sample Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:	Sample Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
MS Numerical Performance Indicator:	MS Numerical Performance Indicator:
MS Percent Recovery:	MSD Percent Recovery:
MSD Status vs Numerical Indicator:	MSD Status vs Numerical Indicator:
MSD Status vs Recovery:	MSD Status vs Recovery:

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	Sample MS I.D.:
Sample MSD I.D.:	Sample Matrix Spike Result:
Sample Matrix Spike Duplicate Result:	Sample Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:	Sample Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
Duplicate Numerical Performance Indicator:	Duplicate Numerical Performance Indicator:
MS/MSD Duplicate Status vs Numerical Indicator:	MS/MSD Duplicate Status vs RPD:



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Laboratory Report

Prepared For:

Georgia Power
2480 Maner Road
Atlanta, GA 30339

Attention: Mr. Joju Abraham

Report Number: AZI0227

September 16, 2016

Project: CCR Event

Project #: Plant McDonough

We appreciate the opportunity to provide the analytical support for your project. The analytical results in this report are based upon information supplied by you, the client, and are for your exclusive use. If you have any questions regarding this data package, please do not hesitate to call.

Approved:

A handwritten signature in black ink, appearing to read "Maya Farko", written over a horizontal line.

Project Manager

This report may not be reproduced, except in full, without written approval from Pace Analytical Services, Inc.
All test results relate only to the samples analyzed.



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

September 16, 2016

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
DGWC-37	AZI0227-01	Ground Water	09/08/16 09:25	09/08/16 12:30
DGWC-38	AZI0227-02	Ground Water	09/08/16 09:20	09/08/16 12:30
DGWC-39	AZI0227-03	Ground Water	09/08/16 10:35	09/08/16 12:30
FD-3	AZI0227-04	Ground Water	09/08/16 00:00	09/08/16 12:30



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

September 16, 2016

Report No.: AZI0227

Project: CCR Event

Client ID: DGWC-37

Lab Number ID: AZI0227-01

Date/Time Sampled: 9/8/2016 9:25:00AM

Date/Time Received: 9/8/2016 12:30:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	279	25	10	mg/L	SM 2540 C		1	09/12/16 16:24	09/12/16 16:24	6090267	JPT
Inorganic Anions											
Chloride	6.2	0.25	0.01	mg/L	EPA 300.0	B-01	1	09/12/16 09:25	09/13/16 03:42	6090259	RLC
Fluoride	0.08	0.30	0.02	mg/L	EPA 300.0	J	1	09/12/16 09:25	09/13/16 03:42	6090259	RLC
Sulfate	97	5.0	0.26	mg/L	EPA 300.0		5	09/12/16 09:25	09/13/16 19:39	6090259	RLC
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:47	6090241	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:47	6090241	CSW
Barium	0.123	0.0100	0.0004	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:47	6090241	CSW
Beryllium	ND	0.0030	0.00008	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:47	6090241	CSW
Boron	1.58	0.100	0.0064	mg/L	EPA 6020B	B-01	1	09/14/16 11:55	09/14/16 20:47	6090241	CSW
Cadmium	0.0002	0.0010	0.00007	mg/L	EPA 6020B	J	1	09/14/16 11:55	09/14/16 20:47	6090241	CSW
Calcium	52.5	5.00	0.311	mg/L	EPA 6020B		10	09/14/16 11:55	09/16/16 01:51	6090241	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:47	6090241	CSW
Cobalt	ND	0.0100	0.0005	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:47	6090241	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:47	6090241	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:47	6090241	CSW
Selenium	ND	0.0100	0.0010	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:47	6090241	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:47	6090241	CSW
Lithium	ND	0.0500	0.0021	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:47	6090241	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	09/12/16 08:55	09/12/16 15:34	6090243	MTC



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

September 16, 2016

Report No.: AZI0227

Project: CCR Event

Client ID: DGWC-38

Lab Number ID: AZI0227-02

Date/Time Sampled: 9/8/2016 9:20:00AM

Date/Time Received: 9/8/2016 12:30:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	437	25	10	mg/L	SM 2540 C		1	09/12/16 16:24	09/12/16 16:24	6090267	JPT
Inorganic Anions											
Chloride	7.4	0.25	0.01	mg/L	EPA 300.0	B-01	1	09/12/16 09:25	09/13/16 05:27	6090259	RLC
Fluoride	0.10	0.30	0.02	mg/L	EPA 300.0	J	1	09/12/16 09:25	09/13/16 05:27	6090259	RLC
Sulfate	270	10	0.51	mg/L	EPA 300.0		10	09/12/16 09:25	09/13/16 20:00	6090259	RLC
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:53	6090241	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:53	6090241	CSW
Barium	0.0333	0.0100	0.0004	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:53	6090241	CSW
Beryllium	ND	0.0030	0.00008	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:53	6090241	CSW
Boron	2.69	1.00	0.0642	mg/L	EPA 6020B	B-01	10	09/14/16 11:55	09/16/16 10:56	6090241	CSW
Cadmium	0.0002	0.0010	0.00007	mg/L	EPA 6020B	J	1	09/14/16 11:55	09/14/16 20:53	6090241	CSW
Calcium	70.3	5.00	0.311	mg/L	EPA 6020B		10	09/14/16 11:55	09/16/16 10:56	6090241	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:53	6090241	CSW
Cobalt	0.0015	0.0100	0.0005	mg/L	EPA 6020B	J	1	09/14/16 11:55	09/14/16 20:53	6090241	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:53	6090241	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:53	6090241	CSW
Selenium	ND	0.0100	0.0010	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:53	6090241	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:53	6090241	CSW
Lithium	0.0032	0.0500	0.0021	mg/L	EPA 6020B	J	1	09/14/16 11:55	09/14/16 20:53	6090241	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	09/12/16 08:55	09/12/16 15:37	6090243	MTC



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

September 16, 2016

Report No.: AZI0227

Project: CCR Event

Client ID: DGWC-39

Lab Number ID: AZI0227-03

Date/Time Sampled: 9/8/2016 10:35:00AM

Date/Time Received: 9/8/2016 12:30:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	522	25	10	mg/L	SM 2540 C		1	09/12/16 16:24	09/12/16 16:24	6090267	JPT
Inorganic Anions											
Chloride	9.2	0.25	0.01	mg/L	EPA 300.0	B-01	1	09/12/16 09:25	09/13/16 05:48	6090259	RLC
Fluoride	0.17	0.30	0.02	mg/L	EPA 300.0	J	1	09/12/16 09:25	09/13/16 05:48	6090259	RLC
Sulfate	280	10	0.51	mg/L	EPA 300.0		10	09/12/16 09:25	09/13/16 20:21	6090259	RLC
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:59	6090241	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:59	6090241	CSW
Barium	0.0978	0.0100	0.0004	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:59	6090241	CSW
Beryllium	ND	0.0030	0.00008	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:59	6090241	CSW
Boron	3.35	1.00	0.0642	mg/L	EPA 6020B	B-01	10	09/14/16 11:55	09/16/16 11:08	6090241	CSW
Cadmium	ND	0.0010	0.00007	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:59	6090241	CSW
Calcium	87.2	25.0	1.55	mg/L	EPA 6020B		50	09/14/16 11:55	09/16/16 11:02	6090241	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:59	6090241	CSW
Cobalt	0.0068	0.0100	0.0005	mg/L	EPA 6020B	J	1	09/14/16 11:55	09/14/16 20:59	6090241	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:59	6090241	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:59	6090241	CSW
Selenium	ND	0.0100	0.0010	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:59	6090241	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:59	6090241	CSW
Lithium	ND	0.0500	0.0021	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 20:59	6090241	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	09/12/16 08:55	09/12/16 15:39	6090243	MTC



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

September 16, 2016

Report No.: AZI0227

Project: CCR Event

Client ID: FD-3

Lab Number ID: AZI0227-04

Date/Time Sampled: 9/8/2016 12:00:00AM

Date/Time Received: 9/8/2016 12:30:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	457	25	10	mg/L	SM 2540 C		1	09/12/16 16:24	09/12/16 16:24	6090267	JPT
Inorganic Anions											
Chloride	7.4	0.25	0.01	mg/L	EPA 300.0	B-01	1	09/12/16 09:25	09/13/16 06:09	6090259	RLC
Fluoride	0.10	0.30	0.02	mg/L	EPA 300.0	J	1	09/12/16 09:25	09/13/16 06:09	6090259	RLC
Sulfate	270	10	0.51	mg/L	EPA 300.0		10	09/12/16 09:25	09/13/16 20:42	6090259	RLC
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 21:05	6090241	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 21:05	6090241	CSW
Barium	0.0325	0.0100	0.0004	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 21:05	6090241	CSW
Beryllium	ND	0.0030	0.00008	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 21:05	6090241	CSW
Boron	2.58	1.00	0.0642	mg/L	EPA 6020B	B-01	10	09/14/16 11:55	09/16/16 11:13	6090241	CSW
Cadmium	0.0002	0.0010	0.00007	mg/L	EPA 6020B	J	1	09/14/16 11:55	09/14/16 21:05	6090241	CSW
Calcium	70.1	5.00	0.311	mg/L	EPA 6020B		10	09/14/16 11:55	09/16/16 11:13	6090241	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 21:05	6090241	CSW
Cobalt	0.0015	0.0100	0.0005	mg/L	EPA 6020B	J	1	09/14/16 11:55	09/14/16 21:05	6090241	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 21:05	6090241	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 21:05	6090241	CSW
Selenium	ND	0.0100	0.0010	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 21:05	6090241	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	09/14/16 11:55	09/14/16 21:05	6090241	CSW
Lithium	0.0029	0.0500	0.0021	mg/L	EPA 6020B	J	1	09/14/16 11:55	09/14/16 21:05	6090241	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	09/12/16 08:55	09/12/16 15:46	6090243	MTC



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

September 16, 2016

Report No.: AZI0227

General Chemistry - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 6090267 - SM 2540 C											
Blank (6090267-BLK1)						Prepared & Analyzed: 09/12/16					
Total Dissolved Solids	ND	25	10	mg/L							
LCS (6090267-BS1)						Prepared & Analyzed: 09/12/16					
Total Dissolved Solids	370	25	10	mg/L	400.00		92	84-108			
Duplicate (6090267-DUP1)						Source: AZI0018-04RE1 Prepared & Analyzed: 09/12/16					
Total Dissolved Solids	81	25	10	mg/L		79			2	10	



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

September 16, 2016

Report No.: AZI0227

Inorganic Anions - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 6090259 - EPA 300.0											
Blank (6090259-BLK1)						Prepared & Analyzed: 09/12/16					
Chloride	0.05	0.25	0.01	mg/L							J
Fluoride	ND	0.30	0.02	mg/L							
Sulfate	ND	1.0	0.05	mg/L							
LCS (6090259-BS1)						Prepared & Analyzed: 09/12/16					
Chloride	10.2	0.25	0.01	mg/L	10.010		102	90-110			
Fluoride	10.6	0.30	0.02	mg/L	10.010		106	90-110			
Sulfate	10.3	1.0	0.05	mg/L	10.010		103	90-110			
Matrix Spike (6090259-MS1)						Source: AZI0211-02			Prepared & Analyzed: 09/12/16		
Chloride	17.0	0.25	0.01	mg/L	10.010	7.86	91	90-110			
Fluoride	9.71	0.30	0.02	mg/L	10.010	0.09	96	90-110			
Sulfate	53.3	1.0	0.05	mg/L	10.010	48.5	48	90-110			QM-05
Matrix Spike (6090259-MS2)						Source: AZI0226-07			Prepared: 09/12/16 Analyzed: 09/13/16		
Chloride	11.9	0.25	0.01	mg/L	10.010	1.96	99	90-110			
Fluoride	10.6	0.30	0.02	mg/L	10.010	0.08	105	90-110			
Sulfate	98.2	1.0	0.05	mg/L	10.010	98.5	NR	90-110			QM-05
Matrix Spike Dup (6090259-MSD1)						Source: AZI0211-02			Prepared & Analyzed: 09/12/16		
Chloride	17.5	0.25	0.01	mg/L	10.010	7.86	96	90-110	3	15	
Fluoride	10.4	0.30	0.02	mg/L	10.010	0.09	103	90-110	7	15	
Sulfate	53.6	1.0	0.05	mg/L	10.010	48.5	51	90-110	0.5	15	QM-05



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

September 16, 2016

Report No.: AZI0227

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 6090241 - EPA 3005A											
Blank (6090241-BLK1)					Prepared & Analyzed: 09/14/16						
Antimony	ND	0.0030	0.0008	mg/L							
Arsenic	ND	0.0050	0.0016	mg/L							
Barium	ND	0.0100	0.0004	mg/L							
Beryllium	ND	0.0030	0.00008	mg/L							
Boron	0.0068	0.100	0.0064	mg/L							J
Cadmium	ND	0.0010	0.00007	mg/L							
Calcium	ND	0.500	0.0311	mg/L							
Chromium	ND	0.0100	0.0009	mg/L							
Cobalt	ND	0.0100	0.0005	mg/L							
Copper	ND	0.0250	0.0005	mg/L							
Lead	ND	0.0050	0.0001	mg/L							
Molybdenum	ND	0.0100	0.0017	mg/L							
Nickel	ND	0.0100	0.0006	mg/L							
Selenium	ND	0.0100	0.0010	mg/L							
Silver	ND	0.0100	0.0005	mg/L							
Thallium	ND	0.0010	0.0002	mg/L							
Vanadium	ND	0.0100	0.0071	mg/L							
Zinc	ND	0.0100	0.0021	mg/L							
Lithium	ND	0.0500	0.0021	mg/L							
LCS (6090241-BS1)					Prepared & Analyzed: 09/14/16						
Antimony	0.103	0.0030	0.0008	mg/L	0.10000		103	80-120			
Arsenic	0.100	0.0050	0.0016	mg/L	0.10000		100	80-120			
Barium	0.0975	0.0100	0.0004	mg/L	0.10000		97	80-120			
Beryllium	0.104	0.0030	0.00008	mg/L	0.10000		104	80-120			
Boron	1.06	0.100	0.0064	mg/L	1.0000		106	80-120			
Cadmium	0.100	0.0010	0.00007	mg/L	0.10000		100	80-120			
Calcium	1.03	0.500	0.0311	mg/L	1.0000		103	80-120			
Chromium	0.101	0.0100	0.0009	mg/L	0.10000		101	80-120			
Cobalt	0.0963	0.0100	0.0005	mg/L	0.10000		96	80-120			
Copper	0.0983	0.0250	0.0005	mg/L	0.10000		98	80-120			
Lead	0.0990	0.0050	0.0001	mg/L	0.10000		99	80-120			
Molybdenum	0.103	0.0100	0.0017	mg/L	0.10000		103	80-120			
Nickel	0.0998	0.0100	0.0006	mg/L	0.10000		100	80-120			
Selenium	0.0969	0.0100	0.0010	mg/L	0.10000		97	80-120			
Silver	0.0985	0.0100	0.0005	mg/L	0.10000		98	80-120			
Thallium	0.0978	0.0010	0.0002	mg/L	0.10000		98	80-120			
Vanadium	0.0989	0.0100	0.0071	mg/L	0.10000		99	80-120			
Zinc	0.104	0.0100	0.0021	mg/L	0.10000		104	80-120			
Lithium	0.108	0.0500	0.0021	mg/L	0.10000		108	80-120			



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

September 16, 2016

Report No.: AZI0227

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 6090241 - EPA 3005A											
Matrix Spike (6090241-MS1)			Source: AZI0226-03				Prepared & Analyzed: 09/14/16				
Antimony	0.107	0.0030	0.0008	mg/L	0.10000	0.0009	106	75-125			
Arsenic	0.104	0.0050	0.0016	mg/L	0.10000	ND	104	75-125			
Barium	0.294	0.0100	0.0004	mg/L	0.10000	0.164	130	75-125			QM-02
Beryllium	0.0956	0.0030	0.00008	mg/L	0.10000	ND	96	75-125			
Boron	1.07	0.100	0.0064	mg/L	1.0000	0.163	90	75-125			
Cadmium	0.102	0.0010	0.00007	mg/L	0.10000	ND	102	75-125			
Calcium	62.4	5.00	0.311	mg/L	1.0000	59.8	260	75-125			QM-02
Chromium	0.101	0.0100	0.0009	mg/L	0.10000	ND	101	75-125			
Cobalt	0.0996	0.0100	0.0005	mg/L	0.10000	ND	100	75-125			
Copper	0.0960	0.0250	0.0005	mg/L	0.10000	ND	96	75-125			
Lead	0.0962	0.0050	0.0001	mg/L	0.10000	ND	96	75-125			
Molybdenum	0.107	0.0100	0.0017	mg/L	0.10000	ND	107	75-125			
Nickel	0.100	0.0100	0.0006	mg/L	0.10000	ND	100	75-125			
Selenium	0.0997	0.0100	0.0010	mg/L	0.10000	ND	100	75-125			
Silver	0.0974	0.0100	0.0005	mg/L	0.10000	ND	97	75-125			
Thallium	0.0978	0.0010	0.0002	mg/L	0.10000	ND	98	75-125			
Vanadium	0.101	0.0100	0.0071	mg/L	0.10000	ND	101	75-125			
Zinc	0.106	0.0100	0.0021	mg/L	0.10000	0.0034	102	75-125			
Lithium	0.115	0.0500	0.0021	mg/L	0.10000	0.0195	96	75-125			
Matrix Spike Dup (6090241-MSD1)			Source: AZI0226-03				Prepared & Analyzed: 09/14/16				
Antimony	0.108	0.0030	0.0008	mg/L	0.10000	0.0009	107	75-125	1	20	
Arsenic	0.103	0.0050	0.0016	mg/L	0.10000	ND	103	75-125	0.5	20	
Barium	0.297	0.0100	0.0004	mg/L	0.10000	0.164	133	75-125	0.9	20	QM-02
Beryllium	0.0881	0.0030	0.00008	mg/L	0.10000	ND	88	75-125	8	20	
Boron	1.04	0.100	0.0064	mg/L	1.0000	0.163	88	75-125	2	20	
Cadmium	0.100	0.0010	0.00007	mg/L	0.10000	ND	100	75-125	2	20	
Calcium	60.5	5.00	0.311	mg/L	1.0000	59.8	75	75-125	3	20	
Chromium	0.0983	0.0100	0.0009	mg/L	0.10000	ND	98	75-125	3	20	
Cobalt	0.0982	0.0100	0.0005	mg/L	0.10000	ND	98	75-125	1	20	
Copper	0.0956	0.0250	0.0005	mg/L	0.10000	ND	96	75-125	0.4	20	
Lead	0.0971	0.0050	0.0001	mg/L	0.10000	ND	97	75-125	0.9	20	
Molybdenum	0.106	0.0100	0.0017	mg/L	0.10000	ND	106	75-125	2	20	
Nickel	0.0993	0.0100	0.0006	mg/L	0.10000	ND	99	75-125	1	20	
Selenium	0.0974	0.0100	0.0010	mg/L	0.10000	ND	97	75-125	2	20	
Silver	0.0985	0.0100	0.0005	mg/L	0.10000	ND	99	75-125	1	20	
Thallium	0.0992	0.0010	0.0002	mg/L	0.10000	ND	99	75-125	1	20	
Vanadium	0.100	0.0100	0.0071	mg/L	0.10000	ND	100	75-125	1	20	
Zinc	0.103	0.0100	0.0021	mg/L	0.10000	0.0034	100	75-125	2	20	
Lithium	0.115	0.0500	0.0021	mg/L	0.10000	0.0195	95	75-125	0.1	20	



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

September 16, 2016

Report No.: AZI0227

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 6090241 - EPA 3005A											
Post Spike (6090241-PS1)			Source: AZI0226-03			Prepared & Analyzed: 09/14/16					
Antimony	92.1			ug/L	100.00	0.876	91	80-120			
Arsenic	101			ug/L	100.00	1.05	100	80-120			
Barium	291			ug/L	100.00	164	127	80-120			QM-02
Beryllium	88.7			ug/L	100.00	0.0152	89	80-120			
Boron	961			ug/L	1000.0	163	80	80-120			
Cadmium	97.2			ug/L	100.00	-0.0130	97	80-120			
Calcium	60700			ug/L	1000.0	59800	92	80-120			
Chromium	100			ug/L	100.00	0.275	100	80-120			
Cobalt	98.2			ug/L	100.00	0.175	98	80-120			
Copper	95.3			ug/L	100.00	0.0297	95	80-120			
Lead	96.1			ug/L	100.00	0.0240	96	80-120			
Molybdenum	108			ug/L	100.00	0.161	107	80-120			
Nickel	97.3			ug/L	100.00	0.424	97	80-120			
Selenium	99.8			ug/L	100.00	-0.260	100	80-120			
Silver	95.0			ug/L	100.00	0.0150	95	80-120			
Thallium	98.4			ug/L	100.00	0.0413	98	80-120			
Vanadium	102			ug/L	100.00	-0.0816	103	80-120			
Zinc	102			ug/L	100.00	3.38	99	80-120			
Lithium	110			ug/L	100.00	19.5	91	80-120			

Batch 6090243 - EPA 7470A

Blank (6090243-BLK1)					Prepared & Analyzed: 09/12/16						
Mercury	ND	0.00050	0.000041	mg/L							
LCS (6090243-BS1)					Prepared & Analyzed: 09/12/16						
Mercury	0.00249	0.00050	0.000041	mg/L	2.5000E-3		100	80-120			



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

September 16, 2016

Report No.: AZI0227

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 6090243 - EPA 7470A											
Matrix Spike (6090243-MS1)			Source: AZI0211-05			Prepared & Analyzed: 09/12/16					
Mercury	0.00237	0.00050	0.000041	mg/L	2.5000E-3	ND	95	75-125			
Matrix Spike Dup (6090243-MSD1)			Source: AZI0211-05			Prepared & Analyzed: 09/12/16					
Mercury	0.00241	0.00050	0.000041	mg/L	2.5000E-3	ND	96	75-125	2	20	
Post Spike (6090243-PS1)			Source: AZI0211-05			Prepared & Analyzed: 09/12/16					
Mercury	1.77			ug/L	1.6667	0.0125	105	80-120			



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

September 16, 2016

Legend

Definition of Laboratory Terms

- ND** - Not Detected at levels equal to or greater than the MDL
BRL - Not Detected at levels equal to or greater than the RL
RL - Reporting Limit **MDL** - Method Detection Limit
SOP - Method run per Pace Standard Operating Procedure
CFU - Colony Forming Units
DF - Dilution Factor **TIC** - Tentatively Identified Compound

Sample Information

N-Nitrosodiphenylamine breaks down to diphenylamine in the GCMS; both analytes are reported as N-Nitrosodiphenylamine. Pace is not NELAC certified for N-Nitrosodiphenylamine.

Phthalic acid and phthalic anhydride are reported as dimethyl phthalate

Maleic acid and maleic anhydride are reported as dimethyl malate

1,2-Diphenylhydrazine breaks down to azobenzene in the GCMS; both analytes are reported as azobenzene

Definition of Qualifiers

- QM-05** The spike recovery was outside acceptance limits for the MS and/or MSD and/or PDS due to suspected matrix interference. Sample results for the QC batch were accepted based on acceptable LCS recoveries.
- QM-02** The spike recovery is outside acceptance limits due to insignificant spike amount as compared to sample concentration.
- J** Estimated value less than Reporting Limit (RL) but greater than Method Detection Limit(MDL) (CLP J-Flag).
- B-01** Analyte was detected in the associated method blank at an estimated level equal to or greater than the MDL. Sample values reported as greater than the MDL and less than 10x the method blank value are reported as estimated values.

Note: Unless otherwise noted, all results are reported on an as received basis.



Pace Analytical Services, Inc.
110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
(770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CHAIN OF CUSTODY RECORD

CLIENT NAME: Georgia Power CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185 Atlanta, GA 30308 804-506-7239		REPORT TO: Joju Abraham CC: Maria Padilla Heath McCorkle PO #: laburch@southernmco.com		PROJECT NAME/STATE: Plant McDonough AP PROJECT #: 1663199 Phase II CCR	
CONTAINER TYPE: PRESERVATION: # of CONTAINERS →		ANALYSIS REQUESTED		LABORATORY INFORMATION	
P - PLASTIC A - AMBER GLASS G - CLEAR GLASS V - VOA VIAL S - STERILE O - OTHER		P P P 3 7 3 Metals App. III & IV (EPA 6020/7470) Cl, F, SO ₄ & TDS (EPA 300.0 & SM 2540C) Radium 226 & 228 (SW-846 9315/9320)		PRESERVATION 1 - HCl, ≤6°C 2 - H ₂ SO ₄ , ≤6°C 3 - HNO ₃ 4 - NaOH, ≤6°C 5 - NaOH/ZnAc, ≤6°C 6 - Na ₂ S ₂ O ₃ , ≤6°C 7 - ≤6°C not frozen	
MATRIX CODES: DW - DRINKING WATER WW - WASTEWATER GW - GROUNDWATER SW - SURFACE WATER ST - STORM WATER W - WATER		MATRIX CODES: S - SOIL SL - SLUDGE SD - SOLID A - AIR L - LIQUID P - PRODUCT		REMARKS/ADDITIONAL INFORMATION	
L A B I D N U M B E R →		DATE/TIME: 8/16/12 1230 DATE/TIME:		LAB #: A210227 Entered into LIMS: NR Tracking #:	
RELINQUISHED BY: [Signature] RELINQUISHED BY:		SAMPLE SHIPPED VIA: UPS Intact Custody Seal: [Signature]		COURIER # of Coolers: [Signature]	
DATE/TIME: 8/16/12 1035 DATE/TIME:		DATE/TIME: 8/16/12 1230 DATE/TIME:		CLIENT OTHER FS	
SAMPLED BY AND TITLE: Ben Hodges Field Lead RECEIVED BY: [Signature]		RECEIVED BY LAB: [Signature] Temperature: 22°C Min: [Signature] Max: [Signature]		COOLERS # of Coolers: [Signature]	

Plant McDonough COC Phase II CCR



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

LOG-IN CHECKLIST

Printed: 9/16/2016 6:41:08PM

Attn: Mr. Joju Abraham

Client: Georgia Power

Project: CCR Event

Date Received: 09/08/16 12:30

Work Order: AZI0227

Logged In By: Mohammad M. Rahman

OBSERVATIONS

#Samples: 4

#Containers: 12

Minimum Temp(C): 2.0

Maximum Temp(C): 2.0

Custody Seal(s) Used: N/A

CHECKLIST ITEMS

COC included with Samples	YES
Sample Container(s) Intact	YES
Chain of Custody Complete	YES
Sample Container(s) Match COC	YES
Custody seal Intact	NO
Temperature in Compliance	YES
Sufficient Sample Volume for Analysis	YES
Zero Headspace Maintained for VOA Analyses	YES
Samples labeled preserved (If Applicable)	YES
Samples received within Allowable Hold Times	YES
Samples Received on Ice	YES
Preservation Confirmed	YES

Comments:



October 07, 2016

Maria Padilla
GA Power
2480 Maner Rd
Atlanta, GA 30339

RE: Project: Plant McDonough AP
Pace Project No.: 30195546

Dear Maria Padilla:

Enclosed are the analytical results for sample(s) received by the laboratory on September 09, 2016. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,

Jacquelyn Collins
jacquelyn.collins@pacelabs.com
Project Manager

Enclosures



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



CERTIFICATIONS

Project: Plant McDonough AP
Pace Project No.: 30195546

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601
L-A-B DOD-ELAP Accreditation #: L2417

Alabama Certification #: 41590

Arizona Certification #: AZ0734

Arkansas Certification

California Certification #: 04222CA

Colorado Certification

Connecticut Certification #: PH-0694

Delaware Certification

Florida/TNI Certification #: E87683

Georgia Certification #: C040

Guam Certification

Hawaii Certification

Idaho Certification

Illinois Certification

Indiana Certification

Iowa Certification #: 391

Kansas/TNI Certification #: E-10358

Kentucky Certification #: 90133

Louisiana DHH/TNI Certification #: LA140008

Louisiana DEQ/TNI Certification #: 4086

Maine Certification #: PA00091

Maryland Certification #: 308

Massachusetts Certification #: M-PA1457

Michigan/PADEP Certification

Missouri Certification #: 235

Montana Certification #: Cert 0082

Nebraska Certification #: NE-05-29-14

Nevada Certification #: PA014572015-1

New Hampshire/TNI Certification #: 2976

New Jersey/TNI Certification #: PA 051

New Mexico Certification #: PA01457

New York/TNI Certification #: 10888

North Carolina Certification #: 42706

North Dakota Certification #: R-190

Oregon/TNI Certification #: PA200002

Pennsylvania/TNI Certification #: 65-00282

Puerto Rico Certification #: PA01457

Rhode Island Certification #: 65-00282

South Dakota Certification

Tennessee Certification #: TN2867

Texas/TNI Certification #: T104704188-14-8

Utah/TNI Certification #: PA014572015-5

USDA Soil Permit #: P330-14-00213

Vermont Dept. of Health: ID# VT-0282

Virgin Island/PADEP Certification

Virginia/VELAP Certification #: 460198

Washington Certification #: C868

West Virginia DEP Certification #: 143

West Virginia DHHR Certification #: 9964C

Wisconsin Certification

Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



SAMPLE SUMMARY

Project: Plant McDonough AP
Pace Project No.: 30195546

Lab ID	Sample ID	Matrix	Date Collected	Date Received
30195546001	DGWC-37	Water	09/08/16 09:25	09/09/16 09:50
30195546002	DGWC-38	Water	09/08/16 09:20	09/09/16 09:50
30195546003	DGWC-39	Water	09/08/16 10:35	09/09/16 09:50
30195546004	FD-3	Water	09/08/16 00:01	09/09/16 09:50

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



SAMPLE ANALYTE COUNT

Project: Plant McDonough AP
 Pace Project No.: 30195546

Lab ID	Sample ID	Method	Analysts	Analytes Reported
30195546001	DGWC-37	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30195546002	DGWC-38	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30195546003	DGWC-39	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30195546004	FD-3	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
 without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough AP
 Pace Project No.: 30195546

Sample: DGWC-37		Lab ID: 30195546001	Collected: 09/08/16 09:25	Received: 09/09/16 09:50	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.184 ± 0.166 (0.298) C:87% T:NA	pCi/L	09/30/16 08:09	13982-63-3	
Radium-228	EPA 9320	0.643 ± 0.366 (0.643) C:76% T:77%	pCi/L	09/28/16 16:15	15262-20-1	
Total Radium	Total Radium Calculation	0.827 ± 0.532 (0.941)	pCi/L	10/07/16 15:40	7440-14-4	

Sample: DGWC-38		Lab ID: 30195546002	Collected: 09/08/16 09:20	Received: 09/09/16 09:50	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.424 ± 0.248 (0.373) C:84% T:NA	pCi/L	09/30/16 08:09	13982-63-3	
Radium-228	EPA 9320	1.06 ± 0.439 (0.670) C:76% T:79%	pCi/L	09/28/16 16:15	15262-20-1	
Total Radium	Total Radium Calculation	1.48 ± 0.687 (1.04)	pCi/L	10/07/16 15:40	7440-14-4	

Sample: DGWC-39		Lab ID: 30195546003	Collected: 09/08/16 10:35	Received: 09/09/16 09:50	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.157 ± 0.160 (0.303) C:92% T:NA	pCi/L	09/30/16 08:09	13982-63-3	
Radium-228	EPA 9320	1.28 ± 0.506 (0.770) C:75% T:78%	pCi/L	09/28/16 16:15	15262-20-1	
Total Radium	Total Radium Calculation	1.44 ± 0.666 (1.07)	pCi/L	10/07/16 15:40	7440-14-4	

Sample: FD-3		Lab ID: 30195546004	Collected: 09/08/16 00:01	Received: 09/09/16 09:50	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.228 ± 0.183 (0.319) C:87% T:NA	pCi/L	09/30/16 08:09	13982-63-3	
Radium-228	EPA 9320	0.683 ± 0.448 (0.850) C:68% T:81%	pCi/L	09/28/16 16:15	15262-20-1	
Total Radium	Total Radium Calculation	0.911 ± 0.631 (1.17)	pCi/L	10/07/16 15:40	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
 without the written consent of Pace Analytical Services, LLC.



QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough AP
 Pace Project No.: 30195546

QC Batch: 233308 Analysis Method: EPA 9320
 QC Batch Method: EPA 9320 Analysis Description: 9320 Radium 228
 Associated Lab Samples: 30195546001, 30195546002, 30195546003, 30195546004

METHOD BLANK: 1143415 Matrix: Water
 Associated Lab Samples: 30195546001, 30195546002, 30195546003, 30195546004

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.0884 ± 0.332 (0.753) C:77% T:77%	pCi/L	09/28/16 12:21	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
 without the written consent of Pace Analytical Services, LLC.



QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough AP
 Pace Project No.: 30195546

QC Batch: 233313 Analysis Method: EPA 9315
 QC Batch Method: EPA 9315 Analysis Description: 9315 Total Radium
 Associated Lab Samples: 30195546001, 30195546002, 30195546003, 30195546004

METHOD BLANK: 1143427 Matrix: Water
 Associated Lab Samples: 30195546001, 30195546002, 30195546003, 30195546004

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.0767 ± 0.109 (0.226) C:95% T:NA	pCi/L	09/30/16 08:08	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
 without the written consent of Pace Analytical Services, LLC.



QUALIFIERS

Project: Plant McDonough AP
Pace Project No.: 30195546

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CHAIN OF CUSTODY RECORD

PAGE: 1 OF 1

CLIENT NAME:		ANALYSIS REQUESTED		CONTAINER TYPE		PRESERVATION			
Georgia Power		# of		P		1 - HCl, ≤6°C			
CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER:		CONTAINER TYPE		P		2 - H ₂ SO ₄ , ≤6°C			
241 Ralph McGill Blvd SE B10185		PRESERVATION:		P		3 - HNO ₃			
Atlanta, GA 30308		# of		P		4 - NaOH, ≤6°C			
404-506-7239		CONTAINERS		P		5 - NaOH/ZnAc, ≤6°C			
REPORT TO:		CONTAINERS		P		6 - Na ₂ S ₂ O ₈ , ≤6°C			
Jojo Abraham		CONTAINERS		P		7 - ≤6°C not frozen			
REQUESTED COMPLETION DATE:		CONTAINERS		P					
laburch@southernco.com		CONTAINERS		P					
PROJECT NAME/STATE:		CONTAINERS		P					
Plant McDonough AP		CONTAINERS		P					
PROJECT #: 1663199		CONTAINERS		P					
Phase II CCR		CONTAINERS		P					
Collection DATE	Collection TIME	MATRIX CODE*	C O M P	G R A B	SAMPLE IDENTIFICATION	CONTAINER TYPE	ANALYSIS REQUESTED	CONTAINER TYPE	PRESERVATION
9/8/16	0925	6W	X	X	DGWC-37				
9/8/16	0920	6W	X	X	DGWC-38				
9/8/16	1035	6W	X	X	DFWC-39				
9/8/16	-	6W	X	X	FD-3				
WO#: 30195546 									
SAMPLED BY AND TITLE:		RELINQUISHED BY:		DATE/TIME:		DATE/TIME:		LAB #:	
Ben Hoags Field Lead		Field Lead		9/8/16 1035		9/8/16 1230			
RECEIVED BY:		RELINQUISHED BY:		DATE/TIME:		DATE/TIME:		FOR LAB USE ONLY	
[Signature]		[Signature]							
RECEIVED BY LAB:		SAMPLE SHIPPED VIA:		UPS		FED-EX		USPS	
[Signature]		COURIER		# of Coolers		CLIENT		OTHER	
Ice: No NA Yes NO		Intact Broken Not Present		Cooler ID:		Cooler ID:		Cooler ID:	
Entered into LIMS:		Tracking #:							

Plant McDonough COC Phase II CCR

Sample Condition Upon Receipt Pittsburgh



Client Name: Georgia Power Project # 30195546

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: 6812 5099 0058

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Thermometer Used N/A Type of Ice: Wet Blue None

Cooler Temperature Observed Temp _____ °C Correction Factor _____ °C Final Temp: _____ °C

Temp should be above freezing to 6°C

Date and Initials of person examining contents: ML 9-9-16

Comments:	Yes	No	N/A	
Chain of Custody Present:	X			1.
Chain of Custody Filled Out:	X			2.
Chain of Custody Relinquished:	X			3.
Sampler Name & Signature on COC:	X			4.
Sample Labels match COC:	X			5.
-Includes date/time/ID/Analysis Matrix <u>SW</u>				
Samples Arrived within Hold Time:	X			6.
Short Hold Time Analysis (<72hr remaining):		X		7.
Rush Turn Around Time Requested:		X		8.
Sufficient Volume:	X			9.
Correct Containers Used:	X			10.
-Pace Containers Used:		X		
Containers Intact:	X			11.
Filtered volume received for Dissolved tests				12.
All containers needing preservation have been checked.	X			13.
All containers needing preservation are found to be in compliance with EPA recommendation.	X			<u>PH < 2</u>
exceptions: VOA, coliform, TOC, O&G, Phenolics				Initial when completed: <u>ML</u> Date/time of preservation: _____
				Lot # of added preservative: _____
Headspace in VOA Vials (>6mm):			X	14.
Trip Blank Present:		X		15.
Trip Blank Custody Seals Present			X	
Rad Aqueous Samples Screened > 0.5 mrem/hr		X		Initial when completed: <u>ML</u> Date: <u>9-9-16</u>


Client Notification/ Resolution:

Person Contacted: _____ Date/Time: _____ Contacted By: _____

Comments/ Resolution: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)
 *PM review is documented electronically in LIMS. When the Project Manager closes the SRF Review schedule in LIMS. The review is in the Status section of the Workorder Edit Screen.

Quality Control Sample Performance Assessment



Analyst **Must Manually Enter All Fields Highlighted in Yellow.**

Test: Ra-228
Analyst: JLW
Date: 9/2/2016
Worklist: 31428
Matrix: DW

Method Blank Assessment	
MB Sample ID	1143415
MB Concentration:	0.088
M/B Counting Uncertainty:	0.331
MB MDC:	0.753
MB Numerical Performance Indicator:	0.52
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment		LCS#(Y or N)?	N
LCS#1428		LCS#1428	LCS#31428
Count Date:	9/28/2016		
Spike I.D.:	16-025		
Spike Concentration (pCi/mL):	25.557		
Volume Used (mL):	0.20		
Aliquot Volume (L, g, F):	0.807		
Target Conc. (pCi/L, g, F):	6.336		
Uncertainty (Calculated):	0.456		
Result (pCi/L, g, F):	7.193		
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.821		
Numerical Performance Indicator:	1.79		
Percent Recovery:	113.54%		
Status vs Numerical Indicator:	N/A		
Status vs Recovery:	Pass		

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc.(pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Duplicate Sample Assessment	
Sample I.D.:	30195540001
Duplicate Sample I.D.:	30195540001DUP
Duplicate Sample I.D.:	30195540001DUP
Sample Result (pCi/L, g, F):	0.597
Sample Duplicate Result (pCi/L, g, F):	0.376
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	1.138
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.496
Are sample and/or duplicate results below MDC?	See Below ##
Duplicate Numerical Performance Indicator:	-1.706
Duplicate RPD:	62.40%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Fail***

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
(Based on the Percent Recoveries) MS/ MSD Duplicate RPD:	
MS/ MSD Duplicate Status vs Numerical Indicator:	
MS/ MSD Duplicate Status vs RPD:	

Enter Duplicate sample IDs if other than LCS/LCSD in the space below.
30195540001
30195540001DUP

Comments:

Handwritten signature: Amy

***Batch must be re-prepped due to unacceptable precision.

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: LAL
Date: 9/28/2016
Worklist: 31430
Matrix: DW

Method Blank Assessment	
MB Sample ID	1143427
MB concentration:	0.077
M/B Counting Uncertainty:	0.108
MB MDC:	0.228
MB Numerical Performance Indicator:	1.39
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment	
LCS (Y or N)?	N
LCS31430	LCS31430
Count Date:	9/30/2016
Spike I.D.:	16-026
Spike Concentration (pCi/mL):	44.677
Volume Used (mL):	0.10
Aliquot Volume (L, g, F):	0.511
Target Conc. (pCi/L, g, F):	8.751
Uncertainty (Calculated):	0.412
Result (pCi/L, g, F):	7.365
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.742
Numerical Performance Indicator:	-3.20
Percent Recovery:	84.17%
Status vs Numerical Indicator:	N/A
Status vs Recovery:	Pass

Duplicate Sample Assessment	
Sample I.D.:	30195376002
Duplicate Sample I.D.:	30195376002DUP
Sample Result (pCi/L, g, F):	0.428
Sample Duplicate Result (pCi/L, g, F):	0.216
Sample Duplicate Counting Uncertainty (pCi/L, g, F):	0.117
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.181
Ave sample and/or duplicate results below MDC?	See Below ##
Duplicate Numerical Performance Indicator:	2.170
Duplicate RPD:	114.41%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Fail***

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

***Batch must be re-prepped due to unacceptable precision.

Qualify

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Sample Matrix Spike Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs RPD:	

LABORATORY ANALYTICAL DATA

December 2016



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Laboratory Report

Prepared For:

**Georgia Power
2480 Maner Road
Atlanta, GA 30339**

Attention: Mr. Joju Abraham

Report Number: AZL0383


December 28, 2016

Project: CCR Event

Project #:Plant McDonough

We appreciate the opportunity to provide the analytical support for your project. The analytical results in this report are based upon information supplied by you, the client, and are for your exclusive use. If you have any questions regarding this data package, please do not hesitate to call.

Approved:


Signature

This report may not be reproduced, except in full, without written approval from Pace Analytical Services, LLC.
All test results relate only to the samples analyzed.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

December 28, 2016

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
DGWC-12	AZL0383-01	Ground Water	12/07/16 09:35	12/08/16 12:15
DGWC-13	AZL0383-02	Ground Water	12/07/16 10:55	12/08/16 12:15
DGWC-15	AZL0383-03	Ground Water	12/07/16 14:37	12/08/16 12:15
DGWC-19	AZL0383-04	Ground Water	12/07/16 13:10	12/08/16 12:15
DGWC-20	AZL0383-05	Ground Water	12/07/16 16:15	12/08/16 12:15
DGWC-37	AZL0383-06	Ground Water	12/07/16 13:05	12/08/16 12:15
DGWC-38	AZL0383-07	Ground Water	12/07/16 14:15	12/08/16 12:15
DGWC-39	AZL0383-08	Ground Water	12/07/16 15:25	12/08/16 12:15
FD-1	AZL0383-09	Ground Water	12/07/16 00:00	12/08/16 12:15
FD-2	AZL0383-10	Ground Water	12/07/16 00:00	12/08/16 12:15
FB-2	AZL0383-11	Water	12/07/16 16:39	12/08/16 12:15
EB-2	AZL0383-12	Water	12/07/16 16:14	12/08/16 12:15



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

December 28, 2016

Attention: Mr. Joju Abraham

Report No.: AZL0383

Project: CCR Event

Client ID: DGWC-12

Lab Number ID: AZL0383-01

Date/Time Sampled: 12/7/2016 9:35:00AM

Date/Time Received: 12/8/2016 12:15:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	559	25	10	mg/L	SM 2540 C		1	12/13/16 08:56	12/13/16 08:56	6120342	JPT
Inorganic Anions											
Chloride	20	0.25	0.01	mg/L	EPA 300.0		1	12/17/16 10:12	12/22/16 15:36	6120528	RNB
Fluoride	0.16	0.30	0.02	mg/L	EPA 300.0	J	1	12/17/16 10:12	12/22/16 15:36	6120528	RNB
Sulfate	350	20	1.0	mg/L	EPA 300.0	B-01	20	12/17/16 10:12	12/23/16 18:32	6120528	RNB
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:18	6120326	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:18	6120326	CSW
Barium	0.0241	0.0100	0.0004	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:18	6120326	CSW
Beryllium	0.0002	0.0030	0.00008	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:18	6120326	CSW
Boron	8.07	0.0400	0.0064	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:18	6120326	CSW
Cadmium	0.0003	0.0010	0.00007	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:18	6120326	CSW
Calcium	82.1	25.0	1.55	mg/L	EPA 6020B		50	12/14/16 15:30	12/21/16 13:06	6120326	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:18	6120326	CSW
Cobalt	0.0026	0.0100	0.0005	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:18	6120326	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:18	6120326	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:18	6120326	CSW
Selenium	ND	0.0100	0.0010	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:18	6120326	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:18	6120326	CSW
Lithium	ND	0.0500	0.0021	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:18	6120326	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	12/14/16 10:55	12/14/16 13:55	6120386	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

December 28, 2016

Attention: Mr. Joju Abraham

Report No.: AZL0383

Project: CCR Event

Client ID: DGWC-13

Lab Number ID: AZL0383-02

Date/Time Sampled: 12/7/2016 10:55:00AM

Date/Time Received: 12/8/2016 12:15:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	270	25	10	mg/L	SM 2540 C		1	12/13/16 08:56	12/13/16 08:56	6120342	JPT
Inorganic Anions											
Chloride	14	0.25	0.01	mg/L	EPA 300.0		1	12/17/16 10:12	12/22/16 15:57	6120528	RNB
Fluoride	0.30	0.30	0.02	mg/L	EPA 300.0		1	12/17/16 10:12	12/22/16 15:57	6120528	RNB
Sulfate	160	10	0.51	mg/L	EPA 300.0	B-01	10	12/17/16 10:12	12/23/16 18:53	6120528	RNB
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:24	6120326	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:24	6120326	CSW
Barium	0.0266	0.0100	0.0004	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:24	6120326	CSW
Beryllium	ND	0.0030	0.00008	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:24	6120326	CSW
Boron	0.900	0.0400	0.0064	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:24	6120326	CSW
Cadmium	0.0002	0.0010	0.00007	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:24	6120326	CSW
Calcium	39.8	5.00	0.311	mg/L	EPA 6020B		10	12/14/16 15:30	12/21/16 13:12	6120326	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:24	6120326	CSW
Cobalt	ND	0.0100	0.0005	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:24	6120326	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:24	6120326	CSW
Molybdenum	0.0273	0.0100	0.0017	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:24	6120326	CSW
Selenium	0.0015	0.0100	0.0010	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:24	6120326	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:24	6120326	CSW
Lithium	0.0030	0.0500	0.0021	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:24	6120326	CSW
Mercury	0.00009	0.00050	0.000041	mg/L	EPA 7470A	J	1	12/14/16 10:55	12/14/16 13:58	6120386	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

December 28, 2016

Attention: Mr. Joju Abraham

Report No.: AZL0383

Project: CCR Event

Client ID: DGWC-15

Lab Number ID: AZL0383-03

Date/Time Sampled: 12/7/2016 2:37:00PM

Date/Time Received: 12/8/2016 12:15:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	287	25	10	mg/L	SM 2540 C		1	12/13/16 08:56	12/13/16 08:56	6120342	JPT
Inorganic Anions											
Chloride	20	0.25	0.01	mg/L	EPA 300.0		1	12/17/16 10:12	12/22/16 16:59	6120528	RNB
Fluoride	0.11	0.30	0.02	mg/L	EPA 300.0	J	1	12/17/16 10:12	12/22/16 16:59	6120528	RNB
Sulfate	180	10	0.51	mg/L	EPA 300.0	B-01	10	12/17/16 10:12	12/23/16 19:14	6120528	RNB
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:30	6120326	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:30	6120326	CSW
Barium	0.0469	0.0100	0.0004	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:30	6120326	CSW
Beryllium	ND	0.0030	0.00008	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:30	6120326	CSW
Boron	1.56	0.0400	0.0064	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:30	6120326	CSW
Cadmium	0.000090	0.0010	0.00007	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:30	6120326	CSW
Calcium	34.7	5.00	0.311	mg/L	EPA 6020B		10	12/14/16 15:30	12/21/16 13:32	6120326	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:30	6120326	CSW
Cobalt	0.0028	0.0100	0.0005	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:30	6120326	CSW
Lead	0.0002	0.0050	0.0001	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:30	6120326	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:30	6120326	CSW
Selenium	ND	0.0100	0.0010	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:30	6120326	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:30	6120326	CSW
Lithium	0.0066	0.0500	0.0021	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:30	6120326	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	12/14/16 10:55	12/14/16 14:00	6120386	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

December 28, 2016

Attention: Mr. Joju Abraham

Report No.: AZL0383

Project: CCR Event

Client ID: DGWC-19

Lab Number ID: AZL0383-04

Date/Time Sampled: 12/7/2016 1:10:00PM

Date/Time Received: 12/8/2016 12:15:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	400	25	10	mg/L	SM 2540 C		1	12/13/16 08:56	12/13/16 08:56	6120342	JPT
Inorganic Anions											
Chloride	41	0.25	0.01	mg/L	EPA 300.0		1	12/17/16 10:12	12/22/16 17:19	6120528	RNB
Fluoride	0.37	0.30	0.02	mg/L	EPA 300.0		1	12/17/16 10:12	12/22/16 17:19	6120528	RNB
Sulfate	250	10	0.51	mg/L	EPA 300.0	B-01	10	12/17/16 10:12	12/23/16 19:36	6120528	RNB
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:36	6120326	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:36	6120326	CSW
Barium	0.0191	0.0100	0.0004	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:36	6120326	CSW
Beryllium	0.0021	0.0030	0.00008	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:36	6120326	CSW
Boron	3.34	0.0400	0.0064	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:36	6120326	CSW
Cadmium	0.0004	0.0010	0.00007	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:36	6120326	CSW
Calcium	68.3	25.0	1.55	mg/L	EPA 6020B		50	12/14/16 15:30	12/21/16 13:38	6120326	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:36	6120326	CSW
Cobalt	0.0561	0.0100	0.0005	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:36	6120326	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:36	6120326	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:36	6120326	CSW
Selenium	ND	0.0100	0.0010	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:36	6120326	CSW
Thallium	0.0005	0.0010	0.0002	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:36	6120326	CSW
Lithium	0.0034	0.0500	0.0021	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:36	6120326	CSW
Mercury	0.00005	0.00050	0.000041	mg/L	EPA 7470A	J	1	12/14/16 10:55	12/14/16 14:07	6120386	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

December 28, 2016

Attention: Mr. Joju Abraham

Report No.: AZL0383

Project: CCR Event

Client ID: DGWC-20

Lab Number ID: AZL0383-05

Date/Time Sampled: 12/7/2016 4:15:00PM

Date/Time Received: 12/8/2016 12:15:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	930	25	10	mg/L	SM 2540 C		1	12/13/16 08:56	12/13/16 08:56	6120342	JPT
Inorganic Anions											
Chloride	16	0.25	0.01	mg/L	EPA 300.0		1	12/17/16 10:12	12/22/16 17:40	6120528	RNB
Fluoride	0.66	0.30	0.02	mg/L	EPA 300.0		1	12/17/16 10:12	12/22/16 17:40	6120528	RNB
Sulfate	650	20	1.0	mg/L	EPA 300.0	B-01	20	12/17/16 10:12	12/23/16 19:57	6120528	RNB
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:43	6120326	CSW
Arsenic	0.0037	0.0050	0.0016	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:43	6120326	CSW
Barium	0.0087	0.0100	0.0004	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:43	6120326	CSW
Beryllium	0.0035	0.0030	0.00008	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:43	6120326	CSW
Boron	6.04	0.0400	0.0064	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:43	6120326	CSW
Cadmium	0.0023	0.0010	0.00007	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:43	6120326	CSW
Calcium	91.9	25.0	1.55	mg/L	EPA 6020B		50	12/14/16 15:30	12/21/16 13:43	6120326	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:43	6120326	CSW
Cobalt	0.614	0.0100	0.0005	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:43	6120326	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:43	6120326	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:43	6120326	CSW
Selenium	0.0056	0.0100	0.0010	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:43	6120326	CSW
Thallium	0.0006	0.0010	0.0002	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:43	6120326	CSW
Lithium	0.0050	0.0500	0.0021	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:43	6120326	CSW
Mercury	0.00008	0.00050	0.000041	mg/L	EPA 7470A	J	1	12/14/16 10:55	12/14/16 14:10	6120386	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

December 28, 2016

Attention: Mr. Joju Abraham

Report No.: AZL0383

Project: CCR Event

Client ID: DGWC-37

Lab Number ID: AZL0383-06

Date/Time Sampled: 12/7/2016 1:05:00PM

Date/Time Received: 12/8/2016 12:15:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	300	25	10	mg/L	SM 2540 C		1	12/13/16 08:56	12/13/16 08:56	6120342	JPT
Inorganic Anions											
Chloride	6.1	0.25	0.01	mg/L	EPA 300.0		1	12/17/16 10:12	12/22/16 18:01	6120528	RNB
Fluoride	0.21	0.30	0.02	mg/L	EPA 300.0	J	1	12/17/16 10:12	12/22/16 18:01	6120528	RNB
Sulfate	100	10	0.51	mg/L	EPA 300.0	B-01	10	12/17/16 10:12	12/23/16 20:19	6120528	RNB
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:49	6120326	CSW
Arsenic	0.0019	0.0050	0.0016	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:49	6120326	CSW
Barium	0.125	0.0100	0.0004	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:49	6120326	CSW
Beryllium	ND	0.0030	0.00008	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:49	6120326	CSW
Boron	2.01	0.0400	0.0064	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:49	6120326	CSW
Cadmium	0.0001	0.0010	0.00007	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:49	6120326	CSW
Calcium	29.7	25.0	1.55	mg/L	EPA 6020B		50	12/14/16 15:30	12/21/16 13:49	6120326	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:49	6120326	CSW
Cobalt	0.0005	0.0100	0.0005	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:49	6120326	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:49	6120326	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:49	6120326	CSW
Selenium	ND	0.0100	0.0010	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:49	6120326	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:49	6120326	CSW
Lithium	ND	0.0500	0.0021	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:49	6120326	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	12/14/16 10:55	12/14/16 14:12	6120386	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

December 28, 2016

Attention: Mr. Joju Abraham

Report No.: AZL0383

Project: CCR Event

Client ID: DGWC-38

Lab Number ID: AZL0383-07

Date/Time Sampled: 12/7/2016 2:15:00PM

Date/Time Received: 12/8/2016 12:15:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	478	25	10	mg/L	SM 2540 C		1	12/13/16 08:56	12/13/16 08:56	6120342	JPT
Inorganic Anions											
Chloride	7.4	0.25	0.01	mg/L	EPA 300.0		1	12/17/16 10:12	12/22/16 18:21	6120528	RNB
Fluoride	0.27	0.30	0.02	mg/L	EPA 300.0	J	1	12/17/16 10:12	12/22/16 18:21	6120528	RNB
Sulfate	250	10	0.51	mg/L	EPA 300.0	B-01	10	12/17/16 10:12	12/23/16 22:07	6120528	RNB
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:55	6120326	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:55	6120326	CSW
Barium	0.0336	0.0100	0.0004	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:55	6120326	CSW
Beryllium	ND	0.0030	0.00008	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:55	6120326	CSW
Boron	3.08	0.0400	0.0064	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:55	6120326	CSW
Cadmium	0.0002	0.0010	0.00007	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:55	6120326	CSW
Calcium	38.4	25.0	1.55	mg/L	EPA 6020B		50	12/14/16 15:30	12/21/16 13:55	6120326	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:55	6120326	CSW
Cobalt	0.0017	0.0100	0.0005	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:55	6120326	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:55	6120326	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:55	6120326	CSW
Selenium	ND	0.0100	0.0010	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:55	6120326	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 14:55	6120326	CSW
Lithium	0.0035	0.0500	0.0021	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 14:55	6120326	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	12/14/16 10:55	12/14/16 14:14	6120386	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

December 28, 2016

Attention: Mr. Joju Abraham

Report No.: AZL0383

Project: CCR Event

Client ID: DGWC-39

Lab Number ID: AZL0383-08

Date/Time Sampled: 12/7/2016 3:25:00PM

Date/Time Received: 12/8/2016 12:15:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	565	25	10	mg/L	SM 2540 C		1	12/13/16 08:56	12/13/16 08:56	6120342	JPT
Inorganic Anions											
Chloride	8.9	0.25	0.01	mg/L	EPA 300.0		1	12/17/16 10:12	12/22/16 18:42	6120528	RNB
Fluoride	0.33	0.30	0.02	mg/L	EPA 300.0		1	12/17/16 10:12	12/22/16 18:42	6120528	RNB
Sulfate	250	10	0.51	mg/L	EPA 300.0	B-01	10	12/17/16 10:12	12/23/16 22:29	6120528	RNB
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:01	6120326	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:01	6120326	CSW
Barium	0.0844	0.0100	0.0004	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:01	6120326	CSW
Beryllium	ND	0.0030	0.00008	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:01	6120326	CSW
Boron	3.63	0.0400	0.0064	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:01	6120326	CSW
Cadmium	ND	0.0010	0.00007	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:01	6120326	CSW
Calcium	96.7	50.0	3.11	mg/L	EPA 6020B		100	12/14/16 15:30	12/21/16 14:01	6120326	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:01	6120326	CSW
Cobalt	0.0071	0.0100	0.0005	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 15:01	6120326	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:01	6120326	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:01	6120326	CSW
Selenium	ND	0.0100	0.0010	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:01	6120326	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:01	6120326	CSW
Lithium	ND	0.0500	0.0021	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:01	6120326	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	12/14/16 10:55	12/14/16 14:17	6120386	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

December 28, 2016

Attention: Mr. Joju Abraham

Report No.: AZL0383

Project: CCR Event

Client ID: FD-1

Lab Number ID: AZL0383-09

Date/Time Sampled: 12/7/2016 12:00:00AM

Date/Time Received: 12/8/2016 12:15:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	581	25	10	mg/L	SM 2540 C		1	12/13/16 08:56	12/13/16 08:56	6120342	JPT
Inorganic Anions											
Chloride	13	0.25	0.01	mg/L	EPA 300.0		1	12/17/16 10:12	12/22/16 20:25	6120528	RNB
Fluoride	0.17	0.30	0.02	mg/L	EPA 300.0	J	1	12/17/16 10:12	12/22/16 20:25	6120528	RNB
Sulfate	340	20	1.0	mg/L	EPA 300.0	B-01	20	12/17/16 10:12	12/23/16 22:51	6120528	RNB
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:07	6120326	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:07	6120326	CSW
Barium	0.0248	0.0100	0.0004	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:07	6120326	CSW
Beryllium	0.0002	0.0030	0.00008	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 15:07	6120326	CSW
Boron	7.74	0.0400	0.0064	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:07	6120326	CSW
Cadmium	0.0004	0.0010	0.00007	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 15:07	6120326	CSW
Calcium	41.9	25.0	1.55	mg/L	EPA 6020B		50	12/14/16 15:30	12/21/16 14:06	6120326	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:07	6120326	CSW
Cobalt	0.0026	0.0100	0.0005	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 15:07	6120326	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:07	6120326	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:07	6120326	CSW
Selenium	ND	0.0100	0.0010	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:07	6120326	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:07	6120326	CSW
Lithium	ND	0.0500	0.0021	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:07	6120326	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	12/14/16 10:55	12/14/16 14:19	6120386	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

December 28, 2016

Attention: Mr. Joju Abraham

Report No.: AZL0383

Project: CCR Event

Client ID: FD-2

Lab Number ID: AZL0383-10

Date/Time Sampled: 12/7/2016 12:00:00AM

Date/Time Received: 12/8/2016 12:15:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	421	25	10	mg/L	SM 2540 C		1	12/13/16 08:56	12/13/16 08:56	6120342	JPT
Inorganic Anions											
Chloride	41	0.25	0.01	mg/L	EPA 300.0		1	12/17/16 10:12	12/22/16 20:46	6120528	RNB
Fluoride	0.50	0.30	0.02	mg/L	EPA 300.0		1	12/17/16 10:12	12/22/16 20:46	6120528	RNB
Sulfate	240	10	0.51	mg/L	EPA 300.0	B-01	10	12/17/16 10:12	12/23/16 23:13	6120528	RNB
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:14	6120326	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:14	6120326	CSW
Barium	0.0188	0.0100	0.0004	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:14	6120326	CSW
Beryllium	0.0020	0.0030	0.00008	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 15:14	6120326	CSW
Boron	3.25	0.0400	0.0064	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:14	6120326	CSW
Cadmium	0.0004	0.0010	0.00007	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 15:14	6120326	CSW
Calcium	34.3	25.0	1.55	mg/L	EPA 6020B		50	12/14/16 15:30	12/21/16 14:12	6120326	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:14	6120326	CSW
Cobalt	0.0545	0.0100	0.0005	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:14	6120326	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:14	6120326	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:14	6120326	CSW
Selenium	ND	0.0100	0.0010	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:14	6120326	CSW
Thallium	0.0005	0.0010	0.0002	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 15:14	6120326	CSW
Lithium	0.0033	0.0500	0.0021	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 15:14	6120326	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	12/14/16 10:55	12/14/16 14:21	6120386	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

December 28, 2016

Attention: Mr. Joju Abraham

Report No.: AZL0383

Project: CCR Event

Client ID: FB-2

Lab Number ID: AZL0383-11

Date/Time Sampled: 12/7/2016 4:39:00PM

Date/Time Received: 12/8/2016 12:15:00PM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C		1	12/13/16 08:56	12/13/16 08:56	6120342	JPT
Inorganic Anions											
Chloride	0.04	0.25	0.01	mg/L	EPA 300.0	J	1	12/17/16 10:12	12/22/16 21:07	6120528	RNB
Fluoride	ND	0.30	0.02	mg/L	EPA 300.0		1	12/17/16 10:12	12/22/16 21:07	6120528	RNB
Sulfate	0.19	1.0	0.05	mg/L	EPA 300.0	B-01, J	1	12/17/16 10:12	12/22/16 21:07	6120528	RNB
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:35	6120326	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:35	6120326	CSW
Barium	ND	0.0100	0.0004	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:35	6120326	CSW
Beryllium	ND	0.0030	0.00008	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:35	6120326	CSW
Boron	0.0109	0.0400	0.0064	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 15:35	6120326	CSW
Cadmium	ND	0.0010	0.00007	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:35	6120326	CSW
Calcium	ND	0.500	0.0311	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:35	6120326	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:35	6120326	CSW
Cobalt	ND	0.0100	0.0005	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:35	6120326	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:35	6120326	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:35	6120326	CSW
Selenium	ND	0.0100	0.0010	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:35	6120326	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:35	6120326	CSW
Lithium	ND	0.0500	0.0021	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:35	6120326	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	12/14/16 10:55	12/14/16 14:24	6120386	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

December 28, 2016

Attention: Mr. Joju Abraham

Report No.: AZL0383

Project: CCR Event

Client ID: EB-2

Lab Number ID: AZL0383-12

Date/Time Sampled: 12/7/2016 4:14:00PM

Date/Time Received: 12/8/2016 12:15:00PM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C		1	12/13/16 08:56	12/13/16 08:56	6120342	JPT
Inorganic Anions											
Chloride	0.05	0.25	0.01	mg/L	EPA 300.0	J	1	12/17/16 10:12	12/22/16 21:27	6120528	RNB
Fluoride	ND	0.30	0.02	mg/L	EPA 300.0		1	12/17/16 10:12	12/22/16 21:27	6120528	RNB
Sulfate	0.09	1.0	0.05	mg/L	EPA 300.0	B-01, J	1	12/17/16 10:12	12/22/16 21:27	6120528	RNB
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:41	6120326	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:41	6120326	CSW
Barium	ND	0.0100	0.0004	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:41	6120326	CSW
Beryllium	ND	0.0030	0.00008	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:41	6120326	CSW
Boron	0.0091	0.0400	0.0064	mg/L	EPA 6020B	J	1	12/14/16 15:30	12/15/16 15:41	6120326	CSW
Cadmium	ND	0.0010	0.00007	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:41	6120326	CSW
Calcium	ND	0.500	0.0311	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:41	6120326	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:41	6120326	CSW
Cobalt	ND	0.0100	0.0005	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:41	6120326	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:41	6120326	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:41	6120326	CSW
Selenium	ND	0.0100	0.0010	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:41	6120326	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:41	6120326	CSW
Lithium	ND	0.0500	0.0021	mg/L	EPA 6020B		1	12/14/16 15:30	12/15/16 15:41	6120326	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	12/14/16 10:55	12/14/16 14:26	6120386	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

December 28, 2016

Report No.: AZL0383

General Chemistry - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 6120342 - SM 2540 C											
Blank (6120342-BLK1)						Prepared & Analyzed: 12/13/16					
Total Dissolved Solids	ND	25	10	mg/L							
LCS (6120342-BS1)						Prepared & Analyzed: 12/13/16					
Total Dissolved Solids	381	25	10	mg/L	400.00		95	84-108			
Duplicate (6120342-DUP1)						Source: AZL0383-08			Prepared & Analyzed: 12/13/16		
Total Dissolved Solids	557	25	10	mg/L		565			1	10	
Duplicate (6120342-DUP2)						Source: AZL0383-11			Prepared & Analyzed: 12/13/16		
Total Dissolved Solids	ND	25	10	mg/L		ND				10	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

December 28, 2016

Report No.: AZL0383

Inorganic Anions - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 6120528 - EPA 300.0											
Blank (6120528-BLK1)											
						Prepared: 12/17/16 Analyzed: 12/22/16					
Chloride	ND	0.25	0.01	mg/L							
Fluoride	ND	0.30	0.02	mg/L							
Sulfate	0.15	1.0	0.05	mg/L							J
LCS (6120528-BS1)											
						Prepared: 12/17/16 Analyzed: 12/22/16					
Chloride	9.89	0.25	0.01	mg/L	10.010		99	90-110			
Fluoride	9.76	0.30	0.02	mg/L	10.020		97	90-110			
Sulfate	10.0	1.0	0.05	mg/L	10.020		100	90-110			
Matrix Spike (6120528-MS1)											
						Source: AZL0383-02					
						Prepared: 12/17/16 Analyzed: 12/22/16					
Chloride	22.5	0.25	0.01	mg/L	10.010	13.6	89	90-110			QM-05
Fluoride	9.73	0.30	0.02	mg/L	10.020	0.30	94	90-110			
Sulfate	131	1.0	0.05	mg/L	10.020	133	NR	90-110			QM-02
Matrix Spike (6120528-MS2)											
						Source: AZL0406-03					
						Prepared: 12/17/16 Analyzed: 12/22/16					
Chloride	43.3	0.25	0.01	mg/L	10.010	37.6	57	90-110			QM-05
Fluoride	10.2	0.30	0.02	mg/L	10.020	0.31	99	90-110			
Sulfate	155	1.0	0.05	mg/L	10.020	160	NR	90-110			QM-02
Matrix Spike Dup (6120528-MSD1)											
						Source: AZL0383-02					
						Prepared: 12/17/16 Analyzed: 12/22/16					
Chloride	23.0	0.25	0.01	mg/L	10.010	13.6	94	90-110	2	15	
Fluoride	10.4	0.30	0.02	mg/L	10.020	0.30	101	90-110	7	15	
Sulfate	130	1.0	0.05	mg/L	10.020	133	NR	90-110	0.7	15	QM-02



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

December 28, 2016

Report No.: AZL0383

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	----	-----	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 6120326 - EPA 3005A

Blank (6120326-BLK1)

Prepared: 12/14/16 Analyzed: 12/15/16

Antimony	ND	0.0030	0.0008	mg/L							
Arsenic	ND	0.0050	0.0016	mg/L							
Barium	ND	0.0100	0.0004	mg/L							
Beryllium	ND	0.0030	0.00008	mg/L							
Boron	ND	0.0400	0.0064	mg/L							
Cadmium	ND	0.0010	0.00007	mg/L							
Calcium	ND	0.500	0.0311	mg/L							
Chromium	ND	0.0100	0.0009	mg/L							
Cobalt	ND	0.0100	0.0005	mg/L							
Copper	ND	0.0250	0.0005	mg/L							
Lead	ND	0.0050	0.0001	mg/L							
Molybdenum	ND	0.0100	0.0017	mg/L							
Nickel	ND	0.0100	0.0006	mg/L							
Selenium	ND	0.0100	0.0010	mg/L							
Silver	ND	0.0100	0.0005	mg/L							
Thallium	ND	0.0010	0.0002	mg/L							
Vanadium	ND	0.0100	0.0071	mg/L							
Zinc	ND	0.0100	0.0021	mg/L							
Lithium	ND	0.0500	0.0021	mg/L							

LCS (6120326-BS1)

Prepared: 12/14/16 Analyzed: 12/15/16

Antimony	0.101	0.0030	0.0008	mg/L	0.10000		101	80-120			
Arsenic	0.100	0.0050	0.0016	mg/L	0.10000		100	80-120			
Barium	0.0974	0.0100	0.0004	mg/L	0.10000		97	80-120			
Beryllium	0.108	0.0030	0.00008	mg/L	0.10000		108	80-120			
Boron	1.06	0.0400	0.0064	mg/L	1.0000		106	80-120			
Cadmium	0.101	0.0010	0.00007	mg/L	0.10000		101	80-120			
Calcium	0.972	0.500	0.0311	mg/L	1.0000		97	80-120			
Chromium	0.101	0.0100	0.0009	mg/L	0.10000		101	80-120			
Cobalt	0.0998	0.0100	0.0005	mg/L	0.10000		100	80-120			
Copper	0.100	0.0250	0.0005	mg/L	0.10000		100	80-120			
Lead	0.0990	0.0050	0.0001	mg/L	0.10000		99	80-120			
Molybdenum	0.102	0.0100	0.0017	mg/L	0.10000		102	80-120			
Nickel	0.101	0.0100	0.0006	mg/L	0.10000		101	80-120			
Selenium	0.0980	0.0100	0.0010	mg/L	0.10000		98	80-120			
Silver	0.0985	0.0100	0.0005	mg/L	0.10000		98	80-120			
Thallium	0.0982	0.0010	0.0002	mg/L	0.10000		98	80-120			
Vanadium	0.104	0.0100	0.0071	mg/L	0.10000		104	80-120			
Zinc	0.101	0.0100	0.0021	mg/L	0.10000		101	80-120			
Lithium	0.104	0.0500	0.0021	mg/L	0.10000		104	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

December 28, 2016

Report No.: AZL0383

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 6120326 - EPA 3005A											
Matrix Spike (6120326-MS1)			Source: AZL0316-02				Prepared: 12/14/16 Analyzed: 12/15/16				
Antimony	0.101	0.0030	0.0008	mg/L	0.10000	0.0008	100	75-125			
Arsenic	0.0976	0.0050	0.0016	mg/L	0.10000	ND	98	75-125			
Barium	0.109	0.0100	0.0004	mg/L	0.10000	0.0127	96	75-125			
Beryllium	0.105	0.0030	0.00008	mg/L	0.10000	ND	105	75-125			
Boron	1.48	0.0400	0.0064	mg/L	1.0000	0.436	105	75-125			
Cadmium	0.0992	0.0010	0.00007	mg/L	0.10000	ND	99	75-125			
Calcium	107	50.0	3.11	mg/L	1.0000	105	276	75-125			QM-02
Chromium	0.0954	0.0100	0.0009	mg/L	0.10000	ND	95	75-125			
Cobalt	0.0957	0.0100	0.0005	mg/L	0.10000	ND	96	75-125			
Copper	0.0942	0.0250	0.0005	mg/L	0.10000	ND	94	75-125			
Lead	0.0979	0.0050	0.0001	mg/L	0.10000	ND	98	75-125			
Molybdenum	0.102	0.0100	0.0017	mg/L	0.10000	ND	102	75-125			
Nickel	0.100	0.0100	0.0006	mg/L	0.10000	0.0042	96	75-125			
Selenium	0.0986	0.0100	0.0010	mg/L	0.10000	ND	99	75-125			
Silver	0.0958	0.0100	0.0005	mg/L	0.10000	ND	96	75-125			
Thallium	0.0983	0.0010	0.0002	mg/L	0.10000	0.0002	98	75-125			
Vanadium	0.102	0.0100	0.0071	mg/L	0.10000	ND	102	75-125			
Zinc	0.0978	0.0100	0.0021	mg/L	0.10000	ND	98	75-125			
Lithium	0.103	0.0500	0.0021	mg/L	0.10000	0.0022	101	75-125			
Matrix Spike Dup (6120326-MSD1)											
Matrix Spike Dup (6120326-MSD1)			Source: AZL0316-02				Prepared: 12/14/16 Analyzed: 12/15/16				
Antimony	0.105	0.0030	0.0008	mg/L	0.10000	0.0008	104	75-125	4	20	
Arsenic	0.100	0.0050	0.0016	mg/L	0.10000	ND	100	75-125	2	20	
Barium	0.110	0.0100	0.0004	mg/L	0.10000	0.0127	97	75-125	1	20	
Beryllium	0.109	0.0030	0.00008	mg/L	0.10000	ND	109	75-125	4	20	
Boron	1.52	0.0400	0.0064	mg/L	1.0000	0.436	108	75-125	2	20	
Cadmium	0.104	0.0010	0.00007	mg/L	0.10000	ND	104	75-125	5	20	
Calcium	108	50.0	3.11	mg/L	1.0000	105	301	75-125	0.2	20	QM-02
Chromium	0.0968	0.0100	0.0009	mg/L	0.10000	ND	97	75-125	1	20	
Cobalt	0.0993	0.0100	0.0005	mg/L	0.10000	ND	99	75-125	4	20	
Copper	0.0960	0.0250	0.0005	mg/L	0.10000	ND	96	75-125	2	20	
Lead	0.100	0.0050	0.0001	mg/L	0.10000	ND	100	75-125	2	20	
Molybdenum	0.107	0.0100	0.0017	mg/L	0.10000	ND	107	75-125	4	20	
Nickel	0.102	0.0100	0.0006	mg/L	0.10000	0.0042	98	75-125	2	20	
Selenium	0.0975	0.0100	0.0010	mg/L	0.10000	ND	98	75-125	1	20	
Silver	0.0986	0.0100	0.0005	mg/L	0.10000	ND	99	75-125	3	20	
Thallium	0.0988	0.0010	0.0002	mg/L	0.10000	0.0002	99	75-125	0.5	20	
Vanadium	0.103	0.0100	0.0071	mg/L	0.10000	ND	103	75-125	0.5	20	
Zinc	0.101	0.0100	0.0021	mg/L	0.10000	ND	101	75-125	3	20	
Lithium	0.108	0.0500	0.0021	mg/L	0.10000	0.0022	106	75-125	5	20	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

December 28, 2016

Report No.: AZL0383

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 6120326 - EPA 3005A											
Post Spike (6120326-PS1)			Source: AZL0316-02			Prepared: 12/14/16 Analyzed: 12/15/16					
Antimony	97.3			ug/L	100.00	0.850	96	80-120			
Arsenic	98.2			ug/L	100.00	-0.560	98	80-120			
Barium	109			ug/L	100.00	12.7	96	80-120			
Beryllium	107			ug/L	100.00	0.0200	107	80-120			
Boron	1490			ug/L	1000.0	436	105	80-120			
Cadmium	101			ug/L	100.00	0.00	101	80-120			
Calcium	103000			ug/L	1000.0	105000	NR	80-120			QM-02
Chromium	97.1			ug/L	100.00	-3.67	97	80-120			
Cobalt	97.0			ug/L	100.00	0.400	97	80-120			
Copper	95.8			ug/L	100.00	0.520	95	80-120			
Lead	96.9			ug/L	100.00	0.0200	97	80-120			
Molybdenum	102			ug/L	100.00	0.140	102	80-120			
Nickel	101			ug/L	100.00	4.18	97	80-120			
Selenium	97.8			ug/L	100.00	-0.170	98	80-120			
Silver	96.6			ug/L	100.00	0.00	97	80-120			
Thallium	96.4			ug/L	100.00	0.220	96	80-120			
Vanadium	103			ug/L	100.00	3.25	99	80-120			
Zinc	100			ug/L	100.00	1.15	99	80-120			
Lithium	108			ug/L	100.00	2.21	105	80-120			

Batch 6120386 - EPA 7470A

Blank (6120386-BLK1)				Prepared & Analyzed: 12/14/16							
Mercury	ND	0.00050	0.000041	mg/L							
LCS (6120386-BS1)				Prepared & Analyzed: 12/14/16							
Mercury	0.00252	0.00050	0.000041	mg/L	2.5000E-3		101	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

December 28, 2016

Report No.: AZL0383

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 6120386 - EPA 7470A											
Matrix Spike (6120386-MS1)			Source: AZL0316-05			Prepared & Analyzed: 12/14/16					
Mercury	0.00247	0.00050	0.000041	mg/L	2.5000E-3	ND	99	75-125			
Matrix Spike Dup (6120386-MSD1)			Source: AZL0316-05			Prepared & Analyzed: 12/14/16					
Mercury	0.00245	0.00050	0.000041	mg/L	2.5000E-3	ND	98	75-125	0.6	20	
Post Spike (6120386-PS1)			Source: AZL0316-05			Prepared & Analyzed: 12/14/16					
Mercury	1.69			ug/L	1.6667	0.00473	101	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

December 28, 2016

Legend

Definition of Laboratory Terms

- ND** - Not Detected at levels equal to or greater than the MDL
- BRL** - Not Detected at levels equal to or greater than the RL
- RL** - Reporting Limit **MDL** - Method Detection Limit
- SOP** - Method run per Pace Standard Operating Procedure
- CFU** - Colony Forming Units
- DF** - Dilution Factor **TIC** - Tentatively Identified Compound

Sample Information

N-Nitrosodiphenylamine breaks down to diphenylamine in the GCMS; both analytes are reported as N-Nitrosodiphenylamine. Pace is not NELAC certified for N-Nitrosodiphenylamine.

Phthalic acid and phthalic anhydride are reported as dimethyl phthalate

Maleic acid and maleic anhydride are reported as dimethyl malate

1,2-Diphenylhydrazine breaks down to azobenzene in the GCMS; both analytes are reported as azobenzene

Definition of Qualifiers

- QM-05** The spike recovery was outside acceptance limits for the MS and/or MSD and/or PDS due to suspected matrix interference. Sample results for the QC batch were accepted based on acceptable LCS recoveries.
- QM-02** The spike recovery is outside acceptance limits due to insignificant spike amount as compared to sample concentration.
- J** Estimated value less than Reporting Limit (RL) but greater than Method Detection Limit(MDL) (CLP J-Flag).
- B-01** Analyte was detected in the associated method blank at an estimated level equal to or greater than the MDL. Sample values reported as greater than the MDL and less than 10x the method blank value are reported as estimated values.

Note: Unless otherwise noted, all results are reported on an as received basis.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

December 28, 2016

Report Notes

Sample DGWC-14 was not present in the cooler. MMR

Per communication with consultant on 12/9/2016, DGWC-14 was sampled 12/6/2016, received 12/7/2016 on work order AZL0284, and does not apply to work order AZL0383. BMcD



Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

PAGE: 1 OF 2

CHAIN OF CUSTODY RECORD

CLIENT NAME: Georgia Power CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185 Atlanta, GA 30308 404-506-7239		REPORT TO: Dawn Pirelli (Dawn.Pirelli@golder.com) CC: Kjurinko@golder.com Maria Padilla, Heath McCorkle REQUESTED COMPLETION DATE: PO #:		PROJECT NAME/STATE: Plant McDonough AP PROJECT #: Phase II CCR 1668496	
Collection DATE	Collection TIME	MATRIX CODE*	C O R A B C O M P	SAMPLE IDENTIFICATION	ANALYSIS REQUESTED
12/7/16	0935	GW	X	DGWC-12	Metals App III & IV (EPA 6020 & EPA 7470)
12/7/16	1055			DGWC-B	CI, F, SO4 (EPA 300) TDS (SM2540C)
12/7/16	1450			DGWC-14	Radium 226 & 228 (SM-846 9315 and 9320)
12/7/16	1437			DGWC-15	
12/7/16	1310			DGWC-19	
12/7/16	1615			DGWC-20	
12/7/16	1305			DGWC-37	
12/7/16	1415			DGWC-38	
12/7/16	1525			DGWC-39	
12/7/16				FD-1	
12/7/16				FD-2	
12/7/16	1639			FB-2	

SAMPLED BY AND TITLE: Kristen Jurinko Field Lead RECEIVED BY: Dawn Pirelli	DATE/TIME: 12/7/16 see Above DATE/TIME: 12/8/16 1030 DATE/TIME: 12/09/16 1218	RELINQUISHED BY: Dawn Pirelli DATE/TIME: 12/18/16 RELINQUISHED BY: Dawn Pirelli	DATE/TIME: 12/18/16 DATE/TIME: 12/18/16
---	---	---	--

RECEIVED BY LAB: Dawn Pirelli DATE/TIME: 12/09/16 1218	TEMPERATURE: 10 Min: 10 Max: 10	STATUS: No NA Yes No NA	SHIPMENT: Intact Broken Non-Transferable	SHIPMENT VIA: UPS FED-EX USPS COURIER CLIENT OTHER FS
---	---	-----------------------------------	--	---

CONTAINER TYPE: P - PLASTIC A - AMBER GLASS G - CLEAR GLASS V - VOA VIAL S - STERILE O - OTHER	PRESERVATION: 1 - HCl, ≤6°C 2 - H ₂ SO ₄ , ≤6°C 3 - HNO ₃ 4 - NaOH, ≤6°C 5 - NaOH/ZnAc, ≤6°C 6 - Na ₂ S ₂ O ₃ , ≤6°C 7 - ≤6°C not frozen
MATRIX CODES: DW - DRINKING WATER S - SOIL WW - WASTEWATER SL - SLUDGE GW - GROUNDWATER SD - SOLID SW - SURFACE WATER A - AIR ST - STORM WATER L - LIQUID W - WATER P - PRODUCT	
REMARKS/ADDITIONAL INFORMATION: → Sample not present NR 12/08/16 ← possible preservative loss in Radium bottle due to packaging	

LAB #: A2L0983 Entered into LIMS: NR Tracking #:	FOR LAB USE ONLY
---	-------------------------



Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.ash-lab.com

PAGE: 2 OF 2

CHAIN OF CUSTODY RECORD

CLIENT NAME:		ANALYSIS REQUESTED		CONTAINER TYPE		PRESERVATION	
Georgia Power		METALS APP III & IV (EPA 6020 & EPA 7470)		P - PLASTIC		1 - HCl, 56°C	
CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER:		CIT, SO4 (EPA 300) TDS (SM2540C)		A - AMBER GLASS		2 - H ₂ SO ₄ , 56°C	
241 Ralph McGill Blvd SE B10185		(SW-846 9315 and 9320) Radium 226 & 228		G - CLEAR GLASS		3 - HNO ₃	
Atlanta, GA 30308		Metals APP III & IV (EPA 6020 & EPA 7470)		V - VOA VIAL		4 - NaOH, 56°C	
404-506-7239		C, T, SO4 (EPA 300) TDS (SM2540C)		S - STERILE		5 - NaOH/ZnAc, 56°C	
REPORT TO:		Radiation 226 & 228 (SW-846 9315 and 9320)		O - OTHER		6 - Na ₂ S ₂ O ₃ , 56°C	
Dawn Prell (Dawn_Prell@golder.com)		Radiation 226 & 228 (SW-846 9315 and 9320)				7 - 56°C not frozen	
REQUESTED COMPLETION DATE:		Radiation 226 & 228 (SW-846 9315 and 9320)					
PO #:		Radiation 226 & 228 (SW-846 9315 and 9320)					
PROJECT NAME/STATE:		Radiation 226 & 228 (SW-846 9315 and 9320)					
Plant McDonough AP		Radiation 226 & 228 (SW-846 9315 and 9320)					
PROJECT #:		Radiation 226 & 228 (SW-846 9315 and 9320)					
1668496		Radiation 226 & 228 (SW-846 9315 and 9320)					
Collection DATE	Collection TIME	MATRIX CODE*	GRA B	COM P	SAMPLE IDENTIFICATION	CONTAINERS	
12/17/16	1614	W	X	E	B-2	3	
REMARKS/ADDITIONAL INFORMATION							
FOR LAB USE ONLY							
LAB #:		DATE/TIME:		DATE/TIME:		DATE/TIME:	
A2L0383		12/18/16		12/18/16		12/18/16	
Entered into LIMS:		RELINQUISHED BY:		RELINQUISHED BY:		RELINQUISHED BY:	
Tracking #:		SAMPLE SHIPPED VIA:		SAMPLE SHIPPED VIA:		SAMPLE SHIPPED VIA:	
		USPS COURIER / FedEx		USPS COURIER / FedEx		USPS COURIER / FedEx	
		Custody Seal: Intact Broken Not Resealed		Custody Seal: Intact Broken Not Resealed		Custody Seal: Intact Broken Not Resealed	
		Client: Other FS		Client: Other FS		Client: Other FS	
		Cooler ID:		Cooler ID:		Cooler ID:	



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

LOG-IN CHECKLIST

Printed: 12/12/2016 9:34:49AM

Attn: Mr. Joju Abraham

Client: Georgia Power

Project: CCR Event

Date Received: 12/08/16 12:15

Work Order: AZL0383

Logged In By: Mohammad M. Rahman

OBSERVATIONS

#Samples: 12

#Containers: 37

Minimum Temp(C): 1.0

Maximum Temp(C): 1.0

Custody Seal(s) Used: N/A

CHECKLIST ITEMS

COC included with Samples	YES
Sample Container(s) Intact	YES
Chain of Custody Complete	YES
Sample Container(s) Match COC	NO
Custody seal Intact	NO
Temperature in Compliance	YES
Sufficient Sample Volume for Analysis	YES
Zero Headspace Maintained for VOA Analyses	YES
Samples labeled preserved (If Applicable)	YES
Samples received within Allowable Hold Times	YES
Samples Received on Ice	YES
Preservation Confirmed	YES

Comments:

Sample DGWC-14 was not present in the cooler. MMR

Per communication with consultant on 12/9/2016, DGWC-14 was sampled 12/6/2016, received 12/7/2016 on work order AZL0284, and does not apply to work order AZL0383. BMeD

January 23, 2017

Maria Padilla
GA Power
2480 Maner Rd
Atlanta, GA 30339

RE: Project: Plant McDonough
Pace Project No.: 30205162

Dear Maria Padilla:

Enclosed are the analytical results for sample(s) received by the laboratory on December 12, 2016. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Jacquelyn Collins
jacquelyn.collins@pacelabs.com
Project Manager

Enclosures



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: Plant McDonough
Pace Project No.: 30205162

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601
L-A-B DOD-ELAP Accreditation #: L2417
Alabama Certification #: 41590
Arizona Certification #: AZ0734
Arkansas Certification
California Certification #: 04222CA
Colorado Certification
Connecticut Certification #: PH-0694
Delaware Certification
Florida/TNI Certification #: E87683
Georgia Certification #: C040
Guam Certification
Hawaii Certification
Idaho Certification
Illinois Certification
Indiana Certification
Iowa Certification #: 391
Kansas/TNI Certification #: E-10358
Kentucky Certification #: 90133
Louisiana DHH/TNI Certification #: LA140008
Louisiana DEQ/TNI Certification #: 4086
Maine Certification #: PA00091
Maryland Certification #: 308
Massachusetts Certification #: M-PA1457
Michigan/PADEP Certification
Missouri Certification #: 235

Montana Certification #: Cert 0082
Nebraska Certification #: NE-05-29-14
Nevada Certification #: PA014572015-1
New Hampshire/TNI Certification #: 2976
New Jersey/TNI Certification #: PA 051
New Mexico Certification #: PA01457
New York/TNI Certification #: 10888
North Carolina Certification #: 42706
North Dakota Certification #: R-190
Oregon/TNI Certification #: PA200002
Pennsylvania/TNI Certification #: 65-00282
Puerto Rico Certification #: PA01457
Rhode Island Certification #: 65-00282
South Dakota Certification
Tennessee Certification #: TN2867
Texas/TNI Certification #: T104704188-14-8
Utah/TNI Certification #: PA014572015-5
USDA Soil Permit #: P330-14-00213
Vermont Dept. of Health: ID# VT-0282
Virgin Island/PADEP Certification
Virginia/VELAP Certification #: 460198
Washington Certification #: C868
West Virginia DEP Certification #: 143
West Virginia DHHR Certification #: 9964C
Wisconsin Certification
Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: Plant McDonough

Pace Project No.: 30205162

Lab ID	Sample ID	Matrix	Date Collected	Date Received
30205162001	DGWC-12	Water	12/07/16 09:35	12/12/16 09:20
30205162002	DGWC-13	Water	12/07/16 10:55	12/12/16 09:20
30205162003	DGWC-15	Water	12/07/16 14:37	12/12/16 09:20
30205162004	DGWC-19	Water	12/07/16 13:10	12/12/16 09:20
30205162005	DGWC-20	Water	12/07/16 16:15	12/12/16 09:20
30205162006	DGWC-37	Water	12/07/16 13:05	12/12/16 09:20
30205162007	DGWC-38	Water	12/07/16 14:15	12/12/16 09:20
30205162008	DGWC-39	Water	12/07/16 15:25	12/12/16 09:20
30205162009	FD-1	Water	12/07/16 00:00	12/12/16 09:20
30205162010	FD-2	Water	12/07/16 00:00	12/12/16 09:20
30205162011	FB-2	Water	12/07/16 16:39	12/12/16 09:20
30205162012	EB-2	Water	12/07/16 16:14	12/12/16 09:20

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough
Pace Project No.: 30205162

Lab ID	Sample ID	Method	Analysts	Analytes Reported
30205162001	DGWC-12	EPA 9315	LAL	1
		EPA 9320	JAL	1
		Total Radium Calculation	CMC	1
30205162002	DGWC-13	EPA 9315	LAL	1
		EPA 9320	JAL	1
		Total Radium Calculation	CMC	1
30205162003	DGWC-15	EPA 9315	LAL	1
		EPA 9320	JAL	1
		Total Radium Calculation	CMC	1
30205162004	DGWC-19	EPA 9315	LAL	1
		EPA 9320	JAL	1
		Total Radium Calculation	CMC	1
30205162005	DGWC-20	EPA 9315	LAL	1
		EPA 9320	JAL	1
		Total Radium Calculation	CMC	1
30205162006	DGWC-37	EPA 9315	LAL	1
		EPA 9320	JAL	1
		Total Radium Calculation	CMC	1
30205162007	DGWC-38	EPA 9315	LAL	1
		EPA 9320	JAL	1
		Total Radium Calculation	CMC	1
30205162008	DGWC-39	EPA 9315	LAL	1
		EPA 9320	JAL	1
		Total Radium Calculation	CMC	1
30205162009	FD-1	EPA 9315	LAL	1
		EPA 9320	JAL	1
		Total Radium Calculation	CMC	1
30205162010	FD-2	EPA 9315	LAL	1
		EPA 9320	JAL	1
		Total Radium Calculation	CMC	1
30205162011	FB-2	EPA 9315	LAL	1
		EPA 9320	JAL	1
		Total Radium Calculation	CMC	1
30205162012	EB-2	EPA 9315	LAL	1
		EPA 9320	JAL	1
		Total Radium Calculation	CMC	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough
Pace Project No.: 30205162

Sample: DGWC-12		Lab ID: 30205162001	Collected: 12/07/16 09:35	Received: 12/12/16 09:20	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.230 ± 0.192 (0.332) C:94% T:NA	pCi/L	01/13/17 08:21	13982-63-3		
Radium-228	EPA 9320	2.43 ± 0.720 (0.822) C:70% T:81%	pCi/L	01/21/17 16:46	15262-20-1		
Total Radium	Total Radium Calculation	2.66 ± 0.912 (1.15)	pCi/L	01/23/17 08:32	7440-14-4		

Sample: DGWC-13		Lab ID: 30205162002	Collected: 12/07/16 10:55	Received: 12/12/16 09:20	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.434 ± 0.251 (0.354) C:90% T:NA	pCi/L	01/13/17 08:21	13982-63-3		
Radium-228	EPA 9320	1.33 ± 0.544 (0.835) C:69% T:82%	pCi/L	01/21/17 16:46	15262-20-1		
Total Radium	Total Radium Calculation	1.76 ± 0.795 (1.19)	pCi/L	01/23/17 08:32	7440-14-4		

Sample: DGWC-15		Lab ID: 30205162003	Collected: 12/07/16 14:37	Received: 12/12/16 09:20	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.0845 ± 0.183 (0.430) C:92% T:NA	pCi/L	01/13/17 08:21	13982-63-3		
Radium-228	EPA 9320	1.65 ± 0.670 (1.06) C:67% T:76%	pCi/L	01/21/17 16:46	15262-20-1		
Total Radium	Total Radium Calculation	1.73 ± 0.853 (1.49)	pCi/L	01/23/17 08:32	7440-14-4		

Sample: DGWC-19		Lab ID: 30205162004	Collected: 12/07/16 13:10	Received: 12/12/16 09:20	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.166 ± 0.207 (0.432) C:93% T:NA	pCi/L	01/13/17 08:21	13982-63-3		
Radium-228	EPA 9320	0.737 ± 0.467 (0.884) C:71% T:89%	pCi/L	01/21/17 16:48	15262-20-1		
Total Radium	Total Radium Calculation	0.903 ± 0.674 (1.32)	pCi/L	01/23/17 08:32	7440-14-4		

Sample: DGWC-20		Lab ID: 30205162005	Collected: 12/07/16 16:15	Received: 12/12/16 09:20	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.359 ± 0.273 (0.497) C:92% T:NA	pCi/L	01/13/17 08:21	13982-63-3		
Radium-228	EPA 9320	0.905 ± 0.510 (0.932) C:74% T:81%	pCi/L	01/21/17 16:48	15262-20-1		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough
Pace Project No.: 30205162

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Total Radium	Total Radium Calculation	1.26 ± 0.783 (1.43)	pCi/L	01/23/17 08:32	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.190 ± 0.178 (0.309) C:86% T:NA	pCi/L	01/13/17 08:27	13982-63-3	
Radium-228	EPA 9320	0.370 ± 0.496 (1.06) C:77% T:80%	pCi/L	01/21/17 16:48	15262-20-1	
Total Radium	Total Radium Calculation	0.560 ± 0.674 (1.37)	pCi/L	01/23/17 08:32	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.00686 ± 0.103 (0.296) C:97% T:NA	pCi/L	01/13/17 08:27	13982-63-3	
Radium-228	EPA 9320	0.213 ± 0.403 (0.885) C:75% T:88%	pCi/L	01/22/17 12:51	15262-20-1	
Total Radium	Total Radium Calculation	0.220 ± 0.506 (1.18)	pCi/L	01/23/17 08:45	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.0206 ± 0.147 (0.387) C:93% T:NA	pCi/L	01/13/17 08:27	13982-63-3	
Radium-228	EPA 9320	2.14 ± 0.690 (0.932) C:68% T:82%	pCi/L	01/22/17 12:51	15262-20-1	
Total Radium	Total Radium Calculation	2.16 ± 0.837 (1.32)	pCi/L	01/23/17 08:45	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.249 ± 0.226 (0.431) C:95% T:NA	pCi/L	01/13/17 08:27	13982-63-3	
Radium-228	EPA 9320	1.37 ± 0.551 (0.862) C:70% T:85%	pCi/L	01/22/17 12:51	15262-20-1	
Total Radium	Total Radium Calculation	1.62 ± 0.777 (1.29)	pCi/L	01/23/17 08:45	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough

Pace Project No.: 30205162

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: FD-2		Lab ID: 30205162010	Collected: 12/07/16 00:00	Received: 12/12/16 09:20	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Radium-226	EPA 9315	0.0572 ± 0.142 (0.343)	pCi/L	01/13/17 08:27	13982-63-3		
Radium-228	EPA 9320	0.419 ± 0.399 (0.819)	pCi/L	01/22/17 12:51	15262-20-1		
Total Radium	Total Radium Calculation	0.476 ± 0.541 (1.16)	pCi/L	01/23/17 08:45	7440-14-4		

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: FB-2		Lab ID: 30205162011	Collected: 12/07/16 16:39	Received: 12/12/16 09:20	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Radium-226	EPA 9315	0.0740 ± 0.137 (0.313)	pCi/L	01/13/17 08:27	13982-63-3		
Radium-228	EPA 9320	0.398 ± 0.445 (0.932)	pCi/L	01/22/17 12:51	15262-20-1		
Total Radium	Total Radium Calculation	0.472 ± 0.582 (1.25)	pCi/L	01/23/17 08:45	7440-14-4		

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: EB-2		Lab ID: 30205162012	Collected: 12/07/16 16:14	Received: 12/12/16 09:20	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Radium-226	EPA 9315	-0.102 ± 0.0798 (0.356)	pCi/L	01/13/17 08:27	13982-63-3		
Radium-228	EPA 9320	0.997 ± 0.484 (0.835)	pCi/L	01/22/17 12:52	15262-20-1		
Total Radium	Total Radium Calculation	0.997 ± 0.564 (1.19)	pCi/L	01/23/17 08:45	7440-14-4		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough

Pace Project No.: 30205162

QC Batch:	245738	Analysis Method:	EPA 9320
QC Batch Method:	EPA 9320	Analysis Description:	9320 Radium 228
Associated Lab Samples:	30205162007, 30205162008, 30205162009, 30205162010, 30205162011, 30205162012		

METHOD BLANK:	1208849	Matrix:	Water
Associated Lab Samples:	30205162007, 30205162008, 30205162009, 30205162010, 30205162011, 30205162012		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.754 ± 0.449 (0.836) C:74% T:81%	pCi/L	01/22/17 12:51	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough

Pace Project No.: 30205162

QC Batch:	245735	Analysis Method:	EPA 9315
QC Batch Method:	EPA 9315	Analysis Description:	9315 Total Radium
Associated Lab Samples:	30205162001, 30205162002, 30205162003, 30205162004, 30205162005, 30205162006		

METHOD BLANK:	1208845	Matrix:	Water
Associated Lab Samples:	30205162001, 30205162002, 30205162003, 30205162004, 30205162005, 30205162006		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.0640 ± 0.166 (0.402) C:91% T:NA	pCi/L	01/13/17 08:20	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough

Pace Project No.: 30205162

QC Batch:	245736	Analysis Method:	EPA 9320
QC Batch Method:	EPA 9320	Analysis Description:	9320 Radium 228
Associated Lab Samples:	30205162001, 30205162002, 30205162003, 30205162004, 30205162005, 30205162006		

METHOD BLANK:	1208846	Matrix:	Water
Associated Lab Samples:	30205162001, 30205162002, 30205162003, 30205162004, 30205162005, 30205162006		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.286 ± 0.385 (0.821) C:68% T:88%	pCi/L	01/21/17 16:43	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough

Pace Project No.: 30205162

QC Batch: 245737

Analysis Method: EPA 9315

QC Batch Method: EPA 9315

Analysis Description: 9315 Total Radium

Associated Lab Samples: 30205162007, 30205162008, 30205162009, 30205162010, 30205162011, 30205162012

METHOD BLANK: 1208848

Matrix: Water

Associated Lab Samples: 30205162007, 30205162008, 30205162009, 30205162010, 30205162011, 30205162012

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.0643 ± 0.137 (0.321) C:95% T:NA	pCi/L	01/13/17 08:27	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: Plant McDonough
Pace Project No.: 30205162

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

Chain of Custody



Workorder: AZL0383

Owner Received Date:

Workorder Name: Plant McDonough

Results Requested By: 1/10/2017

Report To: Betsy McDaniel
 Pace Analytical Atlanta
 110 Technology Parkway
 Peachtree Corners, GA 30092
 Phone (770)-734-4200

Subcontract To:
 Pace - Pittsburgh
 1638 Roseytown Road
 Stes. 2,3,4
 Greensburg, PA 15601
 Phone (724) 850-5600

Requested Analysis

WO#: 30205162



Item	Sample ID	Sample Type	Collect Date/Time	Lab ID	Matrix	Preserved Containers	NO3	NO2	NO	LAB USE ONLY
1	DGWC-12	G	12/7/2016 9:35	AZL0383-01	GW		2			001
2	DGWC-13	G	12/7/2016 10:55	AZL0383-02	GW		1			002
3	DGWC-15	G	12/7/2016 14:37	AZL0383-03	GW		1			003
4	DGWC-19	G	12/7/2016 13:10	AZL0383-04	GW		1			004
5	DGWC-20	G	12/7/2016 16:15	AZL0383-05	GW		1			005
6	DGWC-37	G	12/7/2016 13:05	AZL0383-06	GW		1			006
7	DGWC-38	G	12/7/2016 14:15	AZL0383-07	GW		1			007
8	DGWC-39	G	12/7/2016 15:25	AZL0383-08	GW		1			008
9	FD-1	G	12/7/2016 0:00	AZL0383-09	GW		1			009
10	FD-2	G	12/7/2016 0:00	AZL0383-10	GW		1			010

Transfers Released By: Received By: Date/Time: Comments: Radium 226, 228, Total

1										12-12-16 0970
2										
3										

Cooler Temperature on Receipt M/A °C Custody Seal Y or N Received on ice Y or N Sample Intact Y or N

***In order to maintain client confidentiality, location/name of the sampling site, sampler's name and signature may not be provided on this COC

This chain of custody is considered complete as is since this information is available in the owner laboratory.

Friday, June 17, 2016 11:01:34 AM

FMT-ALL-C-002rev.00 24March2009

Page 1 of 2

30205162



Chain of Custody

Results Requested By: 1/10/2017

Owner Received Date:

Workorder Name: Plant McDonough

Subcontract To:

Report To:

Pace - Pittsburgh
1638 Roseytown Road
Stes. 2,3,4
Greensburg, PA 15601
Phone (724) 850-5600

Betsy McDaniel
Pace Analytical Atlanta
110 Technology Parkway
Peachtree Corners, GA 30092
Phone (770)-734-4200

Item	Sample ID	Sample Type	Collect Date/Time	Lab ID	Matrix	Preserved Containers		Date/Time	Received By	Date/Time	Comments
						H	NH				
11	FB-2	G	12/7/2016 16:39	AZ0383-11	W	1					
12	EB-2	G	12/7/2016 16:14	AZ0383-12	W	1			<i>Wahley Rose Pace</i>	12-12-16/0920	
13											
14											
15											
16											
17											
18											
19											
20											
Transfers Released By											
1											
2											
3											

Cooler Temperature on Receipt N/A °C Custody Seal Y or (N) Received on Ice Y or (N) Sample Intact Y or N

***In order to maintain client confidentiality, location/name of the sampling site, sampler's name and signature may not be provided on this COC. This chain of custody is considered complete as is since this information is available in the owner laboratory.

Friday, June 17, 2016 11:01:34 AM

FMT-ALL-C-002rev.00 24March2009

Page 2 of 2

30205162

PAGE: 1 OF 2

Pace Analytical Services, Inc.
110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
(770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com



CHAIN OF CUSTODY RECORD

CLIENT NAME:		ANALYSIS REQUESTED		CONTAINER TYPE		PRESERVATION	
Georgia Power		P P P P		P - PLASTIC		1 - HCl, 56°C	
241 Ralph McGill Blvd SE B10185		P P P P		A - AMBER GLASS		2 - H ₂ SO ₄ , 56°C	
Atlanta, GA 30308		P P P P		G - CLEAR GLASS		3 - HNO ₃	
404-506-7239		P P P P		V - VOA VIAL		4 - NaOH/ZnAc, 56°C	
REPORT TO:		P P P P		S - STERILE		5 - NaOH/ZnAc, 56°C	
Dawn Prael (Dawn.Prael@golder.com)		P P P P		O - OTHER		6 - Na ₂ S ₂ O ₈ , 56°C	
REQUESTED COMPLETION DATE:		P P P P				7 - 56°C not frozen	
PO #:		P P P P					
PROJECT NAME/STATE:		P P P P					
Plant McDonough AP		P P P P					
PROJECT #:		P P P P					
1668496		P P P P					
Collection DATE	Collection TIME	MATRIX CODE*	C O R A B	SAMPLE IDENTIFICATION	CONTAINER TYPE	PRESERVATION	REMARKS/ADDITIONAL INFORMATION
12/7/16	0935	GW	X	DGWC-12			
12/7/16	1055			DGWC-13			
12/7/16	1450			DGWC-14			
12/7/16	1437			DGWC-15			
12/7/16	1310			DGWC-19			
12/7/16	1615			DGWC-20			
12/7/16	1305			DGWC-37			
12/7/16	1415			DGWC-38			
12/7/16	1525			DGWC-39			
12/7/16				FD-1			
12/7/16				FD-2			
12/7/16	1639			FB-2			
SAMPLED BY AND TITLE:		RELINQUISHED BY:		DATE/TIME:		DATE/TIME:	
Kristen Jurinka Field Lead		[Signature]		12/13/16		12/13/16	
RECEIVED BY:		RELINQUISHED BY:		DATE/TIME:		DATE/TIME:	
[Signature]		[Signature]		12/13/16		12/13/16	
RECEIVED BY LAB:		SAMPLE SHIPPED VIA:		CLIENT:		OTHER: FS	
[Signature]		UPS		GOLDER		GOLDER	
PROJECT:		Custody Seal:		# of Containers:		Custody ID:	
[Signature]		Intact / Broken		1		[Signature]	
Temp/ature:		Masc:		1030		1030	
12/13/16		12/13/16		12/13/16		12/13/16	

Plant McDonough COC.xlsx

30205162

Pace Analytical Services, Inc.
110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
(770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

PAGE: 2 OF 2

CHAIN OF CUSTODY RECORD

CLIENT NAME: Georgia Power
CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185
 Atlanta, GA 30308
 404-506-7239
REPORT TO: Dawn Prell (Dawn_Prell@golder.com)
 Maria Pedilla, Health McConkle
REQUESTED COMPLETION DATE: PC #
PROJECT NAME/STATE: Plant McDonough AP
PROJECT #: Phase II CCR
 1668496

Collection DATE	Collection TIME	MATRIX CODE*	C O M P				SAMPLE IDENTIFICATION
			G	A	B	A	
12/17/16	1614	w	X	E	B	2	

CONTAINERS → 3

CONTAINER TYPE:	ANALYSIS REQUESTED		DATE/TIME
	P	P	
# of PRESERVATION	3&7	7 3&7	12/18/16
		Meis AP III & IV (EPA 6020 & EPA 7470)	
		Cl, F, SO4 (EPA 300) TDS (SM2640C)	
		Radium 226 & 228 (SW-846 9315 and 9320)	

CONTAINER TYPE PRESERVATION
 P - PLASTIC 1 - HCl, ≤6°C
 A - AMBER GLASS 2 - H₂SO₄, ≤6°C
 G - CLEAR GLASS 3 - HNO₃
 V - VOA VIAL 4 - NaOH, ≤6°C
 S - STERILE 5 - NaOH/IZnAc, ≤6°C
 O - OTHER 6 - Na₂S₂O₃, ≤6°C
 7 - ≤6°C not frozen

MATRIX CODES:
 DW - DRINKING WATER S - SOIL
 WW - WASTEWATER SL - SLUDGE
 GW - GROUNDWATER SD - SOLID
 SW - SURFACE WATER A - AIR
 ST - STORM WATER L - LIQUID
 W - WATER P - PRODUCT

REMARKS/ADDITIONAL INFORMATION

LAB # A2L0383 FOR LAB USE ONLY
 Entered Into LIMS:
 Tracking #:

RELINQUISHED BY:	DATE/TIME:	RELINQUISHED BY:	DATE/TIME:
[Signature]	12/18/16	[Signature]	12/18/16

SAMPLE SHIPPED VIA: COURIER / UPS
 Custody Sealed: Intact Broken Not Resealed
 # of Coolers: 1
 Cooler ID:

RECEIVED BY LAB: Kristin Juriniko
 RECEIVED BY: N. G. Y. SA
 RECEIVED BY: [Signature]
 Date: 12/18/16 1030
 Temperature: 16°C

Plant McDonough COC.xlsx

Sample Condition Upon Receipt Pittsburgh

30205162



Client Name: Pace Georgia Project # _____

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: 08125101 0100

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Thermometer Used N/A Type of Ice: Wet Blue (None)

Cooler Temperature Observed Temp N/A °C Correction Factor: N/A °C Final Temp: N/A °C

Temp should be above freezing to 6°C

Date and Initials of person examining contents: KA 12-12-16

Comments:	Yes	No	N/A	
Chain of Custody Present:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	1.
Chain of Custody Filled Out:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	2.
Chain of Custody Relinquished:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	3.
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	4.
Sample Labels match COC:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	5.
-Includes date/time/ID/Analysis Matrix: <u>WT</u>				
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	6.
Short Hold Time Analysis (<72hr remaining):	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	7.
Rush Turn Around Time Requested:	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	8.
Sufficient Volume:	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	9.
Correct Containers Used:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	10.
-Pace Containers Used:	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
Containers Intact:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	11.
Filtered volume received for Dissolved tests	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	12.
All containers needing preservation have been checked.	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	13.
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
exceptions: VOA, coliform, TOC, O&G, Phenolics				Initial when completed: <u>AKA</u> Date/time of preservation
				Lot # of added preservative
Headspace in VOA Vials (>6mm):	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	14.
Trip Blank Present:	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	15.
Trip Blank Custody Seals Present	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
Rad Aqueous Samples Screened > 0.5 mrem/hr	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Initial when completed: <u>AKA</u> Date: <u>12-13-16</u>

Client Notification/ Resolution:

Person Contacted: _____ Date/Time: _____ Contacted By: _____

Comments/ Resolution: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)
 *PM review is documented electronically in LIMS. When the Project Manager closes the SRF Review schedule in LIMS. The review is in the Status section of the Workorder Edit Screen.

Quality Control Sample Performance Assessment



www.paceanalytical.com

Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-228
Analyst: JAL
Date: 1/11/2017
Worklist: 33369
Matrix: DW

Method Blank Assessment

MB Sample ID: 1208849
MB concentration: 0.754
M/B Counting Uncertainty: 0.429
MB MDC: 0.836
MB Numerical Performance Indicator: 3.45
MB Status vs Numerical Indicator: N/A
MB Status vs. MDC: Pass

Laboratory Control Sample Assessment

LCS (Y or N)? N
LCS33369

Count Date: 1/22/2017
Spike I.D.: 16-027
Spike Concentration (pCi/mL): 25.496
Volume Used (mL): 0.20
Aliquot Volume (L, g, F): 0.805
Target Conc. (pCi/L, g, F): 6.333
Uncertainty (Calculated): 0.456
Result (pCi/L, g, F): 7.208
LCS/LCSD Counting Uncertainty (pCi/L, g, F): 0.813
Numerical Performance Indicator: 1.84
Percent Recovery: 113.81%
Status vs Numerical Indicator: N/A
Status vs Recovery: Pass

Duplicate Sample Assessment

Sample I.D.: 30205165010
Duplicate Sample I.D.: 30205165010DUP
Sample Result (pCi/L, g, F): 1.294
Sample Result Counting Uncertainty (pCi/L, g, F): 0.518
Sample Duplicate Result (pCi/L, g, F): 2.243
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F): 0.546
Are sample and/or duplicate results below MDC? See Below ##
Duplicate Numerical Performance Indicator: -2.471
Duplicate RPD: 53.69%
Duplicate Status vs Numerical Indicator: N/A
Duplicate Status vs RPD: Fail***

Enter Duplicate sample IDs if other than LCS/LCSD in the space below.
30205165010
30205165010DUP

Sample Matrix Spike Control Assessment

Sample Collection Date:
Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Spike I.D.:
MS/MSD Decay Corrected Spike Concentration (pCi/mL):
Spike Volume Used in MS (mL):
Spike Volume Used in MSD (mL):
MS Aliquot (L, g, F):
MS Target Conc. (pCi/L, g, F):
MSD Aliquot (L, g, F):
MSD Target Conc. (pCi/L, g, F):
Spike uncertainty (calculated):
Sample Result:
Sample Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
MS Numerical Performance Indicator:
MS Percent Recovery:
MSD Percent Recovery:
MS Status vs Numerical Indicator:
MSD Status vs Numerical Indicator:
MS Status vs Recovery:
MSD Status vs Recovery:

Matrix Spike/Matrix Spike Duplicate Sample Assessment

Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Sample Matrix Spike Result:
Sample Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Sample Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
Duplicate Numerical Performance Indicator:
(Based on the Percent Recoveries) MS/MSD Duplicate RPD:
MS/MSD Duplicate Status vs Numerical Indicator:
MS/MSD Duplicate Status vs RPD:

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

***Batch must be re-prepped due to unacceptable precision.

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: LAL
Date: 1/12/2017
Worklist: 33368
Matrix: DW

Method Blank Assessment

MB Sample ID: 1208848
MB concentration: 0.064
MB Counting Uncertainty: 0.136
MB MDC: 0.321
MB Numerical Performance Indicator: 0.92
MB Status vs Numerical Indicator: N/A
MB Status vs. MDC: Pass

Laboratory Control Sample Assessment

LCSID (Y or N)? N
LCS33368
LCS33368

Count Date: 1/16/2017
Spike I.D.: 16-026
Spike Concentration (pCi/mL): 44.671
Volume Used (mL): 0.10
Aliquot Volume (L, g, F): 0.504
Target Conc. (pCi/L, g, F): 8.856
Uncertainty (Calculated): 0.417
Result (pCi/L, g, F): 7.727
LCS/LCSD Counting Uncertainty (pCi/L, g, F): 0.676
Numerical Performance Indicator: -2.79
Percent Recovery: 87.25%
Status vs Numerical Indicator: N/A
Status vs Recovery: Pass

Duplicate Sample Assessment

Sample I.D.: 30205165010
Duplicate Sample I.D.: 30205165010DUP
Sample Result (pCi/L, g, F): -0.030
Sample Duplicate Result (pCi/L, g, F): 0.079
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F): 0.183
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F): 0.132
Are sample and/or duplicate results below MDC? See Below #
Duplicate Numerical Performance Indicator: -2.717
Duplicate RPD: 277.85%
Duplicate Status vs Numerical Indicator: N/A
Duplicate Status vs RPD: Fail***

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

***Batch must be re-prepped due to unacceptable precision.

Am/23/17

Sample Matrix Spike Control Assessment

Sample Collection Date:
Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Spike I.D.:
MS/MSD Decay Corrected Spike Concentration (pCi/mL):
Spike Volume Used in MS (mL):
Spike Volume Used in MSD (mL):
MS Aliquot (L, g, F):
MS Target Conc. (pCi/L, g, F):
MSD Aliquot (L, g, F):
MSD Target Conc. (pCi/L, g, F):
Spike uncertainty (calculated):
Sample Result:
Sample Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
MS Numerical Performance Indicator:
MSD Numerical Performance Indicator:
MS Percent Recovery:
MSD Percent Recovery:
MS Status vs Numerical Indicator:
MSD Status vs Numerical Indicator:
MS Status vs Recovery:
MSD Status vs Recovery:

Matrix Spike/Matrix Spike Duplicate Sample Assessment

Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Sample Matrix Spike Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
Duplicate Numerical Performance Indicator:
MS/MSD Duplicate RPD:
MS/MSD Duplicate Status vs Numerical Indicator:
MS/MSD Duplicate Status vs RPD:

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: LAL
Date: 1/12/2017
Worklist: 33366
Matrix: DW

Method Blank Assessment

MB Sample ID: 1208845
MB concentration: 0.064
MB Counting Uncertainty: 0.166
MB MDC: 0.402
MB Numerical Performance Indicator: 0.76
MB Status vs Numerical Indicator: N/A
MB Status vs. MDC: Pass

Laboratory Control Sample Assessment

LCSID (Y or N)?	N
LCS33366	LCS033366
Count Date: 1/13/2017	
Spike I.D.: 16-026	
Spike Concentration (pCi/mL): 44.671	
Volume Used (mL): 0.10	
Aliquot Volume (L, g, F): 0.503	
Target Conc. (pCi/L, g, F): 8.875	
Uncertainty (Calculated): 0.417	
Result (pCi/L, g, F): 6.807	
LCS/LCSD Counting Uncertainty (pCi/L, g, F): 0.818	
Numerical Performance Indicator: -4.41	
Percent Recovery: 76.70%	
Status vs Numerical Indicator: N/A	
Status vs Recovery: Pass	

Duplicate Sample Assessment

Sample I.D.: 30205160001
Duplicate Sample I.D.: 30205160001DUP
Sample Result (pCi/L, g, F): 0.408
Sample Result Counting Uncertainty (pCi/L, g, F): 0.253
Sample Duplicate Result (pCi/L, g, F): 0.029
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F): 0.123
Are sample and/or duplicate results below MDC? See Below ##
Duplicate Numerical Performance Indicator: 2.639
Duplicate RPD: 173.30%
Duplicate Status vs Numerical Indicator: N/A
Duplicate Status vs RPD: Fail***

*** Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

***Batch must be re-prepped due to unacceptable precision.

[Handwritten Signature]
1/12/17

Sample Matrix Spike Control Assessment

Sample Collection Date:
Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:

MS/MSD Decay Corrected Spike Concentration (pCi/mL):
Spike I.D.:
Spike Volume Used in MS (mL):
MS Aliquot (L, g, F):
MS Target Conc. (pCi/L, g, F):
MSD Aliquot (L, g, F):
MSD Target Conc. (pCi/L, g, F):
Spike uncertainty (calculated):

Sample Result:
Sample Result Counting Uncertainty (pCi/L, g, F):
Matrix Spike Result:
Sample Matrix Spike Result:
Sample Matrix Spike Duplicate Result:
Sample Matrix Spike Duplicate Result:
MS Numerical Performance Indicator:
MSD Numerical Performance Indicator:
MS Percent Recovery:
MSD Percent Recovery:
MS Status vs Numerical Indicator:
MSD Status vs Numerical Indicator:
MS Status vs Recovery:
MSD Status vs Recovery:

Matrix Spike/Matrix Spike Duplicate Sample Assessment

Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:

Sample Matrix Spike Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Sample Matrix Spike Duplicate Result:
Duplicate Numerical Performance Indicator:
MS/MSD Duplicate RPD:
MS/MSD Duplicate Status vs Numerical Indicator:
MS/MSD Duplicate Status vs RPD:

Quality Control Sample Performance Assessment

Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-228
Analyst: JAL
Date: 1/11/2017
Worklist: 33367
Matrix: DW



Method Blank Assessment	
MB Sample ID	1208846
MB concentration:	0.286
M/B Counting Uncertainty:	0.381
MB MDC:	0.821
MB Numerical Performance Indicator:	1.47
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment	
LCS (Y or N)?	N
LCS ID	LCSD33367
Count Date:	1/21/2017
Spike I.D.:	16-027
Spike Concentration (pCi/mL):	25.503
Volume Used (mL):	0.20
Aliquot Volume (L, g, F):	0.809
Target Conc. (pCi/L, g, F):	6.307
Uncertainty (Calculated):	0.454
Result (pCi/L, g, F):	6.535
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.834
Numerical Performance Indicator:	0.47
Percent Recovery:	103.62%
Status vs Numerical Indicator:	N/A
Status vs Recovery:	Pass

Duplicate Sample Assessment	
Sample I.D.:	30205160004
Duplicate Sample I.D.:	30205160004DUP
Sample Result (pCi/L, g, F):	1.855
Sample Duplicate Result (pCi/L, g, F):	0.553
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	2.225
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.584
Are sample and/or duplicate results below MDC?	See Below ##
Duplicate Numerical Performance Indicator:	-0.903
Duplicate RPD:	18.15%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Pass

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

JAL 1/13/17

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Sample Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Sample Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
(Based on the Percent Recoveries) MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Laboratory Report

Prepared For:

**Georgia Power
2480 Maner Road
Atlanta, GA 30339**

Attention: Mr. Joju Abraham

Report Number: AZL0437

December 30, 2016

Project: CCR Event

Project #:Plant McDonough

We appreciate the opportunity to provide the analytical support for your project. The analytical results in this report are based upon information supplied by you, the client, and are for your exclusive use. If you have any questions regarding this data package, please do not hesitate to call.

Approved:

A handwritten signature in black ink, appearing to read "Betty McDaniel", written over a horizontal line.

Project Manager

This report may not be reproduced, except in full, without written approval from Pace Analytical Services, LLC.
All test results relate only to the samples analyzed.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

December 30, 2016

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
DGWC-17	AZL0437-01	Ground Water	12/08/16 09:35	12/09/16 11:45
DGWC-21	AZL0437-02	Ground Water	12/08/16 11:00	12/09/16 11:45
DGWC-22	AZL0437-03	Ground Water	12/08/16 12:16	12/09/16 11:45
DGWC-40	AZL0437-04	Ground Water	12/08/16 09:10	12/09/16 11:45
DGWC-42	AZL0437-05	Ground Water	12/08/16 11:20	12/09/16 11:45
DGWC-47	AZL0437-06	Ground Water	12/08/16 14:10	12/09/16 11:45
DGWC-48	AZL0437-07	Ground Water	12/08/16 14:07	12/09/16 11:45
FD-3	AZL0437-08	Ground Water	12/08/16 00:00	12/09/16 11:45
FB-3	AZL0437-09	Water	12/08/16 13:08	12/09/16 11:45
EB-3	AZL0437-10	Water	12/08/16 13:03	12/09/16 11:45



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

December 30, 2016

Attention: Mr. Joju Abraham

Report No.: AZL0437

Project: CCR Event

Client ID: DGWC-17

Lab Number ID: AZL0437-01

Date/Time Sampled: 12/8/2016 9:35:00AM

Date/Time Received: 12/9/2016 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	408	25	10	mg/L	SM 2540 C		1	12/14/16 19:17	12/14/16 19:17	6120357	JPT
Inorganic Anions											
Chloride	19	0.25	0.01	mg/L	EPA 300.0		1	12/23/16 08:53	12/24/16 08:17	6120720	RNB
Fluoride	0.31	0.30	0.02	mg/L	EPA 300.0		1	12/23/16 08:53	12/24/16 08:17	6120720	RNB
Sulfate	240	10	0.51	mg/L	EPA 300.0		10	12/23/16 08:53	12/24/16 21:15	6120720	RNB
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:27	6120446	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:27	6120446	CSW
Barium	0.0620	0.0100	0.0004	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:27	6120446	CSW
Beryllium	0.0005	0.0030	0.00008	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/16/16 23:27	6120446	CSW
Boron	0.688	0.0400	0.0064	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:27	6120446	CSW
Cadmium	0.0003	0.0010	0.00007	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/16/16 23:27	6120446	CSW
Calcium	7.92	0.500	0.0311	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:27	6120446	CSW
Chromium	0.0025	0.0100	0.0009	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/16/16 23:27	6120446	CSW
Cobalt	0.0290	0.0100	0.0005	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:27	6120446	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:27	6120446	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:27	6120446	CSW
Selenium	0.0087	0.0100	0.0010	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/16/16 23:27	6120446	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:27	6120446	CSW
Lithium	ND	0.0500	0.0021	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:27	6120446	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	12/15/16 10:35	12/15/16 15:45	6120427	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

December 30, 2016

Attention: Mr. Joju Abraham

Report No.: AZL0437

Project: CCR Event

Client ID: DGWC-21

Lab Number ID: AZL0437-02

Date/Time Sampled: 12/8/2016 11:00:00AM

Date/Time Received: 12/9/2016 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	491	25	10	mg/L	SM 2540 C		1	12/14/16 19:17	12/14/16 19:17	6120357	JPT
Inorganic Anions											
Chloride	24	0.25	0.01	mg/L	EPA 300.0		1	12/23/16 08:53	12/24/16 08:39	6120720	RNB
Fluoride	0.14	0.30	0.02	mg/L	EPA 300.0	J	1	12/23/16 08:53	12/24/16 08:39	6120720	RNB
Sulfate	280	10	0.51	mg/L	EPA 300.0		10	12/23/16 08:53	12/24/16 21:36	6120720	RNB
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:44	6120446	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:44	6120446	CSW
Barium	0.0262	0.0100	0.0004	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:44	6120446	CSW
Beryllium	0.0001	0.0030	0.00008	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/16/16 23:44	6120446	CSW
Boron	3.57	0.0400	0.0064	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:44	6120446	CSW
Cadmium	0.0006	0.0010	0.00007	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/16/16 23:44	6120446	CSW
Calcium	70.1	5.00	0.311	mg/L	EPA 6020B		10	12/15/16 09:25	12/23/16 13:08	6120446	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:44	6120446	CSW
Cobalt	0.0095	0.0100	0.0005	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/16/16 23:44	6120446	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:44	6120446	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:44	6120446	CSW
Selenium	ND	0.0100	0.0010	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:44	6120446	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:44	6120446	CSW
Lithium	0.0054	0.0500	0.0021	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/16/16 23:44	6120446	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	12/15/16 10:35	12/15/16 15:47	6120427	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

December 30, 2016

Attention: Mr. Joju Abraham

Report No.: AZL0437

Project: CCR Event

Client ID: DGWC-22

Lab Number ID: AZL0437-03

Date/Time Sampled: 12/8/2016 12:16:00PM

Date/Time Received: 12/9/2016 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	464	25	10	mg/L	SM 2540 C		1	12/14/16 19:17	12/14/16 19:17	6120357	JPT
Inorganic Anions											
Chloride	26	0.25	0.01	mg/L	EPA 300.0		1	12/23/16 08:53	12/24/16 09:01	6120720	RNB
Fluoride	0.12	0.30	0.02	mg/L	EPA 300.0	J	1	12/23/16 08:53	12/24/16 09:01	6120720	RNB
Sulfate	260	100	5.1	mg/L	EPA 300.0		100	12/23/16 08:53	12/26/16 11:12	6120720	RNB
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:50	6120446	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:50	6120446	CSW
Barium	0.0408	0.0100	0.0004	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:50	6120446	CSW
Beryllium	0.0001	0.0030	0.00008	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/16/16 23:50	6120446	CSW
Boron	3.10	0.0400	0.0064	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:50	6120446	CSW
Cadmium	0.0004	0.0010	0.00007	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/16/16 23:50	6120446	CSW
Calcium	60.1	5.00	0.311	mg/L	EPA 6020B		10	12/15/16 09:25	12/23/16 13:15	6120446	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:50	6120446	CSW
Cobalt	0.0079	0.0100	0.0005	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/16/16 23:50	6120446	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:50	6120446	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:50	6120446	CSW
Selenium	ND	0.0100	0.0010	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:50	6120446	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:50	6120446	CSW
Lithium	0.0047	0.0500	0.0021	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/16/16 23:50	6120446	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	12/15/16 10:35	12/15/16 15:50	6120427	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

December 30, 2016

Attention: Mr. Joju Abraham

Report No.: AZL0437

Project: CCR Event

Client ID: DGWC-40

Lab Number ID: AZL0437-04

Date/Time Sampled: 12/8/2016 9:10:00AM

Date/Time Received: 12/9/2016 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	319	25	10	mg/L	SM 2540 C		1	12/14/16 19:17	12/14/16 19:17	6120357	JPT
Inorganic Anions											
Chloride	18	0.25	0.01	mg/L	EPA 300.0		1	12/23/16 08:53	12/24/16 09:22	6120720	RNB
Fluoride	0.35	0.30	0.02	mg/L	EPA 300.0		1	12/23/16 08:53	12/24/16 09:22	6120720	RNB
Sulfate	270	10	0.51	mg/L	EPA 300.0		10	12/23/16 08:53	12/24/16 23:40	6120720	RNB
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:55	6120446	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:55	6120446	CSW
Barium	0.0163	0.0100	0.0004	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:55	6120446	CSW
Beryllium	0.0026	0.0030	0.00008	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/16/16 23:55	6120446	CSW
Boron	0.841	0.0400	0.0064	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:55	6120446	CSW
Cadmium	0.0007	0.0010	0.00007	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/16/16 23:55	6120446	CSW
Calcium	37.9	2.50	0.155	mg/L	EPA 6020B		5	12/15/16 09:25	12/23/16 13:21	6120446	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:55	6120446	CSW
Cobalt	0.0318	0.0100	0.0005	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:55	6120446	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:55	6120446	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:55	6120446	CSW
Selenium	0.0022	0.0100	0.0010	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/16/16 23:55	6120446	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:55	6120446	CSW
Lithium	ND	0.0500	0.0021	mg/L	EPA 6020B		1	12/15/16 09:25	12/16/16 23:55	6120446	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	12/15/16 10:35	12/15/16 15:52	6120427	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

December 30, 2016

Attention: Mr. Joju Abraham

Report No.: AZL0437

Project: CCR Event

Client ID: DGWC-42

Lab Number ID: AZL0437-05

Date/Time Sampled: 12/8/2016 11:20:00AM

Date/Time Received: 12/9/2016 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	535	25	10	mg/L	SM 2540 C		1	12/14/16 19:17	12/14/16 19:17	6120357	JPT
Inorganic Anions											
Chloride	32	0.25	0.01	mg/L	EPA 300.0		1	12/23/16 08:53	12/24/16 10:35	6120720	RNB
Fluoride	0.06	0.30	0.02	mg/L	EPA 300.0	J	1	12/23/16 08:53	12/24/16 10:35	6120720	RNB
Sulfate	350	10	0.51	mg/L	EPA 300.0		10	12/23/16 08:53	12/25/16 00:00	6120720	RNB
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:01	6120446	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:01	6120446	CSW
Barium	0.0189	0.0100	0.0004	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:01	6120446	CSW
Beryllium	0.0023	0.0030	0.00008	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/17/16 00:01	6120446	CSW
Boron	0.957	0.0400	0.0064	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:01	6120446	CSW
Cadmium	0.0003	0.0010	0.00007	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/17/16 00:01	6120446	CSW
Calcium	45.8	2.50	0.155	mg/L	EPA 6020B		5	12/15/16 09:25	12/23/16 13:27	6120446	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:01	6120446	CSW
Cobalt	0.0652	0.0100	0.0005	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:01	6120446	CSW
Lead	0.0002	0.0050	0.0001	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/17/16 00:01	6120446	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:01	6120446	CSW
Selenium	ND	0.0100	0.0010	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:01	6120446	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:01	6120446	CSW
Lithium	0.0118	0.0500	0.0021	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/17/16 00:01	6120446	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	12/15/16 10:35	12/15/16 15:54	6120427	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

December 30, 2016

Attention: Mr. Joju Abraham

Report No.: AZL0437

Project: CCR Event

Client ID: DGWC-47

Lab Number ID: AZL0437-06

Date/Time Sampled: 12/8/2016 2:10:00PM

Date/Time Received: 12/9/2016 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	587	25	10	mg/L	SM 2540 C		1	12/14/16 19:17	12/14/16 19:17	6120357	JPT
Inorganic Anions											
Chloride	12	0.25	0.01	mg/L	EPA 300.0		1	12/23/16 08:53	12/24/16 10:55	6120720	RNB
Fluoride	1.1	0.30	0.02	mg/L	EPA 300.0		1	12/23/16 08:53	12/24/16 10:55	6120720	RNB
Sulfate	400	10	0.51	mg/L	EPA 300.0		10	12/23/16 08:53	12/25/16 00:21	6120720	RNB
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:07	6120446	CSW
Arsenic	0.0032	0.0050	0.0016	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/17/16 00:07	6120446	CSW
Barium	0.0247	0.0100	0.0004	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:07	6120446	CSW
Beryllium	0.0116	0.0030	0.00008	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:07	6120446	CSW
Boron	0.352	0.0400	0.0064	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:07	6120446	CSW
Cadmium	0.0002	0.0010	0.00007	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/17/16 00:07	6120446	CSW
Calcium	71.1	5.00	0.311	mg/L	EPA 6020B		10	12/15/16 09:25	12/23/16 13:33	6120446	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:07	6120446	CSW
Cobalt	0.381	0.0100	0.0005	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:07	6120446	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:07	6120446	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:07	6120446	CSW
Selenium	0.0170	0.0100	0.0010	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:07	6120446	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:07	6120446	CSW
Lithium	0.0667	0.0500	0.0021	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:07	6120446	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	12/15/16 10:35	12/15/16 15:57	6120427	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

December 30, 2016

Attention: Mr. Joju Abraham

Report No.: AZL0437

Project: CCR Event

Client ID: DGWC-48

Lab Number ID: AZL0437-07

Date/Time Sampled: 12/8/2016 2:07:00PM

Date/Time Received: 12/9/2016 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	777	25	10	mg/L	SM 2540 C		1	12/14/16 19:17	12/14/16 19:17	6120357	JPT
Inorganic Anions											
Chloride	17	0.25	0.01	mg/L	EPA 300.0		1	12/23/16 08:53	12/24/16 11:16	6120720	RNB
Fluoride	1.6	0.30	0.02	mg/L	EPA 300.0		1	12/23/16 08:53	12/24/16 11:16	6120720	RNB
Sulfate	540	20	1.0	mg/L	EPA 300.0		20	12/23/16 08:53	12/26/16 11:32	6120720	RNB
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:13	6120446	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:13	6120446	CSW
Barium	0.0155	0.0100	0.0004	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:13	6120446	CSW
Beryllium	0.0086	0.0030	0.00008	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:13	6120446	CSW
Boron	0.919	0.0400	0.0064	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:13	6120446	CSW
Cadmium	0.0042	0.0010	0.00007	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:13	6120446	CSW
Calcium	105	25.0	1.55	mg/L	EPA 6020B		50	12/15/16 09:25	12/23/16 14:15	6120446	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:13	6120446	CSW
Cobalt	0.575	0.0100	0.0005	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:13	6120446	CSW
Lead	0.0019	0.0050	0.0001	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/17/16 00:13	6120446	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:13	6120446	CSW
Selenium	0.0084	0.0100	0.0010	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/17/16 00:13	6120446	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:13	6120446	CSW
Lithium	0.122	0.0500	0.0021	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:13	6120446	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	12/15/16 10:35	12/15/16 15:59	6120427	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

December 30, 2016

Attention: Mr. Joju Abraham

Report No.: AZL0437

Project: CCR Event

Client ID: FD-3

Lab Number ID: AZL0437-08

Date/Time Sampled: 12/8/2016 12:00:00AM

Date/Time Received: 12/9/2016 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	426	25	10	mg/L	SM 2540 C		1	12/14/16 19:17	12/14/16 19:17	6120357	JPT
Inorganic Anions											
Chloride	24	0.25	0.01	mg/L	EPA 300.0		1	12/23/16 08:53	12/24/16 11:57	6120720	RNB
Fluoride	0.14	0.30	0.02	mg/L	EPA 300.0	J	1	12/23/16 08:53	12/24/16 11:57	6120720	RNB
Sulfate	260	10	0.51	mg/L	EPA 300.0		10	12/23/16 08:53	12/25/16 01:02	6120720	RNB
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:18	6120446	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:18	6120446	CSW
Barium	0.0258	0.0100	0.0004	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:18	6120446	CSW
Beryllium	0.0001	0.0030	0.00008	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/17/16 00:18	6120446	CSW
Boron	3.43	0.0400	0.0064	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:18	6120446	CSW
Cadmium	0.0005	0.0010	0.00007	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/17/16 00:18	6120446	CSW
Calcium	70.5	5.00	0.311	mg/L	EPA 6020B		10	12/15/16 09:25	12/23/16 13:56	6120446	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:18	6120446	CSW
Cobalt	0.0092	0.0100	0.0005	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/17/16 00:18	6120446	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:18	6120446	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:18	6120446	CSW
Selenium	ND	0.0100	0.0010	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:18	6120446	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:18	6120446	CSW
Lithium	0.0053	0.0500	0.0021	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/17/16 00:18	6120446	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	12/15/16 10:35	12/15/16 16:06	6120427	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

December 30, 2016

Attention: Mr. Joju Abraham

Report No.: AZL0437

Project: CCR Event

Client ID: FB-3

Lab Number ID: AZL0437-09

Date/Time Sampled: 12/8/2016 1:08:00PM

Date/Time Received: 12/9/2016 11:45:00AM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C		1	12/14/16 19:17	12/14/16 19:17	6120357	JPT
Inorganic Anions											
Chloride	0.04	0.25	0.01	mg/L	EPA 300.0	J	1	12/23/16 08:53	12/24/16 12:18	6120720	RNB
Fluoride	ND	0.30	0.02	mg/L	EPA 300.0		1	12/23/16 08:53	12/24/16 12:18	6120720	RNB
Sulfate	0.31	1.0	0.05	mg/L	EPA 300.0	J	1	12/23/16 08:53	12/24/16 12:18	6120720	RNB
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:24	6120446	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:24	6120446	CSW
Barium	0.0007	0.0100	0.0004	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/17/16 00:24	6120446	CSW
Beryllium	ND	0.0030	0.00008	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:24	6120446	CSW
Boron	0.0172	0.0400	0.0064	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/17/16 00:24	6120446	CSW
Cadmium	ND	0.0010	0.00007	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:24	6120446	CSW
Calcium	ND	0.500	0.0311	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:24	6120446	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:24	6120446	CSW
Cobalt	ND	0.0100	0.0005	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:24	6120446	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:24	6120446	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:24	6120446	CSW
Selenium	ND	0.0100	0.0010	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:24	6120446	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:24	6120446	CSW
Lithium	ND	0.0500	0.0021	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:24	6120446	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	12/15/16 10:35	12/15/16 16:09	6120427	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

December 30, 2016

Attention: Mr. Joju Abraham

Report No.: AZL0437

Project: CCR Event

Client ID: EB-3

Lab Number ID: AZL0437-10

Date/Time Sampled: 12/8/2016 1:03:00PM

Date/Time Received: 12/9/2016 11:45:00AM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C		1	12/14/16 19:17	12/14/16 19:17	6120357	JPT
Inorganic Anions											
Chloride	0.04	0.25	0.01	mg/L	EPA 300.0	J	1	12/28/16 13:22	12/28/16 14:47	6120802	RNB
Fluoride	0.05	0.30	0.02	mg/L	EPA 300.0	J	1	12/28/16 13:22	12/28/16 14:47	6120802	RNB
Sulfate	ND	1.0	0.05	mg/L	EPA 300.0		1	12/28/16 13:22	12/28/16 14:47	6120802	RNB
Metals, Total											
Antimony	ND	0.0030	0.0008	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:30	6120446	CSW
Arsenic	ND	0.0050	0.0016	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:30	6120446	CSW
Barium	0.0007	0.0100	0.0004	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/17/16 00:30	6120446	CSW
Beryllium	ND	0.0030	0.00008	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:30	6120446	CSW
Boron	0.0085	0.0400	0.0064	mg/L	EPA 6020B	J	1	12/15/16 09:25	12/17/16 00:30	6120446	CSW
Cadmium	ND	0.0010	0.00007	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:30	6120446	CSW
Calcium	ND	0.500	0.0311	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:30	6120446	CSW
Chromium	ND	0.0100	0.0009	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:30	6120446	CSW
Cobalt	ND	0.0100	0.0005	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:30	6120446	CSW
Lead	ND	0.0050	0.0001	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:30	6120446	CSW
Molybdenum	ND	0.0100	0.0017	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:30	6120446	CSW
Selenium	ND	0.0100	0.0010	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:30	6120446	CSW
Thallium	ND	0.0010	0.0002	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:30	6120446	CSW
Lithium	ND	0.0500	0.0021	mg/L	EPA 6020B		1	12/15/16 09:25	12/17/16 00:30	6120446	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	12/15/16 10:35	12/15/16 16:11	6120427	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

December 30, 2016

Report No.: AZL0437

General Chemistry - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 6120357 - SM 2540 C											
Blank (6120357-BLK1)						Prepared & Analyzed: 12/14/16					
Total Dissolved Solids	ND	25	10	mg/L							
LCS (6120357-BS1)						Prepared & Analyzed: 12/14/16					
Total Dissolved Solids	389	25	10	mg/L	400.00		97	84-108			
Duplicate (6120357-DUP1)						Source: AZL0436-05 Prepared & Analyzed: 12/14/16					
Total Dissolved Solids	237	25	10	mg/L		227			4	10	
Duplicate (6120357-DUP2)						Source: AZL0436-07 Prepared & Analyzed: 12/14/16					
Total Dissolved Solids	ND	25	10	mg/L		ND				10	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

December 30, 2016

Report No.: AZL0437

Inorganic Anions - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 6120720 - EPA 300.0											
Blank (6120720-BLK1)						Prepared: 12/23/16 Analyzed: 12/24/16					
Chloride	ND	0.25	0.01	mg/L							
Fluoride	ND	0.30	0.02	mg/L							
Sulfate	ND	1.0	0.05	mg/L							
LCS (6120720-BS1)						Prepared: 12/23/16 Analyzed: 12/24/16					
Chloride	10.1	0.25	0.01	mg/L	10.010		101	90-110			
Fluoride	10.6	0.30	0.02	mg/L	10.020		106	90-110			
Sulfate	10.1	1.0	0.05	mg/L	10.020		101	90-110			
Matrix Spike (6120720-MS1)						Source: AZL0436-02 Prepared: 12/23/16 Analyzed: 12/24/16					
Chloride	11.0	0.25	0.01	mg/L	10.010	1.96	91	90-110			
Fluoride	9.72	0.30	0.02	mg/L	10.020	0.13	96	90-110			
Sulfate	94.9	1.0	0.05	mg/L	10.020	95.1	NR	90-110			QM-02
Matrix Spike (6120720-MS2)						Source: AZL0437-07 Prepared: 12/23/16 Analyzed: 12/24/16					
Chloride	25.4	0.25	0.01	mg/L	10.010	17.2	83	90-110			QM-05
Fluoride	14.7	0.30	0.02	mg/L	10.020	1.56	131	90-110			QM-05
Sulfate	301	1.0	0.05	mg/L	10.020	315	NR	90-110			QM-02
Matrix Spike Dup (6120720-MSD1)						Source: AZL0436-02 Prepared: 12/23/16 Analyzed: 12/24/16					
Chloride	11.8	0.25	0.01	mg/L	10.010	1.96	99	90-110	7	15	
Fluoride	10.5	0.30	0.02	mg/L	10.020	0.13	104	90-110	8	15	
Sulfate	94.8	1.0	0.05	mg/L	10.020	95.1	NR	90-110	0.03	15	QM-02
Batch 6120802 - EPA 300.0											
Blank (6120802-BLK1)						Prepared & Analyzed: 12/28/16					
Chloride	ND	0.25	0.01	mg/L							
Fluoride	ND	0.30	0.02	mg/L							
Sulfate	ND	1.0	0.05	mg/L							



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

December 30, 2016

Report No.: AZL0437

Inorganic Anions - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 6120802 - EPA 300.0											
LCS (6120802-BS1)						Prepared & Analyzed: 12/28/16					
Chloride	9.93	0.25	0.01	mg/L	10.010		99	90-110			
Fluoride	10.6	0.30	0.02	mg/L	10.020		106	90-110			
Sulfate	10.0	1.0	0.05	mg/L	10.020		100	90-110			
Matrix Spike (6120802-MS1)						Source: AZL0437-10 Prepared & Analyzed: 12/28/16					
Chloride	7.81	0.25	0.01	mg/L	10.010	0.04	78	90-110			QM-05
Fluoride	8.48	0.30	0.02	mg/L	10.020	0.05	84	90-110			QM-05
Sulfate	8.63	1.0	0.05	mg/L	10.020	ND	86	90-110			QM-05
Matrix Spike Dup (6120802-MSD1)						Source: AZL0437-10 Prepared & Analyzed: 12/28/16					
Chloride	9.07	0.25	0.01	mg/L	10.010	0.04	90	90-110	15	15	
Fluoride	9.74	0.30	0.02	mg/L	10.020	0.05	97	90-110	14	15	
Sulfate	9.72	1.0	0.05	mg/L	10.020	ND	97	90-110	12	15	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

December 30, 2016

Report No.: AZL0437

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 6120427 - EPA 7470A											
Blank (6120427-BLK1) Prepared & Analyzed: 12/15/16											
Mercury	ND	0.00050	0.000041	mg/L							
LCS (6120427-BS1) Prepared & Analyzed: 12/15/16											
Mercury	0.00235	0.00050	0.000041	mg/L	2.5000E-3		94	80-120			
Matrix Spike (6120427-MS1) Source: AZL0436-01 Prepared & Analyzed: 12/15/16											
Mercury	0.00238	0.00050	0.000041	mg/L	2.5000E-3	ND	95	75-125			
Matrix Spike Dup (6120427-MSD1) Source: AZL0436-01 Prepared & Analyzed: 12/15/16											
Mercury	0.00238	0.00050	0.000041	mg/L	2.5000E-3	ND	95	75-125	0.09	20	
Post Spike (6120427-PS1) Source: AZL0436-01 Prepared & Analyzed: 12/15/16											
Mercury	1.72			ug/L	1.6667	-0.00768	103	80-120			
Batch 6120446 - EPA 3005A											
Blank (6120446-BLK1) Prepared: 12/15/16 Analyzed: 12/16/16											
Antimony	ND	0.0030	0.0008	mg/L							
Arsenic	ND	0.0050	0.0016	mg/L							
Barium	ND	0.0100	0.0004	mg/L							
Beryllium	ND	0.0030	0.00008	mg/L							
Boron	ND	0.0400	0.0064	mg/L							
Cadmium	ND	0.0010	0.00007	mg/L							
Calcium	ND	0.500	0.0311	mg/L							
Chromium	ND	0.0100	0.0009	mg/L							
Cobalt	ND	0.0100	0.0005	mg/L							
Copper	ND	0.0250	0.0005	mg/L							
Lead	ND	0.0050	0.0001	mg/L							
Molybdenum	ND	0.0100	0.0017	mg/L							
Nickel	ND	0.0100	0.0006	mg/L							
Selenium	ND	0.0100	0.0010	mg/L							
Silver	ND	0.0100	0.0005	mg/L							
Thallium	ND	0.0010	0.0002	mg/L							
Vanadium	ND	0.0100	0.0071	mg/L							
Zinc	ND	0.0100	0.0021	mg/L							
Lithium	ND	0.0500	0.0021	mg/L							



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

December 30, 2016

Report No.: AZL0437

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	----	-----	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 6120446 - EPA 3005A

LCS (6120446-BS1)

Prepared: 12/15/16 Analyzed: 12/16/16

Antimony	0.113	0.0030	0.0008	mg/L	0.10000		113	80-120			
Arsenic	0.101	0.0050	0.0016	mg/L	0.10000		101	80-120			
Barium	0.101	0.0100	0.0004	mg/L	0.10000		101	80-120			
Beryllium	0.0946	0.0030	0.00008	mg/L	0.10000		95	80-120			
Boron	0.952	0.0400	0.0064	mg/L	1.0000		95	80-120			
Cadmium	0.103	0.0010	0.00007	mg/L	0.10000		103	80-120			
Calcium	1.02	0.500	0.0311	mg/L	1.0000		102	80-120			
Chromium	0.104	0.0100	0.0009	mg/L	0.10000		104	80-120			
Cobalt	0.105	0.0100	0.0005	mg/L	0.10000		105	80-120			
Copper	0.105	0.0250	0.0005	mg/L	0.10000		105	80-120			
Lead	0.101	0.0050	0.0001	mg/L	0.10000		101	80-120			
Molybdenum	0.105	0.0100	0.0017	mg/L	0.10000		105	80-120			
Nickel	0.103	0.0100	0.0006	mg/L	0.10000		103	80-120			
Selenium	0.0982	0.0100	0.0010	mg/L	0.10000		98	80-120			
Silver	0.102	0.0100	0.0005	mg/L	0.10000		102	80-120			
Thallium	0.101	0.0010	0.0002	mg/L	0.10000		101	80-120			
Vanadium	0.106	0.0100	0.0071	mg/L	0.10000		106	80-120			
Zinc	0.105	0.0100	0.0021	mg/L	0.10000		105	80-120			
Lithium	0.0940	0.0500	0.0021	mg/L	0.10000		94	80-120			

Matrix Spike (6120446-MS1)

Source: AZL0436-05

Prepared: 12/15/16 Analyzed: 12/16/16

Antimony	0.110	0.0030	0.0008	mg/L	0.10000	0.0012	109	75-125			
Arsenic	0.103	0.0050	0.0016	mg/L	0.10000	ND	103	75-125			
Barium	0.154	0.0100	0.0004	mg/L	0.10000	0.0648	89	75-125			
Beryllium	0.0886	0.0030	0.00008	mg/L	0.10000	ND	89	75-125			
Boron	0.913	0.0400	0.0064	mg/L	1.0000	0.0178	90	75-125			
Cadmium	0.101	0.0010	0.00007	mg/L	0.10000	ND	101	75-125			
Calcium	33.2	2.50	0.155	mg/L	1.0000	33.4	NR	75-125			QM-02
Chromium	0.104	0.0100	0.0009	mg/L	0.10000	ND	104	75-125			
Cobalt	0.103	0.0100	0.0005	mg/L	0.10000	ND	103	75-125			
Copper	0.102	0.0250	0.0005	mg/L	0.10000	ND	102	75-125			
Lead	0.0996	0.0050	0.0001	mg/L	0.10000	ND	100	75-125			
Molybdenum	0.105	0.0100	0.0017	mg/L	0.10000	ND	105	75-125			
Nickel	0.103	0.0100	0.0006	mg/L	0.10000	0.0023	101	75-125			
Selenium	0.0993	0.0100	0.0010	mg/L	0.10000	ND	99	75-125			
Silver	0.0987	0.0100	0.0005	mg/L	0.10000	ND	99	75-125			
Thallium	0.0995	0.0010	0.0002	mg/L	0.10000	ND	99	75-125			
Vanadium	0.104	0.0100	0.0071	mg/L	0.10000	ND	104	75-125			
Zinc	0.107	0.0100	0.0021	mg/L	0.10000	ND	107	75-125			
Lithium	0.102	0.0500	0.0021	mg/L	0.10000	0.0152	86	75-125			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

December 30, 2016

Report No.: AZL0437

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 6120446 - EPA 3005A											
Matrix Spike Dup (6120446-MSD1)			Source: AZL0436-05			Prepared: 12/15/16 Analyzed: 12/16/16					
Antimony	0.113	0.0030	0.0008	mg/L	0.10000	0.0012	112	75-125	2	20	
Arsenic	0.104	0.0050	0.0016	mg/L	0.10000	ND	104	75-125	1	20	
Barium	0.157	0.0100	0.0004	mg/L	0.10000	0.0648	93	75-125	2	20	
Beryllium	0.0926	0.0030	0.00008	mg/L	0.10000	ND	93	75-125	4	20	
Boron	0.916	0.0400	0.0064	mg/L	1.0000	0.0178	90	75-125	0.3	20	
Cadmium	0.103	0.0010	0.00007	mg/L	0.10000	ND	103	75-125	2	20	
Calcium	34.4	2.50	0.155	mg/L	1.0000	33.4	96	75-125	4	20	
Chromium	0.105	0.0100	0.0009	mg/L	0.10000	ND	105	75-125	2	20	
Cobalt	0.104	0.0100	0.0005	mg/L	0.10000	ND	104	75-125	0.8	20	
Copper	0.104	0.0250	0.0005	mg/L	0.10000	ND	104	75-125	1	20	
Lead	0.0982	0.0050	0.0001	mg/L	0.10000	ND	98	75-125	1	20	
Molybdenum	0.105	0.0100	0.0017	mg/L	0.10000	ND	105	75-125	0.05	20	
Nickel	0.106	0.0100	0.0006	mg/L	0.10000	0.0023	104	75-125	3	20	
Selenium	0.101	0.0100	0.0010	mg/L	0.10000	ND	101	75-125	2	20	
Silver	0.0994	0.0100	0.0005	mg/L	0.10000	ND	99	75-125	0.7	20	
Thallium	0.0998	0.0010	0.0002	mg/L	0.10000	ND	100	75-125	0.3	20	
Vanadium	0.108	0.0100	0.0071	mg/L	0.10000	ND	108	75-125	4	20	
Zinc	0.110	0.0100	0.0021	mg/L	0.10000	ND	110	75-125	2	20	
Lithium	0.105	0.0500	0.0021	mg/L	0.10000	0.0152	90	75-125	3	20	
Post Spike (6120446-PS1)											
Source: AZL0436-05			Prepared: 12/15/16 Analyzed: 12/16/16								
Antimony	105			ug/L	100.00	1.16	104	80-120			
Arsenic	105			ug/L	100.00	-0.392	105	80-120			
Barium	158			ug/L	100.00	64.8	94	80-120			
Beryllium	92.0			ug/L	100.00	0.0162	92	80-120			
Boron	932			ug/L	1000.0	17.8	91	80-120			
Cadmium	103			ug/L	100.00	0.0069	103	80-120			
Calcium	33200			ug/L	1000.0	33400	NR	80-120			QM-02
Chromium	103			ug/L	100.00	0.0236	103	80-120			
Cobalt	101			ug/L	100.00	0.446	101	80-120			
Copper	99.3			ug/L	100.00	0.0839	99	80-120			
Lead	96.2			ug/L	100.00	0.0213	96	80-120			
Molybdenum	107			ug/L	100.00	0.255	106	80-120			
Nickel	102			ug/L	100.00	2.31	100	80-120			
Selenium	104			ug/L	100.00	-0.0806	104	80-120			
Silver	99.8			ug/L	100.00	0.0111	100	80-120			
Thallium	96.9			ug/L	100.00	0.106	97	80-120			
Vanadium	106			ug/L	100.00	-1.30	106	80-120			
Zinc	105			ug/L	100.00	1.83	104	80-120			
Lithium	102			ug/L	100.00	15.2	87	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

December 30, 2016

Legend

Definition of Laboratory Terms

- ND** - Not Detected at levels equal to or greater than the MDL
- BRL** - Not Detected at levels equal to or greater than the RL
- RL** - Reporting Limit **MDL** - Method Detection Limit
- SOP** - Method run per Pace Standard Operating Procedure
- CFU** - Colony Forming Units
- DF** - Dilution Factor **TIC** - Tentatively Identified Compound

Sample Information

N-Nitrosodiphenylamine breaks down to diphenylamine in the GCMS; both analytes are reported as N-Nitrosodiphenylamine. Pace is not NELAC certified for N-Nitrosodiphenylamine.

Phthalic acid and phthalic anhydride are reported as dimethyl phthalate

Maleic acid and maleic anhydride are reported as dimethyl malate

1,2-Diphenylhydrazine breaks down to azobenzene in the GCMS; both analytes are reported as azobenzene

Definition of Qualifiers

- QM-05** The spike recovery was outside acceptance limits for the MS and/or MSD and/or PDS due to suspected matrix interference. Sample results for the QC batch were accepted based on acceptable LCS recoveries.
- QM-02** The spike recovery is outside acceptance limits due to insignificant spike amount as compared to sample concentration.
- J** Estimated value less than Reporting Limit (RL) but greater than Method Detection Limit(MDL) (CLP J-Flag).

Note: Unless otherwise noted, all results are reported on an as received basis.



Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CHAIN OF CUSTODY RECORD

PAGE: 1 OF 1

CLIENT NAME: Georgia Power CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185 Atlanta, GA 30308 404-506-7239		REPORT TO: Dawn Priel (Dawn_Priel@golder.com) REQUESTED COMPLETION DATE: PROJECT NAME/STATE: Plant McDonough AP		CC: Kjurinko@golder.com Mania Padilla, Heath McCorkle PO #:	
PROJECT #: 1688496		Phase II CCR			
Collection DATE	Collection TIME	MATRIX CODE*	C O M P	SAMPLE IDENTIFICATION	
12/18/16	09:35	GW	X	D9WC-17	
12/18/16	11:00			D9WC-21	
12/18/16	11:16			D9WC-22	
12/18/16	11:20			D9WC-40	
12/18/16	14:10			D9WC-42	
12/18/16	14:07			D9WC-47	
12/18/16				ED-3	
12/18/16	13:08	W		PB-3	
12/18/16	13:03	W		PB-3	

CLIENT NAME: Georgia Power CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185 Atlanta, GA 30308 404-506-7239		REPORT TO: Dawn Priel (Dawn_Priel@golder.com) REQUESTED COMPLETION DATE: PROJECT NAME/STATE: Plant McDonough AP		CC: Kjurinko@golder.com Mania Padilla, Heath McCorkle PO #:	
PROJECT #: 1688496		Phase II CCR			
Collection DATE	Collection TIME	MATRIX CODE*	C O M P	SAMPLE IDENTIFICATION	
12/18/16	09:35	GW	X	D9WC-17	
12/18/16	11:00			D9WC-21	
12/18/16	11:16			D9WC-22	
12/18/16	11:20			D9WC-40	
12/18/16	14:10			D9WC-42	
12/18/16	14:07			D9WC-47	
12/18/16				ED-3	
12/18/16	13:08	W		PB-3	
12/18/16	13:03	W		PB-3	

SAMPLED BY AND TITLE: Kristen Jurinko Field Lead		DATE/TIME: 12/18/16 - SEE ABOVE	
RECEIVED BY: Dawn Priel		DATE/TIME: 12/19/16: 11:18	
TESTED BY: Dawn Priel		DATE/TIME: 12/19/16: 11:18	
Temp: 16 Min: 16 Max:		Temperature: 16 Min: 16 Max:	

RELINQUISHED BY: Dawn Priel		DATE/TIME: 12/19/16 11:18	
RELINQUISHED BY: Dawn Priel		DATE/TIME: 12/19/16 11:18	
SAMPLE SHIPPED VIA: UPS		CLIENT: COURIER	
Custody Seal: Intact		Other FS: FS	

CONTAINER TYPE: P - PLASTIC A - AMBER GLASS G - CLEAR GLASS V - VOA VIAL S - STERILE O - OTHER	PRESERVATION: 1 - HCl, ≤6°C 2 - H ₂ SO ₄ , ≤6°C 3 - HNO ₃ 4 - NaOH, ≤6°C 5 - NaOH/ZnAc, ≤6°C 6 - Na ₂ S ₂ O ₃ , ≤6°C 7 - ≤6°C not frozen
CONTAINER TYPE: P - PLASTIC A - AMBER GLASS G - CLEAR GLASS V - VOA VIAL S - STERILE O - OTHER	PRESERVATION: 1 - HCl, ≤6°C 2 - H ₂ SO ₄ , ≤6°C 3 - HNO ₃ 4 - NaOH, ≤6°C 5 - NaOH/ZnAc, ≤6°C 6 - Na ₂ S ₂ O ₃ , ≤6°C 7 - ≤6°C not frozen

MATRIX CODES: DW - DRINKING WATER WW - WASTEWATER GW - GROUNDWATER SW - SURFACE WATER ST - STORM WATER W - WATER	S - SOIL SL - SLUDGE SD - SOLID A - AIR L - LIQUID P - PRODUCT
REMARKS/ADDITIONAL INFORMATION	

LAB #: A2260437	FOR LAB USE ONLY
Entered into LIMS: [Signature]	Tracking #:



PACE ANALYTICAL SERVICES, INC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

LOG-IN CHECKLIST

Printed: 12/12/2016 11:21:58AM

Attn: Mr. Joju Abraham

Client: Georgia Power

Project: CCR Event

Date Received: 12/09/16 11:45

Work Order: AZL0437

Logged In By: Mohammad M. Rahman

OBSERVATIONS

#Samples: 10

#Containers: 31

Minimum Temp(C): 1.0

Maximum Temp(C): 1.0

Custody Seal(s) Used: No

CHECKLIST ITEMS

COC included with Samples	YES
Sample Container(s) Intact	YES
Chain of Custody Complete	YES
Sample Container(s) Match COC	YES
Custody seal Intact	NO
Temperature in Compliance	YES
Sufficient Sample Volume for Analysis	YES
Zero Headspace Maintained for VOA Analyses	YES
Samples labeled preserved (If Applicable)	YES
Samples received within Allowable Hold Times	YES
Samples Received on Ice	YES
Preservation Confirmed	YES

Comments:

January 23, 2017

Maria Padilla
GA Power
2480 Maner Rd
Atlanta, GA 30339

RE: Project: Plant McDonough
Pace Project No.: 30205165

Dear Maria Padilla:

Enclosed are the analytical results for sample(s) received by the laboratory on December 12, 2016. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Jacquelyn Collins
jacquelyn.collins@pacelabs.com
Project Manager

Enclosures



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: Plant McDonough

Pace Project No.: 30205165

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601

L-A-B DOD-ELAP Accreditation #: L2417

Alabama Certification #: 41590

Arizona Certification #: AZ0734

Arkansas Certification

California Certification #: 04222CA

Colorado Certification

Connecticut Certification #: PH-0694

Delaware Certification

Florida/TNI Certification #: E87683

Georgia Certification #: C040

Guam Certification

Hawaii Certification

Idaho Certification

Illinois Certification

Indiana Certification

Iowa Certification #: 391

Kansas/TNI Certification #: E-10358

Kentucky Certification #: 90133

Louisiana DHH/TNI Certification #: LA140008

Louisiana DEQ/TNI Certification #: 4086

Maine Certification #: PA00091

Maryland Certification #: 308

Massachusetts Certification #: M-PA1457

Michigan/PADEP Certification

Missouri Certification #: 235

Montana Certification #: Cert 0082

Nebraska Certification #: NE-05-29-14

Nevada Certification #: PA014572015-1

New Hampshire/TNI Certification #: 2976

New Jersey/TNI Certification #: PA 051

New Mexico Certification #: PA01457

New York/TNI Certification #: 10888

North Carolina Certification #: 42706

North Dakota Certification #: R-190

Oregon/TNI Certification #: PA200002

Pennsylvania/TNI Certification #: 65-00282

Puerto Rico Certification #: PA01457

Rhode Island Certification #: 65-00282

South Dakota Certification

Tennessee Certification #: TN2867

Texas/TNI Certification #: T104704188-14-8

Utah/TNI Certification #: PA014572015-5

USDA Soil Permit #: P330-14-00213

Vermont Dept. of Health: ID# VT-0282

Virgin Island/PADEP Certification

Virginia/VELAP Certification #: 460198

Washington Certification #: C868

West Virginia DEP Certification #: 143

West Virginia DHHR Certification #: 9964C

Wisconsin Certification

Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: Plant McDonough

Pace Project No.: 30205165

Lab ID	Sample ID	Matrix	Date Collected	Date Received
30205165001	DGWC-17	Water	12/08/16 09:35	12/12/16 09:20
30205165002	DGWC-21	Water	12/08/16 11:00	12/12/16 09:20
30205165003	DGWC-22	Water	12/08/16 12:16	12/12/16 09:20
30205165004	DGWC-40	Water	12/08/16 09:10	12/12/16 09:20
30205165005	DGWC-42	Water	12/08/16 11:20	12/12/16 09:20
30205165006	DGWC-47	Water	12/08/16 14:10	12/12/16 09:20
30205165007	DGWC-48	Water	12/08/16 14:07	12/12/16 09:20
30205165008	FD-3	Water	12/08/16 00:00	12/12/16 09:20
30205165009	FB-3	Water	12/08/16 13:08	12/12/16 09:20
30205165010	EB-3	Water	12/08/16 13:03	12/12/16 09:20

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough
Pace Project No.: 30205165

Lab ID	Sample ID	Method	Analysts	Analytes Reported
30205165001	DGWC-17	EPA 9315	LAL	1
		EPA 9320	JAL	1
		Total Radium Calculation	RMK	1
30205165002	DGWC-21	EPA 9315	LAL	1
		EPA 9320	JAL	1
		Total Radium Calculation	RMK	1
30205165003	DGWC-22	EPA 9315	LAL	1
		EPA 9320	JAL	1
		Total Radium Calculation	RMK	1
30205165004	DGWC-40	EPA 9315	LAL	1
		EPA 9320	JAL	1
		Total Radium Calculation	RMK	1
30205165005	DGWC-42	EPA 9315	LAL	1
		EPA 9320	JAL	1
		Total Radium Calculation	RMK	1
30205165006	DGWC-47	EPA 9315	LAL	1
		EPA 9320	JAL	1
		Total Radium Calculation	RMK	1
30205165007	DGWC-48	EPA 9315	LAL	1
		EPA 9320	JAL	1
		Total Radium Calculation	RMK	1
30205165008	FD-3	EPA 9315	LAL	1
		EPA 9320	JAL	1
		Total Radium Calculation	RMK	1
30205165009	FB-3	EPA 9315	LAL	1
		EPA 9320	JAL	1
		Total Radium Calculation	RMK	1
30205165010	EB-3	EPA 9315	LAL	1
		EPA 9320	JAL	1
		Total Radium Calculation	RMK	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough

Pace Project No.: 30205165

Sample: DGWC-17		Lab ID: 30205165001	Collected: 12/08/16 09:35	Received: 12/12/16 09:20	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.121 ± 0.107 (0.189) C:93% T:NA	pCi/L	01/16/17 08:08	13982-63-3		
Radium-228	EPA 9320	1.53 ± 0.551 (0.780) C:70% T:83%	pCi/L	01/22/17 12:52	15262-20-1		
Total Radium	Total Radium Calculation	1.65 ± 0.658 (0.969)	pCi/L	01/23/17 12:09	7440-14-4		

Sample: DGWC-21		Lab ID: 30205165002	Collected: 12/08/16 11:00	Received: 12/12/16 09:20	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.161 ± 0.126 (0.221) C:93% T:NA	pCi/L	01/16/17 08:08	13982-63-3		
Radium-228	EPA 9320	0.864 ± 0.555 (1.07) C:64% T:85%	pCi/L	01/22/17 12:52	15262-20-1		
Total Radium	Total Radium Calculation	1.03 ± 0.681 (1.29)	pCi/L	01/23/17 12:09	7440-14-4		

Sample: DGWC-22		Lab ID: 30205165003	Collected: 12/08/16 12:16	Received: 12/12/16 09:20	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.0754 ± 0.116 (0.257) C:96% T:NA	pCi/L	01/16/17 08:08	13982-63-3		
Radium-228	EPA 9320	0.430 ± 0.377 (0.760) C:68% T:92%	pCi/L	01/22/17 12:52	15262-20-1		
Total Radium	Total Radium Calculation	0.505 ± 0.493 (1.02)	pCi/L	01/23/17 12:09	7440-14-4		

Sample: DGWC-40		Lab ID: 30205165004	Collected: 12/08/16 09:10	Received: 12/12/16 09:20	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.0616 ± 0.128 (0.297) C:96% T:NA	pCi/L	01/16/17 08:08	13982-63-3		
Radium-228	EPA 9320	2.50 ± 0.813 (1.10) C:60% T:78%	pCi/L	01/22/17 12:52	15262-20-1		
Total Radium	Total Radium Calculation	2.56 ± 0.941 (1.40)	pCi/L	01/23/17 12:09	7440-14-4		

Sample: DGWC-42		Lab ID: 30205165005	Collected: 12/08/16 11:20	Received: 12/12/16 09:20	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.177 ± 0.111 (0.138) C:95% T:NA	pCi/L	01/16/17 08:46	13982-63-3		
Radium-228	EPA 9320	0.778 ± 0.436 (0.792) C:69% T:90%	pCi/L	01/22/17 12:52	15262-20-1		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough
Pace Project No.: 30205165

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-42 Lab ID: 30205165005 Collected: 12/08/16 11:20 Received: 12/12/16 09:20 Matrix: Water PWS: Site ID: Sample Type:						
Total Radium	Total Radium Calculation	0.955 ± 0.547 (0.930)	pCi/L	01/23/17 12:09	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-47 Lab ID: 30205165006 Collected: 12/08/16 14:10 Received: 12/12/16 09:20 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	0.569 ± 0.204 (0.170) C:96% T:NA	pCi/L	01/16/17 08:46	13982-63-3	
Radium-228	EPA 9320	2.31 ± 0.685 (0.832) C:69% T:85%	pCi/L	01/22/17 12:52	15262-20-1	
Total Radium	Total Radium Calculation	2.88 ± 0.889 (1.00)	pCi/L	01/23/17 12:09	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-48 Lab ID: 30205165007 Collected: 12/08/16 14:07 Received: 12/12/16 09:20 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	0.435 ± 0.180 (0.188) C:98% T:NA	pCi/L	01/16/17 08:46	13982-63-3	
Radium-228	EPA 9320	2.43 ± 0.722 (0.863) C:65% T:84%	pCi/L	01/22/17 12:52	15262-20-1	
Total Radium	Total Radium Calculation	2.87 ± 0.902 (1.05)	pCi/L	01/23/17 12:09	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: FD-3 Lab ID: 30205165008 Collected: 12/08/16 00:00 Received: 12/12/16 09:20 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	0.157 ± 0.112 (0.168) C:97% T:NA	pCi/L	01/16/17 08:46	13982-63-3	
Radium-228	EPA 9320	1.51 ± 0.527 (0.721) C:71% T:84%	pCi/L	01/22/17 12:53	15262-20-1	
Total Radium	Total Radium Calculation	1.67 ± 0.639 (0.889)	pCi/L	01/23/17 12:09	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: FB-3 Lab ID: 30205165009 Collected: 12/08/16 13:08 Received: 12/12/16 09:20 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	0.0394 ± 0.0698 (0.157) C:98% T:NA	pCi/L	01/16/17 08:46	13982-63-3	
Radium-228	EPA 9320	1.02 ± 0.500 (0.859) C:66% T:85%	pCi/L	01/22/17 12:53	15262-20-1	
Total Radium	Total Radium Calculation	1.06 ± 0.570 (1.02)	pCi/L	01/23/17 12:09	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough

Pace Project No.: 30205165

Sample: EB-3 **Lab ID: 30205165010** Collected: 12/08/16 13:03 Received: 12/12/16 09:20 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	-0.0299 ± 0.0793 (0.241) C:95% T:NA	pCi/L	01/16/17 08:46	13982-63-3	
Radium-228	EPA 9320	1.29 ± 0.567 (0.929) C:73% T:72%	pCi/L	01/22/17 12:53	15262-20-1	
Total Radium	Total Radium Calculation	1.29 ± 0.646 (1.17)	pCi/L	01/23/17 12:09	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough

Pace Project No.: 30205165

QC Batch:	245738	Analysis Method:	EPA 9320
QC Batch Method:	EPA 9320	Analysis Description:	9320 Radium 228
Associated Lab Samples:	30205165001, 30205165002, 30205165003, 30205165004, 30205165005, 30205165006, 30205165007, 30205165008, 30205165009, 30205165010		

METHOD BLANK:	1208849	Matrix:	Water
Associated Lab Samples:	30205165001, 30205165002, 30205165003, 30205165004, 30205165005, 30205165006, 30205165007, 30205165008, 30205165009, 30205165010		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.754 ± 0.449 (0.836) C:74% T:81%	pCi/L	01/22/17 12:51	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough

Pace Project No.: 30205165

QC Batch: 245737

Analysis Method: EPA 9315

QC Batch Method: EPA 9315

Analysis Description: 9315 Total Radium

Associated Lab Samples: 30205165001, 30205165002, 30205165003, 30205165004, 30205165005, 30205165006, 30205165007, 30205165008, 30205165009, 30205165010

METHOD BLANK: 1208848

Matrix: Water

Associated Lab Samples: 30205165001, 30205165002, 30205165003, 30205165004, 30205165005, 30205165006, 30205165007, 30205165008, 30205165009, 30205165010

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.0643 ± 0.137 (0.321) C:95% T:NA	pCi/L	01/13/17 08:27	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: Plant McDonough

Pace Project No.: 30205165

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

Chain of Custody



Workorder: AZL0437 Workorder Name: Plant McDonough Owner Received Date: Results Requested By: 1/10/2017
 Report To: Subcontract To:

Betsy McDaniel
 Pace Analytical Atlanta
 110 Technology Parkway
 Peachtree Corners, GA 30092
 Phone (770)-734-4200

Pace - Pittsburgh
 1638 Roseytown Road
 Stes. 2,3,4
 Greensburg, PA 15601
 Phone (724) 850-5600

Requested Analysis

WO#: 30205165



Item	Sample ID	Sample Type	Collect Date/Time	Lab ID	Matrix	Preserved Containers		LAB USE ONLY
						CON	NH	
1	DGWC-17	G	12/8/2016 9:35	AZL0437-01	GW	1		001
2	DGWC-21	G	12/8/2016 11:00	AZL0437-02	GW	1		002
3	DGWC-22	G	12/8/2016 12:16	AZL0437-03	GW	1		003
4	DGWC-40	G	12/8/2016 9:10	AZL0437-04	GW	1		004
5	DGWC-42	G	12/8/2016 11:20	AZL0437-05	GW	1		005
6	DGWC-47	G	12/8/2016 14:10	AZL0437-06	GW	1		006
7	DGWC-48	G	12/8/2016 14:07	AZL0437-07	GW	1		007
8	FD-3	G	12/8/2016 0:00	AZL0437-08	GW	1		008
9	FB-3	G	12/8/2016 13:08	AZL0437-09	W	1		009
10	EB-3	G	12/8/2016 13:03	AZL0437-10	W	2		010

Radium 226, 228, Total

Transfers	Released By	Date/Time	Received By	Date/Time	Comments
1			<i>Karen Liu</i>	12-12-16 09:20	
2					
3					

Cooler Temperature on Receipt N/A °C Custody Seal Y or N Received on Ice Y or N Sample Intact Y or N
 ***In order to maintain client confidentiality, location/name of the sampling site, sampler's name and signature may not be provided on this COC
 This chain of custody is considered complete as is since this information is available in the owner laboratory.

30205165



Pace Analytical Services, Inc.
110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
(770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CHAIN OF CUSTODY RECORD

PAGE: 1 OF 1

CLIENT NAME:
Georgia Power

CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER:
241 Ralph McGill Blvd SE B10185
Atlanta, GA 30308
404-506-7239

REPORT TO:
Dawn Priell (Dawn_Priell@golder.com)

REQUESTED COMPLETION DATE:

PROJECT NAME/STATE:
Plant McDonough AP

PROJECT #:
1668496

Phase II CCR

Collection DATE	Collection TIME	MATRIX CODE*	SAMPLE IDENTIFICATION			
			C O M P	G R A B		
12/16/16	0935	GW	X		D9WC-17	
12/16/16	1100				D9WC-21	
12/16/16	1116				D9WC-22	
12/16/16	0916				D9WC-40	
12/16/16	1130				D9WC-42	
12/16/16	1410				D9WC-47	
12/16/16	1407				D9WC-48	
12/16/16					D9-3	
12/16/16	1308	W			PB-3	
12/16/16		W			PB-3	

CONTAINER TYPE:	P	P	P	ANALYSIS REQUESTED	CONTAINER TYPE:	P	P	P
# of	3&7	7	3&7	Metals AP III & IV (EPA 6020 & EPA 7470) Cl, F, SO4 (EPA 300) TDS (SM2540C) Radium 226 & 228 (SW-846 9315 and 9320)				

CONTAINERS REQUESTED

CONTAINER TYPE	P	P	P
# of	3&7	7	3&7

CONTAINERS

CONTAINER TYPE	P	P	P
# of	3&7	7	3&7

CONTAINER TYPE	LAB #	ENTERED INTO LIMS	TRACKING #
P - PLASTIC			
A - AMBER GLASS			
G - CLEAR GLASS			
V - VOA VIAL			
S - STERILE			
O - OTHER			

PRESERVATION

- HCl, 56°C
- H2SO4, 56°C
- HNO3
- NaOH, 56°C
- NaOH/ZnAc, 56°C
- Na2S2O3, 56°C
- 56°C not frozen

MATRIX CODES:

- DW - DRINKING WATER
- WW - WASTEWATER
- GW - GROUNDWATER
- SW - SURFACE WATER
- ST - STORM WATER
- W - WATER
- S - SOIL
- SL - SLUDGE
- SD - SOLID
- A - AIR
- L - LIQUID
- P - PRODUCT

REMARKS/ADDITIONAL INFORMATION

FOR LAB USE ONLY
A2L0437

Sample Condition Upon Receipt Pittsburgh

30 2 0 5 1 6 5



Client Name: Pace Georgia Project # _____

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: 0812 5101 0100

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Thermometer Used N/A Type of Ice: Wet Blue None

Cooler Temperature Observed Temp N/A °C Correction Factor: N/A °C Final Temp: N/A °C
Temp should be above freezing to 6°C

Date and Initials of person examining contents: KH 12-12-16

Comments:

	Yes	No	N/A	
Chain of Custody Present:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	1.
Chain of Custody Filled Out:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	2.
Chain of Custody Relinquished:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	3.
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	4.
Sample Labels match COC:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	5.
-Includes date/time/ID/Analysis Matrix: <u>W+</u>				
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	6.
Short Hold Time Analysis (<72hr remaining):	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	7.
Rush Turn Around Time Requested:	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	8.
Sufficient Volume:	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	9.
Correct Containers Used:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	10.
-Pace Containers Used:	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
Containers Intact:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	11.
Filtered volume received for Dissolved tests	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	12.
All containers needing preservation have been checked.	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	13.
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<u>PHLZ</u>
exceptions: VOA, coliform, TOC, O&G, Phenolics	Initial when completed		Date/time of preservation	<u>aghr</u>
	Lot # of added preservative			
Headspace in VOA Vials (>6mm):	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	14.
Trip Blank Present:	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	15.
Trip Blank Custody Seals Present	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
Rad Aqueous Samples Screened > 0.5 mrem/hr	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Initial when completed: <u>aghr</u> Date: <u>12-13-16</u>

Client Notification/ Resolution:

Person Contacted: _____ Date/Time: _____ Contacted By: _____

Comments/ Resolution: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

*PM review is documented electronically in LIMS. When the Project Manager closes the SRF Review schedule in LIMS. The review is in the Status section of the Workorder Edit Screen.

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-228
Analyst: JAL
Date: 1/11/2017
Worklist: 33369
Matrix: DW

Method Blank Assessment

MB Sample ID: 1208849
MB concentration: 0.754
M/B Counting Uncertainty: 0.429
MB MDC: 0.836
MB Numerical Performance Indicator: 3.45
MB Status vs Numerical Indicator: N/A
MB Status vs. MDC: Pass

Laboratory Control Sample Assessment

LCS (Y or N)? N
LCSID: LCS33369
Count Date: 1/22/2017
Spike I.D.: 15-027
Spike Concentration (pCi/mL): 25.496
Volume Used (mL): 0.20
Aliquot Volume (L, g, F): 0.805
Target Conc. (pCi/L, g, F): 6.333
Uncertainty (Calculated): 0.456
Result (pCi/L, g, F): 7.208
LCS/LCSD Counting Uncertainty (pCi/L, g, F): 0.813
Numerical Performance Indicator: 1.84
Percent Recovery: 113.81%
Status vs Numerical Indicator: N/A
Status vs Recovery: Pass

Duplicate Sample Assessment

Sample I.D.: 30205165010
Duplicate Sample I.D.: 30205165010DUP
Sample Result (pCi/L, g, F): 1.294
Sample Duplicate Result (pCi/L, g, F): 0.518
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F): 2.243
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F): 0.546
Are sample and/or duplicate results below MDC? See Below ##
Duplicate Numerical Performance Indicator: -2.471
Duplicate RPD: 53.69%
Duplicate Status vs Numerical Indicator: N/A
Duplicate Status vs RPD: Fail***

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

[Handwritten Signature]

***Batch must be re-prepped due to unacceptable precision.

Sample Matrix Spike Control Assessment

Sample Collection Date:
Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Spike I.D.:
MS/MSD Decay Corrected Spike Concentration (pCi/mL):
Spike Volume Used in MS (mL):
Spike Volume Used in MSD (mL):
MS Aliquot (L, g, F):
MS Target Conc. (pCi/L, g, F):
MSD Aliquot (L, g, F):
MSD Target Conc. (pCi/L, g, F):
Spike uncertainty (calculated):
Sample Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
MS Numerical Performance Indicator:
MS Percent Recovery:
MSD Percent Recovery:
MS Status vs Numerical Indicator:
MSD Status vs Numerical Indicator:
MS Status vs Recovery:
MSD Status vs Recovery:

Matrix Spike/Matrix Spike Duplicate Sample Assessment

Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Spike I.D.:
Sample Matrix Spike Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
Duplicate Numerical Performance Indicator:
(Based on the Percent Recoveries) MS/MSD Duplicate RPD:
MS/MSD Duplicate Status vs Numerical Indicator:
MS/MSD Duplicate Status vs RPD:

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: LAL
Date: 1/12/2017
Worklist: 33368
Matrix: DW

Method Blank Assessment

MB Sample ID: 1208848
MB Concentration: 0.064
MB Counting Uncertainty: 0.136
MB MDC: 0.321
MB Numerical Performance Indicator: 0.92
MB Status vs Numerical Indicator: N/A
MB Status vs MDC: Pass

Laboratory Control Sample Assessment

LCS (Y or N)? N
LCS# 33368
Count Date: 1/16/2017
Spike I.D.: 16-026
Spike Concentration (pCi/mL): 44.671
Volume Used (mL): 0.10
Aliquot Volume (L, g, F): 0.504
Target Conc. (pCi/L, g, F): 8.856
Uncertainty (Calculated): 0.417
Result (pCi/L, g, F): 7.727
LCS/LCSD Counting Uncertainty (pCi/L, g, F): 0.676
Numerical Performance Indicator: -2.79
Percent Recovery: 87.25%
Status vs Numerical Indicator: N/A
Status vs Recovery: Pass

Duplicate Sample Assessment

Sample I.D.: 30205165010
Duplicate Sample I.D.: 30205165010DUP
Sample Result (pCi/L, g, F): -0.030
Sample Result Counting Uncertainty (pCi/L, g, F): 0.079
Sample Duplicate Result (pCi/L, g, F): 0.183
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F): 0.132
Are sample and/or duplicate results below MDC? See Below ##
Duplicate Numerical Performance Indicator: -2.717
Duplicate RPD: 277.85%
Duplicate Status vs Numerical Indicator: N/A
Duplicate Status vs RPD: Fail**

Enter Duplicate sample IDs if other than LCS/LCSD in the space below.
30205165010
30205165010DUP

Sample Matrix Spike Control Assessment

Sample Collection Date:
Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Spike I.D.:
MS/MSD Decay Corrected Spike Concentration (pCi/mL):
Spike Volume Used in MS (mL):
Spike Volume Used in MSD (mL):
MS Aliquot (L, g, F):
MS Target Conc. (pCi/L, g, F):
MSD Aliquot (L, g, F):
MSD Target Conc. (pCi/L, g, F):
Spike uncertainty (calculated):
Sample Result:
Sample Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
MS Numerical Performance Indicator:
MSD Numerical Performance Indicator:
MS Percent Recovery:
MSD Percent Recovery:
MS Status vs Numerical Indicator:
MSD Status vs Numerical Indicator:
MS Status vs Recovery:
MSD Status vs Recovery:

Matrix Spike/Matrix Spike Duplicate Sample Assessment

Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Spike I.D.:
Sample Matrix Spike Result:
Sample Matrix Spike Duplicate Result:
Sample Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
Duplicate Numerical Performance Indicator:
MS/MSD Duplicate RPD:
MS/MSD Duplicate Status vs Numerical Indicator:
MS/MSD Duplicate Status vs RPD:

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

***Batch must be re-prepped due to unacceptable precision.

Handwritten signature/initials

LABORATORY ANALYTICAL DATA

March – April 2017



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Laboratory Report

Prepared For:

**Georgia Power
2480 Maner Road
Atlanta, GA 30339**

Attention: Mr. Joju Abraham

Report Number: AAC0995

April 10, 2017

Project: CCR Event

Project #:Plant McDonough

We appreciate the opportunity to provide the analytical support for your project. The analytical results in this report are based upon information supplied by you, the client, and are for your exclusive use. If you have any questions regarding this data package, please do not hesitate to call.

Approved:

A handwritten signature in black ink that reads "Betsy McDonough". The signature is written over a horizontal line.

Project Manager

This report may not be reproduced, except in full, without written approval from Pace Analytical Services, LLC.
All test results relate only to the samples analyzed.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 10, 2017

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
DGWA-53	AAC0995-01	Ground Water	03/28/17 14:05	03/29/17 11:30
DGWA-70	AAC0995-02	Ground Water	03/28/17 10:05	03/29/17 11:30
DGWA-71	AAC0995-03	Ground Water	03/28/17 17:40	03/29/17 11:30
FB-1	AAC0995-04	Water	03/28/17 16:45	03/29/17 11:30
DGWC-4	AAC0995-05	Ground Water	03/28/17 12:35	03/29/17 11:30
DGWC-5	AAC0995-06	Ground Water	03/28/17 14:45	03/29/17 11:30
DGWC-9	AAC0995-07	Ground Water	03/28/17 16:35	03/29/17 11:30



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 10, 2017

Case Narrative

Plant McDonough Report AAC0995 4/10/2017

This revised report replaces the original report submitted on 4/7/2017.

Due to analyst error, the dilution factor for AAC0995-01 (DGWA-53) on sulfate was entered incorrectly. The following changes were made:

the dilution factor for sulfate on the affected sample was re-entered, and the report was revised to correct the previously errant data.

No other changes were made to this report.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

April 10, 2017

Attention: Mr. Joju Abraham

Report No.: AAC0995

Project: CCR Event

Client ID: DGWA-53

Lab Number ID: AAC0995-01

Date/Time Sampled: 3/28/2017 2:05:00PM

Date/Time Received: 3/29/2017 11:30:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	202	25	10	mg/L	SM 2540 C		1	04/03/17 15:10	04/03/17 15:10	7030964	JPT
Inorganic Anions											
Chloride	3.7	0.25	0.01	mg/L	EPA 300.0		1	03/31/17 11:00	03/31/17 19:10	7030971	RLC
Fluoride	0.12	0.30	0.004	mg/L	EPA 300.0	J	1	03/31/17 11:00	03/31/17 19:10	7030971	RLC
Sulfate	49	5.0	0.46	mg/L	EPA 300.0		5	03/31/17 11:00	04/04/17 16:23	7030971	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 16:28	7030905	CSW
Arsenic	0.0005	0.0050	0.0004	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 16:28	7030905	CSW
Barium	0.134	0.0100	0.0003	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 16:28	7030905	CSW
Beryllium	ND	0.0030	0.00007	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 16:28	7030905	CSW
Boron	0.0612	0.0400	0.0060	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 16:28	7030905	CSW
Cadmium	ND	0.0010	0.00006	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 16:28	7030905	CSW
Calcium	30.8	25.0	0.522	mg/L	EPA 6020B		50	03/30/17 12:30	04/05/17 16:33	7030905	CSW
Chromium	ND	0.0100	0.0003	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 16:28	7030905	CSW
Cobalt	0.0250	0.0100	0.0005	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 16:28	7030905	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 16:28	7030905	CSW
Molybdenum	0.0242	0.0100	0.0006	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 16:28	7030905	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 16:28	7030905	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 16:28	7030905	CSW
Lithium	0.0108	0.0500	0.0011	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 16:28	7030905	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	04/04/17 11:00	04/04/17 16:07	7040040	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 10, 2017

Report No.: AAC0995

Project: CCR Event

Client ID: DGWA-70

Lab Number ID: AAC0995-02

Date/Time Sampled: 3/28/2017 10:05:00AM

Date/Time Received: 3/29/2017 11:30:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	39	25	10	mg/L	SM 2540 C		1	04/03/17 15:10	04/03/17 15:10	7030964	JPT
Inorganic Anions											
Chloride	3.8	0.25	0.01	mg/L	EPA 300.0		1	03/31/17 11:00	03/31/17 19:30	7030971	RLC
Fluoride	1.2	0.30	0.004	mg/L	EPA 300.0		1	03/31/17 11:00	03/31/17 19:30	7030971	RLC
Sulfate	2.7	1.0	0.09	mg/L	EPA 300.0		1	03/31/17 11:00	03/31/17 19:30	7030971	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 16:39	7030905	CSW
Arsenic	ND	0.0050	0.0004	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 16:39	7030905	CSW
Barium	0.0166	0.0100	0.0003	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 16:39	7030905	CSW
Beryllium	ND	0.0030	0.00007	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 16:39	7030905	CSW
Boron	0.0067	0.0400	0.0060	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 16:39	7030905	CSW
Cadmium	ND	0.0010	0.00006	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 16:39	7030905	CSW
Calcium	5.14	0.500	0.0104	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 16:39	7030905	CSW
Chromium	0.0008	0.0100	0.0003	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 16:39	7030905	CSW
Cobalt	0.0034	0.0100	0.0005	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 16:39	7030905	CSW
Lead	0.00009	0.0050	0.00007	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 16:39	7030905	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 16:39	7030905	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 16:39	7030905	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 16:39	7030905	CSW
Lithium	0.0054	0.0500	0.0011	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 16:39	7030905	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	04/04/17 11:00	04/04/17 16:10	7040040	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 10, 2017

Report No.: AAC0995

Project: CCR Event

Client ID: DGWA-71

Lab Number ID: AAC0995-03

Date/Time Sampled: 3/28/2017 5:40:00PM

Date/Time Received: 3/29/2017 11:30:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	90	25	10	mg/L	SM 2540 C		1	04/03/17 15:10	04/03/17 15:10	7030964	JPT
Inorganic Anions											
Chloride	3.6	0.25	0.01	mg/L	EPA 300.0		1	03/31/17 11:00	03/31/17 19:51	7030971	RLC
Fluoride	0.06	0.30	0.004	mg/L	EPA 300.0	J	1	03/31/17 11:00	03/31/17 19:51	7030971	RLC
Sulfate	17	1.0	0.09	mg/L	EPA 300.0		1	03/31/17 11:00	03/31/17 19:51	7030971	RLC
Metals, Total											
Antimony	0.0007	0.0030	0.0003	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 18:18	7030905	CSW
Arsenic	ND	0.0050	0.0004	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:18	7030905	CSW
Barium	0.0378	0.0100	0.0003	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:18	7030905	CSW
Beryllium	0.00009	0.0030	0.00007	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 18:18	7030905	CSW
Boron	0.0097	0.0400	0.0060	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 18:18	7030905	CSW
Cadmium	ND	0.0010	0.00006	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:18	7030905	CSW
Calcium	8.31	0.500	0.0104	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:18	7030905	CSW
Chromium	0.0023	0.0100	0.0003	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 18:18	7030905	CSW
Cobalt	0.0033	0.0100	0.0005	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 18:18	7030905	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:18	7030905	CSW
Molybdenum	0.0009	0.0100	0.0006	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 18:18	7030905	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:18	7030905	CSW
Thallium	0.00006	0.0010	0.00005	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 18:18	7030905	CSW
Lithium	0.0025	0.0500	0.0011	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 18:18	7030905	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	04/04/17 11:00	04/04/17 16:12	7040040	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 10, 2017

Report No.: AAC0995

Project: CCR Event

Client ID: FB-1

Lab Number ID: AAC0995-04

Date/Time Sampled: 3/28/2017 4:45:00PM

Date/Time Received: 3/29/2017 11:30:00AM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C		1	04/03/17 15:10	04/03/17 15:10	7030964	JPT
Inorganic Anions											
Chloride	0.07	0.25	0.01	mg/L	EPA 300.0	J	1	03/31/17 11:00	03/31/17 20:11	7030971	RLC
Fluoride	ND	0.30	0.004	mg/L	EPA 300.0		1	03/31/17 11:00	03/31/17 20:11	7030971	RLC
Sulfate	ND	1.0	0.09	mg/L	EPA 300.0		1	03/31/17 11:00	03/31/17 20:11	7030971	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:24	7030905	CSW
Arsenic	ND	0.0050	0.0004	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:24	7030905	CSW
Barium	0.0008	0.0100	0.0003	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 18:24	7030905	CSW
Beryllium	ND	0.0030	0.00007	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:24	7030905	CSW
Boron	ND	0.0400	0.0060	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:24	7030905	CSW
Cadmium	ND	0.0010	0.00006	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:24	7030905	CSW
Calcium	ND	0.500	0.0104	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:24	7030905	CSW
Chromium	ND	0.0100	0.0003	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:24	7030905	CSW
Cobalt	ND	0.0100	0.0005	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:24	7030905	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:24	7030905	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:24	7030905	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:24	7030905	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:24	7030905	CSW
Lithium	ND	0.0500	0.0011	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:24	7030905	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	04/04/17 11:00	04/04/17 16:14	7040040	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 10, 2017

Report No.: AAC0995

Project: CCR Event

Client ID: DGWC-4

Lab Number ID: AAC0995-05

Date/Time Sampled: 3/28/2017 12:35:00PM

Date/Time Received: 3/29/2017 11:30:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	1160	25	10	mg/L	SM 2540 C		1	04/03/17 15:10	04/03/17 15:10	7030964	JPT
Inorganic Anions											
Chloride	29	0.25	0.01	mg/L	EPA 300.0		1	03/31/17 11:00	03/31/17 20:32	7030971	RLC
Fluoride	0.17	0.30	0.004	mg/L	EPA 300.0	J	1	03/31/17 11:00	03/31/17 20:32	7030971	RLC
Sulfate	680	50	4.6	mg/L	EPA 300.0		50	03/31/17 11:00	04/04/17 16:44	7030971	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:30	7030905	CSW
Arsenic	0.0005	0.0050	0.0004	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 18:30	7030905	CSW
Barium	0.0363	0.0100	0.0003	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:30	7030905	CSW
Beryllium	0.0002	0.0030	0.00007	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 18:30	7030905	CSW
Boron	4.01	2.00	0.302	mg/L	EPA 6020B		50	03/30/17 12:30	04/06/17 15:51	7030905	CSW
Cadmium	0.0006	0.0010	0.00006	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 18:30	7030905	CSW
Calcium	229	25.0	0.522	mg/L	EPA 6020B		50	03/30/17 12:30	04/05/17 18:36	7030905	CSW
Chromium	0.0005	0.0100	0.0003	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 18:30	7030905	CSW
Cobalt	0.0018	0.0100	0.0005	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 18:30	7030905	CSW
Lead	0.0002	0.0050	0.00007	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 18:30	7030905	CSW
Molybdenum	0.0080	0.0100	0.0006	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 18:30	7030905	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:30	7030905	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:30	7030905	CSW
Lithium	0.0031	0.0500	0.0011	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 18:30	7030905	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	04/04/17 11:00	04/04/17 16:17	7040040	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

April 10, 2017

Attention: Mr. Joju Abraham

Report No.: AAC0995

Project: CCR Event

Client ID: DGWC-5

Lab Number ID: AAC0995-06

Date/Time Sampled: 3/28/2017 2:45:00PM

Date/Time Received: 3/29/2017 11:30:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	545	25	10	mg/L	SM 2540 C		1	04/03/17 15:10	04/03/17 15:10	7030964	JPT
Inorganic Anions											
Chloride	9.5	0.25	0.01	mg/L	EPA 300.0		1	03/31/17 11:00	03/31/17 21:14	7030971	RLC
Fluoride	1.2	0.30	0.004	mg/L	EPA 300.0		1	03/31/17 11:00	03/31/17 21:14	7030971	RLC
Sulfate	380	50	4.6	mg/L	EPA 300.0		50	03/31/17 11:00	04/04/17 17:05	7030971	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:41	7030905	CSW
Arsenic	0.0385	0.0250	0.0021	mg/L	EPA 6020B		5	03/30/17 12:30	04/06/17 16:20	7030905	CSW
Barium	0.0187	0.0100	0.0003	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:41	7030905	CSW
Beryllium	0.0049	0.0030	0.00007	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:41	7030905	CSW
Boron	6.16	2.00	0.302	mg/L	EPA 6020B		50	03/30/17 12:30	04/06/17 15:57	7030905	CSW
Cadmium	0.0002	0.0010	0.00006	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 18:41	7030905	CSW
Calcium	89.1	25.0	0.522	mg/L	EPA 6020B		50	03/30/17 12:30	04/05/17 18:47	7030905	CSW
Chromium	ND	0.0100	0.0003	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:41	7030905	CSW
Cobalt	0.0400	0.0100	0.0005	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:41	7030905	CSW
Lead	ND	0.0050	0.0003	mg/L	EPA 6020B		5	03/30/17 12:30	04/06/17 16:20	7030905	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:41	7030905	CSW
Selenium	0.168	0.0500	0.0070	mg/L	EPA 6020B		5	03/30/17 12:30	04/06/17 16:20	7030905	CSW
Thallium	0.0002	0.0020	0.0002	mg/L	EPA 6020B	R-01, J	5	03/30/17 12:30	04/06/17 16:20	7030905	CSW
Lithium	0.0028	0.0500	0.0011	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 18:41	7030905	CSW
Mercury	0.00017	0.00050	0.000041	mg/L	EPA 7470A	J	1	04/04/17 11:00	04/04/17 16:24	7040040	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 10, 2017

Report No.: AAC0995

Project: CCR Event

Client ID: DGWC-9

Lab Number ID: AAC0995-07

Date/Time Sampled: 3/28/2017 4:35:00PM

Date/Time Received: 3/29/2017 11:30:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	404	25	10	mg/L	SM 2540 C		1	04/03/17 15:10	04/03/17 15:10	7030964	JPT
Inorganic Anions											
Chloride	6.6	0.25	0.01	mg/L	EPA 300.0		1	03/31/17 11:00	03/31/17 21:34	7030971	RLC
Fluoride	1.1	0.30	0.004	mg/L	EPA 300.0		1	03/31/17 11:00	03/31/17 21:34	7030971	RLC
Sulfate	300	50	4.6	mg/L	EPA 300.0		50	03/31/17 11:00	04/04/17 17:27	7030971	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:53	7030905	CSW
Arsenic	0.0243	0.0050	0.0004	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:53	7030905	CSW
Barium	0.0170	0.0100	0.0003	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:53	7030905	CSW
Beryllium	0.0052	0.0030	0.00007	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:53	7030905	CSW
Boron	2.01	2.00	0.302	mg/L	EPA 6020B		50	03/30/17 12:30	04/06/17 16:02	7030905	CSW
Cadmium	0.0005	0.0010	0.00006	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 18:53	7030905	CSW
Calcium	71.6	25.0	0.522	mg/L	EPA 6020B		50	03/30/17 12:30	04/05/17 18:59	7030905	CSW
Chromium	0.0010	0.0100	0.0003	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 18:53	7030905	CSW
Cobalt	0.124	0.0100	0.0005	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:53	7030905	CSW
Lead	ND	0.0050	0.0003	mg/L	EPA 6020B		5	03/30/17 12:30	04/05/17 19:04	7030905	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:53	7030905	CSW
Selenium	0.0954	0.0100	0.0014	mg/L	EPA 6020B		1	03/30/17 12:30	04/05/17 18:53	7030905	CSW
Thallium	0.0007	0.0020	0.0002	mg/L	EPA 6020B	R-01, J	5	03/30/17 12:30	04/05/17 19:04	7030905	CSW
Lithium	0.0249	0.0500	0.0011	mg/L	EPA 6020B	J	1	03/30/17 12:30	04/05/17 18:53	7030905	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	04/04/17 11:00	04/04/17 16:26	7040040	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 10, 2017

Report No.: AAC0995

General Chemistry - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7030964 - SM 2540 C											
Blank (7030964-BLK1)						Prepared & Analyzed: 04/03/17					
Total Dissolved Solids	ND	25	10	mg/L							
LCS (7030964-BS1)						Prepared & Analyzed: 04/03/17					
Total Dissolved Solids	382	25	10	mg/L	400.00		96	84-108			
Duplicate (7030964-DUP1)						Source: AAC0993-02 Prepared & Analyzed: 04/03/17					
Total Dissolved Solids	ND	25	10	mg/L		ND				10	
Duplicate (7030964-DUP2)						Source: AAC0995-01 Prepared & Analyzed: 04/03/17					
Total Dissolved Solids	211	25	10	mg/L		202			4	10	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 10, 2017

Report No.: AAC0995

Inorganic Anions - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7030971 - EPA 300.0											
Blank (7030971-BLK1)						Prepared & Analyzed: 03/31/17					
Chloride	ND	0.25	0.01	mg/L							
Fluoride	ND	0.30	0.004	mg/L							
Sulfate	ND	1.0	0.09	mg/L							
LCS (7030971-BS1)						Prepared & Analyzed: 03/31/17					
Chloride	10.3	0.25	0.01	mg/L	10.010		103	90-110			
Fluoride	10.6	0.30	0.004	mg/L	10.020		106	90-110			
Sulfate	10.5	1.0	0.09	mg/L	10.020		104	90-110			
Matrix Spike (7030971-MS1)						Source: AAC0993-05 Prepared & Analyzed: 03/31/17					
Chloride	15.5	0.25	0.01	mg/L	10.010	5.68	98	90-110			
Fluoride	11.9	0.30	0.004	mg/L	10.020	0.04	119	90-110			QM-05
Sulfate	24.2	1.0	0.09	mg/L	10.020	16.2	80	90-110			QM-05
Matrix Spike (7030971-MS2)						Source: AAC0995-05 Prepared & Analyzed: 03/31/17					
Chloride	36.6	0.25	0.01	mg/L	10.010	29.0	76	90-110			QM-05
Fluoride	11.3	0.30	0.004	mg/L	10.020	0.17	111	90-110			QM-05
Sulfate	365	1.0	0.09	mg/L	10.020	386	NR	90-110			QM-02
Matrix Spike Dup (7030971-MSD1)						Source: AAC0993-05 Prepared & Analyzed: 03/31/17					
Chloride	15.5	0.25	0.01	mg/L	10.010	5.68	98	90-110	0.1	15	
Fluoride	12.2	0.30	0.004	mg/L	10.020	0.04	121	90-110	2	15	QM-05
Sulfate	24.8	1.0	0.09	mg/L	10.020	16.2	86	90-110	2	15	QM-05



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 10, 2017

Report No.: AAC0995

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	----	-----	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7030905 - EPA 3005A

Blank (7030905-BLK1)

Prepared: 03/30/17 Analyzed: 04/05/17

Antimony	ND	0.0030	0.0003	mg/L							
Arsenic	ND	0.0050	0.0004	mg/L							
Barium	ND	0.0100	0.0003	mg/L							
Beryllium	ND	0.0030	0.00007	mg/L							
Boron	ND	0.0400	0.0060	mg/L							
Cadmium	ND	0.0010	0.00006	mg/L							
Calcium	ND	0.500	0.0104	mg/L							
Chromium	ND	0.0100	0.0003	mg/L							
Cobalt	ND	0.0100	0.0005	mg/L							
Copper	0.0004	0.0250	0.0003	mg/L							J
Lead	ND	0.0050	0.00007	mg/L							
Molybdenum	ND	0.0100	0.0006	mg/L							
Nickel	ND	0.0100	0.0003	mg/L							
Selenium	ND	0.0100	0.0014	mg/L							
Silver	ND	0.0100	0.0003	mg/L							
Thallium	ND	0.0010	0.00005	mg/L							
Vanadium	ND	0.0100	0.0014	mg/L							
Zinc	ND	0.0100	0.0013	mg/L							
Lithium	ND	0.0500	0.0011	mg/L							

LCS (7030905-BS1)

Prepared: 03/30/17 Analyzed: 04/05/17

Antimony	0.113	0.0030	0.0003	mg/L	0.10000		113	80-120			
Arsenic	0.103	0.0050	0.0004	mg/L	0.10000		103	80-120			
Barium	0.103	0.0100	0.0003	mg/L	0.10000		103	80-120			
Beryllium	0.104	0.0030	0.00007	mg/L	0.10000		104	80-120			
Boron	1.09	0.0400	0.0060	mg/L	1.0000		109	80-120			
Cadmium	0.102	0.0010	0.00006	mg/L	0.10000		102	80-120			
Calcium	1.01	0.500	0.0104	mg/L	1.0000		101	80-120			
Chromium	0.105	0.0100	0.0003	mg/L	0.10000		105	80-120			
Cobalt	0.100	0.0100	0.0005	mg/L	0.10000		100	80-120			
Copper	0.104	0.0250	0.0003	mg/L	0.10000		104	80-120			
Lead	0.103	0.0050	0.00007	mg/L	0.10000		103	80-120			
Molybdenum	0.108	0.0100	0.0006	mg/L	0.10000		108	80-120			
Nickel	0.103	0.0100	0.0003	mg/L	0.10000		103	80-120			
Selenium	0.102	0.0100	0.0014	mg/L	0.10000		102	80-120			
Silver	0.106	0.0100	0.0003	mg/L	0.10000		106	80-120			
Thallium	0.103	0.0010	0.00005	mg/L	0.10000		103	80-120			
Vanadium	0.104	0.0100	0.0014	mg/L	0.10000		104	80-120			
Zinc	0.102	0.0100	0.0013	mg/L	0.10000		102	80-120			
Lithium	0.108	0.0500	0.0011	mg/L	0.10000		108	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 10, 2017

Report No.: AAC0995

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7030905 - EPA 3005A											
Matrix Spike (7030905-MS1)			Source: AAC0993-05				Prepared: 03/30/17 Analyzed: 04/05/17				
Antimony	0.110	0.0030	0.0003	mg/L	0.10000	ND	110	75-125			
Arsenic	0.104	0.0050	0.0004	mg/L	0.10000	0.0009	103	75-125			
Barium	0.146	0.0100	0.0003	mg/L	0.10000	0.0437	103	75-125			
Beryllium	0.105	0.0030	0.00007	mg/L	0.10000	0.00008	105	75-125			
Boron	1.10	0.0400	0.0060	mg/L	1.0000	0.0113	109	75-125			
Cadmium	0.105	0.0010	0.00006	mg/L	0.10000	ND	105	75-125			
Calcium	4.99	0.500	0.0104	mg/L	1.0000	4.23	76	75-125			
Chromium	0.107	0.0100	0.0003	mg/L	0.10000	ND	107	75-125			
Cobalt	0.108	0.0100	0.0005	mg/L	0.10000	0.0019	106	75-125			
Copper	0.109	0.0250	0.0003	mg/L	0.10000	0.0007	108	75-125			
Lead	0.103	0.0050	0.00007	mg/L	0.10000	0.0005	102	75-125			
Molybdenum	0.107	0.0100	0.0006	mg/L	0.10000	ND	107	75-125			
Nickel	0.107	0.0100	0.0003	mg/L	0.10000	0.0008	106	75-125			
Selenium	0.104	0.0100	0.0014	mg/L	0.10000	0.0033	101	75-125			
Silver	0.105	0.0100	0.0003	mg/L	0.10000	ND	105	75-125			
Thallium	0.103	0.0010	0.00005	mg/L	0.10000	0.00005	103	75-125			
Vanadium	0.106	0.0100	0.0014	mg/L	0.10000	ND	106	75-125			
Zinc	0.106	0.0100	0.0013	mg/L	0.10000	0.0046	102	75-125			
Lithium	0.105	0.0500	0.0011	mg/L	0.10000	ND	105	75-125			
Matrix Spike Dup (7030905-MSD1)											
Matrix Spike Dup (7030905-MSD1)			Source: AAC0993-05				Prepared: 03/30/17 Analyzed: 04/05/17				
Antimony	0.114	0.0030	0.0003	mg/L	0.10000	ND	114	75-125	4	20	
Arsenic	0.103	0.0050	0.0004	mg/L	0.10000	0.0009	102	75-125	0.8	20	
Barium	0.150	0.0100	0.0003	mg/L	0.10000	0.0437	106	75-125	3	20	
Beryllium	0.110	0.0030	0.00007	mg/L	0.10000	0.00008	110	75-125	4	20	
Boron	1.12	0.0400	0.0060	mg/L	1.0000	0.0113	110	75-125	1	20	
Cadmium	0.102	0.0010	0.00006	mg/L	0.10000	ND	102	75-125	4	20	
Calcium	5.28	0.500	0.0104	mg/L	1.0000	4.23	106	75-125	6	20	
Chromium	0.106	0.0100	0.0003	mg/L	0.10000	ND	106	75-125	2	20	
Cobalt	0.104	0.0100	0.0005	mg/L	0.10000	0.0019	102	75-125	3	20	
Copper	0.107	0.0250	0.0003	mg/L	0.10000	0.0007	106	75-125	2	20	
Lead	0.104	0.0050	0.00007	mg/L	0.10000	0.0005	103	75-125	1	20	
Molybdenum	0.108	0.0100	0.0006	mg/L	0.10000	ND	108	75-125	1	20	
Nickel	0.109	0.0100	0.0003	mg/L	0.10000	0.0008	108	75-125	2	20	
Selenium	0.101	0.0100	0.0014	mg/L	0.10000	0.0033	98	75-125	3	20	
Silver	0.105	0.0100	0.0003	mg/L	0.10000	ND	105	75-125	0.9	20	
Thallium	0.104	0.0010	0.00005	mg/L	0.10000	0.00005	104	75-125	1	20	
Vanadium	0.108	0.0100	0.0014	mg/L	0.10000	ND	108	75-125	2	20	
Zinc	0.106	0.0100	0.0013	mg/L	0.10000	0.0046	101	75-125	0.4	20	
Lithium	0.109	0.0500	0.0011	mg/L	0.10000	ND	109	75-125	4	20	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 10, 2017

Report No.: AAC0995

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7030905 - EPA 3005A											
Post Spike (7030905-PS1)			Source: AAC0993-05			Prepared: 03/30/17 Analyzed: 04/05/17					
Antimony	108			ug/L	100.00	0.272	108	80-120			
Arsenic	101			ug/L	100.00	0.933	100	80-120			
Barium	143			ug/L	100.00	43.7	100	80-120			
Beryllium	103			ug/L	100.00	0.0752	103	80-120			
Boron	1070			ug/L	1000.0	11.3	105	80-120			
Cadmium	101			ug/L	100.00	-0.0070	101	80-120			
Calcium	5020			ug/L	1000.0	4230	79	80-120			QM-02
Chromium	104			ug/L	100.00	0.183	104	80-120			
Cobalt	106			ug/L	100.00	1.94	104	80-120			
Copper	106			ug/L	100.00	0.655	105	80-120			
Lead	101			ug/L	100.00	0.499	101	80-120			
Molybdenum	109			ug/L	100.00	0.0432	109	80-120			
Nickel	108			ug/L	100.00	0.815	107	80-120			
Selenium	104			ug/L	100.00	3.26	100	80-120			
Silver	103			ug/L	100.00	0.0132	103	80-120			
Thallium	102			ug/L	100.00	0.0502	102	80-120			
Vanadium	106			ug/L	100.00	0.766	105	80-120			
Zinc	105			ug/L	100.00	4.59	100	80-120			
Lithium	105			ug/L	100.00	0.701	105	80-120			

Batch 7040040 - EPA 7470A

Blank (7040040-BLK1)					Prepared & Analyzed: 04/04/17						
Mercury	ND	0.00050	0.000041	mg/L							
LCS (7040040-BS1)					Prepared & Analyzed: 04/04/17						
Mercury	0.00247	0.00050	0.000041	mg/L	2.5000E-3		99	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 10, 2017

Report No.: AAC0995

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7040040 - EPA 7470A											
Matrix Spike (7040040-MS1)			Source: AAC0993-01			Prepared & Analyzed: 04/04/17					
Mercury	0.00240	0.00050	0.000041	mg/L	2.5000E-3	ND	96	75-125			
Matrix Spike Dup (7040040-MSD1)			Source: AAC0993-01			Prepared & Analyzed: 04/04/17					
Mercury	0.00245	0.00050	0.000041	mg/L	2.5000E-3	ND	98	75-125	2	20	
Post Spike (7040040-PS1)			Source: AAC0993-01			Prepared & Analyzed: 04/04/17					
Mercury	1.68			ug/L	1.6667	0.00028	101	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 10, 2017

Legend

Definition of Laboratory Terms

- ND** - Not Detected at levels equal to or greater than the MDL
- BRL** - Not Detected at levels equal to or greater than the RL
- RL** - Reporting Limit **MDL** - Method Detection Limit
- SOP** - Method run per Pace Standard Operating Procedure
- CFU** - Colony Forming Units
- DF** - Dilution Factor **TIC** - Tentatively Identified Compound

Sample Information

N-Nitrosodiphenylamine breaks down to diphenylamine in the GCMS; both analytes are reported as N-Nitrosodiphenylamine. Pace is not NELAC certified for N-Nitrosodiphenylamine.

Phthalic acid and phthalic anhydride are reported as dimethyl phthalate

Maleic acid and maleic anhydride are reported as dimethyl malate

1,2-Diphenylhydrazine breaks down to azobenzene in the GCMS; both analytes are reported as azobenzene

Definition of Qualifiers

- R-01** Elevated reporting limit due to matrix interference.
- QM-05** The spike recovery was outside acceptance limits for the MS and/or MSD and/or PDS due to suspected matrix interference. Sample results for the QC batch were accepted based on acceptable LCS recoveries.
- QM-02** The spike recovery is outside acceptance limits due to insignificant spike amount as compared to sample concentration.
- J** Estimated value less than Reporting Limit (RL) but greater than Method Detection Limit(MDL) (CLP J-Flag).

Note: Unless otherwise noted, all results are reported on an as received basis.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 10, 2017

Report Notes

There were 2 containers present instead of 1 as listed on the COC for Radium. MMR

CHAIN OF CUSTODY RECORD

Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30082
 (770) 734-4200 : FAX (770) 734-4201

CLIENT NAME: Georgia Power CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10165 Atlanta, GA 30308 404-505-7239		REPORT TO: Dawn Prell (Dawn_Prell@golder.com) REQUESTED COMPLETION DATE:		CC: Maria Padilla PO #:	
PROJECT NAME/STATE: Plant McDonough AP		PROJECT #: Phase II CCR			
Collection DATE	Collection TIME	MATRIX CODE*	COMB	G R A B	SAMPLE IDENTIFICATION
03/28/17	1405	GW	X	X	DGWA-53
03/28/17	1005	GW	X	X	DGWA-70
03/28/17	1740	GW	X	X	DGWA-71
03/28/17	1645	W	X	X	FB-1
03/28/17	1235	GW	X	X	DGWC-4
03/28/17	1445	GW	X	X	DGWC-5
03/28/17	1635	GW	X	X	DGWC-9

SAMPLED BY AND TITLE: Ben Hodges Field Lead	DATE/TIME: 3/29/17 0950
RECEIVED BY: Mike Norman	DATE/TIME: 3/29/17 0950
RECEIVED BY LAB: Mike Norman	DATE/TIME: 03/29/17 1130

RELINQUISHED BY: Sumpter	DATE/TIME: 3/29/17 0950
RELINQUISHED BY:	DATE/TIME:

LAB #: AAC 0995	FOR LAB USE ONLY
Entered Into LIMS:	Tracking #:

Shipped by: Pace Courier
 Seal- N/A



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

LOG-IN CHECKLIST

Printed: 3/30/2017 12:05:36PM

Attn: Mr. Joju Abraham

Client: Georgia Power

Project: CCR Event

Date Received: 03/29/17 11:30

Work Order: AAC0995

Logged In By: Mohammad M. Rahman

OBSERVATIONS

#Samples: 7

#Containers: 28

Minimum Temp(C): 2.0

Maximum Temp(C): 2.0

Custody Seal(s) Used: N/A

CHECKLIST ITEMS

COC included with Samples	YES
Sample Container(s) Intact	YES
Chain of Custody Complete	YES
Sample Container(s) Match COC	NO
Custody seal Intact	NO
Temperature in Compliance	YES
Sufficient Sample Volume for Analysis	YES
Zero Headspace Maintained for VOA Analyses	YES
Samples labeled preserved (If Applicable)	YES
Samples received within Allowable Hold Times	YES
Samples Received on Ice	YES
Preservation Confirmed	YES

Comments:

There were 2 containers present instead of 1 as listed on the COC for Radium. MMR

April 21, 2017

Maria Padilla
GA Power
2480 Maner Rd
Atlanta, GA 30339

RE: Project: AAC0995 Plant McDonough
Pace Project No.: 30214647

Dear Maria Padilla:

Enclosed are the analytical results for sample(s) received by the laboratory on March 30, 2017. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Jacquelyn Collins
jacquelyn.collins@pacelabs.com
(724)850-5612
Project Manager

Enclosures



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: AAC0995 Plant McDonough
Pace Project No.: 30214647

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601
L-A-B DOD-ELAP Accreditation #: L2417
Alabama Certification #: 41590
Arizona Certification #: AZ0734
Arkansas Certification
California Certification #: 04222CA
Colorado Certification
Connecticut Certification #: PH-0694
Delaware Certification
Florida/TNI Certification #: E87683
Georgia Certification #: C040
Guam Certification
Hawaii Certification
Idaho Certification
Illinois Certification
Indiana Certification
Iowa Certification #: 391
Kansas/TNI Certification #: E-10358
Kentucky Certification #: 90133
Louisiana DHH/TNI Certification #: LA140008
Louisiana DEQ/TNI Certification #: 4086
Maine Certification #: PA00091
Maryland Certification #: 308
Massachusetts Certification #: M-PA1457
Michigan/PADEP Certification
Missouri Certification #: 235

Montana Certification #: Cert 0082
Nebraska Certification #: NE-05-29-14
Nevada Certification #: PA014572015-1
New Hampshire/TNI Certification #: 2976
New Jersey/TNI Certification #: PA 051
New Mexico Certification #: PA01457
New York/TNI Certification #: 10888
North Carolina Certification #: 42706
North Dakota Certification #: R-190
Oregon/TNI Certification #: PA200002
Pennsylvania/TNI Certification #: 65-00282
Puerto Rico Certification #: PA01457
Rhode Island Certification #: 65-00282
South Dakota Certification
Tennessee Certification #: TN2867
Texas/TNI Certification #: T104704188-14-8
Utah/TNI Certification #: PA014572015-5
USDA Soil Permit #: P330-14-00213
Vermont Dept. of Health: ID# VT-0282
Virgin Island/PADEP Certification
Virginia/VELAP Certification #: 460198
Washington Certification #: C868
West Virginia DEP Certification #: 143
West Virginia DHHR Certification #: 9964C
Wisconsin Certification
Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: AAC0995 Plant McDonough

Pace Project No.: 30214647

Lab ID	Sample ID	Matrix	Date Collected	Date Received
30214647001	DGWA-53	Water	03/28/17 14:05	03/30/17 10:50
30214647002	DGWA-70	Water	03/28/17 10:05	03/30/17 10:50
30214647003	DGWA-71	Water	03/28/17 17:40	03/30/17 10:50
30214647004	FB-1	Water	03/28/17 16:45	03/30/17 10:50
30214647005	DGWC-4	Water	03/28/17 12:35	03/30/17 10:50
30214647006	DGWC-5	Water	03/28/17 14:45	03/30/17 10:50
30214647007	DGWC-9	Water	03/28/17 16:35	03/30/17 10:50

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: AAC0995 Plant McDonough

Pace Project No.: 30214647

Lab ID	Sample ID	Method	Analysts	Analytes Reported
30214647001	DGWA-53	EPA 9315	JC2	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30214647002	DGWA-70	EPA 9315	JC2	1
		EPA 9320	JJY	1
		Total Radium Calculation	RMK	1
30214647003	DGWA-71	EPA 9315	JC2	1
		EPA 9320	JJY	1
		Total Radium Calculation	RMK	1
30214647004	FB-1	EPA 9315	JC2	1
		EPA 9320	JJY	1
		Total Radium Calculation	RMK	1
30214647005	DGWC-4	EPA 9315	JC2	1
		EPA 9320	JJY	1
		Total Radium Calculation	RMK	1
30214647006	DGWC-5	EPA 9315	JC2	1
		EPA 9320	JJY	1
		Total Radium Calculation	RMK	1
30214647007	DGWC-9	EPA 9315	JC2	1
		EPA 9320	JJY	1
		Total Radium Calculation	RMK	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAC0995 Plant McDonough

Pace Project No.: 30214647

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226		EPA 9315	2.86 ± 0.615 (0.232) C:81% T:NA	pCi/L	04/07/17 10:19	13982-63-3	
Radium-228		EPA 9320	3.50 ± 0.848 (0.711) C:74% T:82%	pCi/L	04/14/17 15:08	15262-20-1	
Total Radium		Total Radium Calculation	6.36 ± 1.46 (0.943)	pCi/L	04/21/17 15:25	7440-14-4	

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226		EPA 9315	0.263 ± 0.161 (0.234) C:97% T:NA	pCi/L	04/10/17 08:47	13982-63-3	
Radium-228		EPA 9320	0.603 ± 0.388 (0.736) C:79% T:80%	pCi/L	04/19/17 11:54	15262-20-1	
Total Radium		Total Radium Calculation	0.866 ± 0.549 (0.970)	pCi/L	04/21/17 15:25	7440-14-4	

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226		EPA 9315	0.0695 ± 0.107 (0.234) C:90% T:NA	pCi/L	04/10/17 08:47	13982-63-3	
Radium-228		EPA 9320	0.187 ± 0.332 (0.727) C:78% T:77%	pCi/L	04/19/17 11:54	15262-20-1	
Total Radium		Total Radium Calculation	0.257 ± 0.439 (0.961)	pCi/L	04/21/17 15:25	7440-14-4	

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226		EPA 9315	0.0723 ± 0.121 (0.272) C:90% T:NA	pCi/L	04/10/17 08:47	13982-63-3	
Radium-228		EPA 9320	0.603 ± 0.426 (0.827) C:77% T:74%	pCi/L	04/19/17 11:54	15262-20-1	
Total Radium		Total Radium Calculation	0.675 ± 0.547 (1.10)	pCi/L	04/21/17 15:25	7440-14-4	

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226		EPA 9315	0.598 ± 0.238 (0.297) C:103% T:NA	pCi/L	04/10/17 08:47	13982-63-3	
Radium-228		EPA 9320	0.764 ± 0.464 (0.869) C:77% T:80%	pCi/L	04/19/17 12:44	15262-20-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAC0995 Plant McDonough

Pace Project No.: 30214647

Sample: DGWC-4		Lab ID: 30214647005	Collected: 03/28/17 12:35	Received: 03/30/17 10:50	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac		Units	Analyzed	CAS No.	Qual
Total Radium	Total Radium Calculation	1.36 ± 0.702 (1.17)		pCi/L	04/21/17 15:25	7440-14-4	

Sample: DGWC-5		Lab ID: 30214647006	Collected: 03/28/17 14:45	Received: 03/30/17 10:50	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac		Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.415 ± 0.199 (0.258)		pCi/L	04/10/17 08:47	13982-63-3	
		C:93% T:NA					
Radium-228	EPA 9320	0.278 ± 0.336 (0.711)		pCi/L	04/19/17 11:54	15262-20-1	
		C:78% T:88%					
Total Radium	Total Radium Calculation	0.693 ± 0.535 (0.969)		pCi/L	04/21/17 15:25	7440-14-4	

Sample: DGWC-9		Lab ID: 30214647007	Collected: 03/28/17 16:35	Received: 03/30/17 10:50	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac		Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.468 ± 0.202 (0.235)		pCi/L	04/10/17 08:47	13982-63-3	
		C:97% T:NA					
Radium-228	EPA 9320	0.594 ± 0.372 (0.695)		pCi/L	04/19/17 11:54	15262-20-1	
		C:77% T:83%					
Total Radium	Total Radium Calculation	1.06 ± 0.574 (0.930)		pCi/L	04/21/17 15:25	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAC0995 Plant McDonough

Pace Project No.: 30214647

QC Batch: 253968

Analysis Method: EPA 9315

QC Batch Method: EPA 9315

Analysis Description: 9315 Total Radium

Associated Lab Samples: 30214647001

METHOD BLANK: 1250174

Matrix: Water

Associated Lab Samples: 30214647001

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.0348 ± 0.0843 (0.204) C:94% T:NA	pCi/L	04/07/17 08:32	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAC0995 Plant McDonough

Pace Project No.: 30214647

QC Batch: 254213

Analysis Method: EPA 9315

QC Batch Method: EPA 9315

Analysis Description: 9315 Total Radium

Associated Lab Samples: 30214647002, 30214647003, 30214647004, 30214647005, 30214647006, 30214647007

METHOD BLANK: 1251795

Matrix: Water

Associated Lab Samples: 30214647002, 30214647003, 30214647004, 30214647005, 30214647006, 30214647007

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.0693 ± 0.120 (0.269) C:90% T:NA	pCi/L	04/10/17 08:46	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAC0995 Plant McDonough

Pace Project No.: 30214647

QC Batch: 254544

Analysis Method: EPA 9320

QC Batch Method: EPA 9320

Analysis Description: 9320 Radium 228

Associated Lab Samples: 30214647001

METHOD BLANK: 1253321

Matrix: Water

Associated Lab Samples: 30214647001

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	-0.191 ± 0.253 (0.655) C:76% T:78%	pCi/L	04/14/17 11:42	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAC0995 Plant McDonough

Pace Project No.: 30214647

QC Batch: 254545 Analysis Method: EPA 9320

QC Batch Method: EPA 9320 Analysis Description: 9320 Radium 228

Associated Lab Samples: 30214647002, 30214647003, 30214647004, 30214647005, 30214647006, 30214647007

METHOD BLANK: 1253322 Matrix: Water

Associated Lab Samples: 30214647002, 30214647003, 30214647004, 30214647005, 30214647006, 30214647007

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.712 ± 0.380 (0.669) C:81% T:76%	pCi/L	04/19/17 11:55	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: AAC0995 Plant McDonough

Pace Project No.: 30214647

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

WO#: 30214647



30214647



Chain of Custody

Workorder: AAC0995

Workorder Name: Plant McDonough

Owner Received Date:

Results Requested By: 4/21/2017

Report To:	Subcontract To:	Requested Analysis											
Betsy McDaniel Pace Analytical Atlanta 110 Technology Parkway Peachtree Corners, GA 30092 Phone (770)-734-4200	Pace - Pittsburgh 1638 Roseytown Road Stes. 2,3,4 Greensburg, PA 15601 Phone (724) 850-5600												
Item	Sample ID	Sample Type	Collect Date/Time	Lab ID	Matrix	CON	H	Preserved Containers	Date/Time	Received By	Date/Time	Comments	
1	DGWA-53	G	3/28/2017 14:05	AAC0995-01	GW	2							
2	DGWA-70	G	3/28/2017 10:05	AAC0995-02	GW	2							
3	DGWA-71	G	3/28/2017 17:40	AAC0995-03	GW	2							
4	FB-1	G	3/28/2017 16:45	AAC0995-04	W	2							
5	DGWC-4	G	3/28/2017 12:35	AAC0995-05	GW	2							
6	DGWC-5	G	3/28/2017 14:45	AAC0995-06	GW	2							
7	DGWC-9	G	3/28/2017 16:35	AAC0995-07	GW	2							
8													
9													
10													
Transfers Released By											Date/Time		Comments
M. D. ...											03/29/17		Rocem Liu
											3/30/17 10:50		

Cooler Temperature on Receipt NA °C Custody Seal Y or (N) Received on Ice Y or (N) Sample Intact Y or N

***In order to maintain client confidentiality, location/name of the sampling site, sampler's name and signature may not be provided on this COC. This chain of custody is considered complete as is since this information is available in the owner laboratory.

CHAIN OF CUSTODY RECORD

Pace Analytical Services, Inc.
110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
(770) 734-4200 : FAX (770) 734-4201

CLIENT NAME: Georgia Power			ANALYSIS REQUESTED			CONTAINER TYPE			PRESERVATION		
CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185 Atlanta, GA 30308			P P P 3 7 3			P - PLASTIC A - AMBER GLASS G - CLEAR GLASS V - VOA VIAL S - STERILE O - OTHER			1 - HCl, 58°C 2 - H ₂ SO ₄ , 58°C 3 - HNO ₃ 4 - NaOH, 58°C 5 - NaOH/ZnAc, 58°C 6 - Na ₂ S ₂ O ₃ , 58°C 7 - 58°C not frozen		
REPORT TO: Dawn Priel (Dawn_Priel@gpds.com)			CONTAINERS			L A B			MATRIX CODES:		
REQUESTED COMPLETION DATE:			# of			I D N U M B E R			DW - DRINKING WATER S - SOIL WW - WASTEWATER SL - SLUDGE GW - GROUNDWATER SD - SOLID SW - SURFACE WATER A - AIR ST - STORM WATER L - LIQUID W - WATER P - PRODUCT		
PROJECT NAME/STATE: Plant McDonough AP			C O N T A I N E R S			R E M A R K S / A D D I T I O N A L I N F O R M A T I O N					
PROJECT #: Phase II CCR											
Collection DATE	Collection TIME	MATRIX CODE	C O R M A P	SAMPLE IDENTIFICATION	Metals App. III & IV (EPA 6020/7470)	C _T n SO ₄ & TDS (EPA 300.0 & SM 2540C)	Radium 226 & 228 (SW-846 9315/9320)				
03/28/17	1405	GW	x	DGWA-53	1	1	1	1			
03/28/17	1005	GW	x	DGWA-70	1	1	1	1			
03/28/17	1740	GW	x	DGWA-71	1	1	1	1			
03/28/17	1645	W	x	FB-1	1	1	1	1			
03/28/17	1235	GW	x	DGWC-4	1	1	1	1			
03/28/17	1445	GW	x	DGWC-5	1	1	1	1			
03/28/17	1635	GW	x	DGWC-9	1	1	1	1			
SAMPLED BY AND TITLE: Ben Hodges Field Lead			RELINQUISHED BY: <i>Ben Hodges</i>			DATE/TIME: 3/29/17 0950			FOR LAB USE ONLY AAC 0995 <i>MR</i>		
RECEIVED BY: Mike Noyes			RELINQUISHED BY:			DATE/TIME:			LAB #:		
RECEIVED BY LAB: W. Galvan			shipped by: Pace Converter			DATE/TIME: 03/29/17 1130			Entered into LIMS:		
SHIP TO: No NA (65) No NA			1cc Present, T-2i Seal: N/A			DATE/TIME: 03/29/17 1130			Tracking #:		

March 28 Plant McDonough COC Phase II CCR.xlsx

Sample Condition Upon Receipt Pittsburgh



Client Name: Pace Atlanta

Project # 30214647

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: 6812 5103 3215

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Thermometer Used N/A Type of Ice: Wet Blue (None)

Cooler Temperature Observed Temp N/A °C Correction Factor: N/A °C Final Temp: N/A °C

Temp should be above freezing to 6°C

Date and Initials of person examining contents: KEH 3/30/17

Comments:	Yes	No	N/A	
Chain of Custody Present:	/			1.
Chain of Custody Filled Out:	/			2.
Chain of Custody Relinquished:	/			3.
Sampler Name & Signature on COC:	/			4.
Sample Labels match COC:	/			5.
-Includes date/time/ID Matrix: <u>Wf</u>				
Samples Arrived within Hold Time:	/			6.
Short Hold Time Analysis (<72hr remaining):		/		7.
Rush Turn Around Time Requested:		/		8.
Sufficient Volume:	/			9.
Correct Containers Used:	/			10.
-Pace Containers Used:	/			
Containers Intact:	/			11.
Orthophosphate field filtered			/	12.
Organic Samples checked for dechlorination:			/	13.
Filtered volume received for Dissolved tests			/	14.
All containers have been checked for preservation.	/			15. <u>pH < 2</u>
All containers needing preservation are found to be in compliance with EPA recommendation.	/			
exceptions: VOA, coliform, TOC, O&G, Phenolics				Initial when completed: <u>KEH</u> Date/time of preservation
				Lot # of added preservative
Headspace in VOA Vials (>6mm):			/	16.
Trip Blank Present:		/		17.
Trip Blank Custody Seals Present		/		
Rad Aqueous Samples Screened > 0.5 mrem/hr		/		Initial when completed: <u>KEH</u> Date: <u>3/30/17</u>

Client Notification/ Resolution:

Person Contacted: _____ Date/Time: _____ Contacted By: _____

Comments/ Resolution: _____

A check in this box indicates that additional information has been stored in ereports.

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

*PM review is documented electronically in LIMS. When the Project Manager closes the SRF Review schedule in LIMS. The review is in the Status section of the Workorder Edit Screen.

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-228
Analyst: JLW
Date: 4/11/2017
Worklist: 34999
Matrix: DW

Method Blank Assessment	
MB Sample ID	1253321
MB concentration:	-0.191
M/B Counting Uncertainty:	0.251
MB MDC:	0.655
MB Numerical Performance Indicator:	-1.49
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment	
LCS34999	Y
Count Date:	4/14/2017
Spike I.D.:	17-005
Spike Concentration (pCi/mL):	24.787
Volume Used (mL):	0.20
Aliquot Volume (L, g, F):	0.801
Target Conc. (pCi/L, g, F):	6.187
Uncertainty (Calculated):	0.445
Result (pCi/L, g, F):	6.482
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.766
Numerical Performance Indicator:	0.65
Percent Recovery:	104.78%
Status vs Numerical Indicator:	N/A
Status vs Recovery:	Pass

Duplicate Sample Assessment	
LCS34999	Y
Count Date:	4/14/2017
Spike I.D.:	17-005
Spike Concentration (pCi/mL):	24.787
Volume Used (mL):	0.20
Aliquot Volume (L, g, F):	0.801
Target Conc. (pCi/L, g, F):	6.187
Uncertainty (Calculated):	0.445
Result (pCi/L, g, F):	7.063
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.792
Numerical Performance Indicator:	1.90
Percent Recovery:	114.27%
Status vs Numerical Indicator:	N/A
Status vs Recovery:	Pass


Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
MS Allquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Allquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
(Based on the Percent Recoveries) MS/ MSD Duplicate RPD:	
MS/ MSD Duplicate Status vs Numerical Indicator:	
MS/ MSD Duplicate Status vs RPD:	

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

Quality Control Sample Performance Assessment



www.pacebsi.com

Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-228
Analyst: JJY
Date: 4/13/2017
Worklist: 35000
Matrix: DW

Method Blank Assessment	
MB Sample ID	1253322
MB concentration:	0.712
M/B Counting Uncertainty:	0.359
MB MDC:	0.669
MB Numerical Performance Indicator:	3.89
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	See Comment*

Laboratory Control Sample Assessment	
Count Date:	LCS35000 4/19/2017
Spike I.D.:	17-005
Spike Concentration (pCi/mL):	24.746
Volume Used (mL):	0.20
Aliquot Volume (L, g, F):	0.805
Target Conc. (pCi/L, g, F):	6.146
Uncertainty (Calculated):	0.442
Result (pCi/L, g, F):	5.745
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.700
Numerical Performance Indicator:	-0.95
Percent Recovery:	93.48%
Status vs Numerical Indicator:	N/A
Status vs Recovery:	Pass

Duplicate Sample Assessment	
Sample I.D.:	LCS35000
Duplicate Sample I.D.:	LCS35000
Sample Result (pCi/L, g, F):	5.745
Sample Result Counting Uncertainty (pCi/L, g, F):	0.700
Sample Duplicate Result (pCi/L, g, F):	5.992
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.741
Are sample and/or duplicate results below MDC?	NO
Duplicate Numerical Performance Indicator:	-0.474
(Based on the LCS/LCSD Percent Recoveries) Duplicate RPD:	3.61%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Pass

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

*The method blank result is below the reporting limit for this analysis and is acceptable.

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc.(pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
(Based on the Percent Recoveries) MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	

Handwritten signature

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: JC2
Date: 4/6/2017
Worklist: 34953
Matrix: DW

Method Blank Assessment	
MB Sample ID	1251795
MB Concentration:	0.069
MB Counting Uncertainty:	0.119
MB MDC:	0.269
MB Numerical Performance Indicator:	1.14
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment	
Count Date:	4/10/2017
Spike I.D.:	17-003
Spike Concentration (pCi/mL):	38.229
Volume Used (mL):	0.25
Aliquot Volume (L, g, F):	0.502
Target Conc. (pCi/L, g, F):	19.020
Uncertainty (Calculated):	0.895
Result (pCi/L, g, F):	16.218
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	1.025
Numerical Performance Indicator:	-4.04
Percent Recovery:	85.27%
Status vs Numerical Indicator:	N/A
Status vs Recovery:	Pass

Duplicate Sample Assessment	
Sample I.D.:	30214650005
Duplicate Sample I.D.:	30214650005DUP
Sample Result (pCi/L, g, F):	1.656
Sample Duplicate Result (pCi/L, g, F):	0.386
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	1.983
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.369
Are sample and/or duplicate results below MDC?	See Below ##
Duplicate Numerical Performance Indicator:	-1.201
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Pass

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

Handwritten signature

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: JC2
Date: 4/4/2017
Worklist: 34921
Matrix: DW

Method Blank Assessment

MB Sample ID: 1250174
 MB concentration: 0.035
 MB Counting Uncertainty: 0.084
 MB MDC: 0.204
 MB Numerical Performance Indicator: 0.81
 MB Status vs Numerical Indicator: N/A
 MB Status vs MDC: Pass

Laboratory Control Sample Assessment

LCS ID	Y or N?
LCS34921	4/7/2017
LCS34921	17-003
LCS34921	38.230
LCS34921	0.25
LCS34921	0.511
LCS34921	18.715
LCS34921	0.880
LCS34921	15.332
LCS34921	1.026
LCS34921	81.92%
LCS34921	N/A
LCS34921	Pass

Count Date: 4/7/2017
 Spike ID: 17-003
 Spike Concentration (pCi/mL): 38.230
 Volume Used (mL): 0.25
 Aliquot Volume (L, g, F): 0.510
 Target Conc. (pCi/L, g, F): 18.736
 Uncertainty (Calculated): 0.881
 Result (pCi/L, g, F): 15.468
 LCS/LCSD Counting Uncertainty (pCi/L, g, F): 1.007
 Numerical Performance Indicator: -4.79
 Percent Recovery: 82.56%
 Status vs Numerical Indicator: N/A
 Status vs Recovery: Pass

Duplicate Sample Assessment

Sample I.D.	Duplicate Sample I.D.	Sample Result (pCi/L, g, F)	Duplicate Result (pCi/L, g, F)	Sample Result Counting Uncertainty (pCi/L, g, F)	Duplicate Result Counting Uncertainty (pCi/L, g, F)	Are sample and/or duplicate results below MDC?	Duplicate Numerical Performance Indicator	Duplicate RPD	Duplicate Status vs Numerical Indicator	Duplicate Status vs RPD
LCS34921	LCS34921	15.468	15.468	1.007	1.007	NO	0.186	0.88%	N/A	Pass

Enter Duplicate sample IDs if other than LCS/LCSD in the space below.

Sample Matrix Spike Control Assessment

Sample Collection Date: 4/7/2017
 Sample I.D.: 17-003
 Sample MS I.D.: 38.230
 Sample MSD I.D.: 0.25
 Spike I.D.: 0.511
 MS/MSD Decay Corrected Spike Concentration (pCi/mL): 18.736
 Spike Volume Used in MS (mL): 0.881
 MS Aliquot (L, g, F): 15.468
 MS Target Conc. (pCi/L, g, F): 1.007
 MSD Aliquot (L, g, F): -4.79
 MSD Target Conc. (pCi/L, g, F): 82.56%
 Spike uncertainty (calculated): N/A
 Sample Result: Pass

Sample Result Counting Uncertainty (pCi/L, g, F): 1.007
 Sample Matrix Spike Result: -4.79
 Matrix Spike Result Counting Uncertainty (pCi/L, g, F): 82.56%
 Sample Matrix Spike Duplicate Result: N/A
 Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F): Pass
 MS Numerical Performance Indicator: N/A
 MS Percent Recovery: Pass
 MSD Percent Recovery: N/A
 MS Status vs Numerical Indicator: N/A
 MSD Status vs Numerical Indicator: Pass
 MS/MSD Duplicate Status vs RPD: Pass

Matrix Spike/Matrix Spike Duplicate Sample Assessment

Sample I.D.: 17-003
 Sample MS I.D.: 38.230
 Sample MSD I.D.: 0.25
 Sample Matrix Spike Result: 0.511
 Matrix Spike Result Counting Uncertainty (pCi/L, g, F): 18.736
 Sample Matrix Spike Duplicate Result: 0.880
 Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F): 15.468
 Duplicate Numerical Performance Indicator: 1.007
 MS/MSD Duplicate Status vs Numerical Indicator: -4.79
 MS/MSD Duplicate Status vs RPD: 82.56%

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

Handwritten signature



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Laboratory Report

Prepared For:

**Georgia Power
2480 Maner Road
Atlanta, GA 30339**

Attention: Mr. Joju Abraham

Report Number: AAC1096

April 12, 2017

Project: CCR Event

Project #:Plant McDonough

We appreciate the opportunity to provide the analytical support for your project. The analytical results in this report are based upon information supplied by you, the client, and are for your exclusive use. If you have any questions regarding this data package, please do not hesitate to call.

Approved:

A handwritten signature in black ink that reads "Betsy McDonough". The signature is written over a horizontal line.

Project Manager

This report may not be reproduced, except in full, without written approval from Pace Analytical Services, LLC.
All test results relate only to the samples analyzed.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 12, 2017

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
DGWC-39	AAC1096-01	Ground Water	03/30/17 15:59	03/31/17 11:45
DGWC-38	AAC1096-02	Ground Water	03/30/17 11:36	03/31/17 11:45
DGWC-37	AAC1096-03	Ground Water	03/30/17 09:44	03/31/17 11:45
DGWA-2	AAC1096-04	Ground Water	03/30/17 11:05	03/31/17 11:45
FB-3	AAC1096-05	Water	03/30/17 09:30	03/31/17 11:45
DGWC-13	AAC1096-06	Ground Water	03/30/17 12:20	03/31/17 11:45
DGWC-15	AAC1096-07	Ground Water	03/30/17 14:15	03/31/17 11:45
EB-2	AAC1096-08	Water	03/30/17 13:55	03/31/17 11:45
DGWC-17	AAC1096-09	Ground Water	03/30/17 16:05	03/31/17 11:45
DGWC-21	AAC1096-10	Ground Water	03/30/17 10:20	03/31/17 11:45
DGWC-40	AAC1096-11	Ground Water	03/30/17 12:40	03/31/17 11:45
FD-3	AAC1096-12	Ground Water	03/30/17 00:00	03/31/17 11:45
DGWC-23	AAC1096-13	Ground Water	03/30/17 16:30	03/31/17 11:45
DGWC-48	AAC1096-14	Ground Water	03/30/17 14:45	03/31/17 11:45



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 12, 2017

Case Narrative

The Radium analysis by methods EPA 9315/9320 was performed by Pace-Pittsburgh, 1638 Roseytown Road - Suites 2, 3, 4, Greensburg PA 15601. The Pace-Pittsburgh lab contact is Jacquelyn Collins at 724-850-5612.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 12, 2017

Report No.: AAC1096

Project: CCR Event

Client ID: DGWC-39

Lab Number ID: AAC1096-01

Date/Time Sampled: 3/30/2017 3:59:00PM

Date/Time Received: 3/31/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	496	25	10	mg/L	SM 2540 C		1	04/04/17 17:10	04/04/17 17:10	7040045	JPT
Inorganic Anions											
Chloride	8.7		0.01	mg/L	EPA 300.0		1	04/05/17 17:28	04/06/17 08:43	7040126	RLC
Fluoride	0.17	0.30	0.004	mg/L	EPA 300.0	J	1	04/05/17 17:28	04/06/17 08:43	7040126	RLC
Sulfate	310	10	0.92	mg/L	EPA 300.0		10	04/05/17 17:28	04/07/17 13:26	7040126	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 19:29	7040019	CSW
Arsenic	0.0007	0.0050	0.0004	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 19:29	7040019	CSW
Barium	0.0858	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 19:29	7040019	CSW
Beryllium	ND	0.0030	0.00007	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 19:29	7040019	CSW
Boron	3.57	2.00	0.302	mg/L	EPA 6020B		50	04/04/17 12:30	04/06/17 19:35	7040019	CSW
Cadmium	ND	0.0010	0.00006	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 19:29	7040019	CSW
Calcium	98.9	25.0	0.522	mg/L	EPA 6020B		50	04/04/17 12:30	04/06/17 19:35	7040019	CSW
Chromium	ND	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 19:29	7040019	CSW
Cobalt	0.0060	0.0100	0.0005	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 19:29	7040019	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 19:29	7040019	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 19:29	7040019	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 19:29	7040019	CSW
Thallium	0.0001	0.0010	0.00005	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 19:29	7040019	CSW
Lithium	ND	0.0500	0.0011	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 19:29	7040019	CSW
Mercury	0.000059	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	04/05/17 09:30	04/05/17 17:14	7040087	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

April 12, 2017

Attention: Mr. Joju Abraham

Report No.: AAC1096

Project: CCR Event

Client ID: DGWC-38

Lab Number ID: AAC1096-02

Date/Time Sampled: 3/30/2017 11:36:00AM

Date/Time Received: 3/31/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	448	25	10	mg/L	SM 2540 C		1	04/04/17 17:10	04/04/17 17:10	7040045	JPT
Inorganic Anions											
Chloride	7.7	0.25	0.01	mg/L	EPA 300.0		1	04/05/17 17:28	04/06/17 09:04	7040126	RLC
Fluoride	0.12	0.30	0.004	mg/L	EPA 300.0	J	1	04/05/17 17:28	04/06/17 09:04	7040126	RLC
Sulfate	290	20	1.8	mg/L	EPA 300.0		20	04/05/17 17:28	04/07/17 13:48	7040126	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 19:52	7040019	CSW
Arsenic	ND	0.0050	0.0004	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 19:52	7040019	CSW
Barium	0.0325	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 19:52	7040019	CSW
Beryllium	ND	0.0030	0.00007	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 19:52	7040019	CSW
Boron	3.19	2.00	0.302	mg/L	EPA 6020B		50	04/04/17 12:30	04/06/17 19:58	7040019	CSW
Cadmium	0.0002	0.0010	0.00006	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 19:52	7040019	CSW
Calcium	80.3	25.0	0.522	mg/L	EPA 6020B		50	04/04/17 12:30	04/06/17 19:58	7040019	CSW
Chromium	ND	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 19:52	7040019	CSW
Cobalt	0.0016	0.0100	0.0005	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 19:52	7040019	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 19:52	7040019	CSW
Molybdenum	0.0011	0.0100	0.0006	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 19:52	7040019	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 19:52	7040019	CSW
Thallium	0.0001	0.0010	0.00005	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 19:52	7040019	CSW
Lithium	0.0035	0.0500	0.0011	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 19:52	7040019	CSW
Mercury	0.00007	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	04/05/17 09:30	04/05/17 17:17	7040087	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 12, 2017

Report No.: AAC1096

Project: CCR Event

Client ID: DGWC-37

Lab Number ID: AAC1096-03

Date/Time Sampled: 3/30/2017 9:44:00AM

Date/Time Received: 3/31/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	273	25	10	mg/L	SM 2540 C		1	04/04/17 17:10	04/04/17 17:10	7040045	JPT
Inorganic Anions											
Chloride	6.3	0.25	0.01	mg/L	EPA 300.0		1	04/05/17 17:28	04/06/17 09:25	7040126	RLC
Fluoride	0.05	0.30	0.004	mg/L	EPA 300.0	J	1	04/05/17 17:28	04/06/17 09:25	7040126	RLC
Sulfate	110	10	0.92	mg/L	EPA 300.0		10	04/05/17 17:28	04/07/17 14:10	7040126	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:03	7040019	CSW
Arsenic	ND	0.0050	0.0004	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:03	7040019	CSW
Barium	0.110	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:03	7040019	CSW
Beryllium	ND	0.0030	0.00007	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:03	7040019	CSW
Boron	1.47	0.0400	0.0060	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:03	7040019	CSW
Cadmium	0.0001	0.0010	0.00006	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 20:03	7040019	CSW
Calcium	62.6	25.0	0.522	mg/L	EPA 6020B		50	04/04/17 12:30	04/06/17 20:09	7040019	CSW
Chromium	ND	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:03	7040019	CSW
Cobalt	ND	0.0100	0.0005	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:03	7040019	CSW
Lead	0.0014	0.0050	0.00007	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 20:03	7040019	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:03	7040019	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:03	7040019	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:03	7040019	CSW
Lithium	0.0029	0.0500	0.0011	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 20:03	7040019	CSW
Mercury	0.00006	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	04/05/17 09:30	04/05/17 17:24	7040087	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 12, 2017

Report No.: AAC1096

Project: CCR Event

Client ID: DGWA-2

Lab Number ID: AAC1096-04

Date/Time Sampled: 3/30/2017 11:05:00AM

Date/Time Received: 3/31/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	580	25	10	mg/L	SM 2540 C		1	04/04/17 17:10	04/04/17 17:10	7040045	JPT
Inorganic Anions											
Chloride	4.8	0.25	0.01	mg/L	EPA 300.0		1	04/05/17 17:28	04/06/17 09:46	7040126	RLC
Fluoride	0.06	0.30	0.004	mg/L	EPA 300.0	J	1	04/05/17 17:28	04/06/17 09:46	7040126	RLC
Sulfate	360	20	1.8	mg/L	EPA 300.0		20	04/05/17 17:28	04/07/17 16:00	7040126	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:15	7040019	CSW
Arsenic	ND	0.0050	0.0004	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:15	7040019	CSW
Barium	0.0232	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:15	7040019	CSW
Beryllium	ND	0.0030	0.00007	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:15	7040019	CSW
Boron	1.56	0.0400	0.0060	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:15	7040019	CSW
Cadmium	0.0005	0.0010	0.00006	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 20:15	7040019	CSW
Calcium	103	25.0	0.522	mg/L	EPA 6020B		50	04/04/17 12:30	04/06/17 20:20	7040019	CSW
Chromium	0.0005	0.0100	0.0003	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 20:15	7040019	CSW
Cobalt	0.0255	0.0100	0.0005	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:15	7040019	CSW
Lead	0.0001	0.0050	0.00007	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 20:15	7040019	CSW
Molybdenum	0.0009	0.0100	0.0006	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 20:15	7040019	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:15	7040019	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:15	7040019	CSW
Lithium	0.0807	0.0500	0.0011	mg/L	EPA 6020B		1	04/04/17 12:30	04/10/17 15:16	7040019	CSW
Mercury	0.00007	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	04/05/17 09:30	04/05/17 17:26	7040087	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 12, 2017

Report No.: AAC1096

Project: CCR Event

Client ID: FB-3

Lab Number ID: AAC1096-05

Date/Time Sampled: 3/30/2017 9:30:00AM

Date/Time Received: 3/31/2017 11:45:00AM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C		1	04/04/17 17:10	04/04/17 17:10	7040045	JPT
Inorganic Anions											
Chloride	0.09	0.25	0.01	mg/L	EPA 300.0	J	1	04/05/17 17:28	04/06/17 10:08	7040126	RLC
Fluoride	ND	0.30	0.004	mg/L	EPA 300.0		1	04/05/17 17:28	04/06/17 10:08	7040126	RLC
Sulfate	0.13	1.0	0.09	mg/L	EPA 300.0	J	1	04/05/17 17:28	04/06/17 10:08	7040126	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:26	7040019	CSW
Arsenic	ND	0.0050	0.0004	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:26	7040019	CSW
Barium	0.0012	0.0100	0.0003	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 20:26	7040019	CSW
Beryllium	ND	0.0030	0.00007	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:26	7040019	CSW
Boron	ND	0.0400	0.0060	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:26	7040019	CSW
Cadmium	ND	0.0010	0.00006	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:26	7040019	CSW
Calcium	0.0140	0.500	0.0104	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 20:26	7040019	CSW
Chromium	0.0003	0.0100	0.0003	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 20:26	7040019	CSW
Cobalt	ND	0.0100	0.0005	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:26	7040019	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:26	7040019	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:26	7040019	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:26	7040019	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:26	7040019	CSW
Lithium	ND	0.0500	0.0011	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:26	7040019	CSW
Mercury	0.00006	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	04/05/17 09:30	04/05/17 17:28	7040087	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 12, 2017

Report No.: AAC1096

Project: CCR Event

Client ID: DGWC-13

Lab Number ID: AAC1096-06

Date/Time Sampled: 3/30/2017 12:20:00PM

Date/Time Received: 3/31/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	287	25	10	mg/L	SM 2540 C		1	04/04/17 17:10	04/04/17 17:10	7040045	JPT
Inorganic Anions											
Chloride	16	0.25	0.01	mg/L	EPA 300.0		1	04/05/17 17:28	04/06/17 10:29	7040126	RLC
Fluoride	0.12	0.30	0.004	mg/L	EPA 300.0	J	1	04/05/17 17:28	04/06/17 10:29	7040126	RLC
Sulfate	180	10	0.92	mg/L	EPA 300.0		10	04/05/17 17:28	04/07/17 16:22	7040126	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:32	7040019	CSW
Arsenic	ND	0.0050	0.0004	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:32	7040019	CSW
Barium	0.0308	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:32	7040019	CSW
Beryllium	0.00007	0.0030	0.00007	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 20:32	7040019	CSW
Boron	0.898	0.0400	0.0060	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:32	7040019	CSW
Cadmium	0.00008	0.0010	0.00006	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 20:32	7040019	CSW
Calcium	46.3	25.0	0.522	mg/L	EPA 6020B		50	04/04/17 12:30	04/06/17 20:38	7040019	CSW
Chromium	0.0009	0.0100	0.0003	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 20:32	7040019	CSW
Cobalt	0.0005	0.0100	0.0005	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 20:32	7040019	CSW
Lead	0.0002	0.0050	0.00007	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 20:32	7040019	CSW
Molybdenum	0.0300	0.0100	0.0006	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:32	7040019	CSW
Selenium	0.0015	0.0100	0.0014	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 20:32	7040019	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:32	7040019	CSW
Lithium	0.0035	0.0500	0.0011	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 20:32	7040019	CSW
Mercury	0.00007	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	04/05/17 09:30	04/05/17 17:31	7040087	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 12, 2017

Report No.: AAC1096

Project: CCR Event

Client ID: DGWC-15

Lab Number ID: AAC1096-07

Date/Time Sampled: 3/30/2017 2:15:00PM

Date/Time Received: 3/31/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	312	25	10	mg/L	SM 2540 C		1	04/04/17 17:10	04/04/17 17:10	7040045	JPT
Inorganic Anions											
Chloride	21	0.25	0.01	mg/L	EPA 300.0		1	04/05/17 17:28	04/06/17 10:50	7040126	RLC
Fluoride	ND	0.30	0.004	mg/L	EPA 300.0		1	04/05/17 17:28	04/06/17 10:50	7040126	RLC
Sulfate	210	5.0	0.46	mg/L	EPA 300.0		5	04/05/17 17:28	04/07/17 16:45	7040126	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:55	7040019	CSW
Arsenic	0.0006	0.0050	0.0004	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 20:55	7040019	CSW
Barium	0.0495	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:55	7040019	CSW
Beryllium	ND	0.0030	0.00007	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:55	7040019	CSW
Boron	1.50	0.0400	0.0060	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:55	7040019	CSW
Cadmium	0.00009	0.0010	0.00006	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 20:55	7040019	CSW
Calcium	36.9	25.0	0.522	mg/L	EPA 6020B		50	04/04/17 12:30	04/06/17 21:01	7040019	CSW
Chromium	0.0005	0.0100	0.0003	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 20:55	7040019	CSW
Cobalt	0.0024	0.0100	0.0005	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 20:55	7040019	CSW
Lead	0.0001	0.0050	0.00007	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 20:55	7040019	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:55	7040019	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:55	7040019	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 20:55	7040019	CSW
Lithium	0.0061	0.0500	0.0011	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 20:55	7040019	CSW
Mercury	0.00006	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	04/05/17 09:30	04/05/17 17:33	7040087	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 12, 2017

Report No.: AAC1096

Project: CCR Event

Client ID: EB-2

Lab Number ID: AAC1096-08

Date/Time Sampled: 3/30/2017 1:55:00PM

Date/Time Received: 3/31/2017 11:45:00AM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C		1	04/04/17 17:10	04/04/17 17:10	7040045	JPT
Inorganic Anions											
Chloride	0.09	0.25	0.01	mg/L	EPA 300.0	J	1	04/05/17 17:28	04/06/17 11:11	7040126	RLC
Fluoride	ND	0.30	0.004	mg/L	EPA 300.0		1	04/05/17 17:28	04/06/17 11:11	7040126	RLC
Sulfate	0.09	1.0	0.09	mg/L	EPA 300.0	J	1	04/05/17 17:28	04/06/17 11:11	7040126	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:06	7040019	CSW
Arsenic	ND	0.0050	0.0004	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:06	7040019	CSW
Barium	0.0013	0.0100	0.0003	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:06	7040019	CSW
Beryllium	ND	0.0030	0.00007	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:06	7040019	CSW
Boron	ND	0.0400	0.0060	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:06	7040019	CSW
Cadmium	ND	0.0010	0.00006	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:06	7040019	CSW
Calcium	0.0232	0.500	0.0104	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:06	7040019	CSW
Chromium	ND	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:06	7040019	CSW
Cobalt	ND	0.0100	0.0005	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:06	7040019	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:06	7040019	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:06	7040019	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:06	7040019	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:06	7040019	CSW
Lithium	ND	0.0500	0.0011	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:06	7040019	CSW
Mercury	0.00006	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	04/05/17 09:30	04/05/17 17:36	7040087	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 12, 2017

Report No.: AAC1096

Project: CCR Event

Client ID: DGWC-17

Lab Number ID: AAC1096-09

Date/Time Sampled: 3/30/2017 4:05:00PM

Date/Time Received: 3/31/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	338	25	10	mg/L	SM 2540 C		1	04/04/17 17:10	04/04/17 17:10	7040045	JPT
Inorganic Anions											
Chloride	20	0.25	0.01	mg/L	EPA 300.0		1	04/05/17 17:28	04/06/17 11:33	7040126	RLC
Fluoride	0.10	0.30	0.004	mg/L	EPA 300.0	J	1	04/05/17 17:28	04/06/17 11:33	7040126	RLC
Sulfate	260	10	0.92	mg/L	EPA 300.0		10	04/05/17 17:28	04/07/17 17:07	7040126	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:12	7040019	CSW
Arsenic	0.0008	0.0050	0.0004	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:12	7040019	CSW
Barium	0.0615	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:12	7040019	CSW
Beryllium	0.0006	0.0030	0.00007	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:12	7040019	CSW
Boron	0.743	0.0400	0.0060	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:12	7040019	CSW
Cadmium	0.0003	0.0010	0.00006	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:12	7040019	CSW
Calcium	9.56	0.500	0.0104	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:12	7040019	CSW
Chromium	0.0026	0.0100	0.0003	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:12	7040019	CSW
Cobalt	0.0283	0.0100	0.0005	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:12	7040019	CSW
Lead	0.0001	0.0050	0.00007	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:12	7040019	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:12	7040019	CSW
Selenium	0.0099	0.0100	0.0014	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:12	7040019	CSW
Thallium	0.0002	0.0010	0.00005	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:12	7040019	CSW
Lithium	ND	0.0500	0.0011	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:12	7040019	CSW
Mercury	0.00012	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	04/05/17 09:30	04/05/17 17:38	7040087	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

April 12, 2017

Attention: Mr. Joju Abraham

Report No.: AAC1096

Project: CCR Event

Client ID: DGWC-21

Lab Number ID: AAC1096-10

Date/Time Sampled: 3/30/2017 10:20:00AM

Date/Time Received: 3/31/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	436	25	10	mg/L	SM 2540 C		1	04/04/17 17:10	04/04/17 17:10	7040045	JPT
Inorganic Anions											
Chloride	24	0.25	0.01	mg/L	EPA 300.0		1	04/05/17 17:28	04/06/17 11:54	7040126	RLC
Fluoride	ND	0.30	0.004	mg/L	EPA 300.0		1	04/05/17 17:28	04/06/17 11:54	7040126	RLC
Sulfate	270	20	1.8	mg/L	EPA 300.0		20	04/05/17 17:28	04/07/17 17:29	7040126	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:23	7040019	CSW
Arsenic	ND	0.0050	0.0004	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:23	7040019	CSW
Barium	0.0272	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:23	7040019	CSW
Beryllium	0.0002	0.0030	0.00007	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:23	7040019	CSW
Boron	5.68	2.00	0.302	mg/L	EPA 6020B		50	04/04/17 12:30	04/06/17 21:29	7040019	CSW
Cadmium	0.0008	0.0010	0.00006	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:23	7040019	CSW
Calcium	72.5	25.0	0.522	mg/L	EPA 6020B		50	04/04/17 12:30	04/06/17 21:29	7040019	CSW
Chromium	0.0005	0.0100	0.0003	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:23	7040019	CSW
Cobalt	0.0076	0.0100	0.0005	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:23	7040019	CSW
Lead	0.0004	0.0050	0.00007	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:23	7040019	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:23	7040019	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:23	7040019	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:23	7040019	CSW
Lithium	0.0065	0.0500	0.0011	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:23	7040019	CSW
Mercury	0.00008	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	04/05/17 09:30	04/05/17 17:43	7040087	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 12, 2017

Report No.: AAC1096

Project: CCR Event

Client ID: DGWC-40

Lab Number ID: AAC1096-11

Date/Time Sampled: 3/30/2017 12:40:00PM

Date/Time Received: 3/31/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	344	25	10	mg/L	SM 2540 C		1	04/04/17 17:10	04/04/17 17:10	7040045	JPT
Inorganic Anions											
Chloride	20	0.25	0.01	mg/L	EPA 300.0		1	04/05/17 17:28	04/06/17 13:19	7040126	RLC
Fluoride	0.21	0.30	0.004	mg/L	EPA 300.0	J	1	04/05/17 17:28	04/06/17 13:19	7040126	RLC
Sulfate	240	10	0.92	mg/L	EPA 300.0		10	04/05/17 17:28	04/07/17 17:52	7040126	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:35	7040019	CSW
Arsenic	0.0006	0.0050	0.0004	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:35	7040019	CSW
Barium	0.0177	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:35	7040019	CSW
Beryllium	0.0030	0.0030	0.00007	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:35	7040019	CSW
Boron	0.937	0.0400	0.0060	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:35	7040019	CSW
Cadmium	0.0007	0.0010	0.00006	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:35	7040019	CSW
Calcium	43.9	25.0	0.522	mg/L	EPA 6020B		50	04/04/17 12:30	04/06/17 21:41	7040019	CSW
Chromium	0.0007	0.0100	0.0003	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:35	7040019	CSW
Cobalt	0.0364	0.0100	0.0005	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:35	7040019	CSW
Lead	0.00007	0.0050	0.00007	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:35	7040019	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:35	7040019	CSW
Selenium	0.0023	0.0100	0.0014	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:35	7040019	CSW
Thallium	0.00006	0.0010	0.00005	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:35	7040019	CSW
Lithium	0.0023	0.0500	0.0011	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:35	7040019	CSW
Mercury	0.00009	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	04/05/17 09:30	04/05/17 17:45	7040087	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 12, 2017

Report No.: AAC1096

Project: CCR Event

Client ID: FD-3

Lab Number ID: AAC1096-12

Date/Time Sampled: 3/30/2017 12:00:00AM

Date/Time Received: 3/31/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	362	25	10	mg/L	SM 2540 C		1	04/04/17 17:10	04/04/17 17:10	7040045	JPT
Inorganic Anions											
Chloride	20	0.25	0.01	mg/L	EPA 300.0		1	04/05/17 17:28	04/06/17 14:22	7040126	RLC
Fluoride	0.25	0.30	0.004	mg/L	EPA 300.0	J	1	04/05/17 17:28	04/06/17 14:22	7040126	RLC
Sulfate	240	10	0.92	mg/L	EPA 300.0		10	04/05/17 17:28	04/07/17 18:14	7040126	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:58	7040019	CSW
Arsenic	0.0005	0.0050	0.0004	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:58	7040019	CSW
Barium	0.0170	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:58	7040019	CSW
Beryllium	0.0031	0.0030	0.00007	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:58	7040019	CSW
Boron	0.921	0.0400	0.0060	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:58	7040019	CSW
Cadmium	0.0008	0.0010	0.00006	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:58	7040019	CSW
Calcium	43.6	25.0	0.522	mg/L	EPA 6020B		50	04/04/17 12:30	04/06/17 22:04	7040019	CSW
Chromium	0.0006	0.0100	0.0003	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/10/17 15:22	7040019	CSW
Cobalt	0.0393	0.0100	0.0005	mg/L	EPA 6020B		1	04/04/17 12:30	04/10/17 15:22	7040019	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:58	7040019	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 21:58	7040019	CSW
Selenium	0.0030	0.0100	0.0014	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:58	7040019	CSW
Thallium	0.00007	0.0010	0.00005	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:58	7040019	CSW
Lithium	0.0025	0.0500	0.0011	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 21:58	7040019	CSW
Mercury	0.000093	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	04/05/17 09:30	04/05/17 17:47	7040087	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

April 12, 2017

Attention: Mr. Joju Abraham

Report No.: AAC1096

Project: CCR Event

Client ID: DGWC-23

Lab Number ID: AAC1096-13

Date/Time Sampled: 3/30/2017 4:30:00PM

Date/Time Received: 3/31/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	380	25	10	mg/L	SM 2540 C		1	04/04/17 17:10	04/04/17 17:10	7040045	JPT
Inorganic Anions											
Chloride	17	0.25	0.01	mg/L	EPA 300.0		1	04/05/17 17:28	04/06/17 14:43	7040126	RLC
Fluoride	0.12	0.30	0.004	mg/L	EPA 300.0	J	1	04/05/17 17:28	04/06/17 14:43	7040126	RLC
Sulfate	220	10	0.92	mg/L	EPA 300.0		10	04/05/17 17:28	04/07/17 18:36	7040126	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 22:09	7040019	CSW
Arsenic	ND	0.0050	0.0004	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 22:09	7040019	CSW
Barium	0.0184	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 22:09	7040019	CSW
Beryllium	0.0004	0.0030	0.00007	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 22:09	7040019	CSW
Boron	4.68	2.00	0.302	mg/L	EPA 6020B		50	04/04/17 12:30	04/06/17 22:15	7040019	CSW
Cadmium	0.0002	0.0010	0.00006	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 22:09	7040019	CSW
Calcium	68.1	25.0	0.522	mg/L	EPA 6020B		50	04/04/17 12:30	04/06/17 22:15	7040019	CSW
Chromium	0.0012	0.0100	0.0003	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/10/17 15:28	7040019	CSW
Cobalt	ND	0.0100	0.0005	mg/L	EPA 6020B		1	04/04/17 12:30	04/10/17 15:28	7040019	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 22:09	7040019	CSW
Molybdenum	0.0084	0.0100	0.0006	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 22:09	7040019	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 22:09	7040019	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 22:09	7040019	CSW
Lithium	0.0162	0.0500	0.0011	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 22:09	7040019	CSW
Mercury	0.00020	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	04/05/17 09:30	04/05/17 17:55	7040087	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

April 12, 2017

Attention: Mr. Joju Abraham

Report No.: AAC1096

Project: CCR Event

Client ID: DGWC-48

Lab Number ID: AAC1096-14

Date/Time Sampled: 3/30/2017 2:45:00PM

Date/Time Received: 3/31/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	775	25	10	mg/L	SM 2540 C		1	04/04/17 17:10	04/04/17 17:10	7040045	JPT
Inorganic Anions											
Chloride	16	0.25	0.01	mg/L	EPA 300.0		1	04/05/17 17:28	04/06/17 15:05	7040126	RLC
Fluoride	0.86	0.30	0.004	mg/L	EPA 300.0		1	04/05/17 17:28	04/06/17 15:05	7040126	RLC
Sulfate	550	50	4.6	mg/L	EPA 300.0		50	04/05/17 17:28	04/07/17 18:59	7040126	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 22:21	7040019	CSW
Arsenic	0.0015	0.0050	0.0004	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 22:21	7040019	CSW
Barium	0.0131	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 22:21	7040019	CSW
Beryllium	0.0106	0.0030	0.00007	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 22:21	7040019	CSW
Boron	0.925	0.0400	0.0060	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 22:21	7040019	CSW
Cadmium	0.0089	0.0010	0.00006	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 22:21	7040019	CSW
Calcium	98.6	25.0	0.522	mg/L	EPA 6020B		50	04/04/17 12:30	04/06/17 22:21	7040019	CSW
Chromium	ND	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 12:30	04/10/17 15:34	7040019	CSW
Cobalt	0.573	0.0100	0.0005	mg/L	EPA 6020B		1	04/04/17 12:30	04/10/17 15:34	7040019	CSW
Lead	0.0035	0.0050	0.00007	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 22:21	7040019	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 22:21	7040019	CSW
Selenium	0.0079	0.0100	0.0014	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 22:21	7040019	CSW
Thallium	0.00009	0.0010	0.00005	mg/L	EPA 6020B	J	1	04/04/17 12:30	04/06/17 22:21	7040019	CSW
Lithium	0.144	0.0500	0.0011	mg/L	EPA 6020B		1	04/04/17 12:30	04/06/17 22:21	7040019	CSW
Mercury	0.00006	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	04/05/17 09:30	04/05/17 17:57	7040087	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 12, 2017

Report No.: AAC1096

General Chemistry - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7040045 - SM 2540 C											
Blank (7040045-BLK1)						Prepared & Analyzed: 04/04/17					
Total Dissolved Solids	ND	25	10	mg/L							
LCS (7040045-BS1)						Prepared & Analyzed: 04/04/17					
Total Dissolved Solids	376	25	10	mg/L	400.00		94	84-108			
Duplicate (7040045-DUP1)						Source: AAC1096-01 Prepared & Analyzed: 04/04/17					
Total Dissolved Solids	468	25	10	mg/L		496			6	10	
Duplicate (7040045-DUP2)						Source: AAC1096-08 Prepared & Analyzed: 04/04/17					
Total Dissolved Solids	ND	25	10	mg/L		ND				10	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 12, 2017

Report No.: AAC1096

Inorganic Anions - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7040126 - EPA 300.0											
Blank (7040126-BLK1)						Prepared: 04/05/17 Analyzed: 04/06/17					
Chloride	ND	0.25	0.01	mg/L							
Fluoride	ND	0.30	0.004	mg/L							
Sulfate	ND	1.0	0.09	mg/L							
LCS (7040126-BS1)						Prepared: 04/05/17 Analyzed: 04/06/17					
Chloride	10.3	0.25	0.01	mg/L	10.010		103	90-110			
Fluoride	10.5	0.30	0.004	mg/L	10.020		105	90-110			
Sulfate	10.3	1.0	0.09	mg/L	10.020		103	90-110			
Matrix Spike (7040126-MS1)						Source: AAC1096-11 Prepared: 04/05/17 Analyzed: 04/06/17					
Chloride	29.3	0.25	0.01	mg/L	10.010	20.3	89	90-110			QM-02
Fluoride	11.2	0.30	0.004	mg/L	10.020	0.21	110	90-110			
Sulfate	176	1.0	0.09	mg/L	10.020	186	NR	90-110			QM-02
Matrix Spike (7040126-MS2)						Source: AAC1108-01 Prepared: 04/05/17 Analyzed: 04/06/17					
Chloride	11.9	0.25	0.01	mg/L	10.010	1.78	101	90-110			
Fluoride	10.7	0.30	0.004	mg/L	10.020	0.01	107	90-110			
Sulfate	11.9	1.0	0.09	mg/L	10.020	1.62	103	90-110			
Matrix Spike Dup (7040126-MSD1)						Source: AAC1096-11 Prepared: 04/05/17 Analyzed: 04/06/17					
Chloride	29.3	0.25	0.01	mg/L	10.010	20.3	89	90-110	0.2	15	QM-02
Fluoride	11.0	0.30	0.004	mg/L	10.020	0.21	108	90-110	2	15	
Sulfate	175	1.0	0.09	mg/L	10.020	186	NR	90-110	0.2	15	QM-02



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 12, 2017

Report No.: AAC1096

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	----	-----	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7040019 - EPA 3005A

Blank (7040019-BLK1)

Prepared: 04/04/17 Analyzed: 04/06/17

Antimony	ND	0.0030	0.0003	mg/L							
Arsenic	ND	0.0050	0.0004	mg/L							
Barium	ND	0.0100	0.0003	mg/L							
Beryllium	ND	0.0030	0.00007	mg/L							
Boron	ND	0.0400	0.0060	mg/L							
Cadmium	ND	0.0010	0.00006	mg/L							
Calcium	ND	0.500	0.0104	mg/L							
Chromium	ND	0.0100	0.0003	mg/L							
Cobalt	ND	0.0100	0.0005	mg/L							
Copper	ND	0.0250	0.0003	mg/L							
Lead	ND	0.0050	0.00007	mg/L							
Molybdenum	ND	0.0100	0.0006	mg/L							
Nickel	ND	0.0100	0.0003	mg/L							
Selenium	ND	0.0100	0.0014	mg/L							
Silver	ND	0.0100	0.0003	mg/L							
Thallium	ND	0.0010	0.00005	mg/L							
Vanadium	ND	0.0100	0.0014	mg/L							
Zinc	ND	0.0100	0.0013	mg/L							
Lithium	ND	0.0500	0.0011	mg/L							

LCS (7040019-BS1)

Prepared: 04/04/17 Analyzed: 04/06/17

Antimony	0.111	0.0030	0.0003	mg/L	0.10000		111	80-120			
Arsenic	0.104	0.0050	0.0004	mg/L	0.10000		104	80-120			
Barium	0.103	0.0100	0.0003	mg/L	0.10000		103	80-120			
Beryllium	0.109	0.0030	0.00007	mg/L	0.10000		109	80-120			
Boron	1.05	0.0400	0.0060	mg/L	1.0000		105	80-120			
Cadmium	0.104	0.0010	0.00006	mg/L	0.10000		104	80-120			
Calcium	1.05	0.500	0.0104	mg/L	1.0000		105	80-120			
Chromium	0.106	0.0100	0.0003	mg/L	0.10000		106	80-120			
Cobalt	0.101	0.0100	0.0005	mg/L	0.10000		101	80-120			
Copper	0.102	0.0250	0.0003	mg/L	0.10000		102	80-120			
Lead	0.106	0.0050	0.00007	mg/L	0.10000		106	80-120			
Molybdenum	0.103	0.0100	0.0006	mg/L	0.10000		103	80-120			
Nickel	0.102	0.0100	0.0003	mg/L	0.10000		102	80-120			
Selenium	0.106	0.0100	0.0014	mg/L	0.10000		106	80-120			
Silver	0.107	0.0100	0.0003	mg/L	0.10000		107	80-120			
Thallium	0.106	0.0010	0.00005	mg/L	0.10000		106	80-120			
Vanadium	0.104	0.0100	0.0014	mg/L	0.10000		104	80-120			
Zinc	0.106	0.0100	0.0013	mg/L	0.10000		106	80-120			
Lithium	0.115	0.0500	0.0011	mg/L	0.10000		115	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 12, 2017

Report No.: AAC1096

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7040019 - EPA 3005A											
Matrix Spike (7040019-MS1)			Source: AAC1096-04			Prepared: 04/04/17 Analyzed: 04/06/17					
Antimony	0.110	0.0030	0.0003	mg/L	0.10000	ND	110	75-125			
Arsenic	0.106	0.0050	0.0004	mg/L	0.10000	ND	106	75-125			
Barium	0.124	0.0100	0.0003	mg/L	0.10000	0.0232	101	75-125			
Beryllium	0.105	0.0030	0.00007	mg/L	0.10000	ND	105	75-125			
Boron	2.32	0.0400	0.0060	mg/L	1.0000	1.56	76	75-125			
Cadmium	0.102	0.0010	0.00006	mg/L	0.10000	0.0005	102	75-125			
Calcium	106	25.0	0.522	mg/L	1.0000	103	250	75-125			QM-02
Chromium	0.102	0.0100	0.0003	mg/L	0.10000	0.0005	101	75-125			
Cobalt	0.125	0.0100	0.0005	mg/L	0.10000	0.0255	99	75-125			
Copper	0.0985	0.0250	0.0003	mg/L	0.10000	0.0023	96	75-125			
Lead	0.0982	0.0050	0.00007	mg/L	0.10000	0.0001	98	75-125			
Molybdenum	0.104	0.0100	0.0006	mg/L	0.10000	0.0009	103	75-125			
Nickel	0.126	0.0100	0.0003	mg/L	0.10000	0.0261	100	75-125			
Selenium	0.106	0.0100	0.0014	mg/L	0.10000	ND	106	75-125			
Silver	0.0995	0.0100	0.0003	mg/L	0.10000	ND	99	75-125			
Thallium	0.101	0.0010	0.00005	mg/L	0.10000	ND	101	75-125			
Vanadium	0.103	0.0100	0.0014	mg/L	0.10000	ND	103	75-125			
Zinc	0.109	0.0100	0.0013	mg/L	0.10000	0.0063	103	75-125			
Lithium	0.198	0.0500	0.0011	mg/L	0.10000	0.0807	117	75-125			
Matrix Spike Dup (7040019-MSD1)			Source: AAC1096-04			Prepared: 04/04/17 Analyzed: 04/06/17					
Antimony	0.112	0.0030	0.0003	mg/L	0.10000	ND	112	75-125	2	20	
Arsenic	0.104	0.0050	0.0004	mg/L	0.10000	ND	104	75-125	2	20	
Barium	0.124	0.0100	0.0003	mg/L	0.10000	0.0232	101	75-125	0.03	20	
Beryllium	0.101	0.0030	0.00007	mg/L	0.10000	ND	101	75-125	3	20	
Boron	2.28	0.0400	0.0060	mg/L	1.0000	1.56	72	75-125	2	20	QM-02
Cadmium	0.0999	0.0010	0.00006	mg/L	0.10000	0.0005	99	75-125	2	20	
Calcium	107	25.0	0.522	mg/L	1.0000	103	380	75-125	1	20	QM-02
Chromium	0.101	0.0100	0.0003	mg/L	0.10000	0.0005	101	75-125	0.5	20	
Cobalt	0.125	0.0100	0.0005	mg/L	0.10000	0.0255	100	75-125	0.2	20	
Copper	0.0995	0.0250	0.0003	mg/L	0.10000	0.0023	97	75-125	1	20	
Lead	0.0992	0.0050	0.00007	mg/L	0.10000	0.0001	99	75-125	1	20	
Molybdenum	0.104	0.0100	0.0006	mg/L	0.10000	0.0009	103	75-125	0.2	20	
Nickel	0.123	0.0100	0.0003	mg/L	0.10000	0.0261	97	75-125	2	20	
Selenium	0.105	0.0100	0.0014	mg/L	0.10000	ND	105	75-125	2	20	
Silver	0.100	0.0100	0.0003	mg/L	0.10000	ND	100	75-125	0.5	20	
Thallium	0.101	0.0010	0.00005	mg/L	0.10000	ND	101	75-125	0.9	20	
Vanadium	0.103	0.0100	0.0014	mg/L	0.10000	ND	103	75-125	0.3	20	
Zinc	0.112	0.0100	0.0013	mg/L	0.10000	0.0063	105	75-125	2	20	
Lithium	0.198	0.0500	0.0011	mg/L	0.10000	0.0807	117	75-125	0.2	20	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 12, 2017

Report No.: AAC1096

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7040019 - EPA 3005A											
Post Spike (7040019-PS1)			Source: AAC1096-04			Prepared: 04/04/17 Analyzed: 04/06/17					
Antimony	101			ug/L	100.00	0.0681	101	80-120			
Arsenic	102			ug/L	100.00	0.243	102	80-120			
Barium	124			ug/L	100.00	23.2	100	80-120			
Beryllium	98.0			ug/L	100.00	0.0576	98	80-120			
Boron	2170			ug/L	1000.0	1560	62	80-120			QM-02
Cadmium	103			ug/L	100.00	0.492	102	80-120			
Calcium	102000			ug/L	1000.0	103000	NR	80-120			QM-02
Chromium	99.7			ug/L	100.00	0.503	99	80-120			
Cobalt	120			ug/L	100.00	25.5	95	80-120			
Copper	96.6			ug/L	100.00	2.32	94	80-120			
Lead	97.7			ug/L	100.00	0.143	98	80-120			
Molybdenum	105			ug/L	100.00	0.856	105	80-120			
Nickel	120			ug/L	100.00	26.1	94	80-120			
Selenium	104			ug/L	100.00	0.832	103	80-120			
Silver	100			ug/L	100.00	0.0306	100	80-120			
Thallium	100			ug/L	100.00	0.0216	100	80-120			
Vanadium	99.5			ug/L	100.00	0.468	99	80-120			
Zinc	110			ug/L	100.00	6.32	103	80-120			
Lithium	183			ug/L	100.00	80.7	102	80-120			

Batch 7040087 - EPA 7470A

Blank (7040087-BLK1)					Prepared & Analyzed: 04/05/17						
Mercury	0.00006	0.00050	0.000041	mg/L							J
LCS (7040087-BS1)					Prepared & Analyzed: 04/05/17						
Mercury	0.00251	0.00050	0.000041	mg/L	2.5000E-3		100	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 12, 2017

Report No.: AAC1096

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7040087 - EPA 7470A											
Matrix Spike (7040087-MS1)			Source: AAC1096-02			Prepared & Analyzed: 04/05/17					
Mercury	0.00248	0.00050	0.000041	mg/L	2.5000E-3	0.00007	96	75-125			
Matrix Spike Dup (7040087-MSD1)			Source: AAC1096-02			Prepared & Analyzed: 04/05/17					
Mercury	0.00251	0.00050	0.000041	mg/L	2.5000E-3	0.00007	98	75-125	1	20	
Post Spike (7040087-PS1)			Source: AAC1096-02			Prepared & Analyzed: 04/05/17					
Mercury	1.75			ug/L	1.6667	0.0448	102	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 12, 2017

Legend

Definition of Laboratory Terms

- ND** - Not Detected at levels equal to or greater than the MDL
- BRL** - Not Detected at levels equal to or greater than the RL
- RL** - Reporting Limit **MDL** - Method Detection Limit
- SOP** - Method run per Pace Standard Operating Procedure
- CFU** - Colony Forming Units
- DF** - Dilution Factor **TIC** - Tentatively Identified Compound

Sample Information

N-Nitrosodiphenylamine breaks down to diphenylamine in the GCMS; both analytes are reported as N-Nitrosodiphenylamine. Pace is not NELAC certified for N-Nitrosodiphenylamine.

Phthalic acid and phthalic anhydride are reported as dimethyl phthalate

Maleic acid and maleic anhydride are reported as dimethyl malate

1,2-Diphenylhydrazine breaks down to azobenzene in the GCMS; both analytes are reported as azobenzene

Definition of Qualifiers

- QM-02** The spike recovery is outside acceptance limits due to insignificant spike amount as compared to sample concentration.
- J** Estimated value less than Reporting Limit (RL) but greater than Method Detection Limit(MDL) (CLP J-Flag).
- B-01** Analyte was detected in the associated method blank at an estimated level equal to or greater than the MDL. Sample values reported as greater than the MDL and less than 10x the method blank value are reported as estimated values.

Note: Unless otherwise noted, all results are reported on an as received basis.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 12, 2017

Report Notes

There were 3 Radium containers present instead of 4 as listed on the COC for DGWC-37. The FD-3 sample listed on the COC was labeled FD-2 on the containers. The COC was used for login purposes. MMR



Pace Analytical
www.pacelabs.com

Pace Analytical Services, LLC - Atlanta GA
110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
(770) 734-4200 : FAX (770) 734-4201

CHAIN OF CUSTODY RECORD

PAGE: 1 OF 2

CLIENT NAME: Georgia Power
 CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER:
241 Ralph McBill Blvd SE #10185
Atlanta, GA 30308
404-586-7239

REPORT TO: Dawn Prellmann - prell@epa.com KJwinko@epa.com
 REQUESTED COMPLETION DATE: 1/23/17

PROJECT NAME/STATE: Plant McDonough LA AP
 PROJECT #: Phase II CCR

Collection DATE	Collection TIME	MATRIX CODE*	COM P	SAMPLE IDENTIFICATION	CONTAINERS	ANALYSIS REQUESTED	CONTAINER TYPE:	PRESERVATION:	# of	RELINQUISHED BY:	DATE/TIME:	RELINQUISHED BY:	DATE/TIME:	SAMPLE SHIPPED VIA:	DATE/TIME:	TEMPERATURE:	COOLING:	OTHER:	FS
3/30/17	1559	GW	X	D6WL-39	4	1	P	(EPA 300.0 + SM254C)	3	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	USPS	11:45	1800	COOLERS	CLIENT	FS
	1136	GW	1	D6WL-38	4	1	P	(EPA 6020/7170)	3	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	USPS	11:45	1800	COOLERS	CLIENT	FS
	0944	GW	1	D6WL-37	6	1	P	(EPA 300.0 + SM254C)	3	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	USPS	11:45	1800	COOLERS	CLIENT	FS
	1105	GW	1	D6WA-2	4	1	P	(EPA 6020/7170)	3	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	USPS	11:45	1800	COOLERS	CLIENT	FS
	0930	W	1	FB-3	4	1	P	(EPA 300.0 + SM254C)	3	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	USPS	11:45	1800	COOLERS	CLIENT	FS
	1220	GW	1	D6WL-13	4	1	P	(EPA 6020/7170)	3	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	USPS	11:45	1800	COOLERS	CLIENT	FS
	1415	GW	1	D6WL-15	4	1	P	(EPA 300.0 + SM254C)	3	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	USPS	11:45	1800	COOLERS	CLIENT	FS
	1355	W	1	EB-2	4	1	P	(EPA 6020/7170)	3	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	USPS	11:45	1800	COOLERS	CLIENT	FS
	1605	GW	1	D6WL-17	4	1	P	(EPA 300.0 + SM254C)	3	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	USPS	11:45	1800	COOLERS	CLIENT	FS
	1020	GW	1	D6WL-21	4	1	P	(EPA 6020/7170)	3	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	USPS	11:45	1800	COOLERS	CLIENT	FS
	1240	GW	1	D6WL-40	4	1	P	(EPA 300.0 + SM254C)	3	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	USPS	11:45	1800	COOLERS	CLIENT	FS
	-	GW	1	FD-3	4	1	P	(EPA 6020/7170)	3	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	RELINQUISHED BY: <u>[Signature]</u>	3/30/17	USPS	11:45	1800	COOLERS	CLIENT	FS

RECEIVED BY LAB: [Signature] RECEIVED BY: [Signature]
 RECEIVED BY: [Signature] RECEIVED BY: [Signature]
 RECEIVED BY: [Signature] RECEIVED BY: [Signature]

LAB #:
 Tracking #:
 Entered into LIMS:
 Tracking #:

FOR LAB USE ONLY
 AACC1096
 MR

DATE/TIME: 3/30/17 1800
 DATE/TIME: 3/30/17 1800
 DATE/TIME: 3/30/17 1145
 DATE/TIME: 3/30/17 1145

Temperature: 18°C
 Min: 18°C Max: 18°C

Cooler ID: [Signature]



Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201

CHAIN OF CUSTODY RECORD

CLIENT NAME: Georgia Power CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185 Atlanta, GA 30308 404-508-7239 REPORT TO: Dawn Prell (Dawn.Prell@golder.com) REQUESTED COMPLETION DATE: PROJECT NAME/STATE: Plant McDonough AP PROJECT #: Phase II CCR											
CONTAINER TYPE: PRESERVATION: # of CONTAINERS		ANALYSIS REQUESTED		P P P 3 7 3		CONTAINER TYPE P - PLASTIC A - AMBER GLASS G - CLEAR GLASS V - VOA VIAL S - STERILE O - OTHER				PRESERVATION 1 - HCl, 56°C 2 - H ₂ SO ₄ , 56°C 3 - HNO ₃ 4 - NaOH, 56°C 5 - NaOH/ZnAc, 56°C 6 - Na ₂ S ₂ O ₃ , 56°C 7 - 56°C not frozen	
MATRIX CODES: DW - DRINKING WATER S - SOIL WW - WASTEWATER SL - SLUDGE GW - GROUNDWATER SD - SOLID SW - SURFACE WATER A - AIR ST - STORM WATER L - LIQUID W - WATER P - PRODUCT		REMARKS/ADDITIONAL INFORMATION		LAB #:		FOR LAB USE ONLY		ENTERED INTO LIMS:		TRACKING #:	
Collection DATE	Collection TIME	MATRIX CODE*	C O R M A P B	SAMPLE IDENTIFICATION	RELINQUISHED BY:	RELINQUISHED BY:	DATE/TIME:	DATE/TIME:	DATE/TIME:	DATE/TIME:	DATE/TIME:
03/30/17	1630	GW	x	DGWC-23	[Signature]	[Signature]	3/31/17 1800	3/31/17 0913			
03/30/17	1445	GW	x	DGWC-48			3/31/17 0913	3/31/17 0913			
RECEIVED BY: Mike Nguyen RECEIVED BY LAB: [Signature] RECEIVED BY: Dawn Prell RECEIVED BY: Dawn Prell											
RECEIVED BY: Mike Nguyen RECEIVED BY LAB: [Signature] RECEIVED BY: Dawn Prell RECEIVED BY: Dawn Prell											

March 30 Plant McDonough COC Phase II CCR.xlsx



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

LOG-IN CHECKLIST

Printed: 4/3/2017 9:45:58AM

Attn: Mr. Joju Abraham

Client: Georgia Power

Project: CCR Event

Date Received: 03/31/17 11:45

Work Order: AAC1096

Logged In By: Mohammad M. Rahman

OBSERVATIONS

#Samples: 14

#Containers: 57

Minimum Temp(C): 1.0

Maximum Temp(C): 1.0

Custody Seal(s) Used: N/A

CHECKLIST ITEMS

COC included with Samples	YES
Sample Container(s) Intact	YES
Chain of Custody Complete	YES
Sample Container(s) Match COC	NO
Custody seal Intact	NO
Temperature in Compliance	YES
Sufficient Sample Volume for Analysis	YES
Zero Headspace Maintained for VOA Analyses	YES
Samples labeled preserved (If Applicable)	YES
Samples received within Allowable Hold Times	YES
Samples Received on Ice	YES
Preservation Confirmed	YES

Comments:

There were 3 Radium containers present instead of 4 as listed on the COC for DGWC-37. The FD-3 sample listed on the COC was labeled FD-2 on the containers. The COC was used for login purposes. MMR

April 25, 2017

Maria Padilla
GA Power
2480 Maner Rd
Atlanta, GA 30339

RE: Project: AAC1096 Plant McDonough
Pace Project No.: 30214952

Dear Maria Padilla:

Enclosed are the analytical results for sample(s) received by the laboratory on April 03, 2017. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Jacquelyn Collins
jacquelyn.collins@pacelabs.com
(724)850-5612
Project Manager

Enclosures



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: AAC1096 Plant McDonough
Pace Project No.: 30214952

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601
L-A-B DOD-ELAP Accreditation #: L2417
Alabama Certification #: 41590
Arizona Certification #: AZ0734
Arkansas Certification
California Certification #: 04222CA
Colorado Certification
Connecticut Certification #: PH-0694
Delaware Certification
Florida/TNI Certification #: E87683
Georgia Certification #: C040
Guam Certification
Hawaii Certification
Idaho Certification
Illinois Certification
Indiana Certification
Iowa Certification #: 391
Kansas/TNI Certification #: E-10358
Kentucky Certification #: 90133
Louisiana DHH/TNI Certification #: LA140008
Louisiana DEQ/TNI Certification #: 4086
Maine Certification #: PA00091
Maryland Certification #: 308
Massachusetts Certification #: M-PA1457
Michigan/PADEP Certification
Missouri Certification #: 235

Montana Certification #: Cert 0082
Nebraska Certification #: NE-05-29-14
Nevada Certification #: PA014572015-1
New Hampshire/TNI Certification #: 2976
New Jersey/TNI Certification #: PA 051
New Mexico Certification #: PA01457
New York/TNI Certification #: 10888
North Carolina Certification #: 42706
North Dakota Certification #: R-190
Oregon/TNI Certification #: PA200002
Pennsylvania/TNI Certification #: 65-00282
Puerto Rico Certification #: PA01457
Rhode Island Certification #: 65-00282
South Dakota Certification
Tennessee Certification #: TN2867
Texas/TNI Certification #: T104704188-14-8
Utah/TNI Certification #: PA014572015-5
USDA Soil Permit #: P330-14-00213
Vermont Dept. of Health: ID# VT-0282
Virgin Island/PADEP Certification
Virginia/VELAP Certification #: 460198
Washington Certification #: C868
West Virginia DEP Certification #: 143
West Virginia DHHR Certification #: 9964C
Wisconsin Certification
Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: AAC1096 Plant McDonough
Pace Project No.: 30214952

Lab ID	Sample ID	Matrix	Date Collected	Date Received
30214952001	DGWC-39	Water	03/30/17 15:59	04/03/17 09:15
30214952002	DGWC-38	Water	03/30/17 11:36	04/03/17 09:15
30214952003	DGWC-37	Water	03/30/17 09:44	04/03/17 09:15
30214952004	DGWA-2	Water	03/30/17 11:05	04/03/17 09:15
30214952005	FB-3	Water	03/30/17 09:30	04/03/17 09:15
30214952006	DGWC-13	Water	03/30/17 12:20	04/03/17 09:15
30214952007	DGWC-15	Water	03/30/17 14:15	04/03/17 09:15
30214952008	EB-2	Water	03/30/17 13:55	04/03/17 09:15
30214952009	DGWC-17	Water	03/30/17 16:05	04/03/17 09:15
30214952010	DGWC-21	Water	03/30/17 10:20	04/03/17 09:15
30214952011	DGWC-40	Water	03/30/17 12:40	04/03/17 09:15
30214952012	FD-2	Water	03/30/17 00:00	04/03/17 09:15
30214952013	DGWC-23	Water	03/30/17 16:30	04/03/17 09:15
30214952014	DGWC-48	Water	03/30/17 14:45	04/03/17 09:15

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: AAC1096 Plant McDonough
Pace Project No.: 30214952

Lab ID	Sample ID	Method	Analysts	Analytes Reported
30214952001	DGWC-39	EPA 9315	JC2	1
		EPA 9320	JJY	1
		Total Radium Calculation	RMK	1
30214952002	DGWC-38	EPA 9315	JC2	1
		EPA 9320	JJY	1
		Total Radium Calculation	RMK	1
30214952003	DGWC-37	EPA 9315	JC2	1
		EPA 9320	JJY	1
		Total Radium Calculation	RMK	1
30214952004	DGWA-2	EPA 9315	JC2	1
		EPA 9320	JJY	1
		Total Radium Calculation	RMK	1
30214952005	FB-3	EPA 9315	JC2	1
		EPA 9320	JJY	1
		Total Radium Calculation	RMK	1
30214952006	DGWC-13	EPA 9315	JC2	1
		EPA 9320	JJY	1
		Total Radium Calculation	RMK	1
30214952007	DGWC-15	EPA 9315	JC2	1
		EPA 9320	JJY	1
		Total Radium Calculation	RMK	1
30214952008	EB-2	EPA 9315	JC2	1
		EPA 9320	JJY	1
		Total Radium Calculation	RMK	1
30214952009	DGWC-17	EPA 9315	JC2	1
		EPA 9320	JJY	1
		Total Radium Calculation	RMK	1
30214952010	DGWC-21	EPA 9315	JC2	1
		EPA 9320	JJY	1
		Total Radium Calculation	RMK	1
30214952011	DGWC-40	EPA 9315	JC2	1
		EPA 9320	JJY	1
		Total Radium Calculation	RMK	1
30214952012	FD-2	EPA 9315	JC2	1
		EPA 9320	JJY	1
		Total Radium Calculation	RMK	1
30214952013	DGWC-23	EPA 9315	JC2	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: AAC1096 Plant McDonough

Pace Project No.: 30214952

Lab ID	Sample ID	Method	Analysts	Analytes Reported
		EPA 9320	JJY	1
		Total Radium Calculation	RMK	1
30214952014	DGWC-48	EPA 9315	JC2	1
		EPA 9320	JJY	1
		Total Radium Calculation	RMK	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAC1096 Plant McDonough

Pace Project No.: 30214952

Sample: DGWC-39		Lab ID: 30214952001	Collected: 03/30/17 15:59	Received: 04/03/17 09:15	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac		Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.264 ± 0.153 (0.220)		pCi/L	04/18/17 08:18	13982-63-3	
		C:79% T:NA					
Radium-228	EPA 9320	-0.437 ± 0.369 (0.993)		pCi/L	04/19/17 20:01	15262-20-1	
		C:79% T:76%					
Total Radium	Total Radium Calculation	0.264 ± 0.522 (1.21)		pCi/L	04/25/17 11:31	7440-14-4	

Sample: DGWC-38		Lab ID: 30214952002	Collected: 03/30/17 11:36	Received: 04/03/17 09:15	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac		Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.0740 ± 0.0844 (0.165)		pCi/L	04/18/17 08:18	13982-63-3	
		C:91% T:NA					
Radium-228	EPA 9320	0.445 ± 0.317 (0.600)		pCi/L	04/19/17 16:59	15262-20-1	
		C:82% T:82%					
Total Radium	Total Radium Calculation	0.519 ± 0.401 (0.765)		pCi/L	04/25/17 11:31	7440-14-4	

Sample: DGWC-37		Lab ID: 30214952003	Collected: 03/30/17 09:44	Received: 04/03/17 09:15	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac		Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.170 ± 0.148 (0.276)		pCi/L	04/18/17 08:18	13982-63-3	
		C:71% T:NA					
Radium-228	EPA 9320	0.132 ± 0.316 (0.705)		pCi/L	04/19/17 16:58	15262-20-1	
		C:79% T:80%					
Total Radium	Total Radium Calculation	0.302 ± 0.464 (0.981)		pCi/L	04/25/17 11:31	7440-14-4	

Sample: DGWA-2		Lab ID: 30214952004	Collected: 03/30/17 11:05	Received: 04/03/17 09:15	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac		Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.105 ± 0.103 (0.191)		pCi/L	04/18/17 08:18	13982-63-3	
		C:83% T:NA					
Radium-228	EPA 9320	0.632 ± 0.403 (0.756)		pCi/L	04/19/17 16:59	15262-20-1	
		C:83% T:78%					
Total Radium	Total Radium Calculation	0.737 ± 0.506 (0.947)		pCi/L	04/25/17 11:31	7440-14-4	

Sample: FB-3		Lab ID: 30214952005	Collected: 03/30/17 09:30	Received: 04/03/17 09:15	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac		Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	-0.0253 ± 0.0544 (0.183)		pCi/L	04/18/17 08:18	13982-63-3	
		C:94% T:NA					
Radium-228	EPA 9320	-0.0345 ± 0.475 (1.12)		pCi/L	04/19/17 20:01	15262-20-1	
		C:79% T:74%					

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAC1096 Plant McDonough
Pace Project No.: 30214952

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: FB-3 Lab ID: 30214952005 Collected: 03/30/17 09:30 Received: 04/03/17 09:15 Matrix: Water PWS: Site ID: Sample Type:						
Total Radium	Total Radium Calculation	0.000 ± 0.529 (1.30)	pCi/L	04/25/17 11:31	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-13 Lab ID: 30214952006 Collected: 03/30/17 12:20 Received: 04/03/17 09:15 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	0.387 ± 0.159 (0.152) C:96% T:NA	pCi/L	04/18/17 08:18	13982-63-3	
Radium-228	EPA 9320	1.20 ± 0.557 (0.895) C:78% T:81%	pCi/L	04/19/17 20:01	15262-20-1	
Total Radium	Total Radium Calculation	1.59 ± 0.716 (1.05)	pCi/L	04/25/17 11:31	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-15 Lab ID: 30214952007 Collected: 03/30/17 14:15 Received: 04/03/17 09:15 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	0.163 ± 0.0932 (0.128) C:82% T:NA	pCi/L	04/18/17 09:59	13982-63-3	
Radium-228	EPA 9320	0.113 ± 0.383 (0.869) C:86% T:84%	pCi/L	04/19/17 20:01	15262-20-1	
Total Radium	Total Radium Calculation	0.276 ± 0.476 (0.997)	pCi/L	04/25/17 11:31	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: EB-2 Lab ID: 30214952008 Collected: 03/30/17 13:55 Received: 04/03/17 09:15 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	0.0207 ± 0.0585 (0.140) C:96% T:NA	pCi/L	04/18/17 09:59	13982-63-3	
Radium-228	EPA 9320	0.164 ± 0.447 (1.00) C:81% T:79%	pCi/L	04/19/17 20:01	15262-20-1	
Total Radium	Total Radium Calculation	0.185 ± 0.506 (1.14)	pCi/L	04/25/17 11:31	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-17 Lab ID: 30214952009 Collected: 03/30/17 16:05 Received: 04/03/17 09:15 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	0.0393 ± 0.0723 (0.162) C:83% T:NA	pCi/L	04/18/17 09:59	13982-63-3	
Radium-228	EPA 9320	0.826 ± 0.499 (0.908) C:83% T:81%	pCi/L	04/19/17 20:01	15262-20-1	
Total Radium	Total Radium Calculation	0.865 ± 0.571 (1.07)	pCi/L	04/25/17 11:31	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAC1096 Plant McDonough

Pace Project No.: 30214952

Sample: DGWC-21		Lab ID: 30214952010	Collected: 03/30/17 10:20	Received: 04/03/17 09:15	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.0767 ± 0.0720 (0.133) C:88% T:NA	pCi/L	04/18/17 09:59	13982-63-3		
Radium-228	EPA 9320	0.807 ± 0.577 (1.12) C:81% T:79%	pCi/L	04/19/17 20:01	15262-20-1		
Total Radium	Total Radium Calculation	0.884 ± 0.649 (1.25)	pCi/L	04/25/17 11:31	7440-14-4		

Sample: DGWC-40		Lab ID: 30214952011	Collected: 03/30/17 12:40	Received: 04/03/17 09:15	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.0844 ± 0.0843 (0.167) C:97% T:NA	pCi/L	04/18/17 09:59	13982-63-3		
Radium-228	EPA 9320	-0.160 ± 0.405 (0.995) C:81% T:81%	pCi/L	04/19/17 20:01	15262-20-1		
Total Radium	Total Radium Calculation	0.0844 ± 0.489 (1.16)	pCi/L	04/25/17 11:31	7440-14-4		

Sample: FD-2		Lab ID: 30214952012	Collected: 03/30/17 00:00	Received: 04/03/17 09:15	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.0269 ± 0.0631 (0.148) C:85% T:NA	pCi/L	04/18/17 09:59	13982-63-3		
Radium-228	EPA 9320	0.846 ± 0.532 (0.985) C:81% T:81%	pCi/L	04/19/17 20:01	15262-20-1		
Total Radium	Total Radium Calculation	0.873 ± 0.595 (1.13)	pCi/L	04/25/17 11:31	7440-14-4		

Sample: DGWC-23		Lab ID: 30214952013	Collected: 03/30/17 16:30	Received: 04/03/17 09:15	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.0393 ± 0.0700 (0.156) C:87% T:NA	pCi/L	04/18/17 09:59	13982-63-3		
Radium-228	EPA 9320	0.258 ± 0.492 (1.08) C:83% T:82%	pCi/L	04/19/17 20:02	15262-20-1		
Total Radium	Total Radium Calculation	0.297 ± 0.562 (1.24)	pCi/L	04/25/17 11:31	7440-14-4		

Sample: DGWC-48		Lab ID: 30214952014	Collected: 03/30/17 14:45	Received: 04/03/17 09:15	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.236 ± 0.105 (0.119) C:95% T:NA	pCi/L	04/18/17 09:59	13982-63-3		
Radium-228	EPA 9320	1.47 ± 0.657 (1.06) C:79% T:75%	pCi/L	04/19/17 20:02	15262-20-1		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAC1096 Plant McDonough
Pace Project No.: 30214952

Sample: DGWC-48 **Lab ID: 30214952014** Collected: 03/30/17 14:45 Received: 04/03/17 09:15 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Total Radium	Total Radium Calculation	1.71 ± 0.762 (1.18)	pCi/L	04/25/17 11:31	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAC1096 Plant McDonough

Pace Project No.: 30214952

QC Batch:	254961	Analysis Method:	EPA 9315
QC Batch Method:	EPA 9315	Analysis Description:	9315 Total Radium
Associated Lab Samples:	30214952001, 30214952002, 30214952003, 30214952004, 30214952005, 30214952006, 30214952007, 30214952008, 30214952009, 30214952010, 30214952011, 30214952012, 30214952013, 30214952014		

METHOD BLANK:	1255466	Matrix:	Water
Associated Lab Samples:	30214952001, 30214952002, 30214952003, 30214952004, 30214952005, 30214952006, 30214952007, 30214952008, 30214952009, 30214952010, 30214952011, 30214952012, 30214952013, 30214952014		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.0349 ± 0.0656 (0.149) C:86% T:NA	pCi/L	04/18/17 08:18	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAC1096 Plant McDonough

Pace Project No.: 30214952

QC Batch:	254547	Analysis Method:	EPA 9320
QC Batch Method:	EPA 9320	Analysis Description:	9320 Radium 228
Associated Lab Samples:	30214952001, 30214952002, 30214952003, 30214952004, 30214952005, 30214952006, 30214952007, 30214952008, 30214952009, 30214952010, 30214952011, 30214952012, 30214952013, 30214952014		

METHOD BLANK:	1253324	Matrix:	Water
Associated Lab Samples:	30214952001, 30214952002, 30214952003, 30214952004, 30214952005, 30214952006, 30214952007, 30214952008, 30214952009, 30214952010, 30214952011, 30214952012, 30214952013, 30214952014		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.0181 ± 0.282 (0.654) C:80% T:93%	pCi/L	04/19/17 16:58	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: AAC1096 Plant McDonough
Pace Project No.: 30214952

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

WO#: 30214952



Chain of Custody



Workorder: AAC1096 Workorder Name: Plant McDonough Owner Received Date: Results Requested By: 4/25/2017
 Report To: Betsy McDaniel Subcontract To: Pace - Pittsburgh
 Pace Analytical Atlanta 1638 Roseytown Road
 110 Technology Parkway Stes. 2,3,4
 Peachtree Corners, GA 30092 Greensburg, PA 15601
 Phone (770)-734-4200 Phone (724) 850-5600

Item	Sample ID	Sample Type	Collect Date/Time	Lab ID	Matrix	Preserved Containers			Date/Time	Comments
						CON	NH			
1	DGWC-39	G	3/30/2017 15:59	AAC1096-01	GW	2			X	
2	DGWC-38	G	3/30/2017 11:36	AAC1096-02	GW	2			X	
3	DGWC-37	G	3/30/2017 9:44	AAC1096-03	GW	3			X	
4	DGWA-2	G	3/30/2017 11:05	AAC1096-04	GW	2			X	
5	FB-3	G	3/30/2017 9:30	AAC1096-05	W	2			X	
6	DGWC-13	G	3/30/2017 12:20	AAC1096-06	GW	2			X	
7	DGWC-15	G	3/30/2017 14:15	AAC1096-07	GW	2			X	
8	EB-2	G	3/30/2017 13:55	AAC1096-08	W	2			X	
9	DGWC-17	G	3/30/2017 16:05	AAC1096-09	GW	2			X	
10	DGWC-21	G	3/30/2017 10:20	AAC1096-10	GW	2			X	
Transfers Released By: <i>Madhavan</i> Received By: <i>RBJ</i> Date/Time: 4/3/17 0915										

Cooler Temperature on Receipt: N/A °C Custody Seal Y or N: Received on Ice Y or N: Sample Intact Y or N:

***In order to maintain client confidentiality, location/name of the sampling site, sampler's name and signature may not be provided on this COC
 This chain of custody is considered complete as is since this information is available in the owner laboratory.

Chain of Custody



Workorder: AAC1096 Workorder Name: Plant McDonough Owner Received Date: Results Requested By: 4/25/2017

Report To: Betsy McDaniel
 Pace Analytical Atlanta
 110 Technology Parkway
 Peachtree Corners, GA 30092
 Phone (770)-734-4200

Subcontract To: Pace - Pittsburgh
 1638 Roseytown Road
 Stes. 2,3,4
 Greensburg, PA 15601
 Phone (724) 850-5600

Item	Sample ID	Sample Type	Collect Date/Time	Lab ID	Matrix	Preserved Containers		Date/Time	Comments
						CON	NH		
11	DGWC-40	G	3/30/2017 12:40	AAC1096-11	GW	2			
12	FD-2	G	3/30/2017 0:00	AAC1096-12	GW	2			
13	DGWC-23	G	3/30/2017 16:30	AAC1096-13	GW	2			
14	DGWC-48	G	3/30/2017 14:45	AAC1096-14	GW	2			
15									
16									
17									
18									
19									
20									
						Radium 226, 228, Total			
LAB USE ONLY									
O11									
O12									
O13									
O14									

Transfers Released By: _____ Date/Time: _____ Received By: *RLS* Date/Time: 4/3/17 0915

1
2
3

Cooler Temperature on Receipt: N/A °C Custody Seal Y or N: N Received on Ice Y or N: N Sample Intact Y or N: N

***In order to maintain client confidentiality, location/name of the sampling site, sampler's name and signature may not be provided on this COC
 This chain of custody is considered complete as is since this information is available in the owner laboratory.

CHAIN OF CUSTODY RECORD

Pace Analytical Services, LLC - Atlanta GA
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201



CLIENT NAME: Georgia Power		CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McCall Blvd SE #10185 Atlanta, GA 30308 404-526-7239		REPORT TO: Doris Prell-Damm - prell@epa.gov		CC: Kjwimbo@epa.gov		REQUESTED COMPLETION DATE: 12/15/17		PROJECT NAME/STATE: Plant McDonough L AP					
PROJECT #: Phase II CCR		CONTAINER TYPE: P - PLASTIC A - AMBER GLASS G - CLEAR GLASS V - VOA VIAL S - STERILE O - OTHER		ANALYSIS REQUESTED: Metal App III/IV (EPA 6020/7170) CLP 5017AS (EPA 300.10 + SM254C) Pb (M) 226/228 (SM-246 9315/9320)		CONTAINER PRESERVATION: 1 - HCl, 56°C 2 - H ₂ SO ₄ , 56°C 3 - HNO ₃ 4 - NaOH, 56°C 5 - NaOH/ZnAc, 56°C 6 - Na ₂ S ₂ O ₈ , 56°C 7 - 56°C not frozen		MATRIX CODES: DW - DRINKING WATER WW - WASTEWATER GW - GROUNDWATER SW - SURFACE WATER ST - STORM WATER W - WATER S - SOIL SL - SLUDGE SD - SOLID A - AIR L - LIQUID P - PRODUCT		REMARKS/ADDITIONAL INFORMATION: Extra Radium D6WC-37, 3 contained Present for Radium, MR 3/9/17 FD - 2 per tabs. MR 3/31/17					
Collection DATE	Collection TIME	MATRIX CODE	SAMPLE IDENTIFICATION	CONTAINER #	ANALYSIS REQUESTED	DATE/TIME	DATE/TIME	RELINQUISHED BY	RELINQUISHED BY	SAMPLE SHIPPED VIA	SHIPPER	CLIENT	OTHER	FS	
3/30/17	1559	GW	D6WC-39	4	1	3/31/17 0913				UPS					
	1136	GW	D6WC-38	4	1										
	0944	GW	D6WC-37	6	1										
	1105	GW	D6WA-2	4	1										
	0930	W	FB-3	4	1										
	1220	GW	D6WC-13	4	1										
	1415	GW	D6WC-15	4	1										
	1355	W	EB-7	4	1										
	1605	GW	D6WC-17	4	1										
	1020	GW	D6WC-21	4	1										
	1240	GW	D6WC-40	4	1										
		GW	FD-3	4	1										
SAMPLED BY AND TITLE: Ben Hodges Field Lead		DATE/TIME: 3/30/17 1800		RELINQUISHED BY: <i>[Signature]</i>		DATE/TIME: 3/31/17 0913		RELINQUISHED BY: <i>[Signature]</i>		SAMPLE SHIPPED VIA: UPS		SHIPPER: Pace		CLIENT: EPA	
RECEIVED BY: Miles Napa		DATE/TIME: 3/31/17 0913		RELINQUISHED BY: <i>[Signature]</i>		DATE/TIME: 3/31/17 1105		RELINQUISHED BY: <i>[Signature]</i>		SAMPLE SHIPPED VIA: UPS		SHIPPER: Pace		CLIENT: EPA	
RECEIVED BY: Miles Napa		DATE/TIME: 3/31/17 0913		RELINQUISHED BY: <i>[Signature]</i>		DATE/TIME: 3/31/17 1105		RELINQUISHED BY: <i>[Signature]</i>		SAMPLE SHIPPED VIA: UPS		SHIPPER: Pace		CLIENT: EPA	
LAB #: AAC1096		DATE/TIME: 3/31/17 1105		RELINQUISHED BY: <i>[Signature]</i>		DATE/TIME: 3/31/17 1105		RELINQUISHED BY: <i>[Signature]</i>		SAMPLE SHIPPED VIA: UPS		SHIPPER: Pace		CLIENT: EPA	
Entered into LIMS: Tracking #:		DATE/TIME: 3/31/17 1105		RELINQUISHED BY: <i>[Signature]</i>		DATE/TIME: 3/31/17 1105		RELINQUISHED BY: <i>[Signature]</i>		SAMPLE SHIPPED VIA: UPS		SHIPPER: Pace		CLIENT: EPA	



Pace Analytical Services, Inc.
110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30082
(770) 734-4200 : FAX (770) 734-4201

CHAIN OF CUSTODY RECORD

CLIENT NAME:
Georgia Power

CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER:
241 Ralph McGill Blvd SE 810185
Atlanta, GA 30308
404-508-7238

REPORT TO:
Dawn Prell (dawn_prell@golder.com)
Atlanta, GA 30308
404-508-7238

CC: Maria Padilla
maria.padilla@epa.gov

PO #:
13000000000000000000

PROJECT NAME/STATE:
Plant McDonough AP
Phase II CCR

Collection DATE	Collection TIME	MATRIX CODE	C O M P	G R A B	SAMPLE IDENTIFICATION	CONTAINER TYPE PRESERVATION #	ANALYSIS REQUESTED						DATE/TIME	RELINQUISHED BY:	DATE/TIME	REMARKS/ADDITIONAL INFORMATION
							P	P	P	P	P	P				
03/30/17	1630	GW	X		DGWC-23	4									13	
03/30/17	1445	GW	X		DGWC-48	4									14	

CONTAINER TYPE PRESERVATION #:
P - PLASTIC
A - AMBER GLASS
G - CLEAR GLASS
V - VOA VIAL
S - STERILE
O - OTHER
1 - HCl, 55°C
2 - H2SO4, 55°C
3 - HNO3
4 - NaOH, 55°C
5 - NaOH/ZnAc, 55°C
6 - Na2S2O8, 55°C
7 - 55°C not frozen

MATRIX CODES:
DW - DRINKING WATER S - SOIL
WW - WASTEWATER SL - SLUDGE
GW - GROUNDWATER SD - SOLID
SW - SURFACE WATER A - AIR
ST - STORM WATER L - LIQUID
W - WATER P - PRODUCT

REMARKS/ADDITIONAL INFORMATION

SAMPLED BY AND TITLE: Ben Hodges Field Lead

RECEIVED BY: Mike Nguyen DATE/TIME: 3/31/17 1800

RELINQUISHED BY: [Signature] DATE/TIME: 3/31/17 0913

RECEIVED BY LAB: [Signature] DATE/TIME: 03/31/17 1145

REMARKS: shipped by: Pace Courrier Temp - 1°C Seal - NA

LAB #: FOR LAB USE ONLY: AG 1096
Entered into LIS: [Signature]
Tracing #:

Sample Condition Upon Receipt Pittsburgh

RTB



Client Name: Pace GA Project # 30214952

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: 6812 5103 3498 / 6812 5103 3447

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Thermometer Used N/A Type of Ice: Wet Blue None

Cooler Temperature Observed Temp N/A °C Correction Factor: N/A °C Final Temp: N/A °C
Temp should be above freezing to 6°C

Date and Initials of person examining contents: RTB 4/3/17

Comments:	Yes	No	N/A	
Chain of Custody Present:	X			1.
Chain of Custody Filled Out:	X			2.
Chain of Custody Relinquished:	X			3.
Sampler Name & Signature on COC:	X			4.
Sample Labels match COC:	X			5.
-Includes date/time/ID Matrix: <u>WT</u>				
Samples Arrived within Hold Time:	X			6.
Short Hold Time Analysis (<72hr remaining):		X		7.
Rush Turn Around Time Requested:		X		8.
Sufficient Volume:	X			9.
Correct Containers Used:	X			10.
-Pace Containers Used:	X			
Containers Intact:	X			11.
Orthophosphate field filtered			X	12.
Organic Samples checked for dechlorination:			X	13.
Filtered volume received for Dissolved tests			X	14.
All containers have been checked for preservation.	X			15.
All containers needing preservation are found to be in compliance with EPA recommendation.	X			<u>PHC2</u>
exceptions: VOA, coliform, TOC, O&G, Phenolics				Initial when completed: <u>4/3/17 RTB</u> Date/time of preservation: _____
				Lot # of added preservative: _____
Headspace in VOA Vials (>6mm):			X	16.
Trip Blank Present:			X	17.
Trip Blank Custody Seals Present			X	
Rad Aqueous Samples Screened > 0.5 mrem/hr		X		Initial when completed: <u>4/3/17 RTB</u> Date: <u>4/3/17</u>

Client Notification/ Resolution:
 Person Contacted: _____ Date/Time: _____ Contacted By: _____
 Comments/ Resolution: _____

A check in this box indicates that additional information has been stored in ereports.

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)
 *PM review is documented electronically in LIMS. When the Project Manager closes the SRF Review schedule in LIMS. The review is in the Status section of the Workorder Edit Screen.

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: JC2
Date: 4/13/2017
Worklist: 35076
Matrix: DW

Method Blank Assessment	
MB Sample ID	1255486
MB concentration:	0.035
M/B Counting Uncertainty:	0.065
MB MDC:	0.149
MB Numerical Performance Indicator:	1.05
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment	
LCSID (Y or N)?	N
LCS35076	LCS035076
Count Date:	4/19/2017
Spike I.D.:	17-003
Spike Concentration (pCi/mL):	38.229
Volume Used (mL):	0.25
Aliquot Volume (L, g, F):	0.505
Target Conc. (pCi/L, g, F):	18.933
Uncertainty (Calculated):	0.891
Result (pCi/L, g, F):	16.345
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.881
Numerical Performance Indicator:	-4.05
Percent Recovery:	86.33%
Status vs Numerical Indicator:	N/A
Status vs Recovery:	Pass

Duplicate Sample Assessment	
Sample I.D.:	30214951002
Duplicate Sample I.D.:	30214951002DUP
Sample Result (pCi/L, g, F):	0.091
Sample Result Counting Uncertainty (pCi/L, g, F):	0.087
Sample Duplicate Result (pCi/L, g, F):	0.054
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.086
Are sample and/or duplicate results below MDC?	See Below ##
Duplicate Numerical Performance Indicator:	0.595
Duplicate RPD:	51.43%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Fail***

Enter Duplicate sample IDs if other than LCS/LCSD in the space below.
30214951002
30214951002DUP

Comments:

***Batch must be re-prepped due to unacceptable precision.

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MSD Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Sample Matrix Spike Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Sample Matrix Spike Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-228
Analyst: JJY
Date: 4/17/2017
Worklist: 35002
Matrix: DW

Method Blank Assessment

MB Sample ID: 1253324
MB concentration: 0.018
M/B Counting Uncertainty: 0.281
MB MDC: 0.654
MB Numerical Performance Indicator: 0.13
MB Status vs Numerical Indicator: N/A
MB Status vs MDC: Pass

Laboratory Control Sample Assessment

LCSD (Y or N)? N
LCSD35002

Count Date: 4/19/2017
Spike I.D.: 17-005
Spike Concentration (pCi/mL): 24.744
Volume Used (mL): 0.20
Aliquot Volume (L, g, F): 0.806
Target Conc. (pCi/L, g, F): 6.143
Uncertainty (Calculated): 0.442
Result (pCi/L, g, F): 6.786
LCS/LCSD Counting Uncertainty (pCi/L, g, F): 0.792
Numerical Performance Indicator: 1.39
Percent Recovery: 110.47%
Status vs Numerical Indicator: N/A
Status vs Recovery: Pass

Duplicate Sample Assessment

Sample I.D.: 30214952003
Duplicate Sample I.D.: 30214952003DUP

Sample Result (pCi/L, g, F): 0.132
Sample Result Counting Uncertainty (pCi/L, g, F): 0.315
Sample Duplicate Result (pCi/L, g, F): 0.272
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F): 0.322
Are sample and/or duplicate results below MDC? See Below ##
Duplicate Numerical Performance Indicator: -0.608
Duplicate RPD: 69.25%
Duplicate Status vs Numerical Indicator: N/A
Duplicate Status vs RPD: Fail***

Enter Duplicate sample IDs if other than LCS/LCSD in the space below.
30214952003
30214952003DUP

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

Kimberly Dupont

***Batch must be re-prepped due to unacceptable precision.

Sample Matrix Spike Control Assessment

Sample Collection Date:
Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Spike I.D.:
MS/MSD Decay Corrected Spike Concentration (pCi/mL):
Spike Volume Used in MS (mL):
Spike Volume Used in MSD (mL):
MS Aliquot (L, g, F):
MS Target Conc.(pCi/L, g, F):
MSD Aliquot (L, g, F):
MSD Target Conc. (pCi/L, g, F):
Spike uncertainty (calculated):
Sample Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Result
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
MS Numerical Performance Indicator:
MS Percent Recovery:
MSD Percent Recovery:
MS Status vs Numerical Indicator:
MSD Status vs Numerical Indicator:
MS Status vs Recovery:
MSD Status vs Recovery:

Matrix Spike/Matrix Spike Duplicate Sample Assessment

Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
Duplicate Numerical Performance Indicator:
(Based on the Percent Recoveries) MS/ MSD Duplicate RPD:
MS/MSD Duplicate Status vs Numerical Indicator:
MS/MSD Duplicate Status vs RPD:



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Laboratory Report

Prepared For:

**Georgia Power
2480 Maner Road
Atlanta, GA 30339**

Attention: Mr. Joju Abraham

Report Number: AAC1126

April 11, 2017

Project: CCR Event

Project #:Plant McDonough

We appreciate the opportunity to provide the analytical support for your project. The analytical results in this report are based upon information supplied by you, the client, and are for your exclusive use. If you have any questions regarding this data package, please do not hesitate to call.

Approved:

A handwritten signature in black ink that reads "Betsy McDonough". The signature is written over a horizontal line.

Project Manager

This report may not be reproduced, except in full, without written approval from Pace Analytical Services, LLC.
All test results relate only to the samples analyzed.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 11, 2017

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
DGWC-67	AAC1126-01	Ground Water	03/31/17 10:50	03/31/17 17:25
DGWC-69	AAC1126-02	Ground Water	03/31/17 13:10	03/31/17 17:25
EB-3	AAC1126-03	Water	03/31/17 14:35	03/31/17 17:25
DGWC-68	AAC1126-04	Ground Water	03/31/17 13:00	03/31/17 17:25
DGWC-42	AAC1126-05	Ground Water	03/31/17 14:15	03/31/17 17:25
DGWC-47	AAC1126-06	Ground Water	03/31/17 12:20	03/31/17 17:25
FD-3	AAC1126-07	Ground Water	03/31/17 00:00	03/31/17 17:25



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 11, 2017

Case Narrative

The Radium analysis by methods EPA 9315/9320 was performed by Pace-Pittsburgh, 1638 Roseytown Road - Suites 2, 3, 4, Greensburg PA 15601. The Pace-Pittsburgh lab contact is Jacquelyn Collins at 724-850-5612.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 11, 2017

Report No.: AAC1126

Project: CCR Event

Client ID: DGWC-67

Lab Number ID: AAC1126-01

Date/Time Sampled: 3/31/2017 10:50:00AM

Date/Time Received: 3/31/2017 5:25:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	270	25	10	mg/L	SM 2540 C		1	04/05/17 16:45	04/05/17 16:45	7040108	JPT
Inorganic Anions											
Chloride	5.7	0.25	0.01	mg/L	EPA 300.0		1	04/05/17 19:04	04/07/17 06:11	7040128	RLC
Fluoride	0.02	0.30	0.004	mg/L	EPA 300.0	J	1	04/05/17 19:04	04/07/17 06:11	7040128	RLC
Sulfate	110	20	1.8	mg/L	EPA 300.0		20	04/05/17 19:04	04/08/17 17:51	7040128	RLC
Metals, Total											
Antimony	0.0004	0.0030	0.0003	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 19:20	7040031	CSW
Arsenic	ND	0.0050	0.0004	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:20	7040031	CSW
Barium	0.111	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:20	7040031	CSW
Beryllium	ND	0.0030	0.00007	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:20	7040031	CSW
Boron	2.91	0.0400	0.0060	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:20	7040031	CSW
Cadmium	ND	0.0010	0.00006	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:20	7040031	CSW
Calcium	39.9	25.0	0.522	mg/L	EPA 6020B		50	04/04/17 09:00	04/07/17 19:26	7040031	CSW
Chromium	0.0005	0.0100	0.0003	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 19:20	7040031	CSW
Cobalt	0.0064	0.0100	0.0005	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 19:20	7040031	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:20	7040031	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:20	7040031	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:20	7040031	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:20	7040031	CSW
Lithium	0.0052	0.0500	0.0011	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 19:20	7040031	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	04/05/17 12:35	04/05/17 19:11	7040088	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 11, 2017

Report No.: AAC1126

Project: CCR Event

Client ID: DGWC-69

Lab Number ID: AAC1126-02

Date/Time Sampled: 3/31/2017 1:10:00PM

Date/Time Received: 3/31/2017 5:25:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	138	25	10	mg/L	SM 2540 C		1	04/05/17 16:45	04/05/17 16:45	7040108	JPT
Inorganic Anions											
Chloride	4.4	0.25	0.01	mg/L	EPA 300.0		1	04/05/17 19:04	04/07/17 06:33	7040128	RLC
Fluoride	0.16	0.30	0.004	mg/L	EPA 300.0	J	1	04/05/17 19:04	04/07/17 06:33	7040128	RLC
Sulfate	21	1.0	0.09	mg/L	EPA 300.0		1	04/05/17 19:04	04/07/17 06:33	7040128	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:31	7040031	CSW
Arsenic	0.0239	0.0050	0.0004	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:31	7040031	CSW
Barium	0.0872	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:31	7040031	CSW
Beryllium	0.00007	0.0030	0.00007	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 19:31	7040031	CSW
Boron	0.407	0.0400	0.0060	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:31	7040031	CSW
Cadmium	0.0001	0.0010	0.00006	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 19:31	7040031	CSW
Calcium	18.6	25.0	0.522	mg/L	EPA 6020B	J	50	04/04/17 09:00	04/07/17 19:37	7040031	CSW
Chromium	ND	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:31	7040031	CSW
Cobalt	0.0022	0.0100	0.0005	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 19:31	7040031	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:31	7040031	CSW
Molybdenum	0.0124	0.0100	0.0006	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:31	7040031	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:31	7040031	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:31	7040031	CSW
Lithium	0.0031	0.0500	0.0011	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 19:31	7040031	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	04/05/17 12:35	04/05/17 19:13	7040088	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 11, 2017

Report No.: AAC1126

Project: CCR Event

Client ID: EB-3

Lab Number ID: AAC1126-03

Date/Time Sampled: 3/31/2017 2:35:00PM

Date/Time Received: 3/31/2017 5:25:00PM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C		1	04/05/17 16:45	04/05/17 16:45	7040108	JPT
Inorganic Anions											
Chloride	0.07	0.25	0.01	mg/L	EPA 300.0	J	1	04/05/17 19:04	04/07/17 06:54	7040128	RLC
Fluoride	ND	0.30	0.004	mg/L	EPA 300.0		1	04/05/17 19:04	04/07/17 06:54	7040128	RLC
Sulfate	ND	1.0	0.09	mg/L	EPA 300.0		1	04/05/17 19:04	04/07/17 06:54	7040128	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:54	7040031	CSW
Arsenic	ND	0.0050	0.0004	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:54	7040031	CSW
Barium	0.0013	0.0100	0.0003	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 19:54	7040031	CSW
Beryllium	ND	0.0030	0.00007	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:54	7040031	CSW
Boron	ND	0.0400	0.0060	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:54	7040031	CSW
Cadmium	ND	0.0010	0.00006	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:54	7040031	CSW
Calcium	ND	0.500	0.0104	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:54	7040031	CSW
Chromium	ND	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:54	7040031	CSW
Cobalt	ND	0.0100	0.0005	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:54	7040031	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:54	7040031	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:54	7040031	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:54	7040031	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:54	7040031	CSW
Lithium	ND	0.0500	0.0011	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 19:54	7040031	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	04/05/17 12:35	04/05/17 19:15	7040088	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 11, 2017

Report No.: AAC1126

Project: CCR Event

Client ID: DGWC-68

Lab Number ID: AAC1126-04

Date/Time Sampled: 3/31/2017 1:00:00PM

Date/Time Received: 3/31/2017 5:25:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	288	25	10	mg/L	SM 2540 C		1	04/05/17 16:45	04/05/17 16:45	7040108	JPT
Inorganic Anions											
Chloride	3.8	0.25	0.01	mg/L	EPA 300.0		1	04/05/17 19:04	04/07/17 07:16	7040128	RLC
Fluoride	0.54	0.30	0.004	mg/L	EPA 300.0		1	04/05/17 19:04	04/07/17 07:16	7040128	RLC
Sulfate	38	1.0	0.09	mg/L	EPA 300.0		1	04/05/17 19:04	04/07/17 07:16	7040128	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:00	7040031	CSW
Arsenic	0.488	0.0050	0.0004	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:00	7040031	CSW
Barium	0.0796	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:00	7040031	CSW
Beryllium	ND	0.0030	0.00007	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:00	7040031	CSW
Boron	1.25	0.0400	0.0060	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:00	7040031	CSW
Cadmium	ND	0.0010	0.00006	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:00	7040031	CSW
Calcium	48.2	25.0	0.522	mg/L	EPA 6020B		50	04/04/17 09:00	04/07/17 15:13	7040031	CSW
Chromium	ND	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:00	7040031	CSW
Cobalt	0.0025	0.0100	0.0005	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 20:00	7040031	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:00	7040031	CSW
Molybdenum	0.175	0.0100	0.0006	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:00	7040031	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:00	7040031	CSW
Thallium	0.00008	0.0010	0.00005	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 20:00	7040031	CSW
Lithium	0.0016	0.0500	0.0011	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 20:00	7040031	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	04/05/17 12:35	04/05/17 19:18	7040088	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 11, 2017

Report No.: AAC1126

Project: CCR Event

Client ID: DGWC-42

Lab Number ID: AAC1126-05

Date/Time Sampled: 3/31/2017 2:15:00PM

Date/Time Received: 3/31/2017 5:25:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	661	25	10	mg/L	SM 2540 C		1	04/05/17 16:45	04/05/17 16:45	7040108	JPT
Inorganic Anions											
Chloride	33	0.25	0.01	mg/L	EPA 300.0		1	04/05/17 19:04	04/07/17 07:38	7040128	RLC
Fluoride	ND	0.30	0.004	mg/L	EPA 300.0		1	04/05/17 19:04	04/07/17 07:38	7040128	RLC
Sulfate	380	10	0.92	mg/L	EPA 300.0		10	04/05/17 19:04	04/08/17 18:11	7040128	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:06	7040031	CSW
Arsenic	0.0007	0.0050	0.0004	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 20:06	7040031	CSW
Barium	0.0194	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:06	7040031	CSW
Beryllium	0.0025	0.0030	0.00007	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 20:06	7040031	CSW
Boron	0.989	0.0400	0.0060	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:06	7040031	CSW
Cadmium	0.0009	0.0010	0.00006	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 20:06	7040031	CSW
Calcium	48.3	25.0	0.522	mg/L	EPA 6020B		50	04/04/17 09:00	04/07/17 20:11	7040031	CSW
Chromium	0.0010	0.0100	0.0003	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 20:06	7040031	CSW
Cobalt	0.0524	0.0100	0.0005	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:06	7040031	CSW
Lead	0.0004	0.0050	0.00007	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 20:06	7040031	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:06	7040031	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:06	7040031	CSW
Thallium	0.00009	0.0010	0.00005	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 20:06	7040031	CSW
Lithium	0.0119	0.0500	0.0011	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 20:06	7040031	CSW
Mercury	0.00004	0.00050	0.000041	mg/L	EPA 7470A	J	1	04/05/17 12:35	04/05/17 19:20	7040088	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 11, 2017

Report No.: AAC1126

Project: CCR Event

Client ID: DGWC-47

Lab Number ID: AAC1126-06

Date/Time Sampled: 3/31/2017 12:20:00PM

Date/Time Received: 3/31/2017 5:25:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	545	25	10	mg/L	SM 2540 C		1	04/05/17 16:45	04/05/17 16:45	7040108	JPT
Inorganic Anions											
Chloride	9.1	0.25	0.01	mg/L	EPA 300.0		1	04/05/17 19:04	04/07/17 08:43	7040128	RLC
Fluoride	0.88	0.30	0.004	mg/L	EPA 300.0		1	04/05/17 19:04	04/07/17 08:43	7040128	RLC
Sulfate	350	10	0.92	mg/L	EPA 300.0		10	04/05/17 19:04	04/08/17 18:32	7040128	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:17	7040031	CSW
Arsenic	0.0031	0.0050	0.0004	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 20:17	7040031	CSW
Barium	0.0189	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:17	7040031	CSW
Beryllium	0.0112	0.0030	0.00007	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:17	7040031	CSW
Boron	0.312	0.0400	0.0060	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:17	7040031	CSW
Cadmium	0.0020	0.0010	0.00006	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:17	7040031	CSW
Calcium	62.6	25.0	0.522	mg/L	EPA 6020B		50	04/04/17 09:00	04/07/17 20:23	7040031	CSW
Chromium	0.0007	0.0100	0.0003	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 20:17	7040031	CSW
Cobalt	0.354	0.0100	0.0005	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:17	7040031	CSW
Lead	0.0009	0.0050	0.00007	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 20:17	7040031	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:17	7040031	CSW
Selenium	0.0133	0.0100	0.0014	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:17	7040031	CSW
Thallium	0.0002	0.0010	0.00005	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 20:17	7040031	CSW
Lithium	0.0767	0.0500	0.0011	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:17	7040031	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	04/05/17 12:35	04/05/17 19:23	7040088	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 11, 2017

Report No.: AAC1126

Project: CCR Event

Client ID: FD-3

Lab Number ID: AAC1126-07

Date/Time Sampled: 3/31/2017 12:00:00AM

Date/Time Received: 3/31/2017 5:25:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	543	25	10	mg/L	SM 2540 C		1	04/05/17 16:45	04/05/17 16:45	7040108	JPT
Inorganic Anions											
Chloride	9.1	0.25	0.01	mg/L	EPA 300.0		1	04/05/17 19:04	04/07/17 09:05	7040128	RLC
Fluoride	0.85	0.30	0.004	mg/L	EPA 300.0		1	04/05/17 19:04	04/07/17 09:05	7040128	RLC
Sulfate	440	10	0.92	mg/L	EPA 300.0		10	04/05/17 19:04	04/08/17 18:52	7040128	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:29	7040031	CSW
Arsenic	0.0027	0.0050	0.0004	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 20:29	7040031	CSW
Barium	0.0186	0.0100	0.0003	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:29	7040031	CSW
Beryllium	0.0108	0.0030	0.00007	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:29	7040031	CSW
Boron	0.292	0.0400	0.0060	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:29	7040031	CSW
Cadmium	0.0019	0.0010	0.00006	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:29	7040031	CSW
Calcium	60.3	25.0	0.522	mg/L	EPA 6020B		50	04/04/17 09:00	04/07/17 20:34	7040031	CSW
Chromium	0.0004	0.0100	0.0003	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 20:29	7040031	CSW
Cobalt	0.358	0.0100	0.0005	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:29	7040031	CSW
Lead	0.0009	0.0050	0.00007	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 20:29	7040031	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:29	7040031	CSW
Selenium	0.0156	0.0100	0.0014	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:29	7040031	CSW
Thallium	0.0002	0.0010	0.00005	mg/L	EPA 6020B	J	1	04/04/17 09:00	04/07/17 20:29	7040031	CSW
Lithium	0.0716	0.0500	0.0011	mg/L	EPA 6020B		1	04/04/17 09:00	04/07/17 20:29	7040031	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	04/05/17 12:35	04/05/17 19:25	7040088	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 11, 2017

Report No.: AAC1126

General Chemistry - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7040108 - SM 2540 C											
Blank (7040108-BLK1)						Prepared & Analyzed: 04/05/17					
Total Dissolved Solids	ND	25	10	mg/L							
LCS (7040108-BS1)						Prepared & Analyzed: 04/05/17					
Total Dissolved Solids	373	25	10	mg/L	400.00		93	84-108			
Duplicate (7040108-DUP1)			Source: AAC1126-02			Prepared & Analyzed: 04/05/17					
Total Dissolved Solids	141	25	10	mg/L		138			2	10	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 11, 2017

Report No.: AAC1126

Inorganic Anions - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7040128 - EPA 300.0											
Blank (7040128-BLK1)						Prepared: 04/05/17 Analyzed: 04/07/17					
Chloride	ND	0.25	0.01	mg/L							
Fluoride	ND	0.30	0.004	mg/L							
Sulfate	ND	1.0	0.09	mg/L							
LCS (7040128-BS1)						Prepared: 04/05/17 Analyzed: 04/07/17					
Chloride	10.5	0.25	0.01	mg/L	10.010		105	90-110			
Fluoride	10.8	0.30	0.004	mg/L	10.020		108	90-110			
Sulfate	10.6	1.0	0.09	mg/L	10.020		105	90-110			
Matrix Spike (7040128-MS1)						Source: AAC1126-05 Prepared: 04/05/17 Analyzed: 04/07/17					
Chloride	39.6	0.25	0.01	mg/L	10.010	32.9	67	90-110			QM-02
Fluoride	10.8	0.30	0.004	mg/L	10.020	ND	108	90-110			
Sulfate	247	1.0	0.09	mg/L	10.020	261	NR	90-110			QM-02
Matrix Spike (7040128-MS2)						Source: AAD0072-05 Prepared: 04/05/17 Analyzed: 04/07/17					
Chloride	11.2	0.25	0.01	mg/L	10.010	0.93	103	90-110			
Fluoride	10.7	0.30	0.004	mg/L	10.020	ND	107	90-110			
Sulfate	11.7	1.0	0.09	mg/L	10.020	1.47	102	90-110			
Matrix Spike Dup (7040128-MSD1)						Source: AAC1126-05 Prepared: 04/05/17 Analyzed: 04/07/17					
Chloride	39.1	0.25	0.01	mg/L	10.010	32.9	62	90-110	1	15	QM-02
Fluoride	10.6	0.30	0.004	mg/L	10.020	ND	106	90-110	2	15	
Sulfate	245	1.0	0.09	mg/L	10.020	261	NR	90-110	1	15	QM-02



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 11, 2017

Report No.: AAC1126

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7040031 - EPA 3005A											
Blank (7040031-BLK1)											
						Prepared: 04/04/17 Analyzed: 04/07/17					
Antimony	ND	0.0030	0.0003	mg/L							
Arsenic	ND	0.0050	0.0004	mg/L							
Barium	ND	0.0100	0.0003	mg/L							
Beryllium	ND	0.0030	0.00007	mg/L							
Boron	ND	0.0400	0.0060	mg/L							
Cadmium	ND	0.0010	0.00006	mg/L							
Calcium	ND	0.500	0.0104	mg/L							
Chromium	ND	0.0100	0.0003	mg/L							
Cobalt	ND	0.0100	0.0005	mg/L							
Copper	ND	0.0250	0.0003	mg/L							
Lead	ND	0.0050	0.00007	mg/L							
Molybdenum	ND	0.0100	0.0006	mg/L							
Nickel	ND	0.0100	0.0003	mg/L							
Selenium	ND	0.0100	0.0014	mg/L							
Silver	ND	0.0100	0.0003	mg/L							
Thallium	ND	0.0010	0.00005	mg/L							
Vanadium	ND	0.0100	0.0014	mg/L							
Zinc	ND	0.0100	0.0013	mg/L							
Lithium	ND	0.0500	0.0011	mg/L							
LCS (7040031-BS1)											
						Prepared: 04/04/17 Analyzed: 04/07/17					
Antimony	0.108	0.0030	0.0003	mg/L	0.10000		108	80-120			
Arsenic	0.105	0.0050	0.0004	mg/L	0.10000		105	80-120			
Barium	0.0992	0.0100	0.0003	mg/L	0.10000		99	80-120			
Beryllium	0.105	0.0030	0.00007	mg/L	0.10000		105	80-120			
Boron	1.03	0.0400	0.0060	mg/L	1.0000		103	80-120			
Cadmium	0.102	0.0010	0.00006	mg/L	0.10000		102	80-120			
Calcium	0.979	0.500	0.0104	mg/L	1.0000		98	80-120			
Chromium	0.113	0.0100	0.0003	mg/L	0.10000		113	80-120			
Cobalt	0.105	0.0100	0.0005	mg/L	0.10000		105	80-120			
Copper	0.105	0.0250	0.0003	mg/L	0.10000		105	80-120			
Lead	0.104	0.0050	0.00007	mg/L	0.10000		104	80-120			
Molybdenum	0.103	0.0100	0.0006	mg/L	0.10000		103	80-120			
Nickel	0.111	0.0100	0.0003	mg/L	0.10000		111	80-120			
Selenium	0.106	0.0100	0.0014	mg/L	0.10000		106	80-120			
Silver	0.101	0.0100	0.0003	mg/L	0.10000		101	80-120			
Thallium	0.106	0.0010	0.00005	mg/L	0.10000		106	80-120			
Vanadium	0.107	0.0100	0.0014	mg/L	0.10000		107	80-120			
Zinc	0.103	0.0100	0.0013	mg/L	0.10000		103	80-120			
Lithium	0.104	0.0500	0.0011	mg/L	0.10000		104	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 11, 2017

Report No.: AAC1126

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7040031 - EPA 3005A											
Matrix Spike (7040031-MS1)			Source: AAC1126-04				Prepared: 04/04/17 Analyzed: 04/07/17				
Antimony	0.102	0.0030	0.0003	mg/L	0.10000	ND	102	75-125			
Arsenic	0.604	0.0050	0.0004	mg/L	0.10000	0.488	116	75-125			
Barium	0.181	0.0100	0.0003	mg/L	0.10000	0.0796	101	75-125			
Beryllium	0.0926	0.0030	0.00007	mg/L	0.10000	ND	93	75-125			
Boron	2.72	2.00	0.302	mg/L	1.0000	1.25	147	75-125			QM-02
Cadmium	0.102	0.0010	0.00006	mg/L	0.10000	ND	102	75-125			
Calcium	48.8	25.0	0.522	mg/L	1.0000	48.2	52	75-125			QM-02
Chromium	0.106	0.0100	0.0003	mg/L	0.10000	ND	106	75-125			
Cobalt	0.100	0.0100	0.0005	mg/L	0.10000	0.0025	98	75-125			
Copper	0.101	0.0250	0.0003	mg/L	0.10000	0.0003	101	75-125			
Lead	0.0973	0.0050	0.00007	mg/L	0.10000	ND	97	75-125			
Molybdenum	0.270	0.0100	0.0006	mg/L	0.10000	0.175	94	75-125			
Nickel	0.102	0.0100	0.0003	mg/L	0.10000	0.0013	100	75-125			
Selenium	0.102	0.0100	0.0014	mg/L	0.10000	ND	102	75-125			
Silver	0.0981	0.0100	0.0003	mg/L	0.10000	ND	98	75-125			
Thallium	0.101	0.0010	0.00005	mg/L	0.10000	0.00008	101	75-125			
Vanadium	0.107	0.0100	0.0014	mg/L	0.10000	ND	107	75-125			
Zinc	0.103	0.0100	0.0013	mg/L	0.10000	0.0019	101	75-125			
Lithium	0.0940	0.0500	0.0011	mg/L	0.10000	0.0016	92	75-125			
Matrix Spike Dup (7040031-MSD1)			Source: AAC1126-04				Prepared: 04/04/17 Analyzed: 04/07/17				
Antimony	0.110	0.0030	0.0003	mg/L	0.10000	ND	110	75-125	8	20	
Arsenic	0.593	0.0050	0.0004	mg/L	0.10000	0.488	104	75-125	2	20	
Barium	0.201	0.0100	0.0003	mg/L	0.10000	0.0796	122	75-125	11	20	
Beryllium	0.0948	0.0030	0.00007	mg/L	0.10000	ND	95	75-125	2	20	
Boron	2.67	2.00	0.302	mg/L	1.0000	1.25	142	75-125	2	20	QM-02
Cadmium	0.103	0.0010	0.00006	mg/L	0.10000	ND	103	75-125	1	20	
Calcium	45.8	25.0	0.522	mg/L	1.0000	48.2	NR	75-125	6	20	QM-02
Chromium	0.109	0.0100	0.0003	mg/L	0.10000	ND	109	75-125	2	20	
Cobalt	0.109	0.0100	0.0005	mg/L	0.10000	0.0025	107	75-125	8	20	
Copper	0.102	0.0250	0.0003	mg/L	0.10000	0.0003	102	75-125	1	20	
Lead	0.0984	0.0050	0.00007	mg/L	0.10000	ND	98	75-125	1	20	
Molybdenum	0.277	0.0100	0.0006	mg/L	0.10000	0.175	102	75-125	3	20	
Nickel	0.109	0.0100	0.0003	mg/L	0.10000	0.0013	108	75-125	7	20	
Selenium	0.103	0.0100	0.0014	mg/L	0.10000	ND	103	75-125	1	20	
Silver	0.100	0.0100	0.0003	mg/L	0.10000	ND	100	75-125	2	20	
Thallium	0.103	0.0010	0.00005	mg/L	0.10000	0.00008	103	75-125	2	20	
Vanadium	0.108	0.0100	0.0014	mg/L	0.10000	ND	108	75-125	1	20	
Zinc	0.102	0.0100	0.0013	mg/L	0.10000	0.0019	100	75-125	1	20	
Lithium	0.0967	0.0500	0.0011	mg/L	0.10000	0.0016	95	75-125	3	20	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 11, 2017

Report No.: AAC1126

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7040031 - EPA 3005A											
Post Spike (7040031-PS1)			Source: AAC1126-04			Prepared: 04/04/17 Analyzed: 04/07/17					
Antimony	98.0			ug/L	100.00	0.189	98	80-120			
Arsenic	597			ug/L	100.00	488	109	80-120			
Barium	177			ug/L	100.00	79.6	98	80-120			
Beryllium	85.9			ug/L	100.00	0.0481	86	80-120			
Boron	2540			ug/L	1000.0	1250	129	80-120			QM-02
Cadmium	105			ug/L	100.00	0.0466	105	80-120			
Calcium	47000			ug/L	1000.0	48200	NR	80-120			QM-02
Chromium	106			ug/L	100.00	0.313	106	80-120			
Cobalt	104			ug/L	100.00	2.51	102	80-120			
Copper	102			ug/L	100.00	0.299	101	80-120			
Lead	93.5			ug/L	100.00	0.0608	93	80-120			
Molybdenum	267			ug/L	100.00	175	92	80-120			
Nickel	104			ug/L	100.00	1.29	103	80-120			
Selenium	107			ug/L	100.00	-0.240	107	80-120			
Silver	92.1			ug/L	100.00	0.0070	92	80-120			
Thallium	96.9			ug/L	100.00	0.0796	97	80-120			
Vanadium	104			ug/L	100.00	0.0819	104	80-120			
Zinc	103			ug/L	100.00	1.90	101	80-120			
Lithium	86.7			ug/L	100.00	1.65	85	80-120			

Batch 7040088 - EPA 7470A

Blank (7040088-BLK1)				Prepared & Analyzed: 04/05/17							
Mercury	ND	0.00050	0.000041	mg/L							
LCS (7040088-BS1)				Prepared & Analyzed: 04/05/17							
Mercury	0.00256	0.00050	0.000041	mg/L	2.5000E-3		102	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 11, 2017

Report No.: AAC1126

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7040088 - EPA 7470A											
Duplicate (7040088-DUP1)			Source: AAC1108-03			Prepared & Analyzed: 04/05/17					
Mercury	ND	0.00050	0.000041	mg/L		ND				20	
Matrix Spike (7040088-MS1)			Source: AAC1126-01			Prepared & Analyzed: 04/05/17					
Mercury	0.00249	0.00050	0.000041	mg/L	2.5000E-3	ND	99	75-125			
Matrix Spike Dup (7040088-MSD1)			Source: AAC1126-01			Prepared & Analyzed: 04/05/17					
Mercury	0.00251	0.00050	0.000041	mg/L	2.5000E-3	ND	101	75-125	1	20	
Post Spike (7040088-PS1)			Source: AAC1126-01			Prepared & Analyzed: 04/05/17					
Mercury	1.72			ug/L	1.6667	0.0220	102	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 11, 2017

Legend

Definition of Laboratory Terms

- ND** - Not Detected at levels equal to or greater than the MDL
BRL - Not Detected at levels equal to or greater than the RL
RL - Reporting Limit **MDL** - Method Detection Limit
SOP - Method run per Pace Standard Operating Procedure
CFU - Colony Forming Units
DF - Dilution Factor **TIC** - Tentatively Identified Compound

Sample Information

N-Nitrosodiphenylamine breaks down to diphenylamine in the GCMS; both analytes are reported as N-Nitrosodiphenylamine. Pace is not NELAC certified for N-Nitrosodiphenylamine.

Phthalic acid and phthalic anhydride are reported as dimethyl phthalate

Maleic acid and maleic anhydride are reported as dimethyl malate

1,2-Diphenylhydrazine breaks down to azobenzene in the GCMS; both analytes are reported as azobenzene

Definition of Qualifiers

QM-02 The spike recovery is outside acceptance limits due to insignificant spike amount as compared to sample concentration.

J Estimated value less than Reporting Limit (RL) but greater than Method Detection Limit(MDL) (CLP J-Flag).

Note: Unless otherwise noted, all results are reported on an as received basis.



Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

PAGE: 1 OF 4

CHAIN OF CUSTODY RECORD

CLIENT NAME: Georgia Power
CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER:
 241 Ralph McGill Blvd SE 810185
 Atlanta, GA 30308
 404-506-7238
REPORT TO: Dawn Prell (Dawn_Prell@golder.com)
CC: Maria Padilla (kiurinko@golder.com)
REQUESTED COMPLETION DATE: laburch@southernco.com

PROJECT NAME/STATE: Plant McDonough AP
PROJECT #: Phase II CCR

Collection DATE	Collection TIME	MATRIX CODE*	C O M P O S I T I O N				SAMPLE IDENTIFICATION
			G	R	A	B	
03/31/17	1050	GW	X			DGWC-67	
03/31/17	1310	GW	X			DGWC-69	
03/31/17	1435	W	X			EB-3	
03/31/17	1300	GW	X			DGWC-68	
03/31/17	1415	GW	X			DGWC-42	
03/31/17	1220	GW	X			DGWC-47	
03/31/17	--	GW	X			FD-3	

SAMPLED BY AND TITLE: Ben Hodges, Field Lead
RECEIVED BY:

RECEIVED BY LAB: M. Adamson
DATE/TIME: 3/31/17 17:00
TEMPERATURE: 21 Min, 36 Max
NO. OF CONTAINERS: 7
NO. OF SAMPLES: 36

LAB #	ANALYSIS REQUESTED	CONTAINER TYPE	PRESERVATION	CONTAINERS				DATE/TIME	RELINQUISHED BY
				P	P	P	P		
1	Metals App. III & IV (EPA 6020/7470)	3		6	1	1	4		3/31/17 17:25
2	Cl, F, SO ₄ & TDS (EPA 300.0 & SM 2540C)	7		4	1	1	2		
3	Radium 226 & 228 (SW-846 9316/9320)	3		4	1	1	2		
4				4	1	1	2		
5				4	1	1	2		
6				4	1	1	2		
7				4	1	1	2		

CONTAINER TYPE:
 P - PLASTIC
 A - AMBER GLASS
 G - CLEAR GLASS
 V - VOA VIAL
 S - STERILE
 O - OTHER

PRESERVATION:
 1 - HCl, 56°C
 2 - H₂SO₄, 56°C
 3 - HNO₃
 4 - NaOH, 56°C
 5 - NaOH/ZnAc, 56°C
 6 - Na₂S₂O₃, 56°C
 7 - 56°C not frozen

MATRIX CODES:
 DW - DRINKING WATER S - SOIL
 WW - WASTEWATER SL - SLUDGE
 GW - GROUNDWATER SD - SOLID
 SW - SURFACE WATER A - AIR
 ST - STORM WATER L - LIQUID
 W - WATER P - PRODUCT

REMARKS/ADDITIONAL INFORMATION:
 Extra Radium

FOR LAB USE ONLY:
 LAB # AAC 1126
 Entered into LIMS: MA
 Tracking #:

RELINQUISHED BY: [Signature]
DATE/TIME: 3/31/17 17:25
CLIENT: OTHER FS
OTHER: FS
DATE/TIME: 3/31/17 17:25
RELINQUISHED BY: [Signature]
DATE/TIME: 3/31/17 17:00
FIELD LEAD: Ben Hodges
LAB: M. Adamson
DATE/TIME: 3/31/17 17:25
TEMPERATURE: 21 Min, 36 Max
NO. OF CONTAINERS: 7
NO. OF SAMPLES: 36

March 31 Plant McDonough COC Phase II CCR.xlsx



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

LOG-IN CHECKLIST

Printed: 4/3/2017 10:16:05AM

Attn: Mr. Joju Abraham

Client: Georgia Power

Project: CCR Event

Date Received: 03/31/17 17:25

Work Order: AAC1126

Logged In By: Mohammad M. Rahman

OBSERVATIONS

#Samples: 7

#Containers: 30

Minimum Temp(C): 3.0

Maximum Temp(C): 3.0

Custody Seal(s) Used: N/A

CHECKLIST ITEMS

- COC included with Samples YES
- Sample Container(s) Intact YES
- Chain of Custody Complete YES
- Sample Container(s) Match COC YES
- Custody seal Intact NO
- Temperature in Compliance YES
- Sufficient Sample Volume for Analysis YES
- Zero Headspace Maintained for VOA Analyses YES
- Samples labeled preserved (If Applicable) YES
- Samples received within Allowable Hold Times YES
- Samples Received on Ice YES
- Preservation Confirmed YES

Comments:

April 26, 2017

Maria Padilla
GA Power
2480 Maner Rd
Atlanta, GA 30339

RE: Project: AAC1126 Plant McDonough
Pace Project No.: 30215074

Dear Maria Padilla:

Enclosed are the analytical results for sample(s) received by the laboratory on April 04, 2017. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Jacquelyn Collins
jacquelyn.collins@pacelabs.com
(724)850-5612
Project Manager

Enclosures



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: AAC1126 Plant McDonough
Pace Project No.: 30215074

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601
L-A-B DOD-ELAP Accreditation #: L2417
Alabama Certification #: 41590
Arizona Certification #: AZ0734
Arkansas Certification
California Certification #: 04222CA
Colorado Certification
Connecticut Certification #: PH-0694
Delaware Certification
Florida/TNI Certification #: E87683
Georgia Certification #: C040
Guam Certification
Hawaii Certification
Idaho Certification
Illinois Certification
Indiana Certification
Iowa Certification #: 391
Kansas/TNI Certification #: E-10358
Kentucky Certification #: 90133
Louisiana DHH/TNI Certification #: LA140008
Louisiana DEQ/TNI Certification #: 4086
Maine Certification #: PA00091
Maryland Certification #: 308
Massachusetts Certification #: M-PA1457
Michigan/PADEP Certification
Missouri Certification #: 235

Montana Certification #: Cert 0082
Nebraska Certification #: NE-05-29-14
Nevada Certification #: PA014572015-1
New Hampshire/TNI Certification #: 2976
New Jersey/TNI Certification #: PA 051
New Mexico Certification #: PA01457
New York/TNI Certification #: 10888
North Carolina Certification #: 42706
North Dakota Certification #: R-190
Oregon/TNI Certification #: PA200002
Pennsylvania/TNI Certification #: 65-00282
Puerto Rico Certification #: PA01457
Rhode Island Certification #: 65-00282
South Dakota Certification
Tennessee Certification #: TN2867
Texas/TNI Certification #: T104704188-14-8
Utah/TNI Certification #: PA014572015-5
USDA Soil Permit #: P330-14-00213
Vermont Dept. of Health: ID# VT-0282
Virgin Island/PADEP Certification
Virginia/VELAP Certification #: 460198
Washington Certification #: C868
West Virginia DEP Certification #: 143
West Virginia DHHR Certification #: 9964C
Wisconsin Certification
Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: AAC1126 Plant McDonough

Pace Project No.: 30215074

Lab ID	Sample ID	Matrix	Date Collected	Date Received
30215074001	DGWC-67	Water	03/31/17 10:50	04/04/17 09:45
30215074002	DGWC-69	Water	03/31/17 13:10	04/04/17 09:45
30215074003	EB-3	Water	03/31/17 14:35	04/04/17 09:45
30215074004	DGWC-68	Water	03/31/17 13:00	04/04/17 09:45
30215074005	DGWC-42	Water	03/31/17 14:15	04/04/17 09:45
30215074006	DGWC-47	Water	03/31/17 12:20	04/04/17 09:45
30215074007	FD-3	Water	03/31/17 00:00	04/04/17 09:45

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: AAC1126 Plant McDonough
Pace Project No.: 30215074

Lab ID	Sample ID	Method	Analysts	Analytes Reported
30215074001	DGWC-67	EPA 9315	JC2	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30215074002	DGWC-69	EPA 9315	JC2	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30215074003	EB-3	EPA 9315	JC2	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30215074004	DGWC-68	EPA 9315	JC2	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30215074005	DGWC-42	EPA 9315	JC2	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30215074006	DGWC-47	EPA 9315	JC2	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30215074007	FD-3	EPA 9315	JC2	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAC1126 Plant McDonough
Pace Project No.: 30215074

Sample: DGWC-67		Lab ID: 30215074001	Collected: 03/31/17 10:50	Received: 04/04/17 09:45	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.0392 ± 0.112 (0.271) C:80% T:NA	pCi/L	04/19/17 08:35	13982-63-3	
Radium-228	EPA 9320	0.365 ± 0.329 (0.662) C:82% T:80%	pCi/L	04/21/17 12:50	15262-20-1	
Total Radium	Total Radium Calculation	0.404 ± 0.441 (0.933)	pCi/L	04/26/17 12:10	7440-14-4	

Sample: DGWC-69		Lab ID: 30215074002	Collected: 03/31/17 13:10	Received: 04/04/17 09:45	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.847 ± 0.264 (0.268) C:84% T:NA	pCi/L	04/19/17 08:35	13982-63-3	
Radium-228	EPA 9320	0.539 ± 0.443 (0.886) C:85% T:70%	pCi/L	04/21/17 12:51	15262-20-1	
Total Radium	Total Radium Calculation	1.39 ± 0.707 (1.15)	pCi/L	04/26/17 12:10	7440-14-4	

Sample: EB-3		Lab ID: 30215074003	Collected: 03/31/17 14:35	Received: 04/04/17 09:45	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.0291 ± 0.0546 (0.124) C:89% T:NA	pCi/L	04/20/17 10:43	13982-63-3	
Radium-228	EPA 9320	0.273 ± 0.425 (0.919) C:81% T:73%	pCi/L	04/21/17 12:51	15262-20-1	
Total Radium	Total Radium Calculation	0.302 ± 0.480 (1.04)	pCi/L	04/26/17 12:10	7440-14-4	

Sample: DGWC-68		Lab ID: 30215074004	Collected: 03/31/17 13:00	Received: 04/04/17 09:45	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.342 ± 0.153 (0.158) C:74% T:NA	pCi/L	04/20/17 10:43	13982-63-3	
Radium-228	EPA 9320	0.0162 ± 0.296 (0.687) C:81% T:91%	pCi/L	04/21/17 12:51	15262-20-1	
Total Radium	Total Radium Calculation	0.358 ± 0.449 (0.845)	pCi/L	04/26/17 12:10	7440-14-4	

Sample: DGWC-42		Lab ID: 30215074005	Collected: 03/31/17 14:15	Received: 04/04/17 09:45	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.102 ± 0.0850 (0.147) C:94% T:NA	pCi/L	04/20/17 10:43	13982-63-3	
Radium-228	EPA 9320	-0.109 ± 0.329 (0.796) C:80% T:84%	pCi/L	04/21/17 12:52	15262-20-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAC1126 Plant McDonough

Pace Project No.: 30215074

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Total Radium	Total Radium Calculation	0.102 ± 0.414 (0.943)	pCi/L	04/26/17 12:10	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.410 ± 0.159 (0.162) C:93% T:NA	pCi/L	04/20/17 10:43	13982-63-3	
Radium-228	EPA 9320	0.729 ± 0.408 (0.736) C:83% T:82%	pCi/L	04/21/17 12:52	15262-20-1	
Total Radium	Total Radium Calculation	1.14 ± 0.567 (0.898)	pCi/L	04/26/17 12:10	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.395 ± 0.161 (0.175) C:87% T:NA	pCi/L	04/20/17 10:43	13982-63-3	
Radium-228	EPA 9320	1.20 ± 0.509 (0.832) C:79% T:83%	pCi/L	04/21/17 12:52	15262-20-1	
Total Radium	Total Radium Calculation	1.60 ± 0.670 (1.01)	pCi/L	04/26/17 12:10	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAC1126 Plant McDonough

Pace Project No.: 30215074

QC Batch:	254962	Analysis Method:	EPA 9315
QC Batch Method:	EPA 9315	Analysis Description:	9315 Total Radium
Associated Lab Samples:	30215074001, 30215074002, 30215074003, 30215074004, 30215074005, 30215074006, 30215074007		

METHOD BLANK:	1255467	Matrix:	Water
Associated Lab Samples:	30215074001, 30215074002, 30215074003, 30215074004, 30215074005, 30215074006, 30215074007		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.0962 ± 0.0828 (0.137) C:98% T:NA	pCi/L	04/19/17 08:34	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAC1126 Plant McDonough

Pace Project No.: 30215074

QC Batch: 255525

Analysis Method: EPA 9320

QC Batch Method: EPA 9320

Analysis Description: 9320 Radium 228

Associated Lab Samples: 30215074001, 30215074002, 30215074003, 30215074004, 30215074005, 30215074006, 30215074007

METHOD BLANK: 1258752

Matrix: Water

Associated Lab Samples: 30215074001, 30215074002, 30215074003, 30215074004, 30215074005, 30215074006, 30215074007

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.596 ± 0.409 (0.776) C:74% T:75%	pCi/L	04/21/17 12:50	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: AAC1126 Plant McDonough
Pace Project No.: 30215074

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

30215074

Chain of Custody



Workorder: AAC1126

Workorder Name: Plant McDonough

Results Requested By: 4/26/2017

Owner Received Date:

Item	Sample ID	Sample Type	Collect Date/Time	Lab ID	Matrix	Preserved Containers	Radium 226, 228, Total	LAB USE ONLY	Comments
1	DGWC-67	G	3/31/2017 10:50	AAC1126-01	GW	4	X	001	
2	DGWC-69	G	3/31/2017 13:10	AAC1126-02	GW	2	X	002	
3	EB-3	G	3/31/2017 14:35	AAC1126-03	W	2	X	003	
4	DGWC-68	G	3/31/2017 13:00	AAC1126-04	GW	2	X	004	
5	DGWC-42	G	3/31/2017 14:15	AAC1126-05	GW	2	X	005	
6	DGWC-47	G	3/31/2017 12:20	AAC1126-06	GW	2	X	006	
7	FD-3	G	3/31/2017 0:00	AAC1126-07	GW	2	X	007	
8									
9									
10									

WO#: 30215074



Preserved Containers

Date/Time 4/17/17

Received By Karen Hill

Date/Time 4/3/17

Released By Madalena

Cooler Temperature on Receipt N/A °C Custody Seal Y or N Received on Ice Y or N Sample Intact Y or N

***In order to maintain client confidentiality, location/name of the sampling site, sampler's name and signature may not be provided on this COC. This chain of custody is considered complete as is since this information is available in the owner laboratory.

30215074-

Pace Analytical Services, Inc.
110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
(770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CHAIN OF CUSTODY RECORD



CLIENT NAME: Georgia Power
 CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE 810185 Atlanta, GA 30308
 REPORT TO: Dawn Prell (Dawn_Prell@golder.com) CC: Maria Padilla
 REQUESTED COMPLETION DATE: PO #: laburchi@southernmco.com
 PROJECT NAME/STATE: Plant McDonough AP
 PROJECT #: Phase II CCR

CONTAINER TYPE	ANALYSIS REQUESTED			CONTAINER TYPE	PRESERVATION
	P	P	P		
# of	3	7	3		
CONTAINERS					
Collection DATE	Collection TIME	MATRIX CODE*	COMPARISON	SAMPLE IDENTIFICATION	REMARKS/ADDITIONAL INFORMATION
03/31/17	1050	GW	X	DGWC-67	Extra Radium
03/31/17	1310	GW	X	DGWC-69	
03/31/17	1435	W	X	EB-3	
03/31/17	1300	GW	X	DGWC-66	
03/31/17	1415	GW	X	DGWC-42	
03/31/17	1220	GW	X	DGWC-47	
03/31/17	-	GW	X	FD-3	

DATE/TIME: 3/31/17 1700
 DATE/TIME: 3/31/17 1700
 SAMPLED BY AND TITLE: Ben Hodges Field Lead
 RECEIVED BY: Ben Hodges
 DATE/TIME: 3/31/17 1725
 DATE/TIME: 3/31/17 1725
 REINQUISHED BY: [Signature]
 REINQUISHED BY: [Signature]
 SAMPLE SHIPPED VIA: UPS
 TRACKING #: [Number]
 SIGNATURE: [Signature]
 TITLE: [Title]
 DATE/TIME: 3/31/17 1725
 DATE/TIME: 3/31/17 1725
 FOR LAB USE ONLY: [Signature]
 TRACKING INTO LIMS: [Number]

March 31 Plant McDonough COC Phase II CCR.xlsx

Sample Condition Upon Receipt Pittsburgh

30215074 *3*



Client Name: Pace Atlanta Project # _____

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: 6812 5103 4016

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Thermometer Used N/A Type of Ice: Wet Blue (None)

Cooler Temperature Observed Temp N/A °C Correction Factor: N/A °C Final Temp: N/A °C

Temp should be above freezing to 6°C

Date and Initials of person examining contents: KH 4/4/17

Comments:	Yes	No	N/A	
Chain of Custody Present:	/			1.
Chain of Custody Filled Out:	/			2.
Chain of Custody Relinquished:	/			3.
Sampler Name & Signature on COC:	/			4.
Sample Labels match COC:	/			5.
-Includes date/time/ID Matrix: <u>WA</u>				
Samples Arrived within Hold Time:	/			6.
Short Hold Time Analysis (<72hr remaining):	/	/		7.
Rush Turn Around Time Requested:		/		8.
Sufficient Volume:	/			9.
Correct Containers Used:	/			10.
-Pace Containers Used:	/			
Containers Intact:	/			11.
Orthophosphate field filtered			/	12.
Organic Samples checked for dechlorination:			/	13.
Filtered volume received for Dissolved tests			/	14.
All containers have been checked for preservation.	/			15. <u>PH<2</u>
All containers needing preservation are found to be in compliance with EPA recommendation.	/			
exceptions: VOA, coliform, TOC, O&G, Phenolics				Initial when completed: <u>KH</u>
				Date/time of preservation
Headspace in VOA Vials (>6mm):			/	Lot # of added preservative
			/	
Trip Blank Present:	/			16.
Trip Blank Custody Seals Present	/			17.
Rad Aqueous Samples Screened > 0.5 mrem/hr	/			Initial when completed: <u>KH</u>
				Date: <u>4/4/17</u>

Client Notification/ Resolution:

Person Contacted: _____ Date/Time: _____ Contacted By: _____

Comments/ Resolution: _____

A check in this box indicates that additional information has been stored in ereports.

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)
 *PM review is documented electronically in LIMS. When the Project Manager closes the SRF Review schedule in LIMS. The review is in the Status section of the Workorder Edit Screen.

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: JC2
Date: 4/13/2017
Worklist: 35077
Matrix: DW

Method Blank Assessment

MB Sample ID: 1265487
MB Concentration: 0.096
MB Counting Uncertainty: 0.082
MB MDC: 0.137
MB Numerical Performance Indicator: 2.31
MB Status vs Numerical Indicator: N/A
MB Status vs. MDC: Pass

Laboratory Control Sample Assessment

LCS# (Y or N)?	N	LCS#
4/20/2017		LCS35077
Count Date:		
Spike I.D.:	17-003	
Spike Concentration (pCi/mL):	38.229	
Volume Used (mL):	0.25	
Aliquot Volume (L, g, F):	0.502	
Target Conc. (pCi/L, g, F):	19.038	
Uncertainty (Calculated):	0.896	
Result (pCi/L, g, F):	15.492	
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.839	
Numerical Performance Indicator:	-5.67	
Percent Recovery:	81.37%	
Status vs Numerical Indicator:	N/A	
Status vs Recovery:	Pass	

Duplicate Sample Assessment

Sample I.D.:	Duplicate Sample I.D.:	Enter Duplicate sample IDs if other than LCS/LCSD in the space below.
30214954002	30214954002DUP	30214954002
Duplicate Sample I.D.:	30214954002DUP	30214954002DUP
Sample Result (pCi/L, g, F):	0.318	
Sample Result Counting Uncertainty (pCi/L, g, F):	0.144	
Sample Duplicate Result (pCi/L, g, F):	0.163	
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.157	
Are sample and/or duplicate results below MDC?	See Below #	
Duplicate Numerical Performance Indicator:	1.418	
Duplicate RPD:	64.24%	
Duplicate Status vs Numerical Indicator:	N/A	
Duplicate Status vs RPD:	Fail***	

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

***Batch must be re-prepped due to unacceptable precision.

Handwritten signature: J. Wasil

Sample Matrix Spike Control Assessment

Sample Collection Date:
Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Spike I.D.:


MS/MSD Decay Corrected Spike Concentration (pCi/mL):
Spike Volume Used in MS (mL):
Spike Volume Used in MSD (mL):
MS Aliquot (L, g, F):
MS Target Conc. (pCi/L, g, F):
MSD Aliquot (L, g, F):
MSD Target Conc. (pCi/L, g, F):
Spike uncertainty (calculated):

Sample Result:
Sample Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Result:
Sample Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Sample Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
MS Numerical Performance Indicator:
MSD Numerical Performance Indicator:
MS Percent Recovery:
MSD Percent Recovery:
MS Status vs Numerical Indicator:
MSD Status vs Numerical Indicator:
MS Status vs Recovery:
MSD Status vs Recovery:

Matrix Spike/Matrix Spike Duplicate Sample Assessment

Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Sample Matrix Spike Result:
Sample Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Sample Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
Duplicate Numerical Performance Indicator:
MS/MSD Duplicate RPD:
MS/MSD Duplicate Status vs Numerical Indicator:
MS/MSD Duplicate Status vs RPD:

Quality Control Sample Performance Assessment



Analyst **Must Manually Enter All Fields Highlighted in Yellow.**

Test: Re-228
 Analyst: JLW
 Date: 4/19/2017
 Worklist: 35139
 Matrix: DW

Method Blank Assessment	
MB Sample ID	1258752
MB Concentration:	0.596
M/B Counting Uncertainty:	0.395
MB MDC:	0.776
MB Numerical Performance Indicator:	2.95
MB Status vs Numerical Indicator:	N/A
MB Status vs MDC:	Pass

Laboratory Control Sample Assessment	
LCS (Y or N)?	N
LCS35139	LCS35139
Count Date:	4/21/2017
Spike I.D.:	17-005
Spike Concentration (pCi/mL):	24.729
Volume Used (mL):	0.20
Aliquot Volume (L, g, F):	0.804
Target Conc. (pCi/L, g, F):	6.148
Uncertainty (Calculated):	0.443
Result (pCi/L, g, F):	6.590
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.804
Numerical Performance Indicator:	0.94
Percent Recovery:	107.18%
Status vs Numerical Indicator:	N/A
Status vs Recovery:	Pass

Duplicate Sample Assessment	
Sample I.D.:	30215074001
Duplicate Sample I.D.:	30215074001DUP
Sample Result (pCi/L, g, F):	0.365
Sample Result Counting Uncertainty (pCi/L, g, F):	0.322
Sample Duplicate Result (pCi/L, g, F):	1.025
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.390
Are sample and/or duplicate results below MDC?	See Below #
Duplicate Numerical Performance Indicator:	-2.557
Duplicate RPD:	94.91%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Fail***

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

***Batch must be re-prepped due to unacceptable precision.

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Sample Matrix Spike Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Sample Matrix Spike Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
(Based on the Percent Recoveries) MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	

Handwritten signature/initials



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Laboratory Report

Prepared For:

**Georgia Power
2480 Maner Road
Atlanta, GA 30339**

Attention: Mr. Joju Abraham

Report Number: AAD0425

April 13, 2017

Project: CCR Event

Project #:Plant McDonough

We appreciate the opportunity to provide the analytical support for your project. The analytical results in this report are based upon information supplied by you, the client, and are for your exclusive use. If you have any questions regarding this data package, please do not hesitate to call.

Approved:

A handwritten signature in black ink that reads "Betsy McDonough". The signature is written over a horizontal line.

Project Manager

This report may not be reproduced, except in full, without written approval from Pace Analytical Services, LLC.
All test results relate only to the samples analyzed.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 13, 2017

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
DGWC-68	AAD0425-01	Ground Water	04/12/17 12:35	04/12/17 15:34
DGWC-69	AAD0425-02	Ground Water	04/12/17 13:46	04/12/17 15:34



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 13, 2017

Report No.: AAD0425

Project: CCR Event

Client ID: DGWC-68

Lab Number ID: AAD0425-01

Date/Time Sampled: 4/12/2017 12:35:00PM

Date/Time Received: 4/12/2017 3:34:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
Metals, Total											
Arsenic	0.498	0.0050	0.0004	mg/L	EPA 6020B		1	04/12/17 16:05	04/13/17 00:15	7040366	CSW
Boron	1.16	0.0400	0.0060	mg/L	EPA 6020B		1	04/12/17 16:05	04/13/17 00:15	7040366	CSW



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 13, 2017

Report No.: AAD0425

Project: CCR Event

Client ID: DGWC-69

Lab Number ID: AAD0425-02

Date/Time Sampled: 4/12/2017 1:46:00PM

Date/Time Received: 4/12/2017 3:34:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
Metals, Total											
Arsenic	0.0077	0.0050	0.0004	mg/L	EPA 6020B		1	04/12/17 16:05	04/13/17 00:21	7040366	CSW
Boron	0.207	0.0400	0.0060	mg/L	EPA 6020B		1	04/12/17 16:05	04/13/17 13:43	7040366	CSW



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 13, 2017

Report No.: AAD0425

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	----	-----	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7040366 - EPA 3005A

Blank (7040366-BLK1)

Prepared & Analyzed: 04/12/17

Antimony	ND	0.0030	0.0003	mg/L							
Arsenic	ND	0.0050	0.0004	mg/L							
Barium	ND	0.0100	0.0003	mg/L							
Beryllium	ND	0.0030	0.00007	mg/L							
Boron	ND	0.0400	0.0060	mg/L							
Cadmium	ND	0.0010	0.00006	mg/L							
Calcium	ND	0.500	0.0104	mg/L							
Chromium	ND	0.0100	0.0003	mg/L							
Cobalt	ND	0.0100	0.0005	mg/L							
Copper	ND	0.0250	0.0003	mg/L							
Lead	ND	0.0050	0.00007	mg/L							
Molybdenum	ND	0.0100	0.0006	mg/L							
Nickel	ND	0.0100	0.0003	mg/L							
Selenium	ND	0.0100	0.0014	mg/L							
Silver	ND	0.0100	0.0003	mg/L							
Thallium	ND	0.0010	0.00005	mg/L							
Vanadium	ND	0.0100	0.0014	mg/L							
Zinc	ND	0.0100	0.0013	mg/L							
Lithium	ND	0.0500	0.0011	mg/L							

LCS (7040366-BS1)

Prepared & Analyzed: 04/12/17

Antimony	0.0938	0.0030	0.0003	mg/L	0.10000		94	80-120			
Arsenic	0.0942	0.0050	0.0004	mg/L	0.10000		94	80-120			
Barium	0.0899	0.0100	0.0003	mg/L	0.10000		90	80-120			
Beryllium	0.0888	0.0030	0.00007	mg/L	0.10000		89	80-120			
Boron	0.857	0.0400	0.0060	mg/L	1.0000		86	80-120			
Cadmium	0.0974	0.0010	0.00006	mg/L	0.10000		97	80-120			
Calcium	0.904	0.500	0.0104	mg/L	1.0000		90	80-120			
Chromium	0.103	0.0100	0.0003	mg/L	0.10000		103	80-120			
Cobalt	0.0976	0.0100	0.0005	mg/L	0.10000		98	80-120			
Copper	0.0984	0.0250	0.0003	mg/L	0.10000		98	80-120			
Lead	0.0959	0.0050	0.00007	mg/L	0.10000		96	80-120			
Molybdenum	0.0975	0.0100	0.0006	mg/L	0.10000		97	80-120			
Nickel	0.101	0.0100	0.0003	mg/L	0.10000		101	80-120			
Selenium	0.0934	0.0100	0.0014	mg/L	0.10000		93	80-120			
Silver	0.0933	0.0100	0.0003	mg/L	0.10000		93	80-120			
Thallium	0.0984	0.0010	0.00005	mg/L	0.10000		98	80-120			
Vanadium	0.0995	0.0100	0.0014	mg/L	0.10000		99	80-120			
Zinc	0.102	0.0100	0.0013	mg/L	0.10000		102	80-120			
Lithium	0.0984	0.0500	0.0011	mg/L	0.10000		98	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 13, 2017

Report No.: AAD0425

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7040366 - EPA 3005A											
Matrix Spike (7040366-MS1)			Source: AAD0425-01				Prepared & Analyzed: 04/12/17				
Antimony	0.0948	0.0030	0.0003	mg/L	0.10000	0.0012	94	75-125			
Arsenic	0.573	0.0050	0.0004	mg/L	0.10000	0.498	76	75-125			
Barium	0.181	0.0100	0.0003	mg/L	0.10000	0.0758	105	75-125			
Beryllium	0.0827	0.0030	0.00007	mg/L	0.10000	0.00007	83	75-125			
Boron	2.40	0.200	0.0302	mg/L	1.0000	1.16	124	75-125			
Cadmium	0.0936	0.0010	0.00006	mg/L	0.10000	ND	94	75-125			
Calcium	39.3	0.500	0.0104	mg/L	1.0000	40.9	NR	75-125			
Chromium	0.0981	0.0100	0.0003	mg/L	0.10000	0.0011	97	75-125			
Cobalt	0.0961	0.0100	0.0005	mg/L	0.10000	0.0022	94	75-125			
Copper	0.0944	0.0250	0.0003	mg/L	0.10000	ND	94	75-125			
Lead	0.0913	0.0050	0.00007	mg/L	0.10000	0.0001	91	75-125			
Molybdenum	0.246	0.0100	0.0006	mg/L	0.10000	0.155	91	75-125			
Nickel	0.0956	0.0100	0.0003	mg/L	0.10000	0.0010	95	75-125			
Selenium	0.0917	0.0100	0.0014	mg/L	0.10000	ND	92	75-125			
Silver	0.0905	0.0100	0.0003	mg/L	0.10000	ND	90	75-125			
Thallium	0.0960	0.0010	0.00005	mg/L	0.10000	0.0002	96	75-125			
Vanadium	0.0991	0.0100	0.0014	mg/L	0.10000	ND	99	75-125			
Zinc	0.0988	0.0100	0.0013	mg/L	0.10000	0.0025	96	75-125			
Lithium	0.0916	0.0500	0.0011	mg/L	0.10000	0.0017	90	75-125			
Matrix Spike Dup (7040366-MSD1)			Source: AAD0425-01				Prepared: 04/12/17 Analyzed: 04/13/17				
Antimony	0.0946	0.0030	0.0003	mg/L	0.10000	0.0012	93	75-125	0.2	20	
Arsenic	0.565	0.0050	0.0004	mg/L	0.10000	0.498	68	75-125	1	20	QM-02
Barium	0.183	0.0100	0.0003	mg/L	0.10000	0.0758	107	75-125	1	20	
Beryllium	0.0851	0.0030	0.00007	mg/L	0.10000	0.00007	85	75-125	3	20	
Boron	2.41	0.200	0.0302	mg/L	1.0000	1.16	125	75-125	0.6	20	
Cadmium	0.0954	0.0010	0.00006	mg/L	0.10000	ND	95	75-125	2	20	
Calcium	39.8	0.500	0.0104	mg/L	1.0000	40.9	NR	75-125	1	20	
Chromium	0.0984	0.0100	0.0003	mg/L	0.10000	0.0011	97	75-125	0.3	20	
Cobalt	0.0934	0.0100	0.0005	mg/L	0.10000	0.0022	91	75-125	3	20	
Copper	0.0923	0.0250	0.0003	mg/L	0.10000	ND	92	75-125	2	20	
Lead	0.0935	0.0050	0.00007	mg/L	0.10000	0.0001	93	75-125	2	20	
Molybdenum	0.249	0.0100	0.0006	mg/L	0.10000	0.155	94	75-125	1	20	
Nickel	0.0944	0.0100	0.0003	mg/L	0.10000	0.0010	93	75-125	1	20	
Selenium	0.0938	0.0100	0.0014	mg/L	0.10000	ND	94	75-125	2	20	
Silver	0.0909	0.0100	0.0003	mg/L	0.10000	ND	91	75-125	0.5	20	
Thallium	0.0962	0.0010	0.00005	mg/L	0.10000	0.0002	96	75-125	0.2	20	
Vanadium	0.0986	0.0100	0.0014	mg/L	0.10000	ND	99	75-125	0.5	20	
Zinc	0.0987	0.0100	0.0013	mg/L	0.10000	0.0025	96	75-125	0.07	20	
Lithium	0.0929	0.0500	0.0011	mg/L	0.10000	0.0017	91	75-125	1	20	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 13, 2017

Report No.: AAD0425

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7040366 - EPA 3005A											
Post Spike (7040366-PS1)			Source: AAD0425-01			Prepared: 04/12/17 Analyzed: 04/13/17					
Antimony	86.1			ug/L	100.00	1.23	85	80-120			
Arsenic	575			ug/L	100.00	498	78	80-120			QM-02
Barium	188			ug/L	100.00	75.8	112	80-120			
Beryllium	83.0			ug/L	100.00	0.0688	83	80-120			
Boron	2510			ug/L	1000.0	1160	136	80-120			QM-02
Cadmium	94.2			ug/L	100.00	0.0438	94	80-120			
Calcium	39900			ug/L	1000.0	40900	NR	80-120			
Chromium	97.1			ug/L	100.00	1.14	96	80-120			
Cobalt	96.5			ug/L	100.00	2.24	94	80-120			
Copper	90.7			ug/L	100.00	0.131	91	80-120			
Lead	90.8			ug/L	100.00	0.125	91	80-120			
Molybdenum	254			ug/L	100.00	155	99	80-120			
Nickel	95.3			ug/L	100.00	1.02	94	80-120			
Selenium	94.0			ug/L	100.00	0.291	94	80-120			
Silver	92.4			ug/L	100.00	0.0223	92	80-120			
Thallium	94.0			ug/L	100.00	0.153	94	80-120			
Vanadium	97.2			ug/L	100.00	-0.0354	97	80-120			
Zinc	96.0			ug/L	100.00	2.51	94	80-120			
Lithium	89.8			ug/L	100.00	1.68	88	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

April 13, 2017

Legend

Definition of Laboratory Terms

- ND** - Not Detected at levels equal to or greater than the MDL
BRL - Not Detected at levels equal to or greater than the RL
RL - Reporting Limit **MDL** - Method Detection Limit
SOP - Method run per Pace Standard Operating Procedure
CFU - Colony Forming Units
DF - Dilution Factor **TIC** - Tentatively Identified Compound

Sample Information

N-Nitrosodiphenylamine breaks down to diphenylamine in the GCMS; both analytes are reported as N-Nitrosodiphenylamine. Pace is not NELAC certified for N-Nitrosodiphenylamine.

Phthalic acid and phthalic anhydride are reported as dimethyl phthalate

Maleic acid and maleic anhydride are reported as dimethyl malate

1,2-Diphenylhydrazine breaks down to azobenzene in the GCMS; both analytes are reported as azobenzene

Definition of Qualifiers

- QM-02** The spike recovery is outside acceptance limits due to insignificant spike amount as compared to sample concentration.

Note: Unless otherwise noted, all results are reported on an as received basis.



CHAIN OF CUSTODY RECORD

Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CLIENT NAME: Georgia Power CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185 Atlanta, GA 30308 404-506-7239		REPORT TO: JOJO ABRAHAM Dawn Prell (Dawn_Prell@golder.com) CC: Maria Padilla kiurinko@golder.com PO #: laburch@southerncco.com		REQUESTED COMPLETION DATE: RUSH - 24 hr TAT PROJECT NAME/STATE: Plant McDonough AP	
PROJECT # Phase II CCR					
Collection DATE	Collection TIME	MATRIX CODE*	C O M P G O R A B	SAMPLE IDENTIFICATION	ANALYSIS REQUESTED
4/12/17	1235	GW	x	DGWC-68	Total Arsenic
4/12/17	1346	GW	x	DGWC-69	Dissolved Arsenic (Field Filtered 0.45 um)
CONTAINER TYPE: P 3 PRESERVATION: 3 3 # of CONTAINERS					
CONTAINER TYPE: P - PLASTIC A - AMBER GLASS G - CLEAR GLASS V - VOA VIAL S - STERILE O - OTHER PRESERVATION: 1 - HCl, ≤6°C 2 - H ₂ SO ₄ , ≤6°C 3 - HNO ₃ 4 - NaOH, ≤6°C 5 - NaOH/ZnAc, ≤6°C 6 - Na ₂ S ₂ O ₃ , ≤6°C 7 - ≤6°C not frozen					
MATRIX CODES: DW - DRINKING WATER S - SOIL WW - WASTEWATER SL - SLUDGE GW - GROUNDWATER SD - SOLID SW - SURFACE WATER A - AIR ST - STORM WATER L - LIQUID W - WATER P - PRODUCT					
REMARKS/ADDITIONAL INFORMATION *Please limit testing to constituent requested 1 2 RUSH ANALYSIS 24 HR TAT Only Total As, by on This report. MR 04/12/17					
SAMPLED BY AND TITLE: Kristen Jurinko Golder		DATE/TIME: 4/12/17 1532		RELINQUISHED BY: [Signature]	
RECEIVED BY: [Signature]		DATE/TIME: 4/12/17 1534		RELINQUISHED BY: [Signature]	
RECEIVED BY LAB: [Signature]		DATE/TIME: 4/12/17 1534		SAMPLE SHIPPED VIA: UPS FED-EX USPS COURIER CLIENT OTHER FS	
Temp. Secured: [Signature]		Temp. Secured: [Signature]		Cooler ID: [Signature]	

April 12 Plant McDonough COC Phase II CCR.xlsx



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

LOG-IN CHECKLIST

Printed: 4/13/2017 8:09:23AM

Attn: Mr. Joju Abraham

Client: Georgia Power

Project: CCR Event

Date Received: 04/12/17 15:34

Work Order: AAD0425

Logged In By: Mohammad M. Rahman

OBSERVATIONS

#Samples: 2

#Containers: 2

Minimum Temp(C): 6.0

Maximum Temp(C): 6.0

Custody Seal(s) Used: N/A

CHECKLIST ITEMS

- COC included with Samples YES
- Sample Container(s) Intact YES
- Chain of Custody Complete YES
- Sample Container(s) Match COC YES
- Custody seal Intact NO
- Temperature in Compliance YES
- Sufficient Sample Volume for Analysis YES
- Zero Headspace Maintained for VOA Analyses YES
- Samples labeled preserved (If Applicable) YES
- Samples received within Allowable Hold Times YES
- Samples Received on Ice YES
- Preservation Confirmed YES

Comments:

LABORATORY ANALYTICAL DATA

May 2017



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Laboratory Report

Prepared For:

**Georgia Power
2480 Maner Road
Atlanta, GA 30339**

Attention: Mr. Joju Abraham

Report Number: AAE0439

May 23, 2017

Project: CCR Event

Project #:Plant McDonough

We appreciate the opportunity to provide the analytical support for your project. The analytical results in this report are based upon information supplied by you, the client, and are for your exclusive use. If you have any questions regarding this data package, please do not hesitate to call.

Approved:

A handwritten signature in black ink that reads "Betsy McDonough". The signature is written over a horizontal line.

Project Manager

This report may not be reproduced, except in full, without written approval from Pace Analytical Services, LLC.
All test results relate only to the samples analyzed.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 23, 2017

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
DGWA-2	AAE0439-01	Ground Water	05/11/17 16:12	05/12/17 10:20
DGWA-53	AAE0439-02	Ground Water	05/11/17 16:03	05/12/17 10:20
FB-1	AAE0439-03	Water	05/11/17 15:00	05/12/17 10:20
EB-1	AAE0439-04	Water	05/12/17 07:30	05/12/17 10:20



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 23, 2017

Case Narrative

The Radium analysis by methods EPA 9315/9320 was performed by Pace-Pittsburgh, 1638 Roseytown Road - Suites 2, 3, 4, Greensburg PA 15601. The Pace-Pittsburgh lab contact is Jacquelyn Collins at 724-850-5612.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 23, 2017

Report No.: AAE0439

Project: CCR Event

Client ID: DGWA-2

Lab Number ID: AAE0439-01

Date/Time Sampled: 5/11/2017 4:12:00PM

Date/Time Received: 5/12/2017 10:20:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	573	25	10	mg/L	SM 2540 C		1	05/16/17 15:15	05/16/17 15:15	7050534	JPT
Inorganic Anions											
Chloride	4.4	0.25	0.01	mg/L	EPA 300.0		1	05/15/17 09:58	05/15/17 19:00	7050484	RLC
Fluoride	0.06	0.30	0.004	mg/L	EPA 300.0	J	1	05/15/17 09:58	05/15/17 19:00	7050484	RLC
Sulfate	340	20	1.8	mg/L	EPA 300.0		20	05/15/17 09:58	05/18/17 23:19	7050484	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 10:57	7050544	CSW
Arsenic	ND	0.0050	0.0004	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 10:57	7050544	CSW
Barium	0.0231	0.0100	0.0003	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 10:57	7050544	CSW
Beryllium	ND	0.0030	0.00007	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 10:57	7050544	CSW
Boron	1.65	0.0400	0.0060	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 10:57	7050544	CSW
Cadmium	0.0004	0.0010	0.00006	mg/L	EPA 6020B	J	1	05/16/17 14:25	05/19/17 10:57	7050544	CSW
Calcium	102	25.0	0.522	mg/L	EPA 6020B		50	05/16/17 14:25	05/19/17 11:03	7050544	CSW
Chromium	0.0005	0.0100	0.0003	mg/L	EPA 6020B	J	1	05/16/17 14:25	05/19/17 10:57	7050544	CSW
Cobalt	0.0284	0.0100	0.0005	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 10:57	7050544	CSW
Lead	0.00009	0.0050	0.00007	mg/L	EPA 6020B	J	1	05/16/17 14:25	05/19/17 10:57	7050544	CSW
Molybdenum	0.0009	0.0100	0.0006	mg/L	EPA 6020B	J	1	05/16/17 14:25	05/19/17 10:57	7050544	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 10:57	7050544	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 10:57	7050544	CSW
Lithium	0.0850	0.0500	0.0011	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 10:57	7050544	CSW
Mercury	0.000083	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	05/18/17 08:30	05/18/17 14:13	7050598	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

May 23, 2017

Attention: Mr. Joju Abraham

Report No.: AAE0439

Project: CCR Event

Client ID: DGWA-53

Lab Number ID: AAE0439-02

Date/Time Sampled: 5/11/2017 4:03:00PM

Date/Time Received: 5/12/2017 10:20:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	241	25	10	mg/L	SM 2540 C		1	05/16/17 15:15	05/16/17 15:15	7050534	JPT
Inorganic Anions											
Chloride	2.3	0.25	0.01	mg/L	EPA 300.0		1	05/15/17 09:58	05/15/17 19:20	7050484	RLC
Fluoride	0.07	0.30	0.004	mg/L	EPA 300.0	J	1	05/15/17 09:58	05/15/17 19:20	7050484	RLC
Sulfate	21	1.0	0.09	mg/L	EPA 300.0		1	05/15/17 09:58	05/15/17 19:20	7050484	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:09	7050544	CSW
Arsenic	0.0005	0.0050	0.0004	mg/L	EPA 6020B	J	1	05/16/17 14:25	05/19/17 11:09	7050544	CSW
Barium	0.126	0.0100	0.0003	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:09	7050544	CSW
Beryllium	ND	0.0030	0.00007	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:09	7050544	CSW
Boron	0.0805	0.0400	0.0060	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:09	7050544	CSW
Cadmium	0.00008	0.0010	0.00006	mg/L	EPA 6020B	J	1	05/16/17 14:25	05/19/17 11:09	7050544	CSW
Calcium	35.8	25.0	0.522	mg/L	EPA 6020B		50	05/16/17 14:25	05/19/17 11:15	7050544	CSW
Chromium	ND	0.0100	0.0003	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:09	7050544	CSW
Cobalt	0.0281	0.0100	0.0005	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:09	7050544	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:09	7050544	CSW
Molybdenum	0.0375	0.0100	0.0006	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:09	7050544	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:09	7050544	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:09	7050544	CSW
Lithium	0.0087	0.0500	0.0011	mg/L	EPA 6020B	J	1	05/16/17 14:25	05/19/17 11:09	7050544	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	05/18/17 08:30	05/18/17 14:15	7050598	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 23, 2017

Report No.: AAE0439

Project: CCR Event

Client ID: FB-1

Lab Number ID: AAE0439-03

Date/Time Sampled: 5/11/2017 3:00:00PM

Date/Time Received: 5/12/2017 10:20:00AM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C		1	05/16/17 15:15	05/16/17 15:15	7050534	JPT
Inorganic Anions											
Chloride	ND	0.25	0.01	mg/L	EPA 300.0		1	05/15/17 09:58	05/15/17 19:41	7050484	RLC
Fluoride	ND	0.30	0.004	mg/L	EPA 300.0		1	05/15/17 09:58	05/15/17 19:41	7050484	RLC
Sulfate	ND	1.0	0.09	mg/L	EPA 300.0		1	05/15/17 09:58	05/15/17 19:41	7050484	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:20	7050544	CSW
Arsenic	ND	0.0050	0.0004	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:20	7050544	CSW
Barium	0.0027	0.0100	0.0003	mg/L	EPA 6020B	J	1	05/16/17 14:25	05/19/17 11:20	7050544	CSW
Beryllium	ND	0.0030	0.00007	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:20	7050544	CSW
Boron	ND	0.0400	0.0060	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:20	7050544	CSW
Cadmium	ND	0.0010	0.00006	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:20	7050544	CSW
Calcium	0.0966	0.500	0.0104	mg/L	EPA 6020B	J	1	05/16/17 14:25	05/19/17 11:20	7050544	CSW
Chromium	0.0006	0.0100	0.0003	mg/L	EPA 6020B	J	1	05/16/17 14:25	05/19/17 11:20	7050544	CSW
Cobalt	ND	0.0100	0.0005	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:20	7050544	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:20	7050544	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:20	7050544	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:20	7050544	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:20	7050544	CSW
Lithium	ND	0.0500	0.0011	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:20	7050544	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	05/18/17 08:30	05/18/17 14:17	7050598	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

May 23, 2017

Attention: Mr. Joju Abraham

Report No.: AAE0439

Project: CCR Event

Client ID: EB-1

Lab Number ID: AAE0439-04

Date/Time Sampled: 5/12/2017 7:30:00AM

Date/Time Received: 5/12/2017 10:20:00AM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C		1	05/16/17 15:15	05/16/17 15:15	7050534	JPT
Inorganic Anions											
Chloride	ND	0.25	0.01	mg/L	EPA 300.0		1	05/15/17 09:58	05/15/17 20:02	7050484	RLC
Fluoride	ND	0.30	0.004	mg/L	EPA 300.0		1	05/15/17 09:58	05/15/17 20:02	7050484	RLC
Sulfate	ND	1.0	0.09	mg/L	EPA 300.0		1	05/15/17 09:58	05/15/17 20:02	7050484	RLC
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:26	7050544	CSW
Arsenic	ND	0.0050	0.0004	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:26	7050544	CSW
Barium	0.0021	0.0100	0.0003	mg/L	EPA 6020B	J	1	05/16/17 14:25	05/19/17 11:26	7050544	CSW
Beryllium	ND	0.0030	0.00007	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:26	7050544	CSW
Boron	ND	0.0400	0.0060	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:26	7050544	CSW
Cadmium	ND	0.0010	0.00006	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:26	7050544	CSW
Calcium	0.0164	0.500	0.0104	mg/L	EPA 6020B	J	1	05/16/17 14:25	05/19/17 11:26	7050544	CSW
Chromium	0.0006	0.0100	0.0003	mg/L	EPA 6020B	J	1	05/16/17 14:25	05/19/17 11:26	7050544	CSW
Cobalt	ND	0.0100	0.0005	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:26	7050544	CSW
Lead	0.00009	0.0050	0.00007	mg/L	EPA 6020B	J	1	05/16/17 14:25	05/19/17 11:26	7050544	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:26	7050544	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:26	7050544	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:26	7050544	CSW
Lithium	ND	0.0500	0.0011	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:26	7050544	CSW
Mercury	0.00004	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	05/18/17 08:30	05/18/17 14:20	7050598	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 23, 2017

Report No.: AAE0439

General Chemistry - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7050534 - SM 2540 C											
Blank (7050534-BLK1)						Prepared & Analyzed: 05/16/17					
Total Dissolved Solids	ND	25	10	mg/L							
LCS (7050534-BS1)						Prepared & Analyzed: 05/16/17					
Total Dissolved Solids	392	25	10	mg/L	400.00		98	84-108			
Duplicate (7050534-DUP1)			Source: AAE0439-02			Prepared & Analyzed: 05/16/17					
Total Dissolved Solids	237	25	10	mg/L		241			2	10	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 23, 2017

Report No.: AAE0439

Inorganic Anions - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7050484 - EPA 300.0											
Blank (7050484-BLK1)						Prepared & Analyzed: 05/15/17					
Chloride	ND	0.25	0.01	mg/L							
Fluoride	ND	0.30	0.004	mg/L							
Sulfate	ND	1.0	0.09	mg/L							
LCS (7050484-BS1)						Prepared & Analyzed: 05/15/17					
Chloride	9.82	0.25	0.01	mg/L	10.020		98	90-110			
Fluoride	9.76	0.30	0.004	mg/L	10.020		97	90-110			
Sulfate	10.0	1.0	0.09	mg/L	10.050		100	90-110			
Matrix Spike (7050484-MS1)						Source: AAE0388-01 Prepared & Analyzed: 05/15/17					
Chloride	13.9	0.25	0.01	mg/L	10.020	4.17	97	90-110			
Fluoride	10.1	0.30	0.004	mg/L	10.020	0.05	100	90-110			
Sulfate	60.9	1.0	0.09	mg/L	10.050	56.4	44	90-110			QM-02
Matrix Spike (7050484-MS2)						Source: AAE0388-07 Prepared & Analyzed: 05/15/17					
Chloride	16.2	0.25	0.01	mg/L	10.020	7.14	91	90-110			
Fluoride	10.2	0.30	0.004	mg/L	10.020	0.05	101	90-110			
Sulfate	80.2	1.0	0.09	mg/L	10.050	78.3	19	90-110			QM-02
Matrix Spike Dup (7050484-MSD1)						Source: AAE0388-01 Prepared & Analyzed: 05/15/17					
Chloride	13.9	0.25	0.01	mg/L	10.020	4.17	97	90-110	0.2	15	
Fluoride	9.97	0.30	0.004	mg/L	10.020	0.05	99	90-110	1	15	
Sulfate	60.6	1.0	0.09	mg/L	10.050	56.4	41	90-110	0.5	15	QM-02



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 23, 2017

Report No.: AAE0439

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	----	-----	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7050544 - EPA 3005A

Blank (7050544-BLK1)

Prepared: 05/16/17 Analyzed: 05/19/17

Antimony	ND	0.0030	0.0003	mg/L							
Arsenic	ND	0.0050	0.0004	mg/L							
Barium	ND	0.0100	0.0003	mg/L							
Beryllium	ND	0.0030	0.00007	mg/L							
Boron	ND	0.0400	0.0060	mg/L							
Cadmium	ND	0.0010	0.00006	mg/L							
Calcium	ND	0.500	0.0104	mg/L							
Chromium	ND	0.0100	0.0003	mg/L							
Cobalt	ND	0.0100	0.0005	mg/L							
Copper	ND	0.0250	0.0003	mg/L							
Lead	ND	0.0050	0.00007	mg/L							
Molybdenum	ND	0.0100	0.0006	mg/L							
Nickel	ND	0.0100	0.0003	mg/L							
Selenium	ND	0.0100	0.0014	mg/L							
Silver	ND	0.0100	0.0003	mg/L							
Thallium	ND	0.0010	0.00005	mg/L							
Vanadium	ND	0.0100	0.0014	mg/L							
Zinc	ND	0.0100	0.0013	mg/L							
Lithium	ND	0.0500	0.0011	mg/L							

LCS (7050544-BS1)

Prepared: 05/16/17 Analyzed: 05/19/17

Antimony	0.118	0.0030	0.0003	mg/L	0.10000		118	80-120			
Arsenic	0.104	0.0050	0.0004	mg/L	0.10000		104	80-120			
Barium	0.112	0.0100	0.0003	mg/L	0.10000		112	80-120			
Beryllium	0.107	0.0030	0.00007	mg/L	0.10000		107	80-120			
Boron	1.06	0.0400	0.0060	mg/L	1.0000		106	80-120			
Cadmium	0.112	0.0010	0.00006	mg/L	0.10000		112	80-120			
Calcium	1.02	0.500	0.0104	mg/L	1.0000		102	80-120			
Chromium	0.102	0.0100	0.0003	mg/L	0.10000		102	80-120			
Cobalt	0.100	0.0100	0.0005	mg/L	0.10000		100	80-120			
Copper	0.100	0.0250	0.0003	mg/L	0.10000		100	80-120			
Lead	0.114	0.0050	0.00007	mg/L	0.10000		114	80-120			
Molybdenum	0.111	0.0100	0.0006	mg/L	0.10000		111	80-120			
Nickel	0.105	0.0100	0.0003	mg/L	0.10000		105	80-120			
Selenium	0.105	0.0100	0.0014	mg/L	0.10000		105	80-120			
Silver	0.107	0.0100	0.0003	mg/L	0.10000		107	80-120			
Thallium	0.115	0.0010	0.00005	mg/L	0.10000		115	80-120			
Vanadium	0.101	0.0100	0.0014	mg/L	0.10000		101	80-120			
Zinc	0.0970	0.0100	0.0013	mg/L	0.10000		97	80-120			
Lithium	0.103	0.0500	0.0011	mg/L	0.10000		103	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 23, 2017

Report No.: AAE0439

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7050544 - EPA 3005A											
Duplicate (7050544-DUP1)		Source: AAE0482-01				Prepared: 05/16/17 Analyzed: 05/19/17					
Antimony	ND	0.0030	0.0003	mg/L		ND				20	
Arsenic	0.0007	0.0050	0.0004	mg/L		0.0004			45	20	QR-01, J
Barium	0.0392	0.0100	0.0003	mg/L		0.0400			2	20	
Beryllium	0.00009	0.0030	0.00007	mg/L		ND				20	J
Boron	0.0120	0.0400	0.0060	mg/L		0.0082			38	20	QR-01, J
Cadmium	0.00008	0.0010	0.00006	mg/L		ND				20	J
Calcium	8.23	0.500	0.0104	mg/L		8.04			2	20	
Chromium	0.0007	0.0100	0.0003	mg/L		0.0004			41	20	QR-01, J
Cobalt	0.0015	0.0100	0.0005	mg/L		0.0016			6	20	J
Copper	0.0004	0.0250	0.0003	mg/L		0.0004			17	20	J
Lead	0.00008	0.0050	0.00007	mg/L		0.00008			6	20	J
Molybdenum	ND	0.0100	0.0006	mg/L		ND				20	
Nickel	0.0013	0.0100	0.0003	mg/L		0.0015			10	20	J
Selenium	ND	0.0100	0.0014	mg/L		ND				20	
Silver	ND	0.0100	0.0003	mg/L		ND				20	
Thallium	ND	0.0010	0.00005	mg/L		ND				20	
Vanadium	ND	0.0100	0.0014	mg/L		ND				20	
Zinc	0.0027	0.0100	0.0013	mg/L		0.0032			17	20	J
Lithium	0.0017	0.0500	0.0011	mg/L		0.0016			9	20	J

Matrix Spike (7050544-MS1)		Source: AAE0439-01				Prepared: 05/16/17 Analyzed: 05/19/17					
Antimony	0.111	0.0030	0.0003	mg/L	0.10000	ND	111	75-125			
Arsenic	0.0989	0.0050	0.0004	mg/L	0.10000	ND	99	75-125			
Barium	0.123	0.0100	0.0003	mg/L	0.10000	0.0231	100	75-125			
Beryllium	0.0983	0.0030	0.00007	mg/L	0.10000	ND	98	75-125			
Boron	2.50	0.0400	0.0060	mg/L	1.0000	1.65	85	75-125			
Cadmium	0.106	0.0010	0.00006	mg/L	0.10000	0.0004	106	75-125			
Calcium	96.4	25.0	0.522	mg/L	1.0000	102	NR	75-125			QM-02
Chromium	0.0952	0.0100	0.0003	mg/L	0.10000	0.0005	95	75-125			
Cobalt	0.121	0.0100	0.0005	mg/L	0.10000	0.0284	92	75-125			
Copper	0.0940	0.0250	0.0003	mg/L	0.10000	0.0021	92	75-125			
Lead	0.101	0.0050	0.00007	mg/L	0.10000	0.00009	101	75-125			
Molybdenum	0.104	0.0100	0.0006	mg/L	0.10000	0.0009	103	75-125			
Nickel	0.124	0.0100	0.0003	mg/L	0.10000	0.0275	97	75-125			
Selenium	0.0980	0.0100	0.0014	mg/L	0.10000	ND	98	75-125			
Silver	0.0963	0.0100	0.0003	mg/L	0.10000	ND	96	75-125			
Thallium	0.103	0.0010	0.00005	mg/L	0.10000	ND	103	75-125			
Vanadium	0.0984	0.0100	0.0014	mg/L	0.10000	ND	98	75-125			
Zinc	0.101	0.0100	0.0013	mg/L	0.10000	0.0057	95	75-125			
Lithium	0.177	0.0500	0.0011	mg/L	0.10000	0.0850	92	75-125			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 23, 2017

Report No.: AAE0439

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7050544 - EPA 3005A											
Matrix Spike Dup (7050544-MSD1)			Source: AAE0439-01				Prepared: 05/16/17 Analyzed: 05/19/17				
Antimony	0.115	0.0030	0.0003	mg/L	0.10000	ND	115	75-125	3	20	
Arsenic	0.108	0.0050	0.0004	mg/L	0.10000	ND	108	75-125	9	20	
Barium	0.131	0.0100	0.0003	mg/L	0.10000	0.0231	108	75-125	6	20	
Beryllium	0.103	0.0030	0.00007	mg/L	0.10000	ND	103	75-125	5	20	
Boron	2.62	0.0400	0.0060	mg/L	1.0000	1.65	97	75-125	5	20	
Cadmium	0.106	0.0010	0.00006	mg/L	0.10000	0.0004	106	75-125	0.1	20	
Calcium	103	25.0	0.522	mg/L	1.0000	102	153	75-125	7	20	QM-02
Chromium	0.103	0.0100	0.0003	mg/L	0.10000	0.0005	102	75-125	7	20	
Cobalt	0.129	0.0100	0.0005	mg/L	0.10000	0.0284	100	75-125	6	20	
Copper	0.0985	0.0250	0.0003	mg/L	0.10000	0.0021	96	75-125	5	20	
Lead	0.108	0.0050	0.00007	mg/L	0.10000	0.00009	108	75-125	6	20	
Molybdenum	0.109	0.0100	0.0006	mg/L	0.10000	0.0009	109	75-125	5	20	
Nickel	0.124	0.0100	0.0003	mg/L	0.10000	0.0275	96	75-125	0.4	20	
Selenium	0.108	0.0100	0.0014	mg/L	0.10000	ND	108	75-125	9	20	
Silver	0.101	0.0100	0.0003	mg/L	0.10000	ND	101	75-125	4	20	
Thallium	0.110	0.0010	0.00005	mg/L	0.10000	ND	110	75-125	7	20	
Vanadium	0.0979	0.0100	0.0014	mg/L	0.10000	ND	98	75-125	0.5	20	
Zinc	0.101	0.0100	0.0013	mg/L	0.10000	0.0057	95	75-125	0.2	20	
Lithium	0.183	0.0500	0.0011	mg/L	0.10000	0.0850	98	75-125	3	20	
Post Spike (7050544-PS1)											
Source: AAE0439-01			Prepared: 05/16/17 Analyzed: 05/19/17								
Antimony	116			ug/L	100.00	0.103	115	80-120			
Arsenic	109			ug/L	100.00	0.281	109	80-120			
Barium	134			ug/L	100.00	23.1	111	80-120			
Beryllium	93.8			ug/L	100.00	0.0523	94	80-120			
Boron	2480			ug/L	1000.0	1650	83	80-120			
Cadmium	112			ug/L	100.00	0.406	111	80-120			
Calcium	104000			ug/L	1000.0	102000	214	80-120			QM-02
Chromium	103			ug/L	100.00	0.548	103	80-120			
Cobalt	128			ug/L	100.00	28.4	100	80-120			
Copper	102			ug/L	100.00	2.11	100	80-120			
Lead	107			ug/L	100.00	0.0897	107	80-120			
Molybdenum	115			ug/L	100.00	0.864	115	80-120			
Nickel	130			ug/L	100.00	27.5	102	80-120			
Selenium	109			ug/L	100.00	0.999	108	80-120			
Silver	102			ug/L	100.00	0.0174	102	80-120			
Thallium	109			ug/L	100.00	-0.0195	109	80-120			
Vanadium	104			ug/L	100.00	0.633	104	80-120			
Zinc	101			ug/L	100.00	5.71	96	80-120			
Lithium	175			ug/L	100.00	85.0	90	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 23, 2017

Report No.: AAE0439

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7050598 - EPA 7470A											
Blank (7050598-BLK1)						Prepared & Analyzed: 05/18/17					
Mercury	0.00007	0.00050	0.000041	mg/L							J
LCS (7050598-BS1)						Prepared & Analyzed: 05/18/17					
Mercury	0.00250	0.00050	0.000041	mg/L	2.5000E-3		100	80-120			
Matrix Spike (7050598-MS1)			Source: AAE0482-06			Prepared & Analyzed: 05/18/17					
Mercury	0.00254	0.00050	0.000041	mg/L	2.5000E-3	ND	102	75-125			
Matrix Spike Dup (7050598-MSD1)			Source: AAE0482-06			Prepared & Analyzed: 05/18/17					
Mercury	0.00251	0.00050	0.000041	mg/L	2.5000E-3	ND	100	75-125	1	20	
Post Spike (7050598-PS1)			Source: AAE0482-06			Prepared & Analyzed: 05/18/17					
Mercury	1.76			ug/L	1.6667	0.0190	104	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 23, 2017

Legend

Definition of Laboratory Terms

- ND** - Not Detected at levels equal to or greater than the MDL
- BRL** - Not Detected at levels equal to or greater than the RL
- RL** - Reporting Limit **MDL** - Method Detection Limit
- SOP** - Method run per Pace Standard Operating Procedure
- CFU** - Colony Forming Units
- DF** - Dilution Factor **TIC** - Tentatively Identified Compound

Sample Information

N-Nitrosodiphenylamine breaks down to diphenylamine in the GCMS; both analytes are reported as N-Nitrosodiphenylamine. Pace is not NELAC certified for N-Nitrosodiphenylamine.

Phthalic acid and phthalic anhydride are reported as dimethyl phthalate

Maleic acid and maleic anhydride are reported as dimethyl malate

1,2-Diphenylhydrazine breaks down to azobenzene in the GCMS; both analytes are reported as azobenzene

Definition of Qualifiers

- QR-01** RPD was outside acceptance limits due to sample concentrations near or below the reporting limit.
- QM-02** The spike recovery is outside acceptance limits due to insignificant spike amount as compared to sample concentration.
- J** Estimated value less than Reporting Limit (RL) but greater than Method Detection Limit(MDL) (CLP J-Flag).
- B-01** Analyte was detected in the associated method blank at an estimated level equal to or greater than the MDL. Sample values reported as greater than the MDL and less than 10x the method blank value are reported as estimated values.

Note: Unless otherwise noted, all results are reported on an as received basis.



CHAIN OF CUSTODY RECORD

Pace Analytical Services, LLC - Atlanta GA
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201

PAGE: 1 OF 1

CLIENT NAME: **GEORGIA POWER**
 CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER:
 241 RALPH MCGILL BLYD SE B 10185
 ATLANTA GA 30306
 404-504-7259
 REPORT TO: DAWN PRELL
 DAWN.PRELL@GOLDER.COM
 REQUESTED COMPLETION DATE:
 PROJECT NAME/STATE: **PLANT McDONOUGH AP**

CONTAINER TYPE: **P - PLASTIC**
 A - AMBER GLASS
 G - CLEAR GLASS
 V - VOA VIAL
 S - STERILE
 O - OTHER

PRESERVATION:
 1 - HCl, 56°C
 2 - H₂SO₄, 56°C
 3 - HNO₃
 4 - NaOH, 56°C
 5 - NaOH/ZnAc, 56°C
 6 - Na₂S₂O₅, 56°C
 7 - 56°C not frozen

CONTAINER TYPE: **P - PLASTIC**
 A - AMBER GLASS
 G - CLEAR GLASS
 V - VOA VIAL
 S - STERILE
 O - OTHER

PRESERVATION:
 1 - HCl, 56°C
 2 - H₂SO₄, 56°C
 3 - HNO₃
 4 - NaOH, 56°C
 5 - NaOH/ZnAc, 56°C
 6 - Na₂S₂O₅, 56°C
 7 - 56°C not frozen

PROJECT #: **PHASE II CCR**

CONTAINER TYPE: **P - PLASTIC**
 A - AMBER GLASS
 G - CLEAR GLASS
 V - VOA VIAL
 S - STERILE
 O - OTHER

PRESERVATION:
 1 - HCl, 56°C
 2 - H₂SO₄, 56°C
 3 - HNO₃
 4 - NaOH, 56°C
 5 - NaOH/ZnAc, 56°C
 6 - Na₂S₂O₅, 56°C
 7 - 56°C not frozen

Collection DATE	Collection TIME	MATRIX CODE*	SAMPLE IDENTIFICATION
5-11-17	1612	GW	DGWA-2
5-11-17	1603	GW	DGWA-53
5-11-17	1500	W	FB-1
5-12-17	0730	W	EB-1

L	A	B	I	D	N	U	M	B	E	R
1										
2										
3										
4										

Collection DATE	Collection TIME	MATRIX CODE*	SAMPLE IDENTIFICATION	CGORAB
5-11-17	1612	GW	DGWA-2	X
5-11-17	1603	GW	DGWA-53	X
5-11-17	1500	W	FB-1	X
5-12-17	0730	W	EB-1	X

CONTAINER TYPE:	PRESERVATION:	# OF
P	3	3
F		
F		
F		

SAMPLED BY AND TITLE: **AUBREY ELLIS**
 RECEIVED BY: **Ngou, A**
 RECEIVED BY LAB: **Ngou, A**
 DATE/TIME: **05-12-2017 10730**
 DATE/TIME: **5/12/17 0853**
 DATE/TIME: **05/12/17 1020**
 Temperature: **21.5** Min: **2.5** Max: **2.5**

RELINQUISHED BY: **Aubrey Ellis**
 RELINQUISHED BY: **Aubrey Ellis**
 SAMPLE SHIPPED VIA: **UPS**
 UPS FED-EX USPS COURIER CLIENT OTHER FS
 CUSTODY SEAL: **Intact**
 Broken Not Present: **N/A**
 Cooler ID: **N/A**

CONTAINER TYPE	PRESERVATION	ANALYSIS REQUESTED	DATE/TIME	DATE/TIME
P	3	METALS APP III + IV	5-12-17	853
F		(EPA 6020/470)		
F		CI, F, SO ₄ + TS		
F		(EPA 300.0 + 57254C)		
F		Radium 226 + 228		
F		(GW-846 9315/932)		

LAB #: **AAE0439**
 Entered into LIMS:
 Tracking #:



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

LOG-IN CHECKLIST

Printed: 5/15/2017 8:43:32AM

Attn: Mr. Joju Abraham

Client: Georgia Power

Project: CCR Event

Date Received: 05/12/17 10:20

Work Order: AAE0439

Logged In By: Mohammad M. Rahman

OBSERVATIONS

#Samples: 4

#Containers: 18

Minimum Temp(C): 2.5

Maximum Temp(C): 2.5

Custody Seal(s) Used: N/A

CHECKLIST ITEMS

COC included with Samples	YES
Sample Container(s) Intact	YES
Chain of Custody Complete	YES
Sample Container(s) Match COC	YES
Custody seal Intact	N/A
Temperature in Compliance	YES
Sufficient Sample Volume for Analysis	YES
Zero Headspace Maintained for VOA Analyses	YES
Samples labeled preserved (If Applicable)	YES
Samples received within Allowable Hold Times	YES
Samples Received on Ice	YES
Preservation Confirmed	YES

Comments:

June 07, 2017

Maria Padilla
GA Power
2480 Maner Rd
Atlanta, GA 30339

RE: Project: AAE0439 Plant McDonough
Pace Project No.: 30218862

Dear Maria Padilla:

Enclosed are the analytical results for sample(s) received by the laboratory on May 15, 2017. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Jacquelyn Collins
jacquelyn.collins@pacelabs.com
(724)850-5612
Project Manager

Enclosures



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: AAE0439 Plant McDonough
Pace Project No.: 30218862

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601
L-A-B DOD-ELAP Accreditation #: L2417
Alabama Certification #: 41590
Arizona Certification #: AZ0734
Arkansas Certification
California Certification #: 04222CA
Colorado Certification
Connecticut Certification #: PH-0694
Delaware Certification
Florida/TNI Certification #: E87683
Georgia Certification #: C040
Guam Certification
Hawaii Certification
Idaho Certification
Illinois Certification
Indiana Certification
Iowa Certification #: 391
Kansas/TNI Certification #: E-10358
Kentucky Certification #: 90133
Louisiana DHH/TNI Certification #: LA140008
Louisiana DEQ/TNI Certification #: 4086
Maine Certification #: PA00091
Maryland Certification #: 308
Massachusetts Certification #: M-PA1457
Michigan/PADEP Certification
Missouri Certification #: 235

Montana Certification #: Cert 0082
Nebraska Certification #: NE-05-29-14
Nevada Certification #: PA014572015-1
New Hampshire/TNI Certification #: 2976
New Jersey/TNI Certification #: PA 051
New Mexico Certification #: PA01457
New York/TNI Certification #: 10888
North Carolina Certification #: 42706
North Dakota Certification #: R-190
Oregon/TNI Certification #: PA200002
Pennsylvania/TNI Certification #: 65-00282
Puerto Rico Certification #: PA01457
Rhode Island Certification #: 65-00282
South Dakota Certification
Tennessee Certification #: TN2867
Texas/TNI Certification #: T104704188-14-8
Utah/TNI Certification #: PA014572015-5
USDA Soil Permit #: P330-14-00213
Vermont Dept. of Health: ID# VT-0282
Virgin Island/PADEP Certification
Virginia/VELAP Certification #: 460198
Washington Certification #: C868
West Virginia DEP Certification #: 143
West Virginia DHHR Certification #: 9964C
Wisconsin Certification
Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: AAE0439 Plant McDonough

Pace Project No.: 30218862

Lab ID	Sample ID	Matrix	Date Collected	Date Received
30218862001	DGWA-2	Water	05/11/17 16:12	05/15/17 09:30
30218862002	DGWA-53	Water	05/11/17 16:03	05/15/17 09:30
30218862003	FB-1	Water	05/11/17 15:00	05/15/17 09:30
30218862004	EB-1	Water	05/12/17 07:30	05/15/17 09:30

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: AAE0439 Plant McDonough
Pace Project No.: 30218862

Lab ID	Sample ID	Method	Analysts	Analytes Reported
30218862001	DGWA-2	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	CMC	1
30218862002	DGWA-53	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	CMC	1
30218862003	FB-1	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	CMC	1
30218862004	EB-1	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	CMC	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAE0439 Plant McDonough

Pace Project No.: 30218862

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226		EPA 9315	0.223 ± 0.198 (0.384) C:84% T:NA	pCi/L	05/22/17 09:24	13982-63-3	
Radium-228		EPA 9320	0.669 ± 0.356 (0.637) C:96% T:84%	pCi/L	06/02/17 16:28	15262-20-1	
Total Radium		Total Radium Calculation	0.892 ± 0.554 (1.02)	pCi/L	06/06/17 14:13	7440-14-4	

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226		EPA 9315	1.98 ± 0.498 (0.366) C:86% T:NA	pCi/L	05/22/17 09:24	13982-63-3	
Radium-228		EPA 9320	1.47 ± 0.470 (0.623) C:94% T:91%	pCi/L	06/02/17 16:28	15262-20-1	
Total Radium		Total Radium Calculation	3.45 ± 0.968 (0.989)	pCi/L	06/06/17 14:13	7440-14-4	

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226		EPA 9315	-0.000829 ± 0.0628 (0.185) C:79% T:NA	pCi/L	05/24/17 11:25	13982-63-3	
Radium-228		EPA 9320	0.388 ± 0.372 (0.767) C:92% T:81%	pCi/L	06/02/17 16:29	15262-20-1	
Total Radium		Total Radium Calculation	0.388 ± 0.435 (0.952)	pCi/L	06/06/17 14:13	7440-14-4	

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226		EPA 9315	-0.0385 ± 0.0338 (0.171) C:83% T:NA	pCi/L	05/24/17 11:25	13982-63-3	
Radium-228		EPA 9320	0.473 ± 0.354 (0.697) C:94% T:80%	pCi/L	06/02/17 16:29	15262-20-1	
Total Radium		Total Radium Calculation	0.473 ± 0.388 (0.868)	pCi/L	06/06/17 14:13	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAE0439 Plant McDonough

Pace Project No.: 30218862

QC Batch: 258733 Analysis Method: EPA 9315

QC Batch Method: EPA 9315 Analysis Description: 9315 Total Radium

Associated Lab Samples: 30218862001, 30218862002, 30218862003, 30218862004

METHOD BLANK: 1274461 Matrix: Water

Associated Lab Samples: 30218862001, 30218862002, 30218862003, 30218862004

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.00989 ± 0.108 (0.288) C:89% T:NA	pCi/L	05/22/17 09:24	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAE0439 Plant McDonough

Pace Project No.: 30218862

QC Batch: 259469

Analysis Method: EPA 9320

QC Batch Method: EPA 9320

Analysis Description: 9320 Radium 228

Associated Lab Samples: 30218862001, 30218862002, 30218862003, 30218862004

METHOD BLANK: 1278134

Matrix: Water

Associated Lab Samples: 30218862001, 30218862002, 30218862003, 30218862004

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.550 ± 0.338 (0.616) C:94% T:73%	pCi/L	06/02/17 16:30	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: AAE0439 Plant McDonough

Pace Project No.: 30218862

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

WO# : 30218862



Chain of Custody



Workorder: AAE0439

Workorder Name: Plant McDonough

Results Requested By: 6/6/2017

Owner Received Date:

Report To:		Subcontract To:				Requested Analysis				
Betsy McDaniel Pace Analytical Atlanta 110 Technology Parkway Peachtree Corners, GA 30092 Phone (770)-734-4200		Pace - Pittsburgh 1638 Roseytown Road Stes. 2,3,4 Greensburg, PA 15601 Phone (724) 850-5600				Radium 226, 228, Total				
Item	Sample ID	Sample Type	Collect Date/Time	Lab ID	Matrix	Matrix	Matrix	Matrix	Matrix	LAB USE ONLY
1	DGWA-2	G	5/11/2017 16:12	AAE0439-01	GW	GW	GW	GW	GW	001
2	DGWA-53	G	5/11/2017 16:03	AAE0439-02	GW	GW	GW	GW	GW	002
3	FB-1	G	5/11/2017 15:00	AAE0439-03	W	W	W	W	W	003
4	EB-1	G	5/12/2017 7:30	AAE0439-04	W	W	W	W	W	004
5										
6										
7										
8										
9										
10										
Transfers	Released By	Date/Time	Received By	Date/Time	Date/Time	Comments				
1	M. RAHMAN	5/24/17	BBj Pace	5/15/17 0930						
2										
3										

Cooler Temperature on Receipt N/A °C Custody Seal Y or (N) Received on Ice Y or (N) Sample Intact Y or N

***In order to maintain client confidentiality, location/name of the sampling site, sampler's name and signature may not be provided on this COC
 This chain of custody is considered complete as is since this information is available in the owner laboratory.

Sample Condition Upon Receipt Pittsburgh



Client Name: Pace GA

Project # 30218862

RTB

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: 6812 5104 3558

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Thermometer Used N/A Type of Ice: Wet Blue None

Cooler Temperature Observed Temp N/A °C Correction Factor: N/A °C Final Temp: N/A °C

Temp should be above freezing to 6°C

Date and Initials of person examining contents: RTB 5/15/17

Comments:	Yes	No	N/A	
Chain of Custody Present:	X			1.
Chain of Custody Filled Out:	X			2.
Chain of Custody Relinquished:	X			3.
Sampler Name & Signature on COC:	X			4.
Sample Labels match COC:	X			5.
-Includes date/time/ID Matrix: <u>WT</u>				
Samples Arrived within Hold Time:	X			6.
Short Hold Time Analysis (<72hr remaining):		X		7.
Rush Turn Around Time Requested:		X		8.
Sufficient Volume:	X			9.
Correct Containers Used:	X			10.
-Pace Containers Used:	X			
Containers Intact:	X			11.
Orthophosphate field filtered			X	12.
Organic Samples checked for dechlorination:			X	13.
Filtered volume received for Dissolved tests			X	14.
All containers have been checked for preservation.	X			15.
All containers needing preservation are found to be in compliance with EPA recommendation.	X			<u>PH < 2</u>
exceptions: VOA, coliform, TOC, O&G, Phenolics				Initial when completed <u>5/15/17</u> Date/time of preservation <u>RTB</u>
				Lot # of added preservative
Headspace in VOA Vials (>6mm):			X	16.
Trip Blank Present:			X	17.
Trip Blank Custody Seals Present			X	
Rad Aqueous Samples Screened > 0.5 mrem/hr		X		Initial when completed: <u>RTB</u> Date: <u>5/15/17</u>

Client Notification/ Resolution:

Person Contacted: _____ Date/Time: _____ Contacted By: _____

Comments/ Resolution: _____

A check in this box indicates that additional information has been stored in ereports.

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

*PM review is documented electronically in LIMS. When the Project Manager closes the SRF Review schedule in LIMS. The review is in the Status section of the Workorder Edit Screen.

30218862

Pace Analytical Services, LLC - Atlanta GA
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201

CHAIN OF CUSTODY RECORD

PAGE: 1 OF 1



CLIENT NAME: GEORGIA POWER CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 RALPH MCGILL BLVD SE B 10185 ATLANTA GA 30308 404-506-7259 REPORT TO: DAWN PRELL DAWN.PRELL@GOLDER.COM REQUESTED COMPLETION DATE: PROJECT NAME/STATE: PLANT McDonough AP PROJECT #: PHASE II CLR		CONTAINER TYPE: PRESERVATION: # of CONTAINERS ANALYSIS REQUESTED METALS APP III + IV (EPA 6020/413) CI, Ti, SO ₄ + TB (EPA 300.0 + 5712540C) RADUUM 226 + 228 (GW-846 9315/932)		CONTAINER TYPE PRESERVATION P - PLASTIC A - AMBER GLASS G - CLEAR GLASS V - VOA VIAL S - STERILE O - OTHER 1 - HCl, 56°C 2 - H ₂ SO ₄ , 56°C 3 - HNO ₃ 4 - NaOH, 56°C 5 - NaOH/ZnAc, 56°C 6 - Na ₂ S ₂ O ₃ , 56°C 7 - 56°C not frozen	
PROJECT NAME/STATE: PLANT McDonough AP PROJECT #: PHASE II CLR		MATRIX CODE COLLECTION TIME SAMPLE IDENTIFICATION 5-11-17 1612 GW DGWA-2 5-11-17 1603 GW DGWA-53 5-11-17 1500 W FB-1 5-12-17 0730 W EB-1		MATRIX CODES: DW - DRINKING WATER WW - WASTEWATER GW - GROUNDWATER SW - SURFACE WATER ST - STORM WATER W - WATER S - SOIL SL - SLUDGE SD - SOLID A - AIR L - LIQUID P - PRODUCT REMARKS/ADDITIONAL INFORMATION EXTRA RAD	
LAB # ENTERED INTO LIMS: TRACKING #		DATE/TIME 5-12-17 / 0730 DATE/TIME		FOR LAB USE ONLY AA E0439 MA	
RELINQUISHED BY: SIGNATURE: <i>[Signature]</i> DATE/TIME: 5-12-17 0853		SAMPLE SHIPPED VIA: UPS CARRIER: <i>[Signature]</i> CLIENT: COURIER OTHER: FS		DATE/TIME: 5-12-17 / 0730 DATE/TIME	
RECEIVED BY: SIGNATURE: <i>[Signature]</i> DATE/TIME: 5-12-17 0853		SAMPLE SHIPPED VIA: UPS CARRIER: <i>[Signature]</i> CLIENT: COURIER OTHER: FS		DATE/TIME: 5-12-17 / 0730 DATE/TIME	
RECEIVED BY: SIGNATURE: <i>[Signature]</i> DATE/TIME: 5-12-17 1020		SAMPLE SHIPPED VIA: UPS CARRIER: <i>[Signature]</i> CLIENT: COURIER OTHER: FS		DATE/TIME: 5-12-17 / 0730 DATE/TIME	

Quality Control Sample Performance Assessment



Test: Ra-228
Analyst: JLW
Date: 5/27/2017
Worklist: 35805
Matrix: DW

Method Blank Assessment	
MB Sample ID	1278134
MB concentration:	0.550
M/B Counting Uncertainty:	0.323
MB MDC:	0.616
MB Numerical Performance Indicator:	3.34
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment		LCSD (Y or N)?	N
		LCS35805	LCS35805
Count Date:	6/2/2017		
Spike I.D.:	17-005		
Spike Concentration (pCi/mL):	24,388		
Volume Used (mL):	0.20		
Aliquot Volume (L, g, F):	0.829		
Target Conc. (pCi/L, g, F):	5.885		
Uncertainty (Calculated):	0.424		
Result (pCi/L, g, F):	6.176		
LCSD/LCSD Counting Uncertainty (pCi/L, g, F):	0.678		
Numerical Performance Indicator:	0.71		
Percent Recovery:	104.93%		
Status vs Numerical Indicator:	N/A		
Status vs Recovery:	Pass		

Duplicate Sample Assessment	
Sample I.D.:	30218862001
Duplicate Sample I.D.:	30218862001DUP
Sample Result (pCi/L, g, F):	0.669
Sample Result Counting Uncertainty (pCi/L, g, F):	0.335
Sample Duplicate Result (pCi/L, g, F):	0.732
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.329
Are sample and/or duplicate results below MDC?	See Below ##
Duplicate Numerical Performance Indicator:	-0.265
Duplicate RPD:	9.05%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Pass

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

John Miller

Analyst Must Manually Enter All Fields Highlighted in Yellow.

Sample Matrix Spike Control Assessment
Sample Collection Date: Sample I.D. Sample MS I.D. Sample MSD I.D. Spike I.D.:
M/S/MSD Decay Corrected Spike Concentration (pCi/mL): Spike Volume Used in MS (mL): Spike Volume Used in MSD (mL): MS Aliquot (L, g, F): MS Target Conc. (pCi/L, g, F): MSD Aliquot (L, g, F): MSD Target Conc. (pCi/L, g, F): Spike uncertainty (calculated):
Sample Result: Sample Result Counting Uncertainty (pCi/L, g, F): Sample Matrix Spike Result: Matrix Spike Result Counting Uncertainty (pCi/L, g, F): Sample Matrix Spike Duplicate Result: Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F): MS Numerical Performance Indicator: MSD Numerical Performance Indicator:
MS Percent Recovery: MSD Percent Recovery: MS Status vs Numerical Indicator: MSD Status vs Numerical Indicator: MS Status vs Recovery: MSD Status vs Recovery:

Matrix Spike/Matrix Spike Duplicate Sample Assessment
Sample I.D. Sample MS I.D. Sample MSD I.D. Spike I.D.:
Sample Matrix Spike Result: Sample Matrix Spike Result Counting Uncertainty (pCi/L, g, F): Sample Matrix Spike Duplicate Result: Sample Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F): Duplicate Numerical Performance Indicator: (Based on the Percent Recoveries) MS/MSD Duplicate RPD: MS/MSD Duplicate Status vs Numerical Indicator: MS/MSD Duplicate Status vs RPD:

Quality Control Sample Performance Assessment



www.faceanalytical.com

Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: LAL
Date: 5/22/2017
Worklist: 35680
Matrix: DW

Method Blank Assessment	
MB Sample ID	1274461
MB Concentration:	0.010
MB Counting Uncertainty:	0.108
MB MDC:	0.288
MB Numerical Performance Indicator:	0.18
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment	
LCS (Y or N)?	N
LCS35680	LCS35680
Count Date:	5/24/2017
Spike I.D.:	13-033
Spike Concentration (pCi/mL):	19.848
Volume Used (mL):	0.40
Aliquot Volume (L, g, F):	0.502
Target Conc. (pCi/L, g, F):	15.827
Uncertainty (Calculated):	0.745
Result (pCi/L, g, F):	14.483
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.895
Numerical Performance Indicator:	-2.26
Percent Recovery:	91.51%
Status vs Numerical Indicator:	N/A
Status vs Recovery:	Pass

Duplicate Sample Assessment	
Sample I.D.:	30218862001
Duplicate Sample I.D.:	30218862001DUP
Sample Result (pCi/L, g, F):	0.223
Sample Result Counting Uncertainty (pCi/L, g, F):	0.195
Sample Duplicate Result (pCi/L, g, F):	0.160
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.143
Are sample and/or duplicate results below MDC?	See Below ##
Duplicate Numerical Performance Indicator:	0.510
Duplicate RPD:	32.90%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Fail***

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

***Batch must be re-prepped due to unacceptable precision.

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Matrix Spike Result:	
Sample Matrix Spike Result:	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Laboratory Report

Prepared For:

**Georgia Power
2480 Maner Road
Atlanta, GA 30339**

Attention: Mr. Joju Abraham

Report Number: AAE0482

May 24, 2017

Project: CCR Event

Project #:Plant McDonough

We appreciate the opportunity to provide the analytical support for your project. The analytical results in this report are based upon information supplied by you, the client, and are for your exclusive use. If you have any questions regarding this data package, please do not hesitate to call.

Approved:

A handwritten signature in black ink that reads "Betsy McDonough". The signature is written over a horizontal line.

Project Manager

This report may not be reproduced, except in full, without written approval from Pace Analytical Services, LLC.
All test results relate only to the samples analyzed.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
DGWA-71	AAE0482-01	Ground Water	05/12/17 11:08	05/13/17 11:30
FD-1	AAE0482-02	Ground Water	05/12/17 00:00	05/13/17 11:30
DGWC-4	AAE0482-03	Ground Water	05/12/17 14:12	05/13/17 11:30
DGWC-23	AAE0482-04	Ground Water	05/12/17 16:31	05/13/17 11:30
DGWC-67	AAE0482-05	Ground Water	05/12/17 16:18	05/13/17 11:30
DGWC-68A	AAE0482-06	Ground Water	05/12/17 13:21	05/13/17 11:30
DGWC-69	AAE0482-07	Ground Water	05/12/17 11:29	05/13/17 11:30



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

Case Narrative

The Radium analysis by methods EPA 9315/9320 was performed by Pace-Pittsburgh, 1638 Roseytown Road - Suites 2, 3, 4, Greensburg PA 15601. The Pace-Pittsburgh lab contact is Jacquelyn Collins at 724-850-5612.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

Report No.: AAE0482

Project: CCR Event

Client ID: DGWA-71

Lab Number ID: AAE0482-01

Date/Time Sampled: 5/12/2017 11:08:00AM

Date/Time Received: 5/13/2017 11:30:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	92	25	10	mg/L	SM 2540 C		1	05/18/17 12:40	05/18/17 12:40	7050535	JPT
Inorganic Anions											
Chloride	3.8	0.25	0.01	mg/L	EPA 300.0		1	05/15/17 19:30	05/16/17 15:15	7050518	SLH
Fluoride	ND	0.30	0.004	mg/L	EPA 300.0		1	05/15/17 19:30	05/16/17 15:15	7050518	SLH
Sulfate	17	1.0	0.09	mg/L	EPA 300.0		1	05/15/17 19:30	05/16/17 15:15	7050518	SLH
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:55	7050544	CSW
Arsenic	0.0004	0.0050	0.0004	mg/L	EPA 6020B	J	1	05/16/17 14:25	05/19/17 11:55	7050544	CSW
Barium	0.0400	0.0100	0.0003	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:55	7050544	CSW
Beryllium	ND	0.0030	0.00007	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:55	7050544	CSW
Boron	0.0082	0.0400	0.0060	mg/L	EPA 6020B	J	1	05/16/17 14:25	05/19/17 11:55	7050544	CSW
Cadmium	ND	0.0010	0.00006	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:55	7050544	CSW
Calcium	8.04	0.500	0.0104	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:55	7050544	CSW
Chromium	0.0004	0.0100	0.0003	mg/L	EPA 6020B	J	1	05/16/17 14:25	05/19/17 11:55	7050544	CSW
Cobalt	0.0016	0.0100	0.0005	mg/L	EPA 6020B	J	1	05/16/17 14:25	05/19/17 11:55	7050544	CSW
Lead	0.00008	0.0050	0.00007	mg/L	EPA 6020B	J	1	05/16/17 14:25	05/19/17 11:55	7050544	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:55	7050544	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:55	7050544	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	05/16/17 14:25	05/19/17 11:55	7050544	CSW
Lithium	0.0016	0.0500	0.0011	mg/L	EPA 6020B	J	1	05/16/17 14:25	05/19/17 11:55	7050544	CSW
Mercury	0.00006	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	05/18/17 08:30	05/18/17 14:27	7050598	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

May 24, 2017

Attention: Mr. Joju Abraham

Report No.: AAE0482

Project: CCR Event

Client ID: FD-1

Lab Number ID: AAE0482-02

Date/Time Sampled: 5/12/2017 12:00:00AM

Date/Time Received: 5/13/2017 11:30:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	121	25	10	mg/L	SM 2540 C		1	05/18/17 12:40	05/18/17 12:40	7050535	JPT
Inorganic Anions											
Chloride	3.8	0.25	0.01	mg/L	EPA 300.0		1	05/15/17 19:30	05/16/17 15:36	7050518	SLH
Fluoride	ND	0.30	0.004	mg/L	EPA 300.0		1	05/15/17 19:30	05/16/17 15:36	7050518	SLH
Sulfate	17	1.0	0.09	mg/L	EPA 300.0		1	05/15/17 19:30	05/16/17 15:36	7050518	SLH
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 18:40	7050560	CSW
Arsenic	0.0004	0.0050	0.0004	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 18:40	7050560	CSW
Barium	0.0384	0.0100	0.0003	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 18:40	7050560	CSW
Beryllium	0.00009	0.0030	0.00007	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 18:40	7050560	CSW
Boron	0.0110	0.0400	0.0060	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 18:40	7050560	CSW
Cadmium	ND	0.0010	0.00006	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 18:40	7050560	CSW
Calcium	8.92	5.00	0.522	mg/L	EPA 6020B	B-01	50	05/17/17 14:40	05/18/17 18:46	7050560	CSW
Chromium	ND	0.0100	0.0003	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 18:40	7050560	CSW
Cobalt	0.0017	0.0100	0.0005	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 18:40	7050560	CSW
Lead	0.00007	0.0050	0.00007	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 18:40	7050560	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 18:40	7050560	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 18:40	7050560	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 18:40	7050560	CSW
Lithium	0.0019	0.0500	0.0011	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 18:40	7050560	CSW
Mercury	0.00007	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	05/18/17 08:30	05/18/17 14:29	7050598	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

Report No.: AAE0482

Project: CCR Event

Client ID: DGWC-4

Lab Number ID: AAE0482-03

Date/Time Sampled: 5/12/2017 2:12:00PM

Date/Time Received: 5/13/2017 11:30:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	1230	25	10	mg/L	SM 2540 C		1	05/18/17 12:40	05/18/17 12:40	7050535	JPT
Inorganic Anions											
Chloride	29	0.25	0.01	mg/L	EPA 300.0		1	05/15/17 19:30	05/16/17 17:19	7050518	SLH
Fluoride	ND	0.30	0.004	mg/L	EPA 300.0		1	05/15/17 19:30	05/16/17 17:19	7050518	SLH
Sulfate	680	20	1.8	mg/L	EPA 300.0		20	05/15/17 19:30	05/22/17 19:07	7050518	SLH
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 18:51	7050560	CSW
Arsenic	0.0005	0.0050	0.0004	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 18:51	7050560	CSW
Barium	0.0337	0.0100	0.0003	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 18:51	7050560	CSW
Beryllium	0.0002	0.0030	0.00007	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 18:51	7050560	CSW
Boron	3.58	0.0400	0.0060	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 18:51	7050560	CSW
Cadmium	0.0006	0.0010	0.00006	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 18:51	7050560	CSW
Calcium	233	25.0	0.522	mg/L	EPA 6020B	B-01	50	05/17/17 14:40	05/18/17 18:57	7050560	CSW
Chromium	ND	0.0100	0.0003	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 18:51	7050560	CSW
Cobalt	0.0015	0.0100	0.0005	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 18:51	7050560	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 18:51	7050560	CSW
Molybdenum	0.0062	0.0100	0.0006	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 18:51	7050560	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 18:51	7050560	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 18:51	7050560	CSW
Lithium	0.0027	0.0500	0.0011	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 18:51	7050560	CSW
Mercury	0.000082	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	05/18/17 08:30	05/18/17 14:32	7050598	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

Report No.: AAE0482

Project: CCR Event

Client ID: DGWC-23

Lab Number ID: AAE0482-04

Date/Time Sampled: 5/12/2017 4:31:00PM

Date/Time Received: 5/13/2017 11:30:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	438	25	10	mg/L	SM 2540 C		1	05/18/17 12:40	05/18/17 12:40	7050535	JPT
Inorganic Anions											
Chloride	17	0.25	0.01	mg/L	EPA 300.0		1	05/15/17 19:30	05/16/17 18:21	7050518	SLH
Fluoride	0.36	0.30	0.004	mg/L	EPA 300.0		1	05/15/17 19:30	05/16/17 18:21	7050518	SLH
Sulfate	220	10	0.92	mg/L	EPA 300.0		10	05/15/17 19:30	05/22/17 19:28	7050518	SLH
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:14	7050560	CSW
Arsenic	ND	0.0050	0.0004	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:14	7050560	CSW
Barium	0.0202	0.0100	0.0003	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:14	7050560	CSW
Beryllium	0.0004	0.0030	0.00007	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 19:14	7050560	CSW
Boron	4.03	0.0400	0.0060	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:14	7050560	CSW
Cadmium	0.0003	0.0010	0.00006	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 19:14	7050560	CSW
Calcium	71.1	25.0	0.522	mg/L	EPA 6020B	B-01	50	05/17/17 14:40	05/18/17 19:20	7050560	CSW
Chromium	0.0004	0.0100	0.0003	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 19:14	7050560	CSW
Cobalt	ND	0.0100	0.0005	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:14	7050560	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:14	7050560	CSW
Molybdenum	0.0085	0.0100	0.0006	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 19:14	7050560	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:14	7050560	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:14	7050560	CSW
Lithium	0.0036	0.0500	0.0011	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 19:14	7050560	CSW
Mercury	0.00015	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	05/18/17 08:30	05/18/17 14:34	7050598	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

Report No.: AAE0482

Project: CCR Event

Client ID: DGWC-67

Lab Number ID: AAE0482-05

Date/Time Sampled: 5/12/2017 4:18:00PM

Date/Time Received: 5/13/2017 11:30:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	287	25	10	mg/L	SM 2540 C		1	05/18/17 12:40	05/18/17 12:40	7050535	JPT
Inorganic Anions											
Chloride	5.6	0.25	0.01	mg/L	EPA 300.0		1	05/15/17 19:30	05/16/17 18:42	7050518	SLH
Fluoride	ND	0.30	0.004	mg/L	EPA 300.0		1	05/15/17 19:30	05/16/17 18:42	7050518	SLH
Sulfate	100	10	0.92	mg/L	EPA 300.0		10	05/15/17 19:30	05/22/17 19:49	7050518	SLH
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:26	7050560	CSW
Arsenic	ND	0.0050	0.0004	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:26	7050560	CSW
Barium	0.127	0.0100	0.0003	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:26	7050560	CSW
Beryllium	ND	0.0030	0.00007	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:26	7050560	CSW
Boron	3.24	0.0400	0.0060	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:26	7050560	CSW
Cadmium	ND	0.0010	0.00006	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:26	7050560	CSW
Calcium	43.6	25.0	0.522	mg/L	EPA 6020B	B-01	50	05/17/17 14:40	05/18/17 19:31	7050560	CSW
Chromium	0.0007	0.0100	0.0003	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 19:26	7050560	CSW
Cobalt	0.0037	0.0100	0.0005	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 19:26	7050560	CSW
Lead	0.00009	0.0050	0.00007	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 19:26	7050560	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:26	7050560	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:26	7050560	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:26	7050560	CSW
Lithium	0.0054	0.0500	0.0011	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 19:26	7050560	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	05/18/17 08:30	05/18/17 14:36	7050598	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

May 24, 2017

Attention: Mr. Joju Abraham

Report No.: AAE0482

Project: CCR Event

Client ID: DGWC-68A

Lab Number ID: AAE0482-06

Date/Time Sampled: 5/12/2017 1:21:00PM

Date/Time Received: 5/13/2017 11:30:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	300	25	10	mg/L	SM 2540 C		1	05/18/17 12:40	05/18/17 12:40	7050535	JPT
Inorganic Anions											
Chloride	4.2	0.25	0.01	mg/L	EPA 300.0		1	05/15/17 19:30	05/16/17 19:02	7050518	SLH
Fluoride	0.37	0.30	0.004	mg/L	EPA 300.0		1	05/15/17 19:30	05/16/17 19:02	7050518	SLH
Sulfate	50	1.0	0.09	mg/L	EPA 300.0		1	05/15/17 19:30	05/16/17 19:02	7050518	SLH
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:37	7050560	CSW
Arsenic	ND	0.0050	0.0004	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:37	7050560	CSW
Barium	0.0890	0.0100	0.0003	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:37	7050560	CSW
Beryllium	ND	0.0030	0.00007	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:37	7050560	CSW
Boron	1.80	0.0400	0.0060	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:37	7050560	CSW
Cadmium	0.00008	0.0010	0.00006	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 19:37	7050560	CSW
Calcium	51.7	25.0	0.522	mg/L	EPA 6020B	B-01	50	05/17/17 14:40	05/18/17 19:43	7050560	CSW
Chromium	ND	0.0100	0.0003	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:37	7050560	CSW
Cobalt	0.0015	0.0100	0.0005	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 19:37	7050560	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:37	7050560	CSW
Molybdenum	0.275	0.0100	0.0006	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:37	7050560	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:37	7050560	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:37	7050560	CSW
Lithium	0.0016	0.0500	0.0011	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 19:37	7050560	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	05/18/17 08:30	05/18/17 14:39	7050598	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

May 24, 2017

Attention: Mr. Joju Abraham

Report No.: AAE0482

Project: CCR Event

Client ID: DGWC-69

Lab Number ID: AAE0482-07

Date/Time Sampled: 5/12/2017 11:29:00AM

Date/Time Received: 5/13/2017 11:30:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	243	25	10	mg/L	SM 2540 C		1	05/18/17 12:40	05/18/17 12:40	7050535	JPT
Inorganic Anions											
Chloride	4.4	0.25	0.01	mg/L	EPA 300.0		1	05/15/17 19:30	05/16/17 19:23	7050518	SLH
Fluoride	0.12	0.30	0.004	mg/L	EPA 300.0	J	1	05/15/17 19:30	05/16/17 19:23	7050518	SLH
Sulfate	17	1.0	0.09	mg/L	EPA 300.0		1	05/15/17 19:30	05/16/17 19:23	7050518	SLH
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:49	7050560	CSW
Arsenic	0.0097	0.0050	0.0004	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:49	7050560	CSW
Barium	0.0929	0.0100	0.0003	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:49	7050560	CSW
Beryllium	ND	0.0030	0.00007	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:49	7050560	CSW
Boron	0.311	0.0400	0.0060	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:49	7050560	CSW
Cadmium	0.0002	0.0010	0.00006	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 19:49	7050560	CSW
Calcium	18.9	25.0	0.522	mg/L	EPA 6020B	B-01, J	50	05/17/17 14:40	05/18/17 19:54	7050560	CSW
Chromium	ND	0.0100	0.0003	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:49	7050560	CSW
Cobalt	0.0016	0.0100	0.0005	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 19:49	7050560	CSW
Lead	0.0001	0.0050	0.00007	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 19:49	7050560	CSW
Molybdenum	0.0117	0.0100	0.0006	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:49	7050560	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:49	7050560	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 19:49	7050560	CSW
Lithium	0.0030	0.0500	0.0011	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 19:49	7050560	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	05/18/17 08:30	05/18/17 14:41	7050598	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

Report No.: AAE0482

General Chemistry - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7050535 - SM 2540 C											
Blank (7050535-BLK1)						Prepared & Analyzed: 05/18/17					
Total Dissolved Solids	ND	25	10	mg/L							
LCS (7050535-BS1)						Prepared & Analyzed: 05/18/17					
Total Dissolved Solids	408	25	10	mg/L	400.00		102	84-108			
Duplicate (7050535-DUP1)						Source: AAE0482-07 Prepared & Analyzed: 05/18/17					
Total Dissolved Solids	132	25	10	mg/L		243			59	10	QR-03
Duplicate (7050535-DUP2)						Source: AAE0548-05 Prepared & Analyzed: 05/18/17					
Total Dissolved Solids	ND	25	10	mg/L		ND				10	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

Report No.: AAE0482

Inorganic Anions - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7050518 - EPA 300.0											
Blank (7050518-BLK1)						Prepared: 05/15/17 Analyzed: 05/16/17					
Chloride	ND	0.25	0.01	mg/L							
Fluoride	ND	0.30	0.004	mg/L							
Sulfate	ND	1.0	0.09	mg/L							
LCS (7050518-BS1)						Prepared: 05/15/17 Analyzed: 05/16/17					
Chloride	10.1	0.25	0.01	mg/L	10.020		101	90-110			
Fluoride	9.90	0.30	0.004	mg/L	10.020		99	90-110			
Sulfate	10.2	1.0	0.09	mg/L	10.050		102	90-110			
Matrix Spike (7050518-MS1)						Source: AAE0482-03 Prepared: 05/15/17 Analyzed: 05/16/17					
Chloride	36.4	0.25	0.01	mg/L	10.020	28.9	75	90-110			QM-02
Fluoride	10.3	0.30	0.004	mg/L	10.020	ND	103	90-110			
Sulfate	356	1.0	0.09	mg/L	10.050	376	NR	90-110			QM-02
Matrix Spike (7050518-MS2)						Source: AAE0503-02 Prepared: 05/15/17 Analyzed: 05/16/17					
Chloride	12.0	0.25	0.01	mg/L	10.020	1.82	101	90-110			
Fluoride	10.1	0.30	0.004	mg/L	10.020	0.02	101	90-110			
Sulfate	10.8	1.0	0.09	mg/L	10.050	0.45	103	90-110			
Matrix Spike Dup (7050518-MSD1)						Source: AAE0482-03 Prepared: 05/15/17 Analyzed: 05/16/17					
Chloride	36.4	0.25	0.01	mg/L	10.020	28.9	75	90-110	0.2	15	QM-02
Fluoride	10.5	0.30	0.004	mg/L	10.020	ND	105	90-110	2	15	
Sulfate	356	1.0	0.09	mg/L	10.050	376	NR	90-110	0.04	15	QM-02



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

Report No.: AAE0482

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7050544 - EPA 3005A											
Blank (7050544-BLK1)						Prepared: 05/16/17 Analyzed: 05/19/17					
Antimony	ND	0.0030	0.0003	mg/L							
Arsenic	ND	0.0050	0.0004	mg/L							
Barium	ND	0.0100	0.0003	mg/L							
Beryllium	ND	0.0030	0.00007	mg/L							
Boron	ND	0.0400	0.0060	mg/L							
Cadmium	ND	0.0010	0.00006	mg/L							
Calcium	ND	0.500	0.0104	mg/L							
Chromium	ND	0.0100	0.0003	mg/L							
Cobalt	ND	0.0100	0.0005	mg/L							
Copper	ND	0.0250	0.0003	mg/L							
Lead	ND	0.0050	0.00007	mg/L							
Molybdenum	ND	0.0100	0.0006	mg/L							
Nickel	ND	0.0100	0.0003	mg/L							
Selenium	ND	0.0100	0.0014	mg/L							
Silver	ND	0.0100	0.0003	mg/L							
Thallium	ND	0.0010	0.00005	mg/L							
Vanadium	ND	0.0100	0.0014	mg/L							
Zinc	ND	0.0100	0.0013	mg/L							
Lithium	ND	0.0500	0.0011	mg/L							
LCS (7050544-BS1)						Prepared: 05/16/17 Analyzed: 05/19/17					
Antimony	0.118	0.0030	0.0003	mg/L	0.10000		118	80-120			
Arsenic	0.104	0.0050	0.0004	mg/L	0.10000		104	80-120			
Barium	0.112	0.0100	0.0003	mg/L	0.10000		112	80-120			
Beryllium	0.107	0.0030	0.00007	mg/L	0.10000		107	80-120			
Boron	1.06	0.0400	0.0060	mg/L	1.0000		106	80-120			
Cadmium	0.112	0.0010	0.00006	mg/L	0.10000		112	80-120			
Calcium	1.02	0.500	0.0104	mg/L	1.0000		102	80-120			
Chromium	0.102	0.0100	0.0003	mg/L	0.10000		102	80-120			
Cobalt	0.100	0.0100	0.0005	mg/L	0.10000		100	80-120			
Copper	0.100	0.0250	0.0003	mg/L	0.10000		100	80-120			
Lead	0.114	0.0050	0.00007	mg/L	0.10000		114	80-120			
Molybdenum	0.111	0.0100	0.0006	mg/L	0.10000		111	80-120			
Nickel	0.105	0.0100	0.0003	mg/L	0.10000		105	80-120			
Selenium	0.105	0.0100	0.0014	mg/L	0.10000		105	80-120			
Silver	0.107	0.0100	0.0003	mg/L	0.10000		107	80-120			
Thallium	0.115	0.0010	0.00005	mg/L	0.10000		115	80-120			
Vanadium	0.101	0.0100	0.0014	mg/L	0.10000		101	80-120			
Zinc	0.0970	0.0100	0.0013	mg/L	0.10000		97	80-120			
Lithium	0.103	0.0500	0.0011	mg/L	0.10000		103	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

Report No.: AAE0482

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7050544 - EPA 3005A											
Duplicate (7050544-DUP1)			Source: AAE0482-01				Prepared: 05/16/17 Analyzed: 05/19/17				
Antimony	ND	0.0030	0.0003	mg/L		ND				20	
Arsenic	0.0007	0.0050	0.0004	mg/L		0.0004			45	20	QR-01, J
Barium	0.0392	0.0100	0.0003	mg/L		0.0400			2	20	
Beryllium	0.00009	0.0030	0.00007	mg/L		ND				20	J
Boron	0.0120	0.0400	0.0060	mg/L		0.0082			38	20	QR-01, J
Cadmium	0.00008	0.0010	0.00006	mg/L		ND				20	J
Calcium	8.23	0.500	0.0104	mg/L		8.04			2	20	
Chromium	0.0007	0.0100	0.0003	mg/L		0.0004			41	20	QR-01, J
Cobalt	0.0015	0.0100	0.0005	mg/L		0.0016			6	20	J
Copper	0.0004	0.0250	0.0003	mg/L		0.0004			17	20	J
Lead	0.00008	0.0050	0.00007	mg/L		0.00008			6	20	J
Molybdenum	ND	0.0100	0.0006	mg/L		ND				20	
Nickel	0.0013	0.0100	0.0003	mg/L		0.0015			10	20	J
Selenium	ND	0.0100	0.0014	mg/L		ND				20	
Silver	ND	0.0100	0.0003	mg/L		ND				20	
Thallium	ND	0.0010	0.00005	mg/L		ND				20	
Vanadium	ND	0.0100	0.0014	mg/L		ND				20	
Zinc	0.0027	0.0100	0.0013	mg/L		0.0032			17	20	J
Lithium	0.0017	0.0500	0.0011	mg/L		0.0016			9	20	J

Matrix Spike (7050544-MS1)			Source: AAE0439-01				Prepared: 05/16/17 Analyzed: 05/19/17				
Antimony	0.111	0.0030	0.0003	mg/L	0.10000	ND	111	75-125			
Arsenic	0.0989	0.0050	0.0004	mg/L	0.10000	ND	99	75-125			
Barium	0.123	0.0100	0.0003	mg/L	0.10000	0.0231	100	75-125			
Beryllium	0.0983	0.0030	0.00007	mg/L	0.10000	ND	98	75-125			
Boron	2.50	0.0400	0.0060	mg/L	1.0000	1.65	85	75-125			
Cadmium	0.106	0.0010	0.00006	mg/L	0.10000	0.0004	106	75-125			
Calcium	96.4	25.0	0.522	mg/L	1.0000	102	NR	75-125			QM-02
Chromium	0.0952	0.0100	0.0003	mg/L	0.10000	0.0005	95	75-125			
Cobalt	0.121	0.0100	0.0005	mg/L	0.10000	0.0284	92	75-125			
Copper	0.0940	0.0250	0.0003	mg/L	0.10000	0.0021	92	75-125			
Lead	0.101	0.0050	0.00007	mg/L	0.10000	0.00009	101	75-125			
Molybdenum	0.104	0.0100	0.0006	mg/L	0.10000	0.0009	103	75-125			
Nickel	0.124	0.0100	0.0003	mg/L	0.10000	0.0275	97	75-125			
Selenium	0.0980	0.0100	0.0014	mg/L	0.10000	ND	98	75-125			
Silver	0.0963	0.0100	0.0003	mg/L	0.10000	ND	96	75-125			
Thallium	0.103	0.0010	0.00005	mg/L	0.10000	ND	103	75-125			
Vanadium	0.0984	0.0100	0.0014	mg/L	0.10000	ND	98	75-125			
Zinc	0.101	0.0100	0.0013	mg/L	0.10000	0.0057	95	75-125			
Lithium	0.177	0.0500	0.0011	mg/L	0.10000	0.0850	92	75-125			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

Report No.: AAE0482

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7050544 - EPA 3005A											
Matrix Spike Dup (7050544-MSD1)			Source: AAE0439-01			Prepared: 05/16/17 Analyzed: 05/19/17					
Antimony	0.115	0.0030	0.0003	mg/L	0.10000	ND	115	75-125	3	20	
Arsenic	0.108	0.0050	0.0004	mg/L	0.10000	ND	108	75-125	9	20	
Barium	0.131	0.0100	0.0003	mg/L	0.10000	0.0231	108	75-125	6	20	
Beryllium	0.103	0.0030	0.00007	mg/L	0.10000	ND	103	75-125	5	20	
Boron	2.62	0.0400	0.0060	mg/L	1.0000	1.65	97	75-125	5	20	
Cadmium	0.106	0.0010	0.00006	mg/L	0.10000	0.0004	106	75-125	0.1	20	
Calcium	103	25.0	0.522	mg/L	1.0000	102	153	75-125	7	20	QM-02
Chromium	0.103	0.0100	0.0003	mg/L	0.10000	0.0005	102	75-125	7	20	
Cobalt	0.129	0.0100	0.0005	mg/L	0.10000	0.0284	100	75-125	6	20	
Copper	0.0985	0.0250	0.0003	mg/L	0.10000	0.0021	96	75-125	5	20	
Lead	0.108	0.0050	0.00007	mg/L	0.10000	0.00009	108	75-125	6	20	
Molybdenum	0.109	0.0100	0.0006	mg/L	0.10000	0.0009	109	75-125	5	20	
Nickel	0.124	0.0100	0.0003	mg/L	0.10000	0.0275	96	75-125	0.4	20	
Selenium	0.108	0.0100	0.0014	mg/L	0.10000	ND	108	75-125	9	20	
Silver	0.101	0.0100	0.0003	mg/L	0.10000	ND	101	75-125	4	20	
Thallium	0.110	0.0010	0.00005	mg/L	0.10000	ND	110	75-125	7	20	
Vanadium	0.0979	0.0100	0.0014	mg/L	0.10000	ND	98	75-125	0.5	20	
Zinc	0.101	0.0100	0.0013	mg/L	0.10000	0.0057	95	75-125	0.2	20	
Lithium	0.183	0.0500	0.0011	mg/L	0.10000	0.0850	98	75-125	3	20	
Post Spike (7050544-PS1)											
Source: AAE0439-01			Prepared: 05/16/17 Analyzed: 05/19/17								
Antimony	116			ug/L	100.00	0.103	115	80-120			
Arsenic	109			ug/L	100.00	0.281	109	80-120			
Barium	134			ug/L	100.00	23.1	111	80-120			
Beryllium	93.8			ug/L	100.00	0.0523	94	80-120			
Boron	2480			ug/L	1000.0	1650	83	80-120			
Cadmium	112			ug/L	100.00	0.406	111	80-120			
Calcium	104000			ug/L	1000.0	102000	214	80-120			QM-02
Chromium	103			ug/L	100.00	0.548	103	80-120			
Cobalt	128			ug/L	100.00	28.4	100	80-120			
Copper	102			ug/L	100.00	2.11	100	80-120			
Lead	107			ug/L	100.00	0.0897	107	80-120			
Molybdenum	115			ug/L	100.00	0.864	115	80-120			
Nickel	130			ug/L	100.00	27.5	102	80-120			
Selenium	109			ug/L	100.00	0.999	108	80-120			
Silver	102			ug/L	100.00	0.0174	102	80-120			
Thallium	109			ug/L	100.00	-0.0195	109	80-120			
Vanadium	104			ug/L	100.00	0.633	104	80-120			
Zinc	101			ug/L	100.00	5.71	96	80-120			
Lithium	175			ug/L	100.00	85.0	90	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

Report No.: AAE0482

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7050560 - EPA 3005A											
Blank (7050560-BLK1)											
						Prepared: 05/17/17 Analyzed: 05/18/17					
Antimony	ND	0.0030	0.0003	mg/L							
Arsenic	ND	0.0050	0.0004	mg/L							
Barium	ND	0.0100	0.0003	mg/L							
Beryllium	ND	0.0030	0.00007	mg/L							
Boron	ND	0.0400	0.0060	mg/L							
Cadmium	ND	0.0010	0.00006	mg/L							
Calcium	0.0124	0.500	0.0104	mg/L							J
Chromium	ND	0.0100	0.0003	mg/L							
Cobalt	ND	0.0100	0.0005	mg/L							
Copper	ND	0.0250	0.0003	mg/L							
Lead	ND	0.0050	0.00007	mg/L							
Molybdenum	ND	0.0100	0.0006	mg/L							
Nickel	ND	0.0100	0.0003	mg/L							
Selenium	ND	0.0100	0.0014	mg/L							
Silver	ND	0.0100	0.0003	mg/L							
Thallium	ND	0.0010	0.00005	mg/L							
Vanadium	ND	0.0100	0.0014	mg/L							
Zinc	ND	0.0100	0.0013	mg/L							
Lithium	ND	0.0500	0.0011	mg/L							
LCS (7050560-BS1)											
						Prepared: 05/17/17 Analyzed: 05/18/17					
Antimony	0.107	0.0030	0.0003	mg/L	0.10000		107	80-120			
Arsenic	0.103	0.0050	0.0004	mg/L	0.10000		103	80-120			
Barium	0.106	0.0100	0.0003	mg/L	0.10000		106	80-120			
Beryllium	0.106	0.0030	0.00007	mg/L	0.10000		106	80-120			
Boron	1.07	0.0400	0.0060	mg/L	1.0000		107	80-120			
Cadmium	0.108	0.0010	0.00006	mg/L	0.10000		108	80-120			
Calcium	1.05	0.500	0.0104	mg/L	1.0000		105	80-120			
Chromium	0.105	0.0100	0.0003	mg/L	0.10000		105	80-120			
Cobalt	0.103	0.0100	0.0005	mg/L	0.10000		103	80-120			
Copper	0.102	0.0250	0.0003	mg/L	0.10000		102	80-120			
Lead	0.104	0.0050	0.00007	mg/L	0.10000		104	80-120			
Molybdenum	0.108	0.0100	0.0006	mg/L	0.10000		108	80-120			
Nickel	0.103	0.0100	0.0003	mg/L	0.10000		103	80-120			
Selenium	0.105	0.0100	0.0014	mg/L	0.10000		105	80-120			
Silver	0.107	0.0100	0.0003	mg/L	0.10000		107	80-120			
Thallium	0.107	0.0010	0.00005	mg/L	0.10000		107	80-120			
Vanadium	0.103	0.0100	0.0014	mg/L	0.10000		103	80-120			
Zinc	0.102	0.0100	0.0013	mg/L	0.10000		102	80-120			
Lithium	0.111	0.0500	0.0011	mg/L	0.10000		111	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

Report No.: AAE0482

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7050560 - EPA 3005A											
Matrix Spike (7050560-MS1)			Source: AAE0498-01				Prepared: 05/17/17 Analyzed: 05/18/17				
Antimony	0.108	0.0030	0.0003	mg/L	0.10000	ND	108	75-125			
Arsenic	0.0999	0.0050	0.0004	mg/L	0.10000	ND	100	75-125			
Barium	0.129	0.0100	0.0003	mg/L	0.10000	0.0181	111	75-125			
Beryllium	0.103	0.0030	0.00007	mg/L	0.10000	ND	103	75-125			
Boron	0.980	0.0400	0.0060	mg/L	1.0000	0.0073	97	75-125			
Cadmium	0.106	0.0010	0.00006	mg/L	0.10000	ND	106	75-125			
Calcium	7.92	25.0	0.522	mg/L	1.0000	6.50	142	75-125			QM-02, J
Chromium	0.104	0.0100	0.0003	mg/L	0.10000	0.0006	103	75-125			
Cobalt	0.104	0.0100	0.0005	mg/L	0.10000	0.0024	101	75-125			
Copper	0.103	0.0250	0.0003	mg/L	0.10000	0.0007	102	75-125			
Lead	0.103	0.0050	0.00007	mg/L	0.10000	0.0001	103	75-125			
Molybdenum	0.106	0.0100	0.0006	mg/L	0.10000	ND	106	75-125			
Nickel	0.106	0.0100	0.0003	mg/L	0.10000	0.0021	104	75-125			
Selenium	0.101	0.0100	0.0014	mg/L	0.10000	ND	101	75-125			
Silver	0.107	0.0100	0.0003	mg/L	0.10000	ND	107	75-125			
Thallium	0.106	0.0010	0.00005	mg/L	0.10000	ND	106	75-125			
Vanadium	0.103	0.0100	0.0014	mg/L	0.10000	ND	103	75-125			
Zinc	0.117	0.0100	0.0013	mg/L	0.10000	0.0142	103	75-125			
Lithium	0.105	0.0500	0.0011	mg/L	0.10000	0.0020	103	75-125			
Matrix Spike Dup (7050560-MSD1)			Source: AAE0498-01				Prepared: 05/17/17 Analyzed: 05/18/17				
Antimony	0.109	0.0030	0.0003	mg/L	0.10000	ND	109	75-125	0.8	20	
Arsenic	0.102	0.0050	0.0004	mg/L	0.10000	ND	102	75-125	2	20	
Barium	0.128	0.0100	0.0003	mg/L	0.10000	0.0181	109	75-125	1	20	
Beryllium	0.105	0.0030	0.00007	mg/L	0.10000	ND	105	75-125	2	20	
Boron	1.05	0.0400	0.0060	mg/L	1.0000	0.0073	104	75-125	7	20	
Cadmium	0.108	0.0010	0.00006	mg/L	0.10000	ND	108	75-125	2	20	
Calcium	7.66	25.0	0.522	mg/L	1.0000	6.50	116	75-125	3	20	J
Chromium	0.105	0.0100	0.0003	mg/L	0.10000	0.0006	104	75-125	1	20	
Cobalt	0.105	0.0100	0.0005	mg/L	0.10000	0.0024	102	75-125	1	20	
Copper	0.102	0.0250	0.0003	mg/L	0.10000	0.0007	102	75-125	0.3	20	
Lead	0.105	0.0050	0.00007	mg/L	0.10000	0.0001	105	75-125	1	20	
Molybdenum	0.107	0.0100	0.0006	mg/L	0.10000	ND	107	75-125	1	20	
Nickel	0.106	0.0100	0.0003	mg/L	0.10000	0.0021	104	75-125	0.5	20	
Selenium	0.104	0.0100	0.0014	mg/L	0.10000	ND	104	75-125	3	20	
Silver	0.106	0.0100	0.0003	mg/L	0.10000	ND	106	75-125	0.8	20	
Thallium	0.107	0.0010	0.00005	mg/L	0.10000	ND	107	75-125	0.6	20	
Vanadium	0.106	0.0100	0.0014	mg/L	0.10000	ND	106	75-125	3	20	
Zinc	0.119	0.0100	0.0013	mg/L	0.10000	0.0142	105	75-125	2	20	
Lithium	0.109	0.0500	0.0011	mg/L	0.10000	0.0020	107	75-125	4	20	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

Report No.: AAE0482

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7050560 - EPA 3005A											
Post Spike (7050560-PS1)			Source: AAE0498-01			Prepared: 05/17/17 Analyzed: 05/18/17					
Antimony	104			ug/L	100.00	0.198	104	80-120			
Arsenic	106			ug/L	100.00	-0.203	106	80-120			
Barium	129			ug/L	100.00	18.1	110	80-120			
Beryllium	106			ug/L	100.00	0.0341	106	80-120			
Boron	1000			ug/L	1000.0	7.26	100	80-120			
Cadmium	107			ug/L	100.00	0.0444	107	80-120			
Calcium	8060			ug/L	1000.0	6500	156	80-120			QM-02
Chromium	106			ug/L	100.00	0.597	106	80-120			
Cobalt	107			ug/L	100.00	2.40	104	80-120			
Copper	106			ug/L	100.00	0.726	105	80-120			
Lead	107			ug/L	100.00	0.108	107	80-120			
Molybdenum	108			ug/L	100.00	0.264	108	80-120			
Nickel	108			ug/L	100.00	2.06	106	80-120			
Selenium	106			ug/L	100.00	0.0945	106	80-120			
Silver	106			ug/L	100.00	0.0012	106	80-120			
Thallium	108			ug/L	100.00	0.0100	108	80-120			
Vanadium	107			ug/L	100.00	0.297	107	80-120			
Zinc	120			ug/L	100.00	14.2	106	80-120			
Lithium	110			ug/L	100.00	2.03	108	80-120			

Batch 7050598 - EPA 7470A

Blank (7050598-BLK1)				Prepared & Analyzed: 05/18/17							
Mercury	0.00007	0.00050	0.000041	mg/L							J
LCS (7050598-BS1)				Prepared & Analyzed: 05/18/17							
Mercury	0.00250	0.00050	0.000041	mg/L	2.5000E-3		100	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

Report No.: AAE0482

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7050598 - EPA 7470A											
Matrix Spike (7050598-MS1)			Source: AAE0482-06			Prepared & Analyzed: 05/18/17					
Mercury	0.00254	0.00050	0.000041	mg/L	2.5000E-3	ND	102	75-125			
Matrix Spike Dup (7050598-MSD1)			Source: AAE0482-06			Prepared & Analyzed: 05/18/17					
Mercury	0.00251	0.00050	0.000041	mg/L	2.5000E-3	ND	100	75-125	1	20	
Post Spike (7050598-PS1)			Source: AAE0482-06			Prepared & Analyzed: 05/18/17					
Mercury	1.76			ug/L	1.6667	0.0190	104	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

Legend

Definition of Laboratory Terms

- ND** - Not Detected at levels equal to or greater than the MDL
- BRL** - Not Detected at levels equal to or greater than the RL
- RL** - Reporting Limit **MDL** - Method Detection Limit
- SOP** - Method run per Pace Standard Operating Procedure
- CFU** - Colony Forming Units
- DF** - Dilution Factor **TIC** - Tentatively Identified Compound

Sample Information

N-Nitrosodiphenylamine breaks down to diphenylamine in the GCMS; both analytes are reported as N-Nitrosodiphenylamine. Pace is not NELAC certified for N-Nitrosodiphenylamine.

Phthalic acid and phthalic anhydride are reported as dimethyl phthalate

Maleic acid and maleic anhydride are reported as dimethyl malate

1,2-Diphenylhydrazine breaks down to azobenzene in the GCMS; both analytes are reported as azobenzene

Definition of Qualifiers

- QR-03** The RPD value for the sample duplicate or MS/MSD was outside of QC acceptance limits due to suspected matrix interference and/or non-homogeneous sample matrix.
- QR-01** RPD was outside acceptance limits due to sample concentrations near or below the reporting limit.
- QM-02** The spike recovery is outside acceptance limits due to insignificant spike amount as compared to sample concentration.
- J** Estimated value less than Reporting Limit (RL) but greater than Method Detection Limit(MDL) (CLP J-Flag).
- B-01** Analyte was detected in the associated method blank at an estimated level equal to or greater than the MDL. Sample values reported as greater than the MDL and less than 10x the method blank value are reported as estimated values.

Note: Unless otherwise noted, all results are reported on an as received basis.



CHAIN OF CUSTODY RECORD

Pace Analytical Services, LLC - Atlanta GA
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201

PAGE: 1 OF 1

CLIENT NAME: **GA POWER**
 CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER:
241 RALPH MCGILL BLVD SE B10105
ATLANTA GA 30308
 REPORT TO: **DAWN PRELL**
404.508.7239
 DAWN - PRELL@GOLDER.COM
 REQUESTED COMPLETION DATE:
 CC: **MARIA PADILLA**
KJURINKO@GOLDER.COM
 PO #:
LABURCH@SOUTHERNCO.COM
 PROJECT NAME/STATE:
PLANT McDonough AP

CONTAINER TYPE	PRESERVATION	ANALYSIS REQUESTED							REMARKS/ADDITIONAL INFORMATION
		P	P	P	P	P	P	P	
P - PLASTIC	1 - HCl, ≤6°C								
A - AMBER GLASS	2 - H ₂ SO ₄ , ≤6°C								
G - CLEAR GLASS	3 - HNO ₃								
V - VOA VIAL	4 - NaOH, ≤6°C								
S - STERILE	5 - NaOH/ZnAc, ≤6°C								
O - OTHER	6 - Na ₂ S ₂ O ₃ , ≤6°C								
	7 - ≤6°C not frozen								
*MATRIX CODES:									
DW - DRINKING WATER	S - SOIL								
WW - WASTEWATER	SL - SLUDGE								
GW - GROUNDWATER	SD - SOLID								
SW - SURFACE WATER	A - AIR								
ST - STORM WATER	L - LIQUID								
W - WATER	P - PRODUCT								

Collection DATE	Collection TIME	MATRIX CODE*	C O M P				SAMPLE IDENTIFICATION
			C	O	M	P	
5-12-17	1108	GW	X				DGWA-71
5-12-17	-	GW	X				FD-1
5-12-17	1412	GW	X				DGWC-4
5-12-17	1631	GW	X				DGWC-23
5-12-17	1618	GW	X				DGWC-67
5-12-17	1321	GW	X				DGWC-68A
5-12-17	1129	GW	X				DGWC-69

CONTAINER TYPE	PRESERVATION	ANALYSIS REQUESTED	DATE/TIME
L A B			
I D N U M B E R			
→			
4		METALS APP III + IV (FEP 6020/1430) C.I.F. SOL + ADS (FEP 300.0 + 5M254K) RADICUM 226 + 228 (SW 846 9315/19320)	5.13.17/1130
4			
4			
4			
4			
4			
4			
4			

REQUISITIONED BY: *[Signature]*
 RELINQUISHED BY: *[Signature]*
 SAMPLE SHIPPED VIA: UPS
 CUSTODY SEAL: Intact
 BROKEN: Not Present
 COOLERS: # of Coolers N/A
 CLIENT: OTHER FS
 COOLER ID: *[Signature]*
 DATE/TIME: 5.13.17/1130
 RECEIVED BY LAB: *[Signature]*
 TEMPERATURE: Min: 2°C Max: *[Signature]*



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

LOG-IN CHECKLIST

Printed: 5/15/2017 8:49:02AM

Attn: Mr. Joju Abraham

Client: Georgia Power

Project: CCR Event

Date Received: 05/13/17 11:30

Work Order: AAE0482

Logged In By: Charles Hawks

OBSERVATIONS

#Samples: 7

#Containers: 28

Minimum Temp(C): 2.0

Maximum Temp(C): 2.0

Custody Seal(s) Used: N/A

CHECKLIST ITEMS

- COC included with Samples YES
- Sample Container(s) Intact YES
- Chain of Custody Complete YES
- Sample Container(s) Match COC YES
- Custody seal Intact N/A
- Temperature in Compliance YES
- Sufficient Sample Volume for Analysis YES
- Zero Headspace Maintained for VOA Analyses YES
- Samples labeled preserved (If Applicable) YES
- Samples received within Allowable Hold Times YES
- Samples Received on Ice YES
- Preservation Confirmed YES

Comments:

June 07, 2017

Maria Padilla
GA Power
2480 Maner Rd
Atlanta, GA 30339

RE: Project: AAE0482 Plant McDonough
Pace Project No.: 30218988

Dear Maria Padilla:

Enclosed are the analytical results for sample(s) received by the laboratory on May 16, 2017. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Jacquelyn Collins
jacquelyn.collins@pacelabs.com
(724)850-5612
Project Manager

Enclosures



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: AAE0482 Plant McDonough
Pace Project No.: 30218988

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601
L-A-B DOD-ELAP Accreditation #: L2417
Alabama Certification #: 41590
Arizona Certification #: AZ0734
Arkansas Certification
California Certification #: 04222CA
Colorado Certification
Connecticut Certification #: PH-0694
Delaware Certification
Florida/TNI Certification #: E87683
Georgia Certification #: C040
Guam Certification
Hawaii Certification
Idaho Certification
Illinois Certification
Indiana Certification
Iowa Certification #: 391
Kansas/TNI Certification #: E-10358
Kentucky Certification #: 90133
Louisiana DHH/TNI Certification #: LA140008
Louisiana DEQ/TNI Certification #: 4086
Maine Certification #: PA00091
Maryland Certification #: 308
Massachusetts Certification #: M-PA1457
Michigan/PADEP Certification
Missouri Certification #: 235

Montana Certification #: Cert 0082
Nebraska Certification #: NE-05-29-14
Nevada Certification #: PA014572015-1
New Hampshire/TNI Certification #: 2976
New Jersey/TNI Certification #: PA 051
New Mexico Certification #: PA01457
New York/TNI Certification #: 10888
North Carolina Certification #: 42706
North Dakota Certification #: R-190
Oregon/TNI Certification #: PA200002
Pennsylvania/TNI Certification #: 65-00282
Puerto Rico Certification #: PA01457
Rhode Island Certification #: 65-00282
South Dakota Certification
Tennessee Certification #: TN2867
Texas/TNI Certification #: T104704188-14-8
Utah/TNI Certification #: PA014572015-5
USDA Soil Permit #: P330-14-00213
Vermont Dept. of Health: ID# VT-0282
Virgin Island/PADEP Certification
Virginia/VELAP Certification #: 460198
Washington Certification #: C868
West Virginia DEP Certification #: 143
West Virginia DHHR Certification #: 9964C
Wisconsin Certification
Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: AAE0482 Plant McDonough

Pace Project No.: 30218988

Lab ID	Sample ID	Matrix	Date Collected	Date Received
30218988001	DGWA-71	Water	05/12/17 11:08	05/16/17 10:00
30218988002	FD-1	Water	05/12/17 00:00	05/16/17 10:00
30218988003	DGWC-4	Water	05/12/17 14:12	05/16/17 10:00
30218988004	DGWC-23	Water	05/12/17 16:31	05/16/17 10:00
30218988005	DGWC-67	Water	05/12/17 16:18	05/16/17 10:00
30218988006	DGWC-68A	Water	05/12/17 13:21	05/16/17 10:00
30218988007	DGWC-69	Water	05/12/17 11:29	05/16/17 10:00

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: AAE0482 Plant McDonough
Pace Project No.: 30218988

Lab ID	Sample ID	Method	Analysts	Analytes Reported
30218988001	DGWA-71	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	CMC	1
30218988002	FD-1	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	CMC	1
30218988003	DGWC-4	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	CMC	1
30218988004	DGWC-23	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	CMC	1
30218988005	DGWC-67	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	CMC	1
30218988006	DGWC-68A	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	CMC	1
30218988007	DGWC-69	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	CMC	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAE0482 Plant McDonough
Pace Project No.: 30218988

Sample: DGWA-71		Lab ID: 30218988001	Collected: 05/12/17 11:08	Received: 05/16/17 10:00	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.0260 ± 0.0746 (0.184) C:90% T:NA	pCi/L	05/24/17 11:25	13982-63-3		
Radium-228	EPA 9320	0.139 ± 0.333 (0.740) C:93% T:77%	pCi/L	06/02/17 16:29	15262-20-1		
Total Radium	Total Radium Calculation	0.165 ± 0.408 (0.924)	pCi/L	06/06/17 14:13	7440-14-4		

Sample: FD-1		Lab ID: 30218988002	Collected: 05/12/17 00:00	Received: 05/16/17 10:00	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.157 ± 0.113 (0.180) C:89% T:NA	pCi/L	05/24/17 11:25	13982-63-3		
Radium-228	EPA 9320	0.420 ± 0.364 (0.738) C:94% T:76%	pCi/L	06/02/17 16:29	15262-20-1		
Total Radium	Total Radium Calculation	0.577 ± 0.477 (0.918)	pCi/L	06/06/17 14:13	7440-14-4		

Sample: DGWC-4		Lab ID: 30218988003	Collected: 05/12/17 14:12	Received: 05/16/17 10:00	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.563 ± 0.199 (0.161) C:91% T:NA	pCi/L	05/24/17 11:25	13982-63-3		
Radium-228	EPA 9320	0.586 ± 0.372 (0.710) C:93% T:86%	pCi/L	06/02/17 16:29	15262-20-1		
Total Radium	Total Radium Calculation	1.15 ± 0.571 (0.871)	pCi/L	06/06/17 14:13	7440-14-4		

Sample: DGWC-23		Lab ID: 30218988004	Collected: 05/12/17 16:31	Received: 05/16/17 10:00	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.183 ± 0.122 (0.191) C:87% T:NA	pCi/L	05/24/17 11:25	13982-63-3		
Radium-228	EPA 9320	0.510 ± 0.336 (0.642) C:92% T:91%	pCi/L	06/02/17 16:29	15262-20-1		
Total Radium	Total Radium Calculation	0.693 ± 0.458 (0.833)	pCi/L	06/06/17 14:13	7440-14-4		

Sample: DGWC-67		Lab ID: 30218988005	Collected: 05/12/17 16:18	Received: 05/16/17 10:00	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.105 ± 0.122 (0.250) C:82% T:NA	pCi/L	05/24/17 11:25	13982-63-3		
Radium-228	EPA 9320	0.101 ± 0.314 (0.707) C:92% T:82%	pCi/L	06/02/17 16:29	15262-20-1		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAE0482 Plant McDonough

Pace Project No.: 30218988

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Total Radium	Total Radium Calculation	0.206 ± 0.436 (0.957)	pCi/L	06/06/17 14:13	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.199 ± 0.133 (0.205) C:80% T:NA	pCi/L	05/24/17 11:25	13982-63-3	
Radium-228	EPA 9320	0.978 ± 0.448 (0.752) C:93% T:74%	pCi/L	06/02/17 16:29	15262-20-1	
Total Radium	Total Radium Calculation	1.18 ± 0.581 (0.957)	pCi/L	06/06/17 14:13	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.445 ± 0.183 (0.181) C:83% T:NA	pCi/L	05/24/17 11:25	13982-63-3	
Radium-228	EPA 9320	0.835 ± 0.442 (0.802) C:92% T:79%	pCi/L	06/02/17 16:29	15262-20-1	
Total Radium	Total Radium Calculation	1.29 ± 0.625 (0.983)	pCi/L	06/06/17 14:13	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAE0482 Plant McDonough

Pace Project No.: 30218988

QC Batch: 258733 Analysis Method: EPA 9315

QC Batch Method: EPA 9315 Analysis Description: 9315 Total Radium

Associated Lab Samples: 30218988001, 30218988002, 30218988003, 30218988004, 30218988005, 30218988006, 30218988007

METHOD BLANK: 1274461 Matrix: Water

Associated Lab Samples: 30218988001, 30218988002, 30218988003, 30218988004, 30218988005, 30218988006, 30218988007

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.00989 ± 0.108 (0.288) C:89% T:NA	pCi/L	05/22/17 09:24	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAE0482 Plant McDonough

Pace Project No.: 30218988

QC Batch: 259469

Analysis Method: EPA 9320

QC Batch Method: EPA 9320

Analysis Description: 9320 Radium 228

Associated Lab Samples: 30218988001, 30218988002, 30218988003, 30218988004, 30218988005, 30218988006, 30218988007

METHOD BLANK: 1278134

Matrix: Water

Associated Lab Samples: 30218988001, 30218988002, 30218988003, 30218988004, 30218988005, 30218988006, 30218988007

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.550 ± 0.338 (0.616) C:94% T:73%	pCi/L	06/02/17 16:30	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: AAE0482 Plant McDonough

Pace Project No.: 30218988

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

WO#: 30218988



30218988

Chain of Custody



Workorder: AAE0482

Workorder Name: Plant McDonough

Owner Received Date:

Results Requested By: 6/7/2017

Report To: Betsy McDaniel
 Pace Analytical Atlanta
 110 Technology Parkway
 Peachtree Corners, GA 30092
 Phone (770)-734-4200

Subcontract To: Pace - Pittsburgh
 1638 Roseytown Road
 Stes. 2,3,4
 Greensburg, PA 15601
 Phone (724) 850-5600

Item	Sample ID	Sample Type	Collect Date/Time	Lab ID	Matrix	Preserved Containers		Date/Time	Received By	Date/Time	Comments
						NO	HO				
1	DGWA-71	G	5/12/2017 11:08	AAE0482-01	GW	2					
2	FD-1	G	5/12/2017 0:00	AAE0482-02	GW	2					
3	DGWC-4	G	5/12/2017 14:12	AAE0482-03	GW	2					
4	DGWC-23	G	5/12/2017 16:31	AAE0482-04	GW	2					
5	DGWC-67	G	5/12/2017 16:18	AAE0482-05	GW	2					
6	DGWC-68A	G	5/12/2017 13:21	AAE0482-06	GW	2					
7	DGWC-69	G	5/12/2017 11:29	AAE0482-07	GW	2					
8											
9											
10											

Transfers	Released By	Date/Time	Received By	Date/Time	Comments
1	<i>Carroll-ford</i>	5/17 17:30	<i>Michael</i>	5/17 18:00	
2					
3					

Cooler Temperature on Receipt N/A °C Custody Seal Y or N Received on Ice Y or N Sample Intact Y or N

***In order to maintain client confidentiality, location/name of the sampling site, sampler's name and signature may not be provided on this COC
 This chain of custody is considered complete as is since this information is available in the owner laboratory.

30218988



Pace Analytical Services, LLC - Atlanta GA
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201

CHAIN OF CUSTODY RECORD

PAGE: OF

CLIENT NAME: GA POWER		CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 RALPH MCGILL BLVD SE BLDG 05 ATLANTA GA 30308 404.505.7259		CC: MARIA PADILLA DANN PRELL@GOLDER.COM K.T. LING@GOLDER.COM		PO #: LA.BURGH@SOUTHERNCO.COM		PROJECT NAME/STATE: PLANT McDONOUGH AP		PROJECT #: PHASE 11 CCR		CONTAINERS		ANALYSIS REQUESTED		CONTAINER TYPE: PRESERVATION:		CONTAINER TYPE: PRESERVATION			
Collection DATE	Collection TIME	MATRIX CODE*	C O M P	G R A B	SAMPLE IDENTIFICATION	# of	METALS APP III + IV (EPA 6020/4130)	C.I.F. SO4 + TDS (EPA 800.0 + 5M264K)	RADIUM 226 + 228 (SW 846 9818/9820)	P	F	P	P	P	P	P	P	P	P		
5-12-17	1108	GW	X		DGWA-71.	4	1	1	2												
5-12-17	-	GW	X		FD-1	4	1	1	2												
5-12-17	1412	GW	X		DGWC-4	4	1	1	2												
5-12-17	1631	GW	X		DGWC-23	4	1	1	2												
5-12-17	1618	GW	X		DGWC-167	4	1	1	2												
5-12-17	1321	GW	X		DGWC-68A	4	1	1	2												
5-12-17	1129	GW	X		DGWC-69	4	1	1	2												
SAMPLED BY AND TITLE: D. ELLIS FIELD LEAD		DATE/TIME: 5/13/17 / 1700		RELINQUISHED BY: D. Ellis		DATE/TIME: 5/13/17 / 1730		FOR LAB USE ONLY		LAB #:		Entered into LIMS: Tracking #:									
RECEIVED BY: D. Ellis		DATE/TIME: 5/13/17 / 1700		RELINQUISHED BY:		DATE/TIME:		SAMPLE SHIPPED VIA: UPS		FED-EX		USPS		COURIER		CLIENT		OTHER		FS	
RECEIVED BY LAB: D. Ellis		DATE/TIME: 5/13/17 / 1730		Custody/Seal: Intact		Broken		Not Present		N/A		Cooler ID:									
Temperature: Min: 20C		Max:		Yes		No		NA		Yes		No		NA							

Sample Condition Upon Receipt Pittsburgh

KEH



Client Name: Pace Atlanta

Project # 30218988

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: 6812 5104 3683

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Thermometer Used N/A Type of Ice: Wet Blue (None)

Cooler Temperature Observed Temp N/A °C Correction Factor: _____ °C Final Temp: _____ °C
Temp should be above freezing to 6°C

Date and Initials of person examining contents: ML 5-16-17

Comments:	Yes	No	N/A	
Chain of Custody Present:	X			1.
Chain of Custody Filled Out:	X			2.
Chain of Custody Relinquished:	X			3.
Sampler Name & Signature on COC:	X			4.
Sample Labels match COC:	X			5.
-Includes date/time/ID Matrix: <u>W+</u>				
Samples Arrived within Hold Time:	X			6.
Short Hold Time Analysis (<72hr remaining):		X		7.
Rush Turn Around Time Requested:		X		8.
Sufficient Volume:	X			9.
Correct Containers Used:	X			10.
-Pace Containers Used:	X			
Containers Intact:	X			11.
Orthophosphate field filtered		X		12.
Organic Samples checked for dechlorination:			X	13.
Filtered volume received for Dissolved tests			X	14.
All containers have been checked for preservation.	X			15.
All containers needing preservation are found to be in compliance with EPA recommendation.	X			<u>PA < 2</u>
exceptions: VOA, coliform, TOC, O&G, Phenolics				Initial when completed: <u>ML</u> Date/time of preservation: _____
				Lot # of added preservative: _____
Headspace in VOA Vials (>6mm):			X	16.
Trip Blank Present:		X		17.
Trip Blank Custody Seals Present			X	
Rad Aqueous Samples Screened > 0.5 mrem/hr	X			Initial when completed: <u>ML</u> Date: <u>5-16-17</u>

Client Notification/ Resolution:


Person Contacted: _____ Date/Time: _____ Contacted By: _____

Comments/ Resolution: _____

A check in this box indicates that additional information has been stored in ereports.

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)
*PM review is documented electronically in LIMS. When the Project Manager closes the SRF Review schedule in LIMS. The review is in the Status section of the Workorder Edit Screen.

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-228
Analyst: JLW
Date: 5/27/2017
Worklist: 35805
Matrix: DW

Method Blank Assessment	
MB Sample ID	1278134
MB concentration:	0.550
M/B Counting Uncertainty:	0.323
MB MDC:	0.616
MB Numerical Performance Indicator:	3.34
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment	
Count Date:	6/2/2017
Spike I.D.:	17-005
Spike Concentration (pCi/mL):	24.388
Volume Used (mL):	0.20
Aliquot Volume (L, g, F):	0.829
Target Conc. (pCi/L, g, F):	5.885
Uncertainty (Calculated):	0.424
Result (pCi/L, g, F):	6.176
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.678
Numerical Performance Indicator:	0.71
Percent Recovery:	104.93%
Status vs Numerical Indicator:	N/A
Status vs Recovery:	Pass

Duplicate Sample Assessment	
Sample I.D.:	30218862001
Duplicate Sample I.D.:	30218862001DUP
Sample Result (pCi/L, g, F):	0.659
Sample Result Counting Uncertainty (pCi/L, g, F):	0.335
Sample Duplicate Result (pCi/L, g, F):	0.732
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.329
Are sample and/or duplicate results below MDC?	See Below ##
Duplicate Numerical Performance Indicator:	-0.265
Duplicate RPD:	9.05%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Pass

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

John M. [Signature]

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
MS Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
(Based on the Percent Recoveries) MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: LAL
Date: 5/22/2017
Worklist: 35680
Matrix: DW

Method Blank Assessment	
MB Sample ID	1274461
MB concentration:	0.010
M/B Counting Uncertainty:	0.108
MB MDC:	0.288
MB Numerical Performance Indicator:	0.18
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment		LCSD (Y or N)?	N
Count Date:	5/24/2017	LCSD35680	
Spike I.D.:	13-033		
Spike Concentration (pCi/mL):	19.848		
Volume Used (mL):	0.40		
Aliquot Volume (L, g, F):	0.502		
Target Conc. (pCi/L, g, F):	15.827		
Uncertainty (Calculated):	0.745		
Result (pCi/L, g, F):	14.483		
LCSD Counting Uncertainty (pCi/L, g, F):	0.895		
Numerical Performance Indicator:	-2.26		
Percent Recovery:	91.51%		
Status vs Numerical Indicator:	N/A		
Status vs Recovery:	Pass		

Duplicate Sample Assessment	
Sample I.D.:	30218862001
Duplicate Sample I.D.:	30218862001DUP
Sample Result (pCi/L, g, F):	0.223
Sample Result Counting Uncertainty (pCi/L, g, F):	0.195
Sample Duplicate Result (pCi/L, g, F):	0.160
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.143
Are sample and/or duplicate results below MDC?	See Below ##
Duplicate Numerical Performance Indicator:	0.510
Duplicate RPD:	32.90%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Fail***

Evaluation of duplicate precision is not applicable if either the sample or duplicate result is below the MDC.

Comments:

***Batch must be re-prepped due to unacceptable precision.

Quoted

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Sample Matrix Spike Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MS Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Laboratory Report

Prepared For:

**Georgia Power
2480 Maner Road
Atlanta, GA 30339**

Attention: Mr. Joju Abraham

Report Number: AAE0498

May 24, 2017

Project: CCR Event

Project #:Plant McDonough

We appreciate the opportunity to provide the analytical support for your project. The analytical results in this report are based upon information supplied by you, the client, and are for your exclusive use. If you have any questions regarding this data package, please do not hesitate to call.

Approved:

A handwritten signature in black ink that reads "Betsy McDaniel" written over a horizontal line.

Project Manager

This report may not be reproduced, except in full, without written approval from Pace Analytical Services, LLC.
All test results relate only to the samples analyzed.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
DGWA-70A	AAE0498-01	Ground Water	05/15/17 11:30	05/15/17 13:35



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

Case Narrative

The Radium analysis by methods EPA 9315/9320 was performed by Pace-Pittsburgh, 1638 Roseytown Road - Suites 2, 3, 4, Greensburg PA 15601. The Pace-Pittsburgh lab contact is Jacquelyn Collins at 724-850-5612.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

May 24, 2017

Attention: Mr. Joju Abraham

Report No.: AAE0498

Project: CCR Event

Client ID: DGWA-70A

Lab Number ID: AAE0498-01

Date/Time Sampled: 5/15/2017 11:30:00AM

Date/Time Received: 5/15/2017 1:35:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	88	25	10	mg/L	SM 2540 C		1	05/18/17 12:40	05/18/17 12:40	7050535	JPT
Inorganic Anions											
Chloride	2.2	0.25	0.01	mg/L	EPA 300.0		1	05/15/17 19:30	05/16/17 19:44	7050518	SLH
Fluoride	0.005	0.30	0.004	mg/L	EPA 300.0	J	1	05/15/17 19:30	05/16/17 19:44	7050518	SLH
Sulfate	1.0	1.0	0.09	mg/L	EPA 300.0		1	05/15/17 19:30	05/16/17 19:44	7050518	SLH
Metals, Total											
Antimony	ND	0.0030	0.0003	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 20:00	7050560	CSW
Arsenic	ND	0.0050	0.0004	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 20:00	7050560	CSW
Barium	0.0181	0.0100	0.0003	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 20:00	7050560	CSW
Beryllium	ND	0.0030	0.00007	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 20:00	7050560	CSW
Boron	0.0073	0.0400	0.0060	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 20:00	7050560	CSW
Cadmium	ND	0.0010	0.00006	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 20:00	7050560	CSW
Calcium	6.50	5.00	0.522	mg/L	EPA 6020B	B-01	50	05/17/17 14:40	05/18/17 20:06	7050560	CSW
Chromium	0.0006	0.0100	0.0003	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 20:00	7050560	CSW
Cobalt	0.0024	0.0100	0.0005	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 20:00	7050560	CSW
Lead	0.0001	0.0050	0.00007	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 20:00	7050560	CSW
Molybdenum	ND	0.0100	0.0006	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 20:00	7050560	CSW
Selenium	ND	0.0100	0.0014	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 20:00	7050560	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	05/17/17 14:40	05/18/17 20:00	7050560	CSW
Lithium	0.0020	0.0500	0.0011	mg/L	EPA 6020B	J	1	05/17/17 14:40	05/18/17 20:00	7050560	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	05/18/17 08:30	05/18/17 14:44	7050598	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

Report No.: AAE0498

General Chemistry - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7050535 - SM 2540 C											
Blank (7050535-BLK1)						Prepared & Analyzed: 05/18/17					
Total Dissolved Solids	ND	25	10	mg/L							
LCS (7050535-BS1)						Prepared & Analyzed: 05/18/17					
Total Dissolved Solids	408	25	10	mg/L	400.00		102	84-108			
Duplicate (7050535-DUP1)						Source: AAE0482-07 Prepared & Analyzed: 05/18/17					
Total Dissolved Solids	132	25	10	mg/L		243			59	10	QR-03
Duplicate (7050535-DUP2)						Source: AAE0548-05 Prepared & Analyzed: 05/18/17					
Total Dissolved Solids	ND	25	10	mg/L		ND				10	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

Report No.: AAE0498

Inorganic Anions - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7050518 - EPA 300.0											
Blank (7050518-BLK1)						Prepared: 05/15/17 Analyzed: 05/16/17					
Chloride	ND	0.25	0.01	mg/L							
Fluoride	ND	0.30	0.004	mg/L							
Sulfate	ND	1.0	0.09	mg/L							
LCS (7050518-BS1)						Prepared: 05/15/17 Analyzed: 05/16/17					
Chloride	10.1	0.25	0.01	mg/L	10.020		101	90-110			
Fluoride	9.90	0.30	0.004	mg/L	10.020		99	90-110			
Sulfate	10.2	1.0	0.09	mg/L	10.050		102	90-110			
Matrix Spike (7050518-MS1)						Source: AAE0482-03 Prepared: 05/15/17 Analyzed: 05/16/17					
Chloride	36.4	0.25	0.01	mg/L	10.020	28.9	75	90-110			QM-02
Fluoride	10.3	0.30	0.004	mg/L	10.020	ND	103	90-110			
Sulfate	356	1.0	0.09	mg/L	10.050	376	NR	90-110			QM-02
Matrix Spike (7050518-MS2)						Source: AAE0503-02 Prepared: 05/15/17 Analyzed: 05/16/17					
Chloride	12.0	0.25	0.01	mg/L	10.020	1.82	101	90-110			
Fluoride	10.1	0.30	0.004	mg/L	10.020	0.02	101	90-110			
Sulfate	10.8	1.0	0.09	mg/L	10.050	0.45	103	90-110			
Matrix Spike Dup (7050518-MSD1)						Source: AAE0482-03 Prepared: 05/15/17 Analyzed: 05/16/17					
Chloride	36.4	0.25	0.01	mg/L	10.020	28.9	75	90-110	0.2	15	QM-02
Fluoride	10.5	0.30	0.004	mg/L	10.020	ND	105	90-110	2	15	
Sulfate	356	1.0	0.09	mg/L	10.050	376	NR	90-110	0.04	15	QM-02



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

Report No.: AAE0498

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7050560 - EPA 3005A											
Blank (7050560-BLK1)											
						Prepared: 05/17/17 Analyzed: 05/18/17					
Antimony	ND	0.0030	0.0003	mg/L							
Arsenic	ND	0.0050	0.0004	mg/L							
Barium	ND	0.0100	0.0003	mg/L							
Beryllium	ND	0.0030	0.00007	mg/L							
Boron	ND	0.0400	0.0060	mg/L							
Cadmium	ND	0.0010	0.00006	mg/L							
Calcium	0.0124	0.500	0.0104	mg/L							J
Chromium	ND	0.0100	0.0003	mg/L							
Cobalt	ND	0.0100	0.0005	mg/L							
Copper	ND	0.0250	0.0003	mg/L							
Lead	ND	0.0050	0.00007	mg/L							
Molybdenum	ND	0.0100	0.0006	mg/L							
Nickel	ND	0.0100	0.0003	mg/L							
Selenium	ND	0.0100	0.0014	mg/L							
Silver	ND	0.0100	0.0003	mg/L							
Thallium	ND	0.0010	0.00005	mg/L							
Vanadium	ND	0.0100	0.0014	mg/L							
Zinc	ND	0.0100	0.0013	mg/L							
Lithium	ND	0.0500	0.0011	mg/L							
LCS (7050560-BS1)											
						Prepared: 05/17/17 Analyzed: 05/18/17					
Antimony	0.107	0.0030	0.0003	mg/L	0.10000		107	80-120			
Arsenic	0.103	0.0050	0.0004	mg/L	0.10000		103	80-120			
Barium	0.106	0.0100	0.0003	mg/L	0.10000		106	80-120			
Beryllium	0.106	0.0030	0.00007	mg/L	0.10000		106	80-120			
Boron	1.07	0.0400	0.0060	mg/L	1.0000		107	80-120			
Cadmium	0.108	0.0010	0.00006	mg/L	0.10000		108	80-120			
Calcium	1.05	0.500	0.0104	mg/L	1.0000		105	80-120			
Chromium	0.105	0.0100	0.0003	mg/L	0.10000		105	80-120			
Cobalt	0.103	0.0100	0.0005	mg/L	0.10000		103	80-120			
Copper	0.102	0.0250	0.0003	mg/L	0.10000		102	80-120			
Lead	0.104	0.0050	0.00007	mg/L	0.10000		104	80-120			
Molybdenum	0.108	0.0100	0.0006	mg/L	0.10000		108	80-120			
Nickel	0.103	0.0100	0.0003	mg/L	0.10000		103	80-120			
Selenium	0.105	0.0100	0.0014	mg/L	0.10000		105	80-120			
Silver	0.107	0.0100	0.0003	mg/L	0.10000		107	80-120			
Thallium	0.107	0.0010	0.00005	mg/L	0.10000		107	80-120			
Vanadium	0.103	0.0100	0.0014	mg/L	0.10000		103	80-120			
Zinc	0.102	0.0100	0.0013	mg/L	0.10000		102	80-120			
Lithium	0.111	0.0500	0.0011	mg/L	0.10000		111	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

Report No.: AAE0498

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7050560 - EPA 3005A											
Matrix Spike (7050560-MS1)			Source: AAE0498-01				Prepared: 05/17/17 Analyzed: 05/18/17				
Antimony	0.108	0.0030	0.0003	mg/L	0.10000	ND	108	75-125			
Arsenic	0.0999	0.0050	0.0004	mg/L	0.10000	ND	100	75-125			
Barium	0.129	0.0100	0.0003	mg/L	0.10000	0.0181	111	75-125			
Beryllium	0.103	0.0030	0.00007	mg/L	0.10000	ND	103	75-125			
Boron	0.980	0.0400	0.0060	mg/L	1.0000	0.0073	97	75-125			
Cadmium	0.106	0.0010	0.00006	mg/L	0.10000	ND	106	75-125			
Calcium	7.92	25.0	0.522	mg/L	1.0000	6.50	142	75-125			QM-02, J
Chromium	0.104	0.0100	0.0003	mg/L	0.10000	0.0006	103	75-125			
Cobalt	0.104	0.0100	0.0005	mg/L	0.10000	0.0024	101	75-125			
Copper	0.103	0.0250	0.0003	mg/L	0.10000	0.0007	102	75-125			
Lead	0.103	0.0050	0.00007	mg/L	0.10000	0.0001	103	75-125			
Molybdenum	0.106	0.0100	0.0006	mg/L	0.10000	ND	106	75-125			
Nickel	0.106	0.0100	0.0003	mg/L	0.10000	0.0021	104	75-125			
Selenium	0.101	0.0100	0.0014	mg/L	0.10000	ND	101	75-125			
Silver	0.107	0.0100	0.0003	mg/L	0.10000	ND	107	75-125			
Thallium	0.106	0.0010	0.00005	mg/L	0.10000	ND	106	75-125			
Vanadium	0.103	0.0100	0.0014	mg/L	0.10000	ND	103	75-125			
Zinc	0.117	0.0100	0.0013	mg/L	0.10000	0.0142	103	75-125			
Lithium	0.105	0.0500	0.0011	mg/L	0.10000	0.0020	103	75-125			
Matrix Spike Dup (7050560-MSD1)			Source: AAE0498-01				Prepared: 05/17/17 Analyzed: 05/18/17				
Antimony	0.109	0.0030	0.0003	mg/L	0.10000	ND	109	75-125	0.8	20	
Arsenic	0.102	0.0050	0.0004	mg/L	0.10000	ND	102	75-125	2	20	
Barium	0.128	0.0100	0.0003	mg/L	0.10000	0.0181	109	75-125	1	20	
Beryllium	0.105	0.0030	0.00007	mg/L	0.10000	ND	105	75-125	2	20	
Boron	1.05	0.0400	0.0060	mg/L	1.0000	0.0073	104	75-125	7	20	
Cadmium	0.108	0.0010	0.00006	mg/L	0.10000	ND	108	75-125	2	20	
Calcium	7.66	25.0	0.522	mg/L	1.0000	6.50	116	75-125	3	20	J
Chromium	0.105	0.0100	0.0003	mg/L	0.10000	0.0006	104	75-125	1	20	
Cobalt	0.105	0.0100	0.0005	mg/L	0.10000	0.0024	102	75-125	1	20	
Copper	0.102	0.0250	0.0003	mg/L	0.10000	0.0007	102	75-125	0.3	20	
Lead	0.105	0.0050	0.00007	mg/L	0.10000	0.0001	105	75-125	1	20	
Molybdenum	0.107	0.0100	0.0006	mg/L	0.10000	ND	107	75-125	1	20	
Nickel	0.106	0.0100	0.0003	mg/L	0.10000	0.0021	104	75-125	0.5	20	
Selenium	0.104	0.0100	0.0014	mg/L	0.10000	ND	104	75-125	3	20	
Silver	0.106	0.0100	0.0003	mg/L	0.10000	ND	106	75-125	0.8	20	
Thallium	0.107	0.0010	0.00005	mg/L	0.10000	ND	107	75-125	0.6	20	
Vanadium	0.106	0.0100	0.0014	mg/L	0.10000	ND	106	75-125	3	20	
Zinc	0.119	0.0100	0.0013	mg/L	0.10000	0.0142	105	75-125	2	20	
Lithium	0.109	0.0500	0.0011	mg/L	0.10000	0.0020	107	75-125	4	20	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

Report No.: AAE0498

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7050560 - EPA 3005A											
Post Spike (7050560-PS1)			Source: AAE0498-01			Prepared: 05/17/17 Analyzed: 05/18/17					
Antimony	104			ug/L	100.00	0.198	104	80-120			
Arsenic	106			ug/L	100.00	-0.203	106	80-120			
Barium	129			ug/L	100.00	18.1	110	80-120			
Beryllium	106			ug/L	100.00	0.0341	106	80-120			
Boron	1000			ug/L	1000.0	7.26	100	80-120			
Cadmium	107			ug/L	100.00	0.0444	107	80-120			
Calcium	8060			ug/L	1000.0	6500	156	80-120			QM-02
Chromium	106			ug/L	100.00	0.597	106	80-120			
Cobalt	107			ug/L	100.00	2.40	104	80-120			
Copper	106			ug/L	100.00	0.726	105	80-120			
Lead	107			ug/L	100.00	0.108	107	80-120			
Molybdenum	108			ug/L	100.00	0.264	108	80-120			
Nickel	108			ug/L	100.00	2.06	106	80-120			
Selenium	106			ug/L	100.00	0.0945	106	80-120			
Silver	106			ug/L	100.00	0.0012	106	80-120			
Thallium	108			ug/L	100.00	0.0100	108	80-120			
Vanadium	107			ug/L	100.00	0.297	107	80-120			
Zinc	120			ug/L	100.00	14.2	106	80-120			
Lithium	110			ug/L	100.00	2.03	108	80-120			

Batch 7050598 - EPA 7470A

Blank (7050598-BLK1)					Prepared & Analyzed: 05/18/17						
Mercury	0.00007	0.00050	0.000041	mg/L							J
LCS (7050598-BS1)					Prepared & Analyzed: 05/18/17						
Mercury	0.00250	0.00050	0.000041	mg/L	2.5000E-3		100	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

Report No.: AAE0498

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7050598 - EPA 7470A											
Matrix Spike (7050598-MS1)			Source: AAE0482-06			Prepared & Analyzed: 05/18/17					
Mercury	0.00254	0.00050	0.000041	mg/L	2.5000E-3	ND	102	75-125			
Matrix Spike Dup (7050598-MSD1)			Source: AAE0482-06			Prepared & Analyzed: 05/18/17					
Mercury	0.00251	0.00050	0.000041	mg/L	2.5000E-3	ND	100	75-125	1	20	
Post Spike (7050598-PS1)			Source: AAE0482-06			Prepared & Analyzed: 05/18/17					
Mercury	1.76			ug/L	1.6667	0.0190	104	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

May 24, 2017

Legend

Definition of Laboratory Terms

- ND** - Not Detected at levels equal to or greater than the MDL
- BRL** - Not Detected at levels equal to or greater than the RL
- RL** - Reporting Limit **MDL** - Method Detection Limit
- SOP** - Method run per Pace Standard Operating Procedure
- CFU** - Colony Forming Units
- DF** - Dilution Factor **TIC** - Tentatively Identified Compound

Sample Information

N-Nitrosodiphenylamine breaks down to diphenylamine in the GCMS; both analytes are reported as N-Nitrosodiphenylamine. Pace is not NELAC certified for N-Nitrosodiphenylamine.

Phthalic acid and phthalic anhydride are reported as dimethyl phthalate

Maleic acid and maleic anhydride are reported as dimethyl malate

1,2-Diphenylhydrazine breaks down to azobenzene in the GCMS; both analytes are reported as azobenzene

Definition of Qualifiers

- QR-03** The RPD value for the sample duplicate or MS/MSD was outside of QC acceptance limits due to suspected matrix interference and/or non-homogeneous sample matrix.
- QM-02** The spike recovery is outside acceptance limits due to insignificant spike amount as compared to sample concentration.
- J** Estimated value less than Reporting Limit (RL) but greater than Method Detection Limit(MDL) (CLP J-Flag).
- B-01** Analyte was detected in the associated method blank at an estimated level equal to or greater than the MDL. Sample values reported as greater than the MDL and less than 10x the method blank value are reported as estimated values.

Note: Unless otherwise noted, all results are reported on an as received basis.



Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CHAIN OF CUSTODY RECORD

CLIENT NAME: Georgia Power CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185 Atlanta, GA 30308 404-506-7239		REPORT TO: Dawn Prell (Dawn_Prell@golder.com) REQUESTED COMPLETION DATE: laburch@southernco.com		PROJECT NAME/STATE: Plant McDonough AP Phase II CCR	
CC: Maria Padilla kiurinko@golder.com PO #: laburch@southernco.com		CONTAINERS			
CONTAINER TYPE	ANALYSIS REQUESTED	CONTAINER TYPE	ANALYSIS REQUESTED	CONTAINER TYPE	ANALYSIS REQUESTED
3	Metals App. III & IV (EPA 6020/7470)	3	Cl, F, SO ₄ & TDS (EPA 300.0 & SM 2540C)	3	Radium 226 & 228 (SW-846 9315/9320)
4		4		4	
CONTAINER TYPE P - PLASTIC A - AMBER GLASS G - CLEAR GLASS V - VOA VIAL S - STERILE O - OTHER					
PRESERVATION 1 - HCl, ≤6°C 2 - H ₂ SO ₄ , ≤6°C 3 - HNO ₃ 4 - NaOH, ≤6°C 5 - NaOH/ZnAc, ≤6°C 6 - Na ₂ S ₂ O ₃ , ≤6°C 7 - ≤6°C not frozen					
MATRIX CODES: DW - DRINKING WATER S - SOIL WW - WASTEWATER SL - SLUDGE GW - GROUNDWATER SD - SOLID SW - SURFACE WATER A - AIR ST - STORM WATER L - LIQUID W - WATER P - PRODUCT					
REMARKS/ADDITIONAL INFORMATION					
1					
RELINQUISHED BY: <i>[Signature]</i> DATE/TIME: 5/15/17 1335					
RELINQUISHED BY: <i>[Signature]</i> DATE/TIME:					
SAMPLED BY AND TITLE: Kristen Jurinko Golder DATE/TIME: 5/15/17 1335					
RECEIVED BY: <i>[Signature]</i> DATE/TIME: 5/15/17 1335					
TEMPERATURE: Min: Max: 15°C 15°C					
STATUS: No NA Pres No NA					
LAB USE ONLY: LAB #: DATE/TIME: 5/15/17 1335					
ENTERED INTO LIMS: Tracking #:					

May 2017 Plant McDonough COC Phase II CCR.xlsx



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

LOG-IN CHECKLIST

Printed: 5/16/2017 11:47:06AM

Attn: Mr. Joju Abraham

Client: Georgia Power

Project: CCR Event

Date Received: 05/15/17 13:35

Work Order: AAE0498

Logged In By: Charles Hawks

OBSERVATIONS

#Samples: 1

#Containers: 4

Minimum Temp(C): 15.0

Maximum Temp(C): 15.0

Custody Seal(s) Used: N/A

CHECKLIST ITEMS

- COC included with Samples YES
- Sample Container(s) Intact YES
- Chain of Custody Complete YES
- Sample Container(s) Match COC YES
- Custody seal Intact N/A
- Temperature in Compliance YES
- Sufficient Sample Volume for Analysis YES
- Zero Headspace Maintained for VOA Analyses YES
- Samples labeled preserved (If Applicable) YES
- Samples received within Allowable Hold Times YES
- Samples Received on Ice YES
- Preservation Confirmed YES

Comments:

June 07, 2017

Maria Padilla
GA Power
2480 Maner Rd
Atlanta, GA 30339

RE: Project: AAE0498 Plant McDonough
Pace Project No.: 30219104

Dear Maria Padilla:

Enclosed are the analytical results for sample(s) received by the laboratory on May 17, 2017. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

#PM

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Jacquelyn Collins
jacquelyn.collins@pacelabs.com
(724)850-5612
Project Manager

Enclosures



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: AAE0498 Plant McDonough

Pace Project No.: 30219104

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601

L-A-B DOD-ELAP Accreditation #: L2417

Alabama Certification #: 41590

Arizona Certification #: AZ0734

Arkansas Certification

California Certification #: 04222CA

Colorado Certification

Connecticut Certification #: PH-0694

Delaware Certification

Florida/TNI Certification #: E87683

Georgia Certification #: C040

Guam Certification

Hawaii Certification

Idaho Certification

Illinois Certification

Indiana Certification

Iowa Certification #: 391

Kansas/TNI Certification #: E-10358

Kentucky Certification #: 90133

Louisiana DHH/TNI Certification #: LA140008

Louisiana DEQ/TNI Certification #: 4086

Maine Certification #: PA00091

Maryland Certification #: 308

Massachusetts Certification #: M-PA1457

Michigan/PADEP Certification

Missouri Certification #: 235

Montana Certification #: Cert 0082

Nebraska Certification #: NE-05-29-14

Nevada Certification #: PA014572015-1

New Hampshire/TNI Certification #: 2976

New Jersey/TNI Certification #: PA 051

New Mexico Certification #: PA01457

New York/TNI Certification #: 10888

North Carolina Certification #: 42706

North Dakota Certification #: R-190

Oregon/TNI Certification #: PA200002

Pennsylvania/TNI Certification #: 65-00282

Puerto Rico Certification #: PA01457

Rhode Island Certification #: 65-00282

South Dakota Certification

Tennessee Certification #: TN2867

Texas/TNI Certification #: T104704188-14-8

Utah/TNI Certification #: PA014572015-5

USDA Soil Permit #: P330-14-00213

Vermont Dept. of Health: ID# VT-0282

Virgin Island/PADEP Certification

Virginia/VELAP Certification #: 460198

Washington Certification #: C868

West Virginia DEP Certification #: 143

West Virginia DHHR Certification #: 9964C

Wisconsin Certification

Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: AAE0498 Plant McDonough
Pace Project No.: 30219104

Lab ID	Sample ID	Matrix	Date Collected	Date Received
30219104001	DGWA-70A	Water	05/15/17 11:30	05/17/17 10:00

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: AAE0498 Plant McDonough
Pace Project No.: 30219104

Lab ID	Sample ID	Method	Analysts	Analytes Reported
30219104001	DGWA-70A	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	CMC	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAE0498 Plant McDonough

Pace Project No.: 30219104

Sample: DGWA-70A **Lab ID: 30219104001** Collected: 05/15/17 11:30 Received: 05/17/17 10:00 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.0339 ± 0.109 (0.278) C:95% T:NA	pCi/L	05/26/17 10:09	13982-63-3	
Radium-228	EPA 9320	0.254 ± 0.321 (0.680) C:88% T:78%	pCi/L	06/02/17 16:30	15262-20-1	
Total Radium	Total Radium Calculation	0.288 ± 0.430 (0.958)	pCi/L	06/06/17 14:45	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAE0498 Plant McDonough
Pace Project No.: 30219104

QC Batch:	259465	Analysis Method:	EPA 9315
QC Batch Method:	EPA 9315	Analysis Description:	9315 Total Radium
Associated Lab Samples:	30219104001		

METHOD BLANK:	1278110	Matrix:	Water
Associated Lab Samples:	30219104001		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.0238 ± 0.113 (0.301) C:95% T:NA	pCi/L	05/26/17 10:09	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAE0498 Plant McDonough

Pace Project No.: 30219104

QC Batch: 259469

Analysis Method: EPA 9320

QC Batch Method: EPA 9320

Analysis Description: 9320 Radium 228

Associated Lab Samples: 30219104001

METHOD BLANK: 1278134

Matrix: Water

Associated Lab Samples: 30219104001

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.550 ± 0.338 (0.616) C:94% T:73%	pCi/L	06/02/17 16:30	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: AAE0498 Plant McDonough

Pace Project No.: 30219104

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

30219104

Chain of Custody



Workorder: AAE0498

Workorder Name: Plant McDonough

Owner Received Date:

Results Requested By: 6/8/2017

Report To: Betsy McDaniel
 Pace Analytical Atlanta
 110 Technology Parkway
 Peachtree Corners, GA 30092
 Phone (770)-734-4200


Subcontract To: Pace - Pittsburgh
 1638 Roseytown Road
 Stes. 2,3,4
 Greensburg, PA 15601
 Phone (724) 850-5600

Item	Sample ID	Sample Type	Collect Date/Time	Lab ID	Matrix	Preserved Containers	Date/Time	Received By	Date/Time	Comments	
1	DGWA-70A	G	5/15/2017 11:30	AAE0498-01	GW	NOH 2					
2											
3											
4											
5											
6											
7											
8											
9											
10											
Transfers Released By											
1	M. KATTMAN							5/16/17	KATTMAN	5/17/17 1900	
2											
3											

WO#: 30219104

Cooler Temperature on Receipt N/A °C Custody Seal Y or N Received on Ice Y or N Sample Intact Y or N

***In order to maintain client confidentiality, location/name of the sampling site, sampler's name and signature may not be provided on this COC
 This chain of custody is considered complete as is since this information is available in the owner laboratory.



Pace Analytical Services, Inc.
110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
(770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CHAIN OF CUSTODY RECORD

CLIENT NAME: Georgia Power CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185 Atlanta, GA 30308 404-506-7239		REPORT TO: Dawn Prell (Dawn_Prell@golder.com) REQUESTED COMPLETION DATE: laburch@southernmco.com		CC: Maria Padilla kiurinko@golder.com PO #: laburch@southernmco.com		PROJECT NAME/STATE: Plant McDonough AP Phase II CCR	
CONTAINER TYPE: PRESERVATION: # of		ANALYSIS REQUESTED		CONTAINERS		LABORATORY USE ONLY	
P - PLASTIC	3	P	7	P	3	1	1
A - AMBER GLASS						2	2
G - CLEAR GLASS							
V - VOA VIAL							
S - STERILE							
O - OTHER							
PRESERVATION: 1 - HCl, ≤6°C 2 - H ₂ SO ₄ , ≤6°C 3 - HNO ₃ 4 - NaOH, ≤6°C 5 - NaOH/ZnAc, ≤6°C 6 - Na ₂ S ₂ O ₃ , ≤6°C 7 - ≤6°C not frozen		METALS APP. III & IV (EPA 6020/7470)		Cl, F, SO ₄ & TDS (EPA 300.0 & SM 2540C)		Radium 226 & 228 (SW-846 9315/9320)	
CONTAINER TYPE P - PLASTIC A - AMBER GLASS G - CLEAR GLASS V - VOA VIAL S - STERILE O - OTHER		MATRIX CODES: DW - DRINKING WATER WW - WASTEWATER GW - GROUNDWATER SW - SURFACE WATER ST - STORM WATER W - WATER		MATRIX CODES: S - SOIL SL - SLUDGE SD - SOLID A - AIR L - LIQUID P - PRODUCT		REMARKS/ADDITIONAL INFORMATION	
COLLECTION DATE 5/15/17 1130		MATRIX CODE* GW		SAMPLE IDENTIFICATION DGIWA-70A		DATE/TIME 5/15/17 1335	
SAMPLED BY AND TITLE: Kristen Jurinko Golder		RELINQUISHED BY [Signature]		DATE/TIME 5/15/17 1335		LAB #: ENTERED INTO LIMS: TRACKING #:	
RECEIVED BY LAB [Signature]		RECEIVED BY: [Signature]		DATE/TIME 5/15/17 1335		FOR LAB USE ONLY [Signature]	
pH checked: [] Yes No NA Intact Broken Not Present		SAMPLE SHIPPED VIA: UPS FED-EX USPS COURIER CLIENT OTHER FS		DATE/TIME 5/15/17 1335		# of Coolers Coolers ID:	

May 2017 Plant McDonough CCR Phase II CCR.xlsx

KEH

Sample Condition Upon Receipt Pittsburgh

30219104-1



Client Name: Pace Georgia Project # _____

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: 0812 5104 4072

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Thermometer Used N/A Type of Ice: Wet Blue None

Cooler Temperature Observed Temp N/A °C Correction Factor: N/A °C Final Temp: N/A °C

Temp should be above freezing to 6°C

Date and Initials of person examining contents: KEH 5/17/17

Comments:	Yes	No	N/A	
Chain of Custody Present:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	1.
Chain of Custody Filled Out:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	2.
Chain of Custody Relinquished:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	3.
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	4.
Sample Labels match COC: -Includes date/time/ID Matrix: <u>N/A</u>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	5.
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	6.
Short Hold Time Analysis (<72hr remaining):	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	7.
Rush Turn Around Time Requested:	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	8.
Sufficient Volume:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	9.
Correct Containers Used: -Pace Containers Used:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	10.
Containers Intact:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	11.
Orthophosphate field filtered	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	12.
Organic Samples checked for dechlorination:	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	13.
Filtered volume received for Dissolved tests	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	14.
All containers have been checked for preservation.	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	15. <u>PH < 2</u>
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
exceptions: VOA, coliform, TOC, O&G, Phenolics			Initial when completed: <u>KEH</u>	Date/time of preservation
			Lot # of added preservative	
Headspace in VOA Vials (>6mm):	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	16.
Trip Blank Present:	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	17.
Trip Blank Custody Seals Present	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
Rad Aqueous Samples Screened > 0.5 mrem/hr	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Initial when completed: <u>KEH</u> Date: <u>5/17/17</u>

Client Notification/ Resolution:

Person Contacted: _____ Date/Time: _____ Contacted By: _____

Comments/ Resolution: _____

A check in this box indicates that additional information has been stored in ereports.

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

*PM review is documented electronically in LIMS. When the Project Manager closes the SRF Review schedule in LIMS. The review is in the Status section of the Workorder Edit Screen.

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: LAL
Date: 5/25/2017
Worklist: 35802
Matrix: DW

Method Blank Assessment	
MB Sample ID	1278110
MB concentration:	0.024
M/B Counting Uncertainty:	0.113
MB MDC:	0.301
MB Numerical Performance Indicator:	0.41
MB Status vs Numerical Indicator:	N/A
MB Status vs MDC:	Pass

Laboratory Control Sample Assessment	
Count Date:	5/26/2017
Spike I.D.:	13-033
Spike Concentration (pCi/mL):	19.848
Volume Used (mL):	0.40
Aliquot Volume (L, g, F):	0.512
Target Conc. (pCi/L, g, F):	15.508
Uncertainty (Calculated):	0.729
Result (pCi/L, g, F):	12.896
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	1.046
Numerical Performance Indicator:	-4.01
Percent Recovery:	83.16%
Status vs Numerical Indicator:	N/A
Status vs Recovery:	Pass

Duplicate Sample Assessment	
Sample I.D.:	30219377001
Duplicate Sample I.D.:	30219377001DUP
Sample Result (pCi/L, g, F):	0.507
Sample Result Counting Uncertainty (pCi/L, g, F):	0.245
Sample Duplicate Result (pCi/L, g, F):	0.235
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.181
Are sample and/or duplicate results below MDC?	See Below ##
Duplicate Numerical Performance Indicator:	1.749
Duplicate RPD:	73.17%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Fail***

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

***Batch must be re-prepped due to unacceptable precision.

Handwritten signature: J. Lopez

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Sample Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Counting Uncertainty (pCi/L, g, F):	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Counting Uncertainty (pCi/L, g, F):	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	

Quality Control Sample Performance Assessment



Test: Ra-228
Analyst: JLW
Date: 5/27/2017
Worklist: 35805
Matrix: DW

Method Blank Assessment	
MB Sample ID	1278134
MB concentration:	0.550
M/B Counting Uncertainty:	0.323
MB MDC:	0.616
MB Numerical Performance Indicator:	3.34
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment	
LCS#	Y or N?
LCS35805	N
Count Date:	6/2/2017
Spike I.D.:	17-005
Spike Concentration (pCi/mL):	24.388
Volume Used (mL):	0.20
Aliquot Volume (L, g, F):	0.829
Target Conc. (pCi/L, g, F):	5.885
Uncertainty (Calculated):	0.424
Result (pCi/L, g, F):	6.176
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.678
Numerical Performance Indicator:	0.71
Percent Recovery:	104.93%
Status vs Numerical Indicator:	N/A
Status vs Recovery:	Pass

Duplicate Sample Assessment	
Sample I.D.:	30218862001
Duplicate Sample I.D.:	30218862001DUP
Sample Result (pCi/L, g, F):	0.669
Sample Result Counting Uncertainty (pCi/L, g, F):	0.335
Sample Duplicate Result (pCi/L, g, F):	0.732
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.329
Are sample and/or duplicate results below MDC?	See Below ##
Duplicate Numerical Performance Indicator:	-0.265
Duplicate RPD:	9.05%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Pass

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

Analyst Must Manually Enter All Fields Highlighted in Yellow.

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Duplicate Numerical Performance Indicator:	
MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	

LABORATORY ANALYTICAL DATA

June 2017



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Laboratory Report

Prepared For:

**Georgia Power
2480 Maner Road
Atlanta, GA 30339**

Attention: Mr. Joju Abraham

Report Number: AAF0649

June 27, 2017

Project: CCR Event

Project #:Plant McDonough

We appreciate the opportunity to provide the analytical support for your project. The analytical results in this report are based upon information supplied by you, the client, and are for your exclusive use. If you have any questions regarding this data package, please do not hesitate to call.

Approved:

A handwritten signature in black ink that reads "Betty McDonough" written over a horizontal line.

Project Manager

This report may not be reproduced, except in full, without written approval from Pace Analytical Services, LLC.
All test results relate only to the samples analyzed.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

June 27, 2017

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
DGWA-2	AAF0649-01	Ground Water	06/15/17 10:40	06/16/17 16:20
DGWA-53	AAF0649-02	Ground Water	06/15/17 10:05	06/16/17 16:20
DGWA-70A	AAF0649-03	Ground Water	06/15/17 15:35	06/16/17 16:20
DGWC-4	AAF0649-04	Ground Water	06/15/17 13:05	06/16/17 16:20
DGWC-23	AAF0649-05	Ground Water	06/15/17 13:15	06/16/17 16:20
FD-1	AAF0649-06	Ground Water	06/15/17 00:00	06/16/17 16:20
FB-1	AAF0649-07	Water	06/15/17 14:30	06/16/17 16:20
EB-1	AAF0649-08	Water	06/15/17 16:30	06/16/17 16:20
DGWC-67	AAF0649-09	Ground Water	06/16/17 09:20	06/16/17 16:20
DGWC-68A	AAF0649-10	Ground Water	06/16/17 11:10	06/16/17 16:20
DGWA-71	AAF0649-11	Ground Water	06/16/17 09:25	06/16/17 16:20
DGWC-69	AAF0649-12	Ground Water	06/16/17 11:30	06/16/17 16:20



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

June 27, 2017

Case Narrative

Georgia Power Plant McDonough Report AAF0649 6/23/2017
Report revised to include missing analyte (sulfate on AAF0649-02, DGWA-53).

The Radium analysis by methods EPA 9315/9320 was performed by Pace-Pittsburgh, 1638 Roseytown Road - Suites 2, 3, 4, Greensburg PA 15601. The Pace-Pittsburgh lab contact is Jacquelyn Collins at 724-850-5612.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

June 27, 2017

Report No.: AAF0649

Project: CCR Event

Client ID: DGWA-2

Lab Number ID: AAF0649-01

Date/Time Sampled: 6/15/2017 10:40:00AM

Date/Time Received: 6/16/2017 4:20:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	626	25	10	mg/L	SM 2540 C		1	06/21/17 17:40	06/21/17 17:40	7060626	JPT
Inorganic Anions											
Chloride	4.8	0.25	0.01	mg/L	EPA 300.0		1	06/19/17 17:53	06/20/17 16:57	7060568	RLC
Fluoride	0.07	0.30	0.004	mg/L	EPA 300.0	J	1	06/19/17 17:53	06/20/17 16:57	7060568	RLC
Sulfate	300	10	0.92	mg/L	EPA 300.0		10	06/19/17 17:53	06/22/17 12:39	7060568	RLC
Metals, Total											
Antimony	0.0006	0.0030	0.0006	mg/L	EPA 6020B	B-01, J	1	06/20/17 07:30	06/21/17 08:55	7060562	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 08:55	7060562	CSW
Barium	0.0223	0.0100	0.0004	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 08:55	7060562	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 08:55	7060562	CSW
Boron	1.44	0.0400	0.0060	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 08:55	7060562	CSW
Cadmium	0.0003	0.0010	0.0001	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 08:55	7060562	CSW
Calcium	96.2	25.0	2.02	mg/L	EPA 6020B		50	06/20/17 07:30	06/21/17 09:01	7060562	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 08:55	7060562	CSW
Cobalt	0.0238	0.0100	0.0003	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 08:55	7060562	CSW
Lead	0.0001	0.0050	0.00007	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 08:55	7060562	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 08:55	7060562	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 08:55	7060562	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 08:55	7060562	CSW
Lithium	0.0781	0.0500	0.0015	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 08:55	7060562	CSW
Mercury	0.00008	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	06/20/17 14:50	06/21/17 13:59	7060593	DDN



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

June 27, 2017

Report No.: AAF0649

Project: CCR Event

Client ID: DGWA-53

Lab Number ID: AAF0649-02

Date/Time Sampled: 6/15/2017 10:05:00AM

Date/Time Received: 6/16/2017 4:20:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	251	25	10	mg/L	SM 2540 C		1	06/21/17 17:40	06/21/17 17:40	7060626	JPT
Inorganic Anions											
Chloride	2.6	0.25	0.01	mg/L	EPA 300.0		1	06/19/17 17:53	06/20/17 17:18	7060568	RLC
Fluoride	0.19	0.30	0.004	mg/L	EPA 300.0	J	1	06/19/17 17:53	06/20/17 17:18	7060568	RLC
Sulfate	16	1.0	0.09	mg/L	EPA 300.0		1	06/19/17 17:53	06/20/17 17:18	7060568	RLC
Metals, Total											
Antimony	0.0006	0.0030	0.0006	mg/L	EPA 6020B	B-01, J	1	06/20/17 07:30	06/21/17 09:07	7060562	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:07	7060562	CSW
Barium	0.140	0.0100	0.0004	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:07	7060562	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:07	7060562	CSW
Boron	0.0725	0.0400	0.0060	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:07	7060562	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:07	7060562	CSW
Calcium	36.0	25.0	2.02	mg/L	EPA 6020B		50	06/20/17 07:30	06/21/17 09:12	7060562	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:07	7060562	CSW
Cobalt	0.0322	0.0100	0.0003	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:07	7060562	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:07	7060562	CSW
Molybdenum	0.0409	0.0100	0.0010	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:07	7060562	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:07	7060562	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:07	7060562	CSW
Lithium	0.0088	0.0500	0.0015	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 09:07	7060562	CSW
Mercury	0.00008	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	06/20/17 14:50	06/21/17 14:01	7060593	DDN



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

June 27, 2017

Report No.: AAF0649

Project: CCR Event

Client ID: DGWA-70A

Lab Number ID: AAF0649-03

Date/Time Sampled: 6/15/2017 3:35:00PM

Date/Time Received: 6/16/2017 4:20:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	65	25	10	mg/L	SM 2540 C		1	06/21/17 17:40	06/21/17 17:40	7060626	JPT
Inorganic Anions											
Chloride	2.0	0.25	0.01	mg/L	EPA 300.0		1	06/19/17 17:53	06/20/17 17:39	7060568	RLC
Fluoride	0.02	0.30	0.004	mg/L	EPA 300.0	J	1	06/19/17 17:53	06/20/17 17:39	7060568	RLC
Sulfate	0.86	1.0	0.09	mg/L	EPA 300.0	J	1	06/19/17 17:53	06/20/17 17:39	7060568	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:18	7060562	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:18	7060562	CSW
Barium	0.0277	0.0100	0.0004	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:18	7060562	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:18	7060562	CSW
Boron	ND	0.0400	0.0060	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:18	7060562	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:18	7060562	CSW
Calcium	5.38	0.500	0.0404	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:18	7060562	CSW
Chromium	0.0006	0.0100	0.0005	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 09:18	7060562	CSW
Cobalt	0.0014	0.0100	0.0003	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 09:18	7060562	CSW
Lead	0.0002	0.0050	0.00007	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 09:18	7060562	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:18	7060562	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:18	7060562	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:18	7060562	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:18	7060562	CSW
Mercury	0.00007	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	06/20/17 14:50	06/21/17 14:03	7060593	DDN



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

June 27, 2017

Report No.: AAF0649

Project: CCR Event

Client ID: DGWC-4

Lab Number ID: AAF0649-04

Date/Time Sampled: 6/15/2017 1:05:00PM

Date/Time Received: 6/16/2017 4:20:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	1290	25	10	mg/L	SM 2540 C		1	06/21/17 17:40	06/21/17 17:40	7060626	JPT
Inorganic Anions											
Chloride	28	0.25	0.01	mg/L	EPA 300.0		1	06/19/17 17:53	06/20/17 17:59	7060568	RLC
Fluoride	0.02	0.30	0.004	mg/L	EPA 300.0	J	1	06/19/17 17:53	06/20/17 17:59	7060568	RLC
Sulfate	730	20	1.8	mg/L	EPA 300.0		20	06/19/17 17:53	06/22/17 12:59	7060568	RLC
Metals, Total											
Antimony	0.0008	0.0030	0.0006	mg/L	EPA 6020B	B-01, J	1	06/20/17 07:30	06/21/17 09:41	7060562	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:41	7060562	CSW
Barium	0.0300	0.0100	0.0004	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:41	7060562	CSW
Beryllium	0.0001	0.0030	0.00009	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 09:41	7060562	CSW
Boron	3.58	0.0400	0.0060	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:41	7060562	CSW
Cadmium	0.0005	0.0010	0.0001	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 09:41	7060562	CSW
Calcium	224	25.0	2.02	mg/L	EPA 6020B		50	06/20/17 07:30	06/21/17 09:47	7060562	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:41	7060562	CSW
Cobalt	0.0015	0.0100	0.0003	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 09:41	7060562	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:41	7060562	CSW
Molybdenum	0.0044	0.0100	0.0010	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 09:41	7060562	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:41	7060562	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:41	7060562	CSW
Lithium	0.0025	0.0500	0.0015	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 09:41	7060562	CSW
Mercury	0.00008	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	06/20/17 14:50	06/21/17 14:10	7060593	DDN



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

June 27, 2017

Report No.: AAF0649

Project: CCR Event

Client ID: DGWC-23

Lab Number ID: AAF0649-05

Date/Time Sampled: 6/15/2017 1:15:00PM

Date/Time Received: 6/16/2017 4:20:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	458	25	10	mg/L	SM 2540 C		1	06/21/17 17:40	06/21/17 17:40	7060626	JPT
Inorganic Anions											
Chloride	16	0.25	0.01	mg/L	EPA 300.0		1	06/19/17 17:53	06/20/17 18:41	7060568	RLC
Fluoride	0.21	0.30	0.004	mg/L	EPA 300.0	J	1	06/19/17 17:53	06/20/17 18:41	7060568	RLC
Sulfate	200	10	0.92	mg/L	EPA 300.0		10	06/19/17 17:53	06/22/17 13:20	7060568	RLC
Metals, Total											
Antimony	0.0007	0.0030	0.0006	mg/L	EPA 6020B	B-01, J	1	06/20/17 07:30	06/21/17 09:52	7060562	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	06/20/17 07:30	06/22/17 15:50	7060562	CSW
Barium	0.0188	0.0100	0.0004	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:52	7060562	CSW
Beryllium	0.0004	0.0030	0.00009	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/22/17 15:50	7060562	CSW
Boron	4.11	2.00	0.298	mg/L	EPA 6020B		50	06/20/17 07:30	06/21/17 09:58	7060562	CSW
Cadmium	0.0002	0.0010	0.0001	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 09:52	7060562	CSW
Calcium	65.9	25.0	2.02	mg/L	EPA 6020B		50	06/20/17 07:30	06/21/17 09:58	7060562	CSW
Chromium	0.0005	0.0100	0.0005	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 09:52	7060562	CSW
Cobalt	0.0003	0.0100	0.0003	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 09:52	7060562	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:52	7060562	CSW
Molybdenum	0.0104	0.0100	0.0010	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:52	7060562	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	06/20/17 07:30	06/22/17 15:50	7060562	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 09:52	7060562	CSW
Lithium	0.0063	0.0500	0.0015	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/22/17 15:50	7060562	CSW
Mercury	0.00019	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	06/20/17 14:50	06/21/17 14:13	7060593	DDN



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

June 27, 2017

Report No.: AAF0649

Project: CCR Event

Client ID: FD-1

Lab Number ID: AAF0649-06

Date/Time Sampled: 6/15/2017 12:00:00AM

Date/Time Received: 6/16/2017 4:20:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	621	25	10	mg/L	SM 2540 C		1	06/21/17 17:40	06/21/17 17:40	7060626	JPT
Inorganic Anions											
Chloride	4.8	0.25	0.01	mg/L	EPA 300.0		1	06/19/17 17:53	06/20/17 19:01	7060568	RLC
Fluoride	0.26	0.30	0.004	mg/L	EPA 300.0	J	1	06/19/17 17:53	06/20/17 19:01	7060568	RLC
Sulfate	320	10	0.92	mg/L	EPA 300.0		10	06/19/17 17:53	06/22/17 13:41	7060568	RLC
Metals, Total											
Antimony	0.0009	0.0030	0.0006	mg/L	EPA 6020B	B-01, J	1	06/20/17 07:30	06/21/17 14:01	7060562	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:01	7060562	CSW
Barium	0.0229	0.0100	0.0004	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:01	7060562	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:01	7060562	CSW
Boron	1.49	0.0400	0.0060	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:01	7060562	CSW
Cadmium	0.0004	0.0010	0.0001	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 14:01	7060562	CSW
Calcium	99.0	25.0	2.02	mg/L	EPA 6020B		50	06/20/17 07:30	06/21/17 14:07	7060562	CSW
Chromium	0.0006	0.0100	0.0005	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 14:01	7060562	CSW
Cobalt	0.0241	0.0100	0.0003	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:01	7060562	CSW
Lead	0.0002	0.0050	0.00007	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 14:01	7060562	CSW
Molybdenum	0.0012	0.0100	0.0010	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 14:01	7060562	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:01	7060562	CSW
Thallium	0.00006	0.0010	0.00005	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 14:01	7060562	CSW
Lithium	0.0774	0.0500	0.0015	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:01	7060562	CSW
Mercury	0.000075	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	06/20/17 14:50	06/21/17 14:15	7060593	DDN



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

June 27, 2017

Report No.: AAF0649

Project: CCR Event

Client ID: FB-1

Lab Number ID: AAF0649-07

Date/Time Sampled: 6/15/2017 2:30:00PM

Date/Time Received: 6/16/2017 4:20:00PM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C		1	06/21/17 17:40	06/21/17 17:40	7060626	JPT
Inorganic Anions											
Chloride	0.06	0.25	0.01	mg/L	EPA 300.0	J	1	06/19/17 17:53	06/20/17 19:22	7060568	RLC
Fluoride	ND	0.30	0.004	mg/L	EPA 300.0		1	06/19/17 17:53	06/20/17 19:22	7060568	RLC
Sulfate	0.17	1.0	0.09	mg/L	EPA 300.0	J	1	06/19/17 17:53	06/20/17 19:22	7060568	RLC
Metals, Total											
Antimony	0.0007	0.0030	0.0006	mg/L	EPA 6020B	B-01, J	1	06/20/17 07:30	06/21/17 14:12	7060562	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:12	7060562	CSW
Barium	ND	0.0100	0.0004	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:12	7060562	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:12	7060562	CSW
Boron	ND	0.0400	0.0060	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:12	7060562	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:12	7060562	CSW
Calcium	ND	0.500	0.0404	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:12	7060562	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:12	7060562	CSW
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:12	7060562	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:12	7060562	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:12	7060562	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:12	7060562	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:12	7060562	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:12	7060562	CSW
Mercury	0.00007	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	06/20/17 14:50	06/21/17 14:18	7060593	DDN



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

June 27, 2017

Report No.: AAF0649

Project: CCR Event

Client ID: EB-1

Lab Number ID: AAF0649-08

Date/Time Sampled: 6/15/2017 4:30:00PM

Date/Time Received: 6/16/2017 4:20:00PM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C		1	06/21/17 17:40	06/21/17 17:40	7060626	JPT
Inorganic Anions											
Chloride	0.08	0.25	0.01	mg/L	EPA 300.0	J	1	06/19/17 17:53	06/20/17 19:43	7060568	RLC
Fluoride	ND	0.30	0.004	mg/L	EPA 300.0		1	06/19/17 17:53	06/20/17 19:43	7060568	RLC
Sulfate	ND	1.0	0.09	mg/L	EPA 300.0		1	06/19/17 17:53	06/20/17 19:43	7060568	RLC
Metals, Total											
Antimony	0.0008	0.0030	0.0006	mg/L	EPA 6020B	B-01, J	1	06/20/17 07:30	06/21/17 14:18	7060562	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:18	7060562	CSW
Barium	0.0012	0.0100	0.0004	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 14:18	7060562	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:18	7060562	CSW
Boron	ND	0.0400	0.0060	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:18	7060562	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:18	7060562	CSW
Calcium	ND	0.500	0.0404	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:18	7060562	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:18	7060562	CSW
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:18	7060562	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:18	7060562	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:18	7060562	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:18	7060562	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:18	7060562	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:18	7060562	CSW
Mercury	0.00007	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	06/20/17 14:50	06/21/17 14:20	7060593	DDN



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

June 27, 2017

Report No.: AAF0649

Project: CCR Event

Client ID: DGWC-67

Lab Number ID: AAF0649-09

Date/Time Sampled: 6/16/2017 9:20:00AM

Date/Time Received: 6/16/2017 4:20:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	309	25	10	mg/L	SM 2540 C		1	06/21/17 17:40	06/21/17 17:40	7060626	JPT
Inorganic Anions											
Chloride	5.5	0.25	0.01	mg/L	EPA 300.0		1	06/19/17 17:53	06/20/17 20:03	7060568	RLC
Fluoride	0.03	0.30	0.004	mg/L	EPA 300.0	J	1	06/19/17 17:53	06/20/17 20:03	7060568	RLC
Sulfate	100	5.0	0.46	mg/L	EPA 300.0		5	06/19/17 17:53	06/22/17 14:01	7060568	RLC
Metals, Total											
Antimony	0.0008	0.0030	0.0006	mg/L	EPA 6020B	B-01, J	1	06/20/17 07:30	06/21/17 14:24	7060562	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:24	7060562	CSW
Barium	0.110	0.0100	0.0004	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:24	7060562	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:24	7060562	CSW
Boron	3.42	0.0400	0.0060	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:24	7060562	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:24	7060562	CSW
Calcium	42.5	25.0	2.02	mg/L	EPA 6020B		50	06/20/17 07:30	06/21/17 14:29	7060562	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:24	7060562	CSW
Cobalt	0.0041	0.0100	0.0003	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 14:24	7060562	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:24	7060562	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:24	7060562	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:24	7060562	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 14:24	7060562	CSW
Lithium	0.0048	0.0500	0.0015	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 14:24	7060562	CSW
Mercury	0.00007	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	06/21/17 09:20	06/21/17 15:58	7060604	DDN



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

June 27, 2017

Attention: Mr. Joju Abraham

Report No.: AAF0649

Project: CCR Event

Client ID: DGWC-68A

Lab Number ID: AAF0649-10

Date/Time Sampled: 6/16/2017 11:10:00AM

Date/Time Received: 6/16/2017 4:20:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	271	25	10	mg/L	SM 2540 C		1	06/21/17 17:40	06/21/17 17:40	7060626	JPT
Inorganic Anions											
Chloride	4.2	0.25	0.01	mg/L	EPA 300.0		1	06/19/17 17:53	06/20/17 21:46	7060568	RLC
Fluoride	0.12	0.30	0.004	mg/L	EPA 300.0	J	1	06/19/17 17:53	06/20/17 21:46	7060568	RLC
Sulfate	47	1.0	0.09	mg/L	EPA 300.0		1	06/19/17 17:53	06/20/17 21:46	7060568	RLC
Metals, Total											
Antimony	0.0008	0.0030	0.0006	mg/L	EPA 6020B	B-01, J	1	06/20/17 07:30	06/21/17 15:15	7060562	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:15	7060562	CSW
Barium	0.0855	0.0100	0.0004	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:15	7060562	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:15	7060562	CSW
Boron	1.88	0.0400	0.0060	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:15	7060562	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:15	7060562	CSW
Calcium	47.9	25.0	2.02	mg/L	EPA 6020B		50	06/20/17 07:30	06/21/17 15:21	7060562	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:15	7060562	CSW
Cobalt	0.0003	0.0100	0.0003	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 15:15	7060562	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:15	7060562	CSW
Molybdenum	0.190	0.0100	0.0010	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:15	7060562	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:15	7060562	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:15	7060562	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:15	7060562	CSW
Mercury	0.00007	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	06/21/17 09:20	06/21/17 16:01	7060604	DDN



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

June 27, 2017

Report No.: AAF0649

Project: CCR Event

Client ID: DGWA-71

Lab Number ID: AAF0649-11

Date/Time Sampled: 6/16/2017 9:25:00AM

Date/Time Received: 6/16/2017 4:20:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	100	25	10	mg/L	SM 2540 C		1	06/21/17 17:40	06/21/17 17:40	7060626	JPT
Inorganic Anions											
Chloride	3.4	0.25	0.01	mg/L	EPA 300.0		1	06/19/17 17:53	06/20/17 22:07	7060568	RLC
Fluoride	0.008	0.30	0.004	mg/L	EPA 300.0	J	1	06/19/17 17:53	06/20/17 22:07	7060568	RLC
Sulfate	11	1.0	0.09	mg/L	EPA 300.0		1	06/19/17 17:53	06/20/17 22:07	7060568	RLC
Metals, Total											
Antimony	0.0007	0.0030	0.0006	mg/L	EPA 6020B	B-01, J	1	06/20/17 07:30	06/21/17 15:26	7060562	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:26	7060562	CSW
Barium	0.0369	0.0100	0.0004	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:26	7060562	CSW
Beryllium	0.0001	0.0030	0.00009	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 15:26	7060562	CSW
Boron	0.0085	0.0400	0.0060	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 15:26	7060562	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:26	7060562	CSW
Calcium	7.66	0.500	0.0404	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:26	7060562	CSW
Chromium	0.0005	0.0100	0.0005	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 15:26	7060562	CSW
Cobalt	0.0011	0.0100	0.0003	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 15:26	7060562	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:26	7060562	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:26	7060562	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:26	7060562	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:26	7060562	CSW
Lithium	0.0016	0.0500	0.0015	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 15:26	7060562	CSW
Mercury	0.00007	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	06/21/17 09:20	06/21/17 16:03	7060604	DDN



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

June 27, 2017

Attention: Mr. Joju Abraham

Report No.: AAF0649

Project: CCR Event

Client ID: DGWC-69

Lab Number ID: AAF0649-12

Date/Time Sampled: 6/16/2017 11:30:00AM

Date/Time Received: 6/16/2017 4:20:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	155	25	10	mg/L	SM 2540 C		1	06/21/17 17:40	06/21/17 17:40	7060626	JPT
Inorganic Anions											
Chloride	4.7	0.25	0.01	mg/L	EPA 300.0		1	06/19/17 17:53	06/20/17 22:28	7060568	RLC
Fluoride	0.16	0.30	0.004	mg/L	EPA 300.0	J	1	06/19/17 17:53	06/20/17 22:28	7060568	RLC
Sulfate	20	1.0	0.09	mg/L	EPA 300.0		1	06/19/17 17:53	06/20/17 22:28	7060568	RLC
Metals, Total											
Antimony	0.0007	0.0030	0.0006	mg/L	EPA 6020B	B-01, J	1	06/20/17 07:30	06/21/17 15:38	7060562	CSW
Arsenic	0.0113	0.0050	0.0005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:38	7060562	CSW
Barium	0.100	0.0100	0.0004	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:38	7060562	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:38	7060562	CSW
Boron	0.381	0.0400	0.0060	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:38	7060562	CSW
Cadmium	0.0002	0.0010	0.0001	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 15:38	7060562	CSW
Calcium	17.7	2.50	0.202	mg/L	EPA 6020B		5	06/20/17 07:30	06/21/17 15:49	7060562	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:38	7060562	CSW
Cobalt	0.0009	0.0100	0.0003	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 15:38	7060562	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:38	7060562	CSW
Molybdenum	0.0087	0.0100	0.0010	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 15:38	7060562	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:38	7060562	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	06/20/17 07:30	06/21/17 15:38	7060562	CSW
Lithium	0.0031	0.0500	0.0015	mg/L	EPA 6020B	J	1	06/20/17 07:30	06/21/17 15:38	7060562	CSW
Mercury	0.00007	0.00050	0.000041	mg/L	EPA 7470A	B-01, J	1	06/21/17 09:20	06/21/17 16:05	7060604	DDN



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

June 27, 2017

Report No.: AAF0649

General Chemistry - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7060626 - SM 2540 C											
Blank (7060626-BLK1)						Prepared & Analyzed: 06/21/17					
Total Dissolved Solids	ND	25	10	mg/L							
LCS (7060626-BS1)						Prepared & Analyzed: 06/21/17					
Total Dissolved Solids	383	25	10	mg/L	400.00		96	84-108			
Duplicate (7060626-DUP1)						Source: AAF0631-03 Prepared & Analyzed: 06/21/17					
Total Dissolved Solids	ND	25	10	mg/L		ND				10	
Duplicate (7060626-DUP2)						Source: AAF0649-02 Prepared & Analyzed: 06/21/17					
Total Dissolved Solids	238	25	10	mg/L		251			5	10	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

June 27, 2017

Report No.: AAF0649

Inorganic Anions - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7060568 - EPA 300.0											
Blank (7060568-BLK1)						Prepared: 06/19/17 Analyzed: 06/20/17					
Chloride	ND	0.25	0.01	mg/L							
Fluoride	ND	0.30	0.004	mg/L							
Sulfate	ND	1.0	0.09	mg/L							
LCS (7060568-BS1)						Prepared: 06/19/17 Analyzed: 06/20/17					
Chloride	10.1	0.25	0.01	mg/L	10.020		101	90-110			
Fluoride	10.3	0.30	0.004	mg/L	10.020		102	90-110			
Sulfate	10.2	1.0	0.09	mg/L	10.050		101	90-110			
Matrix Spike (7060568-MS1)						Source: AAF0631-07 Prepared: 06/19/17 Analyzed: 06/20/17					
Chloride	14.8	0.25	0.01	mg/L	10.020	4.78	100	90-110			
Fluoride	13.0	0.30	0.004	mg/L	10.020	0.77	122	90-110			QM-05
Sulfate	277	1.0	0.09	mg/L	10.050	296	NR	90-110			QM-02
Matrix Spike (7060568-MS2)						Source: AAF0649-04 Prepared: 06/19/17 Analyzed: 06/20/17					
Chloride	35.2	0.25	0.01	mg/L	10.020	28.5	67	90-110			QM-02
Fluoride	10.8	0.30	0.004	mg/L	10.020	0.02	107	90-110			
Sulfate	348	1.0	0.09	mg/L	10.050	367	NR	90-110			QM-02
Matrix Spike Dup (7060568-MSD1)						Source: AAF0631-07 Prepared: 06/19/17 Analyzed: 06/20/17					
Chloride	14.8	0.25	0.01	mg/L	10.020	4.78	100	90-110	0.1	15	
Fluoride	13.6	0.30	0.004	mg/L	10.020	0.77	128	90-110	5	15	QM-05
Sulfate	278	1.0	0.09	mg/L	10.050	296	NR	90-110	0.2	15	QM-02



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

June 27, 2017

Report No.: AAF0649

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7060562 - EPA 3005A											
Blank (7060562-BLK1)						Prepared & Analyzed: 06/20/17					
Antimony	0.0008	0.0030	0.0006	mg/L							J
Arsenic	ND	0.0050	0.0005	mg/L							
Barium	ND	0.0100	0.0004	mg/L							
Beryllium	ND	0.0030	0.00009	mg/L							
Boron	ND	0.0400	0.0060	mg/L							
Cadmium	ND	0.0010	0.0001	mg/L							
Calcium	ND	0.500	0.0404	mg/L							
Chromium	ND	0.0100	0.0005	mg/L							
Cobalt	ND	0.0100	0.0003	mg/L							
Copper	ND	0.0250	0.0003	mg/L							
Lead	ND	0.0050	0.00007	mg/L							
Molybdenum	ND	0.0100	0.0010	mg/L							
Nickel	ND	0.0100	0.0005	mg/L							
Selenium	ND	0.0100	0.0018	mg/L							
Silver	ND	0.0100	0.0002	mg/L							
Thallium	ND	0.0010	0.00005	mg/L							
Vanadium	ND	0.0100	0.0012	mg/L							
Zinc	ND	0.0100	0.0012	mg/L							
Lithium	ND	0.0500	0.0015	mg/L							
LCS (7060562-BS1)						Prepared & Analyzed: 06/20/17					
Antimony	0.102	0.0030	0.0006	mg/L	0.10000		102	80-120			
Arsenic	0.0975	0.0050	0.0005	mg/L	0.10000		97	80-120			
Barium	0.0988	0.0100	0.0004	mg/L	0.10000		99	80-120			
Beryllium	0.0990	0.0030	0.00009	mg/L	0.10000		99	80-120			
Boron	0.990	0.0400	0.0060	mg/L	1.0000		99	80-120			
Cadmium	0.0984	0.0010	0.0001	mg/L	0.10000		98	80-120			
Calcium	0.950	0.500	0.0404	mg/L	1.0000		95	80-120			
Chromium	0.104	0.0100	0.0005	mg/L	0.10000		104	80-120			
Cobalt	0.0971	0.0100	0.0003	mg/L	0.10000		97	80-120			
Copper	0.0979	0.0250	0.0003	mg/L	0.10000		98	80-120			
Lead	0.0937	0.0050	0.00007	mg/L	0.10000		94	80-120			
Molybdenum	0.100	0.0100	0.0010	mg/L	0.10000		100	80-120			
Nickel	0.0989	0.0100	0.0005	mg/L	0.10000		99	80-120			
Selenium	0.0934	0.0100	0.0018	mg/L	0.10000		93	80-120			
Silver	0.0984	0.0100	0.0002	mg/L	0.10000		98	80-120			
Thallium	0.0938	0.0010	0.00005	mg/L	0.10000		94	80-120			
Vanadium	0.0988	0.0100	0.0012	mg/L	0.10000		99	80-120			
Zinc	0.101	0.0100	0.0012	mg/L	0.10000		101	80-120			
Lithium	0.103	0.0500	0.0015	mg/L	0.10000		103	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

June 27, 2017

Report No.: AAF0649

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7060562 - EPA 3005A											
Matrix Spike (7060562-MS1)			Source: AAF0631-02				Prepared & Analyzed: 06/20/17				
Antimony	0.105	0.0030	0.0006	mg/L	0.10000	0.0009	104	75-125			
Arsenic	0.100	0.0050	0.0005	mg/L	0.10000	0.0006	100	75-125			
Barium	0.137	0.0100	0.0004	mg/L	0.10000	0.0364	101	75-125			
Beryllium	0.101	0.0030	0.00009	mg/L	0.10000	ND	101	75-125			
Boron	0.975	0.0400	0.0060	mg/L	1.0000	ND	97	75-125			
Cadmium	0.0967	0.0010	0.0001	mg/L	0.10000	ND	97	75-125			
Calcium	29.1	25.0	2.02	mg/L	1.0000	29.0	2	75-125			QM-02
Chromium	0.111	0.0100	0.0005	mg/L	0.10000	0.0117	100	75-125			
Cobalt	0.100	0.0100	0.0003	mg/L	0.10000	ND	100	75-125			
Copper	0.0950	0.0250	0.0003	mg/L	0.10000	ND	95	75-125			
Lead	0.0923	0.0050	0.00007	mg/L	0.10000	ND	92	75-125			
Molybdenum	0.103	0.0100	0.0010	mg/L	0.10000	ND	103	75-125			
Nickel	0.0983	0.0100	0.0005	mg/L	0.10000	0.0012	97	75-125			
Selenium	0.0948	0.0100	0.0018	mg/L	0.10000	0.0024	92	75-125			
Silver	0.0980	0.0100	0.0002	mg/L	0.10000	ND	98	75-125			
Thallium	0.0939	0.0010	0.00005	mg/L	0.10000	ND	94	75-125			
Vanadium	0.117	0.0100	0.0012	mg/L	0.10000	0.0171	100	75-125			
Zinc	0.101	0.0100	0.0012	mg/L	0.10000	0.0013	100	75-125			
Lithium	0.0998	0.0500	0.0015	mg/L	0.10000	ND	100	75-125			
Matrix Spike Dup (7060562-MSD1)			Source: AAF0631-02				Prepared & Analyzed: 06/20/17				
Antimony	0.105	0.0030	0.0006	mg/L	0.10000	0.0009	104	75-125	0.2	20	
Arsenic	0.105	0.0050	0.0005	mg/L	0.10000	0.0006	105	75-125	5	20	
Barium	0.136	0.0100	0.0004	mg/L	0.10000	0.0364	100	75-125	0.6	20	
Beryllium	0.0996	0.0030	0.00009	mg/L	0.10000	ND	100	75-125	0.9	20	
Boron	0.959	0.0400	0.0060	mg/L	1.0000	ND	96	75-125	2	20	
Cadmium	0.0989	0.0010	0.0001	mg/L	0.10000	ND	99	75-125	2	20	
Calcium	30.1	25.0	2.02	mg/L	1.0000	29.0	103	75-125	3	20	
Chromium	0.113	0.0100	0.0005	mg/L	0.10000	0.0117	102	75-125	2	20	
Cobalt	0.0977	0.0100	0.0003	mg/L	0.10000	ND	98	75-125	3	20	
Copper	0.0972	0.0250	0.0003	mg/L	0.10000	ND	97	75-125	2	20	
Lead	0.0928	0.0050	0.00007	mg/L	0.10000	ND	93	75-125	0.6	20	
Molybdenum	0.102	0.0100	0.0010	mg/L	0.10000	ND	102	75-125	0.6	20	
Nickel	0.0980	0.0100	0.0005	mg/L	0.10000	0.0012	97	75-125	0.3	20	
Selenium	0.101	0.0100	0.0018	mg/L	0.10000	0.0024	98	75-125	6	20	
Silver	0.0976	0.0100	0.0002	mg/L	0.10000	ND	98	75-125	0.4	20	
Thallium	0.0942	0.0010	0.00005	mg/L	0.10000	ND	94	75-125	0.4	20	
Vanadium	0.118	0.0100	0.0012	mg/L	0.10000	0.0171	101	75-125	1	20	
Zinc	0.101	0.0100	0.0012	mg/L	0.10000	0.0013	100	75-125	0.0007	20	
Lithium	0.101	0.0500	0.0015	mg/L	0.10000	ND	101	75-125	1	20	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

June 27, 2017

Report No.: AAF0649

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7060562 - EPA 3005A											
Post Spike (7060562-PS1)			Source: AAF0631-02			Prepared & Analyzed: 06/20/17					
Antimony	99.2			ug/L	100.00	0.874	98	80-120			
Arsenic	101			ug/L	100.00	0.566	101	80-120			
Barium	137			ug/L	100.00	36.4	100	80-120			
Beryllium	101			ug/L	100.00	0.0039	101	80-120			
Boron	1010			ug/L	1000.0	1.30	101	80-120			
Cadmium	98.3			ug/L	100.00	-0.0357	98	80-120			
Calcium	30100			ug/L	1000.0	29000	110	80-120			
Chromium	120			ug/L	100.00	11.7	108	80-120			
Cobalt	103			ug/L	100.00	0.0265	103	80-120			
Copper	99.8			ug/L	100.00	0.0522	100	80-120			
Lead	94.6			ug/L	100.00	0.0002	95	80-120			
Molybdenum	103			ug/L	100.00	0.110	103	80-120			
Nickel	103			ug/L	100.00	1.22	102	80-120			
Selenium	101			ug/L	100.00	2.39	99	80-120			
Silver	99.1			ug/L	100.00	-0.0002	99	80-120			
Thallium	97.3			ug/L	100.00	0.0174	97	80-120			
Vanadium	128			ug/L	100.00	17.1	110	80-120			
Zinc	108			ug/L	100.00	1.26	106	80-120			
Lithium	104			ug/L	100.00	0.917	103	80-120			

Batch 7060593 - EPA 7470A

Blank (7060593-BLK1)					Prepared: 06/20/17 Analyzed: 06/21/17						
Mercury	0.00007	0.00050	0.000041	mg/L							J
LCS (7060593-BS1)					Prepared: 06/20/17 Analyzed: 06/21/17						
Mercury	0.00257	0.00050	0.000041	mg/L	2.5000E-3		103	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

June 27, 2017

Report No.: AAF0649

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7060593 - EPA 7470A											
Matrix Spike (7060593-MS1)			Source: AAF0595-01			Prepared: 06/20/17 Analyzed: 06/21/17					
Mercury	0.00254	0.00050	0.000041	mg/L	2.5000E-3	0.00006	99	75-125			
Matrix Spike Dup (7060593-MSD1)			Source: AAF0595-01			Prepared: 06/20/17 Analyzed: 06/21/17					
Mercury	0.00262	0.00050	0.000041	mg/L	2.5000E-3	0.00006	102	75-125	3	20	
Post Spike (7060593-PS1)			Source: AAF0595-01			Prepared: 06/20/17 Analyzed: 06/21/17					
Mercury	1.88			ug/L	1.6667	0.0424	110	80-120			
Batch 7060604 - EPA 7470A											
Blank (7060604-BLK1)						Prepared & Analyzed: 06/21/17					
Mercury	0.00007	0.00050	0.000041	mg/L							J
LCS (7060604-BS1)						Prepared & Analyzed: 06/21/17					
Mercury	0.00262	0.00050	0.000041	mg/L	2.5000E-3		105	80-120			
Matrix Spike (7060604-MS1)			Source: AAF0737-02			Prepared & Analyzed: 06/21/17					
Mercury	0.00253	0.00050	0.000041	mg/L	2.5000E-3	0.00008	98	75-125			
Matrix Spike Dup (7060604-MSD1)			Source: AAF0737-02			Prepared & Analyzed: 06/21/17					
Mercury	0.00248	0.00050	0.000041	mg/L	2.5000E-3	0.00008	96	75-125	2	20	
Post Spike (7060604-PS1)			Source: AAF0737-02			Prepared & Analyzed: 06/21/17					
Mercury	1.84			ug/L	1.6667	0.0501	108	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

June 27, 2017

Legend

Definition of Laboratory Terms

- ND** - Not Detected at levels equal to or greater than the MDL
- BRL** - Not Detected at levels equal to or greater than the RL
- RL** - Reporting Limit **MDL** - Method Detection Limit
- SOP** - Method run per Pace Standard Operating Procedure
- CFU** - Colony Forming Units
- DF** - Dilution Factor **TIC** - Tentatively Identified Compound

Sample Information

N-Nitrosodiphenylamine breaks down to diphenylamine in the GCMS; both analytes are reported as N-Nitrosodiphenylamine. Pace is not NELAC certified for N-Nitrosodiphenylamine.

Phthalic acid and phthalic anhydride are reported as dimethyl phthalate

Maleic acid and maleic anhydride are reported as dimethyl malate

1,2-Diphenylhydrazine breaks down to azobenzene in the GCMS; both analytes are reported as azobenzene

Definition of Qualifiers

- QM-05** The spike recovery was outside acceptance limits for the MS and/or MSD and/or PDS due to suspected matrix interference. Sample results for the QC batch were accepted based on acceptable LCS recoveries.
- QM-02** The spike recovery is outside acceptance limits due to insignificant spike amount as compared to sample concentration.
- J** Estimated value less than Reporting Limit (RL) but greater than Method Detection Limit(MDL) (CLP J-Flag).
- B-01** Analyte was detected in the associated method blank at an estimated level equal to or greater than the MDL. Sample values reported as greater than the MDL and less than 10x the method blank value are reported as estimated values.

Note: Unless otherwise noted, all results are reported on an as received basis.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

June 27, 2017

Report Notes

The sample collection times for FB-1 and EB-1 were not listed on the COC and were taken from the container labels. MMR



CHAIN OF CUSTODY RECORD

Pace Analytical Services, Inc.
110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
(770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

Form containing client information (Georgia Power, 241 Ralph McGill Blvd SE B10185), report details (Dawn Prell, 6/15/17), project name (Plant McDonough AP), and a table of 12 samples with columns for date, time, matrix code, and analysis requested.

June 2017 Plant McDonough COC Phase II CCR.xlsx



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

LOG-IN CHECKLIST

Printed: 6/19/2017 12:03:34PM

Attn: Mr. Joju Abraham

Client: Georgia Power

Project: CCR Event

Date Received: 06/16/17 16:20

Work Order: AAF0649

Logged In By: Mohammad M. Rahman

OBSERVATIONS

#Samples: 12

#Containers: 50

Minimum Temp(C): 1.3

Maximum Temp(C): 1.3

Custody Seal(s) Used: N/A

CHECKLIST ITEMS

COC included with Samples	YES
Sample Container(s) Intact	YES
Chain of Custody Complete	NO
Sample Container(s) Match COC	YES
Custody seal Intact	N/A
Temperature in Compliance	YES
Sufficient Sample Volume for Analysis	YES
Zero Headspace Maintained for VOA Analyses	YES
Samples labeled preserved (If Applicable)	YES
Samples received within Allowable Hold Times	YES
Samples Received on Ice	YES
Preservation Confirmed	YES

Comments:

The sample collection times for FB-1 and EB-1 were not listed on the COC and were taken from the container labels. MMR

July 13, 2017

Maria Padilla
GA Power
2480 Maner Rd
Atlanta, GA 30339

RE: Project: AAF0649 Plant McDonough
Pace Project No.: 30222152

Dear Maria Padilla:

Enclosed are the analytical results for sample(s) received by the laboratory on June 20, 2017. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Jacquelyn Collins
jacquelyn.collins@pacelabs.com
(724)850-5612
Project Manager

Enclosures



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: AAF0649 Plant McDonough

Pace Project No.: 30222152

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601

L-A-B DOD-ELAP Accreditation #: L2417

Alabama Certification #: 41590

Arizona Certification #: AZ0734

Arkansas Certification

California Certification #: 04222CA

Colorado Certification

Connecticut Certification #: PH-0694

Delaware Certification

Florida/TNI Certification #: E87683

Georgia Certification #: C040

Guam Certification

Hawaii Certification

Idaho Certification

Illinois Certification

Indiana Certification

Iowa Certification #: 391

Kansas/TNI Certification #: E-10358

Kentucky Certification #: 90133

Louisiana DHH/TNI Certification #: LA140008

Louisiana DEQ/TNI Certification #: 4086

Maine Certification #: PA00091

Maryland Certification #: 308

Massachusetts Certification #: M-PA1457

Michigan/PADEP Certification

Missouri Certification #: 235

Montana Certification #: Cert 0082

Nebraska Certification #: NE-05-29-14

Nevada Certification #: PA014572015-1

New Hampshire/TNI Certification #: 2976

New Jersey/TNI Certification #: PA 051

New Mexico Certification #: PA01457

New York/TNI Certification #: 10888

North Carolina Certification #: 42706

North Dakota Certification #: R-190

Oregon/TNI Certification #: PA200002

Pennsylvania/TNI Certification #: 65-00282

Puerto Rico Certification #: PA01457

Rhode Island Certification #: 65-00282

South Dakota Certification

Tennessee Certification #: TN2867

Texas/TNI Certification #: T104704188-14-8

Utah/TNI Certification #: PA014572015-5

USDA Soil Permit #: P330-14-00213

Vermont Dept. of Health: ID# VT-0282

Virgin Island/PADEP Certification

Virginia/VELAP Certification #: 460198

Washington Certification #: C868

West Virginia DEP Certification #: 143

West Virginia DHHR Certification #: 9964C

Wisconsin Certification

Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: AAF0649 Plant McDonough
Pace Project No.: 30222152

Lab ID	Sample ID	Matrix	Date Collected	Date Received
30222152001	DGWA-2	Water	06/15/17 10:40	06/20/17 10:10
30222152002	DGWA-53	Water	06/15/17 10:05	06/20/17 10:10
30222152003	DGWA-70A	Water	06/15/17 15:35	06/20/17 10:10
30222152004	DGWC-4	Water	06/15/17 13:05	06/20/17 10:10
30222152005	DGWC-23	Water	06/15/17 13:15	06/20/17 10:10
30222152006	FD-1	Water	06/15/17 00:00	06/20/17 10:10
30222152007	FB-1	Water	06/15/17 14:30	06/20/17 10:10
30222152008	EB-1	Water	06/15/17 16:30	06/20/17 10:10
30222152009	DGWC-67	Water	06/16/17 09:20	06/20/17 10:10
30222152010	DGWC-68A	Water	06/16/17 11:10	06/20/17 10:10
30222152011	DGWA-71	Water	06/16/17 09:25	06/20/17 10:10
30222152012	DGWC-69	Water	06/16/17 11:30	06/20/17 10:10

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: AAF0649 Plant McDonough
Pace Project No.: 30222152

Lab ID	Sample ID	Method	Analysts	Analytes Reported
30222152001	DGWA-2	EPA 9315	JC2	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30222152002	DGWA-53	EPA 9315	JC2	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30222152003	DGWA-70A	EPA 9315	JC2	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30222152004	DGWC-4	EPA 9315	JC2	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30222152005	DGWC-23	EPA 9315	JC2	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30222152006	FD-1	EPA 9315	JC2	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30222152007	FB-1	EPA 9315	JC2	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30222152008	EB-1	EPA 9315	JC2	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30222152009	DGWC-67	EPA 9315	JC2	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30222152010	DGWC-68A	EPA 9315	JC2	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30222152011	DGWA-71	EPA 9315	JC2	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30222152012	DGWC-69	EPA 9315	JC2	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAF0649 Plant McDonough

Pace Project No.: 30222152

Sample: DGWA-2		Lab ID: 30222152001	Collected: 06/15/17 10:40	Received: 06/20/17 10:10	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac		Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.404 ± 0.258 (0.406)		pCi/L	07/07/17 08:35	13982-63-3	
		C:93% T:NA					
Radium-228	EPA 9320	0.575 ± 0.400 (0.773)		pCi/L	07/07/17 16:22	15262-20-1	
		C:76% T:86%					
Total Radium	Total Radium Calculation	0.979 ± 0.658 (1.18)		pCi/L	07/13/17 10:54	7440-14-4	

Sample: DGWA-53		Lab ID: 30222152002	Collected: 06/15/17 10:05	Received: 06/20/17 10:10	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac		Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	2.44 ± 0.638 (0.410)		pCi/L	07/07/17 08:36	13982-63-3	
		C:86% T:NA					
Radium-228	EPA 9320	2.14 ± 0.624 (0.761)		pCi/L	07/07/17 16:22	15262-20-1	
		C:72% T:91%					
Total Radium	Total Radium Calculation	4.58 ± 1.26 (1.17)		pCi/L	07/13/17 10:54	7440-14-4	

Sample: DGWA-70A		Lab ID: 30222152003	Collected: 06/15/17 15:35	Received: 06/20/17 10:10	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac		Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.248 ± 0.208 (0.366)		pCi/L	07/07/17 08:36	13982-63-3	
		C:94% T:NA					
Radium-228	EPA 9320	0.762 ± 0.495 (0.962)		pCi/L	07/07/17 16:22	15262-20-1	
		C:76% T:82%					
Total Radium	Total Radium Calculation	1.01 ± 0.703 (1.33)		pCi/L	07/13/17 10:54	7440-14-4	

Sample: DGWC-4		Lab ID: 30222152004	Collected: 06/15/17 13:05	Received: 06/20/17 10:10	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac		Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.345 ± 0.236 (0.363)		pCi/L	07/07/17 08:36	13982-63-3	
		C:83% T:NA					
Radium-228	EPA 9320	0.420 ± 0.384 (0.781)		pCi/L	07/07/17 16:22	15262-20-1	
		C:74% T:82%					
Total Radium	Total Radium Calculation	0.765 ± 0.620 (1.14)		pCi/L	07/13/17 10:54	7440-14-4	

Sample: DGWC-23		Lab ID: 30222152005	Collected: 06/15/17 13:15	Received: 06/20/17 10:10	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac		Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.412 ± 0.223 (0.277)		pCi/L	06/29/17 12:08	13982-63-3	2c
		C:83% T:NA					
Radium-228	EPA 9320	0.0225 ± 0.340 (0.786)		pCi/L	07/07/17 16:22	15262-20-1	1c
		C:72% T:87%					

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAF0649 Plant McDonough

Pace Project No.: 30222152

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-23 Lab ID: 30222152005 Collected: 06/15/17 13:15 Received: 06/20/17 10:10 Matrix: Water PWS: Site ID: Sample Type:						
Total Radium	Total Radium Calculation	0.435 ± 0.563 (1.06)	pCi/L	07/13/17 10:54	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: FD-1 Lab ID: 30222152006 Collected: 06/15/17 00:00 Received: 06/20/17 10:10 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	0.667 ± 0.319 (0.437) C:90% T:NA	pCi/L	07/07/17 08:37	13982-63-3	
Radium-228	EPA 9320	0.455 ± 0.395 (0.797) C:66% T:89%	pCi/L	07/07/17 16:23	15262-20-1	
Total Radium	Total Radium Calculation	1.12 ± 0.714 (1.23)	pCi/L	07/13/17 10:54	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: FB-1 Lab ID: 30222152007 Collected: 06/15/17 14:30 Received: 06/20/17 10:10 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	-0.0745 ± 0.156 (0.485) C:83% T:NA	pCi/L	07/07/17 08:37	13982-63-3	
Radium-228	EPA 9320	0.254 ± 0.340 (0.726) C:74% T:83%	pCi/L	07/07/17 16:23	15262-20-1	
Total Radium	Total Radium Calculation	0.254 ± 0.496 (1.21)	pCi/L	07/13/17 10:54	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: EB-1 Lab ID: 30222152008 Collected: 06/15/17 16:30 Received: 06/20/17 10:10 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	0.166 ± 0.183 (0.358) C:86% T:NA	pCi/L	07/07/17 08:37	13982-63-3	
Radium-228	EPA 9320	0.412 ± 0.345 (0.692) C:74% T:88%	pCi/L	07/07/17 16:23	15262-20-1	
Total Radium	Total Radium Calculation	0.578 ± 0.528 (1.05)	pCi/L	07/13/17 10:54	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-67 Lab ID: 30222152009 Collected: 06/16/17 09:20 Received: 06/20/17 10:10 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	0.158 ± 0.226 (0.493) C:85% T:NA	pCi/L	07/07/17 08:37	13982-63-3	
Radium-228	EPA 9320	0.808 ± 0.431 (0.784) C:79% T:85%	pCi/L	07/07/17 16:23	15262-20-1	
Total Radium	Total Radium Calculation	0.966 ± 0.657 (1.28)	pCi/L	07/13/17 10:54	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAF0649 Plant McDonough

Pace Project No.: 30222152

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-68A		Lab ID: 30222152010	Collected: 06/16/17 11:10	Received: 06/20/17 10:10	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Radium-226	EPA 9315	0.276 ± 0.208 (0.320)	pCi/L	07/07/17 08:37	13982-63-3		
Radium-228	EPA 9320	0.0557 ± 0.298 (0.682)	pCi/L	07/07/17 16:23	15262-20-1		
Total Radium	Total Radium Calculation	0.332 ± 0.506 (1.00)	pCi/L	07/13/17 10:54	7440-14-4		

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWA-71		Lab ID: 30222152011	Collected: 06/16/17 09:25	Received: 06/20/17 10:10	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Radium-226	EPA 9315	0.372 ± 0.251 (0.413)	pCi/L	07/07/17 08:37	13982-63-3		
Radium-228	EPA 9320	0.360 ± 0.378 (0.788)	pCi/L	07/07/17 16:23	15262-20-1		
Total Radium	Total Radium Calculation	0.732 ± 0.629 (1.20)	pCi/L	07/13/17 10:54	7440-14-4		

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-69		Lab ID: 30222152012	Collected: 06/16/17 11:30	Received: 06/20/17 10:10	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Radium-226	EPA 9315	0.482 ± 0.286 (0.431)	pCi/L	07/07/17 08:37	13982-63-3		
Radium-228	EPA 9320	1.13 ± 0.480 (0.775)	pCi/L	07/07/17 16:24	15262-20-1		
Total Radium	Total Radium Calculation	1.61 ± 0.766 (1.21)	pCi/L	07/13/17 10:54	7440-14-4		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAF0649 Plant McDonough

Pace Project No.: 30222152

QC Batch:	262721	Analysis Method:	EPA 9315
QC Batch Method:	EPA 9315	Analysis Description:	9315 Total Radium
Associated Lab Samples:	30222152001, 30222152002, 30222152003, 30222152004, 30222152005, 30222152006, 30222152007, 30222152008, 30222152009, 30222152010, 30222152011, 30222152012		

METHOD BLANK:	1293767	Matrix:	Water
Associated Lab Samples:	30222152001, 30222152002, 30222152003, 30222152004, 30222152005, 30222152006, 30222152007, 30222152008, 30222152009, 30222152010, 30222152011, 30222152012		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.137 ± 0.161 (0.320) C:91% T:NA	pCi/L	07/07/17 08:35	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAF0649 Plant McDonough

Pace Project No.: 30222152

QC Batch:	262719	Analysis Method:	EPA 9320
QC Batch Method:	EPA 9320	Analysis Description:	9320 Radium 228
Associated Lab Samples:	30222152001, 30222152002, 30222152003, 30222152004, 30222152005, 30222152006, 30222152007, 30222152008, 30222152009, 30222152010, 30222152011, 30222152012		

METHOD BLANK:	1293765	Matrix:	Water
Associated Lab Samples:	30222152001, 30222152002, 30222152003, 30222152004, 30222152005, 30222152006, 30222152007, 30222152008, 30222152009, 30222152010, 30222152011, 30222152012		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.185 ± 0.344 (0.756) C:75% T:81%	pCi/L	07/07/17 16:22	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: AAF0649 Plant McDonough
Pace Project No.: 30222152

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

TNTC - Too Numerous To Count

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

ANALYTE QUALIFIERS

- 1c Sample RPD for Ra-228 was outside of acceptance limits. Results for the sample and duplicate are both less than 1 pCi/L. There is no remaining volume available for re-analysis. Samples have been reported with narration.
- 2c The LCS recovery associated with this sample failed low and outside of the default acceptance criteria for Total Alpha Radium Ra-226 analysis at 74.38%. Pace's default lower limit is 75%. There was no sample volume available for re-analysis. All remaining samples from the associated analytical batch were re-prepped, and all sample results duplicated. Results for sample 30222152005 have been reported with narration and client permission.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

Chain of Custody



Workorder: AAF0649

Workorder Name: Plant McDonough

Owner Received Date:

Results Requested By: 7/12/2017

Report To:

Betsy McDaniel
Pace Analytical Atlanta
110 Technology Parkway
Peachtree Corners, GA 30092
Phone (770)-734-4200

Subcontract To:

Pace - Pittsburgh
1638 Roseytown Road
Stes. 2,3,4
Greensburg, PA 15601
Phone (724) 850-5600

Requested Analysis

WO#: 30222152



Preserved Containers

Item	Sample ID	Sample Type	Collect Date/Time	Lab ID	Matrix	Matrix	Preserved Containers	Date/Time	Received By	Date/Time	Comments	LAB USE ONLY
1	DGWA-2	G	6/15/2017 10:40	AAF0649-01	GW	GW	2					001
2	DGWA-53	G	6/15/2017 10:05	AAF0649-02	GW	GW	2					002
3	DGWA-70A	G	6/15/2017 15:35	AAF0649-03	GW	GW	2					003
4	DGWC-4	G	6/15/2017 13:05	AAF0649-04	GW	GW	4					004
5	DGWC-23	G	6/15/2017 13:15	AAF0649-05	GW	GW	2					005
6	FD-1	G	6/15/2017 0:00	AAF0649-06	GW	GW	2					006
7	FB-1	G	6/15/2017 14:30	AAF0649-07	GW	GW	2					007
8	EB-1	G	6/15/2017 16:30	AAF0649-08	GW	GW	2					008
9	DGWC-67	G	6/16/2017 9:20	AAF0649-09	GW	GW	2					009
10	DGWC-68A	G	6/16/2017 11:10	AAF0649-10	GW	GW	2					010

Radium 226, 228, Total

Transfers	Released By	Date/Time	Received By	Date/Time
1	M. RAHMAN	6/17/17	[Signature]	6/17/17
2				
3				

Cooler Temperature on Receipt 10K °C Custody Seal Y or N

Received on Ice Y or N

Sample Intact Y or N

***In order to maintain client confidentiality, location/name of the sampling site, sampler's name and signature may not be provided on this COC
This chain of custody is considered complete as is since this information is available in the owner laboratory.

Chain of Custody



Workorder: AAF0649
 Results Requested By: 7/12/2017

Owner Received Date:

Workorder Name: Plant McDonough

Report To:	Subcontract To:		Requested Analysis						
Betsy McDaniel	Pace - Pittsburgh		30222152						
Pace Analytical Atlanta	1638 Roseytown Road								
110 Technology Parkway	Stes. 2,3,4								
Peachtree Corners, GA 30092	Greensburg, PA 15601								
Phone (770)-734-4200	Phone (724) 850-5600								
Item	Sample ID	Sample Type	Collect Date/Time	Lab ID	Matrix	Matrix	Received By	Date/Time	Comments
11	DGWA-71	G	6/16/2017 9:25	AAF0649-11	GW	GW			
12	DGWC-69	G	6/16/2017 11:30	AAF0649-12	GW	GW			
13									
14									
15									
16									
17									
18									
19									
20									
Transfers	Released By	Date/Time	Received By	Date/Time	Comments				
1									
2									
3									

Transfers Released By: Radium 226, 228, Total

Matrix: GW

Sample Type: G

Collect Date/Time: 6/16/2017 9:25, 6/16/2017 11:30

Lab ID: AAF0649-11, AAF0649-12

Matrix: GW

Received By: [Blank]

Date/Time: [Blank]

Comments: [Blank]

LAB USE ONLY: OIL, OIL

Preserved Containers: 2, 2

COOL: [Blank]

COOLER TEMP: [Blank]

CUSTODY SEAL: [Blank]

RECEIVED ON ICE: [Blank]

SAMPLE INTACT: [Blank]

***In order to maintain client confidentiality, location/name of the sampling site, sampler's name and signature may not be provided on this COC

This chain of custody is considered complete as is since this information is available in the owner laboratory.

Friday, June 17, 2016 11:01:34 AM

FMT-ALL-C-002rev.00 24March2009

Page 2 of 2



Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CHAIN OF CUSTODY RECORD

CLIENT NAME: Georgia Power
CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185
 Atlanta, GA 30308
 404-506-7239

REPORT TO: Dawn Prell (Dawn_Prell@golder.com)
REQUESTED COMPLETION DATE: PO #:
 CC: Maria Padilla (kjurinko@golder.com)
 laburch@southernco.com

PROJECT NAME/STATE: Plant McDonough AP
PROJECT #: Phase II CCR

CONTAINER TYPE PRESERVATION	ANALYSIS REQUESTED	CONTAINER TYPE PRESERVATION	CONTAINERS			C O N T A I N E R S	REMARKS/ADDITIONAL INFORMATION
			# of	C	O		
P - PLASTIC A - AMBER GLASS G - CLEAR GLASS V - VOA VIAL S - STERILE O - OTHER	P P P 7 7 3	P P P 3 7 3	4	4	4	4	1 2 2 4 4 4 4 4 4 4 4
1 - HCl, 56°C 2 - H ₂ SO ₄ , 56°C 3 - HNO ₃ 4 - NaOH, 56°C 5 - NaOH/ZnAc, 56°C 6 - Na ₂ S ₂ O ₃ , 56°C 7 - 56°C not frozen							30222152 Extra Radium Collection Time: 14:30/16:30 NR 06/16/17
MATRIX CODES: DW - DRINKING WATER WW - WASTEWATER GW - GROUNDWATER SW - SURFACE WATER ST - STORMWATER W - WATER							
S - SOIL SL - SLUDGE SD - SOLID A - AIR L - LIQUID P - PRODUCT							

SAMPLED BY AND TITLE: Ben Hodges, Golder
RECEIVED BY: Mike Norman
DATE/TIME: 6/16/17 1358
DATE/TIME: 6/16/17 1358

RECEIVED BY LAB: Mike Norman
DATE/TIME: 6/16/17 1620
 Temperature: 1.3 Min 1.3 Max

RELINQUISHED BY:
RELINQUISHED BY:

SAMPLE SHIPPED VIA: UPS
CUSTODY SEAL: Intact Broken Not Present
SHIPMENT #: NA
LAB #: NA
COPIES: NA
DATE/TIME: 6/16/17 1358

FOR LAB USE ONLY: AAFO649
ENTERED INTO LIMS: Tracking #:

Sample Condition Upon Receipt Pittsburgh

30222152



Client Name: PACE - Atlanta Project # _____

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: 1081751051214

ZH

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Thermometer Used N/A Type of Ice: Wet Blue None

Cooler Temperature Observed Temp _____ °C Correction Factor: _____ °C Final Temp: _____ °C

Temp should be above freezing to 6°C

Date and Initials of person examining contents: ZH-6/20/17

Comments:	Yes	No	N/A	
Chain of Custody Present:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	1.
Chain of Custody Filled Out:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	2.
Chain of Custody Relinquished:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	3.
Sampler Name & Signature on COC:	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	4.
Sample Labels match COC:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	5.
-Includes date/time/ID Matrix: <u>WT</u>				
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	6.
Short Hold Time Analysis (<72hr remaining):	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	7.
Rush Turn Around Time Requested:	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	8.
Sufficient Volume:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	9.
Correct Containers Used:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	10.
-Pace Containers Used:	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
Containers Intact:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	11.
Orthophosphate field filtered	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	12.
Organic Samples checked for dechlorination:	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	13.
Filtered volume received for Dissolved tests	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	14.
All containers have been checked for preservation.	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	15.
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<i>PHCZ</i>
exceptions: VOA, coliform, TOC, O&G, Phenolics				Initial when completed: <i>ZH</i> Date/time of preservation: _____
				Lot # of added preservative: _____
Headspace in VOA Vials (>6mm):	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	16.
Trip Blank Present:	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	17.
Trip Blank Custody Seals Present	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
Rad Aqueous Samples Screened > 0.5 mrem/hr	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Initial when completed: <i>ZH</i> Date: <u>6/20/17</u>

Client Notification/ Resolution:


Person Contacted: _____ Date/Time: _____ Contacted By: _____

Comments/ Resolution: _____

A check in this box indicates that additional information has been stored in ereports.

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)
 *PM review is documented electronically in LIMS. When the Project Manager closes the SRF Review schedule in LIMS. The review is in the Status section of the Workorder Edit Screen.

Quality Control Sample Performance Assessment



Test: Ra-226
Analyst: JC2
Date: 7/6/2017
Worklist: 36335
Matrix: DW

Analyst Must Manually Enter All Fields Highlighted in Yellow.

Method Blank Assessment

MB Sample ID: 1293767
MB concentration: 0.137
MB Counting Uncertainty: 0.160
MB MDC: 0.320
MB Numerical Performance Indicator: 1.68
MB Status vs Numerical Indicator: N/A
MB Status vs. MDC: Pass

Laboratory Control Sample Assessment

LCS (Y or N)? N
LCS36335 LCS36335

Count Date: 7/7/2017
Spike I.D.: 17-030
Spike Concentration (pCi/mL): 80.199
Volume Used (mL): 0.10
Aliquot Volume (L, g, F): 0.513
Target Conc. (pCi/L, g, F): 15.637
Uncertainty (Calculated): 1.441
Result (pCi/L, g, F): 13.863
LCS/LCSD Counting Uncertainty (pCi/L, g, F): 1.245
Numerical Performance Indicator: -1.83
Percent Recovery: 88.66%
Status vs Numerical Indicator: N/A
Status vs Recovery: Pass

Duplicate Sample Assessment

Sample I.D.: 30222152004
Duplicate Sample I.D.: 30222152004DUP
Sample Result (pCi/L, g, F): 0.345
Sample Result Counting Uncertainty (pCi/L, g, F): 0.231
Sample Duplicate Result (pCi/L, g, F): 0.227
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F): 0.258
Are sample and/or duplicate results below MDC? See Below #
Duplicate Numerical Performance Indicator: 0.668
Duplicate RPD: 41.21%
Duplicate Status vs Numerical Indicator: N/A
Duplicate Status vs RPD: Fail***

Enter Duplicate sample IDs if other than LCS/LCSD in the space below.
30222152004
30222152004DUP

Sample Matrix Spike Control Assessment

Sample Collection Date:
Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Spike I.D.:
MS/MSD Decay Corrected Spike Concentration (pCi/mL):
Spike Volume Used in MS (mL):
Spike Volume Used in MSD (mL):
MS Aliquot (L, g, F):
MS Target Conc. (pCi/L, g, F):
MSD Aliquot (L, g, F):
MSD Target Conc. (pCi/L, g, F):
Spike uncertainty (calculated):
Sample Result:
Sample Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
MS Numerical Performance Indicator:
MSD Numerical Performance Indicator:
MS Percent Recovery:
MSD Percent Recovery:
MS Status vs Numerical Indicator:
MSD Status vs Numerical Indicator:
MS Status vs Recovery:
MSD Status vs Recovery:

Matrix Spike/Matrix Spike Duplicate Sample Assessment

Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Sample Matrix Spike Result:
Sample Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Sample Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
Duplicate Numerical Performance Indicator:
MS/MSD Duplicate RPD:
MS/MSD Duplicate Status vs Numerical Indicator:
MS/MSD Duplicate Status vs RPD:

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

results < 5x MDC, use numerical indicators to assess +3 for WT

Ph 7/13/17

***Batch must be re-prepped due to unacceptable precision.

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-228
Analyst: JLW
Date: 6/27/2017
Worklist: 36333
Matrix: DW

Method Blank Assessment	
MB Sample ID	1293765
MB Concentration:	0.185
MB Counting Uncertainty:	0.343
MB MDC:	0.756
MB Numerical Performance Indicator:	1.06
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment	
LCS (Y or N)?	N
LCS#	LCS036333
Count Date:	7/7/2017
Spike I.D.:	17-005
Spike Concentration (pCi/mL):	24.108
Volume Used (mL):	0.20
Aliquot Volume (L, g, F):	0.809
Target Conc. (pCi/L, g, F):	5.962
Uncertainty (Calculated):	0.429
Result (pCi/L, g, F):	6.074
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.683
Numerical Performance Indicator:	0.27
Percent Recovery:	101.88%
Status vs Numerical Indicator:	N/A
Status vs Recovery:	Pass

Duplicate Sample Assessment	
Sample I.D.:	30222152005
Duplicate Sample I.D.:	30222152005DUP
Sample Result (pCi/L, g, F):	0.022
Sample Result Counting Uncertainty (pCi/L, g, F):	0.340
Sample Duplicate Result (pCi/L, g, F):	0.922
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.392
Are sample and/or duplicate results below MDC?	See Below ##
Duplicate Numerical Performance Indicator:	-3.395
Duplicate RPD:	190.48%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Fail***

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

***Batch must be re-prepped due to unacceptable precision.

*Navated on report, no available sample for re-prep
Jul 7/13/17*

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Counting Uncertainty (pCi/L, g, F):	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
Duplicate Numerical Performance Indicator (Based on the Percent Recoveries) MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	

LABORATORY ANALYTICAL DATA

July 2017



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Laboratory Report

Prepared For:

**Georgia Power
2480 Maner Road
Atlanta, GA 30339**

Attention: Mr. Joju Abraham

Report Number: AAG0277

July 20, 2017

Project: CCR Event

Project #:Plant McDonough

We appreciate the opportunity to provide the analytical support for your project. The analytical results in this report are based upon information supplied by you, the client, and are for your exclusive use. If you have any questions regarding this data package, please do not hesitate to call.

Approved:

A handwritten signature in black ink that reads "Betsy McDonough" written over a horizontal line.

Project Manager

This report may not be reproduced, except in full, without written approval from Pace Analytical Services, LLC.
All test results relate only to the samples analyzed.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 20, 2017

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
DGWA-70A	AAG0277-01	Ground Water	07/11/17 10:15	07/12/17 13:30
DGWA-71	AAG0277-02	Ground Water	07/11/17 12:15	07/12/17 13:30
DGWA-2	AAG0277-03	Ground Water	07/11/17 10:05	07/12/17 13:30
DGWC-4	AAG0277-04	Ground Water	07/11/17 09:45	07/12/17 13:30
DGWC-5	AAG0277-05	Ground Water	07/11/17 11:35	07/12/17 13:30
DGWC-8	AAG0277-06	Ground Water	07/11/17 14:35	07/12/17 13:30
DGWC-9	AAG0277-07	Ground Water	07/11/17 14:05	07/12/17 13:30
FD-1	AAG0277-08	Ground Water	07/11/17 00:00	07/12/17 13:30
FB-1	AAG0277-09	Water	07/11/17 09:45	07/12/17 13:30
EB-1	AAG0277-10	Water	07/11/17 15:05	07/12/17 13:30



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 20, 2017

Case Narrative

The Radium analysis by methods EPA 9315/9320 was performed by Pace-Pittsburgh, 1638 Roseytown Road - Suites 2, 3, 4, Greensburg PA 15601. The Pace-Pittsburgh lab contact is Jacquelyn Collins at 724-850-5612.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 20, 2017

Report No.: AAG0277

Project: CCR Event

Client ID: DGWA-70A

Lab Number ID: AAG0277-01

Date/Time Sampled: 7/11/2017 10:15:00AM

Date/Time Received: 7/12/2017 1:30:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	25	25	10	mg/L	SM 2540 C		1	07/17/17 19:10	07/17/17 19:10	7070375	JPT
Inorganic Anions											
Chloride	2.1	0.25	0.01	mg/L	EPA 300.0	B-01	1	07/13/17 09:37	07/13/17 17:59	7070282	RLC
Fluoride	0.06	0.30	0.004	mg/L	EPA 300.0	J	1	07/13/17 09:37	07/13/17 17:59	7070282	RLC
Sulfate	1.4	1.0	0.09	mg/L	EPA 300.0		1	07/13/17 09:37	07/13/17 17:59	7070282	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 20:36	7070270	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 20:36	7070270	CSW
Barium	0.0306	0.0100	0.0004	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 20:36	7070270	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 20:36	7070270	CSW
Boron	ND	0.0400	0.0060	mg/L	EPA 6020B		1	07/13/17 09:45	07/14/17 14:55	7070270	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 20:36	7070270	CSW
Calcium	5.96	5.00	2.02	mg/L	EPA 6020B		50	07/13/17 09:45	07/13/17 20:41	7070270	CSW
Chromium	0.0005	0.0100	0.0005	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/13/17 20:36	7070270	CSW
Cobalt	0.0007	0.0100	0.0003	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/13/17 20:36	7070270	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 20:36	7070270	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 20:36	7070270	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 20:36	7070270	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 20:36	7070270	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 20:36	7070270	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/19/17 08:50	07/19/17 12:34	7070369	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

July 20, 2017

Attention: Mr. Joju Abraham

Report No.: AAG0277

Project: CCR Event

Client ID: DGWA-71

Lab Number ID: AAG0277-02

Date/Time Sampled: 7/11/2017 12:15:00PM

Date/Time Received: 7/12/2017 1:30:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	59	25	10	mg/L	SM 2540 C		1	07/17/17 19:10	07/17/17 19:10	7070375	JPT
Inorganic Anions											
Chloride	3.1	0.25	0.01	mg/L	EPA 300.0	B-01	1	07/13/17 09:37	07/13/17 18:19	7070282	RLC
Fluoride	0.007	0.30	0.004	mg/L	EPA 300.0	J	1	07/13/17 09:37	07/13/17 18:19	7070282	RLC
Sulfate	11	1.0	0.09	mg/L	EPA 300.0		1	07/13/17 09:37	07/13/17 18:19	7070282	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 20:47	7070270	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 20:47	7070270	CSW
Barium	0.0362	0.0100	0.0004	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 20:47	7070270	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 20:47	7070270	CSW
Boron	0.0077	0.0400	0.0060	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/14/17 15:01	7070270	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 20:47	7070270	CSW
Calcium	7.71	5.00	2.02	mg/L	EPA 6020B		50	07/13/17 09:45	07/13/17 20:53	7070270	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 20:47	7070270	CSW
Cobalt	0.0008	0.0100	0.0003	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/13/17 20:47	7070270	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 20:47	7070270	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 20:47	7070270	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 20:47	7070270	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 20:47	7070270	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 20:47	7070270	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/19/17 08:50	07/19/17 12:36	7070369	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

July 20, 2017

Attention: Mr. Joju Abraham

Report No.: AAG0277

Project: CCR Event

Client ID: DGWA-2

Lab Number ID: AAG0277-03

Date/Time Sampled: 7/11/2017 10:05:00AM

Date/Time Received: 7/12/2017 1:30:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	542	25	10	mg/L	SM 2540 C		1	07/17/17 19:10	07/17/17 19:10	7070375	JPT
Inorganic Anions											
Chloride	4.6	0.25	0.01	mg/L	EPA 300.0	B-01	1	07/13/17 09:37	07/13/17 18:40	7070282	RLC
Fluoride	0.04	0.30	0.004	mg/L	EPA 300.0	J	1	07/13/17 09:37	07/13/17 18:40	7070282	RLC
Sulfate	330	20	1.8	mg/L	EPA 300.0		20	07/13/17 09:37	07/18/17 01:41	7070282	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:10	7070270	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:10	7070270	CSW
Barium	0.0201	0.0100	0.0004	mg/L	EPA 6020B		1	07/13/17 09:45	07/14/17 17:57	7070270	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:10	7070270	CSW
Boron	1.39	0.500	0.0060	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:10	7070270	CSW
Cadmium	0.0003	0.0010	0.0001	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/13/17 21:10	7070270	CSW
Calcium	98.4	25.0	2.02	mg/L	EPA 6020B		50	07/13/17 09:45	07/13/17 21:15	7070270	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:10	7070270	CSW
Cobalt	0.0238	0.0100	0.0003	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:10	7070270	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:10	7070270	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:10	7070270	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:10	7070270	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:10	7070270	CSW
Lithium	0.0731	0.0500	0.0015	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:10	7070270	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/19/17 08:50	07/19/17 12:39	7070369	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

July 20, 2017

Attention: Mr. Joju Abraham

Report No.: AAG0277

Project: CCR Event

Client ID: DGWC-4

Lab Number ID: AAG0277-04

Date/Time Sampled: 7/11/2017 9:45:00AM

Date/Time Received: 7/12/2017 1:30:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	1160	25	10	mg/L	SM 2540 C		1	07/17/17 19:10	07/17/17 19:10	7070375	JPT
Inorganic Anions											
Chloride	28	0.25	0.01	mg/L	EPA 300.0	B-01	1	07/13/17 09:37	07/13/17 19:01	7070282	RLC
Fluoride	0.02	0.30	0.004	mg/L	EPA 300.0	J	1	07/13/17 09:37	07/13/17 19:01	7070282	RLC
Sulfate	740	50	4.6	mg/L	EPA 300.0		50	07/13/17 09:37	07/18/17 02:01	7070282	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:21	7070270	CSW
Arsenic	0.0008	0.0050	0.0005	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/13/17 21:21	7070270	CSW
Barium	0.0301	0.0100	0.0004	mg/L	EPA 6020B		1	07/13/17 09:45	07/14/17 18:03	7070270	CSW
Beryllium	0.0001	0.0030	0.00009	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/13/17 21:21	7070270	CSW
Boron	3.85	0.500	0.0060	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:21	7070270	CSW
Cadmium	0.0006	0.0010	0.0001	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/13/17 21:21	7070270	CSW
Calcium	249	25.0	2.02	mg/L	EPA 6020B		50	07/13/17 09:45	07/13/17 21:27	7070270	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:21	7070270	CSW
Cobalt	0.0015	0.0100	0.0003	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/13/17 21:21	7070270	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:21	7070270	CSW
Molybdenum	0.0041	0.0100	0.0010	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/13/17 21:21	7070270	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:21	7070270	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:21	7070270	CSW
Lithium	0.0022	0.0500	0.0015	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/13/17 21:21	7070270	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/19/17 08:50	07/19/17 12:41	7070369	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

July 20, 2017

Attention: Mr. Joju Abraham

Report No.: AAG0277

Project: CCR Event

Client ID: DGWC-5

Lab Number ID: AAG0277-05

Date/Time Sampled: 7/11/2017 11:35:00AM

Date/Time Received: 7/12/2017 1:30:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	612	25	10	mg/L	SM 2540 C		1	07/17/17 19:10	07/17/17 19:10	7070375	JPT
Inorganic Anions											
Chloride	9.0	0.25	0.01	mg/L	EPA 300.0	B-01	1	07/13/17 09:37	07/13/17 19:21	7070282	RLC
Fluoride	0.70	0.30	0.004	mg/L	EPA 300.0		1	07/13/17 09:37	07/13/17 19:21	7070282	RLC
Sulfate	440	20	1.8	mg/L	EPA 300.0		20	07/13/17 09:37	07/18/17 02:22	7070282	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:33	7070270	CSW
Arsenic	0.0203	0.0050	0.0005	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:33	7070270	CSW
Barium	0.0174	0.0500	0.0021	mg/L	EPA 6020B	R-01, J	5	07/13/17 09:45	07/14/17 18:08	7070270	CSW
Beryllium	0.0050	0.0030	0.00009	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:33	7070270	CSW
Boron	4.61	0.500	0.0060	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:33	7070270	CSW
Cadmium	0.0003	0.0010	0.0001	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/13/17 21:33	7070270	CSW
Calcium	84.6	25.0	2.02	mg/L	EPA 6020B		50	07/13/17 09:45	07/13/17 21:39	7070270	CSW
Chromium	ND	0.100	0.0045	mg/L	EPA 6020B	R-01	10	07/13/17 09:45	07/17/17 09:12	7070270	CSW
Cobalt	0.0351	0.100	0.0026	mg/L	EPA 6020B	R-01, J	10	07/13/17 09:45	07/17/17 09:12	7070270	CSW
Lead	ND	0.0050	0.0003	mg/L	EPA 6020B		5	07/13/17 09:45	07/14/17 18:08	7070270	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:33	7070270	CSW
Selenium	0.0607	0.0100	0.0018	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:33	7070270	CSW
Thallium	ND	0.0020	0.0003	mg/L	EPA 6020B	R-01	5	07/13/17 09:45	07/14/17 18:08	7070270	CSW
Lithium	0.0031	0.0500	0.0015	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/13/17 21:33	7070270	CSW
Mercury	0.00020	0.00050	0.000041	mg/L	EPA 7470A	J	1	07/19/17 08:50	07/19/17 12:43	7070369	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 20, 2017

Report No.: AAG0277

Project: CCR Event

Client ID: DGWC-8

Lab Number ID: AAG0277-06

Date/Time Sampled: 7/11/2017 2:35:00PM

Date/Time Received: 7/12/2017 1:30:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	679	25	10	mg/L	SM 2540 C		1	07/17/17 19:10	07/17/17 19:10	7070375	JPT
Inorganic Anions											
Chloride	9.7	0.25	0.01	mg/L	EPA 300.0	B-01	1	07/13/17 09:37	07/13/17 19:42	7070282	RLC
Fluoride	0.20	0.30	0.004	mg/L	EPA 300.0	J	1	07/13/17 09:37	07/13/17 19:42	7070282	RLC
Sulfate	440	50	4.6	mg/L	EPA 300.0		50	07/13/17 09:37	07/18/17 02:43	7070282	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:44	7070270	CSW
Arsenic	0.0012	0.0050	0.0005	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/13/17 21:44	7070270	CSW
Barium	0.0389	0.0100	0.0004	mg/L	EPA 6020B		1	07/13/17 09:45	07/14/17 18:14	7070270	CSW
Beryllium	0.0022	0.0030	0.00009	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/13/17 21:44	7070270	CSW
Boron	2.55	0.500	0.0060	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:44	7070270	CSW
Cadmium	0.0021	0.0010	0.0001	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:44	7070270	CSW
Calcium	91.1	25.0	2.02	mg/L	EPA 6020B		50	07/13/17 09:45	07/13/17 21:50	7070270	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:44	7070270	CSW
Cobalt	0.0601	0.0100	0.0003	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:44	7070270	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:44	7070270	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:44	7070270	CSW
Selenium	0.0031	0.0100	0.0018	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/13/17 21:44	7070270	CSW
Thallium	0.0001	0.0010	0.00005	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/13/17 21:44	7070270	CSW
Lithium	0.0045	0.0500	0.0015	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/13/17 21:44	7070270	CSW
Mercury	0.00006	0.00050	0.000041	mg/L	EPA 7470A	J	1	07/19/17 08:50	07/19/17 12:51	7070369	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 20, 2017

Report No.: AAG0277

Project: CCR Event

Client ID: DGWC-9

Lab Number ID: AAG0277-07

Date/Time Sampled: 7/11/2017 2:05:00PM

Date/Time Received: 7/12/2017 1:30:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	436	25	10	mg/L	SM 2540 C		1	07/17/17 19:10	07/17/17 19:10	7070375	JPT
Inorganic Anions											
Chloride	6.9	0.25	0.01	mg/L	EPA 300.0	B-01	1	07/13/17 09:37	07/13/17 20:03	7070282	RLC
Fluoride	1.1	0.30	0.004	mg/L	EPA 300.0		1	07/13/17 09:37	07/13/17 20:03	7070282	RLC
Sulfate	320	20	1.8	mg/L	EPA 300.0		20	07/13/17 09:37	07/18/17 03:03	7070282	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:56	7070270	CSW
Arsenic	0.0194	0.0050	0.0005	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:56	7070270	CSW
Barium	0.0154	0.0500	0.0021	mg/L	EPA 6020B	R-01, J	5	07/13/17 09:45	07/14/17 18:34	7070270	CSW
Beryllium	0.0048	0.0030	0.00009	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:56	7070270	CSW
Boron	1.78	0.500	0.0060	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:56	7070270	CSW
Cadmium	0.0005	0.0010	0.0001	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/13/17 21:56	7070270	CSW
Calcium	73.7	25.0	2.02	mg/L	EPA 6020B		50	07/13/17 09:45	07/13/17 22:01	7070270	CSW
Chromium	ND	0.100	0.0045	mg/L	EPA 6020B	R-01	10	07/13/17 09:45	07/17/17 09:17	7070270	CSW
Cobalt	0.136	0.100	0.0026	mg/L	EPA 6020B		10	07/13/17 09:45	07/17/17 09:17	7070270	CSW
Lead	ND	0.0050	0.0003	mg/L	EPA 6020B		5	07/13/17 09:45	07/14/17 18:34	7070270	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:56	7070270	CSW
Selenium	0.0561	0.0100	0.0018	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 21:56	7070270	CSW
Thallium	0.0007	0.0020	0.0003	mg/L	EPA 6020B	R-01, J	5	07/13/17 09:45	07/14/17 18:34	7070270	CSW
Lithium	0.0220	0.0500	0.0015	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/13/17 21:56	7070270	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/19/17 08:50	07/19/17 12:53	7070369	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 20, 2017

Report No.: AAG0277

Project: CCR Event

Client ID: FD-1

Lab Number ID: AAG0277-08

Date/Time Sampled: 7/11/2017 12:00:00AM

Date/Time Received: 7/12/2017 1:30:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	35	25	10	mg/L	SM 2540 C		1	07/17/17 19:50	07/17/17 19:50	7070376	JPT
Inorganic Anions											
Chloride	2.2	0.25	0.01	mg/L	EPA 300.0	B-01	1	07/13/17 09:37	07/13/17 22:48	7070282	RLC
Fluoride	0.05	0.30	0.004	mg/L	EPA 300.0	J	1	07/13/17 09:37	07/13/17 22:48	7070282	RLC
Sulfate	1.1	1.0	0.09	mg/L	EPA 300.0		1	07/13/17 09:37	07/13/17 22:48	7070282	RLC
Metals, Total											
Antimony	0.0006	0.0030	0.0006	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/13/17 22:19	7070270	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:19	7070270	CSW
Barium	0.0279	0.0100	0.0004	mg/L	EPA 6020B		1	07/13/17 09:45	07/14/17 15:19	7070270	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:19	7070270	CSW
Boron	ND	0.0400	0.0060	mg/L	EPA 6020B		1	07/13/17 09:45	07/14/17 15:19	7070270	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:19	7070270	CSW
Calcium	5.79	5.00	2.02	mg/L	EPA 6020B		50	07/13/17 09:45	07/13/17 22:24	7070270	CSW
Chromium	0.0005	0.0100	0.0005	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/13/17 22:19	7070270	CSW
Cobalt	0.0007	0.0100	0.0003	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/13/17 22:19	7070270	CSW
Lead	0.0002	0.0050	0.00007	mg/L	EPA 6020B	J	1	07/13/17 09:45	07/13/17 22:19	7070270	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:19	7070270	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:19	7070270	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:19	7070270	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:19	7070270	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/19/17 08:50	07/19/17 12:55	7070369	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

July 20, 2017

Attention: Mr. Joju Abraham

Report No.: AAG0277

Project: CCR Event

Client ID: FB-1

Lab Number ID: AAG0277-09

Date/Time Sampled: 7/11/2017 9:45:00AM

Date/Time Received: 7/12/2017 1:30:00PM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C		1	07/17/17 19:50	07/17/17 19:50	7070376	JPT
Inorganic Anions											
Chloride	0.08	0.25	0.01	mg/L	EPA 300.0	B-01, J	1	07/13/17 09:37	07/13/17 23:09	7070282	RLC
Fluoride	ND	0.30	0.004	mg/L	EPA 300.0		1	07/13/17 09:37	07/13/17 23:09	7070282	RLC
Sulfate	ND	1.0	0.09	mg/L	EPA 300.0		1	07/13/17 09:37	07/13/17 23:09	7070282	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:30	7070270	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:30	7070270	CSW
Barium	ND	0.0100	0.0004	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:30	7070270	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:30	7070270	CSW
Boron	ND	0.0400	0.0060	mg/L	EPA 6020B		1	07/13/17 09:45	07/14/17 15:25	7070270	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:30	7070270	CSW
Calcium	ND	0.500	0.0404	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:30	7070270	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:30	7070270	CSW
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:30	7070270	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:30	7070270	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:30	7070270	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:30	7070270	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:30	7070270	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:30	7070270	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/19/17 08:50	07/19/17 12:58	7070369	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 20, 2017

Report No.: AAG0277

Project: CCR Event

Client ID: EB-1

Lab Number ID: AAG0277-10

Date/Time Sampled: 7/11/2017 3:05:00PM

Date/Time Received: 7/12/2017 1:30:00PM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C		1	07/17/17 19:50	07/17/17 19:50	7070376	JPT
Inorganic Anions											
Chloride	0.07	0.25	0.01	mg/L	EPA 300.0	B-01, J	1	07/13/17 09:37	07/13/17 23:29	7070282	RLC
Fluoride	ND	0.30	0.004	mg/L	EPA 300.0		1	07/13/17 09:37	07/13/17 23:29	7070282	RLC
Sulfate	ND	1.0	0.09	mg/L	EPA 300.0		1	07/13/17 09:37	07/13/17 23:29	7070282	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:36	7070270	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:36	7070270	CSW
Barium	ND	0.0100	0.0004	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:36	7070270	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:36	7070270	CSW
Boron	ND	0.0400	0.0060	mg/L	EPA 6020B		1	07/13/17 09:45	07/14/17 15:31	7070270	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:36	7070270	CSW
Calcium	ND	0.500	0.0404	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:36	7070270	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:36	7070270	CSW
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:36	7070270	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:36	7070270	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:36	7070270	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:36	7070270	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:36	7070270	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	07/13/17 09:45	07/13/17 22:36	7070270	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/19/17 08:50	07/19/17 13:00	7070369	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 20, 2017

Report No.: AAG0277

General Chemistry - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7070375 - SM 2540 C											
Blank (7070375-BLK1)						Prepared & Analyzed: 07/17/17					
Total Dissolved Solids	ND	25	10	mg/L							
LCS (7070375-BS1)						Prepared & Analyzed: 07/17/17					
Total Dissolved Solids	390	25	10	mg/L	400.00		98	84-108			
Duplicate (7070375-DUP1)						Source: AAG0275-08 Prepared & Analyzed: 07/17/17					
Total Dissolved Solids	ND	25	10	mg/L		15				10	
Duplicate (7070375-DUP2)						Source: AAG0275-09 Prepared & Analyzed: 07/17/17					
Total Dissolved Solids	824	25	10	mg/L		836			1	10	
Batch 7070376 - SM 2540 C											
Blank (7070376-BLK1)						Prepared & Analyzed: 07/17/17					
Total Dissolved Solids	ND	25	10	mg/L							
LCS (7070376-BS1)						Prepared & Analyzed: 07/17/17					
Total Dissolved Solids	340	25	10	mg/L	400.00		85	84-108			
Duplicate (7070376-DUP1)						Source: AAG0277-09 Prepared & Analyzed: 07/17/17					
Total Dissolved Solids	ND	25	10	mg/L		ND				10	
Duplicate (7070376-DUP2)						Source: AAG0387-03 Prepared & Analyzed: 07/17/17					
Total Dissolved Solids	236	25	10	mg/L		238			0.8	10	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 20, 2017

Report No.: AAG0277

Inorganic Anions - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7070282 - EPA 300.0											
Blank (7070282-BLK1)						Prepared & Analyzed: 07/13/17					
Chloride	0.01	0.25	0.01	mg/L							J
Fluoride	ND	0.30	0.004	mg/L							
Sulfate	ND	1.0	0.09	mg/L							
LCS (7070282-BS1)						Prepared & Analyzed: 07/13/17					
Chloride	10.0	0.25	0.01	mg/L	10.020		100	90-110			
Fluoride	9.96	0.30	0.004	mg/L	10.020		99	90-110			
Sulfate	10.3	1.0	0.09	mg/L	10.050		103	90-110			
Matrix Spike (7070282-MS1)						Source: AAG0275-05 Prepared & Analyzed: 07/13/17					
Chloride	15.7	0.25	0.01	mg/L	10.020	5.73	100	90-110			
Fluoride	10.4	0.30	0.004	mg/L	10.020	0.06	103	90-110			
Sulfate	94.1	1.0	0.09	mg/L	10.050	94.1	NR	90-110			QM-02
Matrix Spike (7070282-MS2)						Source: AAG0277-07 Prepared & Analyzed: 07/13/17					
Chloride	16.9	0.25	0.01	mg/L	10.020	6.93	100	90-110			
Fluoride	15.1	0.30	0.004	mg/L	10.020	1.09	140	90-110			QM-05
Sulfate	210	1.0	0.09	mg/L	10.050	225	NR	90-110			QM-02
Matrix Spike Dup (7070282-MSD1)						Source: AAG0275-05 Prepared & Analyzed: 07/13/17					
Chloride	15.8	0.25	0.01	mg/L	10.020	5.73	101	90-110	0.7	15	
Fluoride	10.6	0.30	0.004	mg/L	10.020	0.06	106	90-110	2	15	
Sulfate	94.0	1.0	0.09	mg/L	10.050	94.1	NR	90-110	0.1	15	QM-02



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 20, 2017

Report No.: AAG0277

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	----	-----	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7070270 - EPA 3005A

Blank (7070270-BLK1)

Prepared & Analyzed: 07/13/17

Antimony	ND	0.0030	0.0006	mg/L							
Arsenic	ND	0.0050	0.0005	mg/L							
Barium	ND	0.0100	0.0004	mg/L							
Beryllium	ND	0.0030	0.00009	mg/L							
Boron	ND	0.0400	0.0060	mg/L							
Cadmium	ND	0.0010	0.0001	mg/L							
Calcium	ND	0.500	0.0404	mg/L							
Chromium	ND	0.0100	0.0005	mg/L							
Cobalt	ND	0.0100	0.0003	mg/L							
Copper	0.0003	0.0250	0.0003	mg/L							J
Lead	ND	0.0050	0.00007	mg/L							
Molybdenum	ND	0.0100	0.0010	mg/L							
Nickel	ND	0.0100	0.0005	mg/L							
Selenium	ND	0.0100	0.0018	mg/L							
Silver	ND	0.0100	0.0002	mg/L							
Thallium	ND	0.0010	0.00005	mg/L							
Vanadium	ND	0.0100	0.0012	mg/L							
Zinc	ND	0.0100	0.0012	mg/L							
Lithium	ND	0.0500	0.0015	mg/L							

LCS (7070270-BS1)

Prepared & Analyzed: 07/13/17

Antimony	0.104	0.0030	0.0006	mg/L	0.10000		104	80-120			
Arsenic	0.100	0.0050	0.0005	mg/L	0.10000		100	80-120			
Barium	0.0945	0.0100	0.0004	mg/L	0.10000		94	80-120			
Beryllium	0.104	0.0030	0.00009	mg/L	0.10000		104	80-120			
Boron	1.05	0.0400	0.0060	mg/L	1.0000		105	80-120			
Cadmium	0.105	0.0010	0.0001	mg/L	0.10000		105	80-120			
Calcium	1.03	0.500	0.0404	mg/L	1.0000		103	80-120			
Chromium	0.104	0.0100	0.0005	mg/L	0.10000		104	80-120			
Cobalt	0.101	0.0100	0.0003	mg/L	0.10000		101	80-120			
Copper	0.100	0.0250	0.0003	mg/L	0.10000		100	80-120			
Lead	0.103	0.0050	0.00007	mg/L	0.10000		103	80-120			
Molybdenum	0.105	0.0100	0.0010	mg/L	0.10000		105	80-120			
Nickel	0.103	0.0100	0.0005	mg/L	0.10000		103	80-120			
Selenium	0.102	0.0100	0.0018	mg/L	0.10000		102	80-120			
Silver	0.103	0.0100	0.0002	mg/L	0.10000		103	80-120			
Thallium	0.103	0.0010	0.00005	mg/L	0.10000		103	80-120			
Vanadium	0.105	0.0100	0.0012	mg/L	0.10000		105	80-120			
Zinc	0.103	0.0100	0.0012	mg/L	0.10000		103	80-120			
Lithium	0.106	0.0500	0.0015	mg/L	0.10000		106	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 20, 2017

Report No.: AAG0277

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7070270 - EPA 3005A											
Matrix Spike (7070270-MS1)			Source: AAG0230-03				Prepared & Analyzed: 07/13/17				
Antimony	0.106	0.0030	0.0006	mg/L	0.10000	ND	106	75-125			
Arsenic	0.103	0.0050	0.0005	mg/L	0.10000	0.0011	102	75-125			
Barium	0.121	0.0100	0.0004	mg/L	0.10000	0.0305	90	75-125			
Beryllium	0.0993	0.0030	0.00009	mg/L	0.10000	ND	99	75-125			
Boron	1.03	0.0400	0.0060	mg/L	1.0000	0.0534	98	75-125			
Cadmium	0.103	0.0010	0.0001	mg/L	0.10000	ND	103	75-125			
Calcium	40.3	25.0	2.02	mg/L	1.0000	39.0	136	75-125			QM-02
Chromium	0.101	0.0100	0.0005	mg/L	0.10000	0.0009	100	75-125			
Cobalt	0.0986	0.0100	0.0003	mg/L	0.10000	ND	99	75-125			
Copper	0.0966	0.0250	0.0003	mg/L	0.10000	ND	97	75-125			
Lead	0.101	0.0050	0.00007	mg/L	0.10000	ND	101	75-125			
Molybdenum	0.108	0.0100	0.0010	mg/L	0.10000	0.0013	107	75-125			
Nickel	0.0990	0.0100	0.0005	mg/L	0.10000	ND	99	75-125			
Selenium	0.102	0.0100	0.0018	mg/L	0.10000	ND	102	75-125			
Silver	0.102	0.0100	0.0002	mg/L	0.10000	ND	102	75-125			
Thallium	0.104	0.0010	0.00005	mg/L	0.10000	ND	104	75-125			
Vanadium	0.102	0.0100	0.0012	mg/L	0.10000	ND	102	75-125			
Zinc	0.101	0.0100	0.0012	mg/L	0.10000	ND	101	75-125			
Lithium	0.0972	0.0500	0.0015	mg/L	0.10000	ND	97	75-125			
Matrix Spike Dup (7070270-MSD1)			Source: AAG0230-03				Prepared & Analyzed: 07/13/17				
Antimony	0.106	0.0030	0.0006	mg/L	0.10000	ND	106	75-125	0.4	20	
Arsenic	0.103	0.0050	0.0005	mg/L	0.10000	0.0011	102	75-125	0.4	20	
Barium	0.122	0.0100	0.0004	mg/L	0.10000	0.0305	92	75-125	1	20	
Beryllium	0.0961	0.0030	0.00009	mg/L	0.10000	ND	96	75-125	3	20	
Boron	1.02	0.0400	0.0060	mg/L	1.0000	0.0534	97	75-125	1	20	
Cadmium	0.102	0.0010	0.0001	mg/L	0.10000	ND	102	75-125	1	20	
Calcium	40.9	25.0	2.02	mg/L	1.0000	39.0	190	75-125	1	20	QM-02
Chromium	0.102	0.0100	0.0005	mg/L	0.10000	0.0009	101	75-125	1	20	
Cobalt	0.0990	0.0100	0.0003	mg/L	0.10000	ND	99	75-125	0.4	20	
Copper	0.0962	0.0250	0.0003	mg/L	0.10000	ND	96	75-125	0.5	20	
Lead	0.0998	0.0050	0.00007	mg/L	0.10000	ND	100	75-125	1	20	
Molybdenum	0.107	0.0100	0.0010	mg/L	0.10000	0.0013	106	75-125	1	20	
Nickel	0.0992	0.0100	0.0005	mg/L	0.10000	ND	99	75-125	0.2	20	
Selenium	0.101	0.0100	0.0018	mg/L	0.10000	ND	101	75-125	2	20	
Silver	0.0998	0.0100	0.0002	mg/L	0.10000	ND	100	75-125	2	20	
Thallium	0.102	0.0010	0.00005	mg/L	0.10000	ND	102	75-125	2	20	
Vanadium	0.103	0.0100	0.0012	mg/L	0.10000	ND	103	75-125	1	20	
Zinc	0.101	0.0100	0.0012	mg/L	0.10000	ND	101	75-125	0.06	20	
Lithium	0.0970	0.0500	0.0015	mg/L	0.10000	ND	97	75-125	0.2	20	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 20, 2017

Report No.: AAG0277

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7070270 - EPA 3005A											
Post Spike (7070270-PS1)			Source: AAG0230-03			Prepared & Analyzed: 07/13/17					
Antimony	104			ug/L	100.00	0.235	103	80-120			
Arsenic	105			ug/L	100.00	1.07	104	80-120			
Barium	123			ug/L	100.00	30.5	93	80-120			
Beryllium	99.0			ug/L	100.00	-0.0033	99	80-120			
Boron	1040			ug/L	1000.0	53.4	99	80-120			
Cadmium	103			ug/L	100.00	0.0002	103	80-120			
Calcium	41600			ug/L	1000.0	39000	266	80-120			QM-02
Chromium	104			ug/L	100.00	0.949	103	80-120			
Cobalt	101			ug/L	100.00	-0.0112	101	80-120			
Copper	99.8			ug/L	100.00	0.0455	100	80-120			
Lead	102			ug/L	100.00	-0.0029	102	80-120			
Molybdenum	110			ug/L	100.00	1.28	108	80-120			
Nickel	103			ug/L	100.00	0.126	103	80-120			
Selenium	103			ug/L	100.00	-0.139	103	80-120			
Silver	103			ug/L	100.00	-0.0060	103	80-120			
Thallium	104			ug/L	100.00	-0.0074	104	80-120			
Vanadium	104			ug/L	100.00	1.00	103	80-120			
Zinc	103			ug/L	100.00	0.520	103	80-120			
Lithium	97.5			ug/L	100.00	0.0887	97	80-120			

Batch 7070369 - EPA 7470A

Blank (7070369-BLK1)					Prepared & Analyzed: 07/19/17						
Mercury	ND	0.00050	0.000041	mg/L							
LCS (7070369-BS1)					Prepared & Analyzed: 07/19/17						
Mercury	0.00214	0.00050	0.000041	mg/L	2.5000E-3	86	80-120				



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 20, 2017

Report No.: AAG0277

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7070369 - EPA 7470A											
Matrix Spike (7070369-MS1)			Source: AAG0275-01			Prepared & Analyzed: 07/19/17					
Mercury	0.00208	0.00050	0.000041	mg/L	2.5000E-3	ND	83	75-125			
Matrix Spike Dup (7070369-MSD1)			Source: AAG0275-01			Prepared & Analyzed: 07/19/17					
Mercury	0.00213	0.00050	0.000041	mg/L	2.5000E-3	ND	85	75-125	2	20	
Post Spike (7070369-PS1)			Source: AAG0275-01			Prepared & Analyzed: 07/19/17					
Mercury	1.61			ug/L	1.6667	0.00618	96	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 20, 2017

Legend

Definition of Laboratory Terms

- ND** - Not Detected at levels equal to or greater than the MDL
- BRL** - Not Detected at levels equal to or greater than the RL
- RL** - Reporting Limit **MDL** - Method Detection Limit
- SOP** - Method run per Pace Standard Operating Procedure
- CFU** - Colony Forming Units
- DF** - Dilution Factor **TIC** - Tentatively Identified Compound

Sample Information

N-Nitrosodiphenylamine breaks down to diphenylamine in the GCMS; both analytes are reported as N-Nitrosodiphenylamine. Pace is not NELAC certified for N-Nitrosodiphenylamine.

Phthalic acid and phthalic anhydride are reported as dimethyl phthalate

Maleic acid and maleic anhydride are reported as dimethyl malate

1,2-Diphenylhydrazine breaks down to azobenzene in the GCMS; both analytes are reported as azobenzene

Definition of Qualifiers

- R-01** Elevated reporting limit due to matrix interference.
- QM-05** The spike recovery was outside acceptance limits for the MS and/or MSD and/or PDS due to suspected matrix interference. Sample results for the QC batch were accepted based on acceptable LCS recoveries.
- QM-02** The spike recovery is outside acceptance limits due to insignificant spike amount as compared to sample concentration.
- J** Estimated value less than Reporting Limit (RL) but greater than Method Detection Limit(MDL) (CLP J-Flag).
- B-01** Analyte was detected in the associated method blank at an estimated level equal to or greater than the MDL. Sample values reported as greater than the MDL and less than 10x the method blank value are reported as estimated values.

Note: Unless otherwise noted, all results are reported on an as received basis.

CHAIN OF CUSTODY RECORD

Pace Analytical Services, Inc.
110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
(770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CLIENT NAME: Georgia Power CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185 Atlanta, GA 30308 404-506-7239 REPORT TO: Dawn Prell (Dawn.Prell@golder.com) REQUESTED COMPLETION DATE: laburch@southernco.com PROJECT NAME/STATE: Plant McDonough AP PROJECT #: Phase II CCR		ANALYSIS REQUESTED P P P P 3 7 3 # of CONTAINERS Metals App. III & IV (EPA 602/7470) Cl, F, SO ₄ & TDS (EPA 300 & 5M 2540C) Radium 226 & 228 (SW-846 9315/9320)		CONTAINER TYPE P - PLASTIC A - AMBER GLASS G - CLEAR GLASS V - VOA VIAL S - STERILE O - OTHER PRESERVATION 1 - HCl, 56°C 2 - H ₂ SO ₄ , 56°C 3 - HNO ₃ 4 - NaOH, 56°C 5 - NaOH/ZnAc, 56°C 6 - Na ₂ S ₂ O ₃ , 56°C 7 - 56°C not frozen	
LAB ID NUMBER 1 2 3 4 5 6 7 8 9 10		CONTAINER TYPE P - PLASTIC A - AMBER GLASS G - CLEAR GLASS V - VOA VIAL S - STERILE O - OTHER PRESERVATION 1 - HCl, 56°C 2 - H ₂ SO ₄ , 56°C 3 - HNO ₃ 4 - NaOH, 56°C 5 - NaOH/ZnAc, 56°C 6 - Na ₂ S ₂ O ₃ , 56°C 7 - 56°C not frozen		MATRIX CODES: DW - DRINKING WATER S - SOIL WW - WASTEWATER SL - SLUDGE GW - GROUNDWATER SD - SOLID SW - SURFACE WATER A - AIR ST - STORM WATER L - LIQUID W - WATER P - PRODUCT REMARKS/ADDITIONAL INFORMATION Extra Radium	
RELINQUISHED BY: Dawn Prell RELINQUISHED BY: DATE/TIME: 7/11/17 1600 DATE/TIME: 7/21/17 1000		SAMPLE SHIPPED VIA: UPS FED-EX USPS COURIER CLIENT OTHER FS Intact Broken Not Present Custody Seal: Intact Broken Not Present Cooler ID:		LAB #: AA60277 Entered into LIMS: Tracking #:	
SAMPLED BY AND TITLE: Ben Hodges Field Lead RECEIVED BY: Mike Naylor DATE/TIME: 7/11/17 1600 DATE/TIME: 7/21/17 1000 DATE/TIME: 7/21/17 1330 Temperature: 21.1 Min: 21.1 Max:		RECEIVED BY LAB: [Signature] Checked: [Signature] Yes No NA Yes No NA Yes No NA		JULY 11 2017 Plant McDonough COC Phase II CCR.xlsx	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

LOG-IN CHECKLIST

Printed: 7/13/2017 8:41:42AM

Attn: Mr. Joju Abraham

Client: Georgia Power

Project: CCR Event

Date Received: 07/12/17 13:30

Work Order: AAG0277

Logged In By: Mohammad M. Rahman

OBSERVATIONS

#Samples: 10

#Containers: 42

Minimum Temp(C): 2.1

Maximum Temp(C): 2.1

Custody Seal(s) Used: N/A

CHECKLIST ITEMS

- COC included with Samples YES
- Sample Container(s) Intact YES
- Chain of Custody Complete YES
- Sample Container(s) Match COC YES
- Custody seal Intact N/A
- Temperature in Compliance YES
- Sufficient Sample Volume for Analysis YES
- Zero Headspace Maintained for VOA Analyses YES
- Samples labeled preserved (If Applicable) YES
- Samples received within Allowable Hold Times YES
- Samples Received on Ice YES
- Preservation Confirmed YES

Comments:

August 04, 2017

Maria Padilla
GA Power
2480 Maner Rd
Atlanta, GA 30339

RE: Project: AAG0277 Plant McDonough
Pace Project No.: 30224002

Dear Maria Padilla:

Enclosed are the analytical results for sample(s) received by the laboratory on July 13, 2017. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Jacquelyn Collins
jacquelyn.collins@pacelabs.com
(724)850-5612
Project Manager

Enclosures



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: AAG0277 Plant McDonough
Pace Project No.: 30224002

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601
L-A-B DOD-ELAP Accreditation #: L2417
Alabama Certification #: 41590
Arizona Certification #: AZ0734
Arkansas Certification
California Certification #: 04222CA
Colorado Certification
Connecticut Certification #: PH-0694
Delaware Certification
Florida/TNI Certification #: E87683
Georgia Certification #: C040
Guam Certification
Hawaii Certification
Idaho Certification
Illinois Certification
Indiana Certification
Iowa Certification #: 391
Kansas/TNI Certification #: E-10358
Kentucky Certification #: 90133
Louisiana DHH/TNI Certification #: LA140008
Louisiana DEQ/TNI Certification #: 4086
Maine Certification #: PA00091
Maryland Certification #: 308
Massachusetts Certification #: M-PA1457
Michigan/PADEP Certification
Missouri Certification #: 235

Montana Certification #: Cert 0082
Nebraska Certification #: NE-05-29-14
Nevada Certification #: PA014572015-1
New Hampshire/TNI Certification #: 2976
New Jersey/TNI Certification #: PA 051
New Mexico Certification #: PA01457
New York/TNI Certification #: 10888
North Carolina Certification #: 42706
North Dakota Certification #: R-190
Oregon/TNI Certification #: PA200002
Pennsylvania/TNI Certification #: 65-00282
Puerto Rico Certification #: PA01457
Rhode Island Certification #: 65-00282
South Dakota Certification
Tennessee Certification #: TN2867
Texas/TNI Certification #: T104704188-14-8
Utah/TNI Certification #: PA014572015-5
USDA Soil Permit #: P330-14-00213
Vermont Dept. of Health: ID# VT-0282
Virgin Island/PADEP Certification
Virginia/VELAP Certification #: 460198
Washington Certification #: C868
West Virginia DEP Certification #: 143
West Virginia DHHR Certification #: 9964C
Wisconsin Certification
Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: AAG0277 Plant McDonough
Pace Project No.: 30224002

Lab ID	Sample ID	Matrix	Date Collected	Date Received
30224002001	DGWA-70A	Water	07/11/17 10:15	07/13/17 10:15
30224002002	DGWA-71	Water	07/11/17 12:15	07/13/17 10:15
30224002003	DGWA-2	Water	07/11/17 10:05	07/13/17 10:15
30224002004	DGWC-4	Water	07/11/17 09:45	07/13/17 10:15
30224002005	DGWC-5	Water	07/11/17 11:35	07/13/17 10:15
30224002006	DGWC-8	Water	07/11/17 14:35	07/13/17 10:15
30224002007	DGWC-9	Water	07/11/17 14:05	07/13/17 10:15
30224002008	FD-1	Water	07/11/17 00:00	07/13/17 10:15
30224002009	FB-1	Water	07/11/17 09:45	07/13/17 10:15
30224002010	EB-1	Water	07/11/17 15:05	07/13/17 10:15

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: AAG0277 Plant McDonough
Pace Project No.: 30224002

Lab ID	Sample ID	Method	Analysts	Analytes Reported
30224002001	DGWA-70A	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224002002	DGWA-71	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224002003	DGWA-2	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224002004	DGWC-4	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224002005	DGWC-5	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224002006	DGWC-8	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224002007	DGWC-9	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224002008	FD-1	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224002009	FB-1	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224002010	EB-1	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAG0277 Plant McDonough

Pace Project No.: 30224002

Sample: DGWA-70A		Lab ID: 30224002001	Collected: 07/11/17 10:15	Received: 07/13/17 10:15	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.0557 ± 0.0682 (0.139) C:78% T:NA	pCi/L	07/25/17 12:04	13982-63-3		
Radium-228	EPA 9320	0.198 ± 0.369 (0.809) C:75% T:75%	pCi/L	07/28/17 11:28	15262-20-1		
Total Radium	Total Radium Calculation	0.254 ± 0.437 (0.948)	pCi/L	08/02/17 11:13	7440-14-4		

Sample: DGWA-71		Lab ID: 30224002002	Collected: 07/11/17 12:15	Received: 07/13/17 10:15	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.0113 ± 0.0484 (0.117) C:86% T:NA	pCi/L	07/25/17 12:04	13982-63-3		
Radium-228	EPA 9320	0.450 ± 0.360 (0.712) C:71% T:85%	pCi/L	07/28/17 11:28	15262-20-1		
Total Radium	Total Radium Calculation	0.461 ± 0.408 (0.829)	pCi/L	08/02/17 11:13	7440-14-4		

Sample: DGWA-2		Lab ID: 30224002003	Collected: 07/11/17 10:05	Received: 07/13/17 10:15	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.142 ± 0.0976 (0.176) C:82% T:NA	pCi/L	07/25/17 12:04	13982-63-3		
Radium-228	EPA 9320	0.729 ± 0.404 (0.726) C:72% T:85%	pCi/L	07/28/17 11:28	15262-20-1		
Total Radium	Total Radium Calculation	0.871 ± 0.502 (0.902)	pCi/L	08/02/17 11:13	7440-14-4		

Sample: DGWC-4		Lab ID: 30224002004	Collected: 07/11/17 09:45	Received: 07/13/17 10:15	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.372 ± 0.126 (0.138) C:89% T:NA	pCi/L	07/25/17 12:04	13982-63-3		
Radium-228	EPA 9320	0.754 ± 0.393 (0.693) C:80% T:81%	pCi/L	07/28/17 11:28	15262-20-1		
Total Radium	Total Radium Calculation	1.13 ± 0.519 (0.831)	pCi/L	08/02/17 11:13	7440-14-4		

Sample: DGWC-5		Lab ID: 30224002005	Collected: 07/11/17 11:35	Received: 07/13/17 10:15	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.330 ± 0.115 (0.125) C:94% T:NA	pCi/L	07/25/17 12:04	13982-63-3		
Radium-228	EPA 9320	1.05 ± 0.489 (0.828) C:77% T:74%	pCi/L	07/28/17 11:28	15262-20-1		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAG0277 Plant McDonough
Pace Project No.: 30224002

Sample: DGWC-5		Lab ID: 30224002005	Collected: 07/11/17 11:35	Received: 07/13/17 10:15	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Total Radium	Total Radium Calculation	1.38 ± 0.604 (0.953)	pCi/L	08/02/17 11:13	7440-14-4		

Sample: DGWC-8		Lab ID: 30224002006	Collected: 07/11/17 14:35	Received: 07/13/17 10:15	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.174 ± 0.0864 (0.122) C:91% T:NA	pCi/L	07/25/17 12:04	13982-63-3		
Radium-228	EPA 9320	0.0346 ± 0.292 (0.673) C:77% T:90%	pCi/L	07/28/17 11:28	15262-20-1		
Total Radium	Total Radium Calculation	0.209 ± 0.378 (0.795)	pCi/L	08/02/17 11:13	7440-14-4		

Sample: DGWC-9		Lab ID: 30224002007	Collected: 07/11/17 14:05	Received: 07/13/17 10:15	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.328 ± 0.112 (0.118) C:95% T:NA	pCi/L	07/25/17 15:28	13982-63-3		
Radium-228	EPA 9320	0.292 ± 0.347 (0.734) C:78% T:90%	pCi/L	07/28/17 14:31	15262-20-1		
Total Radium	Total Radium Calculation	0.620 ± 0.459 (0.852)	pCi/L	08/02/17 11:13	7440-14-4		

Sample: FD-1		Lab ID: 30224002008	Collected: 07/11/17 00:00	Received: 07/13/17 10:15	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.264 ± 0.103 (0.119) C:83% T:NA	pCi/L	07/25/17 15:28	13982-63-3		
Radium-228	EPA 9320	0.577 ± 0.357 (0.665) C:81% T:92%	pCi/L	07/28/17 14:31	15262-20-1		
Total Radium	Total Radium Calculation	0.841 ± 0.460 (0.784)	pCi/L	08/02/17 11:13	7440-14-4		

Sample: FB-1		Lab ID: 30224002009	Collected: 07/11/17 09:45	Received: 07/13/17 10:15	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual	
Radium-226	EPA 9315	0.247 ± 0.0968 (0.117) C:98% T:NA	pCi/L	07/25/17 15:28	13982-63-3		
Radium-228	EPA 9320	0.289 ± 0.324 (0.678) C:77% T:92%	pCi/L	07/28/17 14:31	15262-20-1		
Total Radium	Total Radium Calculation	0.536 ± 0.421 (0.795)	pCi/L	08/02/17 11:13	7440-14-4		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAG0277 Plant McDonough

Pace Project No.: 30224002

Sample: EB-1 **Lab ID: 30224002010** Collected: 07/11/17 15:05 Received: 07/13/17 10:15 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.173 ± 0.0884 (0.127) C:84% T:NA	pCi/L	07/25/17 15:28	13982-63-3	
Radium-228	EPA 9320	0.892 ± 0.496 (0.931) C:80% T:85%	pCi/L	07/28/17 14:31	15262-20-1	
Total Radium	Total Radium Calculation	1.07 ± 0.584 (1.06)	pCi/L	08/02/17 11:13	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAG0277 Plant McDonough

Pace Project No.: 30224002

QC Batch: 265165 Analysis Method: EPA 9320

QC Batch Method: EPA 9320 Analysis Description: 9320 Radium 228

Associated Lab Samples: 30224002001, 30224002002, 30224002003, 30224002004, 30224002005, 30224002006

METHOD BLANK: 1306528 Matrix: Water

Associated Lab Samples: 30224002001, 30224002002, 30224002003, 30224002004, 30224002005, 30224002006

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.0806 ± 0.263 (0.593) C:80% T:100%	pCi/L	07/28/17 11:27	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAG0277 Plant McDonough

Pace Project No.: 30224002

QC Batch: 265166

Analysis Method: EPA 9320

QC Batch Method: EPA 9320

Analysis Description: 9320 Radium 228

Associated Lab Samples: 30224002007, 30224002008, 30224002009, 30224002010

METHOD BLANK: 1306529

Matrix: Water

Associated Lab Samples: 30224002007, 30224002008, 30224002009, 30224002010

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.0444 ± 0.286 (0.656) C:80% T:91%	pCi/L	07/28/17 14:30	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAG0277 Plant McDonough
Pace Project No.: 30224002

QC Batch: 265161 Analysis Method: EPA 9315
QC Batch Method: EPA 9315 Analysis Description: 9315 Total Radium
Associated Lab Samples: 30224002007, 30224002008, 30224002009, 30224002010

METHOD BLANK: 1306524 Matrix: Water
Associated Lab Samples: 30224002007, 30224002008, 30224002009, 30224002010

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.278 ± 0.0986 (0.0983) C:97% T:NA	pCi/L	07/25/17 15:28	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAG0277 Plant McDonough

Pace Project No.: 30224002

QC Batch: 265160 Analysis Method: EPA 9315

QC Batch Method: EPA 9315 Analysis Description: 9315 Total Radium

Associated Lab Samples: 30224002001, 30224002002, 30224002003, 30224002004, 30224002005, 30224002006

METHOD BLANK: 1306523 Matrix: Water

Associated Lab Samples: 30224002001, 30224002002, 30224002003, 30224002004, 30224002005, 30224002006

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	-0.0171 ± 0.0541 (0.175) C:91% T:NA	pCi/L	07/25/17 10:10	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: AAG0277 Plant McDonough

Pace Project No.: 30224002

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

TNTC - Too Numerous To Count

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

Chain of Custody



Workorder: AAG0277

Workorder Name: Plant McDonough

Owner Received Date:

Results Requested By: 8/4/2017

Report To:

Subcontract To:

Requested Analysis

Betsy McDaniel

Pace - Pittsburgh

Pace Analytical Atlanta
110 Technology Parkway
Peachtree Corners, GA 30092
Phone (770)-734-4200

1638 Roseytown Road
Stes. 2,3,4
Greensburg, PA 15601
Phone (724) 850-5600

WO#: 30224002



Preserved Containers

Item	Sample ID	Sample Type	Collect Date/Time	Lab ID	Matrix	HNO3	Preserved Containers	Date/Time	Received By	Date/Time	Comments	LAB USE ONLY
1	DGWA-70A	G	7/11/2017 10:15	AAG0277-01	GW	2						001
2	DGWA-71	G	7/11/2017 12:15	AAG0277-02	GW	2						002
3	DGWA-2	G	7/11/2017 10:05	AAG0277-03	GW	2						003
4	DGWC-4	G	7/11/2017 9:45	AAG0277-04	GW	4						004
5	DGWC-5	G	7/11/2017 11:35	AAG0277-05	GW	2						005
6	DGWC-8	G	7/11/2017 14:35	AAG0277-06	GW	2						006
7	DGWC-9	G	7/11/2017 14:05	AAG0277-07	GW	2						007
8	FD-1	G	7/11/2017 0:00	AAG0277-08	GW	2						008
9	FB-1	G	7/11/2017 9:45	AAG0277-09	W	2						009
10	EB-1	G	7/11/2017 15:05	AAG0277-10	W	2						010

Transfers Released By: M. KAFMAN Date/Time: 7/12/17 Received By: [Signature] Date/Time: 7/13/17

Cooler Temperature on Receipt: N/A °C Custody Seal Y or N: Y Received on Ice Y or N: Y Sample Intact Y or N: Y

***In order to maintain client confidentiality, location/name of the sampling site, sampler's name and signature may not be provided on this COC. This chain of custody is considered complete as is since this information is available in the owner laboratory.

Friday, June 17, 2016 11:01:34 AM

FMT-ALL-C-002rev.00 24March2009

Page 1 of 1

CHAIN OF CUSTODY RECORD




Pace Analytical Services, Inc.
110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
(770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CLIENT NAME: Georgia Power		CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE 810185 Atlanta, GA 30308 404-598-7239		REPORT TO: Dawn Prell (Dawn_Prell@golder.com) REQUESTED COMPLETION DATE:		PROJECT NAME/STATE: Plant McDonough AP		PROJECT #: Phase II COR	
CONTAINER TYPE PRESERVATION # of		ANALYSIS REQUESTED		CONTAINER TYPE PRESERVATION		CONTAINER TYPE PRESERVATION		CONTAINER TYPE PRESERVATION	
Collection DATE	Collection TIME	MATRIX CODE*	C O M P	Sample Identification	Metals App. III & IV (EPA 6020/7470)	Ci, n 60, & TDS (EPA 300D & SM 2540)	Radium 226 & 228 (SW-646 9316/9320)	LAB #:	REMARKS/ADDITIONAL INFORMATION
07/11/17	1015	GW	X	DGWA-70A	1	1	2		
07/11/17	1215	GW	X	DGWA-71	1	1	2		
07/11/17	1005	GW	X	DGWA-2	1	1	2		
07/11/17	0945	GW	X	DGWC-4	1	1	4		
07/11/17	1135	GW	X	DGWC-5	1	1	2		
07/11/17	1435	GW	X	DGWC-8	1	1	2		
07/11/17	1405	GW	X	DGWC-9	1	1	2		
07/11/17	--	GW	X	FD-1	1	1	2		
07/11/17	0945	W	X	FB-1	1	1	2		
07/11/17	1505	W	X	EB-1	1	1	2		
SAMPLED BY AND TITLE: Ben Hodges RECEIVED BY: Mike Naylor		DATE/TIME: 7/11/17 1600	DATE/TIME: 7/12/17 10:00	RELINQUISHED BY: Dawn Prell	DATE/TIME: 7/12/17 10:00	RELINQUISHED BY:	DATE/TIME:	LAB #:	FOR LAB USE ONLY AA610277
RECEIVED BY Lab: [Signature] pH Packet: [Signature]		Temperature: [Signature]	Min: [Signature] Max: [Signature]	SAMPLE SHIPPED VIA: UPS Custody Seal: [Signature]	FED-EX [Signature]	UPS [Signature]	COURIER [Signature]	CLIENT [Signature]	OTHER FS [Signature]
REMARKS: 30224002		Entered Into LIS: [Signature]		Tracking #: [Signature]					

July 11 2017 Plant McDonough COC Phase II CCR.xlsx

Sample Condition Upon Receipt Pittsburgh

30224002



Client Name: PACE-GA Project # _____

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Label	<u>ZH</u>
LIMS Login	<u>AMV</u>

Tracking #: 741366571247

Custody Seal on Cooler/Box Present: yes no Seals Intact: yes no

Thermometer Used N/A Type of Ice: Wet Blue None

Cooler Temperature Observed Temp _____ °C Correction Factor: _____ °C Final Temp: _____ °C
Temp should be above freezing to 6°C

Date and initials of person examining contents: ZH 7/13/17

Comments:	Yes	No	N/A	
Chain of Custody Present:	/			1.
Chain of Custody Filled Out:	/			2.
Chain of Custody Relinquished:	/			3.
Sampler Name & Signature on COC:	/			4. <u>ZH 7/13/17</u>
Sample Labels match COC: -Includes date/lme/ID Matrix: <u>WT</u>	/			5.
Samples Arrived within Hold Time:	/			6.
Short Hold Time Analysts (<72hr remaining):		/		7.
Rush Turn Around Time Requested:		/		8.
Sufficient Volume:	/			9.
Correct Containers Used: -Pace Containers Used:	/			10.
Containers Intact:	/			11.
Orthophosphate field filtered			/	12.
Organic Samples checked for dechlorination:			/	13.
Filtered volume received for Dissolved tests			/	14.
All containers have been checked for preservation.	/			15. <u>PHLZ</u>
All containers needing preservation are found to be in compliance with EPA recommendation.	/			
exceptions: VOA, coliform, TOC, O&G, Phenolics				Initial when completed: <u>ZH</u> Date/lme of preservation: _____ Lot # of added preservative: _____
Headspace in VOA Vials (>6mm):			/	16.
Trip Blank Present:			/	17.
Trip Blank Custody Seals Present			/	
Rad Aqueous Samples Screened > 0.5 mrem/hr		/		Initial when completed: <u>ZH</u> Date: <u>7/13/17</u>

Client Notification/ Resolution: Person Contacted: _____ Date/Time: _____ Contacted By: _____

Comments/ Resolution: _____

A check in this box indicates that additional information has been stored in ereports.

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)
*PM review is documented electronically in LIMS. When the Project Manager closes the SRF Review schedule in LIMS. The review is in the Status section of the Workorder Edit Screen.

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: JC2
Date: 7/20/2017
Worklist: 36691
Matrix: DW

Method Blank Assessment	
MB Sample ID	1306523
MB concentration:	-0.017
MB Counting Uncertainty:	0.054
MB MDC:	0.175
MB Numerical Performance Indicator:	-0.62
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment	
LCS36691	N
LCS36691	LCSD36691
Count Date:	7/25/2017
Spike I.D.:	17-030
Spike Concentration (pCi/mL):	80.197
Volume Used (mL):	0.10
Aliquot Volume (L, g, F):	0.503
Target Conc. (pCi/L, g, F):	15.937
Uncertainty (Calculated):	1.468
Result (pCi/L, g, F):	13.249
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.807
Numerical Performance Indicator:	-3.14
Percent Recovery:	83.13%
Status vs Numerical Indicator:	N/A
Status vs Recovery:	Pass

Duplicate Sample Assessment	
Sample I.D.:	30223998001
Duplicate Sample I.D.:	30223998001DUP
Sample Result Counting Uncertainty (pCi/L, g, F):	0.630
Sample Duplicate Counting Uncertainty (pCi/L, g, F):	0.204
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.359
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.155
Are sample and/or duplicate results below MDC?	See Below #
Duplicate Numerical Performance Indicator:	2.076
Duplicate RPD:	54.88%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Fail**

Enter Duplicate sample IDs if other than LCS/LCSD in the space below.
30223998001
30223998001DUP

***Batch must be re-prepped due to unacceptable precision.

Sample results < 5x MDC, use numerical indicator < 2 acceptable for DW < 3 acceptable for all other matrices

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	

MS/MSD Duplicate Status vs Numerical Indicator: MS/MSD Duplicate Status vs RPD:

Quality Control Sample Performance Assessment

Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: JC2
Date: 7/20/2017
Worklist: 36692
Matrix: DW

Method Blank Assessment

MB Sample ID: 1306524
MB concentration: 0.278
M/B Counting Uncertainty: 0.090
MB MDC: 0.098
MB Numerical Performance Indicator: 6.06
MB Status vs Numerical Indicator: N/A
MB Status vs. MDC: See Comment*

Laboratory Control Sample Assessment

Count Date:	Y
7/26/2017	LCS36692
17-030	7/26/2017
80.197	17-030
0.10	80.197
0.501	0.10
15.999	0.505
1.474	15.872
12.204	1.462
0.770	12.053
-4.47	0.778
76.28%	75.94%
N/A	N/A
Pass	Pass

Duplicate Sample Assessment

Sample I.D.: LCS36692
Duplicate Sample I.D.: LCS36692
Sample Result Counting Uncertainty (pCi/L, g, F): 12.204
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F): 0.770
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F): 12.053
Are sample and/or duplicate results below MDC? NO
Duplicate Numerical Performance Indicator: 0.271
Duplicate RPD: 1.25%
Duplicate Status vs Numerical Indicator: N/A
Duplicate Status vs RPD: Pass

Sample Matrix Spike Control Assessment

Sample Collection Date:
Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Spike I.D.:
MS/MSD Decay Corrected Spike Concentration (pCi/mL):
Spike Volume Used in MS (mL):
Spike Volume Used in MSD (mL):
MS Aliquot (L, g, F):
MS Target Conc. (pCi/L, g, F):
MSD Aliquot (L, g, F):
MSD Target Conc. (pCi/L, g, F):
Spike uncertainty (calculated):
Sample Result:
Sample Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
MS Numerical Performance Indicator:
MSD Numerical Performance Indicator:
MS Percent Recovery:
MSD Percent Recovery:
MS Status vs Numerical Indicator:
MSD Status vs Numerical Indicator:
MS Status vs Recovery:
MSD Status vs Recovery:

Matrix Spike/Matrix Spike Duplicate Sample Assessment

Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Sample Matrix Spike Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
Duplicate Numerical Performance Indicator:
MS/MSD Duplicate RPD:
MS/MSD Duplicate Status vs Numerical Indicator:
MS/MSD Duplicate Status vs RPD:

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

*The method blank result is below the reporting limit for this analysis and is acceptable.

QC 8/3/17

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-228
Analyst: VAL
Date: 7/24/2017
Worklist: 36694
Matrix: DW

Method Blank Assessment	
MB Sample ID	1306528
MB Concentration:	0.081
MB Counting Uncertainty:	0.263
MB MDC:	0.593
MB Numerical Performance Indicator:	0.60
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment	
LCS (Y or N)?	N
LCS36694	LCS36694
Count Date:	7/28/2017
Spike I.D.:	17-005
Spike Concentration (pCi/mL):	23.943
Volume Used (mL):	0.20
Aliquot Volume (L, g, F):	0.800
Target Conc. (pCi/L, g, F):	5.986
Uncertainty (Calculated):	0.431
Result (pCi/L, g, F):	4.848
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.599
Numerical Performance Indicator:	-3.02
Percent Recovery:	81.00%
Status vs Numerical Indicator:	N/A
Status vs Recovery:	Pass

Duplicate Sample Assessment	
Sample I.D.:	30223998001
Duplicate Sample I.D.:	30223998001DUP
Sample Result (pCi/L, g, F):	0.919
Sample Duplicate Result (pCi/L, g, F):	0.431
Sample Result Counting Uncertainty (pCi/L, g, F):	1.199
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.426
Are sample and/or duplicate results below MDC?	See Below ##
Duplicate Numerical Performance Indicator:	-0.906
Duplicate RPD:	26.46%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Pass

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.


Comments:

Qua 13/17

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
(Based on the Percent Recoveries) MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	

Quality Control Sample Performance Assessment



www.paceanalytical.com

Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-228
Analyst: VAL
Date: 7/24/2017
Worklist: 36695
Matrix: DW

Method Blank Assessment	
MB Sample ID	1306529
MB concentration:	0.044
MB Counting Uncertainty:	0.286
MB MDC:	0.656
MB Numerical Performance Indicator:	0.30
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment		LCSD (Y or N)?
Count Date:	7/28/2017	LCSD36695
Spike I.D.:	17-005	7/28/2017
Spike Concentration (pCi/mL):	23.942	17-005
Volume Used (mL):	0.20	23.942
Aliquot Volume (L, g, F):	0.810	0.20
Target Conc. (pCi/L, g, F):	5.964	0.810
Uncertainty (Calculated):	0.429	5.915
Result (pCi/L, g, F):	6.410	0.426
LCSD/LCSD Counting Uncertainty (pCi/L, g, F):	0.669	4.817
Numerical Performance Indicator:	1.10	0.558
Percent Recovery:	107.48%	-3.07
Status vs Numerical Indicator:	N/A	81.44%
Status vs Recovery:	Pass	N/A

Duplicate Sample Assessment	
Sample I.D.:	LCSD36695
Duplicate Sample I.D.:	LCSD36695
Sample Result (pCi/L, g, F):	6.410
Sample Duplicate Result (pCi/L, g, F):	0.669
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	4.817
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.558
Are sample and/or duplicate results below MDC?	NO
Duplicate Numerical Performance Indicator:	3.586
(Based on the LCSD/LCSD Percent Recoveries) Duplicate RPD:	27.57%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Pass

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

August 17

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MS Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
(Based on the Percent Recoveries) MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Laboratory Report

Prepared For:

**Georgia Power
2480 Maner Road
Atlanta, GA 30339**

Attention: Mr. Joju Abraham

Report Number: AAG0338

July 25, 2017

Project: CCR Event

Project #:Plant McDonough

We appreciate the opportunity to provide the analytical support for your project. The analytical results in this report are based upon information supplied by you, the client, and are for your exclusive use. If you have any questions regarding this data package, please do not hesitate to call.

Approved:

A handwritten signature in black ink that reads "Betsy McDonough". The signature is written over a horizontal line.

Project Manager

This report may not be reproduced, except in full, without written approval from Pace Analytical Services, LLC.
All test results relate only to the samples analyzed.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 25, 2017

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
DGWA-53	AAG0338-01	Ground Water	07/12/17 07:45	07/13/17 11:45
DGWC-10	AAG0338-02	Ground Water	07/12/17 09:30	07/13/17 11:45
DGWC-11	AAG0338-03	Ground Water	07/12/17 11:20	07/13/17 11:45
DGWC-12	AAG0338-04	Ground Water	07/12/17 12:35	07/13/17 11:45
DGWC-13	AAG0338-05	Ground Water	07/12/17 09:20	07/13/17 11:45
DGWC-14	AAG0338-06	Ground Water	07/12/17 11:25	07/13/17 11:45
DGWC-15	AAG0338-07	Ground Water	07/12/17 13:10	07/13/17 11:45
DGWC-17	AAG0338-08	Ground Water	07/12/17 09:40	07/13/17 11:45
DGWC-19	AAG0338-09	Ground Water	07/12/17 12:25	07/13/17 11:45
DGWC-20	AAG0338-10	Ground Water	07/12/17 14:45	07/13/17 11:45
DGWC-21	AAG0338-11	Ground Water	07/12/17 14:15	07/13/17 11:45
DGWC-23	AAG0338-12	Ground Water	07/12/17 14:05	07/13/17 11:45
FD-2	AAG0338-13	Ground Water	07/12/17 00:00	07/13/17 11:45
FB-2	AAG0338-14	Water	07/12/17 09:15	07/13/17 11:45
EB-2	AAG0338-15	Water	07/12/17 15:05	07/13/17 11:45



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 25, 2017

Case Narrative

The Radium analysis by methods EPA 9315/9320 was performed by Pace-Pittsburgh, 1638 Roseytown Road - Suites 2, 3, 4, Greensburg PA 15601. The Pace-Pittsburgh lab contact is Jacquelyn Collins at 724-850-5612.

The TDS by SM 2540 C for sample EB-2 was originally analyzed within the sample holding time but required re-analysis due to possible laboratory contamination. The sample was re-analyzed outside of the sample holding time and the data flagged accordingly.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 25, 2017

Report No.: AAG0338

Project: CCR Event

Client ID: DGWA-53

Lab Number ID: AAG0338-01

Date/Time Sampled: 7/12/2017 7:45:00AM

Date/Time Received: 7/13/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	218	25	10	mg/L	SM 2540 C		1	07/18/17 16:55	07/18/17 16:55	7070410	JPT
Inorganic Anions											
Chloride	2.3	0.25	0.02	mg/L	EPA 300.0		1	07/18/17 09:30	07/18/17 11:55	7070416	SLH
Fluoride	0.10	0.30	0.03	mg/L	EPA 300.0	J	1	07/18/17 09:30	07/18/17 11:55	7070416	SLH
Sulfate	10	1.0	0.02	mg/L	EPA 300.0	B-01	1	07/18/17 09:30	07/18/17 11:55	7070416	SLH
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:03	7070302	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:03	7070302	CSW
Barium	0.173	0.0500	0.0021	mg/L	EPA 6020B		5	07/14/17 13:20	07/20/17 14:58	7070302	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:03	7070302	CSW
Boron	0.0735	0.0400	0.0060	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:03	7070302	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:03	7070302	CSW
Calcium	40.3	25.0	2.02	mg/L	EPA 6020B		50	07/14/17 13:20	07/18/17 23:09	7070302	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:03	7070302	CSW
Cobalt	0.0247	0.0100	0.0003	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:03	7070302	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:03	7070302	CSW
Molybdenum	0.0321	0.0100	0.0010	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:03	7070302	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:03	7070302	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:03	7070302	CSW
Lithium	0.0075	0.0500	0.0015	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/18/17 23:03	7070302	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 07:45	07/20/17 12:23	7070373	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

July 25, 2017

Attention: Mr. Joju Abraham

Report No.: AAG0338

Project: CCR Event

Client ID: DGWC-10

Lab Number ID: AAG0338-02

Date/Time Sampled: 7/12/2017 9:30:00AM

Date/Time Received: 7/13/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	598	25	10	mg/L	SM 2540 C		1	07/18/17 16:55	07/18/17 16:55	7070410	JPT
Inorganic Anions											
Chloride	11	0.25	0.02	mg/L	EPA 300.0		1	07/18/17 09:30	07/18/17 12:16	7070416	SLH
Fluoride	1.7	0.30	0.03	mg/L	EPA 300.0		1	07/18/17 09:30	07/18/17 12:16	7070416	SLH
Sulfate	390	10	0.17	mg/L	EPA 300.0	B-01	10	07/18/17 09:30	07/20/17 15:46	7070416	SLH
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:26	7070302	CSW
Arsenic	0.0042	0.0050	0.0005	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/18/17 23:26	7070302	CSW
Barium	0.0314	0.0100	0.0004	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:26	7070302	CSW
Beryllium	0.0046	0.0030	0.00009	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:26	7070302	CSW
Boron	3.38	2.00	0.298	mg/L	EPA 6020B		50	07/14/17 13:20	07/19/17 09:25	7070302	CSW
Cadmium	0.0013	0.0010	0.0001	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:26	7070302	CSW
Calcium	86.3	25.0	2.02	mg/L	EPA 6020B		50	07/14/17 13:20	07/18/17 23:32	7070302	CSW
Chromium	0.0006	0.0100	0.0005	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/18/17 23:26	7070302	CSW
Cobalt	0.177	0.0100	0.0003	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:26	7070302	CSW
Lead	ND	0.0050	0.0003	mg/L	EPA 6020B		5	07/14/17 13:20	07/20/17 15:04	7070302	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:26	7070302	CSW
Selenium	0.0257	0.0100	0.0018	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:26	7070302	CSW
Thallium	0.0005	0.0010	0.0003	mg/L	EPA 6020B	J	5	07/14/17 13:20	07/20/17 15:04	7070302	CSW
Lithium	0.0019	0.0500	0.0015	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/18/17 23:26	7070302	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 07:45	07/20/17 12:26	7070373	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

July 25, 2017

Attention: Mr. Joju Abraham

Report No.: AAG0338

Project: CCR Event

Client ID: DGWC-11

Lab Number ID: AAG0338-03

Date/Time Sampled: 7/12/2017 11:20:00AM

Date/Time Received: 7/13/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	382	25	10	mg/L	SM 2540 C		1	07/18/17 16:55	07/18/17 16:55	7070410	JPT
Inorganic Anions											
Chloride	11	0.25	0.02	mg/L	EPA 300.0		1	07/18/17 09:30	07/18/17 12:37	7070416	SLH
Fluoride	0.03	0.30	0.03	mg/L	EPA 300.0	J	1	07/18/17 09:30	07/18/17 12:37	7070416	SLH
Sulfate	210	10	0.17	mg/L	EPA 300.0	B-01	10	07/18/17 09:30	07/20/17 16:07	7070416	SLH
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:38	7070302	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:38	7070302	CSW
Barium	0.0572	0.0100	0.0004	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:38	7070302	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:38	7070302	CSW
Boron	1.14	0.400	0.0595	mg/L	EPA 6020B		10	07/14/17 13:20	07/19/17 09:31	7070302	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:38	7070302	CSW
Calcium	50.8	25.0	2.02	mg/L	EPA 6020B		50	07/14/17 13:20	07/18/17 23:43	7070302	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:38	7070302	CSW
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:38	7070302	CSW
Lead	ND	0.0010	0.00007	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:38	7070302	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:38	7070302	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:38	7070302	CSW
Thallium	ND	0.0010	0.0003	mg/L	EPA 6020B		5	07/14/17 13:20	07/18/17 23:38	7070302	CSW
Lithium	0.0022	0.0500	0.0015	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/18/17 23:38	7070302	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 07:45	07/20/17 12:28	7070373	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 25, 2017

Report No.: AAG0338

Project: CCR Event

Client ID: DGWC-12

Lab Number ID: AAG0338-04

Date/Time Sampled: 7/12/2017 12:35:00PM

Date/Time Received: 7/13/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	594	25	10	mg/L	SM 2540 C		1	07/18/17 16:55	07/18/17 16:55	7070410	JPT
Inorganic Anions											
Chloride	12	0.25	0.02	mg/L	EPA 300.0		1	07/18/17 09:30	07/18/17 12:57	7070416	SLH
Fluoride	0.20	0.30	0.03	mg/L	EPA 300.0	J	1	07/18/17 09:30	07/18/17 12:57	7070416	SLH
Sulfate	350	10	0.17	mg/L	EPA 300.0	B-01	10	07/18/17 09:30	07/20/17 16:28	7070416	SLH
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:49	7070302	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:49	7070302	CSW
Barium	0.0262	0.0100	0.0004	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:49	7070302	CSW
Beryllium	0.0002	0.0030	0.00009	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/18/17 23:49	7070302	CSW
Boron	7.55	2.00	0.298	mg/L	EPA 6020B		50	07/14/17 13:20	07/19/17 09:36	7070302	CSW
Cadmium	0.0004	0.0010	0.0001	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/18/17 23:49	7070302	CSW
Calcium	87.0	25.0	2.02	mg/L	EPA 6020B		50	07/14/17 13:20	07/18/17 23:55	7070302	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:49	7070302	CSW
Cobalt	0.0033	0.0100	0.0003	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/18/17 23:49	7070302	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:49	7070302	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:49	7070302	CSW
Selenium	0.0019	0.0100	0.0018	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/18/17 23:49	7070302	CSW
Thallium	0.00009	0.0010	0.00005	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/18/17 23:49	7070302	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	07/14/17 13:20	07/18/17 23:49	7070302	CSW
Mercury	0.00008	0.00050	0.000041	mg/L	EPA 7470A	J	1	07/20/17 07:45	07/20/17 12:30	7070373	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

July 25, 2017

Attention: Mr. Joju Abraham

Report No.: AAG0338

Project: CCR Event

Client ID: DGWC-13

Lab Number ID: AAG0338-05

Date/Time Sampled: 7/12/2017 9:20:00AM

Date/Time Received: 7/13/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	312	25	10	mg/L	SM 2540 C		1	07/18/17 16:55	07/18/17 16:55	7070410	JPT
Inorganic Anions											
Chloride	14	0.25	0.02	mg/L	EPA 300.0		1	07/18/17 09:30	07/18/17 13:18	7070416	SLH
Fluoride	0.13	0.30	0.03	mg/L	EPA 300.0	J	1	07/18/17 09:30	07/18/17 13:18	7070416	SLH
Sulfate	170	10	0.17	mg/L	EPA 300.0	B-01	10	07/18/17 09:30	07/20/17 16:48	7070416	SLH
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:00	7070302	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:00	7070302	CSW
Barium	0.0291	0.0100	0.0004	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:00	7070302	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:00	7070302	CSW
Boron	0.996	0.400	0.0595	mg/L	EPA 6020B		10	07/14/17 13:20	07/19/17 09:42	7070302	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:00	7070302	CSW
Calcium	47.8	25.0	2.02	mg/L	EPA 6020B		50	07/14/17 13:20	07/19/17 00:06	7070302	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:00	7070302	CSW
Cobalt	0.0004	0.0100	0.0003	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 00:00	7070302	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:00	7070302	CSW
Molybdenum	0.0323	0.0100	0.0010	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:00	7070302	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:00	7070302	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:00	7070302	CSW
Lithium	0.0028	0.0500	0.0015	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 00:00	7070302	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 07:45	07/20/17 12:33	7070373	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 25, 2017

Report No.: AAG0338

Project: CCR Event

Client ID: DGWC-14

Lab Number ID: AAG0338-06

Date/Time Sampled: 7/12/2017 11:25:00AM

Date/Time Received: 7/13/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	118	25	10	mg/L	SM 2540 C		1	07/18/17 16:55	07/18/17 16:55	7070410	JPT
Inorganic Anions											
Chloride	2.9	0.25	0.02	mg/L	EPA 300.0		1	07/18/17 09:30	07/18/17 13:39	7070416	SLH
Fluoride	ND	0.30	0.03	mg/L	EPA 300.0		1	07/18/17 09:30	07/18/17 13:39	7070416	SLH
Sulfate	44	1.0	0.02	mg/L	EPA 300.0	B-01	1	07/18/17 09:30	07/18/17 13:39	7070416	SLH
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:12	7070302	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:12	7070302	CSW
Barium	0.0585	0.0100	0.0004	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:12	7070302	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:12	7070302	CSW
Boron	0.0440	0.0400	0.0060	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 09:48	7070302	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:12	7070302	CSW
Calcium	10.5	5.00	2.02	mg/L	EPA 6020B		50	07/14/17 13:20	07/19/17 00:18	7070302	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:12	7070302	CSW
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:12	7070302	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:12	7070302	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:12	7070302	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:12	7070302	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:12	7070302	CSW
Lithium	0.0036	0.0500	0.0015	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 00:12	7070302	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 07:45	07/20/17 12:40	7070373	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

July 25, 2017

Attention: Mr. Joju Abraham

Report No.: AAG0338

Project: CCR Event

Client ID: DGWC-15

Lab Number ID: AAG0338-07

Date/Time Sampled: 7/12/2017 1:10:00PM

Date/Time Received: 7/13/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	490	25	10	mg/L	SM 2540 C		1	07/18/17 16:55	07/18/17 16:55	7070410	JPT
Inorganic Anions											
Chloride	21	0.25	0.02	mg/L	EPA 300.0		1	07/18/17 09:30	07/18/17 13:59	7070416	SLH
Fluoride	0.07	0.30	0.03	mg/L	EPA 300.0	J	1	07/18/17 09:30	07/18/17 13:59	7070416	SLH
Sulfate	170	10	0.17	mg/L	EPA 300.0	B-01	10	07/18/17 09:30	07/20/17 17:09	7070416	SLH
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:35	7070302	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:35	7070302	CSW
Barium	0.0517	0.0100	0.0004	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:35	7070302	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:35	7070302	CSW
Boron	1.49	0.400	0.0595	mg/L	EPA 6020B		10	07/14/17 13:20	07/19/17 09:54	7070302	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:35	7070302	CSW
Calcium	38.4	25.0	2.02	mg/L	EPA 6020B		50	07/14/17 13:20	07/19/17 00:40	7070302	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:35	7070302	CSW
Cobalt	0.0020	0.0100	0.0003	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 00:35	7070302	CSW
Lead	0.0001	0.0050	0.00007	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 00:35	7070302	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:35	7070302	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:35	7070302	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:35	7070302	CSW
Lithium	0.0060	0.0500	0.0015	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 00:35	7070302	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 07:45	07/20/17 12:42	7070373	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

July 25, 2017

Attention: Mr. Joju Abraham

Report No.: AAG0338

Project: CCR Event

Client ID: DGWC-17

Lab Number ID: AAG0338-08

Date/Time Sampled: 7/12/2017 9:40:00AM

Date/Time Received: 7/13/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	417	25	10	mg/L	SM 2540 C		1	07/18/17 16:55	07/18/17 16:55	7070410	JPT
Inorganic Anions											
Chloride	18	0.25	0.02	mg/L	EPA 300.0		1	07/18/17 09:30	07/18/17 15:01	7070416	SLH
Fluoride	0.27	0.30	0.03	mg/L	EPA 300.0	J	1	07/18/17 09:30	07/18/17 15:01	7070416	SLH
Sulfate	230	10	0.17	mg/L	EPA 300.0	B-01	10	07/18/17 09:30	07/20/17 17:30	7070416	SLH
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:46	7070302	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:46	7070302	CSW
Barium	0.0532	0.0100	0.0004	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:46	7070302	CSW
Beryllium	0.0005	0.0030	0.00009	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 00:46	7070302	CSW
Boron	0.620	0.200	0.0298	mg/L	EPA 6020B		5	07/14/17 13:20	07/19/17 09:59	7070302	CSW
Cadmium	0.0002	0.0010	0.0001	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 00:46	7070302	CSW
Calcium	10.4	5.00	2.02	mg/L	EPA 6020B		50	07/14/17 13:20	07/19/17 00:52	7070302	CSW
Chromium	0.0022	0.0100	0.0005	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 00:46	7070302	CSW
Cobalt	0.0230	0.0100	0.0003	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:46	7070302	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:46	7070302	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:46	7070302	CSW
Selenium	0.0072	0.0100	0.0018	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 00:46	7070302	CSW
Thallium	0.0002	0.0010	0.00005	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 00:46	7070302	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:46	7070302	CSW
Mercury	0.00005	0.00050	0.000041	mg/L	EPA 7470A	J	1	07/20/17 07:45	07/20/17 12:45	7070373	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

July 25, 2017

Attention: Mr. Joju Abraham

Report No.: AAG0338

Project: CCR Event

Client ID: DGWC-19

Lab Number ID: AAG0338-09

Date/Time Sampled: 7/12/2017 12:25:00PM

Date/Time Received: 7/13/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	360	25	10	mg/L	SM 2540 C		1	07/18/17 16:55	07/18/17 16:55	7070410	JPT
Inorganic Anions											
Chloride	41	0.25	0.02	mg/L	EPA 300.0		1	07/18/17 09:30	07/18/17 16:45	7070416	SLH
Fluoride	0.34	0.30	0.03	mg/L	EPA 300.0		1	07/18/17 09:30	07/18/17 16:45	7070416	SLH
Sulfate	250	10	0.17	mg/L	EPA 300.0	B-01	10	07/18/17 09:30	07/20/17 17:50	7070416	SLH
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:57	7070302	CSW
Arsenic	0.0016	0.0050	0.0005	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 00:57	7070302	CSW
Barium	0.0212	0.0100	0.0004	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:57	7070302	CSW
Beryllium	0.0018	0.0030	0.00009	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 00:57	7070302	CSW
Boron	2.82	2.00	0.298	mg/L	EPA 6020B		50	07/14/17 13:20	07/19/17 10:05	7070302	CSW
Cadmium	0.0004	0.0010	0.0001	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 00:57	7070302	CSW
Calcium	70.0	25.0	2.02	mg/L	EPA 6020B		50	07/14/17 13:20	07/19/17 01:03	7070302	CSW
Chromium	0.0023	0.0100	0.0005	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 00:57	7070302	CSW
Cobalt	0.0489	0.0100	0.0003	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:57	7070302	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:57	7070302	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 00:57	7070302	CSW
Selenium	0.0065	0.0100	0.0018	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 00:57	7070302	CSW
Thallium	0.0005	0.0010	0.00005	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 00:57	7070302	CSW
Lithium	0.0032	0.0500	0.0015	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 00:57	7070302	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 07:45	07/20/17 12:47	7070373	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

July 25, 2017

Attention: Mr. Joju Abraham

Report No.: AAG0338

Project: CCR Event

Client ID: DGWC-20

Lab Number ID: AAG0338-10

Date/Time Sampled: 7/12/2017 2:45:00PM

Date/Time Received: 7/13/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	956	25	10	mg/L	SM 2540 C		1	07/18/17 16:55	07/18/17 16:55	7070410	JPT
Inorganic Anions											
Chloride	18	0.25	0.02	mg/L	EPA 300.0		1	07/18/17 09:30	07/18/17 17:05	7070416	SLH
Fluoride	0.41	0.30	0.03	mg/L	EPA 300.0		1	07/18/17 09:30	07/18/17 17:05	7070416	SLH
Sulfate	630	20	0.34	mg/L	EPA 300.0	B-01	20	07/18/17 09:30	07/20/17 18:11	7070416	SLH
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:09	7070302	CSW
Arsenic	0.0121	0.0050	0.0005	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:09	7070302	CSW
Barium	0.0099	0.0100	0.0004	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 01:09	7070302	CSW
Beryllium	0.0025	0.0030	0.00009	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 01:09	7070302	CSW
Boron	6.81	2.00	0.298	mg/L	EPA 6020B		50	07/14/17 13:20	07/19/17 10:11	7070302	CSW
Cadmium	0.0021	0.0010	0.0001	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:09	7070302	CSW
Calcium	100	25.0	2.02	mg/L	EPA 6020B		50	07/14/17 13:20	07/19/17 01:15	7070302	CSW
Chromium	ND	0.0500	0.0023	mg/L	EPA 6020B	R-01	5	07/14/17 13:20	07/20/17 15:09	7070302	CSW
Cobalt	0.538	0.500	0.0132	mg/L	EPA 6020B		50	07/14/17 13:20	07/19/17 01:15	7070302	CSW
Lead	ND	0.0050	0.0003	mg/L	EPA 6020B		5	07/14/17 13:20	07/20/17 15:09	7070302	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:09	7070302	CSW
Selenium	0.0483	0.0100	0.0018	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:09	7070302	CSW
Thallium	0.0006	0.0010	0.0003	mg/L	EPA 6020B	J	5	07/14/17 13:20	07/20/17 15:09	7070302	CSW
Lithium	0.0019	0.0500	0.0015	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 01:09	7070302	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 07:45	07/20/17 12:49	7070373	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

July 25, 2017

Attention: Mr. Joju Abraham

Report No.: AAG0338

Project: CCR Event

Client ID: DGWC-21

Lab Number ID: AAG0338-11

Date/Time Sampled: 7/12/2017 2:15:00PM

Date/Time Received: 7/13/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	505	25	10	mg/L	SM 2540 C		1	07/18/17 16:55	07/18/17 16:55	7070410	JPT
Inorganic Anions											
Chloride	23	0.25	0.02	mg/L	EPA 300.0		1	07/18/17 09:30	07/18/17 17:26	7070416	SLH
Fluoride	0.04	0.30	0.03	mg/L	EPA 300.0	J	1	07/18/17 09:30	07/18/17 17:26	7070416	SLH
Sulfate	290	10	0.17	mg/L	EPA 300.0	B-01	10	07/18/17 09:30	07/20/17 18:32	7070416	SLH
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:20	7070302	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:20	7070302	CSW
Barium	0.0276	0.0100	0.0004	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:20	7070302	CSW
Beryllium	0.0001	0.0030	0.00009	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 01:20	7070302	CSW
Boron	5.20	2.00	0.298	mg/L	EPA 6020B		50	07/14/17 13:20	07/19/17 10:40	7070302	CSW
Cadmium	0.0006	0.0010	0.0001	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 01:20	7070302	CSW
Calcium	80.4	25.0	2.02	mg/L	EPA 6020B		50	07/14/17 13:20	07/19/17 01:26	7070302	CSW
Chromium	0.0006	0.0100	0.0005	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 01:20	7070302	CSW
Cobalt	0.0092	0.0100	0.0003	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 01:20	7070302	CSW
Lead	0.0001	0.0050	0.00007	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 01:20	7070302	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:20	7070302	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:20	7070302	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:20	7070302	CSW
Lithium	0.0057	0.0500	0.0015	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 01:20	7070302	CSW
Mercury	0.00006	0.00050	0.000041	mg/L	EPA 7470A	J	1	07/20/17 07:45	07/20/17 12:52	7070373	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

July 25, 2017

Attention: Mr. Joju Abraham

Report No.: AAG0338

Project: CCR Event

Client ID: DGWC-23

Lab Number ID: AAG0338-12

Date/Time Sampled: 7/12/2017 2:05:00PM

Date/Time Received: 7/13/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	461	25	10	mg/L	SM 2540 C		1	07/18/17 16:55	07/18/17 16:55	7070410	JPT
Inorganic Anions											
Chloride	16	0.25	0.02	mg/L	EPA 300.0		1	07/18/17 09:30	07/18/17 17:47	7070416	SLH
Fluoride	0.22	0.30	0.03	mg/L	EPA 300.0	J	1	07/18/17 09:30	07/18/17 17:47	7070416	SLH
Sulfate	220	10	0.17	mg/L	EPA 300.0	B-01	10	07/18/17 09:30	07/20/17 18:52	7070416	SLH
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:43	7070302	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:43	7070302	CSW
Barium	0.0186	0.0100	0.0004	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:43	7070302	CSW
Beryllium	0.0004	0.0030	0.00009	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 01:43	7070302	CSW
Boron	3.74	0.0400	0.0060	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:43	7070302	CSW
Cadmium	0.0002	0.0010	0.0001	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 01:43	7070302	CSW
Calcium	70.0	25.0	2.02	mg/L	EPA 6020B		50	07/14/17 13:20	07/19/17 01:49	7070302	CSW
Chromium	0.0007	0.0100	0.0005	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 01:43	7070302	CSW
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:43	7070302	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:43	7070302	CSW
Molybdenum	0.0092	0.0100	0.0010	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 01:43	7070302	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:43	7070302	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:43	7070302	CSW
Lithium	0.0068	0.0500	0.0015	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 01:43	7070302	CSW
Mercury	0.00012	0.00050	0.000041	mg/L	EPA 7470A	J	1	07/20/17 07:45	07/20/17 12:54	7070373	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 25, 2017

Report No.: AAG0338

Project: CCR Event

Client ID: FD-2

Lab Number ID: AAG0338-13

Date/Time Sampled: 7/12/2017 12:00:00AM

Date/Time Received: 7/13/2017 11:45:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	108	25	10	mg/L	SM 2540 C		1	07/18/17 16:15	07/18/17 16:15	7070411	JPT
Inorganic Anions											
Chloride	3.0	0.25	0.02	mg/L	EPA 300.0		1	07/18/17 09:30	07/18/17 18:28	7070416	SLH
Fluoride	ND	0.30	0.03	mg/L	EPA 300.0		1	07/18/17 09:30	07/18/17 18:28	7070416	SLH
Sulfate	44	1.0	0.02	mg/L	EPA 300.0	B-01	1	07/18/17 09:30	07/18/17 18:28	7070416	SLH
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:55	7070302	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:55	7070302	CSW
Barium	0.0583	0.0100	0.0004	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:55	7070302	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:55	7070302	CSW
Boron	0.0564	0.0400	0.0060	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:55	7070302	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:55	7070302	CSW
Calcium	10.1	2.50	0.202	mg/L	EPA 6020B		5	07/14/17 13:20	07/19/17 02:06	7070302	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:55	7070302	CSW
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:55	7070302	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:55	7070302	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:55	7070302	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:55	7070302	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	07/14/17 13:20	07/19/17 01:55	7070302	CSW
Lithium	0.0037	0.0500	0.0015	mg/L	EPA 6020B	J	1	07/14/17 13:20	07/19/17 01:55	7070302	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 07:45	07/20/17 12:56	7070373	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

July 25, 2017

Attention: Mr. Joju Abraham

Report No.: AAG0338

Project: CCR Event

Client ID: FB-2

Lab Number ID: AAG0338-14

Date/Time Sampled: 7/12/2017 9:15:00AM

Date/Time Received: 7/13/2017 11:45:00AM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C		1	07/18/17 16:15	07/18/17 16:15	7070411	JPT
Inorganic Anions											
Chloride	0.17	0.25	0.02	mg/L	EPA 300.0	J	1	07/18/17 09:30	07/18/17 18:49	7070416	RLC
Fluoride	ND	0.30	0.03	mg/L	EPA 300.0		1	07/18/17 09:30	07/18/17 18:49	7070416	RLC
Sulfate	0.11	1.0	0.02	mg/L	EPA 300.0	B-01, J	1	07/18/17 09:30	07/18/17 18:49	7070416	SLH
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:34	7070326	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:34	7070326	CSW
Barium	ND	0.0100	0.0004	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:34	7070326	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:34	7070326	CSW
Boron	ND	0.0400	0.0060	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:34	7070326	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:34	7070326	CSW
Calcium	ND	0.500	0.0404	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:34	7070326	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:34	7070326	CSW
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:34	7070326	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:34	7070326	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:34	7070326	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:34	7070326	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:34	7070326	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:34	7070326	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 07:45	07/20/17 12:59	7070373	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 25, 2017

Report No.: AAG0338

Project: CCR Event

Client ID: EB-2

Lab Number ID: AAG0338-15

Date/Time Sampled: 7/12/2017 3:05:00PM

Date/Time Received: 7/13/2017 11:45:00AM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C	H-02	1	07/21/17 19:20	07/21/17 19:20	7070536	JPT
Inorganic Anions											
Chloride	0.16	0.25	0.02	mg/L	EPA 300.0	J	1	07/18/17 09:30	07/18/17 19:10	7070416	SLH
Fluoride	ND	0.30	0.03	mg/L	EPA 300.0		1	07/18/17 09:30	07/18/17 19:10	7070416	SLH
Sulfate	0.09	1.0	0.02	mg/L	EPA 300.0	B-01, J	1	07/18/17 09:30	07/18/17 19:10	7070416	SLH
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:39	7070326	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:39	7070326	CSW
Barium	ND	0.0100	0.0004	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:39	7070326	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:39	7070326	CSW
Boron	ND	0.0400	0.0060	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:39	7070326	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:39	7070326	CSW
Calcium	ND	0.500	0.0404	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:39	7070326	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:39	7070326	CSW
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:39	7070326	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:39	7070326	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:39	7070326	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:39	7070326	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:39	7070326	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	07/14/17 12:50	07/14/17 22:39	7070326	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 07:45	07/20/17 13:01	7070373	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 25, 2017

Report No.: AAG0338

General Chemistry - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7070410 - SM 2540 C											
Blank (7070410-BLK1)						Prepared & Analyzed: 07/18/17					
Total Dissolved Solids	ND	25	10	mg/L							
LCS (7070410-BS1)						Prepared & Analyzed: 07/18/17					
Total Dissolved Solids	380	25	10	mg/L	400.00		95	84-108			
Duplicate (7070410-DUP1)						Source: AAG0332-17 Prepared & Analyzed: 07/18/17					
Total Dissolved Solids	14	25	10	mg/L		ND				10	J
Duplicate (7070410-DUP2)						Source: AAG0338-01 Prepared & Analyzed: 07/18/17					
Total Dissolved Solids	221	25	10	mg/L		218			1	10	
Batch 7070411 - SM 2540 C											
Blank (7070411-BLK1)						Prepared & Analyzed: 07/18/17					
Total Dissolved Solids	ND	25	10	mg/L							
LCS (7070411-BS1)						Prepared & Analyzed: 07/18/17					
Total Dissolved Solids	430	25	10	mg/L	400.00		108	84-108			
Duplicate (7070411-DUP1)						Source: AAG0383-06 Prepared & Analyzed: 07/18/17					
Total Dissolved Solids	1100	25	10	mg/L		1070			3	10	
Duplicate (7070411-DUP2)						Source: AAG0383-09 Prepared & Analyzed: 07/18/17					
Total Dissolved Solids	ND	25	10	mg/L		13				10	
Batch 7070536 - SM 2540 C											
Blank (7070536-BLK1)						Prepared & Analyzed: 07/21/17					
Total Dissolved Solids	ND	25	10	mg/L							



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 25, 2017

Report No.: AAG0338

General Chemistry - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7070536 - SM 2540 C											
LCS (7070536-BS1)						Prepared & Analyzed: 07/21/17					
Total Dissolved Solids	382	25	10	mg/L	400.00		96	84-108			
Duplicate (7070536-DUP1)						Source: AAG0338-15RE1 Prepared & Analyzed: 07/21/17					
Total Dissolved Solids	ND	25	10	mg/L		ND				10	
Duplicate (7070536-DUP2)						Source: AAG0505-04 Prepared & Analyzed: 07/21/17					
Total Dissolved Solids	11	25	10	mg/L		13			17	10	QR-03, J



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 25, 2017

Report No.: AAG0338

Inorganic Anions - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7070416 - EPA 300.0											
Blank (7070416-BLK1)						Prepared & Analyzed: 07/18/17					
Chloride	ND	0.25	0.02	mg/L							
Fluoride	ND	0.30	0.03	mg/L							
Sulfate	0.03	1.0	0.02	mg/L							J
LCS (7070416-BS1)						Prepared & Analyzed: 07/18/17					
Chloride	10.1	0.25	0.02	mg/L	10.020		101	90-110			
Fluoride	9.80	0.30	0.03	mg/L	10.020		98	90-110			
Sulfate	10.2	1.0	0.02	mg/L	10.050		101	90-110			
Matrix Spike (7070416-MS1)						Source: AAG0338-07 Prepared & Analyzed: 07/18/17					
Chloride	29.2	0.25	0.02	mg/L	10.020	21.1	81	90-110			QM-02
Fluoride	10.2	0.30	0.03	mg/L	10.020	0.07	101	90-110			
Sulfate	141	1.0	0.02	mg/L	10.050	145	NR	90-110			QM-02
Matrix Spike (7070416-MS2)						Source: AAG0338-12 Prepared & Analyzed: 07/18/17					
Chloride	25.3	0.25	0.02	mg/L	10.020	16.0	93	90-110			
Fluoride	10.9	0.30	0.03	mg/L	10.020	0.22	107	90-110			
Sulfate	163	1.0	0.02	mg/L	10.050	169	NR	90-110			QM-02
Matrix Spike Dup (7070416-MSD1)						Source: AAG0338-07 Prepared & Analyzed: 07/18/17					
Chloride	29.2	0.25	0.02	mg/L	10.020	21.1	82	90-110	0.2	15	QM-02
Fluoride	10.3	0.30	0.03	mg/L	10.020	0.07	102	90-110	0.4	15	
Sulfate	141	1.0	0.02	mg/L	10.050	145	NR	90-110	0.3	15	QM-02



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 25, 2017

Report No.: AAG0338

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	----	-----	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7070302 - EPA 3005A

Blank (7070302-BLK1)

Prepared: 07/14/17 Analyzed: 07/18/17

Antimony	ND	0.0030	0.0006	mg/L							
Arsenic	ND	0.0050	0.0005	mg/L							
Barium	ND	0.0100	0.0004	mg/L							
Beryllium	ND	0.0030	0.00009	mg/L							
Boron	ND	0.0400	0.0060	mg/L							
Cadmium	ND	0.0010	0.0001	mg/L							
Calcium	ND	0.500	0.0404	mg/L							
Chromium	ND	0.0100	0.0005	mg/L							
Cobalt	ND	0.0100	0.0003	mg/L							
Copper	ND	0.0250	0.0003	mg/L							
Lead	ND	0.0050	0.00007	mg/L							
Molybdenum	ND	0.0100	0.0010	mg/L							
Nickel	ND	0.0100	0.0005	mg/L							
Selenium	ND	0.0100	0.0018	mg/L							
Silver	ND	0.0100	0.0002	mg/L							
Thallium	ND	0.0010	0.00005	mg/L							
Vanadium	ND	0.0100	0.0012	mg/L							
Zinc	ND	0.0100	0.0012	mg/L							
Lithium	ND	0.0500	0.0015	mg/L							

LCS (7070302-BS1)

Prepared: 07/14/17 Analyzed: 07/18/17

Antimony	0.104	0.0030	0.0006	mg/L	0.10000		104	80-120			
Arsenic	0.0990	0.0050	0.0005	mg/L	0.10000		99	80-120			
Barium	0.104	0.0100	0.0004	mg/L	0.10000		104	80-120			
Beryllium	0.101	0.0030	0.00009	mg/L	0.10000		101	80-120			
Boron	0.959	0.0400	0.0060	mg/L	1.0000		96	80-120			
Cadmium	0.107	0.0010	0.0001	mg/L	0.10000		107	80-120			
Calcium	1.02	0.500	0.0404	mg/L	1.0000		102	80-120			
Chromium	0.102	0.0100	0.0005	mg/L	0.10000		102	80-120			
Cobalt	0.0971	0.0100	0.0003	mg/L	0.10000		97	80-120			
Copper	0.0989	0.0250	0.0003	mg/L	0.10000		99	80-120			
Lead	0.103	0.0050	0.00007	mg/L	0.10000		103	80-120			
Molybdenum	0.101	0.0100	0.0010	mg/L	0.10000		101	80-120			
Nickel	0.0979	0.0100	0.0005	mg/L	0.10000		98	80-120			
Selenium	0.102	0.0100	0.0018	mg/L	0.10000		102	80-120			
Silver	0.102	0.0100	0.0002	mg/L	0.10000		102	80-120			
Thallium	0.105	0.0010	0.00005	mg/L	0.10000		105	80-120			
Vanadium	0.0994	0.0100	0.0012	mg/L	0.10000		99	80-120			
Zinc	0.103	0.0100	0.0012	mg/L	0.10000		103	80-120			
Lithium	0.102	0.0500	0.0015	mg/L	0.10000		102	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 25, 2017

Report No.: AAG0338

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7070302 - EPA 3005A											
Matrix Spike (7070302-MS1)			Source: AAG0338-01				Prepared: 07/14/17 Analyzed: 07/18/17				
Antimony	0.103	0.0030	0.0006	mg/L	0.10000	ND	103	75-125			
Arsenic	0.102	0.0050	0.0005	mg/L	0.10000	ND	102	75-125			
Barium	0.263	0.0500	0.0021	mg/L	0.10000	0.173	89	75-125			
Beryllium	0.0900	0.0030	0.00009	mg/L	0.10000	ND	90	75-125			
Boron	0.938	0.0400	0.0060	mg/L	1.0000	0.0735	86	75-125			
Cadmium	0.101	0.0010	0.0001	mg/L	0.10000	ND	101	75-125			
Calcium	40.6	25.0	2.02	mg/L	1.0000	40.3	27	75-125			QM-02
Chromium	0.0970	0.0100	0.0005	mg/L	0.10000	ND	97	75-125			
Cobalt	0.117	0.0100	0.0003	mg/L	0.10000	0.0247	93	75-125			
Copper	0.0967	0.0250	0.0003	mg/L	0.10000	0.0024	94	75-125			
Lead	0.101	0.0050	0.00007	mg/L	0.10000	ND	101	75-125			
Molybdenum	0.135	0.0100	0.0010	mg/L	0.10000	0.0321	103	75-125			
Nickel	0.105	0.0100	0.0005	mg/L	0.10000	0.0130	92	75-125			
Selenium	0.101	0.0100	0.0018	mg/L	0.10000	ND	101	75-125			
Silver	0.102	0.0100	0.0002	mg/L	0.10000	ND	102	75-125			
Thallium	0.104	0.0010	0.00005	mg/L	0.10000	ND	104	75-125			
Vanadium	0.0969	0.0100	0.0012	mg/L	0.10000	ND	97	75-125			
Zinc	0.0991	0.0100	0.0012	mg/L	0.10000	0.0019	97	75-125			
Lithium	0.0978	0.0500	0.0015	mg/L	0.10000	0.0075	90	75-125			
Matrix Spike Dup (7070302-MSD1)			Source: AAG0338-01				Prepared: 07/14/17 Analyzed: 07/18/17				
Antimony	0.104	0.0030	0.0006	mg/L	0.10000	ND	104	75-125	0.6	20	
Arsenic	0.100	0.0050	0.0005	mg/L	0.10000	ND	100	75-125	2	20	
Barium	0.271	0.0500	0.0021	mg/L	0.10000	0.173	97	75-125	3	20	
Beryllium	0.0857	0.0030	0.00009	mg/L	0.10000	ND	86	75-125	5	20	
Boron	0.898	0.0400	0.0060	mg/L	1.0000	0.0735	82	75-125	4	20	
Cadmium	0.103	0.0010	0.0001	mg/L	0.10000	ND	103	75-125	2	20	
Calcium	39.1	25.0	2.02	mg/L	1.0000	40.3	NR	75-125	4	20	QM-02
Chromium	0.0988	0.0100	0.0005	mg/L	0.10000	ND	99	75-125	2	20	
Cobalt	0.120	0.0100	0.0003	mg/L	0.10000	0.0247	95	75-125	2	20	
Copper	0.0969	0.0250	0.0003	mg/L	0.10000	0.0024	94	75-125	0.2	20	
Lead	0.0989	0.0050	0.00007	mg/L	0.10000	ND	99	75-125	2	20	
Molybdenum	0.133	0.0100	0.0010	mg/L	0.10000	0.0321	101	75-125	2	20	
Nickel	0.109	0.0100	0.0005	mg/L	0.10000	0.0130	96	75-125	3	20	
Selenium	0.100	0.0100	0.0018	mg/L	0.10000	ND	100	75-125	1	20	
Silver	0.0972	0.0100	0.0002	mg/L	0.10000	ND	97	75-125	4	20	
Thallium	0.100	0.0010	0.00005	mg/L	0.10000	ND	100	75-125	3	20	
Vanadium	0.101	0.0100	0.0012	mg/L	0.10000	ND	101	75-125	4	20	
Zinc	0.0996	0.0100	0.0012	mg/L	0.10000	0.0019	98	75-125	0.5	20	
Lithium	0.0950	0.0500	0.0015	mg/L	0.10000	0.0075	87	75-125	3	20	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 25, 2017

Report No.: AAG0338

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7070302 - EPA 3005A											
Post Spike (7070302-PS1)			Source: AAG0338-01			Prepared: 07/14/17 Analyzed: 07/18/17					
Antimony	106			ug/L	100.00	0.342	105	80-120			
Arsenic	100			ug/L	100.00	0.282	100	80-120			
Barium	269			ug/L	100.00	173	96	80-120			
Beryllium	92.0			ug/L	100.00	-0.0015	92	80-120			
Boron	989			ug/L	1000.0	73.5	92	80-120			
Cadmium	105			ug/L	100.00	0.0651	105	80-120			
Calcium	39600			ug/L	1000.0	40300	NR	80-120			QM-02
Chromium	100			ug/L	100.00	0.268	100	80-120			
Cobalt	119			ug/L	100.00	24.7	95	80-120			
Copper	97.6			ug/L	100.00	2.42	95	80-120			
Lead	100			ug/L	100.00	0.0041	100	80-120			
Molybdenum	135			ug/L	100.00	32.1	103	80-120			
Nickel	110			ug/L	100.00	13.0	97	80-120			
Selenium	100			ug/L	100.00	0.118	100	80-120			
Silver	101			ug/L	100.00	0.0109	101	80-120			
Thallium	101			ug/L	100.00	0.0497	101	80-120			
Vanadium	102			ug/L	100.00	-0.118	102	80-120			
Zinc	102			ug/L	100.00	1.92	100	80-120			
Lithium	102			ug/L	100.00	7.52	95	80-120			

Batch 7070326 - EPA 3005A

Blank (7070326-BLK1)				Prepared & Analyzed: 07/14/17							
Antimony	ND	0.0030	0.0006	mg/L							
Arsenic	ND	0.0050	0.0005	mg/L							
Barium	ND	0.0100	0.0004	mg/L							
Beryllium	ND	0.0030	0.00009	mg/L							
Boron	ND	0.0400	0.0060	mg/L							
Cadmium	ND	0.0010	0.0001	mg/L							
Calcium	ND	0.500	0.0404	mg/L							
Chromium	ND	0.0100	0.0005	mg/L							
Cobalt	ND	0.0100	0.0003	mg/L							
Copper	0.0003	0.0250	0.0003	mg/L							J
Lead	ND	0.0050	0.00007	mg/L							
Molybdenum	ND	0.0100	0.0010	mg/L							
Nickel	ND	0.0100	0.0005	mg/L							
Selenium	ND	0.0100	0.0018	mg/L							
Silver	ND	0.0100	0.0002	mg/L							
Thallium	ND	0.0010	0.00005	mg/L							
Vanadium	ND	0.0100	0.0012	mg/L							



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 25, 2017

Report No.: AAG0338

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7070326 - EPA 3005A											
Blank (7070326-BLK1)											
						Prepared & Analyzed: 07/14/17					
Zinc	ND	0.0100	0.0012	mg/L							
Lithium	ND	0.0500	0.0015	mg/L							
LCS (7070326-BS1)											
						Prepared & Analyzed: 07/14/17					
Antimony	0.104	0.0030	0.0006	mg/L	0.10000		104	80-120			
Arsenic	0.103	0.0050	0.0005	mg/L	0.10000		103	80-120			
Barium	0.0984	0.0100	0.0004	mg/L	0.10000		98	80-120			
Beryllium	0.102	0.0030	0.00009	mg/L	0.10000		102	80-120			
Boron	1.07	0.0400	0.0060	mg/L	1.0000		107	80-120			
Cadmium	0.106	0.0010	0.0001	mg/L	0.10000		106	80-120			
Calcium	1.02	0.500	0.0404	mg/L	1.0000		102	80-120			
Chromium	0.109	0.0100	0.0005	mg/L	0.10000		109	80-120			
Cobalt	0.105	0.0100	0.0003	mg/L	0.10000		105	80-120			
Copper	0.104	0.0250	0.0003	mg/L	0.10000		104	80-120			
Lead	0.104	0.0050	0.00007	mg/L	0.10000		104	80-120			
Molybdenum	0.105	0.0100	0.0010	mg/L	0.10000		105	80-120			
Nickel	0.105	0.0100	0.0005	mg/L	0.10000		105	80-120			
Selenium	0.106	0.0100	0.0018	mg/L	0.10000		106	80-120			
Silver	0.101	0.0100	0.0002	mg/L	0.10000		101	80-120			
Thallium	0.105	0.0010	0.00005	mg/L	0.10000		105	80-120			
Vanadium	0.107	0.0100	0.0012	mg/L	0.10000		107	80-120			
Zinc	0.107	0.0100	0.0012	mg/L	0.10000		107	80-120			
Lithium	0.106	0.0500	0.0015	mg/L	0.10000		106	80-120			
Matrix Spike (7070326-MS1)											
						Source: AAG0261-01					
						Prepared & Analyzed: 07/14/17					
Antimony	0.108	0.0030	0.0006	mg/L	0.10000	ND	108	75-125			
Arsenic	0.108	0.0050	0.0005	mg/L	0.10000	0.0044	104	75-125			
Barium	0.113	0.0100	0.0004	mg/L	0.10000	0.0137	99	75-125			
Beryllium	0.0933	0.0030	0.00009	mg/L	0.10000	0.0143	79	75-125			
Boron	14.5	2.00	0.298	mg/L	1.0000	15.2	NR	75-125			QM-02
Cadmium	0.106	0.0010	0.0001	mg/L	0.10000	0.0029	104	75-125			
Calcium	133	25.0	2.02	mg/L	1.0000	139	NR	75-125			QM-02
Chromium	0.103	0.0100	0.0005	mg/L	0.10000	0.0012	102	75-125			
Cobalt	0.109	0.0100	0.0003	mg/L	0.10000	0.0121	97	75-125			
Copper	0.0951	0.0250	0.0003	mg/L	0.10000	0.0030	92	75-125			
Lead	0.0904	0.0050	0.00007	mg/L	0.10000	0.0018	89	75-125			
Molybdenum	0.107	0.0100	0.0010	mg/L	0.10000	ND	107	75-125			
Nickel	0.127	0.0100	0.0005	mg/L	0.10000	0.0325	95	75-125			
Selenium	0.118	0.0100	0.0018	mg/L	0.10000	0.0106	107	75-125			
Silver	0.0966	0.0100	0.0002	mg/L	0.10000	ND	97	75-125			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 25, 2017

Report No.: AAG0338

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7070326 - EPA 3005A											
Matrix Spike (7070326-MS1)			Source: AAG0261-01			Prepared & Analyzed: 07/14/17					
Thallium	0.0910	0.0010	0.00005	mg/L	0.10000	0.0002	91	75-125			
Vanadium	0.103	0.0100	0.0012	mg/L	0.10000	ND	103	75-125			
Zinc	0.230	0.0100	0.0012	mg/L	0.10000	0.136	94	75-125			
Lithium	0.0995	0.0500	0.0015	mg/L	0.10000	0.0214	78	75-125			
Matrix Spike Dup (7070326-MSD1)			Source: AAG0261-01			Prepared & Analyzed: 07/14/17					
Antimony	0.103	0.0030	0.0006	mg/L	0.10000	ND	103	75-125	5	20	
Arsenic	0.105	0.0050	0.0005	mg/L	0.10000	0.0044	100	75-125	3	20	
Barium	0.108	0.0100	0.0004	mg/L	0.10000	0.0137	94	75-125	4	20	
Beryllium	0.0913	0.0030	0.00009	mg/L	0.10000	0.0143	77	75-125	2	20	
Boron	15.2	2.00	0.298	mg/L	1.0000	15.2	NR	75-125	4	20	QM-02
Cadmium	0.104	0.0010	0.0001	mg/L	0.10000	0.0029	101	75-125	2	20	
Calcium	133	25.0	2.02	mg/L	1.0000	139	NR	75-125	0.1	20	QM-02
Chromium	0.0982	0.0100	0.0005	mg/L	0.10000	0.0012	97	75-125	5	20	
Cobalt	0.105	0.0100	0.0003	mg/L	0.10000	0.0121	93	75-125	4	20	
Copper	0.0916	0.0250	0.0003	mg/L	0.10000	0.0030	89	75-125	4	20	
Lead	0.0864	0.0050	0.00007	mg/L	0.10000	0.0018	85	75-125	5	20	
Molybdenum	0.101	0.0100	0.0010	mg/L	0.10000	ND	101	75-125	5	20	
Nickel	0.122	0.0100	0.0005	mg/L	0.10000	0.0325	90	75-125	4	20	
Selenium	0.114	0.0100	0.0018	mg/L	0.10000	0.0106	103	75-125	4	20	
Silver	0.0928	0.0100	0.0002	mg/L	0.10000	ND	93	75-125	4	20	
Thallium	0.0875	0.0010	0.00005	mg/L	0.10000	0.0002	87	75-125	4	20	
Vanadium	0.0983	0.0100	0.0012	mg/L	0.10000	ND	98	75-125	5	20	
Zinc	0.225	0.0100	0.0012	mg/L	0.10000	0.136	89	75-125	2	20	
Lithium	0.0994	0.0500	0.0015	mg/L	0.10000	0.0214	78	75-125	0.06	20	
Post Spike (7070326-PS1)			Source: AAG0261-01			Prepared & Analyzed: 07/14/17					
Antimony	102			ug/L	100.00	0.559	101	80-120			
Arsenic	105			ug/L	100.00	4.41	101	80-120			
Barium	111			ug/L	100.00	13.7	97	80-120			
Beryllium	93.7			ug/L	100.00	14.3	79	80-120			QM-05
Boron	15700			ug/L	1000.0	15200	46	80-120			QM-02
Cadmium	105			ug/L	100.00	2.92	102	80-120			
Calcium	132000			ug/L	1000.0	139000	NR	80-120			QM-02
Chromium	99.8			ug/L	100.00	1.18	99	80-120			
Cobalt	106			ug/L	100.00	12.1	94	80-120			
Copper	91.4			ug/L	100.00	3.03	88	80-120			
Lead	87.7			ug/L	100.00	1.80	86	80-120			
Molybdenum	101			ug/L	100.00	0.0857	101	80-120			
Nickel	122			ug/L	100.00	32.5	90	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 25, 2017

Report No.: AAG0338

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7070326 - EPA 3005A											
Post Spike (7070326-PS1)			Source: AAG0261-01			Prepared & Analyzed: 07/14/17					
Selenium	116			ug/L	100.00	10.6	106	80-120			
Silver	94.6			ug/L	100.00	0.0049	95	80-120			
Thallium	89.4			ug/L	100.00	0.238	89	80-120			
Vanadium	100			ug/L	100.00	-0.224	100	80-120			
Zinc	226			ug/L	100.00	136	90	80-120			
Lithium	104			ug/L	100.00	21.4	82	80-120			
Batch 7070373 - EPA 7470A											
Blank (7070373-BLK1)						Prepared & Analyzed: 07/20/17					
Mercury	ND	0.00050	0.000041	mg/L							
LCS (7070373-BS1)						Prepared & Analyzed: 07/20/17					
Mercury	0.00237	0.00050	0.000041	mg/L	2.5000E-3		95	80-120			
Matrix Spike (7070373-MS1)			Source: AAG0338-02			Prepared & Analyzed: 07/20/17					
Mercury	0.00244	0.00050	0.000041	mg/L	2.5000E-3	ND	97	75-125			
Matrix Spike Dup (7070373-MSD1)			Source: AAG0338-02			Prepared & Analyzed: 07/20/17					
Mercury	0.00247	0.00050	0.000041	mg/L	2.5000E-3	ND	99	75-125	1	20	
Post Spike (7070373-PS1)			Source: AAG0338-02			Prepared & Analyzed: 07/20/17					
Mercury	1.65			ug/L	1.6667	0.0174	98	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 25, 2017

Legend

Definition of Laboratory Terms

- ND** - Not Detected at levels equal to or greater than the MDL
- BRL** - Not Detected at levels equal to or greater than the RL
- RL** - Reporting Limit **MDL** - Method Detection Limit
- SOP** - Method run per Pace Standard Operating Procedure
- CFU** - Colony Forming Units
- DF** - Dilution Factor **TIC** - Tentatively Identified Compound

Sample Information

N-Nitrosodiphenylamine breaks down to diphenylamine in the GCMS; both analytes are reported as N-Nitrosodiphenylamine. Pace is not NELAC certified for N-Nitrosodiphenylamine.

Phthalic acid and phthalic anhydride are reported as dimethyl phthalate

Maleic acid and maleic anhydride are reported as dimethyl malate

1,2-Diphenylhydrazine breaks down to azobenzene in the GCMS; both analytes are reported as azobenzene

Definition of Qualifiers

- R-01** Elevated reporting limit due to matrix interference.
- QR-03** The RPD value for the sample duplicate or MS/MSD was outside of QC acceptance limits due to suspected matrix interference and/or non-homogeneous sample matrix.
- QM-05** The spike recovery was outside acceptance limits for the MS and/or MSD and/or PDS due to suspected matrix interference. Sample results for the QC batch were accepted based on acceptable LCS recoveries.
- QM-02** The spike recovery is outside acceptance limits due to insignificant spike amount as compared to sample concentration.
- J** Estimated value less than Reporting Limit (RL) but greater than Method Detection Limit(MDL) (CLP J-Flag).
- H-02** Sample was prepared and/or analyzed outside of the EPA recommended holding time. See Case Narrative.
- B-01** Analyte was detected in the associated method blank at an estimated level equal to or greater than the MDL. Sample values reported as greater than the MDL and less than 10x the method blank value are reported as estimated values.

Note: Unless otherwise noted, all results are reported on an as received basis.

CHAIN OF CUSTODY RECORD

Pace Analytical

Pace Analytical Services, Inc.
110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
(770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CLIENT NAME: Georgia Power
CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185 Atlanta, GA 30308
REPORT TO: Dawn Prell (Dawn_Prell@golder.com)
REQUESTED COMPLETION DATE: CC: Maria Padilla (kiurinko@golder.com)
PROJECT NAME/STATE: Plant McDonough AP
LABOURCH@SOUTHERNCO.COM

PROJECT #: Phase II CCR

Collection DATE	Collection TIME	MATRIX CODE*	SAMPLE IDENTIFICATION			
			C O M P	G R A B		
07/12/17	0745	GW	X			DGWA-53
07/12/17	0930	GW	X			DGWC-10
07/12/17	1120	GW	X			DGWC-11
07/12/17	1235	GW	X			DGWC-12
07/12/17	0920	GW	X			DGWC-13
07/12/17	1125	GW	X			DGWC-14
07/12/17	1310	GW	X			DGWC-15
07/12/17	0940	GW	X			DGWC-17
07/12/17	1225	GW	X			DGWC-19
07/12/17	1445	GW	X			DGWC-20
07/12/17	1415	GW	X			DGWC-21
07/12/17	1405	GW	X			DGWC-23
07/12/17	-	GW	X			FD-2
07/12/17	0915	W	X			FB-2
07/12/17	1505	W	X			EB-2

SAMPLED BY AND TITLE: Ben Hodges Field Lead
DATE/TIME: 7/12/17 1600
RECEIVED BY: Mike Wagner
DATE/TIME: 7/13/17 0955
RECEIVED BY LAB: Waxman
DATE/TIME: 07/13/17 1145
Temperature: Mm: 2.9 Max: NA
Yes **No** **NA**
USPS **FED-EX** **OTHER FS**
Courier: Pace
Client: Georgia Power
Cooler ID: 4
of Seals: 4

CONTAINER TYPE	PRESERVATION	ANALYSIS REQUESTED			CONTAINER TYPE	PRESERVATION	L A B	I D N U M B E R	REMARKS/ADDITIONAL INFORMATION
		P	P	P					
Metals App. III & IV (EPA 6020/7470)		3	7	3	P - PLASTIC	1 - HCl, 56°C	1		
Cl, T, SO ₄ & TDS (EPA 300.0 & SM 2540C)					A - AMBER GLASS	2 - H ₂ SO ₄ , 56°C	2		
Radium 226 & 228 (SW-846 9315/9320)					G - CLEAR GLASS	3 - HNO ₃	3		
					V - VOA VIAL	4 - NaOH, 56°C	4		
					S - STERILE	5 - NaOH/ZnAc, 56°C	5		
					O - OTHER	6 - Na ₂ S ₂ O ₃ , 56°C	6		
						7 - 56°C not frozen	7		
							8		
							9		
							10		
							11		
							12		
							13		
							14		
							15		

CONTAINER TYPE: P - PLASTIC, A - AMBER GLASS, G - CLEAR GLASS, V - VOA VIAL, S - STERILE, O - OTHER
PRESERVATION: 1 - HCl, 56°C, 2 - H₂SO₄, 56°C, 3 - HNO₃, 4 - NaOH, 56°C, 5 - NaOH/ZnAc, 56°C, 6 - Na₂S₂O₃, 56°C, 7 - 56°C not frozen
MATRIX CODES: DW - DRINKING WATER, WW - WASTEWATER, GW - GROUNDWATER, SW - SURFACE WATER, W - WATER, S - SOIL, SL - SLUDGE, SD - SOLID, A - AIR, L - LIQUID, P - PRODUCT
LAB #: AAG0338
Entered into LIMS: Tracking #: MR
RELINQUISHED BY: Ben Hodges
DATE/TIME: 7/12/17 0955
RELINQUISHED BY: Mike Wagner
DATE/TIME: 7/13/17 0955
FOR LAB USE ONLY

Sample Condition Upon Receipt



Client Name: GIA Power

Project # Plant McDonough

Courier: Fed Ex UPS USPS Client Commercial Pace Other

Tracking #: _____

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other _____

Thermometer Used IR-2 Type of Ice: Wet Blue None Samples on ice, cooling process has begun

Cooler Temperature 2.3
Temp should be above freezing to 6°C

Biological Tissue is Frozen: Yes No

Date and Initials of person examining contents: 7/13/17 NR

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.	
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.	
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.	
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.	
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.	
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.	
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.	
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.	
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.	
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
Containers Intact:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.	
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.	
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.	
-Includes date/time/ID/Analysis Matrix:			
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.	
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Initial when completed	Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.	
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.	
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.	
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A		
Pace Trip Blank Lot # (if purchased):	_____		

Client Notification/ Resolution:

Field Data Required? Y / N

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: _____

Project Manager Review: _____

Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

LOG-IN CHECKLIST

Printed: 7/14/2017 10:29:20AM

Attn: Mr. Joju Abraham

Client: Georgia Power

Project: CCR Event

Date Received: 07/13/17 11:45

Work Order: AAG0338

Logged In By: Mohammad M. Rahman

OBSERVATIONS

#Samples: 15

#Containers: 62

Minimum Temp(C): 2.3

Maximum Temp(C): 2.3

Custody Seal(s) Used: N/A

CHECKLIST ITEMS

- COC included with Samples YES
- Sample Container(s) Intact YES
- Chain of Custody Complete YES
- Sample Container(s) Match COC YES
- Custody seal Intact N/A
- Temperature in Compliance YES
- Sufficient Sample Volume for Analysis YES
- Zero Headspace Maintained for VOA Analyses YES
- Samples labeled preserved (If Applicable) YES
- Samples received within Allowable Hold Times YES
- Samples Received on Ice YES
- Preservation Confirmed YES

Comments:

August 04, 2017

Maria Padilla
GA Power
2480 Maner Rd
Atlanta, GA 30339

RE: Project: AAG0338 Plant McDonough
Pace Project No.: 30224181

Dear Maria Padilla:

Enclosed are the analytical results for sample(s) received by the laboratory on July 14, 2017. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Jacquelyn Collins
jacquelyn.collins@pacelabs.com
(724)850-5612
Project Manager

Enclosures



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: AAG0338 Plant McDonough
Pace Project No.: 30224181

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601
L-A-B DOD-ELAP Accreditation #: L2417
Alabama Certification #: 41590
Arizona Certification #: AZ0734
Arkansas Certification
California Certification #: 04222CA
Colorado Certification
Connecticut Certification #: PH-0694
Delaware Certification
Florida/TNI Certification #: E87683
Georgia Certification #: C040
Guam Certification
Hawaii Certification
Idaho Certification
Illinois Certification
Indiana Certification
Iowa Certification #: 391
Kansas/TNI Certification #: E-10358
Kentucky Certification #: 90133
Louisiana DHH/TNI Certification #: LA140008
Louisiana DEQ/TNI Certification #: 4086
Maine Certification #: PA00091
Maryland Certification #: 308
Massachusetts Certification #: M-PA1457
Michigan/PADEP Certification
Missouri Certification #: 235

Montana Certification #: Cert 0082
Nebraska Certification #: NE-05-29-14
Nevada Certification #: PA014572015-1
New Hampshire/TNI Certification #: 2976
New Jersey/TNI Certification #: PA 051
New Mexico Certification #: PA01457
New York/TNI Certification #: 10888
North Carolina Certification #: 42706
North Dakota Certification #: R-190
Oregon/TNI Certification #: PA200002
Pennsylvania/TNI Certification #: 65-00282
Puerto Rico Certification #: PA01457
Rhode Island Certification #: 65-00282
South Dakota Certification
Tennessee Certification #: TN2867
Texas/TNI Certification #: T104704188-14-8
Utah/TNI Certification #: PA014572015-5
USDA Soil Permit #: P330-14-00213
Vermont Dept. of Health: ID# VT-0282
Virgin Island/PADEP Certification
Virginia/VELAP Certification #: 460198
Washington Certification #: C868
West Virginia DEP Certification #: 143
West Virginia DHHR Certification #: 9964C
Wisconsin Certification
Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: AAG0338 Plant McDonough

Pace Project No.: 30224181

Lab ID	Sample ID	Matrix	Date Collected	Date Received
30224181001	DGWA-53	Water	07/12/17 07:45	07/14/17 10:20
30224181002	DGWC-10	Water	07/12/17 09:30	07/14/17 10:20
30224181003	DGWC-11	Water	07/12/17 11:20	07/14/17 10:20
30224181004	DGWC-12	Water	07/12/17 12:35	07/14/17 10:20
30224181005	DGWC-13	Water	07/12/17 09:20	07/14/17 10:20
30224181006	DGWC-14	Water	07/12/17 11:25	07/14/17 10:20
30224181007	DGWC-15	Water	07/12/17 13:10	07/14/17 10:20
30224181008	DGWC-17	Water	07/12/17 09:40	07/14/17 10:20
30224181009	DGWC-19	Water	07/12/17 12:25	07/14/17 10:20
30224181010	DGWC-20	Water	07/12/17 14:45	07/14/17 10:20
30224181011	DGWC-21	Water	07/12/17 14:15	07/14/17 10:20
30224181012	DGWC-23	Water	07/12/17 14:05	07/14/17 10:20
30224181013	FD-2	Water	07/12/17 00:00	07/14/17 10:20
30224181014	FB-2	Water	07/12/17 09:15	07/14/17 10:20
30224181015	EB-2	Water	07/12/17 15:05	07/14/17 10:20

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: AAG0338 Plant McDonough
Pace Project No.: 30224181

Lab ID	Sample ID	Method	Analysts	Analytes Reported
30224181001	DGWA-53	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224181002	DGWC-10	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224181003	DGWC-11	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224181004	DGWC-12	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224181005	DGWC-13	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224181006	DGWC-14	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224181007	DGWC-15	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224181008	DGWC-17	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224181009	DGWC-19	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224181010	DGWC-20	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224181011	DGWC-21	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224181012	DGWC-23	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224181013	FD-2	EPA 9315	JC2	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: AAG0338 Plant McDonough

Pace Project No.: 30224181

Lab ID	Sample ID	Method	Analysts	Analytes Reported
30224181014	FB-2	EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
		EPA 9315	JC2	1
		EPA 9320	VAL	1
30224181015	EB-2	Total Radium Calculation	RMK	1
		EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAG0338 Plant McDonough
Pace Project No.: 30224181

Sample: DGWA-53		Lab ID: 30224181001	Collected: 07/12/17 07:45	Received: 07/14/17 10:20	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	2.03 ± 0.453 (0.197) C:86% T:NA	pCi/L	07/25/17 08:44	13982-63-3	
Radium-228	EPA 9320	2.34 ± 0.622 (0.615) C:75% T:91%	pCi/L	08/01/17 15:20	15262-20-1	
Total Radium	Total Radium Calculation	4.37 ± 1.08 (0.812)	pCi/L	08/04/17 11:43	7440-14-4	

Sample: DGWC-10		Lab ID: 30224181002	Collected: 07/12/17 09:30	Received: 07/14/17 10:20	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.253 ± 0.136 (0.176) C:88% T:NA	pCi/L	07/25/17 08:44	13982-63-3	
Radium-228	EPA 9320	0.578 ± 0.325 (0.576) C:80% T:85%	pCi/L	08/01/17 15:20	15262-20-1	
Total Radium	Total Radium Calculation	0.831 ± 0.461 (0.752)	pCi/L	08/04/17 11:43	7440-14-4	

Sample: DGWC-11		Lab ID: 30224181003	Collected: 07/12/17 11:20	Received: 07/14/17 10:20	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.101 ± 0.120 (0.249) C:89% T:NA	pCi/L	07/25/17 08:44	13982-63-3	
Radium-228	EPA 9320	0.749 ± 0.421 (0.750) C:75% T:71%	pCi/L	08/01/17 15:20	15262-20-1	
Total Radium	Total Radium Calculation	0.850 ± 0.541 (0.999)	pCi/L	08/04/17 11:43	7440-14-4	

Sample: DGWC-12		Lab ID: 30224181004	Collected: 07/12/17 12:35	Received: 07/14/17 10:20	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.0323 ± 0.0874 (0.212) C:87% T:NA	pCi/L	07/25/17 08:44	13982-63-3	
Radium-228	EPA 9320	0.506 ± 0.361 (0.698) C:80% T:82%	pCi/L	08/01/17 15:20	15262-20-1	
Total Radium	Total Radium Calculation	0.538 ± 0.448 (0.910)	pCi/L	08/04/17 11:43	7440-14-4	

Sample: DGWC-13		Lab ID: 30224181005	Collected: 07/12/17 09:20	Received: 07/14/17 10:20	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.578 ± 0.215 (0.185) C:84% T:NA	pCi/L	07/31/17 08:58	13982-63-3	
Radium-228	EPA 9320	0.786 ± 0.416 (0.746) C:81% T:81%	pCi/L	08/01/17 16:09	15262-20-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAG0338 Plant McDonough
Pace Project No.: 30224181

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-13 Lab ID: 30224181005 Collected: 07/12/17 09:20 Received: 07/14/17 10:20 Matrix: Water						
PWS: Site ID: Sample Type:						
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Total Radium	Total Radium Calculation	1.36 ± 0.631 (0.931)	pCi/L	08/04/17 11:43	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-14 Lab ID: 30224181006 Collected: 07/12/17 11:25 Received: 07/14/17 10:20 Matrix: Water						
PWS: Site ID: Sample Type:						
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.357 ± 0.172 (0.219) C:86% T:NA	pCi/L	07/31/17 08:58	13982-63-3	
Radium-228	EPA 9320	0.674 ± 0.448 (0.864) C:80% T:76%	pCi/L	08/01/17 16:09	15262-20-1	
Total Radium	Total Radium Calculation	1.03 ± 0.620 (1.08)	pCi/L	08/04/17 11:43	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-15 Lab ID: 30224181007 Collected: 07/12/17 13:10 Received: 07/14/17 10:20 Matrix: Water						
PWS: Site ID: Sample Type:						
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.584 ± 0.212 (0.162) C:89% T:NA	pCi/L	07/31/17 08:58	13982-63-3	
Radium-228	EPA 9320	-0.0433 ± 0.401 (0.938) C:80% T:70%	pCi/L	08/01/17 16:09	15262-20-1	
Total Radium	Total Radium Calculation	0.584 ± 0.613 (1.10)	pCi/L	08/04/17 11:43	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-17 Lab ID: 30224181008 Collected: 07/12/17 09:40 Received: 07/14/17 10:20 Matrix: Water						
PWS: Site ID: Sample Type:						
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.362 ± 0.178 (0.208) C:76% T:NA	pCi/L	07/31/17 08:58	13982-63-3	
Radium-228	EPA 9320	-0.115 ± 0.370 (0.878) C:76% T:80%	pCi/L	08/01/17 16:09	15262-20-1	
Total Radium	Total Radium Calculation	0.362 ± 0.548 (1.09)	pCi/L	08/04/17 11:43	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-19 Lab ID: 30224181009 Collected: 07/12/17 12:25 Received: 07/14/17 10:20 Matrix: Water						
PWS: Site ID: Sample Type:						
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.260 ± 0.176 (0.298) C:77% T:NA	pCi/L	07/31/17 08:58	13982-63-3	
Radium-228	EPA 9320	0.0232 ± 0.385 (0.884) C:80% T:76%	pCi/L	08/01/17 16:10	15262-20-1	
Total Radium	Total Radium Calculation	0.283 ± 0.561 (1.18)	pCi/L	08/04/17 11:43	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAG0338 Plant McDonough
Pace Project No.: 30224181

Sample: DGWC-20		Lab ID: 30224181010	Collected: 07/12/17 14:45	Received: 07/14/17 10:20	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.345 ± 0.172 (0.224) C:86% T:NA	pCi/L	07/31/17 08:58	13982-63-3	
Radium-228	EPA 9320	0.565 ± 0.460 (0.920) C:75% T:69%	pCi/L	08/01/17 16:10	15262-20-1	
Total Radium	Total Radium Calculation	0.910 ± 0.632 (1.14)	pCi/L	08/04/17 11:43	7440-14-4	

Sample: DGWC-21		Lab ID: 30224181011	Collected: 07/12/17 14:15	Received: 07/14/17 10:20	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.195 ± 0.142 (0.222) C:71% T:NA	pCi/L	07/31/17 08:58	13982-63-3	
Radium-228	EPA 9320	1.02 ± 0.560 (0.989) C:75% T:76%	pCi/L	08/01/17 18:42	15262-20-1	
Total Radium	Total Radium Calculation	1.22 ± 0.702 (1.21)	pCi/L	08/04/17 11:43	7440-14-4	

Sample: DGWC-23		Lab ID: 30224181012	Collected: 07/12/17 14:05	Received: 07/14/17 10:20	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.243 ± 0.154 (0.226) C:78% T:NA	pCi/L	07/31/17 08:58	13982-63-3	
Radium-228	EPA 9320	0.460 ± 0.482 (1.00) C:78% T:79%	pCi/L	08/01/17 18:42	15262-20-1	
Total Radium	Total Radium Calculation	0.703 ± 0.636 (1.23)	pCi/L	08/04/17 11:43	7440-14-4	

Sample: FD-2		Lab ID: 30224181013	Collected: 07/12/17 00:00	Received: 07/14/17 10:20	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.259 ± 0.109 (0.126) C:76% T:NA	pCi/L	07/31/17 11:48	13982-63-3	
Radium-228	EPA 9320	-0.133 ± 0.433 (1.04) C:82% T:70%	pCi/L	08/01/17 18:42	15262-20-1	
Total Radium	Total Radium Calculation	0.259 ± 0.542 (1.17)	pCi/L	08/04/17 11:43	7440-14-4	

Sample: FB-2		Lab ID: 30224181014	Collected: 07/12/17 09:15	Received: 07/14/17 10:20	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.260 ± 0.103 (0.105) C:86% T:NA	pCi/L	07/31/17 11:48	13982-63-3	
Radium-228	EPA 9320	0.556 ± 0.405 (0.762) C:73% T:82%	pCi/L	08/01/17 18:42	15262-20-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAG0338 Plant McDonough

Pace Project No.: 30224181

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Total Radium	Total Radium Calculation	0.816 ± 0.508 (0.867)	pCi/L	08/04/17 11:43	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.136 ± 0.0779 (0.115) C:90% T:NA	pCi/L	07/31/17 11:48	13982-63-3	
Radium-228	EPA 9320	0.403 ± 0.421 (0.869) C:81% T:79%	pCi/L	08/01/17 18:42	15262-20-1	
Total Radium	Total Radium Calculation	0.539 ± 0.499 (0.984)	pCi/L	08/04/17 11:43	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAG0338 Plant McDonough

Pace Project No.: 30224181

QC Batch:	265655	Analysis Method:	EPA 9315
QC Batch Method:	EPA 9315	Analysis Description:	9315 Total Radium
Associated Lab Samples:	30224181005, 30224181006, 30224181007, 30224181008, 30224181009, 30224181010, 30224181011, 30224181012, 30224181013, 30224181014, 30224181015		

METHOD BLANK:	1308235	Matrix:	Water
Associated Lab Samples:	30224181005, 30224181006, 30224181007, 30224181008, 30224181009, 30224181010, 30224181011, 30224181012, 30224181013, 30224181014, 30224181015		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.129 ± 0.100 (0.150) C:93% T:NA	pCi/L	07/31/17 08:58	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAG0338 Plant McDonough

Pace Project No.: 30224181

QC Batch: 265163 Analysis Method: EPA 9315

QC Batch Method: EPA 9315 Analysis Description: 9315 Total Radium

Associated Lab Samples: 30224181001, 30224181002, 30224181003, 30224181004

METHOD BLANK: 1306527 Matrix: Water

Associated Lab Samples: 30224181001, 30224181002, 30224181003, 30224181004

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.0397 ± 0.106 (0.255) C:94% T:NA	pCi/L	07/25/17 08:23	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAG0338 Plant McDonough

Pace Project No.: 30224181

QC Batch: 265168

Analysis Method: EPA 9320

QC Batch Method: EPA 9320

Analysis Description: 9320 Radium 228

Associated Lab Samples: 30224181001, 30224181002, 30224181003, 30224181004

METHOD BLANK: 1306532

Matrix: Water

Associated Lab Samples: 30224181001, 30224181002, 30224181003, 30224181004

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.591 ± 0.331 (0.601) C:82% T:89%	pCi/L	08/01/17 11:39	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAG0338 Plant McDonough

Pace Project No.: 30224181

QC Batch:	265651	Analysis Method:	EPA 9320
QC Batch Method:	EPA 9320	Analysis Description:	9320 Radium 228
Associated Lab Samples:	30224181005, 30224181006, 30224181007, 30224181008, 30224181009, 30224181010, 30224181011, 30224181012, 30224181013, 30224181014, 30224181015		

METHOD BLANK:	1308224	Matrix:	Water
Associated Lab Samples:	30224181005, 30224181006, 30224181007, 30224181008, 30224181009, 30224181010, 30224181011, 30224181012, 30224181013, 30224181014, 30224181015		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.141 ± 0.341 (0.757) C:82% T:84%	pCi/L	08/01/17 16:09	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: AAG0338 Plant McDonough
Pace Project No.: 30224181

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

TNTC - Too Numerous To Count

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

Chain of Custody



Workorder: AAG0338 Workorder Name: Plant McDonough Owner Received Date: Results Requested By: 8/7/2017
 Report To: Betsy McDaniel Subcontract To: Pace - Pittsburgh

Pace Analytical Atlanta
 110 Technology Parkway
 Peachtree Corners, GA 30092
 Phone (770)-734-4200

1638 Roseytown Road
 Stes. 2,3,4
 Greensburg, PA 15601
 Phone (724) 850-5600

WO#: 30224181

Item	Sample ID	Sample Type	Collect Date/Time	Lab ID	Matrix	Matrix	Preserved Containers		LAB USE ONLY	
							ON	HS		
1	DGWA-53	G	7/12/2017 7:45	AAG0338-01	GW	GW	2		001	
2	DGWC-10	G	7/12/2017 9:30	AAG0338-02	GW	GW	4		007	
3	DGWC-11	G	7/12/2017 11:20	AAG0338-03	GW	GW	2		003	
4	DGWC-12	G	7/12/2017 12:35	AAG0338-04	GW	GW	2		004	
5	DGWC-13	G	7/12/2017 9:20	AAG0338-05	GW	GW	2		005	
6	DGWC-14	G	7/12/2017 11:25	AAG0338-06	GW	GW	2		006	
7	DGWC-15	G	7/12/2017 13:10	AAG0338-07	GW	GW	2		007	
8	DGWC-17	G	7/12/2017 9:40	AAG0338-08	GW	GW	2		008	
9	DGWC-19	G	7/12/2017 12:25	AAG0338-09	GW	GW	2		009	
10	DGWC-20	G	7/12/2017 14:45	AAG0338-10	GW	GW	2		010	
Transfers Released By: M. RAHMAN							Received By:		Comments	
1							Date/Time	7/14/17		
2							Date/Time			
3							Date/Time			

Cooler Temperature on Receipt N/A °C Custody Seal Y or N Received on Ice Y or N Sample Intact Y or N

***In order to maintain client confidentiality, location/name of the sampling site, sampler's name and signature may not be provided on this COC
 This chain of custody is considered complete as is since this information is available in the owner laboratory.

Chain of Custody



Workorder: AAG0338

Workorder Name: Plant McDonough

Results Requested By: 8/7/2017

Report To:

Subcontract To:

Owner Received Date:

Requested Analysis

Betsy McDaniel
 Pace Analytical Atlanta
 110 Technology Parkway
 Peachtree Corners, GA 30092
 Phone (770)-734-4200

Pace - Pittsburgh
 1638 Roseytown Road
 Stes. 2,3,4
 Greensburg, PA 15601
 Phone (724) 850-5600

30224181

Preserved Containers

Item	Sample ID	Sample Type	Collect Date/Time	Lab ID	Matrix	HNO3	LAB USE ONLY
11	DGWC-21	G	7/12/2017 14:15	AAG0338-11	GW	2	011
12	DGWC-23	G	7/12/2017 14:05	AAG0338-12	GW	2	012
13	FD-2	G	7/12/2017 0:00	AAG0338-13	GW	2	013
14	FB-2	G	7/12/2017 9:15	AAG0338-14	W	2	014
15	EB-2	G	7/12/2017 15:05	AAG0338-15	W	2	015
16							
17							
18							
19							
20							

Radium 226, 228, Total

Transfers	Released By	Date/Time	Received By	Date/Time	Comments
1	M. RAHMAN	7/13/17	[Signature]	7/11/17	
2					
3					

Cooler Temperature on Receipt N/A °C Custody Seal Y or N Received on Ice Y or N Sample Intact Y or N

***In order to maintain client confidentiality, location/name of the sampling site, sampler's name and signature may not be provided on this COC

This chain of custody is considered complete as is since this information is available in the owner laboratory.

Friday, June 17, 2016 11:01:34 AM

FMT-ALL-C-002rev.00 24March2009

Page 2 of 2



CHAIN OF CUSTODY RECORD

Pace Analytical Services, Inc.
110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
(770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CLIENT NAME: Georgia Power
CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10165 Atlanta, GA 30308
REPORT TO: Dawn Prell (Dawn_Prell@golder.com)
REQUESTED COMPLETION DATE:
PROJECT NAME/STATE: Plant MacDonough AP
PROJECT #: Phase II CCR
Collection DATE, TIME, MATRIX CODE, SAMPLE IDENTIFICATION, ANALYSIS REQUESTED, CONTAINER TYPE, PRESERVATION, CONTAINER TYPE, PRESERVATION, L A B I D N U M B E R, REMARKS/ADDITIONAL INFORMATION

30224181

Sample Condition Upon Receipt



Client Name: GIA Power

Project # Plant McDonough

Courier: Fed Ex UPS USPS Client Commercial Pace Other

Tracking #: _____

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other

Thermometer Used IR-2 Type of Ice: Wet Blue None Samples on ice, cooling process has begun

Cooler Temperature 2.3 Biological Tissue is Frozen: Yes No
Temp should be above freezing to 8°C

Optional:
Proj Due Date:
Proj Name:
Date and initials of person examining contents: 7/13/17 MR

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.	
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.	
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.	
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.	
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.	
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.	
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.	
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.	
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.	
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
Containers Intact:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.	
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.	
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.	
-Includes date/time/ID/Analysis Matrix:			
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.	
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Initial when completed	Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.	
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.	
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.	
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A		
Pace Trip Blank Lot # (if purchased):			

Client Notification/ Resolution: _____ Date/Time: _____ Field Data Required? Y / N

Person Contacted: _____


Comments/ Resolution: _____

Project Manager Review: _____ Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

Sample Condition Upon Receipt Pittsburgh

30224181



Client Name: PAVE-GA Project # _____

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Label ZH
LIMS Login AM

Tracking #: 741366571590

Custody Seal on Cooler/Box Present: yes no Seals Intact: yes no

Thermometer Used _____ Type of Ice: Wet Blue None

Cooler Temperature Observed Temp _____ °C Correction Factor: _____ °C Final Temp: _____ °C

Temp should be above freezing to 6°C

Date and Initials of person examining contents: ZH 7/14/17

Comments:	Yes	No	N/A	
Chain of Custody Present:	/			1.
Chain of Custody Filled Out:	/			2.
Chain of Custody Relinquished:	/			3.
Sampler Name & Signature on COC:	/	X		4. <u>AM 7-14-17</u>
Sample Labels match COC:	/			5.
-Includes date/time/ID Matrix: <u>WT</u>				
Samples Arrived within Hold Time:	/			6.
Short Hold Time Analysis (<72hr remaining):		/		7.
Rush Turn Around Time Requested:	/			8.
Sufficient Volume:	/			9.
Correct Containers Used:	/			10.
-Pace Containers Used:	/			
Containers Intact:				11.
Orthophosphate field filtered			/	12.
Organic Samples checked for dechlorination:			/	13.
Filtered volume received for Dissolved tests			/	14.
All containers have been checked for preservation.	/			15. <u>PHCZ</u>
All containers needing preservation are found to be in compliance with EPA recommendation.	/			
exceptions: VOA, coliform, TOC, O&G, Phenolics				
				Initial when completed: <u>ZH</u> Date/time of preservation: _____
				Lot # of added preservative: _____
Headspace in VOA Vials (>6mm):			/	16.
Trip Blank Present:			/	17.
Trip Blank Custody Seals Present			/	
Rad Aqueous Samples Screened > 0.5 mrem/hr		/		Initial when completed: <u>ZH</u> Date: <u>7/14/17</u>

Client Notification/ Resolution:

Person Contacted: _____ Date/Time: _____ Contacted By: _____

Comments/ Resolution: _____

A check in this box indicates that additional information has been stored in ereports.

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

*PM review is documented electronically in LIMS. When the Project Manager closes the SRF Review schedule in LIMS. The review is in the Status section of the Workorder Edit Screen.

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: JC2
Date: 7/20/2017
Worklist: 36693
Matrix: DW

Method Blank Assessment

MB Sample ID: 1306527
MB concentration: 0.040
MB Counting Uncertainty: 0.106
MB MDC: 0.255
MB Numerical Performance Indicator: 0.73
MB Status vs Numerical Indicator: N/A
MB Status vs. MDC: Pass

Laboratory Control Sample Assessment

LCS (Y or N)? N
LCS# 36693
LCS# 36693
Count Date: 7/25/2017
Spike I.D.: 17-030
Spike Concentration (pCi/mL): 80.197
Volume Used (mL): 0.10
Aliquot Volume (L, g, F): 0.503
Target Conc. (pCi/L, g, F): 15.943
Uncertainty (Calculated): 1.469
Result (pCi/L, g, F): 13.192
LCS/LCSD Counting Uncertainty (pCi/L, g, F): 0.829
Numerical Performance Indicator: -3.20
Percent Recovery: 82.75%
Status vs Numerical Indicator: N/A
Status vs Recovery: Pass

Duplicate Sample Assessment

Sample I.D.: 30224181002
Duplicate Sample I.D.: 30224181002DUP
Sample Result (pCi/L, g, F): 0.253
Sample Result Counting Uncertainty (pCi/L, g, F): 0.131
Sample Duplicate Result (pCi/L, g, F): 0.208
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F): 0.121
Are sample and/or duplicate results below MDC? See Below ##
Duplicate Numerical Performance Indicator: 0.493
Duplicate Status vs Numerical Indicator: 19.39%
Duplicate Status vs RPD: N/A
Duplicate Status vs RPD: Pass

Enter Duplicate sample IDs if other than LCS/LCSD in the space below.
30224181002
30224181002DUP

Sample Matrix Spike Control Assessment

Sample Collection Date:
Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Spike I.D.:
MS/MSD Decay Corrected Spike Concentration (pCi/mL):
Spike Volume Used in MS (mL):
Spike Volume Used in MSD (mL):
MS Aliquot (L, g, F):
MS Target Conc. (pCi/L, g, F):
MSD Aliquot (L, g, F):
MSD Target Conc. (pCi/L, g, F):
Spike uncertainty (calculated):
Sample Result:
Sample Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
MS Numerical Performance Indicator:
MSD Numerical Performance Indicator:
MS Percent Recovery:
MSD Percent Recovery:
MS Status vs Numerical Indicator:
MSD Status vs Numerical Indicator:
MS Status vs Recovery:
MSD Status vs Recovery:

Matrix Spike/Matrix Spike Duplicate Sample Assessment

Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Sample Matrix Spike Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
Duplicate Numerical Performance Indicator:
MS/MSD Duplicate Status vs Numerical Indicator:
MS/MSD Duplicate Status vs RPD:

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

Must 4/17

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: JC2
Date: 7/27/2017
Worklist: 36805
Matrix: DW

Method Blank Assessment

MB Sample ID	1308235
MB concentration:	0.129
MB Counting Uncertainty:	0.099
MB MDC:	0.150
MB Numerical Performance Indicator:	2.56
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment

LCSID (Y or N)?	N
LCS36805	LCS36805
Count Date:	8/1/2017
Spike I.D.:	17-030
Spike Concentration (pCi/mL):	80.197
Volume Used (mL):	0.10
Aliquot Volume (L, g, F):	0.512
Target Conc. (pCi/L, g, F):	15.671
Uncertainty (Calculated):	1.444
Result (pCi/L, g, F):	12.371
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.808
Numerical Performance Indicator:	-3.91
Percent Recovery:	78.94%
Status vs Numerical Indicator:	N/A
Status vs Recovery:	Pass

Duplicate Sample Assessment

Sample I.D.:	30224380002
Duplicate Sample I.D.:	30224380002DUP
Sample Result (pCi/L, g, F):	0.281
Sample Duplicate Result (pCi/L, g, F):	0.115
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.341
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.158
Are sample and/or duplicate results below MDC?	See Below #
Duplicate Numerical Performance Indicator:	-0.502
Duplicate RPD:	15.83%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Pass

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

M. Kelly

Sample Matrix Spike Control Assessment

Sample Collection Date:
Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Spike I.D.:

MS/MSD Decay Corrected Spike Concentration (pCi/mL):
Spike Volume Used in MS (mL):
Spike Volume Used in MSD (mL):
MS Aliquot (L, g, F):
MS Target Conc. (pCi/L, g, F):
MSD Aliquot (L, g, F):
MSD Target Conc. (pCi/L, g, F):
Spike uncertainty (calculated):

Sample Result:
Sample Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
MS Numerical Performance Indicator:
MSD Numerical Performance Indicator:


MS Percent Recovery:
MSD Percent Recovery:
MS Status vs Numerical Indicator:
MSD Status vs Numerical Indicator:
MS Status vs Recovery:
MSD Status vs Recovery:

Matrix Spike/Matrix Spike Duplicate Sample Assessment

Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:

Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
Duplicate Numerical Performance Indicator:
MS/MSD Duplicate RPD:
MS/MSD Duplicate Status vs Numerical Indicator:
MS/MSD Duplicate Status vs RPD:

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-228
Analyst: VAL
Date: 7/25/2017
Worklist: 36696
Matrix: DW

Method Blank Assessment	
MB Sample ID	1306552
MB concentration:	0.591
MB Counting Uncertainty:	0.314
MB MDC:	0.601
MB Numerical Performance Indicator:	3.70
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment	
Count Date:	LCS (Y or N)?
8/1/2017	LCS036696
17-005	8/1/2017
23.911	17-005
0.20	23.911
0.819	0.20
5.841	0.819
0.421	5.841
6.574	0.421
0.691	6.574
1.78	0.691
112.55%	1.78
N/A	112.55%
Pass	N/A
Pass	Pass

Duplicate Sample Assessment	
Sample I.D.:	LCS036696
Duplicate Sample I.D.:	LCS036696
Sample Result (pCi/L, g, F):	6.753
Sample Result Counting Uncertainty (pCi/L, g, F):	0.741
Sample Duplicate Result (pCi/L, g, F):	6.574
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.691
Are sample and/or duplicate results below MDC?	NO
Duplicate Numerical Performance Indicator:	0.345
(Based on the LCS/LCSD Percent Recoveries) Duplicate RPD:	2.48%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Pass

Sample Matrix Spike Control Assessment	
Sample Collection Date:	Sample I.D.:
Sample MS I.D.:	Sample MS I.D.:
Sample MSD I.D.:	Sample MSD I.D.:
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	Spike I.D.:
Spike Volume Used in MS (mL):	Spike Volume Used in MS (mL):
MS Aliquot (L, g, F):	MS Aliquot (L, g, F):
MS Target Conc. (pCi/L, g, F):	MS Target Conc. (pCi/L, g, F):
MSD Aliquot (L, g, F):	MSD Aliquot (L, g, F):
MSD Target Conc. (pCi/L, g, F):	MSD Target Conc. (pCi/L, g, F):
Spike uncertainty (calculated):	Spike uncertainty (calculated):
Sample Result Counting Uncertainty (pCi/L, g, F):	Sample Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Result:	Sample Matrix Spike Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:	Sample Matrix Spike Duplicate Result:
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
MS Numerical Performance Indicator:	MS Numerical Performance Indicator:
MS Percent Recovery:	MS Percent Recovery:
MS Status vs Numerical Indicator:	MS Status vs Numerical Indicator:
MS Status vs Numerical Indicator:	MS Status vs Numerical Indicator:
MS Status vs Recovery:	MS Status vs Recovery:
MSD Status vs Recovery:	MSD Status vs Recovery:

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	Sample MS I.D.:
Sample MS I.D.:	Sample MSD I.D.:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:	Sample Matrix Spike Duplicate Result:
Duplicate Numerical Performance Indicator:	Duplicate Numerical Performance Indicator:
(Based on the Percent Recoveries) MS/MSD Duplicate RPD:	(Based on the Percent Recoveries) MS/MSD Duplicate RPD:
MS/MSD Duplicate Status vs Numerical Indicator:	MS/MSD Duplicate Status vs RPD:

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

07/28/17

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-228
Analyst: VAL
Date: 7/26/2017
Worklist: 36801
Matrix: DW

Method Blank Assessment	
MB Sample ID	1308224
MB concentration:	0.141
M/B Counting Uncertainty:	0.340
MB MDC:	0.757
MB Numerical Performance Indicator:	0.81
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment		Y
LCS36801		8/1/2017
Count Date:	8/1/2017	
Spike I.D.:	17-005	
Spike Concentration (pCi/mL):	23.910	
Volume Used (mL):	0.20	
Aliquot Volume (L, g, F):	0.802	
Target Conc. (pCi/L, g, F):	5.966	
Uncertainty (Calculated):	0.429	
Result (pCi/L, g, F):	6.314	
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.746	
Numerical Performance Indicator:	0.79	
Percent Recovery:	105.83%	
Status vs Numerical Indicator:	N/A	
Status vs Recovery:	Pass	

Duplicate Sample Assessment		Y
LCS36801		8/1/2017
Sample I.D.:	LCS36801	
Duplicate Sample I.D.:	LCS36801	
Duplicate Result (pCi/L, g, F):	6.314	
Sample Result Counting Uncertainty (pCi/L, g, F):	0.746	
Sample Duplicate Result (pCi/L, g, F):	6.521	
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.679	
Are sample and/or duplicate results below MDC?	NO	
Duplicate Numerical Performance Indicator:	-0.404	
Duplicate (Based on the LCS/LCSD Percent Recoveries) Duplicate RPD:	3.25%	
Duplicate Status vs Numerical Indicator:	N/A	
Duplicate Status vs RPD:	Pass	

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
(Based on the Percent Recoveries) MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

08/14/17



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Laboratory Report

Prepared For:

**Georgia Power
2480 Maner Road
Atlanta, GA 30339**

Attention: Mr. Joju Abraham

Report Number: AAG0388

July 26, 2017

Project: CCR Event

Project #:Plant McDonough

We appreciate the opportunity to provide the analytical support for your project. The analytical results in this report are based upon information supplied by you, the client, and are for your exclusive use. If you have any questions regarding this data package, please do not hesitate to call.

Approved:

A handwritten signature in black ink that reads "Betsy McDonough". The signature is written over a horizontal line.

Project Manager

This report may not be reproduced, except in full, without written approval from Pace Analytical Services, LLC.
All test results relate only to the samples analyzed.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 26, 2017

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
DGWC-22	AAG0388-01	Ground Water	07/13/17 08:55	07/14/17 09:55
DGWC-37	AAG0388-02	Ground Water	07/13/17 09:05	07/14/17 09:55
DGWC-38	AAG0388-03	Ground Water	07/13/17 10:30	07/14/17 09:55
DGWC-39	AAG0388-04	Ground Water	07/13/17 11:45	07/14/17 09:55
DGWC-40	AAG0388-05	Ground Water	07/13/17 13:45	07/14/17 09:55
DGWC-42	AAG0388-06	Ground Water	07/13/17 10:30	07/14/17 09:55
DGWC-47	AAG0388-07	Ground Water	07/13/17 15:10	07/14/17 09:55
DGWC-48	AAG0388-08	Ground Water	07/13/17 12:35	07/14/17 09:55
DGWC-67	AAG0388-09	Ground Water	07/13/17 10:45	07/14/17 09:55
DGWC-68A	AAG0388-10	Ground Water	07/13/17 13:25	07/14/17 09:55
DGWC-69	AAG0388-11	Ground Water	07/13/17 14:45	07/14/17 09:55
FD-3	AAG0388-12	Ground Water	07/13/17 00:00	07/14/17 09:55
FB-3	AAG0388-13	Water	07/13/17 08:30	07/14/17 09:55
EB-3	AAG0388-14	Water	07/13/17 14:27	07/14/17 09:55



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 26, 2017

Case Narrative

The Radium analysis by methods EPA 9315/9320 was performed by Pace-Pittsburgh, 1638 Roseytown Road - Suites 2, 3, 4, Greensburg PA 15601. The Pace-Pittsburgh lab contact is Jacquelyn Collins at 724-850-5612.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

July 26, 2017

Attention: Mr. Joju Abraham

Report No.: AAG0388

Project: CCR Event

Client ID: DGWC-22

Lab Number ID: AAG0388-01

Date/Time Sampled: 7/13/2017 8:55:00AM

Date/Time Received: 7/14/2017 9:55:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	492	25	10	mg/L	SM 2540 C		1	07/20/17 18:53	07/20/17 18:53	7070489	JPT
Inorganic Anions											
Chloride	29	0.25	0.02	mg/L	EPA 300.0		1	07/20/17 16:43	07/21/17 07:44	7070516	RLC
Fluoride	0.09	0.30	0.03	mg/L	EPA 300.0	J	1	07/20/17 16:43	07/21/17 07:44	7070516	RLC
Sulfate	300	10	0.17	mg/L	EPA 300.0		10	07/20/17 16:43	07/23/17 03:07	7070516	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 19:50	7070414	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 19:50	7070414	CSW
Barium	0.0376	0.0100	0.0004	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 19:50	7070414	CSW
Beryllium	0.0002	0.0030	0.00009	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 19:50	7070414	CSW
Boron	3.85	0.0400	0.0060	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 19:50	7070414	CSW
Cadmium	0.0005	0.0010	0.0001	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 19:50	7070414	CSW
Calcium	67.2	25.0	2.02	mg/L	EPA 6020B		50	07/18/17 10:03	07/20/17 19:56	7070414	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 19:50	7070414	CSW
Cobalt	0.0106	0.0100	0.0003	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 19:50	7070414	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 19:50	7070414	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 19:50	7070414	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 19:50	7070414	CSW
Thallium	0.00007	0.0010	0.00005	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 19:50	7070414	CSW
Lithium	0.0044	0.0500	0.0015	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 19:50	7070414	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 10:30	07/21/17 09:49	7070381	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 26, 2017

Report No.: AAG0388

Project: CCR Event

Client ID: DGWC-37

Lab Number ID: AAG0388-02

Date/Time Sampled: 7/13/2017 9:05:00AM

Date/Time Received: 7/14/2017 9:55:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	312	25	10	mg/L	SM 2540 C		1	07/20/17 18:53	07/20/17 18:53	7070489	JPT
Inorganic Anions											
Chloride	6.5	0.25	0.02	mg/L	EPA 300.0		1	07/20/17 16:43	07/21/17 08:05	7070516	RLC
Fluoride	0.06	0.30	0.03	mg/L	EPA 300.0	J	1	07/20/17 16:43	07/21/17 08:05	7070516	RLC
Sulfate	200	10	0.17	mg/L	EPA 300.0		10	07/20/17 16:43	07/23/17 04:30	7070516	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:13	7070414	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:13	7070414	CSW
Barium	0.110	0.0100	0.0004	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:13	7070414	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:13	7070414	CSW
Boron	2.10	0.400	0.0595	mg/L	EPA 6020B		10	07/18/17 10:03	07/25/17 16:33	7070414	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:13	7070414	CSW
Calcium	64.1	25.0	2.02	mg/L	EPA 6020B		50	07/18/17 10:03	07/20/17 20:19	7070414	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:13	7070414	CSW
Cobalt	0.0003	0.0100	0.0003	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 20:13	7070414	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:13	7070414	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:13	7070414	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:13	7070414	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:13	7070414	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:13	7070414	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 10:30	07/21/17 09:51	7070381	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

July 26, 2017

Attention: Mr. Joju Abraham

Report No.: AAG0388

Project: CCR Event

Client ID: DGWC-38

Lab Number ID: AAG0388-03

Date/Time Sampled: 7/13/2017 10:30:00AM

Date/Time Received: 7/14/2017 9:55:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	504	25	10	mg/L	SM 2540 C		1	07/20/17 18:53	07/20/17 18:53	7070489	JPT
Inorganic Anions											
Chloride	7.5	0.25	0.02	mg/L	EPA 300.0		1	07/20/17 16:43	07/21/17 08:26	7070516	RLC
Fluoride	0.13	0.30	0.03	mg/L	EPA 300.0	J	1	07/20/17 16:43	07/21/17 08:26	7070516	RLC
Sulfate	270	10	0.17	mg/L	EPA 300.0		10	07/20/17 16:43	07/23/17 04:51	7070516	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:25	7070414	CSW
Arsenic	0.0005	0.0050	0.0005	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 20:25	7070414	CSW
Barium	0.0332	0.0100	0.0004	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:25	7070414	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:25	7070414	CSW
Boron	3.09	2.00	0.298	mg/L	EPA 6020B		50	07/18/17 10:03	07/25/17 16:39	7070414	CSW
Cadmium	0.0002	0.0010	0.0001	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 20:25	7070414	CSW
Calcium	90.8	25.0	2.02	mg/L	EPA 6020B		50	07/18/17 10:03	07/20/17 20:30	7070414	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:25	7070414	CSW
Cobalt	0.0016	0.0100	0.0003	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 20:25	7070414	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:25	7070414	CSW
Molybdenum	0.0012	0.0100	0.0010	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 20:25	7070414	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:25	7070414	CSW
Thallium	0.0001	0.0010	0.00005	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 20:25	7070414	CSW
Lithium	0.0032	0.0500	0.0015	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 20:25	7070414	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 10:30	07/21/17 09:54	7070381	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 26, 2017

Report No.: AAG0388

Project: CCR Event

Client ID: DGWC-39

Lab Number ID: AAG0388-04

Date/Time Sampled: 7/13/2017 11:45:00AM

Date/Time Received: 7/14/2017 9:55:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	508	25	10	mg/L	SM 2540 C		1	07/20/17 18:53	07/20/17 18:53	7070489	JPT
Inorganic Anions											
Chloride	8.4	0.25	0.02	mg/L	EPA 300.0		1	07/20/17 16:43	07/21/17 08:48	7070516	RLC
Fluoride	0.14	0.30	0.03	mg/L	EPA 300.0	J	1	07/20/17 16:43	07/21/17 08:48	7070516	RLC
Sulfate	220	10	0.17	mg/L	EPA 300.0		10	07/20/17 16:43	07/23/17 05:11	7070516	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:36	7070414	CSW
Arsenic	0.0009	0.0050	0.0005	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 20:36	7070414	CSW
Barium	0.0919	0.0100	0.0004	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:36	7070414	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:36	7070414	CSW
Boron	3.41	2.00	0.298	mg/L	EPA 6020B		50	07/18/17 10:03	07/25/17 16:45	7070414	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:36	7070414	CSW
Calcium	95.0	25.0	2.02	mg/L	EPA 6020B		50	07/18/17 10:03	07/20/17 20:42	7070414	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:36	7070414	CSW
Cobalt	0.0063	0.0100	0.0003	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 20:36	7070414	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:36	7070414	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:36	7070414	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:36	7070414	CSW
Thallium	0.00009	0.0010	0.00005	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 20:36	7070414	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:36	7070414	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 10:30	07/21/17 10:01	7070381	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

July 26, 2017

Attention: Mr. Joju Abraham

Report No.: AAG0388

Project: CCR Event

Client ID: DGWC-40

Lab Number ID: AAG0388-05

Date/Time Sampled: 7/13/2017 1:45:00PM

Date/Time Received: 7/14/2017 9:55:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	386	25	10	mg/L	SM 2540 C		1	07/20/17 18:53	07/20/17 18:53	7070489	JPT
Inorganic Anions											
Chloride	21	0.25	0.02	mg/L	EPA 300.0		1	07/20/17 16:43	07/21/17 09:09	7070516	RLC
Fluoride	0.20	0.30	0.03	mg/L	EPA 300.0	J	1	07/20/17 16:43	07/21/17 09:09	7070516	RLC
Sulfate	220	10	0.17	mg/L	EPA 300.0		10	07/20/17 16:43	07/23/17 05:32	7070516	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:48	7070414	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:48	7070414	CSW
Barium	0.0170	0.0100	0.0004	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:48	7070414	CSW
Beryllium	0.0030	0.0030	0.00009	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 20:48	7070414	CSW
Boron	0.933	0.400	0.0595	mg/L	EPA 6020B		10	07/18/17 10:03	07/25/17 16:50	7070414	CSW
Cadmium	0.0008	0.0010	0.0001	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 20:48	7070414	CSW
Calcium	46.2	25.0	2.02	mg/L	EPA 6020B		50	07/18/17 10:03	07/20/17 20:53	7070414	CSW
Chromium	0.0006	0.0100	0.0005	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 20:48	7070414	CSW
Cobalt	0.0394	0.0100	0.0003	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:48	7070414	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:48	7070414	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:48	7070414	CSW
Selenium	0.0025	0.0100	0.0018	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 20:48	7070414	CSW
Thallium	0.00006	0.0010	0.00005	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 20:48	7070414	CSW
Lithium	0.0023	0.0500	0.0015	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 20:48	7070414	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 10:30	07/21/17 10:03	7070381	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 26, 2017

Report No.: AAG0388

Project: CCR Event

Client ID: DGWC-42

Lab Number ID: AAG0388-06

Date/Time Sampled: 7/13/2017 10:30:00AM

Date/Time Received: 7/14/2017 9:55:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	641	25	10	mg/L	SM 2540 C		1	07/20/17 18:53	07/20/17 18:53	7070489	JPT
Inorganic Anions											
Chloride	33	0.25	0.02	mg/L	EPA 300.0		1	07/20/17 16:43	07/21/17 09:51	7070516	RLC
Fluoride	ND	0.30	0.03	mg/L	EPA 300.0		1	07/20/17 16:43	07/21/17 09:51	7070516	RLC
Sulfate	370	50	0.85	mg/L	EPA 300.0		50	07/20/17 16:43	07/23/17 05:53	7070516	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:59	7070414	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:59	7070414	CSW
Barium	0.0210	0.0100	0.0004	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:59	7070414	CSW
Beryllium	0.0025	0.0030	0.00009	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 20:59	7070414	CSW
Boron	1.03	0.400	0.0595	mg/L	EPA 6020B		10	07/18/17 10:03	07/25/17 16:56	7070414	CSW
Cadmium	0.0008	0.0010	0.0001	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 20:59	7070414	CSW
Calcium	52.3	25.0	2.02	mg/L	EPA 6020B		50	07/18/17 10:03	07/20/17 21:05	7070414	CSW
Chromium	0.0008	0.0100	0.0005	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 20:59	7070414	CSW
Cobalt	0.0481	0.0100	0.0003	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:59	7070414	CSW
Lead	0.0004	0.0050	0.00007	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 20:59	7070414	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:59	7070414	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 20:59	7070414	CSW
Thallium	0.00009	0.0010	0.00005	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 20:59	7070414	CSW
Lithium	0.0116	0.0500	0.0015	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 20:59	7070414	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 10:30	07/21/17 10:06	7070381	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 26, 2017

Report No.: AAG0388

Project: CCR Event

Client ID: DGWC-47

Lab Number ID: AAG0388-07

Date/Time Sampled: 7/13/2017 3:10:00PM

Date/Time Received: 7/14/2017 9:55:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	441	25	10	mg/L	SM 2540 C		1	07/20/17 18:53	07/20/17 18:53	7070489	JPT
Inorganic Anions											
Chloride	5.7	0.25	0.02	mg/L	EPA 300.0		1	07/20/17 16:43	07/21/17 11:16	7070516	RLC
Fluoride	0.84	0.30	0.03	mg/L	EPA 300.0		1	07/20/17 16:43	07/21/17 11:16	7070516	RLC
Sulfate	270	10	0.17	mg/L	EPA 300.0		10	07/20/17 16:43	07/23/17 06:13	7070516	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:22	7070414	CSW
Arsenic	0.0018	0.0050	0.0005	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 21:22	7070414	CSW
Barium	0.0165	0.0100	0.0004	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:22	7070414	CSW
Beryllium	0.0098	0.0030	0.0005	mg/L	EPA 6020B		5	07/18/17 10:03	07/25/17 17:02	7070414	CSW
Boron	0.280	0.200	0.0298	mg/L	EPA 6020B		5	07/18/17 10:03	07/25/17 17:02	7070414	CSW
Cadmium	0.0017	0.0010	0.0001	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:22	7070414	CSW
Calcium	52.5	25.0	2.02	mg/L	EPA 6020B		50	07/18/17 10:03	07/20/17 21:28	7070414	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:22	7070414	CSW
Cobalt	0.396	0.0100	0.0003	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:22	7070414	CSW
Lead	0.0007	0.0050	0.00007	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 21:22	7070414	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:22	7070414	CSW
Selenium	0.0068	0.0100	0.0018	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 21:22	7070414	CSW
Thallium	0.0002	0.0010	0.00005	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 21:22	7070414	CSW
Lithium	0.0743	0.0500	0.0075	mg/L	EPA 6020B		5	07/18/17 10:03	07/25/17 17:02	7070414	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 10:30	07/21/17 10:08	7070381	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 26, 2017

Report No.: AAG0388

Project: CCR Event

Client ID: DGWC-48

Lab Number ID: AAG0388-08

Date/Time Sampled: 7/13/2017 12:35:00PM

Date/Time Received: 7/14/2017 9:55:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	789	25	10	mg/L	SM 2540 C		1	07/20/17 18:53	07/20/17 18:53	7070489	JPT
Inorganic Anions											
Chloride	15	0.25	0.02	mg/L	EPA 300.0		1	07/20/17 16:43	07/21/17 11:37	7070516	RLC
Fluoride	1.1	0.30	0.03	mg/L	EPA 300.0		1	07/20/17 16:43	07/21/17 11:37	7070516	RLC
Sulfate	500	10	0.17	mg/L	EPA 300.0		10	07/20/17 16:43	07/23/17 06:34	7070516	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:33	7070414	CSW
Arsenic	0.0012	0.0050	0.0005	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 21:33	7070414	CSW
Barium	0.0140	0.0100	0.0004	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:33	7070414	CSW
Beryllium	0.0106	0.0030	0.0005	mg/L	EPA 6020B		5	07/18/17 10:03	07/25/17 17:07	7070414	CSW
Boron	0.972	0.200	0.0298	mg/L	EPA 6020B		5	07/18/17 10:03	07/25/17 17:07	7070414	CSW
Cadmium	0.0033	0.0010	0.0001	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:33	7070414	CSW
Calcium	102	25.0	2.02	mg/L	EPA 6020B		50	07/18/17 10:03	07/20/17 21:39	7070414	CSW
Chromium	0.0007	0.0100	0.0005	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 21:33	7070414	CSW
Cobalt	0.531	0.0100	0.0003	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:33	7070414	CSW
Lead	0.0020	0.0050	0.00007	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 21:33	7070414	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:33	7070414	CSW
Selenium	0.0062	0.0100	0.0018	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 21:33	7070414	CSW
Thallium	0.00008	0.0010	0.00005	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 21:33	7070414	CSW
Lithium	0.143	0.0500	0.0075	mg/L	EPA 6020B		5	07/18/17 10:03	07/25/17 17:07	7070414	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 10:30	07/21/17 10:10	7070381	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 26, 2017

Report No.: AAG0388

Project: CCR Event

Client ID: DGWC-67

Lab Number ID: AAG0388-09

Date/Time Sampled: 7/13/2017 10:45:00AM

Date/Time Received: 7/14/2017 9:55:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	275	25	10	mg/L	SM 2540 C		1	07/20/17 18:53	07/20/17 18:53	7070489	JPT
Inorganic Anions											
Chloride	5.2	0.25	0.02	mg/L	EPA 300.0		1	07/20/17 16:43	07/21/17 11:59	7070516	RLC
Fluoride	0.03	0.30	0.03	mg/L	EPA 300.0	J	1	07/20/17 16:43	07/21/17 11:59	7070516	RLC
Sulfate	110	5.0	0.08	mg/L	EPA 300.0		5	07/20/17 16:43	07/23/17 06:55	7070516	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:45	7070414	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:45	7070414	CSW
Barium	0.102	0.0100	0.0004	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:45	7070414	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:45	7070414	CSW
Boron	3.46	2.00	0.298	mg/L	EPA 6020B		50	07/18/17 10:03	07/25/17 17:13	7070414	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:45	7070414	CSW
Calcium	43.7	25.0	2.02	mg/L	EPA 6020B		50	07/18/17 10:03	07/20/17 21:50	7070414	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:45	7070414	CSW
Cobalt	0.0037	0.0100	0.0003	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 21:45	7070414	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:45	7070414	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:45	7070414	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:45	7070414	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:45	7070414	CSW
Lithium	0.0044	0.0500	0.0015	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 21:45	7070414	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 10:30	07/21/17 10:13	7070381	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

July 26, 2017

Attention: Mr. Joju Abraham

Report No.: AAG0388

Project: CCR Event

Client ID: DGWC-68A

Lab Number ID: AAG0388-10

Date/Time Sampled: 7/13/2017 1:25:00PM

Date/Time Received: 7/14/2017 9:55:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	246	25	10	mg/L	SM 2540 C		1	07/20/17 18:53	07/20/17 18:53	7070489	JPT
Inorganic Anions											
Chloride	4.4	0.25	0.02	mg/L	EPA 300.0		1	07/20/17 16:44	07/20/17 23:00	7070517	RLC
Fluoride	0.12	0.30	0.03	mg/L	EPA 300.0	J	1	07/20/17 16:44	07/20/17 23:00	7070517	RLC
Sulfate	49	1.0	0.02	mg/L	EPA 300.0		1	07/20/17 16:44	07/20/17 23:00	7070517	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:56	7070414	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:56	7070414	CSW
Barium	0.0859	0.0100	0.0004	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:56	7070414	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:56	7070414	CSW
Boron	1.97	0.200	0.0298	mg/L	EPA 6020B		5	07/18/17 10:03	07/25/17 17:19	7070414	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:56	7070414	CSW
Calcium	52.3	25.0	2.02	mg/L	EPA 6020B		50	07/18/17 10:03	07/20/17 22:02	7070414	CSW
Chromium	0.0005	0.0100	0.0005	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 21:56	7070414	CSW
Cobalt	0.0005	0.0100	0.0003	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 21:56	7070414	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:56	7070414	CSW
Molybdenum	0.211	0.0100	0.0010	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:56	7070414	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:56	7070414	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:56	7070414	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 21:56	7070414	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 10:30	07/21/17 10:15	7070381	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

July 26, 2017

Attention: Mr. Joju Abraham

Report No.: AAG0388

Project: CCR Event

Client ID: DGWC-69

Lab Number ID: AAG0388-11

Date/Time Sampled: 7/13/2017 2:45:00PM

Date/Time Received: 7/14/2017 9:55:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	122	25	10	mg/L	SM 2540 C		1	07/20/17 19:30	07/20/17 19:30	7070490	JPT
Inorganic Anions											
Chloride	4.7	0.25	0.02	mg/L	EPA 300.0		1	07/20/17 16:44	07/20/17 23:21	7070517	RLC
Fluoride	0.13	0.30	0.03	mg/L	EPA 300.0	J	1	07/20/17 16:44	07/20/17 23:21	7070517	RLC
Sulfate	17	1.0	0.02	mg/L	EPA 300.0		1	07/20/17 16:44	07/20/17 23:21	7070517	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:08	7070414	CSW
Arsenic	0.0029	0.0050	0.0005	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 22:08	7070414	CSW
Barium	0.0985	0.0100	0.0004	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:08	7070414	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:08	7070414	CSW
Boron	0.323	0.0400	0.0060	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:08	7070414	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:08	7070414	CSW
Calcium	17.6	5.00	2.02	mg/L	EPA 6020B		50	07/18/17 10:03	07/20/17 22:13	7070414	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:08	7070414	CSW
Cobalt	0.0004	0.0100	0.0003	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 22:08	7070414	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:08	7070414	CSW
Molybdenum	0.0053	0.0100	0.0010	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 22:08	7070414	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:08	7070414	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:08	7070414	CSW
Lithium	0.0029	0.0500	0.0015	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 22:08	7070414	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 10:30	07/21/17 10:17	7070381	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

July 26, 2017

Attention: Mr. Joju Abraham

Report No.: AAG0388

Project: CCR Event

Client ID: FD-3

Lab Number ID: AAG0388-12

Date/Time Sampled: 7/13/2017 12:00:00AM

Date/Time Received: 7/14/2017 9:55:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	606	25	10	mg/L	SM 2540 C		1	07/20/17 19:30	07/20/17 19:30	7070490	JPT
Inorganic Anions											
Chloride	34	0.25	0.02	mg/L	EPA 300.0		1	07/20/17 16:44	07/20/17 23:42	7070517	RLC
Fluoride	0.11	0.30	0.03	mg/L	EPA 300.0	J	1	07/20/17 16:44	07/20/17 23:42	7070517	RLC
Sulfate	380	10	0.17	mg/L	EPA 300.0		10	07/20/17 16:44	07/21/17 14:06	7070517	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:30	7070414	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:30	7070414	CSW
Barium	0.0199	0.0100	0.0004	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:30	7070414	CSW
Beryllium	0.0027	0.0030	0.00009	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/25/17 17:25	7070414	CSW
Boron	0.987	0.0400	0.0060	mg/L	EPA 6020B		1	07/18/17 10:03	07/25/17 17:25	7070414	CSW
Cadmium	0.0008	0.0010	0.0001	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 22:30	7070414	CSW
Calcium	51.5	25.0	2.02	mg/L	EPA 6020B		50	07/18/17 10:03	07/20/17 22:36	7070414	CSW
Chromium	0.0008	0.0100	0.0005	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 22:30	7070414	CSW
Cobalt	0.0445	0.0100	0.0003	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:30	7070414	CSW
Lead	0.0004	0.0050	0.00007	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 22:30	7070414	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:30	7070414	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:30	7070414	CSW
Thallium	0.00009	0.0010	0.00005	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/20/17 22:30	7070414	CSW
Lithium	0.0114	0.0500	0.0015	mg/L	EPA 6020B	J	1	07/18/17 10:03	07/25/17 17:25	7070414	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 10:30	07/21/17 10:20	7070381	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

July 26, 2017

Attention: Mr. Joju Abraham

Report No.: AAG0388

Project: CCR Event

Client ID: FB-3

Lab Number ID: AAG0388-13

Date/Time Sampled: 7/13/2017 8:30:00AM

Date/Time Received: 7/14/2017 9:55:00AM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C		1	07/20/17 19:30	07/20/17 19:30	7070490	JPT
Inorganic Anions											
Chloride	0.09	0.25	0.02	mg/L	EPA 300.0	J	1	07/20/17 16:44	07/21/17 00:02	7070517	RLC
Fluoride	ND	0.30	0.03	mg/L	EPA 300.0		1	07/20/17 16:44	07/21/17 00:02	7070517	RLC
Sulfate	0.66	1.0	0.02	mg/L	EPA 300.0	J	1	07/20/17 16:44	07/21/17 00:02	7070517	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:42	7070414	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:42	7070414	CSW
Barium	ND	0.0100	0.0004	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:42	7070414	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:42	7070414	CSW
Boron	ND	0.0400	0.0060	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:42	7070414	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:42	7070414	CSW
Calcium	ND	0.500	0.0404	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:42	7070414	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:42	7070414	CSW
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:42	7070414	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:42	7070414	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:42	7070414	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:42	7070414	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:42	7070414	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:42	7070414	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 10:30	07/21/17 10:22	7070381	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 26, 2017

Report No.: AAG0388

Project: CCR Event

Client ID: EB-3

Lab Number ID: AAG0388-14

Date/Time Sampled: 7/13/2017 2:27:00PM

Date/Time Received: 7/14/2017 9:55:00AM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C		1	07/20/17 19:30	07/20/17 19:30	7070490	JPT
Inorganic Anions											
Chloride	0.08	0.25	0.02	mg/L	EPA 300.0	J	1	07/20/17 16:44	07/21/17 00:23	7070517	RLC
Fluoride	ND	0.30	0.03	mg/L	EPA 300.0		1	07/20/17 16:44	07/21/17 00:23	7070517	RLC
Sulfate	0.10	1.0	0.02	mg/L	EPA 300.0	J	1	07/20/17 16:44	07/21/17 00:23	7070517	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:48	7070414	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:48	7070414	CSW
Barium	ND	0.0100	0.0004	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:48	7070414	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:48	7070414	CSW
Boron	ND	0.0400	0.0060	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:48	7070414	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:48	7070414	CSW
Calcium	ND	0.500	0.0404	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:48	7070414	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:48	7070414	CSW
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:48	7070414	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:48	7070414	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:48	7070414	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:48	7070414	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:48	7070414	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	07/18/17 10:03	07/20/17 22:48	7070414	CSW
Mercury	ND	0.00050	0.000041	mg/L	EPA 7470A		1	07/20/17 10:30	07/21/17 10:33	7070381	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 26, 2017

Report No.: AAG0388

General Chemistry - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7070489 - SM 2540 C											
Blank (7070489-BLK1)						Prepared & Analyzed: 07/20/17					
Total Dissolved Solids	ND	25	10	mg/L							
LCS (7070489-BS1)						Prepared & Analyzed: 07/20/17					
Total Dissolved Solids	406	25	10	mg/L	400.00		102	84-108			
Duplicate (7070489-DUP1)						Source: AAG0383-14 Prepared & Analyzed: 07/20/17					
Total Dissolved Solids	2280	25	10	mg/L		2280			0.2	10	
Duplicate (7070489-DUP2)						Source: AAG0387-07 Prepared & Analyzed: 07/20/17					
Total Dissolved Solids	ND	25	10	mg/L		ND				10	
Batch 7070490 - SM 2540 C											
Blank (7070490-BLK1)						Prepared & Analyzed: 07/20/17					
Total Dissolved Solids	ND	25	10	mg/L							
LCS (7070490-BS1)						Prepared & Analyzed: 07/20/17					
Total Dissolved Solids	379	25	10	mg/L	400.00		95	84-108			
Duplicate (7070490-DUP1)						Source: AAG0435-01 Prepared & Analyzed: 07/20/17					
Total Dissolved Solids	117	25	10	mg/L		121			3	10	
Duplicate (7070490-DUP2)						Source: AAG0436-08 Prepared & Analyzed: 07/20/17					
Total Dissolved Solids	ND	25	10	mg/L		ND				10	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 26, 2017

Report No.: AAG0388

Inorganic Anions - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7070516 - EPA 300.0											
Blank (7070516-BLK1)						Prepared: 07/20/17 Analyzed: 07/21/17					
Chloride	ND	0.25	0.02	mg/L							
Fluoride	ND	0.30	0.03	mg/L							
Sulfate	ND	1.0	0.02	mg/L							
LCS (7070516-BS1)						Prepared: 07/20/17 Analyzed: 07/21/17					
Chloride	10.4	0.25	0.02	mg/L	10.020		103	90-110			
Fluoride	10.3	0.30	0.03	mg/L	10.020		103	90-110			
Sulfate	10.5	1.0	0.02	mg/L	10.050		104	90-110			
Matrix Spike (7070516-MS1)						Source: AAG0387-05					
Prepared: 07/20/17 Analyzed: 07/21/17											
Chloride	15.4	0.25	0.02	mg/L	10.020	5.39	100	90-110			
Fluoride	10.3	0.30	0.03	mg/L	10.020	ND	102	90-110			
Sulfate	125	1.0	0.02	mg/L	10.050	129	NR	90-110			QM-02
Matrix Spike (7070516-MS2)						Source: AAG0388-05					
Prepared: 07/20/17 Analyzed: 07/21/17											
Chloride	30.0	0.25	0.02	mg/L	10.020	21.2	87	90-110			QM-02
Fluoride	12.0	0.30	0.03	mg/L	10.020	0.20	117	90-110			QM-05
Sulfate	170	1.0	0.02	mg/L	10.050	178	NR	90-110			QM-02
Matrix Spike Dup (7070516-MSD1)						Source: AAG0387-05					
Prepared: 07/20/17 Analyzed: 07/21/17											
Chloride	15.4	0.25	0.02	mg/L	10.020	5.39	100	90-110	0.2	15	
Fluoride	10.1	0.30	0.03	mg/L	10.020	ND	101	90-110	1	15	
Sulfate	125	1.0	0.02	mg/L	10.050	129	NR	90-110	0.3	15	QM-02
Batch 7070517 - EPA 300.0											
Blank (7070517-BLK1)						Prepared & Analyzed: 07/20/17					
Chloride	ND	0.25	0.02	mg/L							
Fluoride	ND	0.30	0.03	mg/L							
Sulfate	ND	1.0	0.02	mg/L							



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 26, 2017

Report No.: AAG0388

Inorganic Anions - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7070517 - EPA 300.0											
LCS (7070517-BS1)						Prepared & Analyzed: 07/20/17					
Chloride	10.3	0.25	0.02	mg/L	10.020		102	90-110			
Fluoride	10.1	0.30	0.03	mg/L	10.020		101	90-110			
Sulfate	10.4	1.0	0.02	mg/L	10.050		104	90-110			
Matrix Spike (7070517-MS1)						Source: AAG0434-02 Prepared & Analyzed: 07/20/17					
Chloride	39.3	0.25	0.02	mg/L	10.020	32.7	66	90-110			QM-02
Fluoride	10.5	0.30	0.03	mg/L	10.020	0.20	102	90-110			
Sulfate	99.0	1.0	0.02	mg/L	10.050	99.3	NR	90-110			QM-02
Matrix Spike Dup (7070517-MSD1)						Source: AAG0434-02 Prepared & Analyzed: 07/20/17					
Chloride	39.2	0.25	0.02	mg/L	10.020	32.7	65	90-110	0.2	15	QM-02
Fluoride	10.5	0.30	0.03	mg/L	10.020	0.20	103	90-110	0.3	15	
Sulfate	98.8	1.0	0.02	mg/L	10.050	99.3	NR	90-110	0.2	15	QM-02



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 26, 2017

Report No.: AAG0388

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7070381 - EPA 7470A											
Blank (7070381-BLK1) Prepared: 07/20/17 Analyzed: 07/21/17											
Mercury	ND	0.00050	0.000041	mg/L							
LCS (7070381-BS1) Prepared: 07/20/17 Analyzed: 07/21/17											
Mercury	0.00224	0.00050	0.000041	mg/L	2.5000E-3		89	80-120			
Matrix Spike (7070381-MS1) Source: AAG0388-02 Prepared: 07/20/17 Analyzed: 07/21/17											
Mercury	0.00216	0.00050	0.000041	mg/L	2.5000E-3	ND	86	75-125			
Matrix Spike Dup (7070381-MSD1) Source: AAG0388-02 Prepared: 07/20/17 Analyzed: 07/21/17											
Mercury	0.00214	0.00050	0.000041	mg/L	2.5000E-3	ND	86	75-125	0.6	20	
Post Spike (7070381-PS1) Source: AAG0388-02 Prepared: 07/20/17 Analyzed: 07/21/17											
Mercury	1.53			ug/L	1.6667	0.00632	91	80-120			
Batch 7070414 - EPA 3005A											
Blank (7070414-BLK1) Prepared: 07/18/17 Analyzed: 07/20/17											
Antimony	ND	0.0030	0.0006	mg/L							
Arsenic	ND	0.0050	0.0005	mg/L							
Barium	ND	0.0100	0.0004	mg/L							
Beryllium	ND	0.0030	0.00009	mg/L							
Boron	ND	0.0400	0.0060	mg/L							
Cadmium	ND	0.0010	0.0001	mg/L							
Calcium	ND	0.500	0.0404	mg/L							
Chromium	ND	0.0100	0.0005	mg/L							
Cobalt	ND	0.0100	0.0003	mg/L							
Copper	0.0004	0.0250	0.0003	mg/L							J
Lead	ND	0.0050	0.00007	mg/L							
Molybdenum	ND	0.0100	0.0010	mg/L							
Nickel	ND	0.0100	0.0005	mg/L							
Selenium	ND	0.0100	0.0018	mg/L							
Silver	ND	0.0100	0.0002	mg/L							
Thallium	ND	0.0010	0.00005	mg/L							
Vanadium	ND	0.0100	0.0012	mg/L							
Zinc	ND	0.0100	0.0012	mg/L							
Lithium	ND	0.0500	0.0015	mg/L							



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 26, 2017

Report No.: AAG0388

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7070414 - EPA 3005A											
LCS (7070414-BS1)						Prepared: 07/18/17 Analyzed: 07/20/17					
Antimony	0.102	0.0030	0.0006	mg/L	0.10000		102	80-120			
Arsenic	0.101	0.0050	0.0005	mg/L	0.10000		101	80-120			
Barium	0.102	0.0100	0.0004	mg/L	0.10000		102	80-120			
Beryllium	0.105	0.0030	0.00009	mg/L	0.10000		105	80-120			
Boron	1.11	0.0400	0.0060	mg/L	1.0000		111	80-120			
Cadmium	0.101	0.0010	0.0001	mg/L	0.10000		101	80-120			
Calcium	1.05	0.500	0.0404	mg/L	1.0000		105	80-120			
Chromium	0.108	0.0100	0.0005	mg/L	0.10000		108	80-120			
Cobalt	0.104	0.0100	0.0003	mg/L	0.10000		104	80-120			
Copper	0.100	0.0250	0.0003	mg/L	0.10000		100	80-120			
Lead	0.103	0.0050	0.00007	mg/L	0.10000		103	80-120			
Molybdenum	0.104	0.0100	0.0010	mg/L	0.10000		104	80-120			
Nickel	0.104	0.0100	0.0005	mg/L	0.10000		104	80-120			
Selenium	0.102	0.0100	0.0018	mg/L	0.10000		102	80-120			
Silver	0.104	0.0100	0.0002	mg/L	0.10000		104	80-120			
Thallium	0.102	0.0010	0.00005	mg/L	0.10000		102	80-120			
Vanadium	0.107	0.0100	0.0012	mg/L	0.10000		107	80-120			
Zinc	0.103	0.0100	0.0012	mg/L	0.10000		103	80-120			
Lithium	0.107	0.0500	0.0015	mg/L	0.10000		107	80-120			
Matrix Spike (7070414-MS1)						Source: AAG0387-10 Prepared: 07/18/17 Analyzed: 07/20/17					
Antimony	0.101	0.0030	0.0006	mg/L	0.10000	ND	101	75-125			
Arsenic	0.106	0.0050	0.0005	mg/L	0.10000	0.0011	105	75-125			
Barium	0.119	0.0100	0.0004	mg/L	0.10000	0.0365	83	75-125			
Beryllium	0.0931	0.0030	0.00009	mg/L	0.10000	ND	93	75-125			
Boron	2.53	0.0400	0.0060	mg/L	1.0000	1.62	91	75-125			
Cadmium	0.103	0.0010	0.0001	mg/L	0.10000	ND	103	75-125			
Calcium	84.8	25.0	2.02	mg/L	1.0000	83.7	108	75-125			
Chromium	0.104	0.0100	0.0005	mg/L	0.10000	ND	104	75-125			
Cobalt	0.130	0.0100	0.0003	mg/L	0.10000	0.0265	104	75-125			
Copper	0.0959	0.0250	0.0003	mg/L	0.10000	ND	96	75-125			
Lead	0.0983	0.0050	0.00007	mg/L	0.10000	ND	98	75-125			
Molybdenum	0.107	0.0100	0.0010	mg/L	0.10000	0.0015	105	75-125			
Nickel	0.107	0.0100	0.0005	mg/L	0.10000	0.0054	101	75-125			
Selenium	0.108	0.0100	0.0018	mg/L	0.10000	ND	108	75-125			
Silver	0.0956	0.0100	0.0002	mg/L	0.10000	ND	96	75-125			
Thallium	0.101	0.0010	0.00005	mg/L	0.10000	ND	101	75-125			
Vanadium	0.110	0.0100	0.0012	mg/L	0.10000	ND	110	75-125			
Zinc	0.106	0.0100	0.0012	mg/L	0.10000	0.0040	102	75-125			
Lithium	0.107	0.0500	0.0015	mg/L	0.10000	0.0104	96	75-125			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 26, 2017

Report No.: AAG0388

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7070414 - EPA 3005A											
Matrix Spike Dup (7070414-MSD1)			Source: AAG0387-10			Prepared: 07/18/17 Analyzed: 07/20/17					
Antimony	0.104	0.0030	0.0006	mg/L	0.10000	ND	104	75-125	3	20	
Arsenic	0.104	0.0050	0.0005	mg/L	0.10000	0.0011	103	75-125	2	20	
Barium	0.122	0.0100	0.0004	mg/L	0.10000	0.0365	86	75-125	2	20	
Beryllium	0.0866	0.0030	0.00009	mg/L	0.10000	ND	87	75-125	7	20	
Boron	2.45	0.0400	0.0060	mg/L	1.0000	1.62	83	75-125	3	20	
Cadmium	0.0971	0.0010	0.0001	mg/L	0.10000	ND	97	75-125	6	20	
Calcium	89.3	25.0	2.02	mg/L	1.0000	83.7	557	75-125	5	20	QM-02
Chromium	0.103	0.0100	0.0005	mg/L	0.10000	ND	103	75-125	0.9	20	
Cobalt	0.127	0.0100	0.0003	mg/L	0.10000	0.0265	100	75-125	3	20	
Copper	0.0921	0.0250	0.0003	mg/L	0.10000	ND	92	75-125	4	20	
Lead	0.0944	0.0050	0.00007	mg/L	0.10000	ND	94	75-125	4	20	
Molybdenum	0.107	0.0100	0.0010	mg/L	0.10000	0.0015	106	75-125	0.8	20	
Nickel	0.103	0.0100	0.0005	mg/L	0.10000	0.0054	98	75-125	3	20	
Selenium	0.107	0.0100	0.0018	mg/L	0.10000	ND	107	75-125	0.3	20	
Silver	0.0963	0.0100	0.0002	mg/L	0.10000	ND	96	75-125	0.7	20	
Thallium	0.0964	0.0010	0.00005	mg/L	0.10000	ND	96	75-125	5	20	
Vanadium	0.107	0.0100	0.0012	mg/L	0.10000	ND	107	75-125	3	20	
Zinc	0.101	0.0100	0.0012	mg/L	0.10000	0.0040	97	75-125	5	20	
Lithium	0.101	0.0500	0.0015	mg/L	0.10000	0.0104	90	75-125	6	20	

Post Spike (7070414-PS1)			Source: AAG0387-10			Prepared: 07/18/17 Analyzed: 07/20/17					
Antimony	102			ug/L	100.00	0.433	101	80-120			
Arsenic	104			ug/L	100.00	1.05	102	80-120			
Barium	122			ug/L	100.00	36.5	86	80-120			
Beryllium	88.6			ug/L	100.00	0.0154	89	80-120			
Boron	2520			ug/L	1000.0	1620	90	80-120			
Cadmium	99.5			ug/L	100.00	0.0284	99	80-120			
Calcium	83200			ug/L	1000.0	83700	NR	80-120			QM-02
Chromium	101			ug/L	100.00	0.357	101	80-120			
Cobalt	123			ug/L	100.00	26.5	97	80-120			
Copper	92.0			ug/L	100.00	0.184	92	80-120			
Lead	94.2			ug/L	100.00	0.0118	94	80-120			
Molybdenum	109			ug/L	100.00	1.54	107	80-120			
Nickel	102			ug/L	100.00	5.37	96	80-120			
Selenium	105			ug/L	100.00	0.612	104	80-120			
Silver	95.9			ug/L	100.00	0.0028	96	80-120			
Thallium	95.6			ug/L	100.00	0.0057	96	80-120			
Vanadium	107			ug/L	100.00	0.726	107	80-120			
Zinc	103			ug/L	100.00	3.98	99	80-120			
Lithium	104			ug/L	100.00	10.4	94	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

July 26, 2017

Legend

Definition of Laboratory Terms

- ND** - Not Detected at levels equal to or greater than the MDL
BRL - Not Detected at levels equal to or greater than the RL
RL - Reporting Limit **MDL** - Method Detection Limit
SOP - Method run per Pace Standard Operating Procedure
CFU - Colony Forming Units
DF - Dilution Factor **TIC** - Tentatively Identified Compound

Sample Information

N-Nitrosodiphenylamine breaks down to diphenylamine in the GCMS; both analytes are reported as N-Nitrosodiphenylamine. Pace is not NELAC certified for N-Nitrosodiphenylamine.

Phthalic acid and phthalic anhydride are reported as dimethyl phthalate

Maleic acid and maleic anhydride are reported as dimethyl malate

1,2-Diphenylhydrazine breaks down to azobenzene in the GCMS; both analytes are reported as azobenzene

Definition of Qualifiers

- QM-05** The spike recovery was outside acceptance limits for the MS and/or MSD and/or PDS due to suspected matrix interference. Sample results for the QC batch were accepted based on acceptable LCS recoveries.
- QM-02** The spike recovery is outside acceptance limits due to insignificant spike amount as compared to sample concentration.
- J** Estimated value less than Reporting Limit (RL) but greater than Method Detection Limit(MDL) (CLP J-Flag).

Note: Unless otherwise noted, all results are reported on an as received basis.



CHAIN OF CUSTODY RECORD

Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.ashlab.com

CLIENT NAME:				ANALYSIS REQUESTED					CONTAINER TYPE		PRESERVATION
CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER:				CONTAINER TYPE:			P		P	P	P
REPORT TO:				# of			3		7	3	3
REQUESTED COMPLETION DATE:				C O N T A I N E R S							
PROJECT NAME/STATE:											
PROJECT #:				Phase II CCR							
Collection DATE	Collection TIME	MATRIX CODE	SAMPLE IDENTIFICATION								
C	G	R	A	B	CL. F. SO. & TDS (EPA 8020/7470)	Metals App. III & IV (EPA 300.0 & SM 2540C)	Radium 226 & 228 (SW-846 9315/9320)				
07/13/17	0855	GW	x	x	1	1	2				1
07/13/17	0905	GW	x	x	1	1	4				2
07/13/17	1030	GW	x	x	1	1	2				3
07/13/17	1145	GW	x	x	1	1	2				4
07/13/17	1345	GW	x	x	1	1	2				5
07/13/17	1030	GW	x	x	1	1	2				6
07/13/17	1510	GW	x	x	1	1	2				7
07/13/17	1235	GW	x	x	1	1	2				8
07/13/17	1045	GW	x	x	1	1	2				9
07/13/17	1325	GW	x	x	1	1	2				10
07/13/17	1445	GW	x	x	1	1	2				11
07/13/17	-	GW	x	x	1	1	2				12
07/13/17	0830	W	x	x	1	1	2				13
07/13/17	1427	W	x	x	1	1	2				14
SAMPLED BY AND TITLE:		DATE/TIME:				RELINQUISHED BY:		DATE/TIME:		LAB #:	
Ben Hodges Field Lead		7/13/17 1600								FOR LAB USE ONLY AAG20388	
RECEIVED BY: Mike Norman		DATE/TIME: 7/14/17 0916				RELINQUISHED BY:		DATE/TIME:		Entered into LIMS:	
RECEIVED BY: Mike Norman		DATE/TIME: 7/14/17 0958								Tracking #:	
Checked: Yes/No		Ice/No Ice		Temperature: Min/Max		Custody Seal: Intact/Broken		USPS/FED-EX		CLIENT/OTHER FS	
Yes/No		Yes/No		Min: 2.3 Max:		Intact/Broken		USPS/FED-EX		CLIENT/OTHER FS	
										Cooler ID:	

Sample Condition Upon Receipt



Client Name: GIA Power

Project # AA610388

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: _____

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other _____

Thermometer Used IR-2 Type of Ice: Wet Blue None Samples on ice, cooling process has begun

Cooler Temperature 2.3 Biological Tissue is Frozen: Yes No

Temp should be above freezing to 6°C

Date and initials of person examining contents: 7/14/17 MR

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.	
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.	
Chain of Custody Relinquished:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	3.	
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.	
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.	
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.	
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.	
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.	
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.	
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.	
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.	
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.	
-Includes date/time/ID/Analysis Matrix:			
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.	
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Initial when completed	Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.	
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.	
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.	
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A		
Pace Trip Blank Lot # (if purchased):	_____		

Client Notification/ Resolution:

Field Data Required? Y / N

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: _____

Project Manager Review: _____

Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

LOG-IN CHECKLIST

Printed: 7/17/2017 11:50:58AM

Attn: Mr. Joju Abraham

Client: Georgia Power

Project: CCR Event

Date Received: 07/14/17 09:55

Work Order: AAG0388

Logged In By: Mohammad M. Rahman

OBSERVATIONS

#Samples: 14

#Containers: 58

Minimum Temp(C): 2.3

Maximum Temp(C): 2.3

Custody Seal(s) Used: N/A

CHECKLIST ITEMS

- COC included with Samples YES
- Sample Container(s) Intact YES
- Chain of Custody Complete YES
- Sample Container(s) Match COC YES
- Custody seal Intact N/A
- Temperature in Compliance YES
- Sufficient Sample Volume for Analysis YES
- Zero Headspace Maintained for VOA Analyses YES
- Samples labeled preserved (If Applicable) YES
- Samples received within Allowable Hold Times YES
- Samples Received on Ice YES
- Preservation Confirmed YES

Comments:

August 07, 2017

Ms. Lauren Petty
GA Power
42 Inverness Center Parkway
Birmingham, AL 35242

RE: Project: AAG0388 Plant McDonough
Pace Project No.: 30224380

Dear Ms. Petty:

Enclosed are the analytical results for sample(s) received by the laboratory on July 17, 2017. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Jacquelyn Collins
jacquelyn.collins@pacelabs.com
(724)850-5612
Project Manager

Enclosures



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: AAG0388 Plant McDonough
Pace Project No.: 30224380

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601
L-A-B DOD-ELAP Accreditation #: L2417
Alabama Certification #: 41590
Arizona Certification #: AZ0734
Arkansas Certification
California Certification #: 04222CA
Colorado Certification
Connecticut Certification #: PH-0694
Delaware Certification
Florida/TNI Certification #: E87683
Georgia Certification #: C040
Guam Certification
Hawaii Certification
Idaho Certification
Illinois Certification
Indiana Certification
Iowa Certification #: 391
Kansas/TNI Certification #: E-10358
Kentucky Certification #: 90133
Louisiana DHH/TNI Certification #: LA140008
Louisiana DEQ/TNI Certification #: 4086
Maine Certification #: PA00091
Maryland Certification #: 308
Massachusetts Certification #: M-PA1457
Michigan/PADEP Certification
Missouri Certification #: 235

Montana Certification #: Cert 0082
Nebraska Certification #: NE-05-29-14
Nevada Certification #: PA014572015-1
New Hampshire/TNI Certification #: 2976
New Jersey/TNI Certification #: PA 051
New Mexico Certification #: PA01457
New York/TNI Certification #: 10888
North Carolina Certification #: 42706
North Dakota Certification #: R-190
Oregon/TNI Certification #: PA200002
Pennsylvania/TNI Certification #: 65-00282
Puerto Rico Certification #: PA01457
Rhode Island Certification #: 65-00282
South Dakota Certification
Tennessee Certification #: TN2867
Texas/TNI Certification #: T104704188-14-8
Utah/TNI Certification #: PA014572015-5
USDA Soil Permit #: P330-14-00213
Vermont Dept. of Health: ID# VT-0282
Virgin Island/PADEP Certification
Virginia/VELAP Certification #: 460198
Washington Certification #: C868
West Virginia DEP Certification #: 143
West Virginia DHHR Certification #: 9964C
Wisconsin Certification
Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: AAG0388 Plant McDonough
Pace Project No.: 30224380

Lab ID	Sample ID	Matrix	Date Collected	Date Received
30224380001	DGWC-22	Water	07/13/17 08:55	07/17/17 09:30
30224380002	DGWC-37	Water	07/13/17 09:05	07/17/17 09:30
30224380003	DGWC-38	Water	07/13/17 10:30	07/17/17 09:30
30224380004	DGWC-39	Water	07/13/17 11:45	07/17/17 09:30
30224380005	DGWC-40	Water	07/13/17 13:45	07/17/17 09:30
30224380006	DGWC-42	Water	07/13/17 10:30	07/17/17 09:30
30224380007	DGWC-47	Water	07/13/17 15:10	07/17/17 09:30
30224380008	DGWC-48	Water	07/13/17 12:35	07/17/17 09:30
30224380009	DGWC-67	Water	07/13/17 10:45	07/17/17 09:30
30224380010	DGWC-68A	Water	07/13/17 13:25	07/17/17 09:30
30224380011	DGWC-69	Water	07/13/17 14:45	07/17/17 09:30
30224380012	FD-3	Water	07/13/17 00:00	07/17/17 09:30
30224380013	FB-3	Water	07/13/17 08:30	07/17/17 09:30
30224380014	EB-3	Water	07/13/17 14:27	07/17/17 09:30

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: AAG0388 Plant McDonough
Pace Project No.: 30224380

Lab ID	Sample ID	Method	Analysts	Analytes Reported
30224380001	DGWC-22	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224380002	DGWC-37	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224380003	DGWC-38	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224380004	DGWC-39	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224380005	DGWC-40	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224380006	DGWC-42	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224380007	DGWC-47	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224380008	DGWC-48	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224380009	DGWC-67	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224380010	DGWC-68A	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224380011	DGWC-69	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224380012	FD-3	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224380013	FB-3	EPA 9315	JC2	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: AAG0388 Plant McDonough

Pace Project No.: 30224380

Lab ID	Sample ID	Method	Analysts	Analytes Reported
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1
30224380014	EB-3	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	RMK	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAG0388 Plant McDonough
Pace Project No.: 30224380

Sample: DGWC-22		Lab ID: 30224380001	Collected: 07/13/17 08:55	Received: 07/17/17 09:30	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.463 ± 0.148 (0.135) C:79% T:NA	pCi/L	07/31/17 11:48	13982-63-3	
Radium-228	EPA 9320	0.675 ± 0.470 (0.893) C:79% T:77%	pCi/L	08/01/17 18:42	15262-20-1	
Total Radium	Total Radium Calculation	1.14 ± 0.618 (1.03)	pCi/L	08/04/17 11:48	7440-14-4	

Sample: DGWC-37		Lab ID: 30224380002	Collected: 07/13/17 09:05	Received: 07/17/17 09:30	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.291 ± 0.123 (0.153) C:76% T:NA	pCi/L	07/31/17 11:48	13982-63-3	
Radium-228	EPA 9320	0.440 ± 0.492 (1.03) C:78% T:83%	pCi/L	08/01/17 18:42	15262-20-1	
Total Radium	Total Radium Calculation	0.731 ± 0.615 (1.18)	pCi/L	08/04/17 11:48	7440-14-4	

Sample: DGWC-38		Lab ID: 30224380003	Collected: 07/13/17 10:30	Received: 07/17/17 09:30	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.429 ± 0.185 (0.167) C:71% T:NA	pCi/L	08/01/17 08:22	13982-63-3	
Radium-228	EPA 9320	0.683 ± 0.432 (0.805) C:81% T:87%	pCi/L	08/01/17 18:42	15262-20-1	
Total Radium	Total Radium Calculation	1.11 ± 0.617 (0.972)	pCi/L	08/04/17 11:48	7440-14-4	

Sample: DGWC-39		Lab ID: 30224380004	Collected: 07/13/17 11:45	Received: 07/17/17 09:30	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.216 ± 0.142 (0.204) C:66% T:NA	pCi/L	08/01/17 08:22	13982-63-3	
Radium-228	EPA 9320	0.301 ± 0.405 (0.864) C:82% T:83%	pCi/L	08/01/17 18:43	15262-20-1	
Total Radium	Total Radium Calculation	0.517 ± 0.547 (1.07)	pCi/L	08/04/17 11:48	7440-14-4	

Sample: DGWC-40		Lab ID: 30224380005	Collected: 07/13/17 13:45	Received: 07/17/17 09:30	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.251 ± 0.137 (0.181) C:87% T:NA	pCi/L	08/01/17 08:22	13982-63-3	
Radium-228	EPA 9320	0.712 ± 0.521 (1.02) C:77% T:79%	pCi/L	08/01/17 18:43	15262-20-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAG0388 Plant McDonough
Pace Project No.: 30224380

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-40 Lab ID: 30224380005 Collected: 07/13/17 13:45 Received: 07/17/17 09:30 Matrix: Water PWS: Site ID: Sample Type:						
Total Radium	Total Radium Calculation	0.963 ± 0.658 (1.20)	pCi/L	08/04/17 11:48	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-42 Lab ID: 30224380006 Collected: 07/13/17 10:30 Received: 07/17/17 09:30 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	0.366 ± 0.168 (0.206) C:84% T:NA	pCi/L	08/01/17 08:22	13982-63-3	
Radium-228	EPA 9320	0.711 ± 0.529 (1.02) C:80% T:68%	pCi/L	08/01/17 18:43	15262-20-1	
Total Radium	Total Radium Calculation	1.08 ± 0.697 (1.23)	pCi/L	08/04/17 11:48	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-47 Lab ID: 30224380007 Collected: 07/13/17 15:10 Received: 07/17/17 09:30 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	0.542 ± 0.202 (0.159) C:78% T:NA	pCi/L	08/01/17 08:22	13982-63-3	
Radium-228	EPA 9320	1.83 ± 0.603 (0.771) C:80% T:86%	pCi/L	08/01/17 18:43	15262-20-1	
Total Radium	Total Radium Calculation	2.37 ± 0.805 (0.930)	pCi/L	08/04/17 11:48	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-48 Lab ID: 30224380008 Collected: 07/13/17 12:35 Received: 07/17/17 09:30 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	0.380 ± 0.158 (0.158) C:91% T:NA	pCi/L	08/01/17 08:22	13982-63-3	
Radium-228	EPA 9320	1.40 ± 0.551 (0.823) C:77% T:85%	pCi/L	08/01/17 18:43	15262-20-1	
Total Radium	Total Radium Calculation	1.78 ± 0.709 (0.981)	pCi/L	08/04/17 11:48	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-67 Lab ID: 30224380009 Collected: 07/13/17 10:45 Received: 07/17/17 09:30 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	0.387 ± 0.185 (0.257) C:79% T:NA	pCi/L	08/01/17 08:22	13982-63-3	
Radium-228	EPA 9320	-0.325 ± 0.456 (1.14) C:85% T:62%	pCi/L	08/01/17 18:43	15262-20-1	
Total Radium	Total Radium Calculation	0.387 ± 0.641 (1.40)	pCi/L	08/04/17 11:48	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAG0388 Plant McDonough
Pace Project No.: 30224380

Sample: DGWC-68A		Lab ID: 30224380010	Collected: 07/13/17 13:25	Received: 07/17/17 09:30	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.304 ± 0.141 (0.152) C:85% T:NA	pCi/L	08/02/17 07:39	13982-63-3	
Radium-228	EPA 9320	-0.363 ± 0.250 (0.653) C:84% T:88%	pCi/L	08/01/17 15:15	15262-20-1	
Total Radium	Total Radium Calculation	0.304 ± 0.391 (0.805)	pCi/L	08/04/17 11:48	7440-14-4	

Sample: DGWC-69		Lab ID: 30224380011	Collected: 07/13/17 14:45	Received: 07/17/17 09:30	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.729 ± 0.223 (0.164) C:89% T:NA	pCi/L	08/02/17 07:39	13982-63-3	
Radium-228	EPA 9320	0.407 ± 0.396 (0.815) C:80% T:80%	pCi/L	08/01/17 15:15	15262-20-1	
Total Radium	Total Radium Calculation	1.14 ± 0.619 (0.979)	pCi/L	08/04/17 11:48	7440-14-4	

Sample: FD-3		Lab ID: 30224380012	Collected: 07/13/17 00:00	Received: 07/17/17 09:30	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.313 ± 0.151 (0.192) C:84% T:NA	pCi/L	08/02/17 07:39	13982-63-3	
Radium-228	EPA 9320	0.306 ± 0.346 (0.726) C:84% T:81%	pCi/L	08/01/17 15:15	15262-20-1	
Total Radium	Total Radium Calculation	0.619 ± 0.497 (0.918)	pCi/L	08/04/17 11:48	7440-14-4	

Sample: FB-3		Lab ID: 30224380013	Collected: 07/13/17 08:30	Received: 07/17/17 09:30	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.186 ± 0.109 (0.135) C:90% T:NA	pCi/L	08/02/17 07:39	13982-63-3	
Radium-228	EPA 9320	-0.276 ± 0.495 (1.18) C:79% T:68%	pCi/L	08/01/17 15:15	15262-20-1	
Total Radium	Total Radium Calculation	0.186 ± 0.604 (1.32)	pCi/L	08/04/17 11:48	7440-14-4	

Sample: EB-3		Lab ID: 30224380014	Collected: 07/13/17 14:27	Received: 07/17/17 09:30	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.117 ± 0.0949 (0.157) C:87% T:NA	pCi/L	08/02/17 07:39	13982-63-3	
Radium-228	EPA 9320	0.0970 ± 0.343 (0.775) C:82% T:79%	pCi/L	08/01/17 15:16	15262-20-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAG0388 Plant McDonough

Pace Project No.: 30224380

Sample: EB-3 **Lab ID: 30224380014** Collected: 07/13/17 14:27 Received: 07/17/17 09:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Total Radium	Total Radium Calculation	0.214 ± 0.438 (0.932)	pCi/L	08/04/17 11:48	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAG0388 Plant McDonough

Pace Project No.: 30224380

QC Batch:	265655	Analysis Method:	EPA 9315
QC Batch Method:	EPA 9315	Analysis Description:	9315 Total Radium
Associated Lab Samples:	30224380001, 30224380002, 30224380003, 30224380004, 30224380005, 30224380006, 30224380007, 30224380008, 30224380009		

METHOD BLANK:	1308235	Matrix:	Water
Associated Lab Samples:	30224380001, 30224380002, 30224380003, 30224380004, 30224380005, 30224380006, 30224380007, 30224380008, 30224380009		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.129 ± 0.100 (0.150) C:93% T:NA	pCi/L	07/31/17 08:58	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAG0388 Plant McDonough

Pace Project No.: 30224380

QC Batch: 265656

Analysis Method: EPA 9315

QC Batch Method: EPA 9315

Analysis Description: 9315 Total Radium

Associated Lab Samples: 30224380010, 30224380011, 30224380012, 30224380013, 30224380014

METHOD BLANK: 1308237

Matrix: Water

Associated Lab Samples: 30224380010, 30224380011, 30224380012, 30224380013, 30224380014

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.258 ± 0.127 (0.131) C:87% T:NA	pCi/L	08/02/17 07:39	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAG0388 Plant McDonough

Pace Project No.: 30224380

QC Batch:	265651	Analysis Method:	EPA 9320
QC Batch Method:	EPA 9320	Analysis Description:	9320 Radium 228
Associated Lab Samples:	30224380001, 30224380002, 30224380003, 30224380004, 30224380005, 30224380006, 30224380007, 30224380008, 30224380009		

METHOD BLANK:	1308224	Matrix:	Water
Associated Lab Samples:	30224380001, 30224380002, 30224380003, 30224380004, 30224380005, 30224380006, 30224380007, 30224380008, 30224380009		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.141 ± 0.341 (0.757) C:82% T:84%	pCi/L	08/01/17 16:09	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAG0388 Plant McDonough

Pace Project No.: 30224380

QC Batch: 265652 Analysis Method: EPA 9320

QC Batch Method: EPA 9320 Analysis Description: 9320 Radium 228

Associated Lab Samples: 30224380010, 30224380011, 30224380012, 30224380013, 30224380014

METHOD BLANK: 1308225 Matrix: Water

Associated Lab Samples: 30224380010, 30224380011, 30224380012, 30224380013, 30224380014

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.363 ± 0.362 (0.747) C:83% T:76%	pCi/L	08/01/17 15:15	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: AAG0388 Plant McDonough

Pace Project No.: 30224380

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

TNTC - Too Numerous To Count

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

WO#: 30224380



Chain of Custody



Workorder: AAG0388

Worker Name: Plant McDonough

Results Requested By: 8/8/2017

Item	Sample ID	Sample Type	Collect Date/Time	Lab ID	Matrix	Preserved Containers	Received By	Date/Time	Date/Time	Comments	
1	DGWC-22	G	7/13/2017 8:55	AAG0388-01	GW	HNO3 2					
2	DGWC-37	G	7/13/2017 9:05	AAG0388-02	GW	4					
3	DGWC-38	G	7/13/2017 10:30	AAG0388-03	GW	2					
4	DGWC-39	G	7/13/2017 11:45	AAG0388-04	GW	2					
5	DGWC-40	G	7/13/2017 13:45	AAG0388-05	GW	2					
6	DGWC-42	G	7/13/2017 10:30	AAG0388-06	GW	2					
7	DGWC-47	G	7/13/2017 15:10	AAG0388-07	GW	2					
8	DGWC-48	G	7/13/2017 12:35	AAG0388-08	GW	2					
9	DGWC-67	G	7/13/2017 10:45	AAG0388-09	GW	2					
10	DGWC-68A	G	7/13/2017 13:25	AAG0388-10	GW	2					
Transfers Released By											
1	M. RAHMAN							Received By	7-17-17	10:30	
2											
3											
Radium 226, 228, Total										X	

Cooler Temperature on Receipt NA °C Custody Seal Y of N Received on Ice Y of N Sample Intact Y or N

***In order to maintain client confidentiality, location/name of the sampling site, sampler's name and signature may not be provided on this COC

This chain of custody is considered complete as is since this information is available in the owner laboratory.

30224380



Chain of Custody

Worker: AAG0388
 Report To: Betsy McDaniel
 Pace Analytical Atlanta
 110 Technology Parkway
 Peachtree Corners, GA 30092
 Phone (770)-734-4200

Workorder Name: Plant McDonough
 Subcontract To: Pace - Pittsburgh
 1638 Roseytown Road
 Stes. 2,3,4
 Greensburg, PA 15601
 Phone (724) 850-5600

Owner Received Date:
 Results Requested By: 8/8/2017

Item	Sample ID	Sample Type	Collect Date/Time	Lab ID	Matrix	Preserved Containers			Date/Time	Received By	Date/Time	Comments									
						NO	H	3													
11	DGWC-69	G	7/13/2017 14:45	AAG0388-11	GW	2															
12	FD-3	G	7/13/2017 0:00	AAG0388-12	GW	2															
13	FB-3	G	7/13/2017 8:30	AAG0388-13	W	2															
14	EB-3	G	7/13/2017 14:27	AAG0388-14	W	2															
15																					
16																					
17																					
18																					
19																					
20																					
Transfers						Released By			Date/Time			Received By			Date/Time			Comments			
1	M. RAHMAN						7/17/17			J. B. ...			7-17-17			Radium 226, 228, Total					
2																					
3																					

Cooler Temperature on Receipt 11.0 °C Custody Seal Y or N Received on Ice Y or N Sample Intact Y or N
 ***In order to maintain client confidentiality, location/name of the sampling site, sampler's name and signature may not be provided on this COC
 This chain of custody is considered complete as is since this information is available in the owner laboratory.

Pace Analytical Services, Inc.
110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
(770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CHAIN OF CUSTODY RECORD

CLIENT NAME: Georgia Power
CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185 Atlanta, GA 30308 404-506-7239
REPORT TO: Dawn Priel (Dawn_Priel@golder.com)
REQUESTED COMPLETION DATE:
PROJECT NAME/STATE: Plant McDonough AP
PROJECT #: Phase II CCR

CONTAINER TYPE	PRESERVATION	ANALYSIS REQUESTED			CONTAINER TYPE	PRESERVATION	REMARKS/ADDITIONAL INFORMATION
		P	P	P			
P - PLASTIC	1 - HCl, 56°C	3	7	3			
A - AMBER GLASS	2 - H ₂ SO ₄ , 56°C						
G - CLEAR GLASS	3 - HNO ₃						
V - VOA VIAL	4 - NaOH, 56°C						
S - STERILE	5 - NaOH/ZnAc, 56°C						
O - OTHER	6 - Ne ₂ S ₂ O ₈ , 56°C						
	7 - 56°C not frozen						
MATRIX CODES:							
DW - DRINKING WATER	S - SOIL						
WW - WASTEWATER	SL - SLUDGE						
GW - GROUNDWATER	SD - SOLID						
SW - SURFACE WATER	A - AIR						
ST - STORM WATER	L - LIQUID						
W - WATER	P - PRODUCT						

CONTAINER TYPE	PRESERVATION	# of	RELINQUISHED BY:	DATE/TIME:	RELINQUISHED BY:	DATE/TIME:	CLIENT	COOLER ID:	OTHER FS
Meats App. III & IV (FA 6020/7470)	Meats App. III & IV (FA 6020/7470)	1	1	1	1	1			
CL, F, SO, & TDS (FA 308.0 & SM 2540C)	CL, F, SO, & TDS (FA 308.0 & SM 2540C)	1	1	1	1	1			
Radium 226 & 228 (SW-648 9315/9320)	Radium 226 & 228 (SW-648 9315/9320)	2	2	2	2	2			
DGWC-22	DGWC-22	4	4	4	4	4			
DGWC-37	DGWC-37	4	4	4	4	4			
DGWC-38	DGWC-38	4	4	4	4	4			
DGWC-39	DGWC-39	4	4	4	4	4			
DGWC-40	DGWC-40	4	4	4	4	4			
DGWC-42	DGWC-42	4	4	4	4	4			
DGWC-47	DGWC-47	4	4	4	4	4			
DGWC-48	DGWC-48	4	4	4	4	4			
DGWC-67	DGWC-67	4	4	4	4	4			
DGWC-68A	DGWC-68A	4	4	4	4	4			
DGWC-69	DGWC-69	4	4	4	4	4			
FD-3	FD-3	4	4	4	4	4			
FB-3	FB-3	4	4	4	4	4			
EB-3	EB-3	4	4	4	4	4			

LAB #: **AA60388**
 Entered into LIMS: **MR**
 Tracking #:

RECEIVED BY LAB: **Ben Hodges**
 RECEIVED BY: **Pete Nayan**
 DATE/TIME: **7/13/17 1600**
 DATE/TIME: **7/14/17 0916**
 DATE/TIME: **7/14/17 0955**
 Temperature: **21.3** Min: **21.3** Max:
 Yes No NA Yes No NA Yes No NA
 Intact Broken Not Sealed
 USPS COURIER # 8-Coefitf
 SAMPLE SHIPPED VIA: **USPS**
 CUSTODY SEAL: **NA**
 CLIENT: **Pace**
 COOLER ID: **NA**
 OTHER FS: **NA**

Sample Condition Upon Receipt

30224380



Client Name: GIA Power

Project # AA610388

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: _____

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other _____

Thermometer Used IR-2 Type of Ice: Wet Blue None

Cooler Temperature 2.3 Biological Tissue is Frozen: Yes No

Temp should be above freezing to 6°C

Optional: Product Date Pro Name

Samples on Ice, cooling process has begun

Date and Initials of person examining contents: 7/14/17 MR

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.	
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.	
Chain of Custody Relinquished:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	3.	
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.	
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.	
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.	
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.	
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.	
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.	
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.	
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.	
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.	
-Includes date/time/ID/Analysis Matrix:			
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.	
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Initial when completed	Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.	
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.	
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.	
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A		
Pace Trip Blank Lot # (if purchased):			

Client Notification/ Resolution: _____ Date/Time: _____ Field Data Required? Y / N

Person Contacted: _____

Comments/ Resolution: _____

Project Manager Review: _____ Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

F-ALLC003rev.3, 11 September 2008

Sample Condition Upon Receipt Pittsburgh

30224380

Pace Analytical

Client Name: Pace, GA

Project # _____

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: 7413 6657 2151

Label	<u>AML</u>
LIMS Login	<u>BLM</u>

Custody Seal on Cooler/Box Present: yes no Seals Intact: yes no

Thermometer Used N/A Type of Ice: Wet Blue None

Cooler Temperature _____ Observed Temp _____ °C Correction Factor: _____ °C Final Temp: _____ °C
Temp should be above freezing to 6°C

Date and initials of person examining contents: AML 7-17-17

Comments:	Yes	No	N/A	
Chain of Custody Present:	X			1.
Chain of Custody Filled Out:	X			2.
Chain of Custody Relinquished:	X			3.
Sampler Name & Signature on COC:	X			4.
Sample Labels match COC:	X			6.
-Includes date/time/ID Matrix: <u>WT</u>				
Samples Arrived within Hold Time:	X			8.
Short Hold Time Analysis (<72hr remaining):		X		7.
Rush Turn Around Time Requested:		X		8.
Sufficient Volume:	X			9.
Correct Containers Used:	X			10.
-Pace Containers Used:	X			
Containers Intact:	X			11.
Orthophosphate field filtered			X	12.
Organic Samples checked for dechlorination:			X	13.
Filtered volume received for Dissolved tests			X	14.
All containers have been checked for preservation.	X			15.
All containers needing preservation are found to be in compliance with EPA recommendation.	X			<u>PHL2</u>
exceptions: VOA, coliform, TOC, O&G, Phenolics				Initial when completed <u>AML</u> Date/time of preservation _____
				Lot # of added preservative _____
Headspace in VOA Vials (>6mm):			X	16.
Trip Blank Present:		X		17.
Trip Blank Custody Seals Present			X	
Rad Aqueous Samples Screened > 0.5 mrem/hr		X		Initial when completed: <u>AML</u> Date: <u>7-17-17</u>

Client Notification/ Resolution:

Person Contacted: _____ Date/Time: _____ Contacted By: _____


Comments/ Resolution: _____

A check in this box indicates that additional information has been stored in reports.

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

*PM review is documented electronically in LIMS. When the Project Manager closes the SRF Review schedule in LIMS. The review is in the Status section of the Workorder Edit Screen.

Quality Control Sample Performance Assessment



Analyst **Must Manually Enter All Fields Highlighted in Yellow.**

Test: Ra-228
Analyst: VAL
Date: 7/26/2017
Worklist: 36801
Matrix: DW

Method Blank Assessment

MB Sample ID: 1308224
MB concentration: 0.141
MB Counting Uncertainty: 0.340
MB MDC: 0.757
MB Numerical Performance Indicator: 0.81
MB Status vs Numerical Indicator: N/A
MB Status vs MDC: Pass

Laboratory Control Sample Assessment

LCSD (Y or N)?	Y
LCSD36801	8/1/2017
Count Date:	17-005
Spike I.D.:	23.910
Spike Concentration (pCi/mL):	0.20
Volume Used (mL):	0.802
Aliquot Volume (L, g, F):	5.965
Target Conc. (pCi/L, g, F):	0.429
Uncertainty (Calculated):	6.521
Result (pCi/L, g, F):	1.36
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.679
Numerical Performance Indicator:	105.83%
Percent Recovery:	N/A
Status vs Numerical Indicator:	Pass
Status vs Recovery:	Pass

Duplicate Sample Assessment

Sample I.D.:	LCS36801
Duplicate Sample I.D.:	LCS36801
Sample Result (pCi/L, g, F):	6.314
Sample Result Counting Uncertainty (pCi/L, g, F):	0.746
Sample Duplicate Result (pCi/L, g, F):	6.521
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.679
Are sample and/or duplicate results below MDC?	NO
Duplicate Numerical Performance Indicator:	-0.404
(Based on the LCS/LCSD Percent Recoveries) Duplicate RPD:	3.25%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Pass

Enter Duplicate sample IDs if other than LCS/LCSD in the space below.

Sample Matrix Spike Control Assessment

Sample Collection Date:
Sample I.D.
Sample MS I.D.
Sample MSD I.D.
Spike I.D.:

MS/MSD Decay Corrected Spike Concentration (pCi/mL):
Spike Volume Used in MS (mL):
Spike Volume Used in MSD (mL):
MS Aliquot (L, g, F):
MS Target Conc. (pCi/L, g, F):
MSD Aliquot (L, g, F):
MSD Target Conc. (pCi/L, g, F):
Spike uncertainty (calculated):

Sample Result:
Sample Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Sample Matrix Spike Duplicate Counting Uncertainty (pCi/L, g, F):
MS Numerical Performance Indicator:
MSD Numerical Performance Indicator:
MS Percent Recovery:
MSD Percent Recovery:
MS Status vs Numerical Indicator:
MSD Status vs Numerical Indicator:
MS Status vs Recovery:
MSD Status vs Recovery:

Matrix Spike/Matrix Spike Duplicate Sample Assessment

Sample I.D.
Sample MS I.D.
Sample MSD I.D.


Sample Matrix Spike Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Sample Matrix Spike Duplicate Counting Uncertainty (pCi/L, g, F):
Duplicate Numerical Performance Indicator:
MS/MSD Duplicate RPD:
MS/MSD Duplicate Status vs Numerical Indicator:
MS/MSD Duplicate Status vs RPD:

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

28/7/17

Quality Control Sample Performance Assessment



Test: Ra-228
Analyst: VAL
Date: 7/26/2017
Worklist: 36802
Matrix: DW

Analyst Must Manually Enter All Fields Highlighted in Yellow.

Sample Matrix Spike Control Assessment	
Sample Collection Date:	7/13/2017
Sample I.D.:	30224381008
Sample MS I.D.:	30224381008MS
Sample MSD I.D.:	
Spike I.D.:	17-005
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	24.062
Spike Volume Used in MS (mL):	0.30
MS Aliquot (L, g, F):	0.814
MS Target Conc. (pCi/L, g, F):	8.865
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	0.638
Sample Result:	0.094
Sample Result Counting Uncertainty (pCi/L, g, F):	0.295
Sample Matrix Spike Result:	9.451
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	0.859
Sample Matrix Spike Duplicate Result:	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	0.869
MSD Numerical Performance Indicator:	
MS Percent Recovery:	105.55%
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	N/A
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	Pass
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
(Based on the Percent Recoveries) MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	

Method Blank Assessment	
MB Sample ID	1308225
MB concentration:	0.363
M/B Counting Uncertainty:	0.356
MB MDC:	0.747
MB Numerical Performance Indicator:	2.00
MB Status vs Numerical Indicator:	N/A
MB Status vs MDC:	Pass

Laboratory Control Sample Assessment	
LCSD (Y or N)?	N
LCSD36802	LCSD36802
Count Date:	8/1/2017
Spike I.D.:	17-005
Spike Concentration (pCi/mL):	23.910
Volume Used (mL):	0.20
Aliquot Volume (L, g, F):	0.809
Target Conc. (pCi/L, g, F):	5.912
Uncertainty (Calculated):	0.426
Result (pCi/L, g, F):	5.066
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.651
Numerical Performance Indicator:	-2.13
Percent Recovery:	85.68%
Status vs Numerical Indicator:	N/A
Status vs Recovery:	Pass

Duplicate Sample Assessment	
Sample I.D.:	
Duplicate Sample I.D.:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Duplicate Result (pCi/L, g, F):	
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Are sample and/or duplicate results below MDC?	See Below ##
Duplicate Numerical Performance Indicator:	
Duplicate RPD:	
Duplicate Status vs Numerical Indicator:	
Duplicate Status vs RPD:	

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

Handwritten signature/initials

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: JC2
Date: 7/27/2017
Worklist: 36805
Matrix: DW

Method Blank Assessment

MB Sample ID: 1308235
MB Concentration: 0.129
MB Counting Uncertainty: 0.099
MB MDC: 0.150
MB Numerical Performance Indicator: 2.56
MB Status vs Numerical Indicator: N/A
MB Status vs MDC: Pass

Laboratory Control Sample Assessment

LCSD (Y or N)? N
LCS36805
LCS36805

Count Date: 8/1/2017
Spike I.D.: 17-030
Spike Concentration (pCi/mL): 80.197
Volume Used (mL): 0.10
Aliquot Volume (L, g, F): 0.512
Target Conc. (pCi/L, g, F): 15.671
Uncertainty (Calculated): 1.444
Result (pCi/L, g, F): 12.371
LCS/LCSD Counting Uncertainty (pCi/L, g, F): 0.808
Numerical Performance Indicator: -3.91
Percent Recovery: 78.94%
Status vs Numerical Indicator: N/A
Status vs Recovery: Pass

Duplicate Sample Assessment

Sample I.D.: 30224380002
Duplicate Sample I.D.: 30224380002DUP
Sample Result (pCi/L, g, F): 0.291
Sample Result Counting Uncertainty (pCi/L, g, F): 0.115
Sample Duplicate Result (pCi/L, g, F): 0.341
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F): 0.158
Are sample and/or duplicate results below MDC? See Below #
Duplicate Numerical Performance Indicator: -0.502
Duplicate RPD: 15.83%
Duplicate Status vs Numerical Indicator: N/A
Duplicate Status vs RPD: Pass

Enter Duplicate sample IDs if other than LCS/LCSD in the space below.
30224380002
30224380002DUP

Sample Matrix Spike Control Assessment

Sample Collection Date:
Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Spike I.D.:
MS/MSD Decay Corrected Spike Concentration (pCi/mL):
Spike Volume Used in MS (mL):
Spike Volume Used in MSD (mL):
MS Aliquot (L, g, F):
MS Target Conc. (pCi/L, g, F):
MSD Aliquot (L, g, F):
MSD Target Conc. (pCi/L, g, F):
Spike uncertainty (calculated):
Sample Result: Sample Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Result: Sample Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
MS Numerical Performance Indicator: MS Numerical Performance Indicator:
MS Percent Recovery: MS Percent Recovery:
MS Status vs Numerical Indicator: MS Status vs Numerical Indicator:
MSD Status vs Numerical Indicator: MSD Status vs Numerical Indicator:
MSD Status vs Recovery: MSD Status vs Recovery:

Matrix Spike/Matrix Spike Duplicate Sample Assessment

Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Sample Matrix Spike Result: Sample Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Matrix Spike Duplicate Result: Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
Duplicate Numerical Performance Indicator: Duplicate Numerical Performance Indicator:
MS/MSD Duplicate Status vs Numerical Indicator: MS/MSD Duplicate Status vs RPD:

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

Handwritten signature/initials

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: JC2
Date: 7/27/2017
Worklist: 36806
Matrix: DW

Method Blank Assessment

MB Sample ID: 1308237
MB concentration: 0.258
MB Counting Uncertainty: 0.122
MB MDC: 0.131
MB Numerical Performance Indicator: 4.15
MB Status vs Numerical Indicator: **N/A**
MB Status vs MDC: **See Comment***

Laboratory Control Sample Assessment

LCSD (Y or N)? **N**
LCS36806
LCS36806
Count Date: 8/1/2017
Spike I.D.: 17-030
Spike Concentration (pCi/mL): 80.197
Volume Used (mL): 0.10
Aliquot Volume (L, g, F): 0.510
Target Conc. (pCi/L, g, F): 15.726
Uncertainty (Calculated): 1.449
Result (pCi/L, g, F): 13.513
LCS/LCSD Counting Uncertainty (pCi/L, g, F): 0.592
Numerical Performance Indicator: -2.77
Percent Recovery: 85.92%
Status vs Numerical Indicator: **N/A**
Status vs Recovery: **Pass**

Sample Matrix Spike Control Assessment

Sample Collection Date:
Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Spike I.D.:
MS/MSD Decay Corrected Spike Concentration (pCi/mL):
Spike Volume Used in MS (mL):
Spike Volume Used in MSD (mL):
MS Aliquot (L, g, F):
MS Target Conc. (pCi/L, g, F):
MSD Aliquot (L, g, F):
MSD Target Conc. (pCi/L, g, F):
Spike uncertainty (calculated):
Sample Result:
Sample Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Result:
Sample Matrix Spike Duplicate Result:
Sample Matrix Spike Duplicate Result:
MS Numerical Performance Indicator:
MS Percent Recovery:
MSD Percent Recovery:
MS Status vs Numerical Indicator:
MSD Status vs Numerical Indicator:
MS Status vs Recovery:
MSD Status vs Recovery:

Duplicate Sample Assessment

Sample I.D.: 30224381007
Duplicate Sample I.D.: 30224381007DUP
Sample Result (pCi/L, g, F): 0.481
Sample Duplicate Result (pCi/L, g, F): 0.165
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F): 0.436
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F): 0.118
Are sample and/or duplicate results below MDC? See Below ##
Duplicate Numerical Performance Indicator: 0.440
Duplicate RPD: 9.91%
Duplicate Status vs Numerical Indicator: **N/A**
Duplicate Status vs RPD: **Pass**

Enter Duplicate sample IDs if other than LCS/LCSD in the space below.
30224381007
30224381007DUP

Matrix Spike/Matrix Spike Duplicate Sample Assessment

Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Sample Matrix Spike Result:
Sample Matrix Spike Duplicate Result:
Sample Matrix Spike Duplicate Result:
Duplicate Numerical Performance Indicator:
MS/MSD Duplicate RPD:
MS/MSD Duplicate Status vs Numerical Indicator:
MS/MSD Duplicate Status vs RPD:

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:
*The method blank result is below the reporting limit for this analysis and is acceptable.

Handwritten signature/initials

LABORATORY ANALYTICAL DATA

August 2017



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Laboratory Report

Prepared For:

**Georgia Power
2480 Maner Road
Atlanta, GA 30339**

Attention: Mr. Joju Abraham

Report Number: AAH0318


August 16, 2017

Project: CCR Event

Project #:Plant McDonough

We appreciate the opportunity to provide the analytical support for your project. The analytical results in this report are based upon information supplied by you, the client, and are for your exclusive use. If you have any questions regarding this data package, please do not hesitate to call.

Approved:


Signature

This report may not be reproduced, except in full, without written approval from Pace Analytical Services, LLC.
All test results relate only to the samples analyzed.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

August 16, 2017

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
DGWA-70A	AAH0318-01	Ground Water	08/08/17 10:16	08/09/17 09:55
DGWC-68A	AAH0318-02	Ground Water	08/08/17 13:06	08/09/17 09:55
FB-1	AAH0318-03	Water	08/08/17 10:55	08/09/17 09:55
EB-1	AAH0318-04	Water	08/08/17 11:10	08/09/17 09:55
FD-1	AAH0318-05	Ground Water	08/08/17 00:00	08/09/17 09:55



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

August 16, 2017

Case Narrative

The Radium analysis by methods EPA 9315/9320 was performed by Pace-Pittsburgh, 1638 Roseytown Road - Suites 2, 3, 4, Greensburg PA 15601. The Pace-Pittsburgh lab contact is Jacquelyn Collins at 724-850-5612.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

August 16, 2017

Report No.: AAH0318

Project: CCR Event

Client ID: DGWA-70A

Lab Number ID: AAH0318-01

Date/Time Sampled: 08/08/2017 10:16:00AM

Date/Time Received: 08/09/2017 9:55:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	53	25	10	mg/L	SM 2540 C		1	08/10/17 16:35	08/10/17 16:35	7080277	JPT
Inorganic Anions											
Chloride	2.2	0.25	0.02	mg/L	EPA 300.0	B-01	1	08/15/17 10:06	08/15/17 12:46	7080386	SLH
Fluoride	0.04	0.30	0.03	mg/L	EPA 300.0	J	1	08/15/17 10:06	08/15/17 12:46	7080386	SLH
Sulfate	1.5	1.0	0.02	mg/L	EPA 300.0		1	08/15/17 10:06	08/15/17 12:46	7080386	SLH
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:12	7080271	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:12	7080271	CSW
Barium	0.0277	0.0100	0.0004	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:12	7080271	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:12	7080271	CSW
Boron	ND	0.0400	0.0060	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:12	7080271	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:12	7080271	CSW
Calcium	5.20	2.50	0.202	mg/L	EPA 6020B		5	08/11/17 13:05	08/15/17 13:59	7080271	CSW
Chromium	0.0005	0.0100	0.0005	mg/L	EPA 6020B	J	1	08/11/17 13:05	08/14/17 16:12	7080271	CSW
Cobalt	0.0007	0.0100	0.0003	mg/L	EPA 6020B	J	1	08/11/17 13:05	08/14/17 16:12	7080271	CSW
Lead	0.00007	0.0050	0.00007	mg/L	EPA 6020B	J	1	08/11/17 13:05	08/14/17 16:12	7080271	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:12	7080271	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:12	7080271	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:12	7080271	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:12	7080271	CSW
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	08/15/17 08:40	08/15/17 15:16	7080360	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

August 16, 2017

Report No.: AAH0318

Project: CCR Event

Client ID: DGWC-68A

Lab Number ID: AAH0318-02

Date/Time Sampled: 08/08/2017 1:06:00PM

Date/Time Received: 08/09/2017 9:55:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	278	25	10	mg/L	SM 2540 C		1	08/10/17 16:35	08/10/17 16:35	7080277	JPT
Inorganic Anions											
Chloride	4.2	0.25	0.02	mg/L	EPA 300.0	B-01	1	08/15/17 10:06	08/15/17 13:48	7080386	SLH
Fluoride	0.11	0.30	0.03	mg/L	EPA 300.0	J	1	08/15/17 10:06	08/15/17 13:48	7080386	SLH
Sulfate	48	1.0	0.02	mg/L	EPA 300.0		1	08/15/17 10:06	08/15/17 13:48	7080386	SLH
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:23	7080271	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:23	7080271	CSW
Barium	0.0852	0.0100	0.0004	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:23	7080271	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:23	7080271	CSW
Boron	2.10	2.00	0.298	mg/L	EPA 6020B		50	08/11/17 13:05	08/14/17 16:29	7080271	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:23	7080271	CSW
Calcium	46.3	25.0	2.02	mg/L	EPA 6020B		50	08/11/17 13:05	08/14/17 16:29	7080271	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:23	7080271	CSW
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:23	7080271	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:23	7080271	CSW
Molybdenum	0.207	0.0100	0.0010	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:23	7080271	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:23	7080271	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:23	7080271	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:23	7080271	CSW
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	08/15/17 08:40	08/15/17 15:18	7080360	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

August 16, 2017

Report No.: AAH0318

Project: CCR Event

Client ID: FB-1

Lab Number ID: AAH0318-03

Date/Time Sampled: 08/08/2017 10:55:00AM

Date/Time Received: 08/09/2017 9:55:00AM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C		1	08/10/17 16:35	08/10/17 16:35	7080277	JPT
Inorganic Anions											
Chloride	0.08	0.25	0.02	mg/L	EPA 300.0	B-01, J	1	08/15/17 10:06	08/15/17 14:08	7080386	SLH
Fluoride	ND	0.30	0.03	mg/L	EPA 300.0		1	08/15/17 10:06	08/15/17 14:08	7080386	SLH
Sulfate	0.06	1.0	0.02	mg/L	EPA 300.0	J	1	08/15/17 10:06	08/15/17 14:08	7080386	SLH
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:34	7080271	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:34	7080271	CSW
Barium	ND	0.0100	0.0004	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:34	7080271	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:34	7080271	CSW
Boron	ND	0.0400	0.0060	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:34	7080271	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:34	7080271	CSW
Calcium	ND	0.500	0.0404	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:34	7080271	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:34	7080271	CSW
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:34	7080271	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:34	7080271	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:34	7080271	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:34	7080271	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:34	7080271	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:34	7080271	CSW
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	08/15/17 08:40	08/15/17 15:21	7080360	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

August 16, 2017

Report No.: AAH0318

Project: CCR Event

Client ID: EB-1

Lab Number ID: AAH0318-04

Date/Time Sampled: 08/08/2017 11:10:00AM

Date/Time Received: 08/09/2017 9:55:00AM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C		1	08/10/17 16:35	08/10/17 16:35	7080277	JPT
Inorganic Anions											
Chloride	0.08	0.25	0.02	mg/L	EPA 300.0	B-01, J	1	08/15/17 10:06	08/15/17 14:29	7080386	SLH
Fluoride	ND	0.30	0.03	mg/L	EPA 300.0		1	08/15/17 10:06	08/15/17 14:29	7080386	SLH
Sulfate	0.05	1.0	0.02	mg/L	EPA 300.0	J	1	08/15/17 10:06	08/15/17 14:29	7080386	SLH
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:40	7080271	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:40	7080271	CSW
Barium	ND	0.0100	0.0004	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:40	7080271	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:40	7080271	CSW
Boron	ND	0.0400	0.0060	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:40	7080271	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:40	7080271	CSW
Calcium	ND	0.500	0.0404	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:40	7080271	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:40	7080271	CSW
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:40	7080271	CSW
Lead	0.0002	0.0050	0.00007	mg/L	EPA 6020B	J	1	08/11/17 13:05	08/14/17 16:40	7080271	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:40	7080271	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:40	7080271	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:40	7080271	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:40	7080271	CSW
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	08/15/17 08:40	08/15/17 15:23	7080360	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

August 16, 2017

Report No.: AAH0318

Project: CCR Event

Client ID: FD-1

Lab Number ID: AAH0318-05

Date/Time Sampled: 08/08/2017 12:00:00AM

Date/Time Received: 08/09/2017 9:55:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	50	25	10	mg/L	SM 2540 C		1	08/10/17 16:35	08/10/17 16:35	7080277	JPT
Inorganic Anions											
Chloride	2.1	0.25	0.02	mg/L	EPA 300.0	B-01	1	08/15/17 10:06	08/15/17 14:50	7080386	SLH
Fluoride	ND	0.30	0.03	mg/L	EPA 300.0		1	08/15/17 10:06	08/15/17 14:50	7080386	SLH
Sulfate	1.4	1.0	0.02	mg/L	EPA 300.0		1	08/15/17 10:06	08/15/17 14:50	7080386	SLH
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:46	7080271	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:46	7080271	CSW
Barium	0.0278	0.0100	0.0004	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:46	7080271	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:46	7080271	CSW
Boron	ND	0.0400	0.0060	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:46	7080271	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:46	7080271	CSW
Calcium	4.99	0.500	0.0404	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:46	7080271	CSW
Chromium	0.0005	0.0100	0.0005	mg/L	EPA 6020B	J	1	08/11/17 13:05	08/14/17 16:46	7080271	CSW
Cobalt	0.0007	0.0100	0.0003	mg/L	EPA 6020B	J	1	08/11/17 13:05	08/14/17 16:46	7080271	CSW
Lead	0.00007	0.0050	0.00007	mg/L	EPA 6020B	J	1	08/11/17 13:05	08/14/17 16:46	7080271	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:46	7080271	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:46	7080271	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:46	7080271	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	08/11/17 13:05	08/14/17 16:46	7080271	CSW
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	08/15/17 08:40	08/15/17 15:30	7080360	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

August 16, 2017

Report No.: AAH0318

General Chemistry - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7080277 - SM 2540 C											
Blank (7080277-BLK1)						Prepared & Analyzed: 08/10/17					
Total Dissolved Solids	ND	25	10	mg/L							
LCS (7080277-BS1)						Prepared & Analyzed: 08/10/17					
Total Dissolved Solids	407	25	10	mg/L	400.00		102	84-108			
Duplicate (7080277-DUP1)						Source: AAH0318-05 Prepared & Analyzed: 08/10/17					
Total Dissolved Solids	44	25	10	mg/L		50			13	10	QR-03



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

August 16, 2017

Report No.: AAH0318

Inorganic Anions - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7080386 - EPA 300.0											
Blank (7080386-BLK1)						Prepared & Analyzed: 08/15/17					
Chloride	0.05	0.25	0.02	mg/L							J
Fluoride	ND	0.30	0.03	mg/L							
Sulfate	ND	1.0	0.02	mg/L							
LCS (7080386-BS1)						Prepared & Analyzed: 08/15/17					
Chloride	10.2	0.25	0.02	mg/L	10.020		102	90-110			
Fluoride	10.1	0.30	0.03	mg/L	10.020		100	90-110			
Sulfate	10.2	1.0	0.02	mg/L	10.050		102	90-110			
Matrix Spike (7080386-MS1)						Source: AAH0318-01 Prepared & Analyzed: 08/15/17					
Chloride	12.3	0.25	0.02	mg/L	10.020	2.22	100	90-110			
Fluoride	10.3	0.30	0.03	mg/L	10.020	0.04	102	90-110			
Sulfate	11.8	1.0	0.02	mg/L	10.050	1.46	103	90-110			
Matrix Spike Dup (7080386-MSD1)						Source: AAH0318-01 Prepared & Analyzed: 08/15/17					
Chloride	12.3	0.25	0.02	mg/L	10.020	2.22	100	90-110	0.1	15	
Fluoride	10.3	0.30	0.03	mg/L	10.020	0.04	103	90-110	0.4	15	
Sulfate	11.7	1.0	0.02	mg/L	10.050	1.46	102	90-110	0.1	15	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

August 16, 2017

Report No.: AAH0318

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	----	-----	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7080271 - EPA 3005A

Blank (7080271-BLK1)

Prepared: 08/11/17 Analyzed: 08/14/17

Antimony	ND	0.0030	0.0006	mg/L							
Arsenic	ND	0.0050	0.0005	mg/L							
Barium	ND	0.0100	0.0004	mg/L							
Beryllium	ND	0.0030	0.00009	mg/L							
Boron	ND	0.0400	0.0060	mg/L							
Cadmium	ND	0.0010	0.0001	mg/L							
Calcium	ND	0.500	0.0404	mg/L							
Chromium	ND	0.0100	0.0005	mg/L							
Cobalt	ND	0.0100	0.0003	mg/L							
Copper	ND	0.0250	0.0003	mg/L							
Lead	ND	0.0050	0.00007	mg/L							
Molybdenum	ND	0.0100	0.0010	mg/L							
Nickel	ND	0.0100	0.0005	mg/L							
Selenium	ND	0.0100	0.0018	mg/L							
Silver	ND	0.0100	0.0002	mg/L							
Thallium	ND	0.0010	0.00005	mg/L							
Vanadium	ND	0.0100	0.0012	mg/L							
Zinc	ND	0.0100	0.0012	mg/L							
Lithium	ND	0.0500	0.0015	mg/L							

LCS (7080271-BS1)

Prepared: 08/11/17 Analyzed: 08/14/17

Antimony	0.103	0.0030	0.0006	mg/L	0.10000		103	80-120			
Arsenic	0.0991	0.0050	0.0005	mg/L	0.10000		99	80-120			
Barium	0.0989	0.0100	0.0004	mg/L	0.10000		99	80-120			
Beryllium	0.104	0.0030	0.00009	mg/L	0.10000		104	80-120			
Boron	0.992	0.0400	0.0060	mg/L	1.0000		99	80-120			
Cadmium	0.102	0.0010	0.0001	mg/L	0.10000		102	80-120			
Calcium	0.939	0.500	0.0404	mg/L	1.0000		94	80-120			
Chromium	0.103	0.0100	0.0005	mg/L	0.10000		103	80-120			
Cobalt	0.100	0.0100	0.0003	mg/L	0.10000		100	80-120			
Copper	0.103	0.0250	0.0003	mg/L	0.10000		103	80-120			
Lead	0.0971	0.0050	0.00007	mg/L	0.10000		97	80-120			
Molybdenum	0.0999	0.0100	0.0010	mg/L	0.10000		100	80-120			
Nickel	0.101	0.0100	0.0005	mg/L	0.10000		101	80-120			
Selenium	0.0935	0.0100	0.0018	mg/L	0.10000		94	80-120			
Silver	0.0976	0.0100	0.0002	mg/L	0.10000		98	80-120			
Thallium	0.0988	0.0010	0.00005	mg/L	0.10000		99	80-120			
Vanadium	0.101	0.0100	0.0012	mg/L	0.10000		101	80-120			
Zinc	0.103	0.0100	0.0012	mg/L	0.10000		103	80-120			
Lithium	0.101	0.0500	0.0015	mg/L	0.10000		101	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

August 16, 2017

Report No.: AAH0318

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7080271 - EPA 3005A											
Matrix Spike (7080271-MS1)			Source: AAH0231-02			Prepared: 08/11/17 Analyzed: 08/14/17					
Antimony	0.104	0.0030	0.0006	mg/L	0.10000	ND	104	75-125			
Arsenic	0.101	0.0050	0.0005	mg/L	0.10000	0.0009	100	75-125			
Barium	0.136	0.0100	0.0004	mg/L	0.10000	0.0345	102	75-125			
Beryllium	0.104	0.0030	0.00009	mg/L	0.10000	ND	104	75-125			
Boron	1.06	0.0400	0.0060	mg/L	1.0000	0.0598	100	75-125			
Cadmium	0.0990	0.0010	0.0001	mg/L	0.10000	ND	99	75-125			
Calcium	36.3	0.500	0.0404	mg/L	1.0000	37.1	NR	75-125			QM-02
Chromium	0.107	0.0100	0.0005	mg/L	0.10000	0.0008	106	75-125			
Cobalt	0.105	0.0100	0.0003	mg/L	0.10000	ND	105	75-125			
Copper	0.106	0.0250	0.0003	mg/L	0.10000	ND	106	75-125			
Lead	0.0970	0.0050	0.00007	mg/L	0.10000	0.00008	97	75-125			
Molybdenum	0.105	0.0100	0.0010	mg/L	0.10000	ND	105	75-125			
Nickel	0.105	0.0100	0.0005	mg/L	0.10000	0.0007	105	75-125			
Selenium	0.0975	0.0100	0.0018	mg/L	0.10000	ND	97	75-125			
Silver	0.0965	0.0100	0.0002	mg/L	0.10000	ND	97	75-125			
Thallium	0.0999	0.0010	0.00005	mg/L	0.10000	ND	100	75-125			
Vanadium	0.106	0.0100	0.0012	mg/L	0.10000	ND	106	75-125			
Zinc	0.109	0.0100	0.0012	mg/L	0.10000	0.0062	103	75-125			
Lithium	0.117	0.0500	0.0015	mg/L	0.10000	0.0136	104	75-125			
Matrix Spike Dup (7080271-MSD1)			Source: AAH0231-02			Prepared: 08/11/17 Analyzed: 08/14/17					
Antimony	0.103	0.0030	0.0006	mg/L	0.10000	ND	103	75-125	2	20	
Arsenic	0.0993	0.0050	0.0005	mg/L	0.10000	0.0009	98	75-125	2	20	
Barium	0.132	0.0100	0.0004	mg/L	0.10000	0.0345	97	75-125	3	20	
Beryllium	0.0941	0.0030	0.00009	mg/L	0.10000	ND	94	75-125	10	20	
Boron	0.996	0.0400	0.0060	mg/L	1.0000	0.0598	94	75-125	6	20	
Cadmium	0.0997	0.0010	0.0001	mg/L	0.10000	ND	100	75-125	0.7	20	
Calcium	36.5	0.500	0.0404	mg/L	1.0000	37.1	NR	75-125	0.6	20	QM-02
Chromium	0.104	0.0100	0.0005	mg/L	0.10000	0.0008	103	75-125	3	20	
Cobalt	0.105	0.0100	0.0003	mg/L	0.10000	ND	105	75-125	0.7	20	
Copper	0.103	0.0250	0.0003	mg/L	0.10000	ND	103	75-125	2	20	
Lead	0.0936	0.0050	0.00007	mg/L	0.10000	0.00008	93	75-125	4	20	
Molybdenum	0.101	0.0100	0.0010	mg/L	0.10000	ND	101	75-125	4	20	
Nickel	0.104	0.0100	0.0005	mg/L	0.10000	0.0007	103	75-125	1	20	
Selenium	0.0968	0.0100	0.0018	mg/L	0.10000	ND	97	75-125	0.7	20	
Silver	0.0948	0.0100	0.0002	mg/L	0.10000	ND	95	75-125	2	20	
Thallium	0.0972	0.0010	0.00005	mg/L	0.10000	ND	97	75-125	3	20	
Vanadium	0.104	0.0100	0.0012	mg/L	0.10000	ND	104	75-125	2	20	
Zinc	0.103	0.0100	0.0012	mg/L	0.10000	0.0062	96	75-125	6	20	
Lithium	0.105	0.0500	0.0015	mg/L	0.10000	0.0136	92	75-125	11	20	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

August 16, 2017

Report No.: AAH0318

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7080271 - EPA 3005A											
Post Spike (7080271-PS1)			Source: AAH0231-02			Prepared: 08/11/17 Analyzed: 08/14/17					
Antimony	98.6			ug/L	100.00	0.410	98	80-120			
Arsenic	98.8			ug/L	100.00	0.934	98	80-120			
Barium	134			ug/L	100.00	34.5	99	80-120			
Beryllium	98.6			ug/L	100.00	0.0136	99	80-120			
Boron	1030			ug/L	1000.0	59.8	97	80-120			
Cadmium	99.2			ug/L	100.00	0.0038	99	80-120			
Calcium	38600			ug/L	1000.0	37100	149	80-120			QM-02
Chromium	102			ug/L	100.00	0.764	101	80-120			
Cobalt	101			ug/L	100.00	0.218	101	80-120			
Copper	99.8			ug/L	100.00	0.0724	100	80-120			
Lead	94.5			ug/L	100.00	0.0801	94	80-120			
Molybdenum	103			ug/L	100.00	0.464	103	80-120			
Nickel	99.4			ug/L	100.00	0.693	99	80-120			
Selenium	97.1			ug/L	100.00	-0.344	97	80-120			
Silver	96.5			ug/L	100.00	0.0217	96	80-120			
Thallium	98.3			ug/L	100.00	0.0150	98	80-120			
Vanadium	102			ug/L	100.00	-0.327	102	80-120			
Zinc	103			ug/L	100.00	6.21	97	80-120			
Lithium	110			ug/L	100.00	13.6	96	80-120			

Batch 7080360 - EPA 7470A

Blank (7080360-BLK1)					Prepared & Analyzed: 08/15/17						
Mercury	ND	0.00050	0.000036	mg/L							
LCS (7080360-BS1)					Prepared & Analyzed: 08/15/17						
Mercury	0.00246	0.00050	0.000036	mg/L	2.5000E-3		98	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

August 16, 2017

Report No.: AAH0318

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7080360 - EPA 7470A											
Matrix Spike (7080360-MS1)			Source: AAH0318-01			Prepared & Analyzed: 08/15/17					
Mercury	0.00243	0.00050	0.000036	mg/L	2.5000E-3	ND	97	75-125			
Matrix Spike Dup (7080360-MSD1)			Source: AAH0318-01			Prepared & Analyzed: 08/15/17					
Mercury	0.00245	0.00050	0.000036	mg/L	2.5000E-3	ND	98	75-125	0.7	20	
Post Spike (7080360-PS1)			Source: AAH0318-01			Prepared & Analyzed: 08/15/17					
Mercury	1.72			ug/L	1.6667	0.00466	103	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

August 16, 2017

Legend

Definition of Laboratory Terms

- ND** - Not Detected at levels equal to or greater than the MDL
- BRL** - Not Detected at levels equal to or greater than the RL
- RL** - Reporting Limit **MDL** - Method Detection Limit
- SOP** - Method run per Pace Standard Operating Procedure
- CFU** - Colony Forming Units
- DF** - Dilution Factor **TIC** - Tentatively Identified Compound

Sample Information

N-Nitrosodiphenylamine breaks down to diphenylamine in the GCMS; both analytes are reported as N-Nitrosodiphenylamine. Pace is not NELAC certified for N-Nitrosodiphenylamine.

Phthalic acid and phthalic anhydride are reported as dimethyl phthalate

Maleic acid and maleic anhydride are reported as dimethyl malate

1,2-Diphenylhydrazine breaks down to azobenzene in the GCMS; both analytes are reported as azobenzene

Definition of Qualifiers

- QR-03** The RPD value for the sample duplicate or MS/MSD was outside of QC acceptance limits due to suspected matrix interference and/or non-homogeneous sample matrix.
- QM-02** The spike recovery is outside acceptance limits due to insignificant spike amount as compared to sample concentration.
- J** Estimated value less than Reporting Limit (RL) but greater than Method Detection Limit(MDL) (CLP J-Flag).
- B-01** Analyte was detected in the associated method blank at an estimated level equal to or greater than the MDL. Sample values reported as greater than the MDL and less than 10x the method blank value are reported as estimated values.

Note: Unless otherwise noted, all results are reported on an as received basis.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

August 16, 2017

Report Notes

The sample type was not listed on the COC. MMR



Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CHAIN OF CUSTODY RECORD

CLIENT NAME: Georgia Power CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185 Atlanta, GA 30308 404-506-7239		REPORT TO: Dawn Prael (Dawn_Prael@golder.com) REQUESTED COMPLETION DATE: CC: Maria Padilla kiurinko@golder.com PO #: laburch@southernco.com		PROJECT NAME/STATE: Plant McDonough AP PROJECT #: Phase II CCR	
Collection DATE	Collection TIME	MATRIX CODE*	C O M P	G O R A B	SAMPLE IDENTIFICATION
08/08/17	1016	GW			DGWA-70A
08/08/17	1306	GW			DGWC-68A
08/08/17	1055	W			FB-1
08/08/17	1110	W			EB-1
08/08/17	-	GW			FD-1

SAMPLED BY AND TITLE: Kristen Jurinko Golder RECEIVED BY: Mike Noyes	DATE/TIME: 8/9/17 0920 DATE/TIME: 8/17 0920	RELINQUISHED BY: [Signature] RELINQUISHED BY: [Signature]	DATE/TIME: 8/17 0930 DATE/TIME: [Blank]
--	--	--	--

RECEIVED BY LAB: [Signature] Checked: No NA Yes No NA	TEMPERATURE: 8/17/17 0955 Min: 1.3 Max:	SAMPLE SHIPPED VIA: UPS FED-EX USPS COURIER/PHC CLIENT OTHER FS Custody Seal: Intact Broken Not Present # of Coolers:	COOLER ID: [Blank]
---	--	---	------------------------------

CONTAINER TYPE	PRESEVATION
P - PLASTIC	1 - HCl, ≤6°C
A - AMBER GLASS	2 - H ₂ SO ₄ , ≤6°C
G - CLEAR GLASS	3 - HNO ₃
V - VOA VIAL	4 - NaOH, ≤6°C
S - STERILE	5 - NaOH/ZnAc, ≤6°C
O - OTHER	6 - Na ₂ S ₂ O ₃ , ≤6°C
	7 - ≤6°C not frozen

MATRIX CODES:	REMARKS/ADDITIONAL INFORMATION
DW - DRINKING WATER	S - SOIL
WW - WASTEWATER	SL - SLUDGE
GW - GROUNDWATER	SD - SOLID
SW - SURFACE WATER	A - AIR
ST - STORM WATER	L - LIQUID
W - WATER	P - PRODUCT

ANALYSIS REQUESTED	CONTAINER TYPE	PRESEVATION	LAB #
# of			
CONTAINERS			
6		Metals App. III & IV (EPA 6020/7470)	1
4		Cl, F, SO ₄ & TDS (EPA 300.0 & SM 2540C)	2
4		Radium 226 & 228 (SW-846 9315/9320)	3
4			4
4			5

August 2017 Plant McDonough COC Phase II CCR.xlsx



Sample Condition Upon Receipt

Client Name: GIA power Project # AAH0318

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: _____

Optional:
Print Date
Print Name

Custody Seal on Cooler/Box Present: Yes No Seals intact: Yes No

Packing Material: Bubble Wrap Bubble Bags None Other _____

Thermometer Used IR-4 Type of Ice: Wet Blue None Samples on ice, cooling process has begun

Cooler Temperature 1.3 Biological Tissue is Frozen: Yes No
Temp should be above freezing to 6°C

Date and Initials of person examining contents: 8/9/17 MK

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.	
Chain of Custody Filled Out:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	2.	<u>Sample type missing</u>
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.	
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.	
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.	
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.	
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.	
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.	
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.	
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.	
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.	
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.	
-Includes date/time/ID/Analysis Matrix:			
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.	
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
exceptions: VOA, coliform, TOC O&G, WI-DRO (water)	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Initial when completed	Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.	
Headspace in VOA Vials (>6mm)	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.	
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.	
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A		
Pace Trip Blank Lot # (if purchased):			

Client Notification/ Resolution: _____ Field Data Required? Y / N

Person Contacted: _____ Date/Time _____

Comments/ Resolution: _____

Project Manager Review: _____ Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples a copy of this form will be sent to the North Carolina DEHNR Certification Office i.e. out of hold incorrect preservative out of temp incorrect containers



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

LOG-IN CHECKLIST

Printed: 8/10/2017 11:40:23AM

Attn: Mr. Joju Abraham

Client: Georgia Power

Project: CCR Event

Date Received: 08/09/17 09:55

Work Order: AAH0318

Logged In By: Mohammad M. Rahman

OBSERVATIONS

#Samples: 5

#Containers: 22

Minimum Temp(C): 1.3

Maximum Temp(C): 1.3

Custody Seal(s) Used: Yes

CHECKLIST ITEMS

- COC included with Samples YES
- Sample Container(s) Intact YES
- Chain of Custody Complete NO
- Sample Container(s) Match COC YES
- Custody seal Intact YES
- Temperature in Compliance YES
- Sufficient Sample Volume for Analysis YES
- Zero Headspace Maintained for VOA Analyses YES
- Samples labeled preserved (If Applicable) YES
- Samples received within Allowable Hold Times YES
- Samples Received on Ice YES
- Preservation Confirmed YES

Comments:

The sample type was not listed on the COC. MMR

September 01, 2017

Ms. Lauren Petty
GA Power
42 Inverness Center Parkway
Birmingham, AL 35242

RE: Project: AAH0318 Plant McDonough
Pace Project No.: 30226784

Dear Ms. Petty:

Enclosed are the analytical results for sample(s) received by the laboratory on August 10, 2017. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Jacquelyn Collins
jacquelyn.collins@pacelabs.com
(724)850-5612
Project Manager

Enclosures



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: AAH0318 Plant McDonough
Pace Project No.: 30226784

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601
L-A-B DOD-ELAP Accreditation #: L2417
Alabama Certification #: 41590
Arizona Certification #: AZ0734
Arkansas Certification
California Certification #: 04222CA
Colorado Certification
Connecticut Certification #: PH-0694
Delaware Certification
Florida/TNI Certification #: E87683
Georgia Certification #: C040
Guam Certification
Hawaii Certification
Idaho Certification
Illinois Certification
Indiana Certification
Iowa Certification #: 391
Kansas/TNI Certification #: E-10358
Kentucky Certification #: 90133
Louisiana DHH/TNI Certification #: LA140008
Louisiana DEQ/TNI Certification #: 4086
Maine Certification #: PA00091
Maryland Certification #: 308
Massachusetts Certification #: M-PA1457
Michigan/PADEP Certification
Missouri Certification #: 235

Montana Certification #: Cert 0082
Nebraska Certification #: NE-05-29-14
Nevada Certification #: PA014572015-1
New Hampshire/TNI Certification #: 2976
New Jersey/TNI Certification #: PA 051
New Mexico Certification #: PA01457
New York/TNI Certification #: 10888
North Carolina Certification #: 42706
North Dakota Certification #: R-190
Oregon/TNI Certification #: PA200002
Pennsylvania/TNI Certification #: 65-00282
Puerto Rico Certification #: PA01457
Rhode Island Certification #: 65-00282
South Dakota Certification
Tennessee Certification #: TN2867
Texas/TNI Certification #: T104704188-14-8
Utah/TNI Certification #: PA014572015-5
USDA Soil Permit #: P330-14-00213
Vermont Dept. of Health: ID# VT-0282
Virgin Island/PADEP Certification
Virginia/VELAP Certification #: 460198
Washington Certification #: C868
West Virginia DEP Certification #: 143
West Virginia DHHR Certification #: 9964C
Wisconsin Certification
Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: AAH0318 Plant McDonough

Pace Project No.: 30226784

Lab ID	Sample ID	Matrix	Date Collected	Date Received
30226784001	DGWA-70A	Water	08/08/17 10:16	08/10/17 10:05
30226784002	DGWC-68A	Water	08/08/17 13:06	08/10/17 10:05
30226784003	FB-1	Water	08/08/17 10:55	08/10/17 10:05
30226784004	EB-1	Water	08/08/17 11:10	08/10/17 10:05
30226784005	FD-1	Water	08/08/17 00:00	08/10/17 10:05

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: AAH0318 Plant McDonough
Pace Project No.: 30226784

Lab ID	Sample ID	Method	Analysts	Analytes Reported
30226784001	DGWA-70A	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	JAL	1
30226784002	DGWC-68A	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	JAL	1
30226784003	FB-1	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	JAL	1
30226784004	EB-1	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	JAL	1
30226784005	FD-1	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	JAL	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAH0318 Plant McDonough

Pace Project No.: 30226784

Sample: DGWA-70A		Lab ID: 30226784001	Collected: 08/08/17 10:16	Received: 08/10/17 10:05	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.448 ± 0.294 (0.507) C:92% T:NA	pCi/L	08/18/17 08:15	13982-63-3	
Radium-228	EPA 9320	1.03 ± 0.405 (0.597) C:75% T:88%	pCi/L	08/22/17 15:57	15262-20-1	
Total Radium	Total Radium Calculation	1.48 ± 0.699 (1.10)	pCi/L	08/31/17 13:41	7440-14-4	

Sample: DGWC-68A		Lab ID: 30226784002	Collected: 08/08/17 13:06	Received: 08/10/17 10:05	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.503 ± 0.263 (0.325) C:89% T:NA	pCi/L	08/18/17 08:15	13982-63-3	
Radium-228	EPA 9320	0.892 ± 0.538 (1.03) C:74% T:86%	pCi/L	08/22/17 16:00	15262-20-1	
Total Radium	Total Radium Calculation	1.40 ± 0.801 (1.36)	pCi/L	08/31/17 13:41	7440-14-4	

Sample: FB-1		Lab ID: 30226784003	Collected: 08/08/17 10:55	Received: 08/10/17 10:05	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.255 ± 0.218 (0.395) C:91% T:NA	pCi/L	08/18/17 08:15	13982-63-3	
Radium-228	EPA 9320	0.797 ± 0.416 (0.753) C:75% T:96%	pCi/L	08/22/17 16:00	15262-20-1	
Total Radium	Total Radium Calculation	1.05 ± 0.634 (1.15)	pCi/L	08/31/17 13:41	7440-14-4	

Sample: EB-1		Lab ID: 30226784004	Collected: 08/08/17 11:10	Received: 08/10/17 10:05	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.166 ± 0.207 (0.435) C:89% T:NA	pCi/L	08/18/17 08:15	13982-63-3	
Radium-228	EPA 9320	0.492 ± 0.451 (0.931) C:79% T:88%	pCi/L	08/22/17 16:00	15262-20-1	
Total Radium	Total Radium Calculation	0.658 ± 0.658 (1.37)	pCi/L	08/31/17 13:41	7440-14-4	

Sample: FD-1		Lab ID: 30226784005	Collected: 08/08/17 00:00	Received: 08/10/17 10:05	Matrix: Water	
PWS:		Site ID:	Sample Type:			
Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.127 ± 0.171 (0.360) C:91% T:NA	pCi/L	08/18/17 08:15	13982-63-3	
Radium-228	EPA 9320	0.752 ± 0.420 (0.751) C:80% T:73%	pCi/L	08/25/17 11:56	15262-20-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAH0318 Plant McDonough

Pace Project No.: 30226784

Sample: FD-1 **Lab ID: 30226784005** Collected: 08/08/17 00:00 Received: 08/10/17 10:05 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Total Radium	Total Radium Calculation	0.879 ± 0.591 (1.11)	pCi/L	08/31/17 13:41	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAH0318 Plant McDonough

Pace Project No.: 30226784

QC Batch: 268401 Analysis Method: EPA 9315

QC Batch Method: EPA 9315 Analysis Description: 9315 Total Radium

Associated Lab Samples: 30226784001, 30226784002, 30226784003, 30226784004, 30226784005

METHOD BLANK: 1321110 Matrix: Water

Associated Lab Samples: 30226784001, 30226784002, 30226784003, 30226784004, 30226784005

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.207 ± 0.167 (0.268) C:98% T:NA	pCi/L	08/18/17 08:15	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAH0318 Plant McDonough

Pace Project No.: 30226784

QC Batch: 268400

Analysis Method: EPA 9320

QC Batch Method: EPA 9320

Analysis Description: 9320 Radium 228

Associated Lab Samples: 30226784001, 30226784002, 30226784003, 30226784004, 30226784005

METHOD BLANK: 1321109

Matrix: Water

Associated Lab Samples: 30226784001, 30226784002, 30226784003, 30226784004, 30226784005

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.758 ± 0.377 (0.651) C:78% T:88%	pCi/L	08/22/17 15:56	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: AAH0318 Plant McDonough

Pace Project No.: 30226784

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

TNTC - Too Numerous To Count

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

Chain of Custody



Workorder: AAH0318 Workorder Name: Plant McDonough Owner Received Date: Results Requested By: 9/1/2017

Item	Sample ID	Sample Type	Collect Date/Time	Lab ID	Matrix	Preserved Containers	Radium 226, 228, Total	Comments
1	DGWA-70A	G	8/8/2017 10:16	AAH0318-01	GW	4	X	001
2	DGWC-68A	G	8/8/2017 13:06	AAH0318-02	GW	2	X	002
3	FB-1	G	8/8/2017 10:55	AAH0318-03	W	2	X	003
4	EB-1	G	8/8/2017 11:10	AAH0318-04	W	2	X	004
5	FD-1	G	8/8/2017 0:00	AAH0318-05	GW	2	X	005
6								
7								
8								
9								
10								

WO#: 30226784

Report To: Betsy McDaniel
 Pace Analytical Atlanta
 110 Technology Parkway
 Peachtree Corners, GA 30092
 Phone (770)-734-4200

Subcontract To: Pace - Pittsburgh
 1638 Roseytown Road
 Stes. 2,3,4
 Greensburg, PA 15601
 Phone (724) 850-5600

Transfers Released By: M. RAHMAN
 Date/Time: 8/9/17
 Received By: C. Conner
 Date/Time: 8/10/17

Transfers: 1, 2, 3
 Cooler Temperature on Receipt: 50 °C
 Custody Seal Y or N: Y
 Received on Ice Y or N: Y
 Sample Intact Y or N: Y

***In order to maintain client confidentiality, location/name of the sampling site, sampler's name and signature may not be provided on this COC
 This chain of custody is considered complete as is since this information is available in the owner laboratory.

Friday, June 17, 2016 11:01:34 AM FMT-ALL-C-002rev.00 24March2009 Page 1 of 1



Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CHAIN OF CUSTODY RECORD

CLIENT NAME: Georgia Power
 CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185 Atlanta, GA 30308 404-506-7239
 REPORT TO: Dawn Pirell (Dawn_Pirell@golder.com) PO #: laburch@southernco.com
 PROJECT NAME/STATE: Plant McDonough AP Phase II CCR
 PROJECT #:

CONTAINER TYPE	P	F	P	ANALYSIS REQUESTED	LAB #
3	7	3			
CONTAINERS					
6	1	1	4	Metals App. III & IV (EPA 620/7470)	1
4	1	1	2	Cl, F, SO ₄ & TDS (EPA 300.0 & SM 2540C)	2
4	1	1	2	Radium 228 & 228 (SW-84 9315/9320)	3
4	1	1	2		4
4	1	1	2		5

CONTAINER TYPE: P - PLASTIC, A - AMBER GLASS, G - CLEAR GLASS, V - VOA VIAL, S - STERILE, O - OTHER
 PRESERVATION: 1 - HCl, 56°C, 2 - H₂SO₄, 56°C, 3 - HNO₃, 4 - NaOH, 56°C, 5 - NaOH/ZnAc, 56°C, 6 - Na₂S₂O₈, 56°C, 7 - 56°C not frozen
 MATRIX CODES: DW - DRINKING WATER, WW - WASTEWATER, GW - GROUNDWATER, SW - SURFACE WATER, ST - STORM WATER, W - WATER, S - SOIL, SL - SLUDGE, SD - SOLID, A - AIR, L - LIQUID, P - PRODUCT
 REMARKS/ADDITIONAL INFORMATION: Extra Radium
 30226784
 LAB #: FOR LAB USE ONLY
 Entered into LIMS: Tracking #:

Collection DATE	Collection TIME	MATRIX CODE	CLG OR M A B	SAMPLE IDENTIFICATION	RELINQUISHED BY:	DATE/TIME:
08/08/17	1016	GW		DGWA-70A	Mike Noyes	8/9/17 0930
08/08/17	1306	GW		DGWC-68A		
08/08/17	1055	W		FB-1		
08/08/17	1110	W		EB-1		
08/08/17	-	GW		FD-1		

SAMPLED BY AND TITLE: Kristien Juniriko Golder
 RECEIVED BY: Mike Noyes
 RECEIVED BY LAB: [Signature]
 DATE/TIME: 8/9/17 0930
 DATE/TIME: 8/10/17 0955
 SAMPLE SHIPPED VIA: UPS, FED-EX, USPS, COURIER/PACE, CLIENT, OTHER . FS
 Custody Seal: Intact, Broken, Not Present
 Temperature: 11.3 Max

30226784

Sample Condition Upon Receipt




Client Name: GIA power

Project # AAH0318

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: _____



Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other _____

Thermometer Used IR-4 Type of Ice: Wet Blue None Samples on ice, cooling process has begun

Cooler Temperature 1.3
Temp should be above freezing to 6°C

Biological Tissue is Frozen: Yes No

Date and Initials of person examining contents: 8/9/17 MK

Comments:

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.	
Chain of Custody Filled Out:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	2.	<u>Sample type missing</u>
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.	
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.	
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.	
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.	
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.	
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.	
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.	
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.	
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.	
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.	
-Includes date/time/ID/Analysis Matrix:			
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13	
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
exceptions: VOA, coliform, TOC O&G, WI-DRO (water)	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Initial when completed	Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.	
Headspace in VOA Vials (>6mm)	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.	
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16	
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A		
Pace Trip Blank Lot # (if purchased):			

Client Notification/ Resolution: _____

Person Contacted: _____ Date/Time _____


Field Data Required? Y / N

Comments/ Resolution: _____

Project Manager Review: _____ Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples a copy of this form will be sent to the North Carolina DEHNR Certification Office; i.e. out of hold incorrect preservative out of temp incorrect containers

Sample Condition Upon Receipt Pittsburgh



Client Name: PACC GA

Project # 30226784

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: 741366577024

Label COC
LIMS Login RCV

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Thermometer Used NA Type of Ice: Wet Blue None

Cooler Temperature Observed Temp NA °C Correction Factor: _____ °C Final Temp: _____ °C

Temp should be above freezing to 6°C

Date and Initials of person examining contents: COC 8/10/17

Comments:	Yes	No	N/A	
Chain of Custody Present:	/			1.
Chain of Custody Filled Out:	/			2.
Chain of Custody Reinquished:	/			3.
Sampler Name & Signature on COC:	/			4.
Sample Labels match COC:	/			5.
-Includes date/time/ID Matrix: <u>WT</u>	/			
Samples Arrived within Hold Time:	/			6.
Short Hold Time Analysis (<72hr remaining):	/			7.
Rush Turn Around Time Requested:	/			8.
Sufficient Volume:	/			9.
Correct Containers Used:	/			10.
-Pace Containers Used:	/			
Containers intact:	/			11.
Orthophosphate field filtered			/	12.
Organic Samples checked for dechlorination:			/	13.
Filtered volume received for Dissolved tests	/			14.
All containers have been checked for preservation.	/			15. <u>RA 2</u>
All containers needing preservation are found to be in compliance with EPA recommendation.	/			
exceptions: VOA, coliform, TOC, O&G, Phenolics				Initial when completed: <u>COC</u> Date/time of preservation: _____
				Lot # of added preservative: _____
Headspace in VOA Vials (>6mm):				16.
Trip Blank Present:	/			17.
Trip Blank Custody Seals Present	/			
Rad Aqueous Samples Screened > 0.5 mrem/hr	/			Initial when completed: <u>COC</u> Date: <u>8/10/17</u>

Client Notification/ Resolution:

Person Contacted: _____ Date/Time: _____ Contacted By: _____

Comments/ Resolution: _____

A check in this box indicates that additional information has been stored in ereports.

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

*PM review is documented electronically in LIMS. When the Project Manager closes the SRF Review schedule in LIMS. The review is in the Status section of the Workorder Edit Screen.

LABORATORY ANALYTICAL DATA

October – November 2017



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Laboratory Report

Prepared For:

**Georgia Power
2480 Maner Road
Atlanta, GA 30339**

Attention: Mr. Joju Abraham

Report Number: AAJ0865

November 08, 2017

Project: CCR Event

Project #:Plant McDonough

We appreciate the opportunity to provide the analytical support for your project. The analytical results in this report are based upon information supplied by you, the client, and are for your exclusive use. If you have any questions regarding this data package, please do not hesitate to call.

Approved:

A handwritten signature in black ink that reads "Betsy McDonough". The signature is written over a horizontal line.

Project Manager

This report may not be reproduced, except in full, without written approval from Pace Analytical Services, LLC.
All test results relate only to the samples analyzed.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
DGWA-70A	AAJ0865-01	Ground Water	10/24/17 15:40	10/25/17 13:20
DGWA-71	AAJ0865-02	Ground Water	10/24/17 13:35	10/25/17 13:20
DGWA-2	AAJ0865-03	Ground Water	10/24/17 10:30	10/25/17 13:20
DGWC-4	AAJ0865-04	Ground Water	10/24/17 15:50	10/25/17 13:20
DGWA-53	AAJ0865-05	Ground Water	10/24/17 13:00	10/25/17 13:20
DGWC-8	AAJ0865-06	Ground Water	10/24/17 10:25	10/25/17 13:20
DGWC-9	AAJ0865-07	Ground Water	10/24/17 12:45	10/25/17 13:20
FD-1	AAJ0865-08	Ground Water	10/24/17 00:00	10/25/17 13:20
FB-1	AAJ0865-09	Water	10/24/17 12:30	10/25/17 13:20
EB-1	AAJ0865-10	Water	10/24/17 16:40	10/25/17 13:20
DGWC-10	AAJ0865-11	Ground Water	10/24/17 14:30	10/25/17 13:20
DGWC-11	AAJ0865-12	Ground Water	10/24/17 16:30	10/25/17 13:20



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

Case Narrative

The Radium analysis by methods EPA 9315/9320 was performed by Pace-Pittsburgh, 1638 Roseytown Road - Suites 2, 3, 4, Greensburg PA 15601. The Pace-Pittsburgh lab contact is Jacquelyn Collins at 724-850-5612.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

November 08, 2017

Attention: Mr. Joju Abraham

Report No.: AAJ0865

Project: CCR Event

Client ID: DGWA-70A

Lab Number ID: AAJ0865-01

Date/Time Sampled: 10/24/2017 3:40:00PM

Date/Time Received: 10/25/2017 1:20:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	49	25	10	mg/L	SM 2540 C		1	10/27/17 09:55	10/27/17 09:55	7100820	JPT
Inorganic Anions											
Chloride	2.4	0.25	0.02	mg/L	EPA 300.0		1	10/30/17 11:06	10/30/17 13:03	7100870	RLC
Fluoride	ND	0.30	0.03	mg/L	EPA 300.0		1	10/30/17 11:06	10/30/17 13:03	7100870	RLC
Sulfate	1.4	1.0	0.02	mg/L	EPA 300.0	B-01	1	10/30/17 11:06	10/30/17 13:03	7100870	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:14	7100806	KLH
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:14	7100806	KLH
Barium	0.0333	0.0100	0.0004	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:14	7100806	KLH
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:14	7100806	KLH
Boron	0.0082	0.0400	0.0060	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 17:14	7100806	KLH
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:14	7100806	KLH
Calcium	4.93	2.50	0.202	mg/L	EPA 6020B		5	10/27/17 08:35	11/06/17 20:03	7100806	KLH
Chromium	0.0005	0.0100	0.0005	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 17:14	7100806	KLH
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:14	7100806	KLH
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:14	7100806	KLH
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:14	7100806	KLH
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:14	7100806	KLH
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:14	7100806	KLH
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:14	7100806	KLH
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	10/31/17 13:05	10/31/17 15:56	7100899	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

November 08, 2017

Attention: Mr. Joju Abraham

Report No.: AAJ0865

Project: CCR Event

Client ID: DGWA-71

Lab Number ID: AAJ0865-02

Date/Time Sampled: 10/24/2017 1:35:00PM

Date/Time Received: 10/25/2017 1:20:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	117	25	10	mg/L	SM 2540 C		1	10/27/17 09:55	10/27/17 09:55	7100820	JPT
Inorganic Anions											
Chloride	3.2	0.25	0.02	mg/L	EPA 300.0		1	10/30/17 11:06	10/30/17 13:24	7100870	RLC
Fluoride	ND	0.30	0.03	mg/L	EPA 300.0		1	10/30/17 11:06	10/30/17 13:24	7100870	RLC
Sulfate	9.6	1.0	0.02	mg/L	EPA 300.0	B-01	1	10/30/17 11:06	10/30/17 13:24	7100870	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:39	7100806	KLH
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:39	7100806	KLH
Barium	0.0313	0.0100	0.0004	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:39	7100806	KLH
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:39	7100806	KLH
Boron	0.0083	0.0400	0.0060	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 17:39	7100806	KLH
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:39	7100806	KLH
Calcium	6.86	5.00	2.02	mg/L	EPA 6020B		50	10/27/17 08:35	11/03/17 17:45	7100806	KLH
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:39	7100806	KLH
Cobalt	0.0004	0.0100	0.0003	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 17:39	7100806	KLH
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:39	7100806	KLH
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:39	7100806	KLH
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:39	7100806	KLH
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:39	7100806	KLH
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:39	7100806	KLH
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	10/31/17 13:05	10/31/17 15:58	7100899	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

November 08, 2017

Attention: Mr. Joju Abraham

Report No.: AAJ0865

Project: CCR Event

Client ID: DGWA-2

Lab Number ID: AAJ0865-03

Date/Time Sampled: 10/24/2017 10:30:00AM

Date/Time Received: 10/25/2017 1:20:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	523	25	10	mg/L	SM 2540 C		1	10/27/17 09:55	10/27/17 09:55	7100820	JPT
Inorganic Anions											
Chloride	4.4	0.25	0.02	mg/L	EPA 300.0		1	10/30/17 11:06	10/30/17 13:45	7100870	RLC
Fluoride	0.43	0.30	0.03	mg/L	EPA 300.0		1	10/30/17 11:06	10/30/17 13:45	7100870	RLC
Sulfate	260	25	0.42	mg/L	EPA 300.0	B-01	25	10/30/17 11:06	11/02/17 05:24	7100870	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:50	7100806	KLH
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:50	7100806	KLH
Barium	0.0206	0.0100	0.0004	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:50	7100806	KLH
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:50	7100806	KLH
Boron	1.18	0.0400	0.0060	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:50	7100806	KLH
Cadmium	0.0003	0.0010	0.0001	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 17:50	7100806	KLH
Calcium	86.0	25.0	2.02	mg/L	EPA 6020B		50	10/27/17 08:35	11/03/17 17:56	7100806	KLH
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:50	7100806	KLH
Cobalt	0.0292	0.0100	0.0003	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:50	7100806	KLH
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:50	7100806	KLH
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:50	7100806	KLH
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:50	7100806	KLH
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:50	7100806	KLH
Lithium	0.0995	0.0500	0.0015	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 17:50	7100806	KLH
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	10/31/17 13:05	10/31/17 16:00	7100899	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

Report No.: AAJ0865

Project: CCR Event

Client ID: DGWC-4

Lab Number ID: AAJ0865-04

Date/Time Sampled: 10/24/2017 3:50:00PM

Date/Time Received: 10/25/2017 1:20:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	229	25	10	mg/L	SM 2540 C		1	10/27/17 09:55	10/27/17 09:55	7100820	JPT
Inorganic Anions											
Chloride	28	0.25	0.02	mg/L	EPA 300.0		1	10/30/17 11:06	10/30/17 14:07	7100870	RLC
Fluoride	ND	0.30	0.03	mg/L	EPA 300.0		1	10/30/17 11:06	10/30/17 14:07	7100870	RLC
Sulfate	930	50	0.85	mg/L	EPA 300.0	B-01	50	10/30/17 11:06	11/02/17 05:45	7100870	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:02	7100806	KLH
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:02	7100806	KLH
Barium	0.0351	0.0100	0.0004	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:02	7100806	KLH
Beryllium	0.0002	0.0030	0.00009	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 18:02	7100806	KLH
Boron	3.82	0.0400	0.0060	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:02	7100806	KLH
Cadmium	0.0007	0.0010	0.0001	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 18:02	7100806	KLH
Calcium	232	125	10.1	mg/L	EPA 6020B		250	10/27/17 08:35	11/06/17 20:09	7100806	KLH
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:02	7100806	KLH
Cobalt	0.0017	0.0100	0.0003	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 18:02	7100806	KLH
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:02	7100806	KLH
Molybdenum	0.0072	0.0100	0.0010	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 18:02	7100806	KLH
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:02	7100806	KLH
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:02	7100806	KLH
Lithium	0.0024	0.0500	0.0015	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 18:02	7100806	KLH
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	10/31/17 13:05	10/31/17 16:03	7100899	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

November 08, 2017

Attention: Mr. Joju Abraham

Report No.: AAJ0865

Project: CCR Event

Client ID: DGWA-53

Lab Number ID: AAJ0865-05

Date/Time Sampled: 10/24/2017 1:00:00PM

Date/Time Received: 10/25/2017 1:20:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	671	25	10	mg/L	SM 2540 C		1	10/27/17 09:55	10/27/17 09:55	7100820	JPT
Inorganic Anions											
Chloride	2.7	0.25	0.02	mg/L	EPA 300.0		1	10/30/17 11:06	10/30/17 15:10	7100870	RLC
Fluoride	0.06	0.30	0.03	mg/L	EPA 300.0	J	1	10/30/17 11:06	10/30/17 15:10	7100870	RLC
Sulfate	15	1.0	0.02	mg/L	EPA 300.0	B-01	1	10/30/17 11:06	10/30/17 15:10	7100870	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:13	7100806	KLH
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:13	7100806	KLH
Barium	0.109	0.0100	0.0004	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:13	7100806	KLH
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:13	7100806	KLH
Boron	0.0770	0.0400	0.0060	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:13	7100806	KLH
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:13	7100806	KLH
Calcium	30.3	25.0	2.02	mg/L	EPA 6020B		50	10/27/17 08:35	11/03/17 18:19	7100806	KLH
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:13	7100806	KLH
Cobalt	0.0267	0.0100	0.0003	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:13	7100806	KLH
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:13	7100806	KLH
Molybdenum	0.0227	0.0100	0.0010	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:13	7100806	KLH
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:13	7100806	KLH
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:13	7100806	KLH
Lithium	0.0103	0.0500	0.0015	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 18:13	7100806	KLH
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	10/31/17 13:05	10/31/17 16:10	7100899	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

November 08, 2017

Attention: Mr. Joju Abraham

Report No.: AAJ0865

Project: CCR Event

Client ID: DGWC-8

Lab Number ID: AAJ0865-06

Date/Time Sampled: 10/24/2017 10:25:00AM

Date/Time Received: 10/25/2017 1:20:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	468	25	10	mg/L	SM 2540 C		1	10/27/17 09:55	10/27/17 09:55	7100820	JPT
Inorganic Anions											
Chloride	9.9	0.25	0.02	mg/L	EPA 300.0		1	10/30/17 11:06	10/30/17 15:31	7100870	RLC
Fluoride	0.82	0.30	0.03	mg/L	EPA 300.0		1	10/30/17 11:06	10/30/17 15:31	7100870	RLC
Sulfate	430	25	0.42	mg/L	EPA 300.0	B-01	25	10/30/17 11:06	11/02/17 06:07	7100870	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:25	7100806	KLH
Arsenic	0.0015	0.0050	0.0005	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 18:25	7100806	KLH
Barium	0.0369	0.0100	0.0004	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:25	7100806	KLH
Beryllium	0.0042	0.0030	0.00009	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:25	7100806	KLH
Boron	2.29	0.0400	0.0060	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:25	7100806	KLH
Cadmium	0.0029	0.0010	0.0001	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:25	7100806	KLH
Calcium	78.1	25.0	2.02	mg/L	EPA 6020B		50	10/27/17 08:35	11/03/17 18:30	7100806	KLH
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:25	7100806	KLH
Cobalt	0.123	0.0100	0.0003	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:25	7100806	KLH
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:25	7100806	KLH
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:25	7100806	KLH
Selenium	0.0069	0.0100	0.0018	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 18:25	7100806	KLH
Thallium	0.0003	0.0010	0.00005	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 18:25	7100806	KLH
Lithium	0.0072	0.0500	0.0015	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 18:25	7100806	KLH
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	10/31/17 13:05	10/31/17 16:12	7100899	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

November 08, 2017

Attention: Mr. Joju Abraham

Report No.: AAJ0865

Project: CCR Event

Client ID: DGWC-9

Lab Number ID: AAJ0865-07

Date/Time Sampled: 10/24/2017 12:45:00PM

Date/Time Received: 10/25/2017 1:20:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	599	25	10	mg/L	SM 2540 C		1	10/27/17 09:55	10/27/17 09:55	7100820	JPT
Inorganic Anions											
Chloride	6.7	0.25	0.02	mg/L	EPA 300.0		1	10/30/17 11:06	10/30/17 15:53	7100870	RLC
Fluoride	1.7	0.30	0.03	mg/L	EPA 300.0		1	10/30/17 11:06	10/30/17 15:53	7100870	RLC
Sulfate	430	25	0.42	mg/L	EPA 300.0	B-01	25	10/30/17 11:06	11/02/17 06:29	7100870	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:48	7100806	KLH
Arsenic	0.0249	0.0050	0.0005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:48	7100806	KLH
Barium	0.0148	0.0100	0.0004	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:48	7100806	KLH
Beryllium	0.0051	0.0030	0.00009	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:48	7100806	KLH
Boron	1.72	0.0400	0.0060	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:48	7100806	KLH
Cadmium	0.0006	0.0010	0.0001	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 18:48	7100806	KLH
Calcium	92.5	25.0	2.02	mg/L	EPA 6020B		50	10/27/17 08:35	11/06/17 20:21	7100806	KLH
Chromium	ND	0.0500	0.0023	mg/L	EPA 6020B	R-01	5	10/27/17 08:35	11/06/17 20:15	7100806	KLH
Cobalt	0.151	0.0500	0.0013	mg/L	EPA 6020B		5	10/27/17 08:35	11/06/17 20:15	7100806	KLH
Lead	ND	0.0050	0.0003	mg/L	EPA 6020B		5	10/27/17 08:35	11/06/17 20:15	7100806	KLH
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:48	7100806	KLH
Selenium	0.0653	0.0100	0.0018	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:48	7100806	KLH
Thallium	0.0006	0.0010	0.0003	mg/L	EPA 6020B	J	5	10/27/17 08:35	11/06/17 20:15	7100806	KLH
Lithium	0.0281	0.0500	0.0015	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 18:48	7100806	KLH
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	10/31/17 13:05	10/31/17 16:15	7100899	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

Report No.: AAJ0865

Project: CCR Event

Client ID: FD-1

Lab Number ID: AAJ0865-08

Date/Time Sampled: 10/24/2017 12:00:00AM

Date/Time Received: 10/25/2017 1:20:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	603	25	10	mg/L	SM 2540 C		1	10/30/17 16:50	10/30/17 16:50	7100873	JPT
Inorganic Anions											
Chloride	9.9	0.25	0.02	mg/L	EPA 300.0		1	10/30/17 11:06	10/30/17 16:14	7100870	RLC
Fluoride	0.82	0.30	0.03	mg/L	EPA 300.0		1	10/30/17 11:06	10/30/17 16:14	7100870	RLC
Sulfate	440	25	0.42	mg/L	EPA 300.0	B-01	25	10/30/17 11:06	11/02/17 06:51	7100870	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:59	7100806	KLH
Arsenic	0.0015	0.0050	0.0005	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 18:59	7100806	KLH
Barium	0.0376	0.0100	0.0004	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:59	7100806	KLH
Beryllium	0.0044	0.0030	0.00009	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:59	7100806	KLH
Boron	2.32	0.0400	0.0060	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:59	7100806	KLH
Cadmium	0.0029	0.0010	0.0001	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:59	7100806	KLH
Calcium	79.7	25.0	2.02	mg/L	EPA 6020B		50	10/27/17 08:35	11/03/17 19:05	7100806	KLH
Chromium	0.0005	0.0100	0.0005	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 18:59	7100806	KLH
Cobalt	0.124	0.0100	0.0003	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:59	7100806	KLH
Lead	0.00009	0.0050	0.00007	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 18:59	7100806	KLH
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 18:59	7100806	KLH
Selenium	0.0067	0.0100	0.0018	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 18:59	7100806	KLH
Thallium	0.0003	0.0010	0.00005	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 18:59	7100806	KLH
Lithium	0.0072	0.0500	0.0015	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 18:59	7100806	KLH
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	10/31/17 13:05	10/31/17 16:17	7100899	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

November 08, 2017

Attention: Mr. Joju Abraham

Report No.: AAJ0865

Project: CCR Event

Client ID: FB-1

Lab Number ID: AAJ0865-09

Date/Time Sampled: 10/24/2017 12:30:00PM

Date/Time Received: 10/25/2017 1:20:00PM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C		1	10/27/17 09:55	10/27/17 09:55	7100820	JPT
Inorganic Anions											
Chloride	ND	0.25	0.02	mg/L	EPA 300.0		1	10/30/17 11:06	10/30/17 18:00	7100870	RLC
Fluoride	ND	0.30	0.03	mg/L	EPA 300.0		1	10/30/17 11:06	10/30/17 18:00	7100870	RLC
Sulfate	ND	1.0	0.02	mg/L	EPA 300.0	B-01	1	10/30/17 11:06	10/30/17 18:00	7100870	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:10	7100806	KLH
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:10	7100806	KLH
Barium	ND	0.0100	0.0004	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:10	7100806	KLH
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:10	7100806	KLH
Boron	0.0083	0.0400	0.0060	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 19:10	7100806	KLH
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:10	7100806	KLH
Calcium	ND	0.500	0.0404	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:10	7100806	KLH
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:10	7100806	KLH
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:10	7100806	KLH
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:10	7100806	KLH
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:10	7100806	KLH
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:10	7100806	KLH
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:10	7100806	KLH
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:10	7100806	KLH
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	10/31/17 13:05	10/31/17 16:19	7100899	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

November 08, 2017

Attention: Mr. Joju Abraham

Report No.: AAJ0865
Client ID: EB-1
Date/Time Sampled: 10/24/2017 4:40:00PM
Matrix: Water

Project: CCR Event
Lab Number ID: AAJ0865-10
Date/Time Received: 10/25/2017 1:20:00PM

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C		1	10/30/17 16:50	10/30/17 16:50	7100873	JPT
Inorganic Anions											
Chloride	ND	0.25	0.02	mg/L	EPA 300.0		1	10/30/17 11:06	10/30/17 18:21	7100870	RLC
Fluoride	ND	0.30	0.03	mg/L	EPA 300.0		1	10/30/17 11:06	10/30/17 18:21	7100870	RLC
Sulfate	ND	1.0	0.02	mg/L	EPA 300.0	B-01	1	10/30/17 11:06	10/30/17 18:21	7100870	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:16	7100806	KLH
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:16	7100806	KLH
Barium	ND	0.0100	0.0004	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:16	7100806	KLH
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:16	7100806	KLH
Boron	ND	0.0400	0.0060	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:16	7100806	KLH
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:16	7100806	KLH
Calcium	ND	0.500	0.0404	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:16	7100806	KLH
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:16	7100806	KLH
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:16	7100806	KLH
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:16	7100806	KLH
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:16	7100806	KLH
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:16	7100806	KLH
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:16	7100806	KLH
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:16	7100806	KLH
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	10/31/17 13:05	10/31/17 16:22	7100899	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

Report No.: AAJ0865

Project: CCR Event

Client ID: DGWC-10

Lab Number ID: AAJ0865-11

Date/Time Sampled: 10/24/2017 2:30:00PM

Date/Time Received: 10/25/2017 1:20:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	353	25	10	mg/L	SM 2540 C		1	10/27/17 09:55	10/27/17 09:55	7100820	JPT
Inorganic Anions											
Chloride	11	0.25	0.02	mg/L	EPA 300.0		1	10/30/17 11:06	10/30/17 18:42	7100870	RLC
Fluoride	2.1	0.30	0.03	mg/L	EPA 300.0		1	10/30/17 11:06	10/30/17 18:42	7100870	RLC
Sulfate	410	25	0.42	mg/L	EPA 300.0	B-01	25	10/30/17 11:06	11/02/17 07:13	7100870	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:22	7100806	KLH
Arsenic	0.0058	0.0050	0.0005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:22	7100806	KLH
Barium	0.0317	0.0100	0.0004	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:22	7100806	KLH
Beryllium	0.0048	0.0030	0.00009	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:22	7100806	KLH
Boron	3.45	0.0400	0.0060	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:22	7100806	KLH
Cadmium	0.0014	0.0010	0.0001	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:22	7100806	KLH
Calcium	81.5	25.0	2.02	mg/L	EPA 6020B		50	10/27/17 08:35	11/03/17 19:28	7100806	KLH
Chromium	0.0007	0.0100	0.0005	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 19:22	7100806	KLH
Cobalt	0.175	0.0100	0.0003	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:22	7100806	KLH
Lead	ND	0.0050	0.0003	mg/L	EPA 6020B		5	10/27/17 08:35	11/06/17 20:26	7100806	KLH
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:22	7100806	KLH
Selenium	0.0281	0.0100	0.0018	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:22	7100806	KLH
Thallium	0.0004	0.0010	0.0003	mg/L	EPA 6020B	J	5	10/27/17 08:35	11/06/17 20:26	7100806	KLH
Lithium	0.0022	0.0500	0.0015	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 19:22	7100806	KLH
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	10/31/17 13:05	10/31/17 16:24	7100899	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

November 08, 2017

Attention: Mr. Joju Abraham

Report No.: AAJ0865

Project: CCR Event

Client ID: DGWC-11

Lab Number ID: AAJ0865-12

Date/Time Sampled: 10/24/2017 4:30:00PM

Date/Time Received: 10/25/2017 1:20:00PM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	342	25	10	mg/L	SM 2540 C		1	10/30/17 16:50	10/30/17 16:50	7100873	JPT
Inorganic Anions											
Chloride	12	0.25	0.02	mg/L	EPA 300.0		1	10/30/17 11:06	10/30/17 19:25	7100870	RLC
Fluoride	ND	0.30	0.03	mg/L	EPA 300.0		1	10/30/17 11:06	10/30/17 19:25	7100870	RLC
Sulfate	210	10	0.17	mg/L	EPA 300.0	B-01	10	10/30/17 11:06	11/02/17 07:34	7100870	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:33	7100806	KLH
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:33	7100806	KLH
Barium	0.0596	0.0100	0.0004	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:33	7100806	KLH
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:33	7100806	KLH
Boron	1.18	0.0400	0.0060	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:33	7100806	KLH
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:33	7100806	KLH
Calcium	55.0	25.0	2.02	mg/L	EPA 6020B		50	10/27/17 08:35	11/03/17 19:39	7100806	KLH
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:33	7100806	KLH
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:33	7100806	KLH
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:33	7100806	KLH
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:33	7100806	KLH
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:33	7100806	KLH
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	10/27/17 08:35	11/03/17 19:33	7100806	KLH
Lithium	0.0024	0.0500	0.0015	mg/L	EPA 6020B	J	1	10/27/17 08:35	11/03/17 19:33	7100806	KLH
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	10/31/17 13:05	10/31/17 16:26	7100899	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

Report No.: AAJ0865

General Chemistry - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7100820 - SM 2540 C											
Blank (7100820-BLK1)						Prepared & Analyzed: 10/27/17					
Total Dissolved Solids	ND	25	10	mg/L							
LCS (7100820-BS1)						Prepared & Analyzed: 10/27/17					
Total Dissolved Solids	389	25	10	mg/L	400.00		97	84-108			
Duplicate (7100820-DUP1)						Source: AAJ0821-01 Prepared & Analyzed: 10/27/17					
Total Dissolved Solids	98	25	10	mg/L		91			7	10	
Duplicate (7100820-DUP2)						Source: AAJ0865-10 Prepared & Analyzed: 10/27/17					
Total Dissolved Solids	565	25	10	mg/L		10			193	10	QR-03
Batch 7100873 - SM 2540 C											
Blank (7100873-BLK1)						Prepared & Analyzed: 10/30/17					
Total Dissolved Solids	ND	25	10	mg/L							
LCS (7100873-BS1)						Prepared & Analyzed: 10/30/17					
Total Dissolved Solids	391	25	10	mg/L	400.00		98	84-108			
Duplicate (7100873-DUP1)						Source: AAJ0865-08RE1 Prepared & Analyzed: 10/30/17					
Total Dissolved Solids	616	25	10	mg/L		603			2	10	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

Report No.: AAJ0865

Inorganic Anions - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7100870 - EPA 300.0											
Blank (7100870-BLK1)						Prepared & Analyzed: 10/30/17					
Chloride	ND	0.25	0.02	mg/L							
Fluoride	ND	0.30	0.03	mg/L							
Sulfate	0.12	1.0	0.02	mg/L							J
LCS (7100870-BS1)						Prepared & Analyzed: 10/30/17					
Chloride	10.5	0.25	0.02	mg/L	10.020		104	90-110			
Fluoride	10.2	0.30	0.03	mg/L	10.020		102	90-110			
Sulfate	10.4	1.0	0.02	mg/L	10.050		103	90-110			
Matrix Spike (7100870-MS1)						Source: AAJ0865-04 Prepared & Analyzed: 10/30/17					
Chloride	35.1	0.25	0.02	mg/L	10.020	27.9	72	90-110			QM-02
Fluoride	10.2	0.30	0.03	mg/L	10.020	ND	102	90-110			
Sulfate	383	1.0	0.02	mg/L	10.050	404	NR	90-110			QM-02
Matrix Spike (7100870-MS2)						Source: AAJ0865-11 Prepared & Analyzed: 10/30/17					
Chloride	21.3	0.25	0.02	mg/L	10.020	11.4	99	90-110			
Fluoride	15.3	0.30	0.03	mg/L	10.020	2.09	132	90-110			QM-05
Sulfate	243	1.0	0.02	mg/L	10.050	260	NR	90-110			QM-02
Matrix Spike Dup (7100870-MSD1)						Source: AAJ0865-04 Prepared & Analyzed: 10/30/17					
Chloride	35.1	0.25	0.02	mg/L	10.020	27.9	72	90-110	0.01	15	QM-02
Fluoride	10.3	0.30	0.03	mg/L	10.020	ND	103	90-110	0.7	15	
Sulfate	383	1.0	0.02	mg/L	10.050	404	NR	90-110	0.02	15	QM-02



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

Report No.: AAJ0865

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	----	-----	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7100806 - EPA 3005A

Blank (7100806-BLK1)

Prepared: 10/27/17 Analyzed: 11/03/17

Antimony	ND	0.0030	0.0006	mg/L							
Arsenic	ND	0.0050	0.0005	mg/L							
Barium	ND	0.0100	0.0004	mg/L							
Beryllium	ND	0.0030	0.00009	mg/L							
Boron	ND	0.0400	0.0060	mg/L							
Cadmium	ND	0.0010	0.0001	mg/L							
Calcium	ND	0.500	0.0404	mg/L							
Chromium	ND	0.0100	0.0005	mg/L							
Cobalt	ND	0.0100	0.0003	mg/L							
Copper	ND	0.0250	0.0003	mg/L							
Lead	ND	0.0050	0.00007	mg/L							
Molybdenum	ND	0.0100	0.0010	mg/L							
Nickel	ND	0.0100	0.0005	mg/L							
Selenium	ND	0.0100	0.0018	mg/L							
Silver	ND	0.0100	0.0002	mg/L							
Thallium	ND	0.0010	0.00005	mg/L							
Vanadium	ND	0.0100	0.0012	mg/L							
Zinc	ND	0.0100	0.0012	mg/L							
Lithium	ND	0.0500	0.0015	mg/L							

LCS (7100806-BS1)

Prepared: 10/27/17 Analyzed: 11/03/17

Antimony	0.101	0.0030	0.0006	mg/L	0.10000		101	80-120			
Arsenic	0.0980	0.0050	0.0005	mg/L	0.10000		98	80-120			
Barium	0.104	0.0100	0.0004	mg/L	0.10000		104	80-120			
Beryllium	0.102	0.0030	0.00009	mg/L	0.10000		102	80-120			
Cadmium	0.104	0.0010	0.0001	mg/L	0.10000		104	80-120			
Chromium	0.104	0.0100	0.0005	mg/L	0.10000		104	80-120			
Cobalt	0.0987	0.0100	0.0003	mg/L	0.10000		99	80-120			
Copper	0.100	0.0250	0.0003	mg/L	0.10000		100	80-120			
Lead	0.0980	0.0050	0.00007	mg/L	0.10000		98	80-120			
Nickel	0.101	0.0100	0.0005	mg/L	0.10000		101	80-120			
Selenium	0.0959	0.0100	0.0018	mg/L	0.10000		96	80-120			
Silver	0.101	0.0100	0.0002	mg/L	0.10000		101	80-120			
Thallium	0.101	0.0010	0.00005	mg/L	0.10000		101	80-120			
Vanadium	0.106	0.0100	0.0012	mg/L	0.10000		106	80-120			
Zinc	0.104	0.0100	0.0012	mg/L	0.10000		104	80-120			
Lithium	0.103	0.0500	0.0015	mg/L	0.10000		103	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

Report No.: AAJ0865

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7100806 - EPA 3005A											
Matrix Spike (7100806-MS1)			Source: AAJ0865-01				Prepared: 10/27/17 Analyzed: 11/03/17				
Antimony	0.0991	0.0030	0.0006	mg/L	0.10000	ND	99	75-125			
Arsenic	0.0963	0.0050	0.0005	mg/L	0.10000	ND	96	75-125			
Barium	0.133	0.0100	0.0004	mg/L	0.10000	0.0333	99	75-125			
Beryllium	0.0962	0.0030	0.00009	mg/L	0.10000	ND	96	75-125			
Cadmium	0.102	0.0010	0.0001	mg/L	0.10000	ND	102	75-125			
Chromium	0.105	0.0100	0.0005	mg/L	0.10000	0.0005	105	75-125			
Cobalt	0.100	0.0100	0.0003	mg/L	0.10000	ND	100	75-125			
Copper	0.0981	0.0250	0.0003	mg/L	0.10000	0.0005	98	75-125			
Lead	0.0966	0.0050	0.00007	mg/L	0.10000	ND	97	75-125			
Nickel	0.0994	0.0100	0.0005	mg/L	0.10000	ND	99	75-125			
Selenium	0.0974	0.0100	0.0018	mg/L	0.10000	ND	97	75-125			
Silver	0.0981	0.0100	0.0002	mg/L	0.10000	ND	98	75-125			
Thallium	0.0996	0.0010	0.00005	mg/L	0.10000	ND	100	75-125			
Vanadium	0.105	0.0100	0.0012	mg/L	0.10000	ND	105	75-125			
Zinc	0.102	0.0100	0.0012	mg/L	0.10000	0.0019	101	75-125			
Lithium	0.0978	0.0500	0.0015	mg/L	0.10000	ND	98	75-125			
Matrix Spike Dup (7100806-MSD1)			Source: AAJ0865-01				Prepared: 10/27/17 Analyzed: 11/03/17				
Antimony	0.0985	0.0030	0.0006	mg/L	0.10000	ND	98	75-125	0.7	20	
Arsenic	0.0967	0.0050	0.0005	mg/L	0.10000	ND	97	75-125	0.4	20	
Barium	0.133	0.0100	0.0004	mg/L	0.10000	0.0333	99	75-125	0.04	20	
Beryllium	0.0973	0.0030	0.00009	mg/L	0.10000	ND	97	75-125	1	20	
Cadmium	0.102	0.0010	0.0001	mg/L	0.10000	ND	102	75-125	0.3	20	
Chromium	0.106	0.0100	0.0005	mg/L	0.10000	0.0005	106	75-125	0.8	20	
Cobalt	0.103	0.0100	0.0003	mg/L	0.10000	ND	103	75-125	2	20	
Copper	0.100	0.0250	0.0003	mg/L	0.10000	0.0005	100	75-125	2	20	
Lead	0.0970	0.0050	0.00007	mg/L	0.10000	ND	97	75-125	0.4	20	
Nickel	0.104	0.0100	0.0005	mg/L	0.10000	ND	104	75-125	5	20	
Selenium	0.0944	0.0100	0.0018	mg/L	0.10000	ND	94	75-125	3	20	
Silver	0.0973	0.0100	0.0002	mg/L	0.10000	ND	97	75-125	0.8	20	
Thallium	0.0984	0.0010	0.00005	mg/L	0.10000	ND	98	75-125	1	20	
Vanadium	0.107	0.0100	0.0012	mg/L	0.10000	ND	107	75-125	2	20	
Zinc	0.105	0.0100	0.0012	mg/L	0.10000	0.0019	103	75-125	2	20	
Lithium	0.0958	0.0500	0.0015	mg/L	0.10000	ND	96	75-125	2	20	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

Report No.: AAJ0865

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7100806 - EPA 3005A											
Post Spike (7100806-PS1)			Source: AAJ0865-01			Prepared: 10/27/17 Analyzed: 11/03/17					
Antimony	98.8			ug/L	100.00	0.162	99	80-120			
Arsenic	98.1			ug/L	100.00	-0.0337	98	80-120			
Barium	135			ug/L	100.00	33.3	102	80-120			
Beryllium	100			ug/L	100.00	0.0526	100	80-120			
Cadmium	104			ug/L	100.00	0.0080	104	80-120			
Chromium	105			ug/L	100.00	0.476	105	80-120			
Cobalt	104			ug/L	100.00	0.208	104	80-120			
Copper	99.6			ug/L	100.00	0.535	99	80-120			
Lead	97.1			ug/L	100.00	0.0337	97	80-120			
Nickel	103			ug/L	100.00	0.356	103	80-120			
Selenium	97.0			ug/L	100.00	0.808	96	80-120			
Silver	99.8			ug/L	100.00	0.0092	100	80-120			
Thallium	98.7			ug/L	100.00	0.0133	99	80-120			
Vanadium	105			ug/L	100.00	0.171	105	80-120			
Zinc	104			ug/L	100.00	1.87	102	80-120			
Lithium	101			ug/L	100.00	0.478	100	80-120			
Batch 7100899 - EPA 7470A											
Blank (7100899-BLK1)			Prepared & Analyzed: 10/31/17								
Mercury	ND	0.00050	0.000036	mg/L							
LCS (7100899-BS1)			Prepared & Analyzed: 10/31/17								
Mercury	0.00217	0.00050	0.000036	mg/L	2.5000E-3		87	80-120			
Matrix Spike (7100899-MS1)			Source: AAJ0865-02			Prepared & Analyzed: 10/31/17					
Mercury	0.00233	0.00050	0.000036	mg/L	2.5000E-3	ND	93	75-125			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

Report No.: AAJ0865

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7100899 - EPA 7470A											
Matrix Spike Dup (7100899-MSD1)			Source: AAJ0865-02			Prepared & Analyzed: 10/31/17					
Mercury	0.00226	0.00050	0.000036	mg/L	2.5000E-3	ND	91	75-125	3	20	
Post Spike (7100899-PS1)			Source: AAJ0865-02			Prepared & Analyzed: 10/31/17					
Mercury	1.61			ug/L	1.6667	-0.0345	97	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

Legend

Definition of Laboratory Terms

- ND** - Not Detected at levels equal to or greater than the MDL
- BRL** - Not Detected at levels equal to or greater than the RL
- RL** - Reporting Limit **MDL** - Method Detection Limit
- SOP** - Method run per Pace Standard Operating Procedure
- CFU** - Colony Forming Units
- DF** - Dilution Factor **TIC** - Tentatively Identified Compound

Sample Information

N-Nitrosodiphenylamine breaks down to diphenylamine in the GCMS; both analytes are reported as N-Nitrosodiphenylamine. Pace is not NELAC certified for N-Nitrosodiphenylamine.

Phthalic acid and phthalic anhydride are reported as dimethyl phthalate

Maleic acid and maleic anhydride are reported as dimethyl malate

1,2-Diphenylhydrazine breaks down to azobenzene in the GCMS; both analytes are reported as azobenzene

Definition of Qualifiers

- R-01** Elevated reporting limit due to matrix interference.
- QR-03** The RPD value for the sample duplicate or MS/MSD was outside of QC acceptance limits due to suspected matrix interference and/or non-homogeneous sample matrix.
- QM-05** The spike recovery was outside acceptance limits for the MS and/or MSD and/or PDS due to suspected matrix interference. Sample results for the QC batch were accepted based on acceptable LCS recoveries.
- QM-02** The spike recovery is outside acceptance limits due to insignificant spike amount as compared to sample concentration.
- J** Estimated value less than Reporting Limit (RL) but greater than Method Detection Limit(MDL) (CLP J-Flag).
- B-01** Analyte was detected in the associated method blank at an estimated level equal to or greater than the MDL. Sample values reported as greater than the MDL and less than 10x the method blank value are reported as estimated values.

Note: Unless otherwise noted, all results are reported on an as received basis.




Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CHAIN OF CUSTODY RECORD

CLIENT NAME: Georgia Power CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185 Atlanta, GA 30308 404-506-7239		REPORT TO: Dawn Prell (Dawn_Prell@golder.com) REQUESTED COMPLETION DATE: [Blank]		PROJECT NAME/STATE: Plant McDonough AP Phase II CCR	
CC: Maria Padilla kiurinko@golder.com		PO #: laburch@southernco.com		PROJECT #: [Blank]	
Collection DATE	Collection TIME	MATRIX CODE*	C O R M A P B	SAMPLE IDENTIFICATION	ANALYSIS REQUESTED
10/24/17	1540	GW	X	DGWA-70A	4
10/24/17	1335	GW	X	DGWA-71	4
10/24/17	1030	GW	X	DGWA-2	4
10/24/17	1550	GW	X	DGWC-4	4
10/24/17	1300	GW	X	DGWA-53	4
10/24/17	1025	GW	X	DGWC-8	4
10/24/17	1245	GW	X	DGWC-9	4
10/24/17	--	GW	X	FD-1	4
10/24/17	1230	W	X	FB-1	4
10/24/17	1640	W	X	EB-1	4
10/24/17	1430	GW	X	DGWC-10	4
10/24/17	1630	GW	X	DGWC-11	4
SAMPLED BY AND TITLE: Ben Hodges Field Lead		DATE/TIME: 10/25/2017 0930		RELINQUISHED BY: [Blank]	
RECEIVED BY: Mike Nguyen		DATE/TIME: 10/25/17 0930		RELINQUISHED BY: [Blank]	
RECEIVED BY LAB: [Signature]		DATE/TIME: 10/25/17 1320		RELINQUISHED BY: [Blank]	
Temperature: Min: 0.6 Max: [Blank]		Custody Seal: Intact Broken Not Present		USPS FED-EX USPS CLIENT OTHER FS	
LAB #: AAJ0865		ENTERED INTO LIMS: [Blank]		TRACKING #: [Blank]	

October 24 2017 Plant McDonough COC Phase II CCR.xlsx



Sample Condition Upon Receipt

Client Name: GCA Power Project # AAJ0865

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: _____ Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other _____

Thermometer Used IR-4 Type of Ice: Wet Blue None Samples on ice, cooling process has begun

Cooler Temperature 0.6 Biological Tissue is Frozen: Yes No

Temp should be above freezing to 6°C

Optional: Provide Date: _____ Provide Name: _____

Date and Initials of person examining contents: 10/25/17 MK

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.	
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.	
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.	
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.	
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.	
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.	
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.	
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.	
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.	
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.	
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.	
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.	
-Includes date/time/ID/Analysis Matrix: <u>GCA</u>			
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.	
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed	Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.	
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.	
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.	
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A		
Pace Trip Blank Lot # (if purchased):			

Client Notification/ Resolution: _____ Date/Time: _____ Field Data Required? Y / N

Person Contacted: _____

Comments/ Resolution: _____

Project Manager Review: _____ Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

LOG-IN CHECKLIST

Printed: 10/26/2017 8:38:04AM

Attn: Mr. Joju Abraham

Client: Georgia Power

Project: CCR Event

Date Received: 10/25/17 13:20

Work Order: AAJ0865

Logged In By: Mohammad M. Rahman

OBSERVATIONS

#Samples: 12

#Containers: 50

Minimum Temp(C): 0.6

Maximum Temp(C): 0.6

Custody Seal(s) Used: Yes

CHECKLIST ITEMS

- COC included with Samples YES
- Sample Container(s) Intact YES
- Chain of Custody Complete YES
- Sample Container(s) Match COC YES
- Custody seal Intact YES
- Temperature in Compliance YES
- Sufficient Sample Volume for Analysis YES
- Zero Headspace Maintained for VOA Analyses YES
- Samples labeled preserved (If Applicable) YES
- Samples received within Allowable Hold Times YES
- Samples Received on Ice YES
- Preservation Confirmed YES

Comments:

November 13, 2017

Mr. Joju Abraham
Georgia Power
2480 Maner Road
Atlanta, GA 30339

RE: Project: AAJ0865 Plant McDonough
Pace Project No.: 30234155

Dear Mr. Abraham:

Enclosed are the analytical results for sample(s) received by the laboratory on October 26, 2017. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Jacquelyn Collins
jacquelyn.collins@pacelabs.com
(724)850-5612
Project Manager

Enclosures



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: AAJ0865 Plant McDonough
Pace Project No.: 30234155

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601
L-A-B DOD-ELAP Accreditation #: L2417
Alabama Certification #: 41590
Arizona Certification #: AZ0734
Arkansas Certification
California Certification #: 04222CA
Colorado Certification
Connecticut Certification #: PH-0694
Delaware Certification
Florida/TNI Certification #: E87683
Georgia Certification #: C040
Guam Certification
Hawaii Certification
Idaho Certification
Illinois Certification
Indiana Certification
Iowa Certification #: 391
Kansas/TNI Certification #: E-10358
Kentucky Certification #: 90133
Louisiana DHH/TNI Certification #: LA140008
Louisiana DEQ/TNI Certification #: 4086
Maine Certification #: PA00091
Maryland Certification #: 308
Massachusetts Certification #: M-PA1457
Michigan/PADEP Certification
Missouri Certification #: 235

Montana Certification #: Cert 0082
Nebraska Certification #: NE-05-29-14
Nevada Certification #: PA014572015-1
New Hampshire/TNI Certification #: 2976
New Jersey/TNI Certification #: PA 051
New Mexico Certification #: PA01457
New York/TNI Certification #: 10888
North Carolina Certification #: 42706
North Dakota Certification #: R-190
Oregon/TNI Certification #: PA200002
Pennsylvania/TNI Certification #: 65-00282
Puerto Rico Certification #: PA01457
Rhode Island Certification #: 65-00282
South Dakota Certification
Tennessee Certification #: TN2867
Texas/TNI Certification #: T104704188-14-8
Utah/TNI Certification #: PA014572015-5
USDA Soil Permit #: P330-14-00213
Vermont Dept. of Health: ID# VT-0282
Virgin Island/PADEP Certification
Virginia/VELAP Certification #: 460198
Washington Certification #: C868
West Virginia DEP Certification #: 143
West Virginia DHHR Certification #: 9964C
Wisconsin Certification
Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: AAJ0865 Plant McDonough

Pace Project No.: 30234155

Lab ID	Sample ID	Matrix	Date Collected	Date Received
30234155001	DGWA-70A	Water	10/24/17 15:40	10/26/17 10:00
30234155002	DGWA-71	Water	10/24/17 13:35	10/26/17 10:00
30234155003	DGWA-2	Water	10/24/17 10:30	10/26/17 10:00
30234155004	DGWC-4	Water	10/24/17 15:50	10/26/17 10:00
30234155005	DGWA-53	Water	10/24/17 13:00	10/26/17 10:00
30234155006	DGWC-8	Water	10/24/17 10:25	10/26/17 10:00
30234155007	DGWC-9	Water	10/24/17 12:45	10/26/17 10:00
30234155008	FD-1	Water	10/24/17 00:00	10/26/17 10:00
30234155009	FB-1	Water	10/24/17 12:30	10/26/17 10:00
30234155010	EB-1	Water	10/24/17 16:40	10/26/17 10:00
30234155011	DGWC-10	Water	10/24/17 14:30	10/26/17 10:00
30234155012	DGWC-11	Water	10/24/17 16:30	10/26/17 10:00

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: AAJ0865 Plant McDonough
Pace Project No.: 30234155

Lab ID	Sample ID	Method	Analysts	Analytes Reported
30234155001	DGWA-70A	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30234155002	DGWA-71	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30234155003	DGWA-2	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30234155004	DGWC-4	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30234155005	DGWA-53	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30234155006	DGWC-8	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30234155007	DGWC-9	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30234155008	FD-1	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30234155009	FB-1	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30234155010	EB-1	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30234155011	DGWC-10	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30234155012	DGWC-11	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAJ0865 Plant McDonough

Pace Project No.: 30234155

Sample: DGWA-70A		Lab ID: 30234155001	Collected: 10/24/17 15:40	Received: 10/26/17 10:00	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac		Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.471 ± 0.259 (0.403)		pCi/L	11/02/17 08:35	13982-63-3	
		C:89% T:NA					
Radium-228	EPA 9320	0.00142 ± 0.356 (0.826)		pCi/L	11/03/17 11:11	15262-20-1	
		C:79% T:80%					
Total Radium	Total Radium Calculation	0.472 ± 0.615 (1.23)		pCi/L	11/13/17 13:00	7440-14-4	

Sample: DGWA-71		Lab ID: 30234155002	Collected: 10/24/17 13:35	Received: 10/26/17 10:00	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac		Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.278 ± 0.187 (0.280)		pCi/L	11/02/17 08:35	13982-63-3	
		C:85% T:NA					
Radium-228	EPA 9320	0.446 ± 0.353 (0.691)		pCi/L	11/03/17 11:12	15262-20-1	
		C:77% T:77%					
Total Radium	Total Radium Calculation	0.724 ± 0.540 (0.971)		pCi/L	11/13/17 13:00	7440-14-4	

Sample: DGWA-2		Lab ID: 30234155003	Collected: 10/24/17 10:30	Received: 10/26/17 10:00	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac		Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.604 ± 0.277 (0.370)		pCi/L	11/02/17 08:35	13982-63-3	
		C:87% T:NA					
Radium-228	EPA 9320	0.589 ± 0.342 (0.610)		pCi/L	11/03/17 11:12	15262-20-1	
		C:77% T:84%					
Total Radium	Total Radium Calculation	1.19 ± 0.619 (0.980)		pCi/L	11/13/17 13:00	7440-14-4	

Sample: DGWC-4		Lab ID: 30234155004	Collected: 10/24/17 15:50	Received: 10/26/17 10:00	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac		Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.882 ± 0.323 (0.352)		pCi/L	11/02/17 08:35	13982-63-3	
		C:92% T:NA					
Radium-228	EPA 9320	0.361 ± 0.386 (0.805)		pCi/L	11/03/17 14:26	15262-20-1	
		C:79% T:78%					
Total Radium	Total Radium Calculation	1.24 ± 0.709 (1.16)		pCi/L	11/13/17 13:00	7440-14-4	

Sample: DGWA-53		Lab ID: 30234155005	Collected: 10/24/17 13:00	Received: 10/26/17 10:00	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac		Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	2.28 ± 0.557 (0.276)		pCi/L	11/02/17 08:35	13982-63-3	
		C:87% T:NA					
Radium-228	EPA 9320	2.18 ± 0.637 (0.773)		pCi/L	11/03/17 14:26	15262-20-1	
		C:74% T:84%					

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAJ0865 Plant McDonough

Pace Project No.: 30234155

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWA-53 Lab ID: 30234155005 Collected: 10/24/17 13:00 Received: 10/26/17 10:00 Matrix: Water PWS: Site ID: Sample Type:						
Total Radium	Total Radium Calculation	4.46 ± 1.19 (1.05)	pCi/L	11/13/17 13:00	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-8 Lab ID: 30234155006 Collected: 10/24/17 10:25 Received: 10/26/17 10:00 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	0.615 ± 0.271 (0.350) C:93% T:NA	pCi/L	11/02/17 08:35	13982-63-3	
Radium-228	EPA 9320	-0.0176 ± 0.381 (0.888) C:76% T:76%	pCi/L	11/03/17 14:26	15262-20-1	
Total Radium	Total Radium Calculation	0.615 ± 0.652 (1.24)	pCi/L	11/13/17 13:00	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-9 Lab ID: 30234155007 Collected: 10/24/17 12:45 Received: 10/26/17 10:00 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	0.565 ± 0.249 (0.291) C:94% T:NA	pCi/L	11/02/17 08:35	13982-63-3	
Radium-228	EPA 9320	0.649 ± 0.365 (0.651) C:77% T:79%	pCi/L	11/03/17 14:27	15262-20-1	
Total Radium	Total Radium Calculation	1.21 ± 0.614 (0.942)	pCi/L	11/13/17 13:00	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: FD-1 Lab ID: 30234155008 Collected: 10/24/17 00:00 Received: 10/26/17 10:00 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	0.365 ± 0.206 (0.296) C:97% T:NA	pCi/L	11/02/17 08:36	13982-63-3	
Radium-228	EPA 9320	0.293 ± 0.330 (0.687) C:74% T:76%	pCi/L	11/03/17 14:27	15262-20-1	
Total Radium	Total Radium Calculation	0.658 ± 0.536 (0.983)	pCi/L	11/13/17 13:00	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: FB-1 Lab ID: 30234155009 Collected: 10/24/17 12:30 Received: 10/26/17 10:00 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	0.216 ± 0.178 (0.310) C:85% T:NA	pCi/L	11/02/17 08:36	13982-63-3	
Radium-228	EPA 9320	0.502 ± 0.368 (0.709) C:74% T:76%	pCi/L	11/03/17 14:27	15262-20-1	
Total Radium	Total Radium Calculation	0.718 ± 0.546 (1.02)	pCi/L	11/13/17 13:00	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAJ0865 Plant McDonough

Pace Project No.: 30234155

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226		EPA 9315	0.223 ± 0.190 (0.340) C:88% T:NA	pCi/L	11/02/17 08:36	13982-63-3	
Radium-228		EPA 9320	0.0101 ± 0.322 (0.754) C:75% T:75%	pCi/L	11/03/17 14:27	15262-20-1	
Total Radium		Total Radium Calculation	0.233 ± 0.512 (1.09)	pCi/L	11/13/17 13:00	7440-14-4	

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226		EPA 9315	0.542 ± 0.260 (0.311) C:88% T:NA	pCi/L	11/02/17 08:36	13982-63-3	
Radium-228		EPA 9320	0.296 ± 0.374 (0.795) C:80% T:82%	pCi/L	11/03/17 11:15	15262-20-1	
Total Radium		Total Radium Calculation	0.838 ± 0.634 (1.11)	pCi/L	11/13/17 13:00	7440-14-4	

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226		EPA 9315	0.461 ± 0.239 (0.335) C:90% T:NA	pCi/L	11/02/17 08:36	13982-63-3	
Radium-228		EPA 9320	0.519 ± 0.431 (0.870) C:75% T:79%	pCi/L	11/03/17 11:15	15262-20-1	
Total Radium		Total Radium Calculation	0.980 ± 0.670 (1.21)	pCi/L	11/13/17 13:00	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAJ0865 Plant McDonough

Pace Project No.: 30234155

QC Batch:	277201	Analysis Method:	EPA 9320
QC Batch Method:	EPA 9320	Analysis Description:	9320 Radium 228
Associated Lab Samples:	30234155001, 30234155002, 30234155003, 30234155004, 30234155005, 30234155006, 30234155007, 30234155008, 30234155009, 30234155010, 30234155011, 30234155012		

METHOD BLANK:	1362722	Matrix:	Water
Associated Lab Samples:	30234155001, 30234155002, 30234155003, 30234155004, 30234155005, 30234155006, 30234155007, 30234155008, 30234155009, 30234155010, 30234155011, 30234155012		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	-0.00112 ± 0.365 (0.847) C:75% T:80%	pCi/L	11/03/17 11:11	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAJ0865 Plant McDonough

Pace Project No.: 30234155

QC Batch:	277200	Analysis Method:	EPA 9315
QC Batch Method:	EPA 9315	Analysis Description:	9315 Total Radium
Associated Lab Samples:	30234155001, 30234155002, 30234155003, 30234155004, 30234155005, 30234155006, 30234155007, 30234155008, 30234155009, 30234155010, 30234155011, 30234155012		

METHOD BLANK:	1362721	Matrix:	Water
Associated Lab Samples:	30234155001, 30234155002, 30234155003, 30234155004, 30234155005, 30234155006, 30234155007, 30234155008, 30234155009, 30234155010, 30234155011, 30234155012		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.309 ± 0.184 (0.250) C:92% T:NA	pCi/L	11/02/17 08:35	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: AAJ0865 Plant McDonough

Pace Project No.: 30234155

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

TNTC - Too Numerous To Count

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

Chain of Custody



Workorder: AAJ0865

Workorder Name: Plant McDonough

Owner Received Date: 10/3/2017

Results Requested By: 11/17/2017

Report To:

Subcontract To:

Requested Analysis

Betsy McDaniel
 Pace Analytical Atlanta
 110 Technology Parkway
 Peachtree Corners, GA 30092
 Phone (770)-734-4200

Pace - Pittsburgh
 1638 Roseytown Road
 Stes. 2,3,4
 Greensburg, PA 15601
 Phone (724) 850-5600

WO#: 30234155

Item	Sample ID	Sample Type	Collect Date/Time	Lab ID	Matrix	Preserved Containers		Date/Time	Comments
						CON	H		
1	DGWA-70A	G	10/24/2017 15:40	AAJ0865-01	GW	2		X	
2	DGWA-71	G	10/24/2017 13:35	AAJ0865-02	GW	4		X	
3	DGWA-2	G	10/24/2017 10:30	AAJ0865-03	GW	2		X	
4	DGWC-4	G	10/24/2017 15:50	AAJ0865-04	GW	2		X	
5	DGWA-53	G	10/24/2017 13:00	AAJ0865-05	GW	2		X	
6	DGWC-8	G	10/24/2017 10:25	AAJ0865-06	GW	2		X	
7	DGWC-9	G	10/24/2017 12:45	AAJ0865-07	GW	2		X	
8	FD-1	G	10/24/2017 0:00	AAJ0865-08	GW	2		X	
9	FB-1	G	10/24/2017 12:30	AAJ0865-09	W	2		X	
10	EB-1	G	10/24/2017 16:40	AAJ0865-10	W	2		X	
Transfers Released By									
1	M. RAHMAN		10/25/17	Received By		[Signature]		10/26/17	1000
2									
3									

Cooler Temperature on Receipt N/A °C Custody Seal Y of N Received on Ice Y or N Sample Intact Y or N

***In order to maintain client confidentiality, location/name of the sampling site, sampler's name and signature may not be provided on this COC
 This chain of custody is considered complete as is since this information is available in the owner laboratory.

Chain of Custody



Workorder: AAJ0865 Workorder Name: Plant McDonough Owner Received Date: 10/3/2017 Results Requested By: 11/17/2017

Report To: Betsy McDaniel
 Pace Analytical Atlanta
 110 Technology Parkway
 Peachtree Corners, GA 30092
 Phone (770)-734-4200

Subcontract To: Pace - Pittsburgh
 1638 Roseytown Road
 Stes. 2,3,4
 Greensburg, PA 15601
 Phone (724) 850-5600

Item	Sample ID	Sample Type	Collect Date/Time	Lab ID	Matrix	Preserved Containers		Date/Time	Received By	Date/Time	Comments	LAB USE ONLY
						H	N					
11	DGWC-10	G	10/24/2017 14:30	AAJ0865-11	GW	2						
12	DGWC-11	G	10/24/2017 16:30	AAJ0865-12	GW	2						
13												
14												
15												
16												
17												
18												
19												
20												

Radium 226, 228, Total

30234155

011
012


Transfers	Released By	Date/Time	Received By	Date/Time
1	M. RAHMAN	10/25/17	[Signature]	10/25/17 10:50
2				
3				

Cooler Temperature on Receipt N/A °C Custody Seal Y or N Received on Ice Y or N Sample Intact Y or N

***In order to maintain client confidentiality, location/name of the sampling site, sampler's name and signature may not be provided on this COC
 This chain of custody is considered complete as is since this information is available in the owner laboratory.

30234155

Sample Condition Upon Receipt




Client Name: GCA Power

Project # AAJ0865

Courier: Fed Ex UPS USPS Client Commercial Pace Other

Tracking #: _____

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no



Packing Material: Bubble Wrap Bubble Bags None Other

Thermometer Used IR-4 Type of Ice: Wet Blue None Samples on ice, cooling process has begun

Cooler Temperature 0.6
Temp should be above freezing to 8°C

Biological Tissue is Frozen: Yes No

Date and Initials of person examining contents: 10/25/17 MR

Comments:

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.	
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.	
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.	
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.	
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.	
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.	
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.	
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.	
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.	
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.	
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.	
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.	
-Includes date/time/ID/Analysis Matrix:	<u>GCA</u>		
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.	
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed	Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.	
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.	
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.	
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A		
Pace Trip Blank Lot # (if purchased):			

Client Notification/ Resolution: _____ Date/Time: _____ Field Data Required? Y / N

Person Contacted: _____

Comments/ Resolution: _____

Project Manager Review: _____ Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

Pittsburgh Lab Sample Condition Upon Receipt

30234155



Client Name: PACE - GA Project # _____

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Label	<u>ZH</u>
LIMS Login	<u>BM</u>

Tracking #: 7741366594752

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Thermometer Used N/A Type of Ice: Wet Blue None

Cooler Temperature Observed Temp _____ °C Correction Factor: _____ °C Final Temp: _____ °C

Temp should be above freezing to 6°C

Date and Initials of person examining contents: ZH 10/26/17

Comments:	Yes	No	N/A	
Chain of Custody Present:	/			1.
Chain of Custody Filled Out:	/			2.
Chain of Custody Relinquished:	/			3.
Sampler Name & Signature on COC:		/		4.
Sample Labels match COC:	/			5.
-Includes date/time/ID Matrix: <u>WT</u>				
Samples Arrived within Hold Time:	/			6.
Short Hold Time Analysis (<72hr remaining):		/		7.
Rush Turn Around Time Requested:		/		8.
Sufficient Volume:	/			9.
Correct Containers Used:	/			10.
-Pace Containers Used:	/			
Containers Intact:	/			11.
Orthophosphate field filtered			/	12.
Hex Cr Aqueous Compliance/NPDES sample field filtered			/	13.
Organic Samples checked for dechlorination:			/	14.
Filtered volume received for Dissolved tests			/	15.
All containers have been checked for preservation.	/			16. <u>PHLZ</u>
All containers needing preservation are found to be in compliance with EPA recommendation.	/			
exceptions: VOA, coliform, TOC, O&G, Phenolics				Initial when completed: <u>ZH</u> Date/time of preservation: _____
				Lot # of added preservative: _____
Headspace in VOA Vials (>6mm):			/	17.
Trip Blank Present:			/	18.
Trip Blank Custody Seals Present			/	
Rad Aqueous Samples Screened > 0.5 mrem/hr		/		Initial when completed: <u>ZH</u> Date: <u>10/26/17</u>

Client Notification/ Resolution:
 Person Contacted: _____ Date/Time: _____ Contacted By: _____
 Comments/ Resolution: _____

A check in this box indicates that additional information has been stored in ereports.

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

*PM review is documented electronically in LIMS. When the Project Manager closes the SRF Review schedule in LIMS. The review is in the Status section of the Workorder Edit Screen.

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: LAL
Date: 10/31/2017
Worklist: 38463
Matrix: DW

Method Blank Assessment
MB Sample ID: 1362721
MB concentration: 0.309
M/B Counting Uncertainty: 0.178
MB MDC: 0.250
MB Numerical Performance Indicator: 3.40
MB Status vs Numerical Indicator: N/A
MB Status vs. MDC: See Comment*

Laboratory Control Sample Assessment

Count Date:	Count	Y
11/2/2017	LCS38463	
17-030	17-030	17-030
80.188	80.188	80.188
0.10	0.10	0.10
0.508	0.508	0.508
15.792	15.792	15.880
1.455	1.455	1.464
14.140	14.140	12.597
1.054	1.054	-3.70
-1.80	-1.80	79.28%
89.53%	89.53%	N/A
N/A	N/A	Pass

Duplicate Sample Assessment

Sample I.D.:	Duplicate Sample I.D.:	Sample Result (pCi/L, g, F):	Duplicate Result (pCi/L, g, F):	Sample Result Counting Uncertainty (pCi/L, g, F):	Duplicate Result Counting Uncertainty (pCi/L, g, F):	Sample Duplicate Result Are sample and/or duplicate results below MDC?	Duplicate Numerical Performance Indicator:	Duplicate Status vs Numerical Indicator:	Duplicate Status vs RPD:	Pass
LCS38463	LCS38463	14.140	14.140	1.054	1.054	NO	2.133	N/A	Pass	
12.597	12.597	0.947	0.947	NO	NO	11.54%	N/A	Pass		

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

*The method blank result is below the reporting limit for this analysis and is acceptable.

Sample Matrix Spike Control Assessment

Sample Collection Date:
Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:

MS/MSD Decay Corrected Spike Concentration (pCi/mL):
Spike Volume Used in MS (mL):
Spike Volume Used in MSD (mL):
MS Aliquot (L, g, F):
MS Target Conc. (pCi/L, g, F):
MSD Aliquot (L, g, F):
MSD Target Conc. (pCi/L, g, F):
Spike uncertainty (calculated):

Sample Result:
Sample Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Result:
Sample Matrix Spike Duplicate Result:
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
MS Numerical Performance Indicator:
MS Percent Recovery:
MSD Percent Recovery:
MS Status vs Numerical Indicator:
MS Status vs Recovery:
MSD Status vs Recovery:

Matrix Spike/Matrix Spike Duplicate Sample Assessment

Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:

Sample Matrix Spike Result:
Sample Matrix Spike Duplicate Result:
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
Duplicate Numerical Performance Indicator:
MS/MSD Duplicate Status vs Numerical Indicator:
MS/MSD Duplicate Status vs RPD:

Signature
11/1/17

Quality Control Sample Performance Assessment



Analyt. Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-228
Analyst: JLW
Date: 11/11/2017
Worklist: 38464
Matrix: DW

Method Blank Assessment	
MB Sample ID	1362722
MB concentration:	-0.001
M/B Counting Uncertainty:	0.365
MB MDC:	0.847
MB Numerical Performance Indicator:	-0.01
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment	
Count Date:	11/3/2017
Spike I.D.:	17-093
Spike Concentration (pCi/mL):	23.122
Volume Used (mL):	0.20
Aliquot Volume (L, g, F):	0.812
Target Conc. (pCi/L, g, F):	5.695
Uncertainty (Calculated):	0.410
Result (pCi/L, g, F):	6.629
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.698
Numerical Performance Indicator:	2.26
Percent Recovery:	116.38%
Status vs Numerical Indicator:	N/A
Status vs Recovery:	Pass

Duplicate Sample Assessment	
Sample I.D.:	30234155002
Duplicate Sample I.D.:	30234155002DUP
Sample Result (pCi/L, g, F):	0.446
Sample Result Counting Uncertainty (pCi/L, g, F):	0.344
Sample Duplicate Result (pCi/L, g, F):	0.614
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.377
Are sample and/or duplicate results below MDC?	See Below ##
Duplicate Numerical Performance Indicator:	-0.647
Duplicate RPD:	31.76%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Pass

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

Jan 11/13/17

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Laboratory Report

Prepared For:

**Georgia Power
2480 Maner Road
Atlanta, GA 30339**

Attention: Mr. Joju Abraham

Report Number: AAJ0956

November 08, 2017

Project: CCR Event

Project #:Plant McDonough

We appreciate the opportunity to provide the analytical support for your project. The analytical results in this report are based upon information supplied by you, the client, and are for your exclusive use. If you have any questions regarding this data package, please do not hesitate to call.

Approved:

A handwritten signature in black ink that reads "Betsy McDaniel" written over a horizontal line.

Project Manager

This report may not be reproduced, except in full, without written approval from Pace Analytical Services, LLC.
All test results relate only to the samples analyzed.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
DGWC-23	AAJ0956-01	Ground Water	10/26/17 10:05	10/27/17 11:00
DGWC-37	AAJ0956-02	Ground Water	10/26/17 11:05	10/27/17 11:00
DGWC-38	AAJ0956-03	Ground Water	10/26/17 13:30	10/27/17 11:00
DGWC-39	AAJ0956-04	Ground Water	10/26/17 14:40	10/27/17 11:00
DGWC-40	AAJ0956-05	Ground Water	10/26/17 12:05	10/27/17 11:00
DGWC-47	AAJ0956-06	Ground Water	10/26/17 13:35	10/27/17 11:00
DGWC-48	AAJ0956-07	Ground Water	10/26/17 15:20	10/27/17 11:00
FD-3	AAJ0956-08	Ground Water	10/26/17 00:00	10/27/17 11:00
FB-3	AAJ0956-09	Water	10/26/17 09:50	10/27/17 11:00
EB-3	AAJ0956-10	Water	10/26/17 14:50	10/27/17 11:00
DGWC-67	AAJ0956-11	Ground Water	10/26/17 10:05	10/27/17 11:00
DGWC-68A	AAJ0956-12	Ground Water	10/26/17 12:00	10/27/17 11:00
DGWC-69	AAJ0956-13	Ground Water	10/26/17 13:20	10/27/17 11:00



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

Case Narrative

The Radium analysis by methods EPA 9315/9320 was performed by Pace-Pittsburgh, 1638 Roseytown Road - Suites 2, 3, 4, Greensburg PA 15601. The Pace-Pittsburgh lab contact is Jacquelyn Collins at 724-850-5612.

Total Dissolved Solids Analysis by Method SM 2540C (H-02 Qualifier):

Sample AAJ0956-10 (EB-3) for TDS was originally analyzed within the sample holding time of 7 days. Due to a quality question, the sample was re-analyzed in duplicate. All batch QC and sample data from the re-analysis was acceptable. The results of the re-analysis have been reported with an H-02 qualifier.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

Report No.: AAJ0956

Project: CCR Event

Client ID: DGWC-23

Lab Number ID: AAJ0956-01

Date/Time Sampled: 10/26/2017 10:05:00AM

Date/Time Received: 10/27/2017 11:00:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	446	25	10	mg/L	SM 2540 C		1	11/01/17 15:45	11/01/17 15:45	7110011	JPT
Inorganic Anions											
Chloride	17	0.25	0.02	mg/L	EPA 300.0		1	11/02/17 18:04	11/03/17 13:10	7110072	RLC
Fluoride	0.66	0.30	0.03	mg/L	EPA 300.0		1	11/06/17 14:29	11/06/17 22:37	7110147	RLC
Sulfate	220	10	0.17	mg/L	EPA 300.0		10	11/02/17 18:04	11/05/17 16:45	7110072	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:01	7100837	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:01	7100837	CSW
Barium	0.0176	0.0100	0.0004	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:01	7100837	CSW
Beryllium	0.0004	0.0030	0.00009	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:01	7100837	CSW
Boron	4.07	0.0400	0.0060	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:01	7100837	CSW
Cadmium	0.0003	0.0010	0.0001	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:01	7100837	CSW
Calcium	67.2	25.0	2.02	mg/L	EPA 6020B		50	10/31/17 11:15	11/06/17 15:07	7100837	CSW
Chromium	0.0007	0.0100	0.0005	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:01	7100837	CSW
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:01	7100837	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:01	7100837	CSW
Molybdenum	0.0077	0.0100	0.0010	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:01	7100837	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:01	7100837	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:01	7100837	CSW
Lithium	0.0049	0.0500	0.0015	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:01	7100837	CSW
Mercury	0.00012	0.00050	0.000036	mg/L	EPA 7470A	J	1	11/03/17 09:50	11/03/17 12:26	7110070	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

November 08, 2017

Attention: Mr. Joju Abraham

Report No.: AAJ0956

Project: CCR Event

Client ID: DGWC-37

Lab Number ID: AAJ0956-02

Date/Time Sampled: 10/26/2017 11:05:00AM

Date/Time Received: 10/27/2017 11:00:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	340	25	10	mg/L	SM 2540 C		1	11/01/17 15:45	11/01/17 15:45	7110011	JPT
Inorganic Anions											
Chloride	6.4	0.25	0.02	mg/L	EPA 300.0		1	11/02/17 18:04	11/03/17 13:33	7110072	RLC
Fluoride	0.08	0.30	0.03	mg/L	EPA 300.0	J	1	11/06/17 14:29	11/06/17 22:58	7110147	RLC
Sulfate	97	10	0.17	mg/L	EPA 300.0		10	11/02/17 18:04	11/05/17 17:06	7110072	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:25	7100837	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:25	7100837	CSW
Barium	0.112	0.0100	0.0004	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:25	7100837	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:25	7100837	CSW
Boron	1.86	0.0400	0.0060	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:25	7100837	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:25	7100837	CSW
Calcium	60.8	25.0	2.02	mg/L	EPA 6020B		50	10/31/17 11:15	11/06/17 15:30	7100837	CSW
Chromium	0.0007	0.0100	0.0005	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:25	7100837	CSW
Cobalt	0.0003	0.0100	0.0003	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:25	7100837	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:25	7100837	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:25	7100837	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:25	7100837	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:25	7100837	CSW
Lithium	0.0018	0.0500	0.0015	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:25	7100837	CSW
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	11/03/17 09:50	11/03/17 12:28	7110070	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

Report No.: AAJ0956

Project: CCR Event

Client ID: DGWC-38

Lab Number ID: AAJ0956-03

Date/Time Sampled: 10/26/2017 1:30:00PM

Date/Time Received: 10/27/2017 11:00:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	554	25	10	mg/L	SM 2540 C		1	11/01/17 15:45	11/01/17 15:45	7110011	JPT
Inorganic Anions											
Chloride	8.2	0.25	0.02	mg/L	EPA 300.0		1	11/02/17 18:04	11/03/17 13:56	7110072	RLC
Fluoride	0.47	0.30	0.03	mg/L	EPA 300.0		1	11/06/17 14:29	11/07/17 00:00	7110147	RLC
Sulfate	260	10	0.17	mg/L	EPA 300.0		10	11/02/17 18:04	11/05/17 17:26	7110072	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:36	7100837	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:36	7100837	CSW
Barium	0.0333	0.0100	0.0004	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:36	7100837	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:36	7100837	CSW
Boron	2.92	0.0400	0.0060	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:36	7100837	CSW
Cadmium	0.0002	0.0010	0.0001	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:36	7100837	CSW
Calcium	81.3	25.0	2.02	mg/L	EPA 6020B		50	10/31/17 11:15	11/06/17 15:42	7100837	CSW
Chromium	0.0005	0.0100	0.0005	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:36	7100837	CSW
Cobalt	0.0016	0.0100	0.0003	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:36	7100837	CSW
Lead	0.0001	0.0050	0.00007	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:36	7100837	CSW
Molybdenum	0.0011	0.0100	0.0010	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:36	7100837	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:36	7100837	CSW
Thallium	0.0001	0.0010	0.00005	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:36	7100837	CSW
Lithium	0.0034	0.0500	0.0015	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:36	7100837	CSW
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	11/03/17 09:50	11/03/17 12:30	7110070	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

November 08, 2017

Attention: Mr. Joju Abraham

Report No.: AAJ0956
Client ID: DGWC-39
Date/Time Sampled: 10/26/2017 2:40:00PM
Matrix: Ground Water

Project: CCR Event
Lab Number ID: AAJ0956-04
Date/Time Received: 10/27/2017 11:00:00AM

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	532	25	10	mg/L	SM 2540 C		1	11/01/17 15:45	11/01/17 15:45	7110011	JPT
Inorganic Anions											
Chloride	8.3	0.25	0.02	mg/L	EPA 300.0		1	11/02/17 18:04	11/03/17 14:19	7110072	RLC
Fluoride	0.54	0.30	0.03	mg/L	EPA 300.0		1	11/06/17 14:29	11/07/17 00:21	7110147	RLC
Sulfate	210	20	0.34	mg/L	EPA 300.0		20	11/02/17 18:04	11/05/17 17:47	7110072	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:47	7100837	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:47	7100837	CSW
Barium	0.0899	0.0100	0.0004	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:47	7100837	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:47	7100837	CSW
Boron	3.41	0.0400	0.0060	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:47	7100837	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:47	7100837	CSW
Calcium	90.6	25.0	2.02	mg/L	EPA 6020B		50	10/31/17 11:15	11/06/17 15:53	7100837	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:47	7100837	CSW
Cobalt	0.0062	0.0100	0.0003	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:47	7100837	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:47	7100837	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:47	7100837	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:47	7100837	CSW
Thallium	0.0001	0.0010	0.00005	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:47	7100837	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:47	7100837	CSW
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	11/03/17 09:50	11/03/17 12:33	7110070	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

November 08, 2017

Attention: Mr. Joju Abraham

Report No.: AAJ0956

Project: CCR Event

Client ID: DGWC-40

Lab Number ID: AAJ0956-05

Date/Time Sampled: 10/26/2017 12:05:00PM

Date/Time Received: 10/27/2017 11:00:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	373	25	10	mg/L	SM 2540 C		1	11/01/17 15:45	11/01/17 15:45	7110011	JPT
Inorganic Anions											
Chloride	21	0.25	0.02	mg/L	EPA 300.0		1	11/02/17 18:04	11/03/17 15:27	7110072	RLC
Fluoride	0.50	0.30	0.03	mg/L	EPA 300.0		1	11/06/17 14:29	11/07/17 00:41	7110147	RLC
Sulfate	220	10	0.17	mg/L	EPA 300.0		10	11/02/17 18:04	11/05/17 18:08	7110072	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:59	7100837	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:59	7100837	CSW
Barium	0.0168	0.0100	0.0004	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:59	7100837	CSW
Beryllium	0.0027	0.0030	0.00009	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:59	7100837	CSW
Boron	0.873	0.0400	0.0060	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:59	7100837	CSW
Cadmium	0.0008	0.0010	0.0001	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:59	7100837	CSW
Calcium	41.8	25.0	2.02	mg/L	EPA 6020B		50	10/31/17 11:15	11/06/17 16:05	7100837	CSW
Chromium	0.0007	0.0100	0.0005	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:59	7100837	CSW
Cobalt	0.0371	0.0100	0.0003	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:59	7100837	CSW
Lead	0.00007	0.0050	0.00007	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:59	7100837	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 15:59	7100837	CSW
Selenium	0.0036	0.0100	0.0018	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:59	7100837	CSW
Thallium	0.00007	0.0010	0.00005	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:59	7100837	CSW
Lithium	0.0021	0.0500	0.0015	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 15:59	7100837	CSW
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	11/03/17 09:50	11/03/17 12:35	7110070	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

November 08, 2017

Attention: Mr. Joju Abraham

Report No.: AAJ0956

Project: CCR Event

Client ID: DGWC-47

Lab Number ID: AAJ0956-06

Date/Time Sampled: 10/26/2017 1:35:00PM

Date/Time Received: 10/27/2017 11:00:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	444	25	10	mg/L	SM 2540 C		1	11/01/17 15:45	11/01/17 15:45	7110011	JPT
Inorganic Anions											
Chloride	6.6	0.25	0.02	mg/L	EPA 300.0		1	11/02/17 18:04	11/03/17 15:50	7110072	RLC
Fluoride	1.0	0.30	0.03	mg/L	EPA 300.0		1	11/06/17 14:29	11/07/17 01:02	7110147	RLC
Sulfate	290	10	0.17	mg/L	EPA 300.0		10	11/02/17 18:04	11/05/17 18:28	7110072	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:10	7100837	CSW
Arsenic	0.0016	0.0050	0.0005	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 16:10	7100837	CSW
Barium	0.0152	0.0100	0.0004	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:10	7100837	CSW
Beryllium	0.0119	0.0030	0.00009	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:10	7100837	CSW
Boron	0.269	0.0400	0.0060	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:10	7100837	CSW
Cadmium	0.0015	0.0010	0.0001	mg/L	EPA 6020B		1	10/31/17 11:15	11/07/17 14:31	7100837	CSW
Calcium	46.7	25.0	2.02	mg/L	EPA 6020B		50	10/31/17 11:15	11/06/17 16:16	7100837	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:10	7100837	CSW
Cobalt	0.383	0.0100	0.0003	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:10	7100837	CSW
Lead	0.0009	0.0050	0.00007	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 16:10	7100837	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:10	7100837	CSW
Selenium	0.0097	0.0100	0.0018	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 16:10	7100837	CSW
Thallium	0.0003	0.0010	0.00005	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 16:10	7100837	CSW
Lithium	0.0710	0.0500	0.0015	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:10	7100837	CSW
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	11/03/17 09:50	11/03/17 12:42	7110070	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

November 08, 2017

Attention: Mr. Joju Abraham

Report No.: AAJ0956
Client ID: DGWC-48
Date/Time Sampled: 10/26/2017 3:20:00PM
Matrix: Ground Water

Project: CCR Event
Lab Number ID: AAJ0956-07
Date/Time Received: 10/27/2017 11:00:00AM

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	753	25	10	mg/L	SM 2540 C		1	11/01/17 15:45	11/01/17 15:45	7110011	JPT
Inorganic Anions											
Chloride	14	0.25	0.02	mg/L	EPA 300.0		1	11/02/17 18:04	11/03/17 16:13	7110072	RLC
Fluoride	1.7	0.30	0.03	mg/L	EPA 300.0		1	11/06/17 14:29	11/07/17 01:43	7110147	RLC
Sulfate	510	10	0.17	mg/L	EPA 300.0		10	11/02/17 18:04	11/05/17 18:49	7110072	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:45	7100837	CSW
Arsenic	0.0008	0.0050	0.0005	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 16:45	7100837	CSW
Barium	0.0117	0.0100	0.0004	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:45	7100837	CSW
Beryllium	0.0078	0.0030	0.00009	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:45	7100837	CSW
Boron	0.746	0.0400	0.0060	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:45	7100837	CSW
Cadmium	0.0032	0.0010	0.0001	mg/L	EPA 6020B		1	10/31/17 11:15	11/07/17 14:37	7100837	CSW
Calcium	94.0	25.0	2.02	mg/L	EPA 6020B		50	10/31/17 11:15	11/06/17 16:50	7100837	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:45	7100837	CSW
Cobalt	0.482	0.0100	0.0003	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:45	7100837	CSW
Lead	0.0022	0.0050	0.00007	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 16:45	7100837	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:45	7100837	CSW
Selenium	0.0058	0.0100	0.0018	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 16:45	7100837	CSW
Thallium	0.00009	0.0010	0.00005	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 16:45	7100837	CSW
Lithium	0.115	0.0500	0.0015	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:45	7100837	CSW
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	11/03/17 09:50	11/03/17 12:45	7110070	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

November 08, 2017

Attention: Mr. Joju Abraham

Report No.: AAJ0956

Project: CCR Event

Client ID: FD-3

Lab Number ID: AAJ0956-08

Date/Time Sampled: 10/26/2017 12:00:00AM

Date/Time Received: 10/27/2017 11:00:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	292	25	10	mg/L	SM 2540 C		1	11/01/17 15:45	11/01/17 15:45	7110011	JPT
Inorganic Anions											
Chloride	5.9	0.25	0.02	mg/L	EPA 300.0		1	11/02/17 18:04	11/03/17 18:08	7110072	RLC
Fluoride	0.04	0.30	0.03	mg/L	EPA 300.0	J	1	11/06/17 14:29	11/07/17 03:27	7110147	RLC
Sulfate	100	10	0.17	mg/L	EPA 300.0		10	11/02/17 18:04	11/05/17 19:10	7110072	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:56	7100837	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:56	7100837	CSW
Barium	0.106	0.0100	0.0004	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:56	7100837	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:56	7100837	CSW
Boron	3.26	0.0400	0.0060	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:56	7100837	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	10/31/17 11:15	11/07/17 14:42	7100837	CSW
Calcium	41.5	25.0	2.02	mg/L	EPA 6020B		50	10/31/17 11:15	11/06/17 17:02	7100837	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:56	7100837	CSW
Cobalt	0.0022	0.0100	0.0003	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 16:56	7100837	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:56	7100837	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:56	7100837	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:56	7100837	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 16:56	7100837	CSW
Lithium	0.0044	0.0500	0.0015	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 16:56	7100837	CSW
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	11/03/17 09:50	11/03/17 12:47	7110070	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

November 08, 2017

Attention: Mr. Joju Abraham

Report No.: AAJ0956

Project: CCR Event

Client ID: FB-3

Lab Number ID: AAJ0956-09

Date/Time Sampled: 10/26/2017 9:50:00AM

Date/Time Received: 10/27/2017 11:00:00AM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C		1	11/01/17 15:45	11/01/17 15:45	7110011	JPT
Inorganic Anions											
Chloride	ND	0.25	0.02	mg/L	EPA 300.0		1	11/02/17 18:04	11/03/17 18:31	7110072	RLC
Fluoride	ND	0.30	0.03	mg/L	EPA 300.0		1	11/06/17 14:29	11/07/17 03:47	7110147	RLC
Sulfate	ND	1.0	0.02	mg/L	EPA 300.0		1	11/02/17 18:04	11/03/17 18:31	7110072	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:07	7100837	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:07	7100837	CSW
Barium	ND	0.0100	0.0004	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:07	7100837	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:07	7100837	CSW
Boron	0.0073	0.0400	0.0060	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 17:07	7100837	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	10/31/17 11:15	11/07/17 14:48	7100837	CSW
Calcium	ND	0.500	0.0404	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:07	7100837	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:07	7100837	CSW
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:07	7100837	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:07	7100837	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:07	7100837	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:07	7100837	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:07	7100837	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:07	7100837	CSW
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	11/03/17 09:50	11/03/17 12:49	7110070	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

November 08, 2017

Attention: Mr. Joju Abraham

Report No.: AAJ0956

Project: CCR Event

Client ID: EB-3

Lab Number ID: AAJ0956-10

Date/Time Sampled: 10/26/2017 2:50:00PM

Date/Time Received: 10/27/2017 11:00:00AM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C	H-02	1	11/03/17 15:25	11/03/17 15:25	7110090	JPT
Inorganic Anions											
Chloride	0.05	0.25	0.02	mg/L	EPA 300.0	J	1	11/02/17 18:04	11/03/17 18:53	7110072	RLC
Fluoride	ND	0.30	0.03	mg/L	EPA 300.0		1	11/06/17 14:29	11/07/17 04:09	7110147	RLC
Sulfate	ND	1.0	0.02	mg/L	EPA 300.0		1	11/02/17 18:04	11/03/17 18:53	7110072	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:13	7100837	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:13	7100837	CSW
Barium	ND	0.0100	0.0004	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:13	7100837	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:13	7100837	CSW
Boron	ND	0.0400	0.0060	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:13	7100837	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	10/31/17 11:15	11/07/17 14:54	7100837	CSW
Calcium	ND	0.500	0.0404	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:13	7100837	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:13	7100837	CSW
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:13	7100837	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:13	7100837	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:13	7100837	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:13	7100837	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:13	7100837	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:13	7100837	CSW
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	11/03/17 09:50	11/03/17 12:52	7110070	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

November 08, 2017

Attention: Mr. Joju Abraham

Report No.: AAJ0956

Project: CCR Event

Client ID: DGWC-67

Lab Number ID: AAJ0956-11

Date/Time Sampled: 10/26/2017 10:05:00AM

Date/Time Received: 10/27/2017 11:00:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	319	25	10	mg/L	SM 2540 C		1	11/01/17 15:45	11/01/17 15:45	7110011	JPT
Inorganic Anions											
Chloride	6.0	0.25	0.02	mg/L	EPA 300.0		1	11/02/17 18:04	11/03/17 19:16	7110072	RLC
Fluoride	ND	0.30	0.03	mg/L	EPA 300.0		1	11/06/17 14:29	11/07/17 04:30	7110147	RLC
Sulfate	100	10	0.17	mg/L	EPA 300.0		10	11/02/17 18:04	11/05/17 19:30	7110072	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:19	7100837	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:19	7100837	CSW
Barium	0.105	0.0100	0.0004	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:19	7100837	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:19	7100837	CSW
Boron	3.21	0.0400	0.0060	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:19	7100837	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	10/31/17 11:15	11/07/17 14:59	7100837	CSW
Calcium	40.4	25.0	2.02	mg/L	EPA 6020B		50	10/31/17 11:15	11/06/17 17:25	7100837	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:19	7100837	CSW
Cobalt	0.0022	0.0100	0.0003	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 17:19	7100837	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:19	7100837	CSW
Molybdenum	ND	0.0100	0.0010	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:19	7100837	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:19	7100837	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:19	7100837	CSW
Lithium	0.0043	0.0500	0.0015	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 17:19	7100837	CSW
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	11/03/17 09:50	11/03/17 12:54	7110070	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

November 08, 2017

Attention: Mr. Joju Abraham

Report No.: AAJ0956

Project: CCR Event

Client ID: DGWC-68A

Lab Number ID: AAJ0956-12

Date/Time Sampled: 10/26/2017 12:00:00PM

Date/Time Received: 10/27/2017 11:00:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	287	25	10	mg/L	SM 2540 C		1	11/01/17 15:45	11/01/17 15:45	7110011	JPT
Inorganic Anions											
Chloride	4.4	0.25	0.02	mg/L	EPA 300.0		1	11/02/17 18:04	11/03/17 19:39	7110072	RLC
Fluoride	0.11	0.30	0.03	mg/L	EPA 300.0	J	1	11/06/17 14:29	11/07/17 04:51	7110147	RLC
Sulfate	48	1.0	0.02	mg/L	EPA 300.0		1	11/02/17 18:04	11/03/17 19:39	7110072	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:30	7100837	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:30	7100837	CSW
Barium	0.0878	0.0100	0.0004	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:30	7100837	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:30	7100837	CSW
Boron	2.05	0.0400	0.0060	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:30	7100837	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	10/31/17 11:15	11/07/17 15:05	7100837	CSW
Calcium	48.2	25.0	2.02	mg/L	EPA 6020B		50	10/31/17 11:15	11/06/17 17:36	7100837	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:30	7100837	CSW
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:30	7100837	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:30	7100837	CSW
Molybdenum	0.226	0.0100	0.0010	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:30	7100837	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:30	7100837	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:30	7100837	CSW
Lithium	ND	0.0500	0.0015	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 17:30	7100837	CSW
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	11/03/17 09:50	11/03/17 12:57	7110070	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

Report No.: AAJ0956

Project: CCR Event

Client ID: DGWC-69

Lab Number ID: AAJ0956-13

Date/Time Sampled: 10/26/2017 1:20:00PM

Date/Time Received: 10/27/2017 11:00:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	234	25	10	mg/L	SM 2540 C		1	11/01/17 15:45	11/01/17 15:45	7110011	JPT
Inorganic Anions											
Chloride	4.2	0.25	0.02	mg/L	EPA 300.0		1	11/02/17 18:04	11/03/17 20:25	7110072	RLC
Fluoride	0.29	0.30	0.03	mg/L	EPA 300.0	J	1	11/06/17 14:29	11/07/17 05:12	7110147	RLC
Sulfate	31	1.0	0.02	mg/L	EPA 300.0		1	11/02/17 18:04	11/03/17 20:25	7110072	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 18:19	7100837	CSW
Arsenic	0.114	0.0050	0.0005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 18:19	7100837	CSW
Barium	0.136	0.0100	0.0004	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 18:19	7100837	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 18:19	7100837	CSW
Boron	0.779	0.0400	0.0060	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 18:19	7100837	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	10/31/17 11:15	11/07/17 15:11	7100837	CSW
Calcium	33.3	25.0	2.02	mg/L	EPA 6020B		50	10/31/17 11:15	11/06/17 18:25	7100837	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 18:19	7100837	CSW
Cobalt	0.0031	0.0100	0.0003	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 18:19	7100837	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 18:19	7100837	CSW
Molybdenum	0.0244	0.0100	0.0010	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 18:19	7100837	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 18:19	7100837	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	10/31/17 11:15	11/06/17 18:19	7100837	CSW
Lithium	0.0034	0.0500	0.0015	mg/L	EPA 6020B	J	1	10/31/17 11:15	11/06/17 18:19	7100837	CSW
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	11/03/17 09:50	11/03/17 12:59	7110070	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

Report No.: AAJ0956

General Chemistry - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7110011 - SM 2540 C											
Blank (7110011-BLK1)						Prepared & Analyzed: 11/01/17					
Total Dissolved Solids	ND	25	10	mg/L							
LCS (7110011-BS1)						Prepared & Analyzed: 11/01/17					
Total Dissolved Solids	411	25	10	mg/L	400.00		103	84-108			
Duplicate (7110011-DUP1)						Source: AAJ0956-04			Prepared & Analyzed: 11/01/17		
Total Dissolved Solids	507	25	10	mg/L		532			5	10	
Duplicate (7110011-DUP2)						Source: AAJ0956-09			Prepared & Analyzed: 11/01/17		
Total Dissolved Solids	ND	25	10	mg/L		ND				10	
Batch 7110090 - SM 2540 C											
Blank (7110090-BLK1)						Prepared & Analyzed: 11/03/17					
Total Dissolved Solids	ND	25	10	mg/L							
LCS (7110090-BS1)						Prepared & Analyzed: 11/03/17					
Total Dissolved Solids	381	25	10	mg/L	400.00		95	84-108			
Duplicate (7110090-DUP1)						Source: AAJ0956-10RE1			Prepared & Analyzed: 11/03/17		
Total Dissolved Solids	ND	25	10	mg/L		ND				10	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

Report No.: AAJ0956

Inorganic Anions - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7110072 - EPA 300.0											
Blank (7110072-BLK1)						Prepared: 11/02/17 Analyzed: 11/03/17					
Chloride	ND	0.25	0.02	mg/L							
Sulfate	ND	1.0	0.02	mg/L							
LCS (7110072-BS1)						Prepared: 11/02/17 Analyzed: 11/03/17					
Chloride	11.0	0.25	0.02	mg/L	10.020		110	90-110			
Sulfate	11.0	1.0	0.02	mg/L	10.050		110	90-110			
Matrix Spike (7110072-MS1)						Source: AAJ0956-04 Prepared: 11/02/17 Analyzed: 11/03/17					
Chloride	18.4	0.25	0.02	mg/L	10.020	8.26	101	90-110			
Sulfate	166	1.0	0.02	mg/L	10.050	173	NR	90-110			QM-02
Matrix Spike (7110072-MS2)						Source: AAJ0956-12 Prepared: 11/02/17 Analyzed: 11/03/17					
Chloride	14.7	0.25	0.02	mg/L	10.020	4.35	104	90-110			
Sulfate	52.9	1.0	0.02	mg/L	10.050	47.6	53	90-110			QM-02
Matrix Spike Dup (7110072-MSD1)						Source: AAJ0956-04 Prepared: 11/02/17 Analyzed: 11/03/17					
Chloride	18.5	0.25	0.02	mg/L	10.020	8.26	102	90-110	0.4	15	
Sulfate	166	1.0	0.02	mg/L	10.050	173	NR	90-110	0.1	15	QM-02
Batch 7110147 - EPA 300.0											
Blank (7110147-BLK1)						Prepared & Analyzed: 11/06/17					
Chloride	ND	0.25	0.02	mg/L							
Fluoride	ND	0.30	0.03	mg/L							
Sulfate	0.03	1.0	0.02	mg/L							J
LCS (7110147-BS1)						Prepared & Analyzed: 11/06/17					
Chloride	10.5	0.25	0.02	mg/L	10.000		105	90-110			
Fluoride	10.3	0.30	0.03	mg/L	10.000		103	90-110			
Sulfate	10.5	1.0	0.02	mg/L	10.000		105	90-110			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

Report No.: AAJ0956

Inorganic Anions - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7110147 - EPA 300.0											
Matrix Spike (7110147-MS1)			Source: AAJ0956-02RE2			Prepared & Analyzed: 11/06/17					
Chloride	16.5	0.25	0.02	mg/L	10.000	6.44	100	90-110			
Fluoride	10.4	0.30	0.03	mg/L	10.000	0.08	103	90-110			
Sulfate	95.2	1.0	0.02	mg/L	10.000	95.2	NR	90-110			
Matrix Spike (7110147-MS2)			Source: AAJ0956-06RE2			Prepared: 11/06/17 Analyzed: 11/07/17					
Chloride	16.6	0.25	0.02	mg/L	10.000	8.59	80	90-110			
Fluoride	13.9	0.30	0.03	mg/L	10.000	1.00	129	90-110			QM-05
Sulfate	204	1.0	0.02	mg/L	10.000	217	NR	90-110			
Matrix Spike Dup (7110147-MSD1)			Source: AAJ0956-02RE2			Prepared & Analyzed: 11/06/17					
Chloride	16.7	0.25	0.02	mg/L	10.000	6.44	103	90-110	1	15	
Fluoride	10.8	0.30	0.03	mg/L	10.000	0.08	107	90-110	4	15	
Sulfate	95.3	1.0	0.02	mg/L	10.000	95.2	1	90-110	0.2	15	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

Report No.: AAJ0956

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	----	-----	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7100837 - EPA 3005A

Blank (7100837-BLK1)

Prepared: 10/31/17 Analyzed: 11/06/17

Antimony	ND	0.0030	0.0006	mg/L							
Arsenic	ND	0.0050	0.0005	mg/L							
Barium	ND	0.0100	0.0004	mg/L							
Beryllium	ND	0.0030	0.00009	mg/L							
Boron	ND	0.0400	0.0060	mg/L							
Cadmium	ND	0.0010	0.0001	mg/L							
Calcium	ND	0.500	0.0404	mg/L							
Chromium	ND	0.0100	0.0005	mg/L							
Cobalt	ND	0.0100	0.0003	mg/L							
Copper	ND	0.0250	0.0003	mg/L							
Lead	ND	0.0050	0.00007	mg/L							
Molybdenum	ND	0.0100	0.0010	mg/L							
Nickel	ND	0.0100	0.0005	mg/L							
Selenium	ND	0.0100	0.0018	mg/L							
Silver	ND	0.0100	0.0002	mg/L							
Thallium	ND	0.0010	0.00005	mg/L							
Vanadium	ND	0.0100	0.0012	mg/L							
Zinc	ND	0.0100	0.0012	mg/L							
Lithium	ND	0.0500	0.0015	mg/L							

LCS (7100837-BS1)

Prepared: 10/31/17 Analyzed: 11/06/17

Antimony	0.102	0.0030	0.0006	mg/L	0.10000		102	80-120			
Arsenic	0.0990	0.0050	0.0005	mg/L	0.10000		99	80-120			
Barium	0.0999	0.0100	0.0004	mg/L	0.10000		100	80-120			
Beryllium	0.0988	0.0030	0.00009	mg/L	0.10000		99	80-120			
Cadmium	0.101	0.0010	0.0001	mg/L	0.10000		101	80-120			
Chromium	0.103	0.0100	0.0005	mg/L	0.10000		103	80-120			
Cobalt	0.0993	0.0100	0.0003	mg/L	0.10000		99	80-120			
Copper	0.0999	0.0250	0.0003	mg/L	0.10000		100	80-120			
Lead	0.102	0.0050	0.00007	mg/L	0.10000		102	80-120			
Nickel	0.100	0.0100	0.0005	mg/L	0.10000		100	80-120			
Selenium	0.105	0.0100	0.0018	mg/L	0.10000		105	80-120			
Silver	0.0993	0.0100	0.0002	mg/L	0.10000		99	80-120			
Thallium	0.101	0.0010	0.00005	mg/L	0.10000		101	80-120			
Vanadium	0.100	0.0100	0.0012	mg/L	0.10000		100	80-120			
Zinc	0.102	0.0100	0.0012	mg/L	0.10000		102	80-120			
Lithium	0.104	0.0500	0.0015	mg/L	0.10000		104	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

Report No.: AAJ0956

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7100837 - EPA 3005A											
Matrix Spike (7100837-MS1)			Source: AAJ0956-13				Prepared: 10/31/17 Analyzed: 11/06/17				
Antimony	0.100	0.0030	0.0006	mg/L	0.10000	ND	100	75-125			
Arsenic	0.210	0.0050	0.0005	mg/L	0.10000	0.114	96	75-125			
Barium	0.224	0.0100	0.0004	mg/L	0.10000	0.136	88	75-125			
Beryllium	0.0914	0.0030	0.00009	mg/L	0.10000	ND	91	75-125			
Cadmium	0.103	0.0010	0.0001	mg/L	0.10000	ND	103	75-125			
Chromium	0.100	0.0100	0.0005	mg/L	0.10000	ND	100	75-125			
Cobalt	0.103	0.0100	0.0003	mg/L	0.10000	0.0031	100	75-125			
Copper	0.0980	0.0250	0.0003	mg/L	0.10000	0.0008	97	75-125			
Lead	0.0986	0.0050	0.00007	mg/L	0.10000	ND	99	75-125			
Nickel	0.103	0.0100	0.0005	mg/L	0.10000	0.0022	101	75-125			
Selenium	0.103	0.0100	0.0018	mg/L	0.10000	ND	103	75-125			
Silver	0.0946	0.0100	0.0002	mg/L	0.10000	ND	95	75-125			
Thallium	0.100	0.0010	0.00005	mg/L	0.10000	ND	100	75-125			
Vanadium	0.102	0.0100	0.0012	mg/L	0.10000	ND	102	75-125			
Zinc	0.102	0.0100	0.0012	mg/L	0.10000	ND	102	75-125			
Lithium	0.0973	0.0500	0.0015	mg/L	0.10000	0.0034	94	75-125			
Matrix Spike Dup (7100837-MSD1)			Source: AAJ0956-13				Prepared: 10/31/17 Analyzed: 11/06/17				
Antimony	0.102	0.0030	0.0006	mg/L	0.10000	ND	102	75-125	2	20	
Arsenic	0.211	0.0050	0.0005	mg/L	0.10000	0.114	98	75-125	0.7	20	
Barium	0.232	0.0100	0.0004	mg/L	0.10000	0.136	96	75-125	3	20	
Beryllium	0.0904	0.0030	0.00009	mg/L	0.10000	ND	90	75-125	1	20	
Cadmium	0.101	0.0010	0.0001	mg/L	0.10000	ND	101	75-125	2	20	
Chromium	0.0976	0.0100	0.0005	mg/L	0.10000	ND	98	75-125	3	20	
Cobalt	0.0989	0.0100	0.0003	mg/L	0.10000	0.0031	96	75-125	4	20	
Copper	0.0986	0.0250	0.0003	mg/L	0.10000	0.0008	98	75-125	0.6	20	
Lead	0.0974	0.0050	0.00007	mg/L	0.10000	ND	97	75-125	1	20	
Nickel	0.100	0.0100	0.0005	mg/L	0.10000	0.0022	98	75-125	3	20	
Selenium	0.102	0.0100	0.0018	mg/L	0.10000	ND	102	75-125	1	20	
Silver	0.0963	0.0100	0.0002	mg/L	0.10000	ND	96	75-125	2	20	
Thallium	0.0995	0.0010	0.00005	mg/L	0.10000	ND	100	75-125	0.5	20	
Vanadium	0.0972	0.0100	0.0012	mg/L	0.10000	ND	97	75-125	5	20	
Zinc	0.101	0.0100	0.0012	mg/L	0.10000	ND	101	75-125	1	20	
Lithium	0.0965	0.0500	0.0015	mg/L	0.10000	0.0034	93	75-125	0.8	20	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

Report No.: AAJ0956

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7100837 - EPA 3005A											
Post Spike (7100837-PS1)			Source: AAJ0956-13			Prepared: 10/31/17 Analyzed: 11/06/17					
Antimony	103			ug/L	100.00	0.0615	103	80-120			
Arsenic	213			ug/L	100.00	114	100	80-120			
Barium	228			ug/L	100.00	136	92	80-120			
Beryllium	87.8			ug/L	100.00	0.0619	88	80-120			
Cadmium	101			ug/L	100.00	0.0600	101	80-120			
Chromium	102			ug/L	100.00	0.189	102	80-120			
Cobalt	101			ug/L	100.00	3.05	98	80-120			
Copper	101			ug/L	100.00	0.816	100	80-120			
Lead	96.8			ug/L	100.00	0.0604	97	80-120			
Nickel	103			ug/L	100.00	2.25	101	80-120			
Selenium	104			ug/L	100.00	0.589	104	80-120			
Silver	96.6			ug/L	100.00	0.0063	97	80-120			
Thallium	97.6			ug/L	100.00	0.0036	98	80-120			
Vanadium	102			ug/L	100.00	-0.659	102	80-120			
Zinc	105			ug/L	100.00	0.989	104	80-120			
Lithium	93.2			ug/L	100.00	3.39	90	80-120			
Batch 7110070 - EPA 7470A											
Blank (7110070-BLK1)						Prepared & Analyzed: 11/03/17					
Mercury	ND	0.00050	0.000036	mg/L							
LCS (7110070-BS1)						Prepared & Analyzed: 11/03/17					
Mercury	0.00230	0.00050	0.000036	mg/L	2.5000E-3		92	80-120			
Matrix Spike (7110070-MS1)			Source: AAJ0956-01			Prepared & Analyzed: 11/03/17					
Mercury	0.00227	0.00050	0.000036	mg/L	2.5000E-3	0.00012	86	75-125			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

Report No.: AAJ0956

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7110070 - EPA 7470A											
Matrix Spike Dup (7110070-MSD1)			Source: AAJ0956-01			Prepared & Analyzed: 11/03/17					
Mercury	0.00219	0.00050	0.000036	mg/L	2.5000E-3	0.00012	83	75-125	4	20	
Post Spike (7110070-PS1)			Source: AAJ0956-01			Prepared & Analyzed: 11/03/17					
Mercury	1.58			ug/L	1.6667	0.0779	90	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 08, 2017

Legend

Definition of Laboratory Terms

- ND** - Not Detected at levels equal to or greater than the MDL
- BRL** - Not Detected at levels equal to or greater than the RL
- RL** - Reporting Limit **MDL** - Method Detection Limit
- SOP** - Method run per Pace Standard Operating Procedure
- CFU** - Colony Forming Units
- DF** - Dilution Factor **TIC** - Tentatively Identified Compound

Sample Information

N-Nitrosodiphenylamine breaks down to diphenylamine in the GCMS; both analytes are reported as N-Nitrosodiphenylamine. Pace is not NELAC certified for N-Nitrosodiphenylamine.

Phthalic acid and phthalic anhydride are reported as dimethyl phthalate

Maleic acid and maleic anhydride are reported as dimethyl malate

1,2-Diphenylhydrazine breaks down to azobenzene in the GCMS; both analytes are reported as azobenzene

Definition of Qualifiers

- QM-05** The spike recovery was outside acceptance limits for the MS and/or MSD and/or PDS due to suspected matrix interference. Sample results for the QC batch were accepted based on acceptable LCS recoveries.
- QM-02** The spike recovery is outside acceptance limits due to insignificant spike amount as compared to sample concentration.
- J** Estimated value less than Reporting Limit (RL) but greater than Method Detection Limit(MDL) (CLP J-Flag).
- H-02** Sample was prepared and/or analyzed outside of the EPA recommended holding time. See Case Narrative.

Note: Unless otherwise noted, all results are reported on an as received basis.



CHAIN OF CUSTODY RECORD

Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CLIENT NAME: Georgia Power CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185 Atlanta, GA 30308 404-506-7239		REPORT TO: Dawn Pirell (Dawn_Pirell@golder.com) REQUESTED COMPLETION DATE: laburch@southernco.com		CC: Maria Padilla kjiunko@golder.com PO #: laburch@southernco.com		PROJECT NAME/STATE: Plant McDonough AP Phase II CCR	
Collection DATE	Collection TIME	MATRIX CODE*	C O M P	G R A B	SAMPLE IDENTIFICATION	ANALYSIS REQUESTED	CONTAINER TYPE PRESERVATION
10/26/17	1005	GW	X	X	DGWC-23	Metals App. III & IV (EPA 8020/7470) Cl, T, SO ₄ & TDS (EPA 800.0 & SM 2540C) Radium 226 & 228 (SW-846 9315/9320)	P - PLASTIC A - AMBER GLASS G - CLEAR GLASS V - VOA VIAL S - STERILE O - OTHER
10/26/17	1105	GW	X	X	DGWC-37		1 - HCl, 56°C 2 - H ₂ SO ₄ , 56°C 3 - HNO ₃ 4 - NaOH, 56°C 5 - NaOH/ZnAc, 56°C 6 - Na ₂ S ₂ O ₃ , 56°C 7 - 56°C not frozen
10/26/17	1330	GW	X	X	DGWC-38		
10/26/17	1440	GW	X	X	DGWC-39		
10/26/17	1205	GW	X	X	DGWC-40		
10/26/17	1335	GW	X	X	DGWC-47		
10/26/17	1520	GW	X	X	DGWC-48		
10/26/17	-	GW	X	X	FD-3		
10/26/17	0950	W	X	X	FB-3		
10/26/17	1450	W	X	X	EB-3		
10/26/17	1005	GW	X	X	DGWC-67		
10/26/17	1200	GW	X	X	DGWC-68A		
10/26/17	1320	GW	X	X	DGWC-69		
SAMPLED BY AND TITLE: Ben Hodges, Field Lead		DATE/TIME: 10/27/17 0915		RELINQUISHED BY:		DATE/TIME:	
RECEIVED BY: M. H. Nouyva		DATE/TIME: 10/27/17 1100		RELINQUISHED BY:		DATE/TIME:	
TEMPERATURE:		TEMPERATURE:		USPS		USPS	
SECURITY SEAL: Intact		SECURITY SEAL: Broken		COOLERS: Present		COOLERS: Not Present	
LAB #: AAJ 0956		ENTERED INTO LIMS:		TRACKING #:		FOR LAB USE ONLY	

October 26 2017 Plant McDonough CCR Phase II CCR.xlsx



Sample Condition Upon Receipt

Client Name: GIA Power Project # AAJ0956

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: _____

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other _____

Thermometer Used IR-4 Type of Ice: Wet Blue None Samples on ice, cooling process has begun

Cooler Temperature 0.3 Biological Tissue is Frozen: Yes No

Temp should be above freezing to 6°C

Comments:

Date and initials of person examining contents: 10/27/17 MK

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.	
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.	
Chain of Custody Relinquished:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	3.	
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.	
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.	
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.	
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.	
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.	
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.	
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.	
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.	
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.	
-Includes date/time/ID/Analysis Matrix:	<u>GW</u>		
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.	
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed	Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.	
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.	
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.	
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A		
Pace Trip Blank Lot # (if purchased):			

Client Notification/ Resolution: _____ Field Data Required? Y / N

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: _____

Project Manager Review: _____ Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

LOG-IN CHECKLIST

Printed: 10/30/2017 7:47:38AM

Attn: Mr. Joju Abraham

Client: Georgia Power

Project: CCR Event

Date Received: 10/27/17 11:00

Work Order: AAJ0956

Logged In By: Mohammad M. Rahman

OBSERVATIONS

#Samples: 13

#Containers: 54

Minimum Temp(C): 0.3

Maximum Temp(C): 0.3

Custody Seal(s) Used: Yes

CHECKLIST ITEMS

- COC included with Samples YES
- Sample Container(s) Intact YES
- Chain of Custody Complete YES
- Sample Container(s) Match COC YES
- Custody seal Intact YES
- Temperature in Compliance YES
- Sufficient Sample Volume for Analysis YES
- Zero Headspace Maintained for VOA Analyses YES
- Samples labeled preserved (If Applicable) YES
- Samples received within Allowable Hold Times YES
- Samples Received on Ice YES
- Preservation Confirmed YES

Comments:

November 13, 2017

Mr. Joju Abraham
Georgia Power
2480 Maner Road
Atlanta, GA 30339

RE: Project: AAJ0956 Plant McDonough
Pace Project No.: 30234467

Dear Mr. Abraham:

Enclosed are the analytical results for sample(s) received by the laboratory on October 30, 2017. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Jacquelyn Collins
jacquelyn.collins@pacelabs.com
(724)850-5612
Project Manager

Enclosures



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: AAJ0956 Plant McDonough
Pace Project No.: 30234467

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601
L-A-B DOD-ELAP Accreditation #: L2417
Alabama Certification #: 41590
Arizona Certification #: AZ0734
Arkansas Certification
California Certification #: 04222CA
Colorado Certification
Connecticut Certification #: PH-0694
Delaware Certification
Florida/TNI Certification #: E87683
Georgia Certification #: C040
Guam Certification
Hawaii Certification
Idaho Certification
Illinois Certification
Indiana Certification
Iowa Certification #: 391
Kansas/TNI Certification #: E-10358
Kentucky Certification #: 90133
Louisiana DHH/TNI Certification #: LA140008
Louisiana DEQ/TNI Certification #: 4086
Maine Certification #: PA00091
Maryland Certification #: 308
Massachusetts Certification #: M-PA1457
Michigan/PADEP Certification
Missouri Certification #: 235

Montana Certification #: Cert 0082
Nebraska Certification #: NE-05-29-14
Nevada Certification #: PA014572015-1
New Hampshire/TNI Certification #: 2976
New Jersey/TNI Certification #: PA 051
New Mexico Certification #: PA01457
New York/TNI Certification #: 10888
North Carolina Certification #: 42706
North Dakota Certification #: R-190
Oregon/TNI Certification #: PA200002
Pennsylvania/TNI Certification #: 65-00282
Puerto Rico Certification #: PA01457
Rhode Island Certification #: 65-00282
South Dakota Certification
Tennessee Certification #: TN2867
Texas/TNI Certification #: T104704188-14-8
Utah/TNI Certification #: PA014572015-5
USDA Soil Permit #: P330-14-00213
Vermont Dept. of Health: ID# VT-0282
Virgin Island/PADEP Certification
Virginia/VELAP Certification #: 460198
Washington Certification #: C868
West Virginia DEP Certification #: 143
West Virginia DHHR Certification #: 9964C
Wisconsin Certification
Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: AAJ0956 Plant McDonough
Pace Project No.: 30234467

Lab ID	Sample ID	Matrix	Date Collected	Date Received
30234467001	DGWC-23	Water	10/26/17 10:05	10/30/17 09:30
30234467002	DGWC-37	Water	10/26/17 11:05	10/30/17 09:30
30234467003	DGWC-38	Water	10/26/17 13:30	10/30/17 09:30
30234467004	DGWC-39	Water	10/26/17 14:40	10/30/17 09:30
30234467005	DGWC-40	Water	10/26/17 12:05	10/30/17 09:30
30234467006	DGWC-47	Water	10/26/17 13:35	10/30/17 09:30
30234467007	DGWC-48	Water	10/26/17 15:20	10/30/17 09:30
30234467008	FD-3	Water	10/26/17 00:00	10/30/17 09:30
30234467009	FB-3	Water	10/26/17 09:50	10/30/17 09:30
30234467010	EB-3	Water	10/26/17 14:50	10/30/17 09:30
30234467011	DGWC-67	Water	10/26/17 10:05	10/30/17 09:30
30234467012	DGWC-68A	Water	10/26/17 12:00	10/30/17 09:30
30234467013	DGWC-69	Water	10/26/17 13:20	10/30/17 09:30

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: AAJ0956 Plant McDonough

Pace Project No.: 30234467

Lab ID	Sample ID	Method	Analysts	Analytes Reported
30234467001	DGWC-23	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30234467002	DGWC-37	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30234467003	DGWC-38	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30234467004	DGWC-39	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30234467005	DGWC-40	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30234467006	DGWC-47	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30234467007	DGWC-48	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30234467008	FD-3	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30234467009	FB-3	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30234467010	EB-3	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30234467011	DGWC-67	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30234467012	DGWC-68A	EPA 9315	LAL	1
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1
30234467013	DGWC-69	EPA 9315	LAL	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: AAJ0956 Plant McDonough
Pace Project No.: 30234467

Lab ID	Sample ID	Method	Analysts	Analytes Reported
		EPA 9320	JLW	1
		Total Radium Calculation	RMK	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAJ0956 Plant McDonough
Pace Project No.: 30234467

Sample: DGWC-23		Lab ID: 30234467001	Collected: 10/26/17 10:05	Received: 10/30/17 09:30	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac		Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.468 ± 0.274 (0.417)		pCi/L	11/03/17 09:25	13982-63-3	
		C:93% T:NA					
Radium-228	EPA 9320	0.516 ± 0.395 (0.781)		pCi/L	11/06/17 11:50	15262-20-1	
		C:82% T:79%					
Total Radium	Total Radium Calculation	0.984 ± 0.669 (1.20)		pCi/L	11/13/17 13:04	7440-14-4	

Sample: DGWC-37		Lab ID: 30234467002	Collected: 10/26/17 11:05	Received: 10/30/17 09:30	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac		Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.607 ± 0.288 (0.354)		pCi/L	11/03/17 09:25	13982-63-3	
		C:94% T:NA					
Radium-228	EPA 9320	0.428 ± 0.360 (0.719)		pCi/L	11/06/17 11:51	15262-20-1	
		C:80% T:85%					
Total Radium	Total Radium Calculation	1.04 ± 0.648 (1.07)		pCi/L	11/13/17 13:04	7440-14-4	

Sample: DGWC-38		Lab ID: 30234467003	Collected: 10/26/17 13:30	Received: 10/30/17 09:30	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac		Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.420 ± 0.285 (0.492)		pCi/L	11/03/17 09:25	13982-63-3	
		C:94% T:NA					
Radium-228	EPA 9320	0.714 ± 0.434 (0.812)		pCi/L	11/06/17 11:50	15262-20-1	
		C:82% T:76%					
Total Radium	Total Radium Calculation	1.13 ± 0.719 (1.30)		pCi/L	11/13/17 13:04	7440-14-4	

Sample: DGWC-39		Lab ID: 30234467004	Collected: 10/26/17 14:40	Received: 10/30/17 09:30	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac		Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.560 ± 0.285 (0.378)		pCi/L	11/03/17 09:26	13982-63-3	
		C:92% T:NA					
Radium-228	EPA 9320	0.315 ± 0.326 (0.674)		pCi/L	11/06/17 11:51	15262-20-1	
		C:83% T:83%					
Total Radium	Total Radium Calculation	0.875 ± 0.611 (1.05)		pCi/L	11/13/17 13:04	7440-14-4	

Sample: DGWC-40		Lab ID: 30234467005	Collected: 10/26/17 12:05	Received: 10/30/17 09:30	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Parameters	Method	Act ± Unc (MDC) Carr Trac		Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.661 ± 0.311 (0.385)		pCi/L	11/03/17 09:26	13982-63-3	
		C:91% T:NA					
Radium-228	EPA 9320	0.0869 ± 0.383 (0.871)		pCi/L	11/06/17 11:51	15262-20-1	
		C:82% T:73%					

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAJ0956 Plant McDonough
Pace Project No.: 30234467

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-40 Lab ID: 30234467005 Collected: 10/26/17 12:05 Received: 10/30/17 09:30 Matrix: Water PWS: Site ID: Sample Type:						
Total Radium	Total Radium Calculation	0.748 ± 0.694 (1.26)	pCi/L	11/13/17 13:04	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-47 Lab ID: 30234467006 Collected: 10/26/17 13:35 Received: 10/30/17 09:30 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	1.73 ± 0.511 (0.358) C:92% T:NA	pCi/L	11/03/17 09:26	13982-63-3	
Radium-228	EPA 9320	1.15 ± 0.503 (0.868) C:86% T:85%	pCi/L	11/06/17 15:39	15262-20-1	
Total Radium	Total Radium Calculation	2.88 ± 1.01 (1.23)	pCi/L	11/13/17 13:04	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-48 Lab ID: 30234467007 Collected: 10/26/17 15:20 Received: 10/30/17 09:30 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	1.66 ± 0.493 (0.394) C:95% T:NA	pCi/L	11/03/17 09:26	13982-63-3	
Radium-228	EPA 9320	2.08 ± 0.611 (0.772) C:87% T:84%	pCi/L	11/06/17 15:39	15262-20-1	
Total Radium	Total Radium Calculation	3.74 ± 1.10 (1.17)	pCi/L	11/13/17 13:04	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: FD-3 Lab ID: 30234467008 Collected: 10/26/17 00:00 Received: 10/30/17 09:30 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	0.493 ± 0.286 (0.444) C:89% T:NA	pCi/L	11/03/17 09:26	13982-63-3	
Radium-228	EPA 9320	0.525 ± 0.449 (0.920) C:87% T:85%	pCi/L	11/06/17 15:39	15262-20-1	
Total Radium	Total Radium Calculation	1.02 ± 0.735 (1.36)	pCi/L	11/13/17 13:11	7440-14-4	

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: FB-3 Lab ID: 30234467009 Collected: 10/26/17 09:50 Received: 10/30/17 09:30 Matrix: Water PWS: Site ID: Sample Type:						
Radium-226	EPA 9315	0.171 ± 0.201 (0.415) C:95% T:NA	pCi/L	11/03/17 09:26	13982-63-3	
Radium-228	EPA 9320	0.318 ± 0.432 (0.927) C:85% T:78%	pCi/L	11/06/17 15:39	15262-20-1	
Total Radium	Total Radium Calculation	0.489 ± 0.633 (1.34)	pCi/L	11/13/17 13:11	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAJ0956 Plant McDonough

Pace Project No.: 30234467

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226		EPA 9315	0.181 ± 0.187 (0.363) C:94% T:NA	pCi/L	11/03/17 09:26	13982-63-3	
Radium-228		EPA 9320	1.09 ± 0.505 (0.878) C:86% T:78%	pCi/L	11/06/17 15:39	15262-20-1	
Total Radium		Total Radium Calculation	1.27 ± 0.692 (1.24)	pCi/L	11/13/17 13:11	7440-14-4	

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226		EPA 9315	0.333 ± 0.266 (0.493) C:92% T:NA	pCi/L	11/03/17 09:27	13982-63-3	
Radium-228		EPA 9320	0.286 ± 0.382 (0.815) C:84% T:76%	pCi/L	11/06/17 15:43	15262-20-1	
Total Radium		Total Radium Calculation	0.619 ± 0.648 (1.31)	pCi/L	11/13/17 13:11	7440-14-4	

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226		EPA 9315	0.477 ± 0.260 (0.341) C:89% T:NA	pCi/L	11/03/17 09:27	13982-63-3	
Radium-228		EPA 9320	-0.0971 ± 0.263 (0.633) C:86% T:93%	pCi/L	11/06/17 15:43	15262-20-1	
Total Radium		Total Radium Calculation	0.477 ± 0.523 (0.974)	pCi/L	11/13/17 13:11	7440-14-4	

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226		EPA 9315	1.46 ± 0.458 (0.409) C:96% T:NA	pCi/L	11/03/17 09:27	13982-63-3	
Radium-228		EPA 9320	0.575 ± 0.372 (0.699) C:85% T:84%	pCi/L	11/06/17 15:43	15262-20-1	
Total Radium		Total Radium Calculation	2.04 ± 0.830 (1.11)	pCi/L	11/13/17 13:11	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAJ0956 Plant McDonough
Pace Project No.: 30234467

QC Batch:	277299	Analysis Method:	EPA 9320
QC Batch Method:	EPA 9320	Analysis Description:	9320 Radium 228
Associated Lab Samples:	30234467001, 30234467002, 30234467003, 30234467004, 30234467005, 30234467006, 30234467007, 30234467008, 30234467009, 30234467010, 30234467011, 30234467012, 30234467013		

METHOD BLANK:	1363109	Matrix:	Water
Associated Lab Samples:	30234467001, 30234467002, 30234467003, 30234467004, 30234467005, 30234467006, 30234467007, 30234467008, 30234467009, 30234467010, 30234467011, 30234467012, 30234467013		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.133 ± 0.339 (0.757) C:85% T:74%	pCi/L	11/06/17 11:51	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAJ0956 Plant McDonough

Pace Project No.: 30234467

QC Batch: 277298

Analysis Method: EPA 9315

QC Batch Method: EPA 9315

Analysis Description: 9315 Total Radium

Associated Lab Samples: 30234467001, 30234467002, 30234467003, 30234467004, 30234467005, 30234467006, 30234467007, 30234467008, 30234467009, 30234467010, 30234467011, 30234467012, 30234467013

METHOD BLANK: 1363108

Matrix: Water

Associated Lab Samples: 30234467001, 30234467002, 30234467003, 30234467004, 30234467005, 30234467006, 30234467007, 30234467008, 30234467009, 30234467010, 30234467011, 30234467012, 30234467013

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.304 ± 0.210 (0.324) C:97% T:NA	pCi/L	11/03/17 09:24	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: AAJ0956 Plant McDonough
Pace Project No.: 30234467

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

TNTC - Too Numerous To Count

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

Chain of Custody



Workorder: AAJ0956 Workorder Name: Plant McDonough Owner Received Date: 10/27/2017 Results Requested By: 11/21/2017

Report To:		Subcontract To:		Requested Analysis			
Betsy McDaniel Pace Analytical Atlanta 110 Technology Parkway Peachtree Corners, GA 30092 Phone (770)-734-4200		Pace - Pittsburgh 1638 Roseytown Road Stes. 2,3,4 Greensburg, PA 15601 Phone (724) 850-5600		WO#: 30234467 30234467			
Item	Sample ID	Sample Type	Collect Date/Time	Lab ID	Matrix	Preserved Containers	LAB USE ONLY
1	DGWC-23	G	10/26/2017 10:05	AAJ0956-01	GW	2	001
2	DGWC-37	G	10/26/2017 11:05	AAJ0956-02	GW	4	002
3	DGWC-38	G	10/26/2017 13:30	AAJ0956-03	GW	2	003
4	DGWC-39	G	10/26/2017 14:40	AAJ0956-04	GW	2	004
5	DGWC-40	G	10/26/2017 12:05	AAJ0956-05	GW	2	005
6	DGWC-47	G	10/26/2017 13:35	AAJ0956-06	GW	2	006
7	DGWC-48	G	10/26/2017 15:20	AAJ0956-07	GW	2	007
8	FD-3	G	10/26/2017 0:00	AAJ0956-08	GW	2	008
9	FB-3	G	10/26/2017 9:50	AAJ0956-09	W	2	009
10	EB-3	G	10/26/2017 14:50	AAJ0956-10	W	2	010
Transfers Released By						Date/Time	Comments
M. RAHMAN						10/27/17	10-30-17/0930
Received By						Date/Time	Comments
[Signature]						10-30-17/0930	

Cooler Temperature on Receipt N/A °C Custody Seal Y or N Received on Ice Y or N Sample Intact Y or N
 ***In order to maintain client confidentiality, location/name of the sampling site, sampler's name and signature may not be provided on this COC
 This chain of custody is considered complete as is since this information is available in the owner laboratory.

Chain of Custody




Workorder: AAJ0956 Workorder Name: Plant McDonough Owner Received Date: 10/27/2017 Results Requested By: 11/21/2017

Report To:		Subcontract To:		Requested Analysis			
Betsy McDaniel Pace Analytical Atlanta 110 Technology Parkway Peachtree Corners, GA 30092 Phone (770)-734-4200		Pace - Pittsburgh 1638 Roseytown Road Stes. 2,3,4 Greensburg, PA 15601 Phone (724) 850-5600		Radium 226, 228, Total			
Item	Sample ID	Sample Type	Collect Date/Time	Lab ID	Matrix	Preserved Containers	LAB USE ONLY
11	DGWC-67	G	10/26/2017 10:05	AAJ0956-11	GW	2	011
12	DGWC-68A	G	10/26/2017 12:00	AAJ0956-12	GW	2	012
13	DGWC-69	G	10/26/2017 13:20	AAJ0956-13	GW	2	013
14							
15							
16							
17							
18							
19							
20							
Transfers	Released By	Date/Time	Received By	Date/Time	Comments		
1	M. RAHMAN	10/27/17	Dr. [Signature]	10-30-17	023467		
2							
3							

Cooler Temperature on Receipt 4.1 °C Custody Seal Y or N Received on Ice Y or N Sample Intact Y or N

***In order to maintain client confidentiality, location/name of the sampling site, sampler's name and signature may not be provided on this COC

This chain of custody is considered complete as is since this information is available in the owner laboratory.



Sample Condition Upon Receipt

30234467

Client Name: GIA Power

Project # AAJ0966

Courier: Fed Ex UPS USPS Client Commercial Pace Other

Tracking #: _____

Custody Seal on Cooler/Box Present: yes no Seals Intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other

Thermometer Used IR-4 Type of Ice: Wet Blue None Samples on ice, cooling process has begun

Cooler Temperature 0.3
Temp should be above freezing to 8°C

Biological Tissue Is Frozen: Yes No

Date and Initials of person examining contents: 10/27/17 MK

Comments:

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.	
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.	
Chain of Custody Relinquished:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	3.	
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.	
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.	
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.	
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.	
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.	
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.	
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.	
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.	
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.	
-Includes date/time/ID/Analysis Matrix: <u>GIA</u>			
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.	
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed	Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.	
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.	
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.	
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A		
Pace Trip Blank Lot # (if purchased):			

Client Notification/ Resolution: _____ Field Data Required? Y / N

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: _____

Project Manager Review: _____ Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

Pittsburgh Lab Sample Condition Upon Receipt



Client Name: Pace, GA

Project # 30234467

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: 7413 6659 5244

Label	<u>BLM</u>
LIMS Login	<u>ANL</u>

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Thermometer Used N/A Type of Ice: Wet Blue None

Cooler Temperature _____ Observed Temp _____ °C Correction Factor: _____ °C Final Temp: _____ °C
Temp should be above freezing to 6°C

Date and Initials of person examining contents: ANL 10-30-17

Comments:

	Yes	No	N/A	
Chain of Custody Present:	X			1.
Chain of Custody Filled Out:	X			2.
Chain of Custody Relinquished:	X			3.
Sampler Name & Signature on COC:		X		4.
Sample Labels match COC:	X			5.
-Includes date/time/ID Matrix: <u>WI</u>				
Samples Arrived within Hold Time:	X			6.
Short Hold Time Analysis (<72hr remaining):		X		7.
Rush Turn Around Time Requested:		X		8.
Sufficient Volume:	X			9.
Correct Containers Used:	X			10.
-Pace Containers Used:	X			
Containers Intact:	X			11.
Orthophosphate field filtered			X	12.
Hex Cr Aqueous Compliance/NPDES sample field filtered			X	13.
Organic Samples checked for dechlorination:			X	14.
Filtered volume received for Dissolved tests			X	15.
All containers have been checked for preservation.	X			16.
All containers needing preservation are found to be in compliance with EPA recommendation.	X			
exceptions: VOA, coliform, TOC, O&G, Phenolics				
				Initial when completed: <u>ANL</u> Date/time of preservation
				Lot # of added preservative
Headspace in VOA Vials (>6mm):			X	17.
Trip Blank Present:		X		18.
Trip Blank Custody Seals Present		X		
Rad Aqueous Samples Screened > 0.5 mrem/hr		X		Initial when completed: <u>ANL</u> Date: <u>10-30-17</u>

Client Notification/ Resolution:

Person Contacted: _____ Date/Time: _____ Contacted By: _____
 Comments/ Resolution: _____

A check in this box indicates that additional information has been stored in ereports.

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)
 *PM review is documented electronically in LIMS. When the Project Manager closes the SRF Review schedule in LIMS. The review is in the Status section of the Workorder Edit Screen.

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: LAL
Date: 11/21/2017
Worklist: 38483
Matrix: DW

Method Blank Assessment

MB Sample ID: 1383108
MB concentration: 0.304
MB Counting Uncertainty: 0.205
MB MDC: 0.324
MB Numerical Performance Indicator: 2.91
MB Status vs Numerical Indicator: N/A
MB Status vs. MDC: Pass

Laboratory Control Sample Assessment

LCS# 38483 LCS# 38483

Count Date: 11/3/2017

Spike I.D.: 17-030

Spike Concentration (pCi/mL): 80.188
Volume Used (mL): 0.10
Aliquot Volume (L, g, F): 0.520
Target Conc. (pCi/L, g, F): 15.432
Uncertainty (Calculated): 1.422
Result (pCi/L, g, F): 12.579
LCS/LCSD Counting Uncertainty (pCi/L, g, F): 1.073
Numerical Performance Indicator: -3.14
Percent Recovery: 81.51%
Status vs Numerical Indicator: N/A
Status vs Recovery: Pass

Duplicate Sample Assessment

Sample I.D.: 30234467002
Duplicate Sample I.D.: 30234467002DUP

Sample Result (pCi/L, g, F): 0.607
Sample Result Counting Uncertainty (pCi/L, g, F): 0.273
Sample Duplicate Result (pCi/L, g, F): 0.573
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F): 0.320
Are sample and/or duplicate results below MDC? See Below ##
Duplicate Numerical Performance Indicator: 0.155
Duplicate RPD: 5.63%
Duplicate Status vs Numerical Indicator: N/A
Duplicate Status vs RPD: Pass

Enter Duplicate sample IDs if other than LCS/LCSD in the space below.
30234467002
30234467002DUP

Sample Matrix Spike Control Assessment

Sample Collection Date:
Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:

Spike I.D.:
MS/MSD Decay Corrected Spike Concentration (pCi/mL):
Spike Volume Used in MS (mL):
Spike Volume Used in MSD (mL):
MS Aliquot (L, g, F):
MS Target Conc. (pCi/L, g, F):
MSD Aliquot (L, g, F):
MSD Target Conc. (pCi/L, g, F):
Spike uncertainty (calculated):

Sample Result:
Sample Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
MS Numerical Performance Indicator:
MSD Numerical Performance Indicator:
MS Percent Recovery:
MSD Percent Recovery:
MS Status vs Numerical Indicator:
MSD Status vs Numerical Indicator:
MS Status vs Recovery:
MSD Status vs Recovery:

Matrix Spike/Matrix Spike Duplicate Sample Assessment


Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:

Sample Matrix Spike Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
Duplicate Numerical Performance Indicator:
MS/MSD Duplicate RPD:
MS/MSD Duplicate Status vs Numerical Indicator:
MS/MSD Duplicate Status vs RPD:

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:
None

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-228
Analyst: JLLW
Date: 11/2/2017
Worklist: 38484
Matrix: DW

Method Blank Assessment	
MB Sample ID	1363109
MB Concentration:	0.133
MB Counting Uncertainty:	0.338
MB MDC:	0.757
MB Numerical Performance Indicator:	0.77
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment	
Count Date:	11/6/2017
Spike I.D.:	17-033
Spike Concentration (pCi/mL):	23.099
Volume Used (mL):	0.20
Aliquot Volume (L, g, F):	0.803
Target Conc. (pCi/L, g, F):	5.751
Uncertainty (Calculated):	0.414
Result (pCi/L, g, F):	5.828
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.18
Numerical Performance Indicator:	101.33%
Status vs Numerical Indicator:	N/A
Status vs Recovery:	Pass

Duplicate Sample Assessment	
Sample I.D.:	30234467002
Duplicate Sample I.D.:	30234467002DUP
Sample Result (pCi/L, g, F):	0.428
Sample Result Counting Uncertainty (pCi/L, g, F):	0.352
Sample Duplicate Result (pCi/L, g, F):	0.213
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.317
Are sample and/or duplicate results below MDC?	See Below ##
Duplicate Numerical Performance Indicator:	0.891
Duplicate RPD:	67.21%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Fail***

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

***Batch must be re-prepped due to unacceptable precision.

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Sample Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
Duplicate Numerical Performance Indicator (Based on the Percent Recoveries) MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	

Handwritten signature/initials



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Laboratory Report

Prepared For:

**Georgia Power
2480 Maner Road
Atlanta, GA 30339**

Attention: Mr. Joju Abraham

Report Number: AAK0586

November 22, 2017

Project: CCR Event

Project #:Plant McDonough

We appreciate the opportunity to provide the analytical support for your project. The analytical results in this report are based upon information supplied by you, the client, and are for your exclusive use. If you have any questions regarding this data package, please do not hesitate to call.

Approved:

A handwritten signature in black ink that reads "Betsy McDonough" written over a horizontal line.

Project Manager

This report may not be reproduced, except in full, without written approval from Pace Analytical Services, LLC.
All test results relate only to the samples analyzed.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 22, 2017

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
DGWA-53	AAK0586-01	Ground Water	11/15/17 15:25	11/16/17 10:10
DGWA-71	AAK0586-02	Ground Water	11/15/17 11:05	11/16/17 10:10
FB-1	AAK0586-03	Water	11/15/17 10:45	11/16/17 10:10
DGWC-4	AAK0586-04	Ground Water	11/15/17 10:20	11/16/17 10:10
FD-1	AAK0586-05	Ground Water	11/15/17 00:00	11/16/17 10:10
DGWC-10	AAK0586-06	Ground Water	11/15/17 11:35	11/16/17 10:10
DGWC-13	AAK0586-07	Ground Water	11/15/17 15:45	11/16/17 10:10
DGWC-69	AAK0586-08	Ground Water	11/15/17 13:35	11/16/17 10:10



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 22, 2017

Case Narrative

The Radium analysis by methods EPA 9315/9320 was performed by Pace-Pittsburgh, 1638 Roseytown Road - Suites 2, 3, 4, Greensburg PA 15601. The Pace-Pittsburgh lab contact is Jacquelyn Collins at 724-850-5612.



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 22, 2017

Report No.: AAK0586

Project: CCR Event

Client ID: DGWA-53

Lab Number ID: AAK0586-01

Date/Time Sampled: 11/15/2017 3:25:00PM

Date/Time Received: 11/16/2017 10:10:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	241	25	10	mg/L	SM 2540 C		1	11/20/17 16:40	11/20/17 16:40	7110570	JPT
Inorganic Anions											
Chloride	2.2	0.25	0.02	mg/L	EPA 300.0		1	11/20/17 09:03	11/21/17 10:31	7110553	RLC
Fluoride	0.05	0.30	0.03	mg/L	EPA 300.0	J	1	11/20/17 09:03	11/21/17 10:31	7110553	RLC
Sulfate	3.8	1.0	0.02	mg/L	EPA 300.0		1	11/20/17 09:03	11/21/17 10:31	7110553	RLC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 22, 2017

Report No.: AAK0586

Project: CCR Event

Client ID: DGWA-71

Lab Number ID: AAK0586-02

Date/Time Sampled: 11/15/2017 11:05:00AM

Date/Time Received: 11/16/2017 10:10:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	90	25	10	mg/L	SM 2540 C		1	11/20/17 16:40	11/20/17 16:40	7110570	JPT
Inorganic Anions											
Chloride	3.1	0.25	0.02	mg/L	EPA 300.0		1	11/20/17 09:03	11/21/17 12:38	7110553	RLC
Fluoride	ND	0.30	0.03	mg/L	EPA 300.0		1	11/20/17 09:03	11/21/17 12:38	7110553	RLC
Sulfate	7.8	1.0	0.02	mg/L	EPA 300.0		1	11/20/17 09:03	11/21/17 12:38	7110553	RLC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 22, 2017

Report No.: AAK0586

Project: CCR Event

Client ID: FB-1

Lab Number ID: AAK0586-03

Date/Time Sampled: 11/15/2017 10:45:00AM

Date/Time Received: 11/16/2017 10:10:00AM

Matrix: Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	ND	25	10	mg/L	SM 2540 C		1	11/20/17 16:40	11/20/17 16:40	7110570	JPT
Inorganic Anions											
Chloride	ND	0.25	0.02	mg/L	EPA 300.0		1	11/20/17 09:03	11/21/17 12:59	7110553	RLC
Fluoride	ND	0.30	0.03	mg/L	EPA 300.0		1	11/20/17 09:03	11/21/17 12:59	7110553	RLC
Sulfate	ND	1.0	0.02	mg/L	EPA 300.0		1	11/20/17 09:03	11/21/17 12:59	7110553	RLC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 22, 2017

Report No.: AAK0586

Project: CCR Event

Client ID: DGWC-4

Lab Number ID: AAK0586-04

Date/Time Sampled: 11/15/2017 10:20:00AM

Date/Time Received: 11/16/2017 10:10:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	1330	25	10	mg/L	SM 2540 C		1	11/20/17 16:40	11/20/17 16:40	7110570	JPT
Inorganic Anions											
Chloride	27	0.25	0.02	mg/L	EPA 300.0		1	11/20/17 09:03	11/21/17 13:21	7110553	RLC
Fluoride	0.79	0.30	0.03	mg/L	EPA 300.0		1	11/20/17 09:03	11/21/17 13:21	7110553	RLC
Sulfate	820	25	0.42	mg/L	EPA 300.0		25	11/20/17 09:03	11/21/17 17:35	7110553	RLC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 22, 2017

Report No.: AAK0586

Project: CCR Event

Client ID: FD-1

Lab Number ID: AAK0586-05

Date/Time Sampled: 11/15/2017 12:00:00AM

Date/Time Received: 11/16/2017 10:10:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	1350	25	10	mg/L	SM 2540 C		1	11/20/17 16:40	11/20/17 16:40	7110570	JPT
Inorganic Anions											
Chloride	29	0.25	0.02	mg/L	EPA 300.0		1	11/20/17 09:03	11/21/17 13:42	7110553	RLC
Fluoride	1.5	0.30	0.03	mg/L	EPA 300.0		1	11/20/17 09:03	11/21/17 13:42	7110553	RLC
Sulfate	830	25	0.42	mg/L	EPA 300.0		25	11/20/17 09:03	11/21/17 17:56	7110553	RLC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 22, 2017

Report No.: AAK0586

Project: CCR Event

Client ID: DGWC-10

Lab Number ID: AAK0586-06

Date/Time Sampled: 11/15/2017 11:35:00AM

Date/Time Received: 11/16/2017 10:10:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	582	25	10	mg/L	SM 2540 C		1	11/20/17 16:40	11/20/17 16:40	7110570	JPT
Inorganic Anions											
Chloride	12	0.25	0.02	mg/L	EPA 300.0		1	11/20/17 09:03	11/21/17 14:03	7110553	RLC
Fluoride	1.4	0.30	0.03	mg/L	EPA 300.0		1	11/20/17 09:03	11/21/17 14:03	7110553	RLC
Sulfate	390	20	0.34	mg/L	EPA 300.0		20	11/20/17 09:03	11/21/17 18:18	7110553	RLC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

November 22, 2017

Attention: Mr. Joju Abraham

Report No.: AAK0586

Project: CCR Event

Client ID: DGWC-13

Lab Number ID: AAK0586-07

Date/Time Sampled: 11/15/2017 3:45:00PM

Date/Time Received: 11/16/2017 10:10:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	325	25	10	mg/L	SM 2540 C		1	11/20/17 16:40	11/20/17 16:40	7110570	JPT
Inorganic Anions											
Chloride	16	0.25	0.02	mg/L	EPA 300.0		1	11/20/17 09:03	11/21/17 14:24	7110553	RLC
Fluoride	0.44	0.30	0.03	mg/L	EPA 300.0		1	11/20/17 09:03	11/21/17 14:24	7110553	RLC
Sulfate	180	20	0.34	mg/L	EPA 300.0		20	11/20/17 09:03	11/21/17 18:39	7110553	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	11/17/17 10:15	11/21/17 23:13	7110503	CSW
Arsenic	ND	0.0050	0.0005	mg/L	EPA 6020B		1	11/17/17 10:15	11/21/17 23:13	7110503	CSW
Barium	0.0309	0.0100	0.0004	mg/L	EPA 6020B		1	11/17/17 10:15	11/21/17 23:13	7110503	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	11/17/17 10:15	11/21/17 23:13	7110503	CSW
Boron	0.795	0.0400	0.0060	mg/L	EPA 6020B		1	11/17/17 10:15	11/21/17 23:13	7110503	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	11/17/17 10:15	11/21/17 23:13	7110503	CSW
Calcium	49.3	25.0	2.02	mg/L	EPA 6020B		50	11/17/17 10:15	11/21/17 23:19	7110503	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	11/17/17 10:15	11/21/17 23:13	7110503	CSW
Cobalt	ND	0.0100	0.0003	mg/L	EPA 6020B		1	11/17/17 10:15	11/21/17 23:13	7110503	CSW
Lead	ND	0.0050	0.00007	mg/L	EPA 6020B		1	11/17/17 10:15	11/21/17 23:13	7110503	CSW
Molybdenum	0.0275	0.0100	0.0010	mg/L	EPA 6020B		1	11/17/17 10:15	11/21/17 23:13	7110503	CSW
Selenium	0.0019	0.0100	0.0018	mg/L	EPA 6020B	J	1	11/17/17 10:15	11/21/17 23:13	7110503	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	11/17/17 10:15	11/21/17 23:13	7110503	CSW
Lithium	0.0028	0.0500	0.0015	mg/L	EPA 6020B	J	1	11/17/17 10:15	11/21/17 23:13	7110503	CSW
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	11/20/17 12:30	11/21/17 12:53	7110549	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

November 22, 2017

Attention: Mr. Joju Abraham

Report No.: AAK0586

Project: CCR Event

Client ID: DGWC-69

Lab Number ID: AAK0586-08

Date/Time Sampled: 11/15/2017 1:35:00PM

Date/Time Received: 11/16/2017 10:10:00AM

Matrix: Ground Water

Analyte	Result	RL	MDL	Units	Method	Qual.	DF	Preparation Date	Analytical Date	Batch	Init.
General Chemistry											
Total Dissolved Solids	188	25	10	mg/L	SM 2540 C		1	11/20/17 16:40	11/20/17 16:40	7110570	JPT
Inorganic Anions											
Chloride	4.7	0.25	0.02	mg/L	EPA 300.0		1	11/20/17 09:03	11/21/17 14:46	7110553	RLC
Fluoride	0.28	0.30	0.03	mg/L	EPA 300.0	J	1	11/20/17 09:03	11/21/17 14:46	7110553	RLC
Sulfate	29	1.0	0.02	mg/L	EPA 300.0		1	11/20/17 09:03	11/21/17 14:46	7110553	RLC
Metals, Total											
Antimony	ND	0.0030	0.0006	mg/L	EPA 6020B		1	11/17/17 10:15	11/21/17 23:24	7110503	CSW
Arsenic	0.164	0.0050	0.0005	mg/L	EPA 6020B		1	11/17/17 10:15	11/21/17 23:24	7110503	CSW
Barium	0.107	0.0100	0.0004	mg/L	EPA 6020B		1	11/17/17 10:15	11/21/17 23:24	7110503	CSW
Beryllium	ND	0.0030	0.00009	mg/L	EPA 6020B		1	11/17/17 10:15	11/21/17 23:24	7110503	CSW
Boron	0.667	0.0400	0.0060	mg/L	EPA 6020B		1	11/17/17 10:15	11/21/17 23:24	7110503	CSW
Cadmium	ND	0.0010	0.0001	mg/L	EPA 6020B		1	11/17/17 10:15	11/21/17 23:24	7110503	CSW
Calcium	30.6	25.0	2.02	mg/L	EPA 6020B		50	11/17/17 10:15	11/21/17 23:30	7110503	CSW
Chromium	ND	0.0100	0.0005	mg/L	EPA 6020B		1	11/17/17 10:15	11/21/17 23:24	7110503	CSW
Cobalt	0.0028	0.0100	0.0003	mg/L	EPA 6020B	J	1	11/17/17 10:15	11/21/17 23:24	7110503	CSW
Lead	0.00009	0.0050	0.00007	mg/L	EPA 6020B	J	1	11/17/17 10:15	11/21/17 23:24	7110503	CSW
Molybdenum	0.0237	0.0100	0.0010	mg/L	EPA 6020B		1	11/17/17 10:15	11/21/17 23:24	7110503	CSW
Selenium	ND	0.0100	0.0018	mg/L	EPA 6020B		1	11/17/17 10:15	11/21/17 23:24	7110503	CSW
Thallium	ND	0.0010	0.00005	mg/L	EPA 6020B		1	11/17/17 10:15	11/21/17 23:24	7110503	CSW
Lithium	0.0034	0.0500	0.0015	mg/L	EPA 6020B	J	1	11/17/17 10:15	11/21/17 23:24	7110503	CSW
Mercury	ND	0.00050	0.000036	mg/L	EPA 7470A		1	11/20/17 12:30	11/21/17 12:55	7110549	MTC



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 22, 2017

Report No.: AAK0586

General Chemistry - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7110570 - SM 2540 C											
Blank (7110570-BLK1)						Prepared & Analyzed: 11/20/17					
Total Dissolved Solids	ND	25	10	mg/L							
LCS (7110570-BS1)						Prepared & Analyzed: 11/20/17					
Total Dissolved Solids	416	25	10	mg/L	400.00		104	84-108			
Duplicate (7110570-DUP1)						Source: AAK0586-01 Prepared & Analyzed: 11/20/17					
Total Dissolved Solids	230	25	10	mg/L		241			5	10	
Duplicate (7110570-DUP2)						Source: AAK0586-03 Prepared & Analyzed: 11/20/17					
Total Dissolved Solids	ND	25	10	mg/L		ND				10	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 22, 2017

Report No.: AAK0586

Inorganic Anions - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7110553 - EPA 9056A											
Blank (7110553-BLK1) Prepared: 11/20/17 Analyzed: 11/21/17											
Chloride	ND	0.25	0.02	mg/L							
Fluoride	ND	0.30	0.03	mg/L							
Sulfate	ND	1.0	0.02	mg/L							
LCS (7110553-BS1) Prepared: 11/20/17 Analyzed: 11/21/17											
Chloride	11.0	0.25	0.02	mg/L	10.000		110	90-110			
Fluoride	10.6	0.30	0.03	mg/L	10.000		106	90-110			
Sulfate	10.9	1.0	0.02	mg/L	10.000		109	90-110			
Matrix Spike (7110553-MS1) Source: AAK0578-03 Prepared: 11/20/17 Analyzed: 11/21/17											
Chloride	13.6	0.25	0.02	mg/L	10.000	3.09	105	90-110			
Fluoride	11.0	0.30	0.03	mg/L	10.000	ND	110	90-110			
Sulfate	72.8	1.0	0.02	mg/L	10.000	70.1	27	90-110			QM-02
Matrix Spike (7110553-MS2) Source: AAK0586-01 Prepared: 11/20/17 Analyzed: 11/21/17											
Chloride	12.6	0.25	0.02	mg/L	10.000	2.20	104	90-110			
Fluoride	11.0	0.30	0.03	mg/L	10.000	0.05	109	90-110			
Sulfate	13.9	1.0	0.02	mg/L	10.000	3.83	101	90-110			
Matrix Spike Dup (7110553-MSD1) Source: AAK0578-03 Prepared: 11/20/17 Analyzed: 11/21/17											
Chloride	13.6	0.25	0.02	mg/L	10.000	3.09	106	90-110	0.1	15	
Fluoride	11.0	0.30	0.03	mg/L	10.000	ND	110	90-110	0.1	15	
Sulfate	72.9	1.0	0.02	mg/L	10.000	70.1	27	90-110	0.1	15	QM-02



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 22, 2017

Report No.: AAK0586

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	----	-----	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch 7110503 - EPA 3005A

Blank (7110503-BLK1)

Prepared: 11/17/17 Analyzed: 11/21/17

Antimony	ND	0.0030	0.0006	mg/L							
Arsenic	ND	0.0050	0.0005	mg/L							
Barium	ND	0.0100	0.0004	mg/L							
Beryllium	ND	0.0030	0.00009	mg/L							
Boron	ND	0.0400	0.0060	mg/L							
Cadmium	ND	0.0010	0.0001	mg/L							
Calcium	ND	0.500	0.0404	mg/L							
Chromium	ND	0.0100	0.0005	mg/L							
Cobalt	ND	0.0100	0.0003	mg/L							
Copper	ND	0.0250	0.0003	mg/L							
Lead	ND	0.0050	0.00007	mg/L							
Molybdenum	ND	0.0100	0.0010	mg/L							
Nickel	ND	0.0100	0.0005	mg/L							
Selenium	ND	0.0100	0.0018	mg/L							
Silver	ND	0.0100	0.0002	mg/L							
Thallium	ND	0.0010	0.00005	mg/L							
Vanadium	ND	0.0100	0.0012	mg/L							
Zinc	ND	0.0100	0.0012	mg/L							
Lithium	ND	0.0500	0.0015	mg/L							

LCS (7110503-BS1)

Prepared: 11/17/17 Analyzed: 11/21/17

Antimony	0.104	0.0030	0.0006	mg/L	0.10000		104	80-120			
Arsenic	0.0989	0.0050	0.0005	mg/L	0.10000		99	80-120			
Barium	0.102	0.0100	0.0004	mg/L	0.10000		102	80-120			
Beryllium	0.104	0.0030	0.00009	mg/L	0.10000		104	80-120			
Cadmium	0.103	0.0010	0.0001	mg/L	0.10000		103	80-120			
Chromium	0.0990	0.0100	0.0005	mg/L	0.10000		99	80-120			
Cobalt	0.0949	0.0100	0.0003	mg/L	0.10000		95	80-120			
Copper	0.0965	0.0250	0.0003	mg/L	0.10000		96	80-120			
Lead	0.100	0.0050	0.00007	mg/L	0.10000		100	80-120			
Nickel	0.0959	0.0100	0.0005	mg/L	0.10000		96	80-120			
Selenium	0.0994	0.0100	0.0018	mg/L	0.10000		99	80-120			
Silver	0.0943	0.0100	0.0002	mg/L	0.10000		94	80-120			
Thallium	0.103	0.0010	0.00005	mg/L	0.10000		103	80-120			
Vanadium	0.100	0.0100	0.0012	mg/L	0.10000		100	80-120			
Zinc	0.102	0.0100	0.0012	mg/L	0.10000		102	80-120			
Lithium	0.101	0.0500	0.0015	mg/L	0.10000		101	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 22, 2017

Report No.: AAK0586

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7110503 - EPA 3005A											
Matrix Spike (7110503-MS1)			Source: AAK0534-01				Prepared: 11/17/17 Analyzed: 11/21/17				
Antimony	0.107	0.0030	0.0006	mg/L	0.10000	ND	107	75-125			
Arsenic	0.0995	0.0050	0.0005	mg/L	0.10000	ND	99	75-125			
Barium	0.124	0.0100	0.0004	mg/L	0.10000	0.0217	102	75-125			
Beryllium	0.105	0.0030	0.00009	mg/L	0.10000	ND	105	75-125			
Cadmium	0.103	0.0010	0.0001	mg/L	0.10000	ND	103	75-125			
Chromium	0.101	0.0100	0.0005	mg/L	0.10000	ND	101	75-125			
Cobalt	0.0976	0.0100	0.0003	mg/L	0.10000	ND	98	75-125			
Copper	0.0986	0.0250	0.0003	mg/L	0.10000	ND	99	75-125			
Lead	0.106	0.0050	0.00007	mg/L	0.10000	ND	106	75-125			
Nickel	0.0976	0.0100	0.0005	mg/L	0.10000	ND	98	75-125			
Selenium	0.101	0.0100	0.0018	mg/L	0.10000	ND	101	75-125			
Silver	0.0950	0.0100	0.0002	mg/L	0.10000	ND	95	75-125			
Thallium	0.108	0.0010	0.00005	mg/L	0.10000	ND	108	75-125			
Vanadium	0.105	0.0100	0.0012	mg/L	0.10000	ND	105	75-125			
Zinc	0.103	0.0100	0.0012	mg/L	0.10000	ND	103	75-125			
Lithium	0.101	0.0500	0.0015	mg/L	0.10000	ND	101	75-125			
Matrix Spike Dup (7110503-MSD1)			Source: AAK0534-01				Prepared: 11/17/17 Analyzed: 11/21/17				
Antimony	0.107	0.0030	0.0006	mg/L	0.10000	ND	107	75-125	0.4	20	
Arsenic	0.0989	0.0050	0.0005	mg/L	0.10000	ND	99	75-125	0.6	20	
Barium	0.124	0.0100	0.0004	mg/L	0.10000	0.0217	102	75-125	0.1	20	
Beryllium	0.103	0.0030	0.00009	mg/L	0.10000	ND	103	75-125	2	20	
Cadmium	0.104	0.0010	0.0001	mg/L	0.10000	ND	104	75-125	0.7	20	
Chromium	0.100	0.0100	0.0005	mg/L	0.10000	ND	100	75-125	0.4	20	
Cobalt	0.0944	0.0100	0.0003	mg/L	0.10000	ND	94	75-125	3	20	
Copper	0.0977	0.0250	0.0003	mg/L	0.10000	ND	98	75-125	1	20	
Lead	0.104	0.0050	0.00007	mg/L	0.10000	ND	104	75-125	1	20	
Nickel	0.0954	0.0100	0.0005	mg/L	0.10000	ND	95	75-125	2	20	
Selenium	0.0976	0.0100	0.0018	mg/L	0.10000	ND	98	75-125	4	20	
Silver	0.0929	0.0100	0.0002	mg/L	0.10000	ND	93	75-125	2	20	
Thallium	0.105	0.0010	0.00005	mg/L	0.10000	ND	105	75-125	2	20	
Vanadium	0.102	0.0100	0.0012	mg/L	0.10000	ND	102	75-125	3	20	
Zinc	0.102	0.0100	0.0012	mg/L	0.10000	ND	102	75-125	2	20	
Lithium	0.0999	0.0500	0.0015	mg/L	0.10000	ND	100	75-125	1	20	



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 22, 2017

Report No.: AAK0586

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7110503 - EPA 3005A											
Post Spike (7110503-PS1)			Source: AAK0534-01			Prepared: 11/17/17 Analyzed: 11/21/17					
Antimony	105			ug/L	100.00	0.0312	105	80-120			
Arsenic	99.7			ug/L	100.00	-0.252	100	80-120			
Barium	123			ug/L	100.00	21.7	101	80-120			
Beryllium	98.9			ug/L	100.00	0.0069	99	80-120			
Cadmium	101			ug/L	100.00	-0.0009	101	80-120			
Chromium	97.9			ug/L	100.00	0.122	98	80-120			
Cobalt	95.9			ug/L	100.00	0.0083	96	80-120			
Copper	97.3			ug/L	100.00	0.128	97	80-120			
Lead	101			ug/L	100.00	-0.0003	101	80-120			
Nickel	96.2			ug/L	100.00	0.248	96	80-120			
Selenium	99.3			ug/L	100.00	-0.153	99	80-120			
Silver	95.0			ug/L	100.00	-0.0001	95	80-120			
Thallium	103			ug/L	100.00	0.0070	103	80-120			
Vanadium	100			ug/L	100.00	-0.161	100	80-120			
Zinc	102			ug/L	100.00	0.283	102	80-120			
Lithium	101			ug/L	100.00	0.850	100	80-120			

Batch 7110549 - EPA 7470A

Blank (7110549-BLK1)					Prepared: 11/20/17 Analyzed: 11/21/17						
Mercury	ND	0.00050	0.000036	mg/L							
LCS (7110549-BS1)					Prepared: 11/20/17 Analyzed: 11/21/17						
Mercury	0.00240	0.00050	0.000036	mg/L	2.5000E-3		96	80-120			
Matrix Spike (7110549-MS1)					Prepared: 11/20/17 Analyzed: 11/21/17						
Mercury	0.00236	0.00050	0.000036	mg/L	2.5000E-3	ND	94	75-125			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
 110 Technology Parkway, Peachtree Corners, GA 30092
 (770) 734-4200 FAX (770) 734-4201

Georgia Power
 2480 Maner Road
 Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 22, 2017

Report No.: AAK0586

Metals, Total - Quality Control

Analyte	Result	RL	MDL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
Batch 7110549 - EPA 7470A											
Matrix Spike Dup (7110549-MSD1)			Source: AAK0534-02			Prepared: 11/20/17 Analyzed: 11/21/17					
Mercury	0.00238	0.00050	0.000036	mg/L	2.5000E-3	ND	95	75-125	1	20	
Post Spike (7110549-PS1)			Source: AAK0534-02			Prepared: 11/20/17 Analyzed: 11/21/17					
Mercury	1.66			ug/L	1.6667	-0.0350	99	80-120			



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

Georgia Power
2480 Maner Road
Atlanta GA, 30339

Attention: Mr. Joju Abraham

November 22, 2017

Legend

Definition of Laboratory Terms

- ND** - Not Detected at levels equal to or greater than the MDL
BRL - Not Detected at levels equal to or greater than the RL
RL - Reporting Limit **MDL** - Method Detection Limit
SOP - Method run per Pace Standard Operating Procedure
CFU - Colony Forming Units
DF - Dilution Factor **TIC** - Tentatively Identified Compound

Sample Information

N-Nitrosodiphenylamine breaks down to diphenylamine in the GCMS; both analytes are reported as N-Nitrosodiphenylamine. Pace is not NELAC certified for N-Nitrosodiphenylamine.

Phthalic acid and phthalic anhydride are reported as dimethyl phthalate

Maleic acid and maleic anhydride are reported as dimethyl malate

1,2-Diphenylhydrazine breaks down to azobenzene in the GCMS; both analytes are reported as azobenzene

Definition of Qualifiers

QM-02 The spike recovery is outside acceptance limits due to insignificant spike amount as compared to sample concentration.

J Estimated value less than Reporting Limit (RL) but greater than Method Detection Limit(MDL) (CLP J-Flag).

Note: Unless otherwise noted, all results are reported on an as received basis.



Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CHAIN OF CUSTODY RECORD

CLIENT NAME: Georgia Power CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE 810185 Atlanta, GA 30308 404-506-7239		REPORT TO: Dawn Prell (Dawn.Prell@golder.com) REQUESTED COMPLETION DATE: laburch@southernco.com		PROJECT NAME/STATE: Plant McDonough AP PROJECT #: Phase II CCR 1688498	
CC: Maria Padilla kiurinko@golder.com PO #: laburch@southernco.com					
Collection DATE	Collection TIME	MATRIX CODE*	C G R M A P B	SAMPLE IDENTIFICATION	
11/15/17	1525	GW	X	DGWA-53	
11/15/17	1105	GW	X	DGWA-71	
11/15/17	1045	DW	X	FB-1	
11/15/17	1020	GW	X	DGWC-4	
11/15/17	-	GW	X	FD-1	
11/15/17	1135	GW	X	DGWC-10	
11/15/17	1545	GW	X	DGWC-13	
11/15/17	1335	GW	X	DGWC-59	

SAMPLED BY AND TITLE: Ben Hodges Field Lead RECEIVED BY:	DATE/TIME: 11/15/2017 1700 DATE/TIME:	RELINQUISHED BY: [Signature] RELINQUISHED BY:	DATE/TIME: 11-16-17 1910 DATE/TIME:	LAB #: AA K0586 Entered into LIMS: Tracking #:
RECEIVED BY LAB: [Signature] Temp/ature: Min: Max:		SAMPLE SHIPPED VIA: UPS FED-EX USPS COURIER CLIENT OTHER FS # of Coolers Not Present Broken Intact		



Sample Condition Upon Receipt

Client Name: GIA power

Project # AAK0586

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: _____

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other _____

Thermometer Used 1A-4 Type of Ice: Wet Blue None Samples on ice, cooling process has begun

Cooler Temperature 0.9 Biological Tissue is Frozen: Yes No

Temp should be above freezing to 6°C

Date and Initials of person examining contents: 11/16/17 MR

		Comments:
Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.
-Includes date/time/ID/Analysis Matrix:	<u>GW</u>	
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed
		Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
Pace Trip Blank Lot # (if purchased):		

Client Notification/ Resolution: _____ Date/Time: _____ Field Data Required? Y / N

Person Contacted: _____

Comments/ Resolution: _____

Project Manager Review: _____ Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)



PACE ANALYTICAL SERVICES, LLC.

Environmental Monitoring & Laboratory Analysis
110 Technology Parkway, Peachtree Corners, GA 30092
(770) 734-4200 FAX (770) 734-4201

LOG-IN CHECKLIST

Printed: 11/17/2017 9:26:40AM

Attn: Mr. Joju Abraham

Client: Georgia Power

Project: CCR Event

Date Received: 11/16/17 10:10

Work Order: AAK0586

Logged In By: Mohammad M. Rahman

OBSERVATIONS

#Samples: 8

#Containers: 14

Minimum Temp(C): 0.9

Maximum Temp(C): 0.9

Custody Seal(s) Used: Yes

CHECKLIST ITEMS

- COC included with Samples YES
- Sample Container(s) Intact YES
- Chain of Custody Complete YES
- Sample Container(s) Match COC YES
- Custody seal Intact YES
- Temperature in Compliance YES
- Sufficient Sample Volume for Analysis YES
- Zero Headspace Maintained for VOA Analyses YES
- Samples labeled preserved (If Applicable) YES
- Samples received within Allowable Hold Times YES
- Samples Received on Ice YES
- Preservation Confirmed YES

Comments:

December 12, 2017

Mr. Joju Abraham
Georgia Power
2480 Maner Road
Atlanta, GA 30339

RE: Project: AAK0586 Plant McDonough
Pace Project No.: 30236435

Dear Mr. Abraham:

Enclosed are the analytical results for sample(s) received by the laboratory on November 17, 2017. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Jacquelyn Collins
jacquelyn.collins@pacelabs.com
(724)850-5612
Project Manager

Enclosures



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: AAK0586 Plant McDonough
Pace Project No.: 30236435

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601
L-A-B DOD-ELAP Accreditation #: L2417
Alabama Certification #: 41590
Arizona Certification #: AZ0734
Arkansas Certification
California Certification #: 04222CA
Colorado Certification
Connecticut Certification #: PH-0694
Delaware Certification
Florida/TNI Certification #: E87683
Georgia Certification #: C040
Guam Certification
Hawaii Certification
Idaho Certification
Illinois Certification
Indiana Certification
Iowa Certification #: 391
Kansas/TNI Certification #: E-10358
Kentucky Certification #: 90133
Louisiana DHH/TNI Certification #: LA140008
Louisiana DEQ/TNI Certification #: 4086
Maine Certification #: PA00091
Maryland Certification #: 308
Massachusetts Certification #: M-PA1457
Michigan/PADEP Certification
Missouri Certification #: 235

Montana Certification #: Cert 0082
Nebraska Certification #: NE-05-29-14
Nevada Certification #: PA014572015-1
New Hampshire/TNI Certification #: 2976
New Jersey/TNI Certification #: PA 051
New Mexico Certification #: PA01457
New York/TNI Certification #: 10888
North Carolina Certification #: 42706
North Dakota Certification #: R-190
Oregon/TNI Certification #: PA200002
Pennsylvania/TNI Certification #: 65-00282
Puerto Rico Certification #: PA01457
Rhode Island Certification #: 65-00282
South Dakota Certification
Tennessee Certification #: TN2867
Texas/TNI Certification #: T104704188-14-8
Utah/TNI Certification #: PA014572015-5
USDA Soil Permit #: P330-14-00213
Vermont Dept. of Health: ID# VT-0282
Virgin Island/PADEP Certification
Virginia/VELAP Certification #: 460198
Washington Certification #: C868
West Virginia DEP Certification #: 143
West Virginia DHHR Certification #: 9964C
Wisconsin Certification
Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: AAK0586 Plant McDonough

Pace Project No.: 30236435

Lab ID	Sample ID	Matrix	Date Collected	Date Received
30236435001	DGWC-13	Water	11/15/17 15:45	11/17/17 10:10
30236435002	DGWC-69	Water	11/15/17 13:35	11/17/17 10:10

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: AAK0586 Plant McDonough

Pace Project No.: 30236435

Lab ID	Sample ID	Method	Analysts	Analytes Reported
30236435001	DGWC-13	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	CMC	1
30236435002	DGWC-69	EPA 9315	JC2	1
		EPA 9320	VAL	1
		Total Radium Calculation	CMC	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: AAK0586 Plant McDonough

Pace Project No.: 30236435

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-13		Lab ID: 30236435001	Collected: 11/15/17 15:45	Received: 11/17/17 10:10	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Radium-226	EPA 9315	0.625 ± 0.251 (0.300)	pCi/L	11/27/17 18:41	13982-63-3		
Radium-228	EPA 9320	0.455 ± 0.432 (0.882)	pCi/L	11/29/17 14:50	15262-20-1		
Total Radium	Total Radium Calculation	1.08 ± 0.683 (1.18)	pCi/L	12/12/17 12:05	7440-14-4		

Parameters		Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Sample: DGWC-69		Lab ID: 30236435002	Collected: 11/15/17 13:35	Received: 11/17/17 10:10	Matrix: Water		
PWS:		Site ID:	Sample Type:				
Radium-226	EPA 9315	1.31 ± 0.357 (0.246)	pCi/L	11/27/17 18:41	13982-63-3		
Radium-228	EPA 9320	0.683 ± 0.563 (1.13)	pCi/L	11/29/17 14:50	15262-20-1		
Total Radium	Total Radium Calculation	1.99 ± 0.920 (1.08)	pCi/L	12/12/17 12:05	7440-14-4		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: AAK0586 Plant McDonough

Pace Project No.: 30236435

QC Batch: 279888

Analysis Method: EPA 9320

QC Batch Method: EPA 9320

Analysis Description: 9320 Radium 228

Associated Lab Samples: 30236435001, 30236435002

METHOD BLANK: 1374797

Matrix: Water

Associated Lab Samples: 30236435001, 30236435002

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.566 ± 0.420 (0.822) C:79% T:72%	pCi/L	11/29/17 14:48	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: AAK0586 Plant McDonough

Pace Project No.: 30236435

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

TNTC - Too Numerous To Count

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

Chain of Custody



Workorder: AAK0586 Workorder Name: Plant McDonough Owner Received Date: 11/16/2017 Results Requested By: 12/16/2017

Report To:
 Betsy McDaniel
 Pace Analytical Atlanta
 110 Technology Parkway
 Peachtree Corners, GA 30092
 Phone (770)-734-4200

Subcontract To:
 Pace - Pittsburgh
 1638 Roseytown Road
 Stes. 2,3,4
 Greensburg, PA 15601
 Phone (724) 850-5600

Item	Sample ID	Sample Type	Collect Date/Time	Lab ID	Matrix	Preserved Containers		Date/Time	Comments
						CON	HNH		
1	DGWC-13	G	11/15/2017 15:45	AAK0586-001 C1 W		2		X	LAB USE ONLY
2	DGWC-69	G	11/15/2017 13:35	AAK0578-02 W		2		X	0051
3				AAK0586-008					00Z
4									
5				MSR 11/16/17					
6									
7									
8									
9									
10									
Transfers Released By									
1	M. RAHMAN		11/16/17						
2									
3									
Received By									
									11/17/17 10:10

Cooler Temperature on Receipt U/A °C Custody Seal Y or N Received on Ice Y or N Sample Intact Y or N

***In order to maintain client confidentiality, location/name of the sampling site, sampler's name and signature may not be provided on this COC
 This chain of custody is considered complete as is since this information is available in the owner laboratory.

AO#: 30236435

30236435

Friday, June 17, 2016 11:01:34 AM

FMT-ALL-C-002rev.00 24March2009

Page 1 of 1




Sample Condition Upon Receipt

Client Name: GIA power

Project # AAK0586

Courier: Fed Ex UPS USPS Client Commercial Pace Other
Tracking #: _____



Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other

Thermometer Used 1A-4 Type of Ice: Wet Blue None Samples on ice, cooling process has begun

Cooler Temperature 0.9 Biological Tissue Is Frozen: Yes No
Temp should be above freezing to 6°C

Date and initials of person examining contents: 11/16/17 MR

Comments:

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.
Sample Labels match CDC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.
-Includes date/time/ID/Analysis Matrix: <u>GCW</u>		
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed
		Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
Pace Trip Blank Lot # (if purchased):		

Client Notification/ Resolution: _____ Date/Time: _____ Field Data Required? Y / N

Person Contacted: _____

Comments/ Resolution: _____

Project Manager Review: _____ Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

Pittsburgh Lab Sample Condition Upon Receipt

30236435



Client Name: Pace GA Project # _____

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: 741366599456

Label	<u>ML</u>
LIMS Login	<u>ZH</u>

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Thermometer Used NA Type of Ice: Wet Blue None

Cooler Temperature Observed Temp _____ °C Correction Factor: _____ °C Final Temp: _____ °C

Temp should be above freezing to 6°C

Date and Initials of person examining contents:	<u>ZH 11/17/17</u>
---	--------------------

Comments:	Yes	No	N/A	
Chain of Custody Present:	/			1.
Chain of Custody Filled Out:	/			2.
Chain of Custody Relinquished:	/			3.
Sampler Name & Signature on COC:		/		4.
Sample Labels match COC:	/			5.
-Includes date/time/ID Matrix: <u>WAT</u>				
Samples Arrived within Hold Time:	/			6.
Short Hold Time Analysis (<72hr remaining):		/		7.
Rush Turn Around Time Requested:		/		8.
Sufficient Volume:	/			9.
Correct Containers Used:	/			10.
-Pace Containers Used:	/			
Containers Intact:	/			11.
Orthophosphate field filtered			/	12.
Hex Cr Aqueous Compliance/NPDES sample field filtered			/	13.
Organic Samples checked for dechlorination:			/	14.
Filtered volume received for Dissolved tests			/	15.
All containers have been checked for preservation.	/			16. <u>PHCZ</u>
All containers needing preservation are found to be in compliance with EPA recommendation.	/			
exceptions: VOA, coliform, TOC, O&G, Phenolics				initial when completed <u>ZH</u> Date/time of preservation
				Lot # of added preservative
Headspace in VOA Vials (>6mm):			/	17.
Trip Blank Present:			/	18.
Trip Blank Custody Seals Present			/	
Rad Aqueous Samples Screened > 0.5 mrem/hr		/		initial when completed: <u>ZH</u> Date: <u>11/17/17</u>

Client Notification/ Resolution:

Person Contacted: _____ Date/Time: _____ Contacted By: _____

Comments/ Resolution: _____

A check in this box indicates that additional information has been stored in ereports.

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

*PM review is documented electronically in LIMS. When the Project Manager closes the SRF Review schedule in LIMS. The review is in the Status section of the Workorder Edit Screen.

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: JC2
Date: 11/27/2017
Worklist: 38828
Matrix: DW

Method Blank Assessment

MB Sample ID: 1374796
MB concentration: 0.412
MB Counting Uncertainty: 0.203
MB MDC: 0.298
MB Numerical Performance Indicator: 3.97
MB Status vs Numerical Indicator: N/A
MB Status vs. MDC: See Comment*

Laboratory Control Sample Assessment

Count Date:	Y	LCS#	(Y or N)?
11/27/2017		38828	
17-030		17-030	
Spike I.D.:		80.186	
Spike Concentration (pCi/mL):		0.10	
Volume Used (mL):		0.508	
Aliquot Volume (L, g, F):		15.784	
Target Conc. (pCi/L, g, F):		1.443	
Uncertainty (Calculated):		12.786	
Result (pCi/L, g, F):		0.944	
LCS/LCSD Counting Uncertainty (pCi/L, g, F):		-3.39	
Numerical Performance Indicator:		81.01%	
Percent Recovery:		N/A	
Status vs Numerical Indicator:		Pass	
Status vs Recovery:		Pass	

Duplicate Sample Assessment

Sample I.D.: LCS38828
Duplicate Sample I.D.: LCS38828
Sample Result (pCi/L, g, F): 13.083
Sample Result Counting Uncertainty (pCi/L, g, F): 0.888
Sample Duplicate Result (pCi/L, g, F): 12.786
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F): 0.944
Are sample and/or duplicate results below MDC? NO
Duplicate Numerical Performance Indicator: 0.449
Duplicate RPD: 2.30%
Duplicate Status vs Numerical Indicator: N/A
Duplicate Status vs RPD: Pass

Sample Matrix Spike Control Assessment

Sample Collection Date:
Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Spike I.D.:
MS/MSD Decay Corrected Spike Concentration (pCi/mL):
Spike Volume Used in MS (mL):
Spike Volume Used in MSD (mL):
MS Aliquot (L, g, F):
MS Target Conc. (pCi/L, g, F):
MSD Aliquot (L, g, F):
MSD Target Conc. (pCi/L, g, F):
Spike uncertainty (calculated):
Sample Result:
Sample Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Result:
Sample Matrix Spike Duplicate Result:
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
MS Numerical Performance Indicator:
MSD Numerical Performance Indicator:
MS Percent Recovery:
MSD Percent Recovery:
MS Status vs Numerical Indicator:
MSD Status vs Numerical Indicator:
MS Status vs Recovery:
MSD Status vs Recovery:

Matrix Spike/Matrix Spike Duplicate Sample Assessment

Sample I.D.:
Sample MS I.D.:
Sample MSD I.D.:
Sample Matrix Spike Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Sample Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
Duplicate Numerical Performance Indicator:
MS/MSD Duplicate RPD:
MS/MSD Duplicate Status vs Numerical Indicator:
MS/MSD Duplicate Status vs RPD:

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:
*The method blank result is below the reporting limit for this analysis and is acceptable.

Jan 12/17/17

Quality Control Sample Performance Assessment



Test: Ra-228
Analyst: VAL
Date: 11/27/2017
Worklist: 38829
Matrix: DW

Analyst Must Manually Enter All Fields Highlighted in Yellow.

Method Blank Assessment	
MB Sample ID	1374797
MB Concentration:	0.566
M/B Counting Uncertainty:	0.407
MB MDC:	0.822
MB Numerical Performance Indicator:	2.73
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment	
Count Date:	11/29/2017
Spike I.D.:	17-033
Spike Concentration (pCi/mL):	22.923
Volume Used (mL):	0.20
Aliquot Volume (L, g, F):	0.811
Target Conc. (pCi/L, g, F):	5.656
Uncertainty (Calculated):	0.407
Result (pCi/L, g, F):	5.835
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.737
Numerical Performance Indicator:	0.42
Percent Recovery:	103.18%
Status vs Numerical Indicator:	N/A
Status vs Recovery:	Pass

Duplicate Sample Assessment	
Sample I.D.:	LCS38829
Duplicate Sample I.D.:	LCS38829
Sample Result (pCi/L, g, F):	5.835
Sample Duplicate Result (pCi/L, g, F):	0.737
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	6.318
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.698
Are sample and/or duplicate results below MDC?	NO
Duplicate Numerical Performance Indicator:	-0.931
(Based on the LCS/LCSD Percent Recoveries) Duplicate RPD:	6.92%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Pass

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

Handwritten signature and date: 11/27/17

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
(Based on the Percent Recoveries) MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	

LABORATORY ANALYTICAL DATA

February – March 2018

June 10, 2019

Joju Abraham
Georgia Power - Coal Combustion Residuals
2480 Maner Road
Atlanta, GA 30339

RE: Project: Plant McDonough Ash Ponds
Pace Project No.: 262329

Dear Joju Abraham:

Enclosed are the analytical results for sample(s) received by the laboratory on February 28, 2018. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

REV07252018_report revised per consultant request to correct mercury RL.

REV05282019_report revised per consultant request to adjust Ca RL for samples -001, -003, and -027.

REV06102019_report revised per consultant request to correct MDL settings.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Betsy McDaniel
betsy.mcdaniel@pacelabs.com
(770)734-4200
Project Manager

Enclosures

cc: Kristen Jurinko, Golder Associates Inc.

Julie Lehrman, Golder Associates Inc.



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

June 10, 2019
Page 2

cc: Dawn Prell, Golder Associates Inc.
Tim Richards, Golder Associates - Atlanta
Rebecca Thornton, Pace Analytical Atlanta



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262329

Atlanta Certification IDs

110 Technology Parkway Peachtree Corners, GA 30092
Florida DOH Certification #: E87315
Georgia DW Inorganics Certification #: 812
Georgia DW Microbiology Certification #: 812

North Carolina Certification #: 381
South Carolina Certification #: 98011001
Virginia Certification #: 460204

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601
ANAB DOD-ELAP Rad Accreditation #: L2417
Alabama Certification #: 41590
Arizona Certification #: AZ0734
Arkansas Certification
California Certification #: 04222CA
Colorado Certification #: PA01547
Connecticut Certification #: PH-0694
Delaware Certification
EPA Region 4 DW Rad
Florida/TNI Certification #: E87683
Georgia Certification #: C040
Guam Certification
Florida: Cert E871149 SEKS WET
Hawaii Certification
Idaho Certification
Illinois Certification
Indiana Certification
Iowa Certification #: 391
Kansas/TNI Certification #: E-10358
Kentucky Certification #: KY90133
KY WW Permit #: KY0098221
KY WW Permit #: KY0000221
Louisiana DHH/TNI Certification #: LA180012
Louisiana DEQ/TNI Certification #: 4086
Maine Certification #: 2017020
Maryland Certification #: 308
Massachusetts Certification #: M-PA1457
Michigan/PADEP Certification #: 9991

Missouri Certification #: 235
Montana Certification #: Cert0082
Nebraska Certification #: NE-OS-29-14
Nevada Certification #: PA014572018-1
New Hampshire/TNI Certification #: 297617
New Jersey/TNI Certification #: PA051
New Mexico Certification #: PA01457
New York/TNI Certification #: 10888
North Carolina Certification #: 42706
North Dakota Certification #: R-190
Ohio EPA Rad Approval: #41249
Oregon/TNI Certification #: PA200002-010
Pennsylvania/TNI Certification #: 65-00282
Puerto Rico Certification #: PA01457
Rhode Island Certification #: 65-00282
South Dakota Certification
Tennessee Certification #: 02867
Texas/TNI Certification #: T104704188-17-3
Utah/TNI Certification #: PA014572017-9
USDA Soil Permit #: P330-17-00091
Vermont Dept. of Health: ID# VT-0282
Virgin Island/PADEP Certification
Virginia/VELAP Certification #: 9526
Washington Certification #: C868
West Virginia DEP Certification #: 143
West Virginia DHHR Certification #: 9964C
Wisconsin Approve List for Rad
Wyoming Certification #: 8TMS-L

Asheville Certification IDs

2225 Riverside Drive, Asheville, NC 28804
Florida/NELAP Certification #: E87648
Massachusetts Certification #: M-NC030
North Carolina Drinking Water Certification #: 37712

North Carolina Wastewater Certification #: 40
South Carolina Certification #: 99030001
Virginia/VELAP Certification #: 460222

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Lab ID	Sample ID	Matrix	Date Collected	Date Received
262329001	DGWA-70A	Water	02/27/18 10:35	02/28/18 13:30
262329002	DGWA-70A	Water	02/27/18 10:35	02/28/18 13:30
262329003	DGWA-71	Water	02/27/18 09:00	02/28/18 13:30
262329004	DGWA-71	Water	02/27/18 09:00	02/28/18 13:30
262329005	DGWC-2	Water	02/27/18 15:05	02/28/18 13:30
262329006	DGWC-2	Water	02/27/18 15:05	02/28/18 13:30
262329007	DGWC-4	Water	02/27/18 09:40	02/28/18 13:30
262329008	DGWC-4	Water	02/27/18 09:40	02/28/18 13:30
262329009	DGWC-5	Water	02/27/18 11:20	02/28/18 13:30
262329010	DGWC-5	Water	02/27/18 11:20	02/28/18 13:30
262329011	DGWC-8	Water	02/27/18 11:45	02/28/18 13:30
262329012	DGWC-8	Water	02/27/18 11:45	02/28/18 13:30
262329013	DGWC-9	Water	02/27/18 13:30	02/28/18 13:30
262329014	DGWC-9	Water	02/27/18 13:30	02/28/18 13:30
262329015	FD-1	Water	02/27/18 00:00	02/28/18 13:30
262329016	FD-1	Water	02/27/18 00:00	02/28/18 13:30
262329017	FB-1	Water	02/27/18 10:25	02/28/18 13:30
262329018	FB-1	Water	02/27/18 10:25	02/28/18 13:30
262329019	EB-1	Water	02/27/18 16:15	02/28/18 13:30
262329020	EB-1	Water	02/27/18 16:15	02/28/18 13:30
262329021	DGWC-10	Water	02/27/18 14:55	02/28/18 13:30
262329022	DGWC-10	Water	02/27/18 14:55	02/28/18 13:30
262329023	DGWC-11	Water	02/27/18 14:30	02/28/18 13:30
262329024	DGWC-11	Water	02/27/18 14:30	02/28/18 13:30
262329025	DGWC-12	Water	02/27/18 17:20	02/28/18 13:30
262329026	DGWC-12	Water	02/27/18 17:20	02/28/18 13:30
262329027	DGWC-14	Water	02/27/18 16:10	02/28/18 13:30
262329028	DGWC-14	Water	02/27/18 16:10	02/28/18 13:30

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds
Pace Project No.: 262329

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
262329001	DGWA-70A	EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C-2011	MJP	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
262329002	DGWA-70A	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
		EPA 6020B	CSW	14	PASI-GA
262329003	DGWA-71	EPA 7470A	MTC	1	PASI-GA
		SM 2540C-2011	MJP	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
		EPA 9315	JC2	1	PASI-PA
262329004	DGWA-71	EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
		EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
262329005	DGWC-2	SM 2540C-2011	MJP	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
		EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
262329006	DGWC-2	Total Radium Calculation	CMC	1	PASI-PA
		EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C-2011	MJP	1	PASI-A
262329007	DGWC-4	EPA 300.0	RLC	3	PASI-GA
		EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
262329008	DGWC-4	EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C-2011	MJP	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
262329009	DGWC-5	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
		EPA 6020B	CSW	14	PASI-GA
262329010	DGWC-5	EPA 7470A	MTC	1	PASI-GA
		SM 2540C-2011	MJP	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
		EPA 9315	JC2	1	PASI-PA
262329011	DGWC-8	EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
		EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds
Pace Project No.: 262329

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
262329012	DGWC-8	SM 2540C-2011	MJP	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
		EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
262329013	DGWC-9	Total Radium Calculation	CMC	1	PASI-PA
		EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C-2011	MJP	1	PASI-A
262329014	DGWC-9	EPA 300.0	RLC	3	PASI-GA
		EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
262329015	FD-1	EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C-2011	MJP	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
262329016	FD-1	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
		EPA 6020B	CSW	14	PASI-GA
262329017	FB-1	EPA 7470A	MTC	1	PASI-GA
		SM 2540C-2011	MJP	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
		EPA 9315	JC2	1	PASI-PA
262329018	FB-1	EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
		EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
262329019	EB-1	SM 2540C-2011	MJP	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
		EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
262329020	EB-1	Total Radium Calculation	CMC	1	PASI-PA
		EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C-2011	MJP	1	PASI-A
262329021	DGWC-10	EPA 300.0	RLC	3	PASI-GA
		EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C-2011	MJP	1	PASI-A

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds
Pace Project No.: 262329

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
262329022	DGWC-10	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
262329023	DGWC-11	EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C-2011	MJP	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
262329024	DGWC-11	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
262329025	DGWC-12	EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C-2011	MJP	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
262329026	DGWC-12	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
262329027	DGWC-14	EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C-2011	MJP	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
262329028	DGWC-14	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Sample: DGWA-70A		Lab ID: 262329001		Collected: 02/27/18 10:35		Received: 02/28/18 13:30		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	03/02/18 11:00	03/05/18 18:05	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	03/02/18 11:00	03/05/18 18:05	7440-38-2		
Barium	0.034	mg/L	0.010	0.00078	1	03/02/18 11:00	03/05/18 18:05	7440-39-3		
Beryllium	0.000063J	mg/L	0.0030	0.000050	1	03/02/18 11:00	03/05/18 18:05	7440-41-7		
Boron	0.0062J	mg/L	0.040	0.0039	1	03/02/18 11:00	03/05/18 18:05	7440-42-8		
Cadmium	ND	mg/L	0.0010	0.000093	1	03/02/18 11:00	03/05/18 18:05	7440-43-9		
Calcium	5.6	mg/L	5.0	0.69	50	03/02/18 11:00	03/05/18 18:11	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	03/02/18 11:00	03/05/18 18:05	7440-47-3		
Cobalt	ND	mg/L	0.010	0.00052	1	03/02/18 11:00	03/05/18 18:05	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	03/02/18 11:00	03/05/18 18:05	7439-92-1		
Lithium	ND	mg/L	0.050	0.00097	1	03/02/18 11:00	03/05/18 18:05	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	03/02/18 11:00	03/05/18 18:05	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	03/02/18 11:00	03/05/18 18:05	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	03/02/18 11:00	03/05/18 18:05	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	03/05/18 13:05	03/05/18 18:32	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C-2011								
Total Dissolved Solids	43.0	mg/L	25.0	25.0	1		03/02/18 19:08			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	2.5	mg/L	0.25	0.024	1		03/02/18 14:14	16887-00-6		
Fluoride	ND	mg/L	0.30	0.029	1		03/02/18 14:14	16984-48-8		
Sulfate	0.54J	mg/L	1.0	0.017	1		03/02/18 14:14	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Sample: DGWA-71		Lab ID: 262329003		Collected: 02/27/18 09:00		Received: 02/28/18 13:30		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	03/02/18 11:00	03/05/18 18:17	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	03/02/18 11:00	03/05/18 18:17	7440-38-2		
Barium	0.029	mg/L	0.010	0.00078	1	03/02/18 11:00	03/05/18 18:17	7440-39-3	M1	
Beryllium	0.000092J	mg/L	0.0030	0.000050	1	03/02/18 11:00	03/05/18 18:17	7440-41-7		
Boron	0.0069J	mg/L	0.040	0.0039	1	03/02/18 11:00	03/05/18 18:17	7440-42-8		
Cadmium	ND	mg/L	0.0010	0.000093	1	03/02/18 11:00	03/05/18 18:17	7440-43-9		
Calcium	6.1	mg/L	5.0	0.69	50	03/02/18 11:00	03/05/18 18:22	7440-70-2	M1	
Chromium	ND	mg/L	0.010	0.0016	1	03/02/18 11:00	03/05/18 18:17	7440-47-3		
Cobalt	ND	mg/L	0.010	0.00052	1	03/02/18 11:00	03/05/18 18:17	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	03/02/18 11:00	03/05/18 18:17	7439-92-1		
Lithium	0.0013J	mg/L	0.050	0.00097	1	03/02/18 11:00	03/05/18 18:17	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	03/02/18 11:00	03/05/18 18:17	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	03/02/18 11:00	03/05/18 18:17	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	03/02/18 11:00	03/05/18 18:17	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	03/05/18 13:05	03/05/18 18:58	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C-2011								
Total Dissolved Solids	79.0	mg/L	25.0	25.0	1		03/02/18 19:08			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	3.2	mg/L	0.25	0.024	1		03/02/18 15:16	16887-00-6		
Fluoride	ND	mg/L	0.30	0.029	1		03/02/18 15:16	16984-48-8		
Sulfate	7.4	mg/L	1.0	0.017	1		03/02/18 15:16	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262329

Sample: DGWC-2		Lab ID: 262329005		Collected: 02/27/18 15:05		Received: 02/28/18 13:30		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	03/02/18 11:00	03/05/18 19:08	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	03/02/18 11:00	03/05/18 19:08	7440-38-2		
Barium	0.021	mg/L	0.010	0.00078	1	03/02/18 11:00	03/05/18 19:08	7440-39-3		
Beryllium	ND	mg/L	0.0030	0.000050	1	03/02/18 11:00	03/05/18 19:08	7440-41-7		
Boron	1.1	mg/L	0.040	0.0039	1	03/02/18 11:00	03/05/18 19:08	7440-42-8		
Cadmium	0.00062J	mg/L	0.0010	0.000093	1	03/02/18 11:00	03/05/18 19:08	7440-43-9		
Calcium	66.7	mg/L	25.0	0.69	50	03/02/18 11:00	03/05/18 19:14	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	03/02/18 11:00	03/05/18 19:08	7440-47-3		
Cobalt	0.042	mg/L	0.010	0.00052	1	03/02/18 11:00	03/05/18 19:08	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	03/02/18 11:00	03/05/18 19:08	7439-92-1		
Lithium	0.088	mg/L	0.050	0.00097	1	03/02/18 11:00	03/05/18 19:08	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	03/02/18 11:00	03/05/18 19:08	7439-98-7		
Selenium	0.0017J	mg/L	0.010	0.0014	1	03/02/18 11:00	03/05/18 19:08	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	03/02/18 11:00	03/05/18 19:08	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	03/05/18 13:05	03/05/18 19:01	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C-2011								
Total Dissolved Solids	401	mg/L	25.0	25.0	1		03/02/18 19:08			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	4.1	mg/L	0.25	0.024	1		03/02/18 15:36	16887-00-6		
Fluoride	0.28J	mg/L	0.30	0.029	1		03/02/18 15:36	16984-48-8		
Sulfate	189	mg/L	20.0	0.34	20		03/15/18 20:37	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Sample: DGWC-4		Lab ID: 262329007		Collected: 02/27/18 09:40		Received: 02/28/18 13:30		Matrix: Water	
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual
			Limit	MDL	DF				
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	mg/L	0.0030	0.00078	1	03/02/18 11:00	03/05/18 19:20	7440-36-0	
Arsenic	ND	mg/L	0.0050	0.00057	1	03/02/18 11:00	03/05/18 19:20	7440-38-2	
Barium	0.036	mg/L	0.010	0.00078	1	03/02/18 11:00	03/05/18 19:20	7440-39-3	
Beryllium	0.00018J	mg/L	0.0030	0.000050	1	03/02/18 11:00	03/05/18 19:20	7440-41-7	
Boron	4.1	mg/L	0.040	0.0039	1	03/02/18 11:00	03/05/18 19:20	7440-42-8	
Cadmium	0.00074J	mg/L	0.0010	0.000093	1	03/02/18 11:00	03/05/18 19:20	7440-43-9	
Calcium	245	mg/L	125	3.4	250	03/02/18 11:00	03/08/18 17:15	7440-70-2	
Chromium	ND	mg/L	0.010	0.0016	1	03/02/18 11:00	03/05/18 19:20	7440-47-3	
Cobalt	0.0018J	mg/L	0.010	0.00052	1	03/02/18 11:00	03/05/18 19:20	7440-48-4	
Lead	ND	mg/L	0.0050	0.00027	1	03/02/18 11:00	03/05/18 19:20	7439-92-1	
Lithium	0.0027J	mg/L	0.050	0.00097	1	03/02/18 11:00	03/05/18 19:20	7439-93-2	
Molybdenum	0.0069J	mg/L	0.010	0.0019	1	03/02/18 11:00	03/05/18 19:20	7439-98-7	
Selenium	ND	mg/L	0.010	0.0014	1	03/02/18 11:00	03/05/18 19:20	7782-49-2	
Thallium	ND	mg/L	0.0010	0.00014	1	03/02/18 11:00	03/05/18 19:20	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	ND	mg/L	0.00050	0.000036	1	03/05/18 13:05	03/05/18 19:03	7439-97-6	
2540C Total Dissolved Solids		Analytical Method: SM 2540C-2011							
Total Dissolved Solids	1380	mg/L	125	125	1		03/02/18 19:08		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	24.6	mg/L	1.2	0.12	5		03/15/18 20:58	16887-00-6	
Fluoride	ND	mg/L	0.30	0.029	1		03/02/18 15:57	16984-48-8	
Sulfate	811	mg/L	50.0	0.85	50		03/15/18 21:18	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Sample: DGWC-5 **Lab ID: 262329009** Collected: 02/27/18 11:20 Received: 02/28/18 13:30 Matrix: Water

Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual
			Limit	MDL	DF				
6020B MET ICPMS Analytical Method: EPA 6020B Preparation Method: EPA 3005A									
Antimony	ND	mg/L	0.0030	0.00078	1	03/02/18 11:00	03/05/18 19:31	7440-36-0	
Arsenic	0.0094	mg/L	0.0050	0.00057	1	03/02/18 11:00	03/05/18 19:31	7440-38-2	
Barium	0.017	mg/L	0.010	0.00078	1	03/02/18 11:00	03/05/18 19:31	7440-39-3	
Beryllium	0.0086	mg/L	0.0030	0.000050	1	03/02/18 11:00	03/05/18 19:31	7440-41-7	
Boron	4.3	mg/L	0.040	0.0039	1	03/02/18 11:00	03/05/18 19:31	7440-42-8	
Cadmium	0.00072J	mg/L	0.0010	0.000093	1	03/02/18 11:00	03/05/18 19:31	7440-43-9	
Calcium	108	mg/L	50.0	1.4	100	03/02/18 11:00	03/08/18 17:21	7440-70-2	
Chromium	ND	mg/L	0.010	0.0016	1	03/02/18 11:00	03/05/18 19:31	7440-47-3	
Cobalt	0.024	mg/L	0.010	0.00052	1	03/02/18 11:00	03/05/18 19:31	7440-48-4	
Lead	ND	mg/L	0.0050	0.00027	1	03/02/18 11:00	03/05/18 19:31	7439-92-1	
Lithium	0.0066J	mg/L	0.050	0.00097	1	03/02/18 11:00	03/05/18 19:31	7439-93-2	
Molybdenum	ND	mg/L	0.010	0.0019	1	03/02/18 11:00	03/05/18 19:31	7439-98-7	
Selenium	0.035	mg/L	0.010	0.0014	1	03/02/18 11:00	03/05/18 19:31	7782-49-2	
Thallium	ND	mg/L	0.0010	0.00014	1	03/02/18 11:00	03/05/18 19:31	7440-28-0	
7470 Mercury Analytical Method: EPA 7470A Preparation Method: EPA 7470A									
Mercury	0.000090J	mg/L	0.00050	0.000036	1	03/05/18 13:05	03/05/18 19:06	7439-97-6	
2540C Total Dissolved Solids Analytical Method: SM 2540C-2011									
Total Dissolved Solids	698	mg/L	50.0	50.0	1		03/02/18 19:08		
300.0 IC Anions 28 Days Analytical Method: EPA 300.0									
Chloride	9.7	mg/L	0.25	0.024	1		03/02/18 16:18	16887-00-6	
Fluoride	1.3	mg/L	0.30	0.029	1		03/02/18 16:18	16984-48-8	
Sulfate	453	mg/L	25.0	0.42	25		03/15/18 21:39	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Sample: DGWC-8		Lab ID: 262329011		Collected: 02/27/18 11:45		Received: 02/28/18 13:30		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	03/02/18 11:00	03/05/18 19:42	7440-36-0		
Arsenic	0.0020J	mg/L	0.0050	0.00057	1	03/02/18 11:00	03/05/18 19:42	7440-38-2		
Barium	0.035	mg/L	0.010	0.00078	1	03/02/18 11:00	03/05/18 19:42	7440-39-3		
Beryllium	0.0047	mg/L	0.0030	0.000050	1	03/02/18 11:00	03/05/18 19:42	7440-41-7		
Boron	2.1	mg/L	0.040	0.0039	1	03/02/18 11:00	03/05/18 19:42	7440-42-8		
Cadmium	0.0029	mg/L	0.0010	0.000093	1	03/02/18 11:00	03/05/18 19:42	7440-43-9		
Calcium	64.2	mg/L	25.0	0.69	50	03/02/18 11:00	03/05/18 19:48	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	03/02/18 11:00	03/05/18 19:42	7440-47-3		
Cobalt	0.13	mg/L	0.010	0.00052	1	03/02/18 11:00	03/05/18 19:42	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	03/02/18 11:00	03/05/18 19:42	7439-92-1		
Lithium	0.0075J	mg/L	0.050	0.00097	1	03/02/18 11:00	03/05/18 19:42	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	03/02/18 11:00	03/05/18 19:42	7439-98-7		
Selenium	0.0096J	mg/L	0.010	0.0014	1	03/02/18 11:00	03/05/18 19:42	7782-49-2		
Thallium	0.00033J	mg/L	0.0010	0.00014	1	03/02/18 11:00	03/05/18 19:42	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	0.000042J	mg/L	0.00050	0.000036	1	03/05/18 13:05	03/05/18 19:08	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C-2011								
Total Dissolved Solids	520	mg/L	50.0	50.0	1		03/02/18 19:08			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	9.5	mg/L	0.25	0.024	1		03/02/18 16:38	16887-00-6		
Fluoride	0.59	mg/L	0.30	0.029	1		03/02/18 16:38	16984-48-8		
Sulfate	340	mg/L	25.0	0.42	25		03/15/18 22:00	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262329

Sample: DGWC-9		Lab ID: 262329013		Collected: 02/27/18 13:30		Received: 02/28/18 13:30		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	03/02/18 11:00	03/05/18 20:05	7440-36-0		
Arsenic	0.040	mg/L	0.0050	0.00057	1	03/02/18 11:00	03/05/18 20:05	7440-38-2		
Barium	0.015	mg/L	0.010	0.00078	1	03/02/18 11:00	03/05/18 20:05	7440-39-3		
Beryllium	0.0057	mg/L	0.0030	0.000050	1	03/02/18 11:00	03/05/18 20:05	7440-41-7		
Boron	1.7	mg/L	0.040	0.0039	1	03/02/18 11:00	03/05/18 20:05	7440-42-8		
Cadmium	0.00058J	mg/L	0.0010	0.000093	1	03/02/18 11:00	03/05/18 20:05	7440-43-9		
Calcium	73.1	mg/L	25.0	0.69	50	03/02/18 11:00	03/05/18 20:11	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	03/02/18 11:00	03/05/18 20:05	7440-47-3		
Cobalt	0.16	mg/L	0.010	0.00052	1	03/02/18 11:00	03/05/18 20:05	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	03/02/18 11:00	03/05/18 20:05	7439-92-1		
Lithium	0.031J	mg/L	0.050	0.00097	1	03/02/18 11:00	03/05/18 20:05	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	03/02/18 11:00	03/05/18 20:05	7439-98-7		
Selenium	0.13	mg/L	0.010	0.0014	1	03/02/18 11:00	03/05/18 20:05	7782-49-2		
Thallium	0.00038J	mg/L	0.0010	0.00014	1	03/02/18 11:00	03/05/18 20:05	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	0.000042J	mg/L	0.00050	0.000036	1	03/05/18 13:05	03/05/18 19:10	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C-2011								
Total Dissolved Solids	482	mg/L	50.0	50.0	1		03/02/18 19:08			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	8.2	mg/L	0.25	0.024	1		03/02/18 16:59	16887-00-6		
Fluoride	1.2	mg/L	0.30	0.029	1		03/02/18 16:59	16984-48-8		
Sulfate	327	mg/L	25.0	0.42	25		03/15/18 22:20	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262329

Sample: FD-1		Lab ID: 262329015		Collected: 02/27/18 00:00		Received: 02/28/18 13:30		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	03/02/18 11:00	03/05/18 20:17	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	03/02/18 11:00	03/05/18 20:17	7440-38-2		
Barium	0.036	mg/L	0.010	0.00078	1	03/02/18 11:00	03/05/18 20:17	7440-39-3		
Beryllium	0.00017J	mg/L	0.0030	0.000050	1	03/02/18 11:00	03/05/18 20:17	7440-41-7		
Boron	4.3	mg/L	0.040	0.0039	1	03/02/18 11:00	03/05/18 20:17	7440-42-8		
Cadmium	0.00069J	mg/L	0.0010	0.000093	1	03/02/18 11:00	03/05/18 20:17	7440-43-9		
Calcium	252	mg/L	25.0	0.69	50	03/02/18 11:00	03/08/18 17:27	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	03/02/18 11:00	03/05/18 20:17	7440-47-3		
Cobalt	0.0018J	mg/L	0.010	0.00052	1	03/02/18 11:00	03/05/18 20:17	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	03/02/18 11:00	03/05/18 20:17	7439-92-1		
Lithium	0.0029J	mg/L	0.050	0.00097	1	03/02/18 11:00	03/05/18 20:17	7439-93-2		
Molybdenum	0.0069J	mg/L	0.010	0.0019	1	03/02/18 11:00	03/05/18 20:17	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	03/02/18 11:00	03/05/18 20:17	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	03/02/18 11:00	03/05/18 20:17	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	03/05/18 13:05	03/05/18 19:13	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C-2011								
Total Dissolved Solids	1300	mg/L	125	125	1		03/02/18 19:08			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	24.7	mg/L	1.2	0.12	5		03/16/18 00:04	16887-00-6		
Fluoride	ND	mg/L	0.30	0.029	1		03/02/18 17:20	16984-48-8		
Sulfate	824	mg/L	50.0	0.85	50		03/16/18 00:24	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Sample: FB-1		Lab ID: 262329017		Collected: 02/27/18 10:25		Received: 02/28/18 13:30		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	03/02/18 11:00	03/05/18 20:23	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	03/02/18 11:00	03/05/18 20:23	7440-38-2		
Barium	ND	mg/L	0.010	0.00078	1	03/02/18 11:00	03/05/18 20:23	7440-39-3		
Beryllium	ND	mg/L	0.0030	0.000050	1	03/02/18 11:00	03/05/18 20:23	7440-41-7		
Boron	0.012J	mg/L	0.040	0.0039	1	03/02/18 11:00	03/05/18 20:23	7440-42-8		
Cadmium	ND	mg/L	0.0010	0.000093	1	03/02/18 11:00	03/05/18 20:23	7440-43-9		
Calcium	0.048J	mg/L	0.50	0.014	1	03/02/18 11:00	03/05/18 20:23	7440-70-2	B	
Chromium	ND	mg/L	0.010	0.0016	1	03/02/18 11:00	03/05/18 20:23	7440-47-3		
Cobalt	ND	mg/L	0.010	0.00052	1	03/02/18 11:00	03/05/18 20:23	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	03/02/18 11:00	03/05/18 20:23	7439-92-1		
Lithium	ND	mg/L	0.050	0.00097	1	03/02/18 11:00	03/05/18 20:23	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	03/02/18 11:00	03/05/18 20:23	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	03/02/18 11:00	03/05/18 20:23	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	03/02/18 11:00	03/05/18 20:23	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	0.000069J	mg/L	0.00050	0.000036	1	03/05/18 13:05	03/05/18 19:15	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C-2011								
Total Dissolved Solids	ND	mg/L	25.0	25.0	1		03/02/18 19:08			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	0.045J	mg/L	0.25	0.024	1		03/02/18 19:03	16887-00-6		
Fluoride	ND	mg/L	0.30	0.029	1		03/02/18 19:03	16984-48-8		
Sulfate	ND	mg/L	1.0	0.017	1		03/02/18 19:03	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Sample: EB-1		Lab ID: 262329019		Collected: 02/27/18 16:15		Received: 02/28/18 13:30		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	03/02/18 11:00	03/05/18 20:28	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	03/02/18 11:00	03/05/18 20:28	7440-38-2		
Barium	ND	mg/L	0.010	0.00078	1	03/02/18 11:00	03/05/18 20:28	7440-39-3		
Beryllium	ND	mg/L	0.0030	0.000050	1	03/02/18 11:00	03/05/18 20:28	7440-41-7		
Boron	0.0056J	mg/L	0.040	0.0039	1	03/02/18 11:00	03/05/18 20:28	7440-42-8		
Cadmium	ND	mg/L	0.0010	0.000093	1	03/02/18 11:00	03/05/18 20:28	7440-43-9		
Calcium	0.053J	mg/L	0.50	0.014	1	03/02/18 11:00	03/05/18 20:28	7440-70-2	B	
Chromium	ND	mg/L	0.010	0.0016	1	03/02/18 11:00	03/05/18 20:28	7440-47-3		
Cobalt	ND	mg/L	0.010	0.00052	1	03/02/18 11:00	03/05/18 20:28	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	03/02/18 11:00	03/05/18 20:28	7439-92-1		
Lithium	ND	mg/L	0.050	0.00097	1	03/02/18 11:00	03/05/18 20:28	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	03/02/18 11:00	03/05/18 20:28	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	03/02/18 11:00	03/05/18 20:28	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	03/02/18 11:00	03/05/18 20:28	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	03/05/18 13:05	03/05/18 19:17	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C-2011								
Total Dissolved Solids	ND	mg/L	25.0	25.0	1		03/02/18 19:08			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	0.065J	mg/L	0.25	0.024	1		03/02/18 19:24	16887-00-6		
Fluoride	ND	mg/L	0.30	0.029	1		03/02/18 19:24	16984-48-8		
Sulfate	ND	mg/L	1.0	0.017	1		03/02/18 19:24	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262329

Sample: DGWC-10		Lab ID: 262329021		Collected: 02/27/18 14:55		Received: 02/28/18 13:30		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	03/02/18 11:00	03/05/18 20:34	7440-36-0		
Arsenic	0.011	mg/L	0.0050	0.00057	1	03/02/18 11:00	03/05/18 20:34	7440-38-2		
Barium	0.028	mg/L	0.010	0.00078	1	03/02/18 11:00	03/05/18 20:34	7440-39-3		
Beryllium	0.011	mg/L	0.0030	0.000050	1	03/02/18 11:00	03/05/18 20:34	7440-41-7		
Boron	3.2	mg/L	0.040	0.0039	1	03/02/18 11:00	03/05/18 20:34	7440-42-8		
Cadmium	0.0010	mg/L	0.0010	0.000093	1	03/02/18 11:00	03/05/18 20:34	7440-43-9		
Calcium	96.2	mg/L	25.0	0.69	50	03/02/18 11:00	03/05/18 20:40	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	03/02/18 11:00	03/05/18 20:34	7440-47-3		
Cobalt	0.20	mg/L	0.010	0.00052	1	03/02/18 11:00	03/05/18 20:34	7440-48-4		
Lead	ND	mg/L	0.025	0.0014	5	03/02/18 11:00	03/08/18 17:33	7439-92-1	D3	
Lithium	0.0037J	mg/L	0.050	0.00097	1	03/02/18 11:00	03/05/18 20:34	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	03/02/18 11:00	03/05/18 20:34	7439-98-7		
Selenium	0.067	mg/L	0.010	0.0014	1	03/02/18 11:00	03/05/18 20:34	7782-49-2		
Thallium	ND	mg/L	0.0050	0.00071	5	03/02/18 11:00	03/08/18 17:33	7440-28-0	D3	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	03/05/18 13:05	03/05/18 19:25	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C-2011								
Total Dissolved Solids	542	mg/L	50.0	50.0	1		03/02/18 19:08		D6	
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	10.8	mg/L	0.25	0.024	1		03/02/18 20:05	16887-00-6		
Fluoride	2.3	mg/L	0.30	0.029	1		03/02/18 20:05	16984-48-8		
Sulfate	335	mg/L	25.0	0.42	25		03/16/18 00:45	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Sample: DGWC-11		Lab ID: 262329023		Collected: 02/27/18 14:30		Received: 02/28/18 13:30		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	03/02/18 11:00	03/05/18 20:45	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	03/02/18 11:00	03/05/18 20:45	7440-38-2		
Barium	0.067	mg/L	0.010	0.00078	1	03/02/18 11:00	03/05/18 20:45	7440-39-3		
Beryllium	0.000058J	mg/L	0.0030	0.000050	1	03/02/18 11:00	03/05/18 20:45	7440-41-7		
Boron	1.2	mg/L	0.040	0.0039	1	03/02/18 11:00	03/05/18 20:45	7440-42-8		
Cadmium	ND	mg/L	0.0010	0.000093	1	03/02/18 11:00	03/05/18 20:45	7440-43-9		
Calcium	51.4	mg/L	25.0	0.69	50	03/02/18 11:00	03/05/18 20:51	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	03/02/18 11:00	03/05/18 20:45	7440-47-3		
Cobalt	ND	mg/L	0.010	0.00052	1	03/02/18 11:00	03/05/18 20:45	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	03/02/18 11:00	03/05/18 20:45	7439-92-1		
Lithium	0.0022J	mg/L	0.050	0.00097	1	03/02/18 11:00	03/05/18 20:45	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	03/02/18 11:00	03/05/18 20:45	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	03/02/18 11:00	03/05/18 20:45	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	03/02/18 11:00	03/05/18 20:45	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	03/05/18 13:05	03/05/18 19:27	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C-2011								
Total Dissolved Solids	393	mg/L	25.0	25.0	1		03/02/18 19:08			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	12.7	mg/L	0.25	0.024	1		03/02/18 20:26	16887-00-6		
Fluoride	ND	mg/L	0.30	0.029	1		03/02/18 20:26	16984-48-8		
Sulfate	220	mg/L	20.0	0.34	20		03/16/18 01:06	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262329

Sample: DGWC-12		Lab ID: 262329025		Collected: 02/27/18 17:20		Received: 02/28/18 13:30		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	03/02/18 11:00	03/05/18 21:08	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	03/02/18 11:00	03/05/18 21:08	7440-38-2		
Barium	0.025	mg/L	0.010	0.00078	1	03/02/18 11:00	03/05/18 21:08	7440-39-3		
Beryllium	0.00021J	mg/L	0.0030	0.000050	1	03/02/18 11:00	03/05/18 21:08	7440-41-7		
Boron	8.0	mg/L	0.040	0.0039	1	03/02/18 11:00	03/05/18 21:08	7440-42-8		
Cadmium	0.00038J	mg/L	0.0010	0.000093	1	03/02/18 11:00	03/05/18 21:08	7440-43-9		
Calcium	85.6	mg/L	25.0	0.69	50	03/02/18 11:00	03/05/18 21:14	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	03/02/18 11:00	03/05/18 21:08	7440-47-3		
Cobalt	0.0021J	mg/L	0.010	0.00052	1	03/02/18 11:00	03/05/18 21:08	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	03/02/18 11:00	03/05/18 21:08	7439-92-1		
Lithium	0.00097J	mg/L	0.050	0.00097	1	03/02/18 11:00	03/05/18 21:08	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	03/02/18 11:00	03/05/18 21:08	7439-98-7		
Selenium	0.0024J	mg/L	0.010	0.0014	1	03/02/18 11:00	03/05/18 21:08	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	03/02/18 11:00	03/05/18 21:08	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	0.000060J	mg/L	0.00050	0.000036	1	03/05/18 13:05	03/05/18 19:29	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C-2011								
Total Dissolved Solids	582	mg/L	50.0	50.0	1		03/02/18 19:08			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	11.7	mg/L	0.25	0.024	1		03/02/18 20:46	16887-00-6		
Fluoride	0.34	mg/L	0.30	0.029	1		03/02/18 20:46	16984-48-8		
Sulfate	356	mg/L	20.0	0.34	20		03/16/18 01:26	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Sample: DGWC-14		Lab ID: 262329027		Collected: 02/27/18 16:10		Received: 02/28/18 13:30		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	03/02/18 11:00	03/05/18 21:20	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	03/02/18 11:00	03/05/18 21:20	7440-38-2		
Barium	0.059	mg/L	0.010	0.00078	1	03/02/18 11:00	03/05/18 21:20	7440-39-3		
Beryllium	ND	mg/L	0.0030	0.000050	1	03/02/18 11:00	03/05/18 21:20	7440-41-7		
Boron	0.054	mg/L	0.040	0.0039	1	03/02/18 11:00	03/05/18 21:20	7440-42-8		
Cadmium	ND	mg/L	0.0010	0.000093	1	03/02/18 11:00	03/05/18 21:20	7440-43-9		
Calcium	10	mg/L	5.0	0.69	50	03/02/18 11:00	03/05/18 21:26	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	03/02/18 11:00	03/05/18 21:20	7440-47-3		
Cobalt	ND	mg/L	0.010	0.00052	1	03/02/18 11:00	03/05/18 21:20	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	03/02/18 11:00	03/05/18 21:20	7439-92-1		
Lithium	0.0035J	mg/L	0.050	0.00097	1	03/02/18 11:00	03/05/18 21:20	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	03/02/18 11:00	03/05/18 21:20	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	03/02/18 11:00	03/05/18 21:20	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	03/02/18 11:00	03/05/18 21:20	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	03/05/18 13:05	03/05/18 19:32	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C-2011								
Total Dissolved Solids	99.0	mg/L	25.0	25.0	1		03/02/18 19:08			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	3.4	mg/L	0.25	0.024	1		03/02/18 21:07	16887-00-6		
Fluoride	ND	mg/L	0.30	0.029	1		03/02/18 21:07	16984-48-8		
Sulfate	41.0	mg/L	5.0	0.085	5		03/16/18 01:47	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

QC Batch: 1881

Analysis Method: EPA 7470A

QC Batch Method: EPA 7470A

Analysis Description: 7470 Mercury

Associated Lab Samples: 262329001, 262329003, 262329005, 262329007, 262329009, 262329011, 262329013, 262329015, 262329017, 262329019, 262329021, 262329023, 262329025, 262329027

METHOD BLANK: 10591

Matrix: Water

Associated Lab Samples: 262329001, 262329003, 262329005, 262329007, 262329009, 262329011, 262329013, 262329015, 262329017, 262329019, 262329021, 262329023, 262329025, 262329027

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Mercury	mg/L	ND	0.00050	0.000036	03/05/18 18:28	

LABORATORY CONTROL SAMPLE: 10592

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Mercury	mg/L	0.0025	0.0025	98	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 11137 11138

Parameter	Units	262329001 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
Mercury	mg/L	ND	0.0025	0.0025	0.0024	0.0024	94	95	75-125	1	20	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

QC Batch: 1909 Analysis Method: EPA 6020B
 QC Batch Method: EPA 3005A Analysis Description: 6020B MET
 Associated Lab Samples: 262329001, 262329003, 262329005, 262329007, 262329009, 262329011, 262329013, 262329015, 262329017, 262329019, 262329021, 262329023, 262329025, 262329027

METHOD BLANK: 10718 Matrix: Water
 Associated Lab Samples: 262329001, 262329003, 262329005, 262329007, 262329009, 262329011, 262329013, 262329015, 262329017, 262329019, 262329021, 262329023, 262329025, 262329027

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Antimony	mg/L	0.00079J	0.0030	0.00078	03/05/18 17:54	
Arsenic	mg/L	ND	0.0050	0.00057	03/05/18 17:54	
Barium	mg/L	ND	0.010	0.00078	03/05/18 17:54	
Beryllium	mg/L	ND	0.0030	0.000050	03/05/18 17:54	
Boron	mg/L	ND	0.040	0.0039	03/05/18 17:54	
Cadmium	mg/L	ND	0.0010	0.000093	03/05/18 17:54	
Calcium	mg/L	0.015J	0.10	0.014	03/05/18 17:54	
Chromium	mg/L	ND	0.010	0.0016	03/05/18 17:54	
Cobalt	mg/L	ND	0.010	0.00052	03/05/18 17:54	
Lead	mg/L	ND	0.0050	0.00027	03/05/18 17:54	
Lithium	mg/L	ND	0.050	0.00097	03/05/18 17:54	
Molybdenum	mg/L	ND	0.010	0.0019	03/05/18 17:54	
Selenium	mg/L	ND	0.010	0.0014	03/05/18 17:54	
Thallium	mg/L	ND	0.0010	0.00014	03/05/18 17:54	

LABORATORY CONTROL SAMPLE: 10719

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Antimony	mg/L	0.1	0.10	104	80-120	
Arsenic	mg/L	0.1	0.10	103	80-120	
Barium	mg/L	0.1	0.10	102	80-120	
Beryllium	mg/L	0.1	0.11	105	80-120	
Boron	mg/L	1	1.1	111	80-120	
Cadmium	mg/L	0.1	0.10	102	80-120	
Calcium	mg/L	1	1.0	103	80-120	
Chromium	mg/L	0.1	0.11	109	80-120	
Cobalt	mg/L	0.1	0.11	111	80-120	
Lead	mg/L	0.1	0.10	104	80-120	
Lithium	mg/L	0.1	0.11	109	80-120	
Molybdenum	mg/L	0.1	0.11	106	80-120	
Selenium	mg/L	0.1	0.10	101	80-120	
Thallium	mg/L	0.1	0.10	101	80-120	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Parameter	Units	MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 10722		10723		MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
		262329003 Result	MS Spike Conc.	MSD Spike Conc.	MS Result								
Antimony	mg/L	ND	0.1	0.1	0.11	0.11	105	106	75-125	1	20		
Arsenic	mg/L	ND	0.1	0.1	0.10	0.10	102	102	75-125	0	20		
Barium	mg/L	0.029	0.1	0.1	0.16	0.18	132	153	75-125	12	20	M1	
Beryllium	mg/L	0.000092J	0.1	0.1	0.10	0.10	104	104	75-125	1	20		
Boron	mg/L	0.0069J	1	1	1.1	1.1	108	108	75-125	0	20		
Cadmium	mg/L	ND	0.1	0.1	0.10	0.10	103	102	75-125	1	20		
Calcium	mg/L	6.1	1	1	7.5	7.6	136	144	75-125	1	20		
Chromium	mg/L	ND	0.1	0.1	0.11	0.11	107	106	75-125	0	20		
Cobalt	mg/L	ND	0.1	0.1	0.11	0.11	109	109	75-125	1	20		
Lead	mg/L	ND	0.1	0.1	0.10	0.10	104	102	75-125	2	20		
Lithium	mg/L	0.0013J	0.1	0.1	0.10	0.10	103	101	75-125	2	20		
Molybdenum	mg/L	ND	0.1	0.1	0.11	0.11	109	109	75-125	0	20		
Selenium	mg/L	ND	0.1	0.1	0.11	0.10	106	103	75-125	3	20		
Thallium	mg/L	ND	0.1	0.1	0.10	0.10	104	102	75-125	2	20		

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 262329

QC Batch: 400516 Analysis Method: SM 2540C-2011
QC Batch Method: SM 2540C-2011 Analysis Description: 2540C Total Dissolved Solids
Associated Lab Samples: 262329001, 262329003, 262329005, 262329007, 262329009, 262329011, 262329013, 262329015, 262329017, 262329019, 262329021, 262329023, 262329025, 262329027

METHOD BLANK: 2221252 Matrix: Water
Associated Lab Samples: 262329001, 262329003, 262329005, 262329007, 262329009, 262329011, 262329013, 262329015, 262329017, 262329019, 262329021, 262329023, 262329025, 262329027

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Total Dissolved Solids	mg/L	ND	25.0	25.0	03/02/18 19:08	

LABORATORY CONTROL SAMPLE: 2221253

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	250	242	97	90-110	

SAMPLE DUPLICATE: 2221254

Parameter	Units	262329001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	43.0	44.0	2	5	

SAMPLE DUPLICATE: 2221255

Parameter	Units	262329021 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	542	492	10	5 D6	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 262329

QC Batch: 1903 Analysis Method: EPA 300.0
QC Batch Method: EPA 300.0 Analysis Description: 300.0 IC Anions
Associated Lab Samples: 262329001, 262329003, 262329005, 262329007, 262329009, 262329011, 262329013, 262329015, 262329017, 262329019, 262329021, 262329023, 262329025, 262329027

METHOD BLANK: 10675 Matrix: Water
Associated Lab Samples: 262329001, 262329003, 262329005, 262329007, 262329009, 262329011, 262329013, 262329015, 262329017, 262329019, 262329021, 262329023, 262329025, 262329027

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Chloride	mg/L	ND	0.25	0.024	03/02/18 12:51	
Fluoride	mg/L	ND	0.30	0.029	03/02/18 12:51	
Sulfate	mg/L	ND	1.0	0.017	03/02/18 12:51	

LABORATORY CONTROL SAMPLE: 10676

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	10	10.3	103	90-110	
Fluoride	mg/L	10	9.9	99	90-110	
Sulfate	mg/L	10	9.9	99	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 10677 10678

Parameter	Units	262329001 Result	MS		MSD		MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
			Spike Conc.	MSD Spike Conc.	MS Result	MSD Result						
Chloride	mg/L	2.5	10	10	12.0	12.1	95	96	90-110	1	15	
Fluoride	mg/L	ND	10	10	10.1	10.2	101	102	90-110	1	15	
Sulfate	mg/L	0.54J	10	10	10.6	10.7	101	102	90-110	1	15	

MATRIX SPIKE SAMPLE: 10679

Parameter	Units	262329003 Result	Spike Conc.	MS Result	MS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	3.2	10	13.2	100	90-110	
Fluoride	mg/L	ND	10	10.5	105	90-110	
Sulfate	mg/L	7.4	10	17.3	99	90-110	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Sample: DGWA-70A **Lab ID: 262329002** Collected: 02/27/18 10:35 Received: 02/28/18 13:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.138 ± 0.213 (0.472) C:100% T:NA	pCi/L	03/14/18 08:38	13982-63-3	
Radium-228	EPA 9320	1.08 ± 0.446 (0.717) C:83% T:81%	pCi/L	03/21/18 12:16	15262-20-1	
Total Radium	Total Radium Calculation	1.22 ± 0.659 (1.19)	pCi/L	03/23/18 11:25	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Sample: DGWA-71 **Lab ID: 262329004** Collected: 02/27/18 09:00 Received: 02/28/18 13:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.132 ± 0.167 (0.342) C:95% T:NA	pCi/L	03/14/18 08:38	13982-63-3	
Radium-228	EPA 9320	0.582 ± 0.397 (0.766) C:78% T:77%	pCi/L	03/21/18 12:17	15262-20-1	
Total Radium	Total Radium Calculation	0.714 ± 0.564 (1.11)	pCi/L	03/23/18 11:25	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Sample: DGWC-2 **Lab ID: 262329006** Collected: 02/27/18 15:05 Received: 02/28/18 13:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.308 ± 0.218 (0.361) C:100% T:NA	pCi/L	03/14/18 08:38	13982-63-3	
Radium-228	EPA 9320	0.555 ± 0.361 (0.687) C:82% T:82%	pCi/L	03/21/18 12:17	15262-20-1	
Total Radium	Total Radium Calculation	0.863 ± 0.579 (1.05)	pCi/L	03/23/18 11:25	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Sample: DGWC-4 **Lab ID: 262329008** Collected: 02/27/18 09:40 Received: 02/28/18 13:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.695 ± 0.312 (0.386) C:100% T:NA	pCi/L	03/14/18 08:38	13982-63-3	
Radium-228	EPA 9320	1.12 ± 0.429 (0.645) C:84% T:78%	pCi/L	03/21/18 12:17	15262-20-1	
Total Radium	Total Radium Calculation	1.82 ± 0.741 (1.03)	pCi/L	03/23/18 11:25	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Sample: DGWC-5 **Lab ID: 262329010** Collected: 02/27/18 11:20 Received: 02/28/18 13:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.637 ± 0.292 (0.347) C:97% T:NA	pCi/L	03/14/18 08:38	13982-63-3	
Radium-228	EPA 9320	1.33 ± 0.500 (0.760) C:81% T:77%	pCi/L	03/21/18 12:17	15262-20-1	
Total Radium	Total Radium Calculation	1.97 ± 0.792 (1.11)	pCi/L	03/23/18 11:25	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Sample: DGWC-8 **Lab ID: 262329012** Collected: 02/27/18 11:45 Received: 02/28/18 13:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.536 ± 0.295 (0.458) C:100% T:NA	pCi/L	03/14/18 08:38	13982-63-3	
Radium-228	EPA 9320	0.509 ± 0.365 (0.711) C:82% T:81%	pCi/L	03/21/18 12:17	15262-20-1	
Total Radium	Total Radium Calculation	1.05 ± 0.660 (1.17)	pCi/L	03/23/18 11:25	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Sample: DGWC-9 **Lab ID: 262329014** Collected: 02/27/18 13:30 Received: 02/28/18 13:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.605 ± 0.296 (0.385) C:95% T:NA	pCi/L	03/14/18 08:39	13982-63-3	
Radium-228	EPA 9320	1.18 ± 0.456 (0.700) C:82% T:79%	pCi/L	03/21/18 12:17	15262-20-1	
Total Radium	Total Radium Calculation	1.79 ± 0.752 (1.09)	pCi/L	03/23/18 11:25	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Sample: FD-1 **Lab ID: 262329016** Collected: 02/27/18 00:00 Received: 02/28/18 13:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.622 ± 0.289 (0.342) C:101% T:NA	pCi/L	03/14/18 08:39	13982-63-3	
Radium-228	EPA 9320	0.736 ± 0.412 (0.749) C:82% T:74%	pCi/L	03/21/18 12:17	15262-20-1	
Total Radium	Total Radium Calculation	1.36 ± 0.701 (1.09)	pCi/L	03/23/18 11:25	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Sample: FB-1 **Lab ID: 262329018** Collected: 02/27/18 10:25 Received: 02/28/18 13:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.118 ± 0.155 (0.320) C:98% T:NA	pCi/L	03/14/18 08:39	13982-63-3	
Radium-228	EPA 9320	0.701 ± 0.391 (0.705) C:83% T:74%	pCi/L	03/21/18 12:17	15262-20-1	
Total Radium	Total Radium Calculation	0.819 ± 0.546 (1.03)	pCi/L	03/23/18 11:25	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Sample: EB-1 **Lab ID: 262329020** Collected: 02/27/18 16:15 Received: 02/28/18 13:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.357 ± 0.255 (0.431) C:96% T:NA	pCi/L	03/14/18 08:39	13982-63-3	
Radium-228	EPA 9320	0.873 ± 0.473 (0.867) C:81% T:75%	pCi/L	03/21/18 12:17	15262-20-1	
Total Radium	Total Radium Calculation	1.23 ± 0.728 (1.30)	pCi/L	03/23/18 11:25	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Sample: DGWC-10 **Lab ID: 262329022** Collected: 02/27/18 14:55 Received: 02/28/18 13:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.612 ± 0.295 (0.336) C:98% T:NA	pCi/L	03/14/18 08:39	13982-63-3	
Radium-228	EPA 9320	0.942 ± 0.431 (0.726) C:78% T:82%	pCi/L	03/21/18 12:17	15262-20-1	
Total Radium	Total Radium Calculation	1.55 ± 0.726 (1.06)	pCi/L	03/23/18 11:25	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Sample: DGWC-11 **Lab ID: 262329024** Collected: 02/27/18 14:30 Received: 02/28/18 13:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.496 ± 0.267 (0.362) C:95% T:NA	pCi/L	03/14/18 08:39	13982-63-3	
Radium-228	EPA 9320	0.640 ± 0.383 (0.706) C:80% T:74%	pCi/L	03/21/18 12:17	15262-20-1	
Total Radium	Total Radium Calculation	1.14 ± 0.650 (1.07)	pCi/L	03/23/18 11:25	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Sample: DGWC-12 **Lab ID: 262329026** Collected: 02/27/18 17:20 Received: 02/28/18 13:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.423 ± 0.231 (0.296) C:99% T:NA	pCi/L	03/14/18 08:39	13982-63-3	
Radium-228	EPA 9320	0.407 ± 0.270 (0.503) C:83% T:84%	pCi/L	03/21/18 12:18	15262-20-1	
Total Radium	Total Radium Calculation	0.830 ± 0.501 (0.799)	pCi/L	03/23/18 11:25	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Sample: DGWC-14 **Lab ID: 262329028** Collected: 02/27/18 16:10 Received: 02/28/18 13:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.309 ± 0.257 (0.479) C:93% T:NA	pCi/L	03/14/18 08:39	13982-63-3	
Radium-228	EPA 9320	0.386 ± 0.391 (0.807) C:79% T:71%	pCi/L	03/21/18 12:18	15262-20-1	
Total Radium	Total Radium Calculation	0.695 ± 0.648 (1.29)	pCi/L	03/23/18 11:25	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds
Pace Project No.: 262329

QC Batch:	290437	Analysis Method:	EPA 9320
QC Batch Method:	EPA 9320	Analysis Description:	9320 Radium 228
Associated Lab Samples:	262329002, 262329004, 262329006, 262329008, 262329010, 262329012, 262329014, 262329016, 262329018, 262329020, 262329022, 262329024, 262329026, 262329028		

METHOD BLANK:	1422134	Matrix:	Water
Associated Lab Samples:	262329002, 262329004, 262329006, 262329008, 262329010, 262329012, 262329014, 262329016, 262329018, 262329020, 262329022, 262329024, 262329026, 262329028		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.437 ± 0.326 (0.633) C:80% T:79%	pCi/L	03/21/18 12:17	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

QC Batch:	290436	Analysis Method:	EPA 9315
QC Batch Method:	EPA 9315	Analysis Description:	9315 Total Radium
Associated Lab Samples:	262329002, 262329004, 262329006, 262329008, 262329010, 262329012, 262329014, 262329016, 262329018, 262329020, 262329022, 262329024, 262329026, 262329028		

METHOD BLANK:	1422133	Matrix:	Water
Associated Lab Samples:	262329002, 262329004, 262329006, 262329008, 262329010, 262329012, 262329014, 262329016, 262329018, 262329020, 262329022, 262329024, 262329026, 262329028		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.161 ± 0.156 (0.277) C:97% T:NA	pCi/L	03/14/18 08:38	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262329

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.
ND - Not Detected at or above adjusted reporting limit.
J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.
MDL - Adjusted Method Detection Limit.
PQL - Practical Quantitation Limit.
RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.
S - Surrogate
1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.
Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.
LCS(D) - Laboratory Control Sample (Duplicate)
MS(D) - Matrix Spike (Duplicate)
DUP - Sample Duplicate
RPD - Relative Percent Difference
NC - Not Calculable.
SG - Silica Gel - Clean-Up
U - Indicates the compound was analyzed for, but not detected.
N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.
Act - Activity
Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).
Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)
(MDC) - Minimum Detectable Concentration
Trac - Tracer Recovery (%)
Carr - Carrier Recovery (%)
Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.
TNI - The NELAC Institute.

LABORATORIES

PASI-A Pace Analytical Services - Asheville
PASI-GA Pace Analytical Services - Atlanta, GA
PASI-PA Pace Analytical Services - Greensburg

ANALYTE QUALIFIERS

B Analyte was detected in the associated method blank.
D3 Sample was diluted due to the presence of high levels of non-target analytes or other matrix interference.
D6 The precision between the sample and sample duplicate exceeded laboratory control limits.
M1 Matrix spike recovery exceeded QC limits. Batch accepted based on laboratory control sample (LCS) recovery.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
262329001	DGWA-70A	EPA 3005A	1909	EPA 6020B	1969
262329003	DGWA-71	EPA 3005A	1909	EPA 6020B	1969
262329005	DGWC-2	EPA 3005A	1909	EPA 6020B	1969
262329007	DGWC-4	EPA 3005A	1909	EPA 6020B	1969
262329009	DGWC-5	EPA 3005A	1909	EPA 6020B	1969
262329011	DGWC-8	EPA 3005A	1909	EPA 6020B	1969
262329013	DGWC-9	EPA 3005A	1909	EPA 6020B	1969
262329015	FD-1	EPA 3005A	1909	EPA 6020B	1969
262329017	FB-1	EPA 3005A	1909	EPA 6020B	1969
262329019	EB-1	EPA 3005A	1909	EPA 6020B	1969
262329021	DGWC-10	EPA 3005A	1909	EPA 6020B	1969
262329023	DGWC-11	EPA 3005A	1909	EPA 6020B	1969
262329025	DGWC-12	EPA 3005A	1909	EPA 6020B	1969
262329027	DGWC-14	EPA 3005A	1909	EPA 6020B	1969
262329001	DGWA-70A	EPA 7470A	1881	EPA 7470A	2032
262329003	DGWA-71	EPA 7470A	1881	EPA 7470A	2032
262329005	DGWC-2	EPA 7470A	1881	EPA 7470A	2032
262329007	DGWC-4	EPA 7470A	1881	EPA 7470A	2032
262329009	DGWC-5	EPA 7470A	1881	EPA 7470A	2032
262329011	DGWC-8	EPA 7470A	1881	EPA 7470A	2032
262329013	DGWC-9	EPA 7470A	1881	EPA 7470A	2032
262329015	FD-1	EPA 7470A	1881	EPA 7470A	2032
262329017	FB-1	EPA 7470A	1881	EPA 7470A	2032
262329019	EB-1	EPA 7470A	1881	EPA 7470A	2032
262329021	DGWC-10	EPA 7470A	1881	EPA 7470A	2032
262329023	DGWC-11	EPA 7470A	1881	EPA 7470A	2032
262329025	DGWC-12	EPA 7470A	1881	EPA 7470A	2032
262329027	DGWC-14	EPA 7470A	1881	EPA 7470A	2032
262329002	DGWA-70A	EPA 9315	290436		
262329004	DGWA-71	EPA 9315	290436		
262329006	DGWC-2	EPA 9315	290436		
262329008	DGWC-4	EPA 9315	290436		
262329010	DGWC-5	EPA 9315	290436		
262329012	DGWC-8	EPA 9315	290436		
262329014	DGWC-9	EPA 9315	290436		
262329016	FD-1	EPA 9315	290436		
262329018	FB-1	EPA 9315	290436		
262329020	EB-1	EPA 9315	290436		
262329022	DGWC-10	EPA 9315	290436		
262329024	DGWC-11	EPA 9315	290436		
262329026	DGWC-12	EPA 9315	290436		
262329028	DGWC-14	EPA 9315	290436		
262329002	DGWA-70A	EPA 9320	290437		
262329004	DGWA-71	EPA 9320	290437		
262329006	DGWC-2	EPA 9320	290437		
262329008	DGWC-4	EPA 9320	290437		
262329010	DGWC-5	EPA 9320	290437		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Ash Ponds
Pace Project No.: 262329

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
262329012	DGWC-8	EPA 9320	290437		
262329014	DGWC-9	EPA 9320	290437		
262329016	FD-1	EPA 9320	290437		
262329018	FB-1	EPA 9320	290437		
262329020	EB-1	EPA 9320	290437		
262329022	DGWC-10	EPA 9320	290437		
262329024	DGWC-11	EPA 9320	290437		
262329026	DGWC-12	EPA 9320	290437		
262329028	DGWC-14	EPA 9320	290437		
262329002	DGWA-70A	Total Radium Calculation	292213		
262329004	DGWA-71	Total Radium Calculation	292213		
262329006	DGWC-2	Total Radium Calculation	292213		
262329008	DGWC-4	Total Radium Calculation	292213		
262329010	DGWC-5	Total Radium Calculation	292213		
262329012	DGWC-8	Total Radium Calculation	292213		
262329014	DGWC-9	Total Radium Calculation	292213		
262329016	FD-1	Total Radium Calculation	292213		
262329018	FB-1	Total Radium Calculation	292213		
262329020	EB-1	Total Radium Calculation	292213		
262329022	DGWC-10	Total Radium Calculation	292213		
262329024	DGWC-11	Total Radium Calculation	292213		
262329026	DGWC-12	Total Radium Calculation	292213		
262329028	DGWC-14	Total Radium Calculation	292213		
262329001	DGWA-70A	SM 2540C-2011	400516		
262329003	DGWA-71	SM 2540C-2011	400516		
262329005	DGWC-2	SM 2540C-2011	400516		
262329007	DGWC-4	SM 2540C-2011	400516		
262329009	DGWC-5	SM 2540C-2011	400516		
262329011	DGWC-8	SM 2540C-2011	400516		
262329013	DGWC-9	SM 2540C-2011	400516		
262329015	FD-1	SM 2540C-2011	400516		
262329017	FB-1	SM 2540C-2011	400516		
262329019	EB-1	SM 2540C-2011	400516		
262329021	DGWC-10	SM 2540C-2011	400516		
262329023	DGWC-11	SM 2540C-2011	400516		
262329025	DGWC-12	SM 2540C-2011	400516		
262329027	DGWC-14	SM 2540C-2011	400516		
262329001	DGWA-70A	EPA 300.0	1903		
262329003	DGWA-71	EPA 300.0	1903		
262329005	DGWC-2	EPA 300.0	1903		
262329007	DGWC-4	EPA 300.0	1903		
262329009	DGWC-5	EPA 300.0	1903		
262329011	DGWC-8	EPA 300.0	1903		
262329013	DGWC-9	EPA 300.0	1903		
262329015	FD-1	EPA 300.0	1903		
262329017	FB-1	EPA 300.0	1903		
262329019	EB-1	EPA 300.0	1903		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Ash Ponds

Pace Project No.: 262329

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
262329021	DGWC-10	EPA 300.0	1903		
262329023	DGWC-11	EPA 300.0	1903		
262329025	DGWC-12	EPA 300.0	1903		
262329027	DGWC-14	EPA 300.0	1903		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.pas-hbd.com

PAGE: 1 OF 2

CHAIN OF CUSTODY RECORD

CLIENT NAME: Georgia Power
CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185 Atlanta, GA 30308 404-506-7239

REPORT TO: Dawn Prell (Dawn_Prell@golder.com)
REQUESTED COMPLETION DATE:
CC: kiurinko@golder.com
PO #: laburch@southerncco.com

PROJECT NAME/STATE: Plant McDonough AP
PROJECT #: Phase II CCR

Collection DATE	Collection TIME	MATRIX CODE*	C O M P				SAMPLE IDENTIFICATION	ANALYSIS REQUESTED				CONTAINER TYPE PRESERVATION	CONTAINER TYPE PRESERVATION
			G	O	R	A		P	P	P	P		
02/27/18	1035	GW	X			DGWA-70A	4	1	1	2	Radium 226 & 228 (SW-846 9315/9320)	P- PLASTIC	1 - HCl, 56°C
02/27/18	0900	GW	X			DGWA-71	4	1	1	2	Cl, F, SO ₄ & TDS (EPA 300.0 & SM 2540C)	A - AMBER GLASS	2 - H ₂ SO ₄ , 56°C
02/27/18	1505	GW	X			BGWA-2 DGW-2	4	1	1	2	Metals App. III & IV (EPA 6020/470)	G - CLEAR GLASS	3 - HNO ₃
02/27/18	0940	GW	X			DGWC-4	4	1	1	2		V - VOA VIAL	4 - NaOH, 56°C
02/27/18	1120	GW	X			DGWC-5	4	1	1	2		S - STERILE	5 - NaOH/ZnAc, 56°C
02/27/18	1145	GW	X			DGWC-8	4	1	1	4		O - OTHER	6 - Na ₂ S ₂ O ₅ , 56°C
02/27/18	1330	GW	X			DGWC-9	4	1	1	2			7 - 56°C not frozen
02/27/18		GW	X			FD-1	4	1	1	2			
02/27/18	1025	W	X			FB-1	4	1	1	2			
02/27/18	1615	W	X			EB-1	4	1	1	2			
02/27/18	1455	GW	X			DGWC-10	4	1	1	2			
02/27/18	1430	GW	X			DGWC-11	4	1	1	2			

REMARKS/ADDITIONAL INFORMATION: Extra Radium

RELINQUISHED BY: [Signature] DATE/TIME: 2/28/18 1003

RELINQUISHED BY: [Signature] DATE/TIME: 2/28/18 1003

SAMPLED BY AND TITLE: Ben Hodges Field Lead

RECEIVED BY: Mike Navin

RECEIVED BY LAB: [Signature]

pH checked: [] No [] Yes [] NA [] No [] Yes [] NA

Temperature: 20°C Max.

Temp/Seal: [] Broken [] Not Present

Sample Shipped Via: UPS FED-EX USPS COURIER # of Coolers: 1000

Client: McDonough AP

Other: ES

LAB #: []

Entered into LIMS: []

Tracking #: []

WO# : 262329

262329

February 27 Plant McDonough COC Phase II CCR.xlsx



CHAIN OF CUSTODY RECORD

Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CLIENT NAME: Georgia Power CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185 Atlanta, GA 30308 404-506-7239 REPORT TO: Dawn Prell (Dawn_Prell@golder.com) REQUESTED COMPLETION DATE: laburch@southernmco.com PROJECT NAME/STATE: Plant McDonough AP PROJECT #: Phase II CCR		ANALYSIS REQUESTED <table border="1"> <tr> <th>CONTAINER TYPE</th> <th>P</th> <th>P</th> <th>P</th> <th>P</th> </tr> <tr> <td># of</td> <td>3</td> <td>7</td> <td>3</td> <td></td> </tr> </table>		CONTAINER TYPE	P	P	P	P	# of	3	7	3		CONTAINER TYPE P - PLASTIC A - AMBER GLASS G - CLEAR GLASS V - VOA VIAL S - STERILE O - OTHER PRESERVATION 1 - HCl, ≤6°C 2 - H ₂ SO ₄ , ≤6°C 3 - HNO ₃ 4 - NaOH, ≤6°C 5 - NaOH/ZnAc, ≤6°C 6 - Na ₂ S ₂ O ₃ , ≤6°C 7 - ≤6°C not frozen	
CONTAINER TYPE	P	P	P	P											
# of	3	7	3												
CONTAINER TYPE P - PLASTIC A - AMBER GLASS G - CLEAR GLASS V - VOA VIAL S - STERILE O - OTHER PRESERVATION 1 - HCl, ≤6°C 2 - H ₂ SO ₄ , ≤6°C 3 - HNO ₃ 4 - NaOH, ≤6°C 5 - NaOH/ZnAc, ≤6°C 6 - Na ₂ S ₂ O ₃ , ≤6°C 7 - ≤6°C not frozen		*MATRIX CODES: DW - DRINKING WATER S - SOIL WW - WASTEWATER SL - SLUDGE GW - GROUNDWATER SD - SOLID SW - SURFACE WATER A - AIR ST - STORM WATER L - LIQUID W - WATER P - PRODUCT		REMARKS/ADDITIONAL INFORMATION 75/26 2/27/18 1003 2/28/18 1330											
CONTAINER TYPE P - PLASTIC A - AMBER GLASS G - CLEAR GLASS V - VOA VIAL S - STERILE O - OTHER PRESERVATION 1 - HCl, ≤6°C 2 - H ₂ SO ₄ , ≤6°C 3 - HNO ₃ 4 - NaOH, ≤6°C 5 - NaOH/ZnAc, ≤6°C 6 - Na ₂ S ₂ O ₃ , ≤6°C 7 - ≤6°C not frozen		*MATRIX CODES: DW - DRINKING WATER S - SOIL WW - WASTEWATER SL - SLUDGE GW - GROUNDWATER SD - SOLID SW - SURFACE WATER A - AIR ST - STORM WATER L - LIQUID W - WATER P - PRODUCT		REMARKS/ADDITIONAL INFORMATION 75/26 2/27/18 1003 2/28/18 1330											

LAB #: FOR LAB USE ONLY

Entered into LIMS: _____

Tracking #: _____

WO#: 262329

PM: BM Due Date: 03/07/18

CLIENT: GAPower-CCR

February 27 Plant McDonough COC Phase II CCR.xlsx

Sample Condition Upon Receipt

WO# : 262329

Face Analytical

Client Name: GAPower

PM: BM

Due Date: 03/07/18

CLIENT: GAPower-CCR

Courier: Fed Ex UPS USPS Client Commercial Pace Other

Tracking #: _____

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Proj Name: _____

Packing Material: Bubble Wrap Bubble Bags None Other _____

Thermometer Used THROBS Type of Ice: Wet Blue None Samples on ice, cooling process has begun

Cooler Temperature 2.0°C

Biological Tissue is Frozen: Yes No

Date and Initials of person examining contents: 2/28/18 GJH

Temp should be above freezing to 6°C

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	7.
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.
-Includes date/time/ID/Analysis Matrix: <u>GW</u>		
All containers needing preservation have been checked	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
exceptions: VOA, coliform, TOC, O&G, Wt-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed
		Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
Pace Trip Blank Lot # (if purchased): _____		

Client Notification/ Resolution:

Field Data Required? Y N

Person Contacted _____ Date/Time _____

Comments/ Resolution _____

Project Manager Review: _____

Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers).

June 19, 2019

Joju Abraham
Georgia Power - Coal Combustion Residuals
2480 Maner Road
Atlanta, GA 30339

RE: Project: Plant McDonough Ash Ponds
Pace Project No.: 262357

Dear Joju Abraham:


Enclosed are the analytical results for sample(s) received by the laboratory on March 01, 2018. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

REV05302019_report revised per consultant request to adjust Ca RL for samples -001, -005, and -015 and all metals units.

REV06192019_report revised to correct system settings to report data to MDL.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Betsy McDaniel
betsy.mcdaniel@pacelabs.com
(770)734-4200
Project Manager

Enclosures

cc: Kristen Jurinko, Golder Associates Inc.
Julie Lehrman, Golder Associates Inc.
Dawn Prell, Golder Associates Inc.
Tim Richards, Golder Associates - Atlanta

Rebecca Thornton, Pace Analytical Atlanta



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

Atlanta Certification IDs

110 Technology Parkway Peachtree Corners, GA 30092

Florida DOH Certification #: E87315

Georgia DW Inorganics Certification #: 812

Georgia DW Microbiology Certification #: 812

North Carolina Certification #: 381

South Carolina Certification #: 98011001

Virginia Certification #: 460204

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601

ANAB DOD-ELAP Rad Accreditation #: L2417

Alabama Certification #: 41590

Arizona Certification #: AZ0734

Arkansas Certification

California Certification #: 04222CA

Colorado Certification #: PA01547

Connecticut Certification #: PH-0694

Delaware Certification

EPA Region 4 DW Rad

Florida/TNI Certification #: E87683

Georgia Certification #: C040

Guam Certification

Florida: Cert E871149 SEKS WET

Hawaii Certification

Idaho Certification

Illinois Certification

Indiana Certification

Iowa Certification #: 391

Kansas/TNI Certification #: E-10358

Kentucky Certification #: KY90133

KY WW Permit #: KY0098221

KY WW Permit #: KY0000221

Louisiana DHH/TNI Certification #: LA180012

Louisiana DEQ/TNI Certification #: 4086

Maine Certification #: 2017020

Maryland Certification #: 308

Massachusetts Certification #: M-PA1457

Michigan/PADEP Certification #: 9991

Missouri Certification #: 235

Montana Certification #: Cert0082

Nebraska Certification #: NE-OS-29-14

Nevada Certification #: PA014572018-1

New Hampshire/TNI Certification #: 297617

New Jersey/TNI Certification #: PA051

New Mexico Certification #: PA01457

New York/TNI Certification #: 10888

North Carolina Certification #: 42706

North Dakota Certification #: R-190

Ohio EPA Rad Approval: #41249

Oregon/TNI Certification #: PA200002-010

Pennsylvania/TNI Certification #: 65-00282

Puerto Rico Certification #: PA01457

Rhode Island Certification #: 65-00282

South Dakota Certification

Tennessee Certification #: 02867

Texas/TNI Certification #: T104704188-17-3

Utah/TNI Certification #: PA014572017-9

USDA Soil Permit #: P330-17-00091

Vermont Dept. of Health: ID# VT-0282

Virgin Island/PADEP Certification

Virginia/VELAP Certification #: 9526

Washington Certification #: C868

West Virginia DEP Certification #: 143

West Virginia DHHR Certification #: 9964C

Wisconsin Approve List for Rad

Wyoming Certification #: 8TMS-L

Asheville Certification IDs

2225 Riverside Drive, Asheville, NC 28804

Florida/NELAP Certification #: E87648

Massachusetts Certification #: M-NC030

North Carolina Drinking Water Certification #: 37712

North Carolina Wastewater Certification #: 40

South Carolina Certification #: 99030001

Virginia/VELAP Certification #: 460222

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: Plant McDonough Ash Ponds
Pace Project No.: 262357

Lab ID	Sample ID	Matrix	Date Collected	Date Received
262357001	DGWC-13	Water	02/28/18 09:05	03/01/18 14:20
262357002	DGWC-13	Water	02/28/18 09:05	03/01/18 14:20
262357003	DGWC-15	Water	02/28/18 11:05	03/01/18 14:20
262357004	DGWC-15	Water	02/28/18 11:05	03/01/18 14:20
262357005	DGWC-17	Water	02/28/18 09:10	03/01/18 14:20
262357006	DGWC-17	Water	02/28/18 09:10	03/01/18 14:20
262357007	DGWC-19	Water	02/28/18 11:55	03/01/18 14:20
262357008	DGWC-19	Water	02/28/18 11:55	03/01/18 14:20
262357009	DGWC-20	Water	02/28/18 14:50	03/01/18 14:20
262357010	DGWC-20	Water	02/28/18 14:50	03/01/18 14:20
262357011	DGWC-21	Water	02/28/18 15:15	03/01/18 14:20
262357012	DGWC-21	Water	02/28/18 15:15	03/01/18 14:20
262357013	DGWC-42	Water	02/28/18 15:30	03/01/18 14:20
262357014	DGWC-42	Water	02/28/18 15:30	03/01/18 14:20
262357015	FD-2	Water	02/28/18 00:00	03/01/18 14:20
262357016	FD-2	Water	02/28/18 00:00	03/01/18 14:20
262357017	FB-2	Water	02/28/18 10:55	03/01/18 14:20
262357018	FB-2	Water	02/28/18 10:55	03/01/18 14:20
262357019	EB-2	Water	02/28/18 16:25	03/01/18 14:20
262357020	EB-2	Water	02/28/18 16:25	03/01/18 14:20
262357021	DGWC-22	Water	02/28/18 16:45	03/01/18 14:20
262357022	DGWC-22	Water	02/28/18 16:45	03/01/18 14:20

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds
Pace Project No.: 262357

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
262357001	DGWC-13	EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C	EJJ	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
262357002	DGWC-13	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
262357003	DGWC-15	EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C	EJJ	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
262357004	DGWC-15	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
262357005	DGWC-17	EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C	EJJ	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
262357006	DGWC-17	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
262357007	DGWC-19	EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C	EJJ	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
262357008	DGWC-19	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
262357009	DGWC-20	EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C	EJJ	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
262357010	DGWC-20	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
262357011	DGWC-21	EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds
Pace Project No.: 262357

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
262357012	DGWC-21	SM 2540C	EJJ	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
		EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
262357013	DGWC-42	Total Radium Calculation	CMC	1	PASI-PA
		EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C	EJJ	1	PASI-A
262357014	DGWC-42	EPA 300.0	RLC	3	PASI-GA
		EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
262357015	FD-2	EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C	EJJ	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
262357016	FD-2	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
		EPA 6020B	CSW	14	PASI-GA
262357017	FB-2	EPA 7470A	MTC	1	PASI-GA
		SM 2540C	EJJ	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
		EPA 9315	JC2	1	PASI-PA
262357018	FB-2	EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
		EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
262357019	EB-2	SM 2540C	NAL	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
		EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
262357020	EB-2	Total Radium Calculation	CMC	1	PASI-PA
		EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C	NAL	1	PASI-A
262357021	DGWC-22	EPA 300.0	RLC	3	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C	NAL	1	PASI-A
		EPA 6020B	CSW	14	PASI-GA

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
262357022	DGWC-22	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

Sample: DGWC-13 **Lab ID: 262357001** Collected: 02/28/18 09:05 Received: 03/01/18 14:20 Matrix: Water

Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual
			Limit	MDL	DF				
6020B MET ICPMS Analytical Method: EPA 6020B Preparation Method: EPA 3005A									
Antimony	ND	mg/L	0.0030	0.00078	1	03/02/18 11:00	03/05/18 21:31	7440-36-0	
Arsenic	ND	mg/L	0.0050	0.00057	1	03/02/18 11:00	03/05/18 21:31	7440-38-2	
Barium	0.0079J	mg/L	0.010	0.00078	1	03/02/18 11:00	03/05/18 21:31	7440-39-3	
Beryllium	ND	mg/L	0.0030	0.000050	1	03/02/18 11:00	03/05/18 21:31	7440-41-7	
Boron	0.11	mg/L	0.040	0.0039	1	03/02/18 11:00	03/05/18 21:31	7440-42-8	
Cadmium	ND	mg/L	0.0010	0.000093	1	03/02/18 11:00	03/05/18 21:31	7440-43-9	
Calcium	13.1	mg/L	5.0	0.69	50	03/02/18 11:00	03/05/18 21:37	7440-70-2	
Chromium	0.0022J	mg/L	0.010	0.0016	1	03/02/18 11:00	03/05/18 21:31	7440-47-3	
Cobalt	ND	mg/L	0.010	0.00052	1	03/02/18 11:00	03/05/18 21:31	7440-48-4	
Lead	ND	mg/L	0.0050	0.00027	1	03/02/18 11:00	03/05/18 21:31	7439-92-1	
Lithium	ND	mg/L	0.050	0.00097	1	03/02/18 11:00	03/05/18 21:31	7439-93-2	
Molybdenum	0.0093J	mg/L	0.010	0.0019	1	03/02/18 11:00	03/05/18 21:31	7439-98-7	
Selenium	ND	mg/L	0.010	0.0014	1	03/02/18 11:00	03/05/18 21:31	7782-49-2	
Thallium	ND	mg/L	0.0010	0.00014	1	03/02/18 11:00	03/05/18 21:31	7440-28-0	
7470 Mercury Analytical Method: EPA 7470A Preparation Method: EPA 7470A									
Mercury	ND	mg/L	0.00050	0.000036	1	03/12/18 11:15	03/12/18 16:18	7439-97-6	
2540C Total Dissolved Solids Analytical Method: SM 2540C									
Total Dissolved Solids	84.0	mg/L	25.0	25.0	1		03/05/18 23:15		
300.0 IC Anions 28 Days Analytical Method: EPA 300.0									
Chloride	2.7	mg/L	0.25	0.024	1		03/02/18 21:28	16887-00-6	
Fluoride	0.18J	mg/L	0.30	0.029	1		03/02/18 21:28	16984-48-8	
Sulfate	43.5	mg/L	5.0	0.085	5		03/16/18 02:08	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

Sample: DGWC-15 **Lab ID: 262357003** Collected: 02/28/18 11:05 Received: 03/01/18 14:20 Matrix: Water

Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual
			Limit	MDL	DF				
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	mg/L	0.0030	0.00078	1	03/02/18 11:00	03/05/18 21:43	7440-36-0	
Arsenic	ND	mg/L	0.0050	0.00057	1	03/02/18 11:00	03/05/18 21:43	7440-38-2	
Barium	0.045	mg/L	0.010	0.00078	1	03/02/18 11:00	03/05/18 21:43	7440-39-3	
Beryllium	ND	mg/L	0.0030	0.000050	1	03/02/18 11:00	03/05/18 21:43	7440-41-7	
Boron	1.6	mg/L	0.040	0.0039	1	03/02/18 11:00	03/05/18 21:43	7440-42-8	
Cadmium	ND	mg/L	0.0010	0.000093	1	03/02/18 11:00	03/05/18 21:43	7440-43-9	
Calcium	35.0	mg/L	25.0	0.69	50	03/02/18 11:00	03/05/18 21:48	7440-70-2	
Chromium	ND	mg/L	0.010	0.0016	1	03/02/18 11:00	03/05/18 21:43	7440-47-3	
Cobalt	0.0016J	mg/L	0.010	0.00052	1	03/02/18 11:00	03/05/18 21:43	7440-48-4	
Lead	ND	mg/L	0.0050	0.00027	1	03/02/18 11:00	03/05/18 21:43	7439-92-1	
Lithium	0.0062J	mg/L	0.050	0.00097	1	03/02/18 11:00	03/05/18 21:43	7439-93-2	
Molybdenum	ND	mg/L	0.010	0.0019	1	03/02/18 11:00	03/05/18 21:43	7439-98-7	
Selenium	ND	mg/L	0.010	0.0014	1	03/02/18 11:00	03/05/18 21:43	7782-49-2	
Thallium	ND	mg/L	0.0010	0.00014	1	03/02/18 11:00	03/05/18 21:43	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	ND	mg/L	0.00050	0.000036	1	03/12/18 11:15	03/12/18 16:32	7439-97-6	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	313	mg/L	25.0	25.0	1		03/05/18 23:15		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	20.1	mg/L	2.5	0.24	10		03/16/18 02:28	16887-00-6	
Fluoride	ND	mg/L	0.30	0.029	1		03/02/18 21:48	16984-48-8	
Sulfate	168	mg/L	10.0	0.17	10		03/16/18 02:28	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262357

Sample: DGWC-17		Lab ID: 262357005		Collected: 02/28/18 09:10		Received: 03/01/18 14:20		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	mg/L	0.0030	0.00078	1	03/02/18 11:00	03/05/18 21:54	7440-36-0	
Arsenic	0.00073J	mg/L	0.0050	0.00057	1	03/02/18 11:00	03/05/18 21:54	7440-38-2	
Barium	0.053	mg/L	0.010	0.00078	1	03/02/18 11:00	03/05/18 21:54	7440-39-3	
Beryllium	0.00053J	mg/L	0.0030	0.000050	1	03/02/18 11:00	03/05/18 21:54	7440-41-7	
Boron	0.63	mg/L	0.040	0.0039	1	03/02/18 11:00	03/05/18 21:54	7440-42-8	
Cadmium	0.00022J	mg/L	0.0010	0.000093	1	03/02/18 11:00	03/05/18 21:54	7440-43-9	
Calcium	10.9	mg/L	5.0	0.69	50	03/02/18 11:00	03/05/18 22:00	7440-70-2	
Chromium	0.0022J	mg/L	0.010	0.0016	1	03/02/18 11:00	03/05/18 21:54	7440-47-3	
Cobalt	0.020	mg/L	0.010	0.00052	1	03/02/18 11:00	03/05/18 21:54	7440-48-4	
Lead	ND	mg/L	0.0050	0.00027	1	03/02/18 11:00	03/05/18 21:54	7439-92-1	
Lithium	ND	mg/L	0.050	0.00097	1	03/02/18 11:00	03/05/18 21:54	7439-93-2	
Molybdenum	ND	mg/L	0.010	0.0019	1	03/02/18 11:00	03/05/18 21:54	7439-98-7	
Selenium	0.0072J	mg/L	0.010	0.0014	1	03/02/18 11:00	03/05/18 21:54	7782-49-2	
Thallium	0.00015J	mg/L	0.0010	0.00014	1	03/02/18 11:00	03/05/18 21:54	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	ND	mg/L	0.00050	0.000036	1	03/12/18 11:15	03/12/18 16:44	7439-97-6	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	364	mg/L	25.0	25.0	1		03/05/18 23:15		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	17.0	mg/L	0.25	0.024	1		03/02/18 22:09	16887-00-6	
Fluoride	0.54	mg/L	0.30	0.029	1		03/02/18 22:09	16984-48-8	
Sulfate	203	mg/L	20.0	0.34	20		03/16/18 02:49	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262357

Sample: DGWC-19		Lab ID: 262357007		Collected: 02/28/18 11:55		Received: 03/01/18 14:20		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	03/02/18 11:00	03/05/18 22:17	7440-36-0		
Arsenic	0.0028J	mg/L	0.0050	0.00057	1	03/02/18 11:00	03/05/18 22:17	7440-38-2		
Barium	0.021	mg/L	0.010	0.00078	1	03/02/18 11:00	03/05/18 22:17	7440-39-3		
Beryllium	0.0020J	mg/L	0.0030	0.000050	1	03/02/18 11:00	03/05/18 22:17	7440-41-7		
Boron	2.9	mg/L	0.040	0.0039	1	03/02/18 11:00	03/05/18 22:17	7440-42-8		
Cadmium	0.00035J	mg/L	0.0010	0.000093	1	03/02/18 11:00	03/05/18 22:17	7440-43-9		
Calcium	72.0	mg/L	25.0	0.69	50	03/02/18 11:00	03/05/18 22:23	7440-70-2		
Chromium	0.0021J	mg/L	0.010	0.0016	1	03/02/18 11:00	03/05/18 22:17	7440-47-3		
Cobalt	0.051	mg/L	0.010	0.00052	1	03/02/18 11:00	03/05/18 22:17	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	03/02/18 11:00	03/05/18 22:17	7439-92-1		
Lithium	0.0031J	mg/L	0.050	0.00097	1	03/02/18 11:00	03/05/18 22:17	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	03/02/18 11:00	03/05/18 22:17	7439-98-7		
Selenium	0.011	mg/L	0.010	0.0014	1	03/02/18 11:00	03/05/18 22:17	7782-49-2		
Thallium	0.00049J	mg/L	0.0010	0.00014	1	03/02/18 11:00	03/05/18 22:17	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	03/12/18 11:15	03/12/18 16:47	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	440	mg/L	25.0	25.0	1		03/05/18 23:15			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	36.4	mg/L	5.0	0.48	20		03/16/18 03:10	16887-00-6		
Fluoride	1.2	mg/L	0.30	0.029	1		03/02/18 23:52	16984-48-8		
Sulfate	244	mg/L	20.0	0.34	20		03/16/18 03:10	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262357

Sample: DGWC-20		Lab ID: 262357009		Collected: 02/28/18 14:50		Received: 03/01/18 14:20		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	03/02/18 11:00	03/05/18 22:28	7440-36-0		
Arsenic	0.018	mg/L	0.0050	0.00057	1	03/02/18 11:00	03/05/18 22:28	7440-38-2		
Barium	0.0094J	mg/L	0.010	0.00078	1	03/02/18 11:00	03/05/18 22:28	7440-39-3		
Beryllium	0.0025J	mg/L	0.0030	0.000050	1	03/02/18 11:00	03/05/18 22:28	7440-41-7		
Boron	6.3	mg/L	0.040	0.0039	1	03/02/18 11:00	03/05/18 22:28	7440-42-8		
Cadmium	0.0018	mg/L	0.0010	0.000093	1	03/02/18 11:00	03/05/18 22:28	7440-43-9		
Calcium	86.3	mg/L	25.0	0.69	50	03/02/18 11:00	03/05/18 22:34	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	03/02/18 11:00	03/05/18 22:28	7440-47-3		
Cobalt	0.46	mg/L	0.010	0.00052	1	03/02/18 11:00	03/05/18 22:28	7440-48-4		
Lead	ND	mg/L	0.025	0.0014	5	03/02/18 11:00	03/08/18 17:38	7439-92-1	D3	
Lithium	0.0019J	mg/L	0.050	0.00097	1	03/02/18 11:00	03/05/18 22:28	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	03/02/18 11:00	03/05/18 22:28	7439-98-7		
Selenium	0.076	mg/L	0.010	0.0014	1	03/02/18 11:00	03/05/18 22:28	7782-49-2		
Thallium	ND	mg/L	0.0050	0.00071	5	03/02/18 11:00	03/08/18 17:38	7440-28-0	D3	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	03/12/18 11:15	03/12/18 16:49	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	888	mg/L	50.0	50.0	1		03/05/18 23:15			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	18.6	mg/L	0.25	0.024	1		03/03/18 00:13	16887-00-6		
Fluoride	0.76	mg/L	0.30	0.029	1		03/03/18 00:13	16984-48-8		
Sulfate	584	mg/L	50.0	0.85	50		03/20/18 00:29	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262357

Sample: DGWC-21		Lab ID: 262357011		Collected: 02/28/18 15:15		Received: 03/01/18 14:20		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	03/02/18 11:00	03/05/18 22:40	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	03/02/18 11:00	03/05/18 22:40	7440-38-2		
Barium	0.027	mg/L	0.010	0.00078	1	03/02/18 11:00	03/05/18 22:40	7440-39-3		
Beryllium	0.00016J	mg/L	0.0030	0.000050	1	03/02/18 11:00	03/05/18 22:40	7440-41-7		
Boron	5.9	mg/L	0.040	0.0039	1	03/02/18 11:00	03/05/18 22:40	7440-42-8		
Cadmium	0.00054J	mg/L	0.0010	0.000093	1	03/02/18 11:00	03/05/18 22:40	7440-43-9		
Calcium	73.2	mg/L	25.0	0.69	50	03/02/18 11:00	03/05/18 22:46	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	03/02/18 11:00	03/05/18 22:40	7440-47-3		
Cobalt	0.0094J	mg/L	0.010	0.00052	1	03/02/18 11:00	03/05/18 22:40	7440-48-4		
Lead	0.00047J	mg/L	0.0050	0.00027	1	03/02/18 11:00	03/05/18 22:40	7439-92-1		
Lithium	0.0061J	mg/L	0.050	0.00097	1	03/02/18 11:00	03/05/18 22:40	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	03/02/18 11:00	03/05/18 22:40	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	03/02/18 11:00	03/05/18 22:40	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	03/02/18 11:00	03/05/18 22:40	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	03/12/18 11:15	03/12/18 16:51	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	480	mg/L	50.0	50.0	1		03/05/18 23:15			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	19.9	mg/L	0.25	0.024	1		03/03/18 00:34	16887-00-6		
Fluoride	ND	mg/L	0.30	0.029	1		03/03/18 00:34	16984-48-8		
Sulfate	267	mg/L	20.0	0.34	20		03/16/18 05:14	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262357

Sample: DGWC-42		Lab ID: 262357013		Collected: 02/28/18 15:30		Received: 03/01/18 14:20		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	mg/L	0.0030	0.00078	1	03/07/18 10:35	03/07/18 16:54	7440-36-0	
Arsenic	0.0011J	mg/L	0.0050	0.00057	1	03/07/18 10:35	03/07/18 16:54	7440-38-2	
Barium	0.017	mg/L	0.010	0.00078	1	03/07/18 10:35	03/07/18 16:54	7440-39-3	
Beryllium	0.0029J	mg/L	0.0030	0.000050	1	03/07/18 10:35	03/07/18 16:54	7440-41-7	
Boron	0.92	mg/L	0.040	0.0039	1	03/07/18 10:35	03/07/18 16:54	7440-42-8	M1
Cadmium	0.00025J	mg/L	0.0010	0.000093	1	03/07/18 10:35	03/07/18 16:54	7440-43-9	
Calcium	45.1	mg/L	25.0	0.69	50	03/07/18 10:35	03/07/18 17:00	7440-70-2	M6
Chromium	ND	mg/L	0.010	0.0016	1	03/07/18 10:35	03/07/18 16:54	7440-47-3	
Cobalt	0.017	mg/L	0.010	0.00052	1	03/07/18 10:35	03/07/18 16:54	7440-48-4	
Lead	ND	mg/L	0.0050	0.00027	1	03/07/18 10:35	03/07/18 16:54	7439-92-1	
Lithium	0.012J	mg/L	0.050	0.00097	1	03/07/18 10:35	03/07/18 16:54	7439-93-2	
Molybdenum	ND	mg/L	0.010	0.0019	1	03/07/18 10:35	03/07/18 16:54	7439-98-7	
Selenium	ND	mg/L	0.010	0.0014	1	03/07/18 10:35	03/07/18 16:54	7782-49-2	
Thallium	ND	mg/L	0.0010	0.00014	1	03/07/18 10:35	03/07/18 16:54	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	ND	mg/L	0.00050	0.000036	1	03/12/18 11:15	03/12/18 16:54	7439-97-6	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	616	mg/L	50.0	50.0	1		03/05/18 23:15		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	29.0	mg/L	1.2	0.12	5		03/16/18 06:16	16887-00-6	M1
Fluoride	ND	mg/L	0.30	0.029	1		03/05/18 17:58	16984-48-8	
Sulfate	350	mg/L	25.0	0.42	25		03/16/18 06:36	14808-79-8	M1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

Sample: FD-2		Lab ID: 262357015		Collected: 02/28/18 00:00		Received: 03/01/18 14:20		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	mg/L	0.0030	0.00078	1	03/07/18 10:35	03/07/18 18:00	7440-36-0	
Arsenic	0.0014J	mg/L	0.0050	0.00057	1	03/07/18 10:35	03/07/18 18:00	7440-38-2	
Barium	0.052	mg/L	0.010	0.00078	1	03/07/18 10:35	03/07/18 18:00	7440-39-3	
Beryllium	0.00056J	mg/L	0.0030	0.000050	1	03/07/18 10:35	03/07/18 18:00	7440-41-7	
Boron	0.73	mg/L	0.040	0.0039	1	03/07/18 10:35	03/07/18 18:00	7440-42-8	
Cadmium	0.00024J	mg/L	0.0010	0.000093	1	03/07/18 10:35	03/07/18 18:00	7440-43-9	
Calcium	12.1	mg/L	5.0	0.69	50	03/07/18 10:35	03/07/18 18:06	7440-70-2	
Chromium	0.0024J	mg/L	0.010	0.0016	1	03/07/18 10:35	03/07/18 18:00	7440-47-3	
Cobalt	0.020	mg/L	0.010	0.00052	1	03/07/18 10:35	03/07/18 18:00	7440-48-4	
Lead	ND	mg/L	0.0050	0.00027	1	03/07/18 10:35	03/07/18 18:00	7439-92-1	
Lithium	ND	mg/L	0.050	0.00097	1	03/07/18 10:35	03/07/18 18:00	7439-93-2	
Molybdenum	ND	mg/L	0.010	0.0019	1	03/07/18 10:35	03/07/18 18:00	7439-98-7	
Selenium	0.0077J	mg/L	0.010	0.0014	1	03/07/18 10:35	03/07/18 18:00	7782-49-2	
Thallium	0.00016J	mg/L	0.0010	0.00014	1	03/07/18 10:35	03/07/18 18:00	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	ND	mg/L	0.00050	0.000036	1	03/12/18 11:15	03/12/18 16:56	7439-97-6	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	364	mg/L	25.0	25.0	1		03/05/18 23:15		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	17.0	mg/L	0.25	0.024	1		03/05/18 19:00	16887-00-6	M1
Fluoride	0.86	mg/L	0.30	0.029	1		03/05/18 19:00	16984-48-8	
Sulfate	217	mg/L	25.0	0.42	25		03/16/18 06:57	14808-79-8	M1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262357

Sample: FB-2		Lab ID: 262357017		Collected: 02/28/18 10:55		Received: 03/01/18 14:20		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	03/07/18 10:35	03/07/18 18:11	7440-36-0		
Arsenic	0.00091J	mg/L	0.0050	0.00057	1	03/07/18 10:35	03/07/18 18:11	7440-38-2		
Barium	ND	mg/L	0.010	0.00078	1	03/07/18 10:35	03/07/18 18:11	7440-39-3		
Beryllium	ND	mg/L	0.0030	0.000050	1	03/07/18 10:35	03/07/18 18:11	7440-41-7		
Boron	0.0046J	mg/L	0.040	0.0039	1	03/07/18 10:35	03/07/18 18:11	7440-42-8		
Cadmium	ND	mg/L	0.0010	0.000093	1	03/07/18 10:35	03/07/18 18:11	7440-43-9		
Calcium	0.033J	mg/L	0.50	0.014	1	03/07/18 10:35	03/07/18 18:11	7440-70-2	B	
Chromium	ND	mg/L	0.010	0.0016	1	03/07/18 10:35	03/07/18 18:11	7440-47-3		
Cobalt	ND	mg/L	0.010	0.00052	1	03/07/18 10:35	03/07/18 18:11	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	03/07/18 10:35	03/07/18 18:11	7439-92-1		
Lithium	ND	mg/L	0.050	0.00097	1	03/07/18 10:35	03/07/18 18:11	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	03/07/18 10:35	03/07/18 18:11	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	03/07/18 10:35	03/07/18 18:11	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	03/07/18 10:35	03/07/18 18:11	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	03/12/18 11:15	03/12/18 16:58	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	ND	mg/L	25.0	25.0	1		03/05/18 23:15			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	0.057J	mg/L	0.25	0.024	1		03/05/18 19:20	16887-00-6	B	
Fluoride	ND	mg/L	0.30	0.029	1		03/05/18 19:20	16984-48-8		
Sulfate	0.053J	mg/L	1.0	0.017	1		03/05/18 19:20	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

Sample: EB-2 **Lab ID: 262357019** Collected: 02/28/18 16:25 Received: 03/01/18 14:20 Matrix: Water

Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual
			Limit	MDL	DF				
6020B MET ICPMS Analytical Method: EPA 6020B Preparation Method: EPA 3005A									
Antimony	ND	mg/L	0.0030	0.00078	1	03/07/18 10:35	03/07/18 18:17	7440-36-0	
Arsenic	0.00086J	mg/L	0.0050	0.00057	1	03/07/18 10:35	03/07/18 18:17	7440-38-2	
Barium	ND	mg/L	0.010	0.00078	1	03/07/18 10:35	03/07/18 18:17	7440-39-3	
Beryllium	ND	mg/L	0.0030	0.000050	1	03/07/18 10:35	03/07/18 18:17	7440-41-7	
Boron	0.073	mg/L	0.040	0.0039	1	03/07/18 10:35	03/07/18 18:17	7440-42-8	
Cadmium	ND	mg/L	0.0010	0.000093	1	03/07/18 10:35	03/07/18 18:17	7440-43-9	
Calcium	1.0	mg/L	0.50	0.014	1	03/07/18 10:35	03/07/18 18:17	7440-70-2	
Chromium	ND	mg/L	0.010	0.0016	1	03/07/18 10:35	03/07/18 18:17	7440-47-3	
Cobalt	0.0056J	mg/L	0.010	0.00052	1	03/07/18 10:35	03/07/18 18:17	7440-48-4	
Lead	ND	mg/L	0.0050	0.00027	1	03/07/18 10:35	03/07/18 18:17	7439-92-1	
Lithium	ND	mg/L	0.050	0.00097	1	03/07/18 10:35	03/07/18 18:17	7439-93-2	
Molybdenum	ND	mg/L	0.010	0.0019	1	03/07/18 10:35	03/07/18 18:17	7439-98-7	
Selenium	ND	mg/L	0.010	0.0014	1	03/07/18 10:35	03/07/18 18:17	7782-49-2	
Thallium	ND	mg/L	0.0010	0.00014	1	03/07/18 10:35	03/07/18 18:17	7440-28-0	
7470 Mercury Analytical Method: EPA 7470A Preparation Method: EPA 7470A									
Mercury	ND	mg/L	0.00050	0.000036	1	03/12/18 11:15	03/12/18 17:01	7439-97-6	
2540C Total Dissolved Solids Analytical Method: SM 2540C									
Total Dissolved Solids	ND	mg/L	25.0	25.0	1		03/06/18 18:02		
300.0 IC Anions 28 Days Analytical Method: EPA 300.0									
Chloride	0.066J	mg/L	0.25	0.024	1		03/05/18 19:41	16887-00-6	B
Fluoride	ND	mg/L	0.30	0.029	1		03/05/18 19:41	16984-48-8	
Sulfate	ND	mg/L	1.0	0.017	1		03/05/18 19:41	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262357

Sample: DGWC-22		Lab ID: 262357021		Collected: 02/28/18 16:45		Received: 03/01/18 14:20		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	03/07/18 10:35	03/07/18 18:23	7440-36-0		
Arsenic	0.0010J	mg/L	0.0050	0.00057	1	03/07/18 10:35	03/07/18 18:23	7440-38-2		
Barium	0.035	mg/L	0.010	0.00078	1	03/07/18 10:35	03/07/18 18:23	7440-39-3		
Beryllium	0.00019J	mg/L	0.0030	0.000050	1	03/07/18 10:35	03/07/18 18:23	7440-41-7		
Boron	5.1	mg/L	2.0	0.20	50	03/07/18 10:35	03/07/18 18:29	7440-42-8		
Cadmium	0.00086J	mg/L	0.0010	0.000093	1	03/07/18 10:35	03/07/18 18:23	7440-43-9		
Calcium	62.3	mg/L	25.0	0.69	50	03/07/18 10:35	03/07/18 18:29	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	03/07/18 10:35	03/07/18 18:23	7440-47-3		
Cobalt	0.0098J	mg/L	0.010	0.00052	1	03/07/18 10:35	03/07/18 18:23	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	03/07/18 10:35	03/07/18 18:23	7439-92-1		
Lithium	0.0043J	mg/L	0.050	0.00097	1	03/07/18 10:35	03/07/18 18:23	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	03/07/18 10:35	03/07/18 18:23	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	03/07/18 10:35	03/07/18 18:23	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	03/07/18 10:35	03/07/18 18:23	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	03/12/18 11:15	03/12/18 17:03	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	476	mg/L	25.0	25.0	1		03/06/18 18:02			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	23.4	mg/L	2.5	0.24	10		03/16/18 07:19	16887-00-6		
Fluoride	ND	mg/L	0.30	0.029	1		03/05/18 20:02	16984-48-8		
Sulfate	278	mg/L	50.0	0.85	50		03/16/18 07:40	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 262357

QC Batch: 1882 Analysis Method: EPA 7470A
QC Batch Method: EPA 7470A Analysis Description: 7470 Mercury
Associated Lab Samples: 262357001, 262357003, 262357005, 262357007, 262357009, 262357011, 262357013, 262357015, 262357017, 262357019, 262357021

METHOD BLANK: 10597 Matrix: Water
Associated Lab Samples: 262357001, 262357003, 262357005, 262357007, 262357009, 262357011, 262357013, 262357015, 262357017, 262357019, 262357021

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Mercury	mg/L	ND	0.00050	0.000036	03/12/18 16:13	

LABORATORY CONTROL SAMPLE: 10598

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Mercury	mg/L	0.0025	0.0023	92	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 11862 11863

Parameter	Units	262357001 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	Max RPD	Qual
Mercury	mg/L	ND	0.0025	0.0025	0.0023	0.0023	93	93	75-125	0	20

SAMPLE DUPLICATE: 11806

Parameter	Units	261274003 Result	Dup Result	RPD	Max RPD	Qualifiers
Mercury	mg/L	0.10J ug/L	0.000050J		20	H1

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 262357

QC Batch: 1909 Analysis Method: EPA 6020B
QC Batch Method: EPA 3005A Analysis Description: 6020B MET
Associated Lab Samples: 262357001, 262357003, 262357005, 262357007, 262357009, 262357011

METHOD BLANK: 10718 Matrix: Water
Associated Lab Samples: 262357001, 262357003, 262357005, 262357007, 262357009, 262357011

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Antimony	mg/L	0.00079J	0.0030	0.00078	03/05/18 17:54	
Arsenic	mg/L	ND	0.0050	0.00057	03/05/18 17:54	
Barium	mg/L	ND	0.010	0.00078	03/05/18 17:54	
Beryllium	mg/L	ND	0.0030	0.000050	03/05/18 17:54	
Boron	mg/L	ND	0.040	0.0039	03/05/18 17:54	
Cadmium	mg/L	ND	0.0010	0.000093	03/05/18 17:54	
Calcium	mg/L	0.015J	0.10	0.014	03/05/18 17:54	
Chromium	mg/L	ND	0.010	0.0016	03/05/18 17:54	
Cobalt	mg/L	ND	0.010	0.00052	03/05/18 17:54	
Lead	mg/L	ND	0.0050	0.00027	03/05/18 17:54	
Lithium	mg/L	ND	0.050	0.00097	03/05/18 17:54	
Molybdenum	mg/L	ND	0.010	0.0019	03/05/18 17:54	
Selenium	mg/L	ND	0.010	0.0014	03/05/18 17:54	
Thallium	mg/L	ND	0.0010	0.00014	03/05/18 17:54	

LABORATORY CONTROL SAMPLE: 10719

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Antimony	mg/L	0.1	0.10	104	80-120	
Arsenic	mg/L	0.1	0.10	103	80-120	
Barium	mg/L	0.1	0.10	102	80-120	
Beryllium	mg/L	0.1	0.11	105	80-120	
Boron	mg/L	1	1.1	111	80-120	
Cadmium	mg/L	0.1	0.10	102	80-120	
Calcium	mg/L	1	1.0	103	80-120	
Chromium	mg/L	0.1	0.11	109	80-120	
Cobalt	mg/L	0.1	0.11	111	80-120	
Lead	mg/L	0.1	0.10	104	80-120	
Lithium	mg/L	0.1	0.11	109	80-120	
Molybdenum	mg/L	0.1	0.11	106	80-120	
Selenium	mg/L	0.1	0.10	101	80-120	
Thallium	mg/L	0.1	0.10	101	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 10722 10723

Parameter	Units	262329003 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	Max RPD	Qual
Antimony	mg/L	ND	0.1	0.1	0.11	0.11	105	106	75-125	1	20

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

Parameter	Units	MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 10722		10723		MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
		262329003 Result	MS Spike Conc.	MSD Spike Conc.									
Arsenic	mg/L	ND	0.1	0.1	0.10	0.10	102	102	75-125	0	20		
Barium	mg/L	0.029	0.1	0.1	0.16	0.18	132	153	75-125	12	20	M1	
Beryllium	mg/L	0.000092J	0.1	0.1	0.10	0.10	104	104	75-125	1	20		
Boron	mg/L	0.0069J	1	1	1.1	1.1	108	108	75-125	0	20		
Cadmium	mg/L	ND	0.1	0.1	0.10	0.10	103	102	75-125	1	20		
Calcium	mg/L	6.1	1	1	7.5	7.6	136	144	75-125	1	20		
Chromium	mg/L	ND	0.1	0.1	0.11	0.11	107	106	75-125	0	20		
Cobalt	mg/L	ND	0.1	0.1	0.11	0.11	109	109	75-125	1	20		
Lead	mg/L	ND	0.1	0.1	0.10	0.10	104	102	75-125	2	20		
Lithium	mg/L	0.0013J	0.1	0.1	0.10	0.10	103	101	75-125	2	20		
Molybdenum	mg/L	ND	0.1	0.1	0.11	0.11	109	109	75-125	0	20		
Selenium	mg/L	ND	0.1	0.1	0.11	0.10	106	103	75-125	3	20		
Thallium	mg/L	ND	0.1	0.1	0.10	0.10	104	102	75-125	2	20		

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 262357

QC Batch: 2137 Analysis Method: EPA 6020B
QC Batch Method: EPA 3005A Analysis Description: 6020B MET
Associated Lab Samples: 262357013, 262357015, 262357017, 262357019, 262357021

METHOD BLANK: 11618 Matrix: Water
Associated Lab Samples: 262357013, 262357015, 262357017, 262357019, 262357021

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Antimony	mg/L	ND	0.0030	0.00078	03/07/18 16:41	
Arsenic	mg/L	ND	0.0050	0.00057	03/07/18 16:41	
Barium	mg/L	ND	0.010	0.00078	03/07/18 16:41	
Beryllium	mg/L	ND	0.0030	0.000050	03/07/18 16:41	
Boron	mg/L	ND	0.040	0.0039	03/07/18 16:41	
Cadmium	mg/L	ND	0.0010	0.000093	03/07/18 16:41	
Calcium	mg/L	0.024J	0.50	0.014	03/07/18 16:41	
Chromium	mg/L	ND	0.010	0.0016	03/07/18 16:41	
Cobalt	mg/L	ND	0.010	0.00052	03/07/18 16:41	
Lead	mg/L	ND	0.0050	0.00027	03/07/18 16:41	
Lithium	mg/L	ND	0.050	0.00097	03/07/18 16:41	
Molybdenum	mg/L	ND	0.010	0.0019	03/07/18 16:41	
Selenium	mg/L	ND	0.010	0.0014	03/07/18 16:41	
Thallium	mg/L	ND	0.0010	0.00014	03/07/18 16:41	

LABORATORY CONTROL SAMPLE: 11619

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Antimony	mg/L	0.1	0.098	98	80-120	
Arsenic	mg/L	0.1	0.099	99	80-120	
Barium	mg/L	0.1	0.095	95	80-120	
Beryllium	mg/L	0.1	0.11	110	80-120	
Boron	mg/L	1	1.1	109	80-120	
Cadmium	mg/L	0.1	0.10	100	80-120	
Calcium	mg/L	1	1.0	103	80-120	
Chromium	mg/L	0.1	0.099	99	80-120	
Cobalt	mg/L	0.1	0.099	99	80-120	
Lead	mg/L	0.1	0.10	100	80-120	
Lithium	mg/L	0.1	0.11	115	80-120	
Molybdenum	mg/L	0.1	0.10	102	80-120	
Selenium	mg/L	0.1	0.10	100	80-120	
Thallium	mg/L	0.1	0.098	98	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 11620 11621

Parameter	Units	262357013 Result	MS		MSD		MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
			Spike Conc.	MS Result	MSD Result							
Antimony	mg/L	ND	0.1	0.1	0.10	0.10	103	102	75-125	1	20	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 262357

Parameter	Units	MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 11620		11621		MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
		262357013 Result	MS Spike Conc.	MSD Spike Conc.	MS Result								
Arsenic	mg/L	0.0011J	0.1	0.1	0.11	0.11	105	104	75-125	1	20		
Barium	mg/L	0.017	0.1	0.1	0.12	0.12	99	98	75-125	1	20		
Beryllium	mg/L	0.0029J	0.1	0.1	0.10	0.099	99	97	75-125	3	20		
Boron	mg/L	0.92	1	1	2.6	2.6	171	171	75-125	0	20		
Cadmium	mg/L	0.00025J	0.1	0.1	0.10	0.10	100	103	75-125	3	20		
Calcium	mg/L	45.1	1	1	45.5	45.5	38	42	75-125	0	20	M6	
Chromium	mg/L	ND	0.1	0.1	0.099	0.097	99	97	75-125	2	20		
Cobalt	mg/L	0.017	0.1	0.1	0.12	0.12	102	101	75-125	0	20		
Lead	mg/L	ND	0.1	0.1	0.097	0.097	97	97	75-125	0	20		
Lithium	mg/L	0.012J	0.1	0.1	0.11	0.11	103	100	75-125	3	20		
Molybdenum	mg/L	ND	0.1	0.1	0.11	0.11	110	110	75-125	0	20		
Selenium	mg/L	ND	0.1	0.1	0.10	0.10	104	104	75-125	0	20		
Thallium	mg/L	ND	0.1	0.1	0.097	0.097	97	97	75-125	0	20		

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

QC Batch: 400716

Analysis Method: SM 2540C

QC Batch Method: SM 2540C

Analysis Description: 2540C Total Dissolved Solids

Associated Lab Samples: 262357001, 262357003, 262357005, 262357007, 262357009, 262357011, 262357013, 262357015, 262357017

METHOD BLANK: 2222271

Matrix: Water

Associated Lab Samples: 262357001, 262357003, 262357005, 262357007, 262357009, 262357011, 262357013, 262357015, 262357017

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Total Dissolved Solids	mg/L	ND	25.0	25.0	03/05/18 23:15	

LABORATORY CONTROL SAMPLE: 2222272

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	250	254	102	90-110	

SAMPLE DUPLICATE: 2222273

Parameter	Units	92375157007 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	110	128	15	5	D6

SAMPLE DUPLICATE: 2222274

Parameter	Units	92375157017 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	ND	ND		5	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 262357

QC Batch: 400775 Analysis Method: SM 2540C
QC Batch Method: SM 2540C Analysis Description: 2540C Total Dissolved Solids
Associated Lab Samples: 262357019, 262357021

METHOD BLANK: 2222436 Matrix: Water
Associated Lab Samples: 262357019, 262357021

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Total Dissolved Solids	mg/L	ND	25.0	25.0	03/06/18 18:02	

LABORATORY CONTROL SAMPLE: 2222437

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	250	240	96	90-110	

SAMPLE DUPLICATE: 2222438

Parameter	Units	262357019 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	ND	ND		5	

SAMPLE DUPLICATE: 2222439

Parameter	Units	92375316009 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	494	484	2	5	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 262357

QC Batch: 1903 Analysis Method: EPA 300.0
QC Batch Method: EPA 300.0 Analysis Description: 300.0 IC Anions
Associated Lab Samples: 262357001, 262357003, 262357005, 262357007, 262357009, 262357011

METHOD BLANK: 10675 Matrix: Water
Associated Lab Samples: 262357001, 262357003, 262357005, 262357007, 262357009, 262357011

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Chloride	mg/L	ND	0.25	0.024	03/02/18 12:51	
Fluoride	mg/L	ND	0.30	0.029	03/02/18 12:51	
Sulfate	mg/L	ND	1.0	0.017	03/02/18 12:51	

LABORATORY CONTROL SAMPLE: 10676

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	10	10.3	103	90-110	
Fluoride	mg/L	10	9.9	99	90-110	
Sulfate	mg/L	10	9.9	99	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 10677 10678

Parameter	Units	262329001 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
Chloride	mg/L	2.5	10	10	12.0	12.1	95	96	90-110	1	15	
Fluoride	mg/L	ND	10	10	10.1	10.2	101	102	90-110	1	15	
Sulfate	mg/L	0.54J	10	10	10.6	10.7	101	102	90-110	1	15	

MATRIX SPIKE SAMPLE: 10679

Parameter	Units	262329003 Result	Spike Conc.	MS Result	MS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L		3.2	10	13.2	100	90-110
Fluoride	mg/L		ND	10	10.5	105	90-110
Sulfate	mg/L		7.4	10	17.3	99	90-110

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 262357

QC Batch: 1994 Analysis Method: EPA 300.0
QC Batch Method: EPA 300.0 Analysis Description: 300.0 IC Anions
Associated Lab Samples: 262357013, 262357015, 262357017, 262357019, 262357021

METHOD BLANK: 11098 Matrix: Water
Associated Lab Samples: 262357013, 262357015, 262357017, 262357019, 262357021

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Chloride	mg/L	0.058J	0.25	0.024	03/05/18 16:35	
Fluoride	mg/L	ND	0.30	0.029	03/05/18 16:35	
Sulfate	mg/L	ND	1.0	0.017	03/05/18 16:35	

LABORATORY CONTROL SAMPLE: 11099

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	10	10.4	104	90-110	
Fluoride	mg/L	10	10.1	101	90-110	
Sulfate	mg/L	10	9.9	99	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 11100 11101

Parameter	Units	262357013 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
Chloride	mg/L	29.0	10	10	34.6	34.5	56	55	90-110	0	15	E,M1
Fluoride	mg/L	ND	10	10	10.1	10.3	101	103	90-110	2	15	
Sulfate	mg/L	350	10	10	223	222	-1270	-1280	90-110	0	15	E,M1

MATRIX SPIKE SAMPLE: 11102

Parameter	Units	262357015 Result	Spike Conc.	MS Result	MS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	17.0	10	24.8	78	90-110	E,M1
Fluoride	mg/L	0.86	10	11.3	105	90-110	
Sulfate	mg/L	217	10	157	-607	90-110	E,M1

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

Sample: DGWC-13 **Lab ID: 262357002** Collected: 02/28/18 09:05 Received: 03/01/18 14:20 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.118 ± 0.191 (0.422) C:80% T:NA	pCi/L	03/14/18 08:40	13982-63-3	
Radium-228	EPA 9320	0.603 ± 0.351 (0.633) C:85% T:72%	pCi/L	03/21/18 12:18	15262-20-1	
Total Radium	Total Radium Calculation	0.721 ± 0.542 (1.06)	pCi/L	03/23/18 11:25	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.459 ± 0.260 (0.356) C:91% T:NA	pCi/L	03/14/18 08:40	13982-63-3	
Radium-228	EPA 9320	0.794 ± 0.381 (0.611) C:84% T:65%	pCi/L	03/21/18 12:18	15262-20-1	
Total Radium	Total Radium Calculation	1.25 ± 0.641 (0.967)	pCi/L	03/23/18 11:25	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

Sample: DGWC-17 **Lab ID: 262357006** Collected: 02/28/18 09:10 Received: 03/01/18 14:20 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.223 ± 0.238 (0.472) C:77% T:NA	pCi/L	03/14/18 08:40	13982-63-3	
Radium-228	EPA 9320	0.874 ± 0.393 (0.641) C:80% T:82%	pCi/L	03/21/18 12:18	15262-20-1	
Total Radium	Total Radium Calculation	1.10 ± 0.631 (1.11)	pCi/L	03/23/18 11:25	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

Sample: DGWC-19 **Lab ID: 262357008** Collected: 02/28/18 11:55 Received: 03/01/18 14:20 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.296 ± 0.238 (0.422) C:84% T:NA	pCi/L	03/14/18 08:40	13982-63-3	
Radium-228	EPA 9320	0.517 ± 0.385 (0.753) C:81% T:74%	pCi/L	03/21/18 12:18	15262-20-1	
Total Radium	Total Radium Calculation	0.813 ± 0.623 (1.18)	pCi/L	03/23/18 11:25	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

Sample: DGWC-20 **Lab ID: 262357010** Collected: 02/28/18 14:50 Received: 03/01/18 14:20 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.298 ± 0.236 (0.428) C:95% T:NA	pCi/L	03/14/18 08:40	13982-63-3	
Radium-228	EPA 9320	0.429 ± 0.302 (0.578) C:81% T:88%	pCi/L	03/21/18 12:18	15262-20-1	
Total Radium	Total Radium Calculation	0.727 ± 0.538 (1.01)	pCi/L	03/23/18 11:25	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

Sample: DGWC-21 **Lab ID: 262357012** Collected: 02/28/18 15:15 Received: 03/01/18 14:20 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.266 ± 0.220 (0.406) C:101% T:NA	pCi/L	03/14/18 08:40	13982-63-3	
Radium-228	EPA 9320	1.18 ± 0.472 (0.738) C:83% T:75%	pCi/L	03/21/18 12:19	15262-20-1	
Total Radium	Total Radium Calculation	1.45 ± 0.692 (1.14)	pCi/L	03/23/18 11:25	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

Sample: DGWC-42 **Lab ID: 262357014** Collected: 02/28/18 15:30 Received: 03/01/18 14:20 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.555 ± 0.311 (0.436) C:76% T:NA	pCi/L	03/14/18 08:37	13982-63-3	
Radium-228	EPA 9320	0.327 ± 0.277 (0.545) C:79% T:81%	pCi/L	03/20/18 14:35	15262-20-1	
Total Radium	Total Radium Calculation	0.882 ± 0.588 (0.981)	pCi/L	03/23/18 13:00	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

Sample: FD-2 **Lab ID: 262357016** Collected: 02/28/18 00:00 Received: 03/01/18 14:20 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.257 ± 0.275 (0.560) C:88% T:NA	pCi/L	03/14/18 08:37	13982-63-3	
Radium-228	EPA 9320	0.419 ± 0.304 (0.588) C:82% T:87%	pCi/L	03/20/18 14:35	15262-20-1	
Total Radium	Total Radium Calculation	0.676 ± 0.579 (1.15)	pCi/L	03/23/18 13:00	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

Sample: FB-2 **Lab ID: 262357018** Collected: 02/28/18 10:55 Received: 03/01/18 14:20 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.107 ± 0.237 (0.555) C:92% T:NA	pCi/L	03/14/18 08:38	13982-63-3	
Radium-228	EPA 9320	0.0654 ± 0.418 (0.944) C:78% T:86%	pCi/L	03/20/18 12:00	15262-20-1	
Total Radium	Total Radium Calculation	0.172 ± 0.655 (1.50)	pCi/L	03/23/18 13:00	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

Sample: EB-2 **Lab ID: 262357020** Collected: 02/28/18 16:25 Received: 03/01/18 14:20 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.670 ± 0.316 (0.326) C:84% T:NA	pCi/L	03/14/18 08:44	13982-63-3	
Radium-228	EPA 9320	0.495 ± 0.355 (0.698) C:77% T:94%	pCi/L	03/20/18 12:00	15262-20-1	
Total Radium	Total Radium Calculation	1.17 ± 0.671 (1.02)	pCi/L	03/23/18 13:00	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

Sample: DGWC-22 **Lab ID: 262357022** Collected: 02/28/18 16:45 Received: 03/01/18 14:20 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.522 ± 0.286 (0.345) C:78% T:NA	pCi/L	03/14/18 08:44	13982-63-3	
Radium-228	EPA 9320	0.396 ± 0.428 (0.902) C:82% T:85%	pCi/L	03/20/18 12:00	15262-20-1	
Total Radium	Total Radium Calculation	0.918 ± 0.714 (1.25)	pCi/L	03/23/18 13:00	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

QC Batch: 290437

Analysis Method: EPA 9320

QC Batch Method: EPA 9320

Analysis Description: 9320 Radium 228

Associated Lab Samples: 262357002, 262357004, 262357006, 262357008, 262357010, 262357012

METHOD BLANK: 1422134

Matrix: Water

Associated Lab Samples: 262357002, 262357004, 262357006, 262357008, 262357010, 262357012

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.437 ± 0.326 (0.633) C:80% T:79%	pCi/L	03/21/18 12:17	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

QC Batch: 290897 Analysis Method: EPA 9315

QC Batch Method: EPA 9315 Analysis Description: 9315 Total Radium

Associated Lab Samples: 262357014, 262357016, 262357018, 262357020, 262357022

METHOD BLANK: 1424476 Matrix: Water

Associated Lab Samples: 262357014, 262357016, 262357018, 262357020, 262357022

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.259 ± 0.235 (0.428) C:79% T:NA	pCi/L	03/14/18 08:37	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

QC Batch: 290436

Analysis Method: EPA 9315

QC Batch Method: EPA 9315

Analysis Description: 9315 Total Radium

Associated Lab Samples: 262357002, 262357004, 262357006, 262357008, 262357010, 262357012

METHOD BLANK: 1422133

Matrix: Water

Associated Lab Samples: 262357002, 262357004, 262357006, 262357008, 262357010, 262357012

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.161 ± 0.156 (0.277) C:97% T:NA	pCi/L	03/14/18 08:38	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

QC Batch: 290899

Analysis Method: EPA 9320

QC Batch Method: EPA 9320

Analysis Description: 9320 Radium 228

Associated Lab Samples: 262357014, 262357016, 262357018, 262357020, 262357022

METHOD BLANK: 1424478

Matrix: Water

Associated Lab Samples: 262357014, 262357016, 262357018, 262357020, 262357022

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.410 ± 0.336 (0.667) C:81% T:79%	pCi/L	03/20/18 11:27	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

LABORATORIES

PASI-A Pace Analytical Services - Asheville

PASI-GA Pace Analytical Services - Atlanta, GA

PASI-PA Pace Analytical Services - Greensburg

ANALYTE QUALIFIERS

B Analyte was detected in the associated method blank.

D3 Sample was diluted due to the presence of high levels of non-target analytes or other matrix interference.

D6 The precision between the sample and sample duplicate exceeded laboratory control limits.

E Analyte concentration exceeded the calibration range. The reported result is estimated.

H1 Analysis conducted outside the EPA method holding time.

M1 Matrix spike recovery exceeded QC limits. Batch accepted based on laboratory control sample (LCS) recovery.

M6 Matrix spike and Matrix spike duplicate recovery not evaluated against control limits due to sample dilution.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Ash Ponds

Pace Project No.: 262357

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
262357001	DGWC-13	EPA 3005A	1909	EPA 6020B	1969
262357003	DGWC-15	EPA 3005A	1909	EPA 6020B	1969
262357005	DGWC-17	EPA 3005A	1909	EPA 6020B	1969
262357007	DGWC-19	EPA 3005A	1909	EPA 6020B	1969
262357009	DGWC-20	EPA 3005A	1909	EPA 6020B	1969
262357011	DGWC-21	EPA 3005A	1909	EPA 6020B	1969
262357013	DGWC-42	EPA 3005A	2137	EPA 6020B	2184
262357015	FD-2	EPA 3005A	2137	EPA 6020B	2184
262357017	FB-2	EPA 3005A	2137	EPA 6020B	2184
262357019	EB-2	EPA 3005A	2137	EPA 6020B	2184
262357021	DGWC-22	EPA 3005A	2137	EPA 6020B	2184
262357001	DGWC-13	EPA 7470A	1882	EPA 7470A	2413
262357003	DGWC-15	EPA 7470A	1882	EPA 7470A	2413
262357005	DGWC-17	EPA 7470A	1882	EPA 7470A	2413
262357007	DGWC-19	EPA 7470A	1882	EPA 7470A	2413
262357009	DGWC-20	EPA 7470A	1882	EPA 7470A	2413
262357011	DGWC-21	EPA 7470A	1882	EPA 7470A	2413
262357013	DGWC-42	EPA 7470A	1882	EPA 7470A	2413
262357015	FD-2	EPA 7470A	1882	EPA 7470A	2413
262357017	FB-2	EPA 7470A	1882	EPA 7470A	2413
262357019	EB-2	EPA 7470A	1882	EPA 7470A	2413
262357021	DGWC-22	EPA 7470A	1882	EPA 7470A	2413
262357002	DGWC-13	EPA 9315	290436		
262357004	DGWC-15	EPA 9315	290436		
262357006	DGWC-17	EPA 9315	290436		
262357008	DGWC-19	EPA 9315	290436		
262357010	DGWC-20	EPA 9315	290436		
262357012	DGWC-21	EPA 9315	290436		
262357014	DGWC-42	EPA 9315	290897		
262357016	FD-2	EPA 9315	290897		
262357018	FB-2	EPA 9315	290897		
262357020	EB-2	EPA 9315	290897		
262357022	DGWC-22	EPA 9315	290897		
262357002	DGWC-13	EPA 9320	290437		
262357004	DGWC-15	EPA 9320	290437		
262357006	DGWC-17	EPA 9320	290437		
262357008	DGWC-19	EPA 9320	290437		
262357010	DGWC-20	EPA 9320	290437		
262357012	DGWC-21	EPA 9320	290437		
262357014	DGWC-42	EPA 9320	290899		
262357016	FD-2	EPA 9320	290899		
262357018	FB-2	EPA 9320	290899		
262357020	EB-2	EPA 9320	290899		
262357022	DGWC-22	EPA 9320	290899		
262357002	DGWC-13	Total Radium Calculation	292213		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Ash Ponds
Pace Project No.: 262357

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
262357004	DGWC-15	Total Radium Calculation	292213		
262357006	DGWC-17	Total Radium Calculation	292213		
262357008	DGWC-19	Total Radium Calculation	292213		
262357010	DGWC-20	Total Radium Calculation	292213		
262357012	DGWC-21	Total Radium Calculation	292213		
262357014	DGWC-42	Total Radium Calculation	292214		
262357016	FD-2	Total Radium Calculation	292214		
262357018	FB-2	Total Radium Calculation	292214		
262357020	EB-2	Total Radium Calculation	292214		
262357022	DGWC-22	Total Radium Calculation	292214		
262357001	DGWC-13	SM 2540C	400716		
262357003	DGWC-15	SM 2540C	400716		
262357005	DGWC-17	SM 2540C	400716		
262357007	DGWC-19	SM 2540C	400716		
262357009	DGWC-20	SM 2540C	400716		
262357011	DGWC-21	SM 2540C	400716		
262357013	DGWC-42	SM 2540C	400716		
262357015	FD-2	SM 2540C	400716		
262357017	FB-2	SM 2540C	400716		
262357019	EB-2	SM 2540C	400775		
262357021	DGWC-22	SM 2540C	400775		
262357001	DGWC-13	EPA 300.0	1903		
262357003	DGWC-15	EPA 300.0	1903		
262357005	DGWC-17	EPA 300.0	1903		
262357007	DGWC-19	EPA 300.0	1903		
262357009	DGWC-20	EPA 300.0	1903		
262357011	DGWC-21	EPA 300.0	1903		
262357013	DGWC-42	EPA 300.0	1994		
262357015	FD-2	EPA 300.0	1994		
262357017	FB-2	EPA 300.0	1994		
262357019	EB-2	EPA 300.0	1994		
262357021	DGWC-22	EPA 300.0	1994		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



CHAIN OF CUSTODY RECORD

Pace Analytical Services, Inc.
110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
(770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CLIENT NAME:
Georgia Power
CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER:
241 Ralph McGill Blvd SE B10185
Atlanta, GA 30308
404-506-7239
REPORT TO:
Dawn Prell (Dawn_Prell@golder.com)
CC: kiurinko@golder.com
REQUESTED COMPLETION DATE:
laburch@southernco.com
PROJECT NAME/STATE:
Plant McDonough AP

ANALYSIS REQUESTED

CONTAINER TYPE	P	P	P
# of	3	7	3

CONTAINER TYPE

P - PLASTIC	PRESERVATION
A - AMBER GLASS	1 - HCl, 58°C
G - CLEAR GLASS	2 - H ₂ SO ₄ , 58°C
V - VOA VIAL	3 - HNO ₃
S - STERILE	4 - NaOH, 58°C
O - OTHER	5 - NaOH/ZnAc, 58°C
	6 - Na ₂ S ₂ O ₈ , 58°C
	7 - 58°C not frozen

PROJECT #: Phase II CCR

MATRIX CODES:

DW - DRINKING WATER	S - SOIL
WW - WASTEWATER	SL - SLUDGE
GW - GROUNDWATER	SD - SOLID
SW - SURFACE WATER	A - AIR
ST - STORM WATER	L - LIQUID
W - WATER	P - PRODUCT

Collection DATE	Collection TIME	MATRIX CODE*	C O M P	G R A B	SAMPLE IDENTIFICATION
02/28/18	0905	GW	X	X	DGWC-13
02/28/18	1105	GW	X	X	DGWC-15
02/28/18	0910	GW	X	X	DGWC-17
02/28/18	1155	GW	X	X	DGWC-19
02/28/18	1450	GW	X	X	DGWC-20
02/28/18	1515	GW	X	X	DGWC-21
02/28/18	1530	GW	X	X	DGWC-42
02/28/18	-	GW	X	X	FD-2
02/28/18	1055	W	X	X	FB-2
02/28/18	1625	W	X	X	EB-2
02/28/18	1645	GW	X	X	DGWC-22

RELINQUISHED BY:

DATE/TIME	DATE/TIME	DATE/TIME
		3-1-18 / 0919

REMARKS/ADDITIONAL INFORMATION

Extra Radium

WO# : 262357

SAMPLED BY AND TITLE:
Ben Hodges Field Lead
RECEIVED BY: Mike

RELINQUISHED BY: Kevin Minkon


RECEIVED BY: Ryanman
Temperature: Min: 0.1 Max: 14.20
DATE/TIME: 02/28/18 1420
DATE/TIME: 3/1/18 0919
DATE/TIME: 3-1-18 / 0919

RELINQUISHED BY: Kevin Minkon
DATE/TIME: 3-1-18 / 0919

LAB #: FOR LAB USE ONLY
Entered into LIMS:
Tracking #:

February 28 Plant McDonough COC Phase II CCR.xlsx

Sample Condition Upon Receipt



Client Name: GIA Power

Project #

WO#: 262357

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____
Tracking #: _____

PM: BM Due Date: **03/08/18**
CLIENT: **GAPower-CCR**

Custody Seal on Cooler/Box Present: yes no Seals Intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other _____

Thermometer Used 83 Type of Ice: Wet Blue None Samples on Ice, cooling process has begun

Cooler Temperature 0.1 Biological Tissue is Frozen: Yes No
Temp should be above freezing to 6°C

Date and Initials of person examining contents: 3/1/18 MR

Comments:

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.
Sampler Name & Signature on COC:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.
-Includes date/time/ID/Analysis Matrix: <u>GIA</u>		
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed
		Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
Pace Trip Blank Lot # (if purchased):		

Client Notification/ Resolution:

Field Data Required? Y / N

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: _____

Project Manager Review: _____

Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-228
Analyst: JLW
Date: 3/13/2018
Worklist: 40364
Matrix: DW

Method Blank Assessment	
MB Sample ID	1422134
MB concentration:	0.437
M/B Counting Uncertainty:	0.317
MB MDC:	0.633
MB Numerical Performance Indicator:	2.71
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment	
Count Date:	3/21/2018
Spike I.D.:	17-033
Spike Concentration (pCi/mL):	22.092
Volume Used (mL):	0.20
Aliquot Volume (L, g, F):	0.808
Target Conc. (pCi/L, g, F):	5.470
Uncertainty (Calculated):	0.394
Result (pCi/L, g, F):	4.879
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.641
Numerical Performance Indicator:	-1.53
Percent Recovery:	89.25%
Status vs Numerical Indicator:	N/A
Status vs Recovery:	Pass

Duplicate Sample Assessment	
Sample I.D.:	LCS40364
Duplicate Sample I.D.:	LCS40364
Sample Result (pCi/L, g, F):	4.879
Sample Duplicate Result (pCi/L, g, F):	0.641
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	5.673
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	NO
Are sample and/or duplicate results below MDC?	NO
Duplicate Numerical Performance Indicator:	-1.666
Duplicate Numerical Performance Indicator:	14.98%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Pass

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

Handwritten notes:
3/13/18
55750014
JLW

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
Sample Matrix Spike Result:	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
Duplicate Numerical Performance Indicator:	
(Based on the Percent Recoveries) MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: JC2
Date: 3/13/2018
Worklist: 40363
Matrix: DW

Method Blank Assessment

MB Sample ID: 1422133
MB concentration: 0.161
MB Counting Uncertainty: 0.154
MB MDC: 0.277
MB Numerical Performance Indicator: 2.05
MB Status vs Numerical Indicator: N/A
MB Status vs. MDC: Pass

Laboratory Control Sample Assessment

LCS#	(Y or N)?	N/A
LCS-40363	3/14/2018	LCSB40363
Count Date:	3/14/2018	3/14/2018
Spike I.D.:	17-030	17-030
Spike Concentration (pCi/mL):	80.175	80.175
Volume Used (mL):	0.10	0.10
Aliquot Volume (L, g, F):	0.504	0.504
Target Conc. (pCi/L, g, F):	15.636	15.924
Uncertainty (Calculated):	1.440	1.467
Result (pCi/L, g, F):	12.494	12.265
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	1.074	
Numerical Performance Indicator:	-3.43	#VALUE!
Percent Recovery:	79.91%	77.02%
Status vs Numerical Indicator:	N/A	N/A
Status vs Recovery:	Pass	Pass

Duplicate Sample Assessment

Sample I.D.:	262329002	262329002
Duplicate Sample I.D.:	262329002DUP	262329002DUP
Sample Result (pCi/L, g, F):	0.138	0.138
Sample Duplicate Result (pCi/L, g, F):	0.212	0.212
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.229	0.190
Are sample and/or duplicate results below MDC?	See Below ##	See Below ##
Duplicate Numerical Performance Indicator:	-0.626	-0.626
Duplicate RPD:	49.48%	49.48%
Duplicate Status vs Numerical Indicator:	N/A	N/A
Duplicate Status vs RPD:	Fail**	Fail**

Enter Duplicate sample IDs if other than LCS/LCSD in the space below.
262329002
262329002DUP

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

Batch must be re-prepped due to unacceptable precision. Results < 5x MDC, numerical indicator < 2 acceptable for all matrices

3/13/18

Sample Matrix Spike Control Assessment

Sample Collection Date:
Sample I.D.
Sample MS I.D.
Sample MSD I.D.
Spike I.D.:

MS/MSD Decay Corrected Spike Concentration (pCi/mL):
Spike Volume Used in MS (mL):
Spike Volume Used in MSD (mL):
MS Aliquot (L, g, F):
MS Target Conc. (pCi/L, g, F):
MSD Aliquot (L, g, F):
MSD Target Conc. (pCi/L, g, F):
Spike uncertainty (calculated):

Sample Result:
Sample Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Result:
Sample Matrix Spike Duplicate Result:
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
MS Numerical Performance Indicator:
MS Percent Recovery:
MSD Percent Recovery:
MS Status vs Numerical Indicator:
MSD Status vs Numerical Indicator:
MS Status vs Recovery:
MSD Status vs Recovery:

Matrix Spike/Matrix Spike Duplicate Sample Assessment

Sample I.D.
Sample MS I.D.
Sample MSD I.D.

Sample Matrix Spike Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Duplicate Result:
Duplicate Numerical Performance Indicator:
MS/MSD Duplicate RPD:
MS/MSD Duplicate Status vs Numerical Indicator:
MS/MSD Duplicate Status vs RPD:

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: JC2
Date: 3/13/2018
Worklist: 40438
Matrix: DW

Method Blank Assessment	
MB Sample ID	1424476
MB concentration:	0.259
M/B Counting Uncertainty:	0.232
MB MDC:	0.428
MB Numerical Performance Indicator:	2.19
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment	
LCS (Y or N)?	N
LCS40438	LCS40438
Count Date:	3/14/2018
Spike I.D.:	17-030
Spike Concentration (pCi/mL):	80.175
Volume Used (mL):	0.10
Aliquot Volume (L, g, F):	0.508
Target Conc. (pCi/L, g, F):	15.792
Uncertainty (Calculated):	1.455
Result (pCi/L, g, F):	13.680
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	1.154
Numerical Performance Indicator:	-2.23
Percent Recovery:	86.63%
Status vs Numerical Indicator:	N/A
Status vs Recovery:	Pass

Duplicate Sample Assessment	
Sample I.D.:	262423006
Duplicate Sample I.D.:	262423006DUP
Sample Result (pCi/L, g, F):	1.030
Sample Result Counting Uncertainty (pCi/L, g, F):	0.365
Sample Duplicate Result (pCi/L, g, F):	0.981
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.346
Are sample and/or duplicate results below MDC?	See Below ##
Duplicate Numerical Performance Indicator:	0.194
Duplicate RPD:	4.95%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Pass

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Sample Matrix Spike Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Sample Matrix Spike Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	

Handwritten notes:
C
3/15/18
105

Handwritten notes:
JWW
3-14-18

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-228
Analyst: JLW
Date: 3/15/2018
Worklist: 40440
Matrix: DW

Method Blank Assessment	
MB Sample ID	1424478
MB concentration:	0.410
M/B Counting Uncertainty:	0.328
MB MDC:	0.667
MB Numerical Performance Indicator:	2.45
MB Status vs. Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment		LCS40440	Y
Count Date:	3/20/2018	LCS40440	
Spike I.D.:	17-033	3/20/2018	
Spike Concentration (pCi/mL):	22.099	17-033	
Volume Used (mL):	0.20	22.099	
Aliquot Volume (L, g, F):	0.812	0.20	
Target Conc. (pCi/L, g, F):	5.442	0.805	
Uncertainty (Calculated):	0.392	5.488	
Result (pCi/L, g, F):	6.878	0.395	
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.719	5.209	
Numerical Performance Indicator:	3.44	0.639	
Percent Recovery:	126.39%	94.91%	
Status vs Numerical Indicator:	N/A	N/A	
Status vs Recovery:	Pass	Pass	

Duplicate Sample Assessment	
Sample I.D.:	LCS40440
Duplicate Sample I.D.:	LCS40440
Sample Result (pCi/L, g, F):	6.878
Sample Duplicate Result (pCi/L, g, F):	0.719
Sample Duplicate Counting Uncertainty (pCi/L, g, F):	5.209
Are sample and/or duplicate results below MDC?:	NO
Duplicate Numerical Performance Indicator:	3.399
(Based on the LCS/LCSD Percent Recoveries) Duplicate RPD:	28.45%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Pass

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

3/20/18

3-20-18

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Sample Matrix Spike Duplicate Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
(Based on the Percent Recoveries) MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	

July 05, 2019

Joju Abraham
Georgia Power - Coal Combustion Residuals
2480 Maner Road
Atlanta, GA 30339

RE: Project: Plant McDonough Ash Ponds
Pace Project No.: 262423

Dear Joju Abraham:

Enclosed are the analytical results for sample(s) received by the laboratory on March 02, 2018. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

REV07052019_report revised per consultant request to correct MDL settings.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Betsy McDaniel
betsy.mcdaniel@pacelabs.com
(770)734-4200
Project Manager

Enclosures

cc: Kristen Jurinko, Golder Associates Inc.
Julie Lehrman, Golder Associates Inc.
Dawn Prell, Golder Associates Inc.
Tim Richards, Golder Associates - Atlanta
Rebecca Thornton, Pace Analytical Atlanta



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262423

Atlanta Certification IDs

110 Technology Parkway Peachtree Corners, GA 30092
Florida DOH Certification #: E87315
Georgia DW Inorganics Certification #: 812
Georgia DW Microbiology Certification #: 812

North Carolina Certification #: 381
South Carolina Certification #: 98011001
Virginia Certification #: 460204

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601
ANAB DOD-ELAP Rad Accreditation #: L2417
Alabama Certification #: 41590
Arizona Certification #: AZ0734
Arkansas Certification
California Certification #: 04222CA
Colorado Certification #: PA01547
Connecticut Certification #: PH-0694
Delaware Certification
EPA Region 4 DW Rad
Florida/TNI Certification #: E87683
Georgia Certification #: C040
Guam Certification
Florida: Cert E871149 SEKS WET
Hawaii Certification
Idaho Certification
Illinois Certification
Indiana Certification
Iowa Certification #: 391
Kansas/TNI Certification #: E-10358
Kentucky Certification #: KY90133
KY WW Permit #: KY0098221
KY WW Permit #: KY0000221
Louisiana DHH/TNI Certification #: LA180012
Louisiana DEQ/TNI Certification #: 4086
Maine Certification #: 2017020
Maryland Certification #: 308
Massachusetts Certification #: M-PA1457
Michigan/PADEP Certification #: 9991

Missouri Certification #: 235
Montana Certification #: Cert0082
Nebraska Certification #: NE-OS-29-14
Nevada Certification #: PA014572018-1
New Hampshire/TNI Certification #: 297617
New Jersey/TNI Certification #: PA051
New Mexico Certification #: PA01457
New York/TNI Certification #: 10888
North Carolina Certification #: 42706
North Dakota Certification #: R-190
Ohio EPA Rad Approval: #41249
Oregon/TNI Certification #: PA200002-010
Pennsylvania/TNI Certification #: 65-00282
Puerto Rico Certification #: PA01457
Rhode Island Certification #: 65-00282
South Dakota Certification
Tennessee Certification #: 02867
Texas/TNI Certification #: T104704188-17-3
Utah/TNI Certification #: PA014572017-9
USDA Soil Permit #: P330-17-00091
Vermont Dept. of Health: ID# VT-0282
Virgin Island/PADEP Certification
Virginia/VELAP Certification #: 9526
Washington Certification #: C868
West Virginia DEP Certification #: 143
West Virginia DHHR Certification #: 9964C
Wisconsin Approve List for Rad
Wyoming Certification #: 8TMS-L

Asheville Certification IDs

2225 Riverside Drive, Asheville, NC 28804
Florida/NELAP Certification #: E87648
Massachusetts Certification #: M-NC030
North Carolina Drinking Water Certification #: 37712

North Carolina Wastewater Certification #: 40
South Carolina Certification #: 99030001
Virginia/VELAP Certification #: 460222

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: Plant McDonough Ash Ponds
Pace Project No.: 262423

Lab ID	Sample ID	Matrix	Date Collected	Date Received
262423001	DGWC-37	Water	03/01/18 09:50	03/02/18 15:30
262423002	DGWC-37	Water	03/01/18 09:50	03/02/18 15:30
262423003	DGWC-23	Water	03/01/18 10:05	03/02/18 15:30
262423004	DGWC-23	Water	03/01/18 10:05	03/02/18 15:30
262423005	DGWC-47	Water	03/01/18 12:45	03/02/18 15:30
262423006	DGWC-47	Water	03/01/18 12:45	03/02/18 15:30
262423007	DGWC-39	Water	03/01/18 13:15	03/02/18 15:30
262423008	DGWC-39	Water	03/01/18 13:15	03/02/18 15:30
262423009	DGWC-38	Water	03/01/18 11:40	03/02/18 15:30
262423010	DGWC-38	Water	03/01/18 11:40	03/02/18 15:30
262423011	FD-3	Water	03/01/18 00:00	03/02/18 15:30
262423012	FD-3	Water	03/01/18 00:00	03/02/18 15:30
262423013	FB-3	Water	03/01/18 09:55	03/02/18 15:30
262423014	FB-3	Water	03/01/18 09:55	03/02/18 15:30
262423015	EB-3	Water	03/01/18 13:55	03/02/18 15:30
262423016	EB-3	Water	03/01/18 13:55	03/02/18 15:30
262423017	DGWC-67	Water	03/02/18 09:40	03/02/18 15:30
262423018	DGWC-67	Water	03/02/18 09:40	03/02/18 15:30
262423019	DGWC-68A	Water	03/02/18 11:10	03/02/18 15:30
262423020	DGWC-68A	Water	03/02/18 11:10	03/02/18 15:30
262423021	DGWC-69	Water	03/02/18 12:30	03/02/18 15:30
262423022	DGWC-69	Water	03/02/18 12:30	03/02/18 15:30
262423023	DGWC-40	Water	03/02/18 09:40	03/02/18 15:30
262423024	DGWC-40	Water	03/02/18 09:40	03/02/18 15:30
262423025	DGWC-48	Water	03/02/18 11:05	03/02/18 15:30
262423026	DGWC-48	Water	03/02/18 11:05	03/02/18 15:30

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds
Pace Project No.: 262423

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
262423001	DGWC-37	EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C	NAL	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
262423002	DGWC-37	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
262423003	DGWC-23	EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C	NAL	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
262423004	DGWC-23	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
262423005	DGWC-47	EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C	NAL	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
262423006	DGWC-47	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
262423007	DGWC-39	EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C	NAL	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
262423008	DGWC-39	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
262423009	DGWC-38	EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C	NAL	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
262423010	DGWC-38	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
262423011	FD-3	EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds
Pace Project No.: 262423

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
262423012	FD-3	SM 2540C	MJP	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
		EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
262423013	FB-3	Total Radium Calculation	CMC	1	PASI-PA
		EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C	MJP	1	PASI-A
262423014	FB-3	EPA 300.0	RLC	3	PASI-GA
		EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
262423015	EB-3	EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C	MJP	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
262423016	EB-3	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
		EPA 6020B	CSW	14	PASI-GA
262423017	DGWC-67	EPA 7470A	MTC	1	PASI-GA
		SM 2540C	MJP	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
		EPA 9315	JC2	1	PASI-PA
262423018	DGWC-67	EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
		EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
262423019	DGWC-68A	SM 2540C	MJP	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
		EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
262423020	DGWC-68A	Total Radium Calculation	CMC	1	PASI-PA
		EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C	MJP	1	PASI-A
262423021	DGWC-69	EPA 300.0	RLC	3	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C	MJP	1	PASI-A
		EPA 9315	JC2	1	PASI-PA

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
262423022	DGWC-69	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
262423023	DGWC-40	EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C	MJP	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
262423024	DGWC-40	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
262423025	DGWC-48	EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C	MJP	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
262423026	DGWC-48	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

Sample: DGWC-37		Lab ID: 262423001		Collected: 03/01/18 09:50		Received: 03/02/18 15:30		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	ug/L	3.0	0.78	1	03/07/18 10:35	03/09/18 16:17	7440-36-0	
Arsenic	ND	ug/L	5.0	0.57	1	03/07/18 10:35	03/09/18 16:17	7440-38-2	
Barium	102	ug/L	10.0	0.78	1	03/07/18 10:35	03/09/18 16:17	7440-39-3	
Beryllium	0.067J	ug/L	3.0	0.050	1	03/07/18 10:35	03/09/18 16:17	7440-41-7	
Boron	1870	ug/L	40.0	3.9	1	03/07/18 10:35	03/09/18 16:17	7440-42-8	
Cadmium	ND	ug/L	1.0	0.093	1	03/07/18 10:35	03/09/18 16:17	7440-43-9	
Calcium	57000	ug/L	25000	685	50	03/07/18 10:35	03/09/18 16:22	7440-70-2	M6
Chromium	ND	ug/L	10.0	1.6	1	03/07/18 10:35	03/09/18 16:17	7440-47-3	
Cobalt	ND	ug/L	10.0	0.52	1	03/07/18 10:35	03/09/18 16:17	7440-48-4	
Lead	ND	ug/L	5.0	0.27	1	03/07/18 10:35	03/09/18 16:17	7439-92-1	
Lithium	2.4J	ug/L	50.0	0.97	1	03/07/18 10:35	03/09/18 16:17	7439-93-2	
Molybdenum	ND	ug/L	10.0	1.9	1	03/07/18 10:35	03/09/18 16:17	7439-98-7	
Selenium	ND	ug/L	10.0	1.4	1	03/07/18 10:35	03/09/18 16:17	7782-49-2	
Thallium	ND	ug/L	1.0	0.14	1	03/07/18 10:35	03/09/18 16:17	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	ND	mg/L	0.00050	0.000036	1	03/12/18 13:25	03/13/18 14:15	7439-97-6	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	311	mg/L	25.0	25.0	1		03/06/18 18:13		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	6.3	mg/L	0.25	0.024	1		03/05/18 20:22	16887-00-6	
Fluoride	0.22J	mg/L	0.30	0.029	1		03/05/18 20:22	16984-48-8	
Sulfate	94.6	mg/L	10.0	0.17	10		03/16/18 08:01	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262423

Sample: DGWC-23		Lab ID: 262423003		Collected: 03/01/18 10:05		Received: 03/02/18 15:30		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	ug/L	3.0	0.78	1	03/07/18 10:35	03/09/18 17:24	7440-36-0	
Arsenic	ND	ug/L	5.0	0.57	1	03/07/18 10:35	03/09/18 17:24	7440-38-2	
Barium	16.4	ug/L	10.0	0.78	1	03/07/18 10:35	03/09/18 17:24	7440-39-3	
Beryllium	0.34J	ug/L	3.0	0.050	1	03/07/18 10:35	03/09/18 17:24	7440-41-7	
Boron	4370	ug/L	40.0	3.9	1	03/07/18 10:35	03/09/18 17:24	7440-42-8	
Cadmium	ND	ug/L	1.0	0.093	1	03/07/18 10:35	03/09/18 17:24	7440-43-9	
Calcium	66500	ug/L	25000	685	50	03/07/18 10:35	03/09/18 17:30	7440-70-2	
Chromium	3.3J	ug/L	10.0	1.6	1	03/07/18 10:35	03/09/18 17:24	7440-47-3	
Cobalt	ND	ug/L	10.0	0.52	1	03/07/18 10:35	03/09/18 17:24	7440-48-4	
Lead	ND	ug/L	5.0	0.27	1	03/07/18 10:35	03/09/18 17:24	7439-92-1	
Lithium	75.9	ug/L	50.0	0.97	1	03/07/18 10:35	03/09/18 17:24	7439-93-2	
Molybdenum	4.5J	ug/L	10.0	1.9	1	03/07/18 10:35	03/09/18 17:24	7439-98-7	
Selenium	ND	ug/L	10.0	1.4	1	03/07/18 10:35	03/09/18 17:24	7782-49-2	
Thallium	ND	ug/L	1.0	0.14	1	03/07/18 10:35	03/09/18 17:24	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	0.00013J	mg/L	0.00050	0.000036	1	03/12/18 13:25	03/13/18 14:06	7439-97-6	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	454	mg/L	25.0	25.0	1		03/06/18 18:13		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	14.8	mg/L	0.25	0.024	1		03/05/18 20:43	16887-00-6	
Fluoride	0.18J	mg/L	0.30	0.029	1		03/05/18 20:43	16984-48-8	
Sulfate	209	mg/L	25.0	0.42	25		03/16/18 09:47	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262423

Sample: DGWC-47		Lab ID: 262423005		Collected: 03/01/18 12:45		Received: 03/02/18 15:30		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	ug/L	3.0	0.78	1	03/07/18 10:35	03/09/18 17:35	7440-36-0	
Arsenic	2.9J	ug/L	5.0	0.57	1	03/07/18 10:35	03/09/18 17:35	7440-38-2	
Barium	16.4	ug/L	10.0	0.78	1	03/07/18 10:35	03/09/18 17:35	7440-39-3	
Beryllium	14.6	ug/L	3.0	0.050	1	03/07/18 10:35	03/09/18 17:35	7440-41-7	
Boron	296	ug/L	40.0	3.9	1	03/07/18 10:35	03/09/18 17:35	7440-42-8	
Cadmium	2.5	ug/L	1.0	0.093	1	03/07/18 10:35	03/09/18 17:35	7440-43-9	
Calcium	44200	ug/L	25000	685	50	03/07/18 10:35	03/09/18 17:41	7440-70-2	
Chromium	ND	ug/L	10.0	1.6	1	03/07/18 10:35	03/09/18 17:35	7440-47-3	
Cobalt	401	ug/L	10.0	0.52	1	03/07/18 10:35	03/09/18 17:35	7440-48-4	
Lead	1.1J	ug/L	5.0	0.27	1	03/07/18 10:35	03/09/18 17:35	7439-92-1	
Lithium	77.2	ug/L	50.0	0.97	1	03/07/18 10:35	03/09/18 17:35	7439-93-2	
Molybdenum	ND	ug/L	10.0	1.9	1	03/07/18 10:35	03/09/18 17:35	7439-98-7	
Selenium	12.4	ug/L	10.0	1.4	1	03/07/18 10:35	03/09/18 17:35	7782-49-2	
Thallium	0.32J	ug/L	1.0	0.14	1	03/07/18 10:35	03/09/18 17:35	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	ND	mg/L	0.00050	0.000036	1	03/12/18 13:25	03/13/18 14:18	7439-97-6	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	435	mg/L	25.0	25.0	1		03/06/18 18:13		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	10.7	mg/L	0.25	0.024	1		03/05/18 21:04	16887-00-6	
Fluoride	1.4	mg/L	0.30	0.029	1		03/05/18 21:04	16984-48-8	
Sulfate	245	mg/L	25.0	0.42	25		03/16/18 10:08	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

Sample: DGWC-39		Lab ID: 262423007		Collected: 03/01/18 13:15		Received: 03/02/18 15:30		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	ug/L	3.0	0.78	1	03/07/18 10:35	03/09/18 17:47	7440-36-0	
Arsenic	1.1J	ug/L	5.0	0.57	1	03/07/18 10:35	03/09/18 17:47	7440-38-2	
Barium	74.2	ug/L	10.0	0.78	1	03/07/18 10:35	03/09/18 17:47	7440-39-3	
Beryllium	ND	ug/L	3.0	0.050	1	03/07/18 10:35	03/09/18 17:47	7440-41-7	
Boron	2860	ug/L	40.0	3.9	1	03/07/18 10:35	03/09/18 17:47	7440-42-8	
Cadmium	ND	ug/L	1.0	0.093	1	03/07/18 10:35	03/09/18 17:47	7440-43-9	
Calcium	79600	ug/L	25000	685	50	03/07/18 10:35	03/09/18 17:52	7440-70-2	
Chromium	ND	ug/L	10.0	1.6	1	03/07/18 10:35	03/09/18 17:47	7440-47-3	
Cobalt	5.8J	ug/L	10.0	0.52	1	03/07/18 10:35	03/09/18 17:47	7440-48-4	
Lead	ND	ug/L	5.0	0.27	1	03/07/18 10:35	03/09/18 17:47	7439-92-1	
Lithium	ND	ug/L	50.0	0.97	1	03/07/18 10:35	03/09/18 17:47	7439-93-2	
Molybdenum	ND	ug/L	10.0	1.9	1	03/07/18 10:35	03/09/18 17:47	7439-98-7	
Selenium	ND	ug/L	10.0	1.4	1	03/07/18 10:35	03/09/18 17:47	7782-49-2	
Thallium	ND	ug/L	1.0	0.14	1	03/07/18 10:35	03/09/18 17:47	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	ND	mg/L	0.00050	0.000036	1	03/12/18 13:25	03/13/18 14:20	7439-97-6	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	440	mg/L	25.0	25.0	1		03/06/18 18:13		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	8.1	mg/L	0.25	0.024	1		03/05/18 22:47	16887-00-6	
Fluoride	0.13J	mg/L	0.30	0.029	1		03/05/18 22:47	16984-48-8	
Sulfate	166	mg/L	20.0	0.34	20		03/16/18 10:29	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262423

Sample: DGWC-38		Lab ID: 262423009		Collected: 03/01/18 11:40		Received: 03/02/18 15:30		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	ug/L	3.0	0.78	1	03/07/18 10:35	03/09/18 17:58	7440-36-0	
Arsenic	ND	ug/L	5.0	0.57	1	03/07/18 10:35	03/09/18 17:58	7440-38-2	
Barium	33.3	ug/L	10.0	0.78	1	03/07/18 10:35	03/09/18 17:58	7440-39-3	
Beryllium	0.054J	ug/L	3.0	0.050	1	03/07/18 10:35	03/09/18 17:58	7440-41-7	
Boron	3080	ug/L	40.0	3.9	1	03/07/18 10:35	03/09/18 17:58	7440-42-8	
Cadmium	0.18J	ug/L	1.0	0.093	1	03/07/18 10:35	03/09/18 17:58	7440-43-9	
Calcium	81800	ug/L	25000	685	50	03/07/18 10:35	03/09/18 18:04	7440-70-2	
Chromium	ND	ug/L	10.0	1.6	1	03/07/18 10:35	03/09/18 17:58	7440-47-3	
Cobalt	1.8J	ug/L	10.0	0.52	1	03/07/18 10:35	03/09/18 17:58	7440-48-4	
Lead	ND	ug/L	5.0	0.27	1	03/07/18 10:35	03/09/18 17:58	7439-92-1	
Lithium	3.3J	ug/L	50.0	0.97	1	03/07/18 10:35	03/09/18 17:58	7439-93-2	
Molybdenum	ND	ug/L	10.0	1.9	1	03/07/18 10:35	03/09/18 17:58	7439-98-7	
Selenium	ND	ug/L	10.0	1.4	1	03/07/18 10:35	03/09/18 17:58	7782-49-2	
Thallium	ND	ug/L	1.0	0.14	1	03/07/18 10:35	03/09/18 17:58	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	ND	mg/L	0.00050	0.000036	1	03/12/18 13:25	03/13/18 14:23	7439-97-6	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	492	mg/L	25.0	25.0	1		03/06/18 18:13		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	8.1	mg/L	0.25	0.024	1		03/05/18 23:08	16887-00-6	
Fluoride	ND	mg/L	0.30	0.029	1		03/05/18 23:08	16984-48-8	
Sulfate	242	mg/L	25.0	0.42	25		03/16/18 10:50	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

Sample: FD-3		Lab ID: 262423011		Collected: 03/01/18 00:00		Received: 03/02/18 15:30		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	ug/L	3.0	0.78	1	03/07/18 10:35	03/09/18 18:10	7440-36-0		
Arsenic	ND	ug/L	5.0	0.57	1	03/07/18 10:35	03/09/18 18:10	7440-38-2		
Barium	102	ug/L	10.0	0.78	1	03/07/18 10:35	03/09/18 18:10	7440-39-3		
Beryllium	0.058J	ug/L	3.0	0.050	1	03/07/18 10:35	03/09/18 18:10	7440-41-7		
Boron	1800	ug/L	40.0	3.9	1	03/07/18 10:35	03/09/18 18:10	7440-42-8		
Cadmium	ND	ug/L	1.0	0.093	1	03/07/18 10:35	03/09/18 18:10	7440-43-9		
Calcium	58500	ug/L	25000	685	50	03/07/18 10:35	03/09/18 18:15	7440-70-2		
Chromium	ND	ug/L	10.0	1.6	1	03/07/18 10:35	03/09/18 18:10	7440-47-3		
Cobalt	ND	ug/L	10.0	0.52	1	03/07/18 10:35	03/09/18 18:10	7440-48-4		
Lead	ND	ug/L	5.0	0.27	1	03/07/18 10:35	03/09/18 18:10	7439-92-1		
Lithium	2.3J	ug/L	50.0	0.97	1	03/07/18 10:35	03/09/18 18:10	7439-93-2		
Molybdenum	ND	ug/L	10.0	1.9	1	03/07/18 10:35	03/09/18 18:10	7439-98-7		
Selenium	ND	ug/L	10.0	1.4	1	03/07/18 10:35	03/09/18 18:10	7782-49-2		
Thallium	ND	ug/L	1.0	0.14	1	03/07/18 10:35	03/09/18 18:10	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	03/12/18 13:25	03/13/18 14:30	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	301	mg/L	25.0	25.0	1		03/08/18 14:44			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	6.3	mg/L	0.25	0.024	1		03/05/18 23:49	16887-00-6		
Fluoride	ND	mg/L	0.30	0.029	1		03/05/18 23:49	16984-48-8		
Sulfate	95.9	mg/L	10.0	0.17	10		03/16/18 11:11	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262423

Sample: FB-3		Lab ID: 262423013		Collected: 03/01/18 09:55		Received: 03/02/18 15:30		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	ug/L	3.0	0.78	1	03/07/18 10:35	03/09/18 18:33	7440-36-0		
Arsenic	ND	ug/L	5.0	0.57	1	03/07/18 10:35	03/09/18 18:33	7440-38-2		
Barium	ND	ug/L	10.0	0.78	1	03/07/18 10:35	03/09/18 18:33	7440-39-3		
Beryllium	ND	ug/L	3.0	0.050	1	03/07/18 10:35	03/09/18 18:33	7440-41-7		
Boron	ND	ug/L	40.0	3.9	1	03/07/18 10:35	03/09/18 18:33	7440-42-8		
Cadmium	ND	ug/L	1.0	0.093	1	03/07/18 10:35	03/09/18 18:33	7440-43-9		
Calcium	37.9J	ug/L	500	13.7	1	03/07/18 10:35	03/09/18 18:33	7440-70-2	B	
Chromium	ND	ug/L	10.0	1.6	1	03/07/18 10:35	03/09/18 18:33	7440-47-3		
Cobalt	ND	ug/L	10.0	0.52	1	03/07/18 10:35	03/09/18 18:33	7440-48-4		
Lead	ND	ug/L	5.0	0.27	1	03/07/18 10:35	03/09/18 18:33	7439-92-1		
Lithium	ND	ug/L	50.0	0.97	1	03/07/18 10:35	03/09/18 18:33	7439-93-2		
Molybdenum	ND	ug/L	10.0	1.9	1	03/07/18 10:35	03/09/18 18:33	7439-98-7		
Selenium	ND	ug/L	10.0	1.4	1	03/07/18 10:35	03/09/18 18:33	7782-49-2		
Thallium	ND	ug/L	1.0	0.14	1	03/07/18 10:35	03/09/18 18:33	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	03/12/18 13:25	03/13/18 14:32	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	ND	mg/L	25.0	25.0	1		03/08/18 14:54			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	0.057J	mg/L	0.25	0.024	1		03/06/18 00:10	16887-00-6	B	
Fluoride	ND	mg/L	0.30	0.029	1		03/06/18 00:10	16984-48-8		
Sulfate	ND	mg/L	1.0	0.017	1		03/06/18 00:10	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

Sample: EB-3		Lab ID: 262423015		Collected: 03/01/18 13:55		Received: 03/02/18 15:30		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	ug/L	3.0	0.78	1	03/07/18 10:35	03/09/18 18:38	7440-36-0		
Arsenic	ND	ug/L	5.0	0.57	1	03/07/18 10:35	03/09/18 18:38	7440-38-2		
Barium	ND	ug/L	10.0	0.78	1	03/07/18 10:35	03/09/18 18:38	7440-39-3		
Beryllium	ND	ug/L	3.0	0.050	1	03/07/18 10:35	03/09/18 18:38	7440-41-7		
Boron	ND	ug/L	40.0	3.9	1	03/07/18 10:35	03/09/18 18:38	7440-42-8		
Cadmium	ND	ug/L	1.0	0.093	1	03/07/18 10:35	03/09/18 18:38	7440-43-9		
Calcium	41.2J	ug/L	500	13.7	1	03/07/18 10:35	03/09/18 18:38	7440-70-2	B	
Chromium	ND	ug/L	10.0	1.6	1	03/07/18 10:35	03/09/18 18:38	7440-47-3		
Cobalt	ND	ug/L	10.0	0.52	1	03/07/18 10:35	03/09/18 18:38	7440-48-4		
Lead	ND	ug/L	5.0	0.27	1	03/07/18 10:35	03/09/18 18:38	7439-92-1		
Lithium	ND	ug/L	50.0	0.97	1	03/07/18 10:35	03/09/18 18:38	7439-93-2		
Molybdenum	ND	ug/L	10.0	1.9	1	03/07/18 10:35	03/09/18 18:38	7439-98-7		
Selenium	ND	ug/L	10.0	1.4	1	03/07/18 10:35	03/09/18 18:38	7782-49-2		
Thallium	ND	ug/L	1.0	0.14	1	03/07/18 10:35	03/09/18 18:38	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	03/12/18 13:25	03/13/18 14:34	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	ND	mg/L	25.0	25.0	1		03/08/18 14:54			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	0.045J	mg/L	0.25	0.024	1		03/06/18 00:30	16887-00-6	B	
Fluoride	ND	mg/L	0.30	0.029	1		03/06/18 00:30	16984-48-8		
Sulfate	ND	mg/L	1.0	0.017	1		03/06/18 00:30	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262423

Sample: DGWC-67		Lab ID: 262423017		Collected: 03/02/18 09:40		Received: 03/02/18 15:30		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	ug/L	3.0	0.78	1	03/07/18 10:35	03/09/18 18:44	7440-36-0	
Arsenic	ND	ug/L	5.0	0.57	1	03/07/18 10:35	03/09/18 18:44	7440-38-2	
Barium	104	ug/L	10.0	0.78	1	03/07/18 10:35	03/09/18 18:44	7440-39-3	
Beryllium	ND	ug/L	3.0	0.050	1	03/07/18 10:35	03/09/18 18:44	7440-41-7	
Boron	3490	ug/L	40.0	3.9	1	03/07/18 10:35	03/09/18 18:44	7440-42-8	
Cadmium	ND	ug/L	1.0	0.093	1	03/07/18 10:35	03/09/18 18:44	7440-43-9	
Calcium	40100	ug/L	25000	685	50	03/07/18 10:35	03/09/18 18:50	7440-70-2	
Chromium	ND	ug/L	10.0	1.6	1	03/07/18 10:35	03/09/18 18:44	7440-47-3	
Cobalt	1.7J	ug/L	10.0	0.52	1	03/07/18 10:35	03/09/18 18:44	7440-48-4	
Lead	ND	ug/L	5.0	0.27	1	03/07/18 10:35	03/09/18 18:44	7439-92-1	
Lithium	4.7J	ug/L	50.0	0.97	1	03/07/18 10:35	03/09/18 18:44	7439-93-2	
Molybdenum	ND	ug/L	10.0	1.9	1	03/07/18 10:35	03/09/18 18:44	7439-98-7	
Selenium	ND	ug/L	10.0	1.4	1	03/07/18 10:35	03/09/18 18:44	7782-49-2	
Thallium	ND	ug/L	1.0	0.14	1	03/07/18 10:35	03/09/18 18:44	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	ND	mg/L	0.00050	0.000036	1	03/12/18 13:25	03/13/18 14:37	7439-97-6	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	264	mg/L	25.0	25.0	1		03/08/18 14:54		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	5.8	mg/L	0.25	0.024	1		03/06/18 00:51	16887-00-6	
Fluoride	ND	mg/L	0.30	0.029	1		03/06/18 00:51	16984-48-8	
Sulfate	98.5	mg/L	10.0	0.17	10		03/16/18 11:33	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262423

Sample: DGWC-68A		Lab ID: 262423019		Collected: 03/02/18 11:10		Received: 03/02/18 15:30		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	ug/L	3.0	0.78	1	03/07/18 10:35	03/09/18 18:55	7440-36-0	
Arsenic	ND	ug/L	5.0	0.57	1	03/07/18 10:35	03/09/18 18:55	7440-38-2	
Barium	87.8	ug/L	10.0	0.78	1	03/07/18 10:35	03/09/18 18:55	7440-39-3	
Beryllium	ND	ug/L	3.0	0.050	1	03/07/18 10:35	03/09/18 18:55	7440-41-7	
Boron	2050	ug/L	40.0	3.9	1	03/07/18 10:35	03/09/18 18:55	7440-42-8	
Cadmium	0.19J	ug/L	1.0	0.093	1	03/07/18 10:35	03/09/18 18:55	7440-43-9	
Calcium	48900	ug/L	25000	685	50	03/07/18 10:35	03/09/18 19:01	7440-70-2	
Chromium	ND	ug/L	10.0	1.6	1	03/07/18 10:35	03/09/18 18:55	7440-47-3	
Cobalt	ND	ug/L	10.0	0.52	1	03/07/18 10:35	03/09/18 18:55	7440-48-4	
Lead	ND	ug/L	5.0	0.27	1	03/07/18 10:35	03/09/18 18:55	7439-92-1	
Lithium	ND	ug/L	50.0	0.97	1	03/07/18 10:35	03/09/18 18:55	7439-93-2	
Molybdenum	215	ug/L	10.0	1.9	1	03/07/18 10:35	03/09/18 18:55	7439-98-7	
Selenium	ND	ug/L	10.0	1.4	1	03/07/18 10:35	03/09/18 18:55	7782-49-2	
Thallium	ND	ug/L	1.0	0.14	1	03/07/18 10:35	03/09/18 18:55	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	ND	mg/L	0.00050	0.000036	1	03/12/18 13:25	03/13/18 14:39	7439-97-6	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	252	mg/L	25.0	25.0	1		03/08/18 14:54		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	4.2	mg/L	0.25	0.024	1		03/06/18 01:12	16887-00-6	
Fluoride	0.23J	mg/L	0.30	0.029	1		03/06/18 01:12	16984-48-8	
Sulfate	44.7	mg/L	5.0	0.085	5		03/16/18 11:54	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

Sample: DGWC-69		Lab ID: 262423021		Collected: 03/02/18 12:30		Received: 03/02/18 15:30		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	ug/L	3.0	0.78	1	03/07/18 10:35	03/09/18 19:07	7440-36-0	
Arsenic	12.7	ug/L	5.0	0.57	1	03/07/18 10:35	03/09/18 19:07	7440-38-2	
Barium	67.1	ug/L	10.0	0.78	1	03/07/18 10:35	03/09/18 19:07	7440-39-3	
Beryllium	0.060J	ug/L	3.0	0.050	1	03/07/18 10:35	03/09/18 19:07	7440-41-7	
Boron	47.8	ug/L	40.0	3.9	1	03/07/18 10:35	03/09/18 19:07	7440-42-8	
Cadmium	0.16J	ug/L	1.0	0.093	1	03/07/18 10:35	03/09/18 19:07	7440-43-9	
Calcium	8090	ug/L	500	13.7	1	03/07/18 10:35	03/09/18 19:07	7440-70-2	
Chromium	ND	ug/L	10.0	1.6	1	03/07/18 10:35	03/09/18 19:07	7440-47-3	
Cobalt	ND	ug/L	10.0	0.52	1	03/07/18 10:35	03/09/18 19:07	7440-48-4	
Lead	ND	ug/L	5.0	0.27	1	03/07/18 10:35	03/09/18 19:07	7439-92-1	
Lithium	2.8J	ug/L	50.0	0.97	1	03/07/18 10:35	03/09/18 19:07	7439-93-2	
Molybdenum	7.2J	ug/L	10.0	1.9	1	03/07/18 10:35	03/09/18 19:07	7439-98-7	
Selenium	ND	ug/L	10.0	1.4	1	03/07/18 10:35	03/09/18 19:07	7782-49-2	
Thallium	ND	ug/L	1.0	0.14	1	03/07/18 10:35	03/09/18 19:07	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	ND	mg/L	0.00050	0.000036	1	03/12/18 13:25	03/13/18 14:42	7439-97-6	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	73.0	mg/L	25.0	25.0	1		03/08/18 14:54		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	6.4	mg/L	0.25	0.024	1		03/06/18 01:32	16887-00-6	
Fluoride	0.18J	mg/L	0.30	0.029	1		03/06/18 01:32	16984-48-8	
Sulfate	10.1	mg/L	1.0	0.017	1		03/06/18 01:32	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262423

Sample: DGWC-40		Lab ID: 262423023		Collected: 03/02/18 09:40		Received: 03/02/18 15:30		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	ug/L	3.0	0.78	1	03/07/18 10:35	03/09/18 19:18	7440-36-0	
Arsenic	1.1J	ug/L	5.0	0.57	1	03/07/18 10:35	03/09/18 19:18	7440-38-2	
Barium	16.9	ug/L	10.0	0.78	1	03/07/18 10:35	03/09/18 19:18	7440-39-3	
Beryllium	3.3	ug/L	3.0	0.050	1	03/07/18 10:35	03/09/18 19:18	7440-41-7	
Boron	974	ug/L	40.0	3.9	1	03/07/18 10:35	03/09/18 19:18	7440-42-8	
Cadmium	0.85J	ug/L	1.0	0.093	1	03/07/18 10:35	03/09/18 19:18	7440-43-9	
Calcium	43200	ug/L	25000	685	50	03/07/18 10:35	03/09/18 19:24	7440-70-2	
Chromium	ND	ug/L	10.0	1.6	1	03/07/18 10:35	03/09/18 19:18	7440-47-3	
Cobalt	42.5	ug/L	10.0	0.52	1	03/07/18 10:35	03/09/18 19:18	7440-48-4	
Lead	ND	ug/L	5.0	0.27	1	03/07/18 10:35	03/09/18 19:18	7439-92-1	
Lithium	2.3J	ug/L	50.0	0.97	1	03/07/18 10:35	03/09/18 19:18	7439-93-2	
Molybdenum	ND	ug/L	10.0	1.9	1	03/07/18 10:35	03/09/18 19:18	7439-98-7	
Selenium	4.5J	ug/L	10.0	1.4	1	03/07/18 10:35	03/09/18 19:18	7782-49-2	
Thallium	ND	ug/L	1.0	0.14	1	03/07/18 10:35	03/09/18 19:18	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	ND	mg/L	0.00050	0.000036	1	03/12/18 13:25	03/13/18 14:44	7439-97-6	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	359	mg/L	25.0	25.0	1		03/08/18 14:58		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	19.5	mg/L	0.25	0.024	1		03/06/18 01:53	16887-00-6	
Fluoride	0.33	mg/L	0.30	0.029	1		03/06/18 01:53	16984-48-8	
Sulfate	219	mg/L	25.0	0.42	25		03/16/18 12:15	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

Sample: DGWC-48 **Lab ID: 262423025** Collected: 03/02/18 11:05 Received: 03/02/18 15:30 Matrix: Water

Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual
			Limit	MDL	DF				
6020B MET ICPMS Analytical Method: EPA 6020B Preparation Method: EPA 3005A									
Antimony	ND	ug/L	3.0	0.78	1	03/07/18 10:35	03/09/18 19:41	7440-36-0	
Arsenic	1.7J	ug/L	5.0	0.57	1	03/07/18 10:35	03/09/18 19:41	7440-38-2	
Barium	13.1	ug/L	10.0	0.78	1	03/07/18 10:35	03/09/18 19:41	7440-39-3	
Beryllium	9.6	ug/L	3.0	0.050	1	03/07/18 10:35	03/09/18 19:41	7440-41-7	
Boron	878	ug/L	40.0	3.9	1	03/07/18 10:35	03/09/18 19:41	7440-42-8	
Cadmium	4.9	ug/L	1.0	0.093	1	03/07/18 10:35	03/09/18 19:41	7440-43-9	
Calcium	86600	ug/L	25000	685	50	03/07/18 10:35	03/09/18 19:47	7440-70-2	
Chromium	ND	ug/L	10.0	1.6	1	03/07/18 10:35	03/09/18 19:41	7440-47-3	
Cobalt	490	ug/L	10.0	0.52	1	03/07/18 10:35	03/09/18 19:41	7440-48-4	
Lead	2.2J	ug/L	5.0	0.27	1	03/07/18 10:35	03/09/18 19:41	7439-92-1	
Lithium	129	ug/L	50.0	0.97	1	03/07/18 10:35	03/09/18 19:41	7439-93-2	
Molybdenum	ND	ug/L	10.0	1.9	1	03/07/18 10:35	03/09/18 19:41	7439-98-7	
Selenium	8.4J	ug/L	10.0	1.4	1	03/07/18 10:35	03/09/18 19:41	7782-49-2	
Thallium	ND	ug/L	1.0	0.14	1	03/07/18 10:35	03/09/18 19:41	7440-28-0	
7470 Mercury Analytical Method: EPA 7470A Preparation Method: EPA 7470A									
Mercury	ND	mg/L	0.00050	0.000036	1	03/12/18 13:25	03/13/18 14:46	7439-97-6	
2540C Total Dissolved Solids Analytical Method: SM 2540C									
Total Dissolved Solids	704	mg/L	50.0	50.0	1		03/08/18 14:58		
300.0 IC Anions 28 Days Analytical Method: EPA 300.0									
Chloride	12.8	mg/L	0.25	0.024	1		03/06/18 03:36	16887-00-6	
Fluoride	1.1	mg/L	0.30	0.029	1		03/06/18 03:36	16984-48-8	
Sulfate	456	mg/L	50.0	0.85	50		03/16/18 12:36	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

QC Batch: 2176 Analysis Method: EPA 7470A
 QC Batch Method: EPA 7470A Analysis Description: 7470 Mercury
 Associated Lab Samples: 262423001, 262423003, 262423005, 262423007, 262423009, 262423011, 262423013, 262423015, 262423017, 262423019, 262423021, 262423023, 262423025

METHOD BLANK: 11813 Matrix: Water
 Associated Lab Samples: 262423001, 262423003, 262423005, 262423007, 262423009, 262423011, 262423013, 262423015, 262423017, 262423019, 262423021, 262423023, 262423025

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Mercury	mg/L	ND	0.00050	0.000036	03/13/18 14:01	

LABORATORY CONTROL SAMPLE: 11814

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Mercury	mg/L	0.0025	0.0022	89	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 11872 11873

Parameter	Units	262423003 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
Mercury	mg/L	0.00013J	0.0025	0.0025	0.0022	0.0022	84	84	75-125	1	20	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 262423

QC Batch: 2138 Analysis Method: EPA 6020B
QC Batch Method: EPA 3005A Analysis Description: 6020B MET
Associated Lab Samples: 262423001, 262423003, 262423005, 262423007, 262423009, 262423011, 262423013, 262423015, 262423017, 262423019, 262423021, 262423023, 262423025

METHOD BLANK: 11622 Matrix: Water
Associated Lab Samples: 262423001, 262423003, 262423005, 262423007, 262423009, 262423011, 262423013, 262423015, 262423017, 262423019, 262423021, 262423023, 262423025

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Antimony	ug/L	ND	3.0	0.78	03/09/18 16:05	
Arsenic	ug/L	ND	5.0	0.57	03/09/18 16:05	
Barium	ug/L	ND	10.0	0.78	03/09/18 16:05	
Beryllium	ug/L	ND	3.0	0.050	03/09/18 16:05	
Boron	ug/L	ND	40.0	3.9	03/09/18 16:05	
Cadmium	ug/L	ND	1.0	0.093	03/09/18 16:05	
Calcium	ug/L	25.3J	500	13.7	03/09/18 16:05	
Chromium	ug/L	ND	10.0	1.6	03/09/18 16:05	
Cobalt	ug/L	ND	10.0	0.52	03/09/18 16:05	
Lead	ug/L	ND	5.0	0.27	03/09/18 16:05	
Lithium	ug/L	ND	50.0	0.97	03/09/18 16:05	
Molybdenum	ug/L	ND	10.0	1.9	03/09/18 16:05	
Selenium	ug/L	ND	10.0	1.4	03/09/18 16:05	
Thallium	ug/L	ND	1.0	0.14	03/09/18 16:05	

LABORATORY CONTROL SAMPLE: 11623

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Antimony	ug/L	100	113	113	80-120	
Arsenic	ug/L	100	104	104	80-120	
Barium	ug/L	100	104	104	80-120	
Beryllium	ug/L	100	108	108	80-120	
Boron	ug/L	1000	1130	113	80-120	
Cadmium	ug/L	100	105	105	80-120	
Calcium	ug/L	1000	1060	106	80-120	
Chromium	ug/L	100	110	110	80-120	
Cobalt	ug/L	100	109	109	80-120	
Lead	ug/L	100	97.4	97	80-120	
Lithium	ug/L	100	109	109	80-120	
Molybdenum	ug/L	100	111	111	80-120	
Selenium	ug/L	100	104	104	80-120	
Thallium	ug/L	100	99.1	99	80-120	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

Parameter	Units	MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 11624		11625		MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
		262423001 Result	MS Spike Conc.	MSD Spike Conc.									
Antimony	ug/L	ND	100	100	110	109	110	109	75-125	1	20		
Arsenic	ug/L	ND	100	100	104	103	104	103	75-125	1	20		
Barium	ug/L	102	100	100	178	177	77	75	75-125	1	20		
Beryllium	ug/L	0.067J	100	100	103	102	102	102	75-125	0	20		
Boron	ug/L	1870	1000	1000	2790	2750	91	88	75-125	1	20		
Cadmium	ug/L	ND	100	100	101	101	101	101	75-125	0	20		
Calcium	ug/L	57000	1000	1000	58300	54100	129	-295	75-125	8	20	M6	
Chromium	ug/L	ND	100	100	105	103	105	102	75-125	3	20		
Cobalt	ug/L	ND	100	100	103	101	102	101	75-125	1	20		
Lead	ug/L	ND	100	100	96.1	97.2	96	97	75-125	1	20		
Lithium	ug/L	2.4J	100	100	101	107	99	104	75-125	5	20		
Molybdenum	ug/L	ND	100	100	106	105	106	105	75-125	1	20		
Selenium	ug/L	ND	100	100	100	104	100	103	75-125	3	20		
Thallium	ug/L	ND	100	100	96.9	99.1	97	99	75-125	2	20		

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

QC Batch: 400840

Analysis Method: SM 2540C

QC Batch Method: SM 2540C

Analysis Description: 2540C Total Dissolved Solids

Associated Lab Samples: 262423001, 262423003, 262423005, 262423007, 262423009

METHOD BLANK: 2223092

Matrix: Water

Associated Lab Samples: 262423001, 262423003, 262423005, 262423007, 262423009

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Total Dissolved Solids	mg/L	ND	25.0	25.0	03/06/18 18:13	

LABORATORY CONTROL SAMPLE: 2223093

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	250	250	100	90-110	

SAMPLE DUPLICATE: 2223094

Parameter	Units	92375320001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	ND	ND		5	

SAMPLE DUPLICATE: 2223095

Parameter	Units	92375320011 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	158	156	1	5	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

QC Batch: 401129

Analysis Method: SM 2540C

QC Batch Method: SM 2540C

Analysis Description: 2540C Total Dissolved Solids

Associated Lab Samples: 262423011, 262423013, 262423015, 262423017, 262423019, 262423021, 262423023, 262423025

METHOD BLANK: 2224811

Matrix: Water

Associated Lab Samples: 262423011, 262423013, 262423015, 262423017, 262423019, 262423021, 262423023, 262423025

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Total Dissolved Solids	mg/L	ND	25.0	25.0	03/08/18 14:44	

LABORATORY CONTROL SAMPLE: 2224812

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	250	240	96	90-110	

SAMPLE DUPLICATE: 2224813

Parameter	Units	262423011 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	301	302	0	5	

SAMPLE DUPLICATE: 2224814

Parameter	Units	92375484002 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	ND	ND		5	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 262423

QC Batch: 1994 Analysis Method: EPA 300.0
QC Batch Method: EPA 300.0 Analysis Description: 300.0 IC Anions
Associated Lab Samples: 262423001, 262423003, 262423005, 262423007, 262423009, 262423011, 262423013, 262423015, 262423017, 262423019, 262423021, 262423023, 262423025

METHOD BLANK: 11098 Matrix: Water
Associated Lab Samples: 262423001, 262423003, 262423005, 262423007, 262423009, 262423011, 262423013, 262423015, 262423017, 262423019, 262423021, 262423023, 262423025

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Chloride	mg/L	0.058J	0.25	0.024	03/05/18 16:35	
Fluoride	mg/L	ND	0.30	0.029	03/05/18 16:35	
Sulfate	mg/L	ND	1.0	0.017	03/05/18 16:35	

LABORATORY CONTROL SAMPLE: 11099

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	10	10.4	104	90-110	
Fluoride	mg/L	10	10.1	101	90-110	
Sulfate	mg/L	10	9.9	99	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 11100 11101

Parameter	Units	262357013 Result	MS		MSD		MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
			Spike Conc.	MSD Spike Conc.	MS Result	MSD Result						
Chloride	mg/L	29.0	10	10	34.6	34.5	56	55	90-110	0	15	E,M1
Fluoride	mg/L	ND	10	10	10.1	10.3	101	103	90-110	2	15	
Sulfate	mg/L	350	10	10	223	222	-1270	-1280	90-110	0	15	E,M1

MATRIX SPIKE SAMPLE: 11102

Parameter	Units	262357015 Result	Spike Conc.	MS Result	MS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	17.0	10	24.8	78	90-110	E,M1
Fluoride	mg/L	0.86	10	11.3	105	90-110	
Sulfate	mg/L	217	10	157	-607	90-110	E,M1

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

Sample: DGWC-37 **Lab ID: 262423002** Collected: 03/01/18 09:50 Received: 03/02/18 15:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.344 ± 0.298 (0.519) C:58% T:NA	pCi/L	03/14/18 08:44	13982-63-3	
Radium-228	EPA 9320	-0.280 ± 0.362 (0.876) C:80% T:84%	pCi/L	03/20/18 12:00	15262-20-1	
Total Radium	Total Radium Calculation	0.344 ± 0.660 (1.40)	pCi/L	03/23/18 13:00	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

Sample: DGWC-23 **Lab ID: 262423004** Collected: 03/01/18 10:05 Received: 03/02/18 15:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.511 ± 0.303 (0.420) C:81% T:NA	pCi/L	03/14/18 08:44	13982-63-3	
Radium-228	EPA 9320	0.232 ± 0.439 (0.962) C:82% T:85%	pCi/L	03/20/18 12:00	15262-20-1	
Total Radium	Total Radium Calculation	0.743 ± 0.742 (1.38)	pCi/L	03/23/18 13:00	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

Sample: DGWC-47 **Lab ID: 262423006** Collected: 03/01/18 12:45 Received: 03/02/18 15:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	1.03 ± 0.395 (0.376) C:86% T:NA	pCi/L	03/14/18 08:44	13982-63-3	
Radium-228	EPA 9320	1.18 ± 0.503 (0.783) C:79% T:81%	pCi/L	03/20/18 14:23	15262-20-1	
Total Radium	Total Radium Calculation	2.21 ± 0.898 (1.16)	pCi/L	03/23/18 13:00	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

Sample: DGWC-39 **Lab ID: 262423008** Collected: 03/01/18 13:15 Received: 03/02/18 15:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.140 ± 0.171 (0.344) C:94% T:NA	pCi/L	03/14/18 08:44	13982-63-3	
Radium-228	EPA 9320	1.10 ± 0.470 (0.772) C:82% T:82%	pCi/L	03/20/18 15:07	15262-20-1	
Total Radium	Total Radium Calculation	1.24 ± 0.641 (1.12)	pCi/L	03/23/18 13:00	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

Sample: DGWC-38 **Lab ID: 262423010** Collected: 03/01/18 11:40 Received: 03/02/18 15:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.138 ± 0.210 (0.460) C:88% T:NA	pCi/L	03/14/18 08:44	13982-63-3	
Radium-228	EPA 9320	0.847 ± 0.449 (0.804) C:77% T:81%	pCi/L	03/20/18 15:07	15262-20-1	
Total Radium	Total Radium Calculation	0.985 ± 0.659 (1.26)	pCi/L	03/23/18 13:00	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

Sample: FD-3 **Lab ID: 262423012** Collected: 03/01/18 00:00 Received: 03/02/18 15:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.430 ± 0.301 (0.481) C:66% T:NA	pCi/L	03/14/18 10:19	13982-63-3	
Radium-228	EPA 9320	0.639 ± 0.372 (0.683) C:84% T:83%	pCi/L	03/20/18 15:07	15262-20-1	
Total Radium	Total Radium Calculation	1.07 ± 0.673 (1.16)	pCi/L	03/23/18 13:00	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

Sample: FB-3 **Lab ID: 262423014** Collected: 03/01/18 09:55 Received: 03/02/18 15:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.0936 ± 0.164 (0.368) C:81% T:NA	pCi/L	03/14/18 08:44	13982-63-3	
Radium-228	EPA 9320	0.727 ± 0.384 (0.695) C:84% T:92%	pCi/L	03/20/18 15:07	15262-20-1	
Total Radium	Total Radium Calculation	0.821 ± 0.548 (1.06)	pCi/L	03/23/18 13:00	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

Sample: EB-3 **Lab ID: 262423016** Collected: 03/01/18 13:55 Received: 03/02/18 15:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.155 ± 0.185 (0.371) C:87% T:NA	pCi/L	03/14/18 08:44	13982-63-3	
Radium-228	EPA 9320	0.545 ± 0.355 (0.675) C:82% T:88%	pCi/L	03/20/18 15:07	15262-20-1	
Total Radium	Total Radium Calculation	0.700 ± 0.540 (1.05)	pCi/L	03/23/18 13:00	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

Sample: DGWC-67 **Lab ID: 262423018** Collected: 03/02/18 09:40 Received: 03/02/18 15:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.702 ± 0.438 (0.577) C:43% T:NA	pCi/L	03/14/18 10:22	13982-63-3	
Radium-228	EPA 9320	0.611 ± 0.352 (0.642) C:84% T:84%	pCi/L	03/20/18 15:07	15262-20-1	
Total Radium	Total Radium Calculation	1.31 ± 0.790 (1.22)	pCi/L	03/23/18 13:00	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

Sample: DGWC-68A **Lab ID: 262423020** Collected: 03/02/18 11:10 Received: 03/02/18 15:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.336 ± 0.224 (0.316) C:86% T:NA	pCi/L	03/14/18 10:22	13982-63-3	
Radium-228	EPA 9320	0.796 ± 0.418 (0.748) C:81% T:83%	pCi/L	03/20/18 15:07	15262-20-1	
Total Radium	Total Radium Calculation	1.13 ± 0.642 (1.06)	pCi/L	03/23/18 13:00	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

Sample: DGWC-69 **Lab ID: 262423022** Collected: 03/02/18 12:30 Received: 03/02/18 15:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.468 ± 0.259 (0.340) C:91% T:NA	pCi/L	03/14/18 10:22	13982-63-3	
Radium-228	EPA 9320	0.450 ± 0.374 (0.737) C:75% T:77%	pCi/L	03/26/18 15:46	15262-20-1	
Total Radium	Total Radium Calculation	0.918 ± 0.633 (1.08)	pCi/L	03/27/18 13:53	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

Sample: DGWC-40 **Lab ID: 262423024** Collected: 03/02/18 09:40 Received: 03/02/18 15:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.298 ± 0.240 (0.402) C:76% T:NA	pCi/L	03/14/18 10:22	13982-63-3	
Radium-228	EPA 9320	0.187 ± 0.442 (0.983) C:75% T:66%	pCi/L	03/26/18 15:46	15262-20-1	
Total Radium	Total Radium Calculation	0.485 ± 0.682 (1.39)	pCi/L	03/27/18 13:53	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

Sample: DGWC-48 **Lab ID: 262423026** Collected: 03/02/18 11:05 Received: 03/02/18 15:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	1.05 ± 0.387 (0.353) C:91% T:NA	pCi/L	03/14/18 10:22	13982-63-3	
Radium-228	EPA 9320	1.21 ± 0.483 (0.731) C:75% T:83%	pCi/L	03/26/18 15:46	15262-20-1	
Total Radium	Total Radium Calculation	2.26 ± 0.870 (1.08)	pCi/L	03/27/18 13:53	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

QC Batch: 290897

Analysis Method: EPA 9315

QC Batch Method: EPA 9315

Analysis Description: 9315 Total Radium

Associated Lab Samples: 262423002, 262423004, 262423006, 262423008, 262423010, 262423012, 262423014, 262423016, 262423018, 262423020, 262423022, 262423024, 262423026

METHOD BLANK: 1424476

Matrix: Water

Associated Lab Samples: 262423002, 262423004, 262423006, 262423008, 262423010, 262423012, 262423014, 262423016, 262423018, 262423020, 262423022, 262423024, 262423026

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.259 ± 0.235 (0.428) C:79% T:NA	pCi/L	03/14/18 08:37	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

QC Batch:	291249	Analysis Method:	EPA 9320
QC Batch Method:	EPA 9320	Analysis Description:	9320 Radium 228
Associated Lab Samples:	262423022, 262423024, 262423026		

METHOD BLANK:	1425571	Matrix:	Water
Associated Lab Samples:	262423022, 262423024, 262423026		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.247 ± 0.304 (0.638) C:75% T:80%	pCi/L	03/26/18 15:46	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

QC Batch:	290899	Analysis Method:	EPA 9320
QC Batch Method:	EPA 9320	Analysis Description:	9320 Radium 228
Associated Lab Samples:	262423002, 262423004, 262423006, 262423008, 262423010, 262423012, 262423014, 262423016, 262423018, 262423020		

METHOD BLANK:	1424478	Matrix:	Water
Associated Lab Samples:	262423002, 262423004, 262423006, 262423008, 262423010, 262423012, 262423014, 262423016, 262423018, 262423020		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.410 ± 0.336 (0.667) C:81% T:79%	pCi/L	03/20/18 11:27	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

LABORATORIES

PASI-A Pace Analytical Services - Asheville

PASI-GA Pace Analytical Services - Atlanta, GA

PASI-PA Pace Analytical Services - Greensburg

ANALYTE QUALIFIERS

B Analyte was detected in the associated method blank.

E Analyte concentration exceeded the calibration range. The reported result is estimated.

M1 Matrix spike recovery exceeded QC limits. Batch accepted based on laboratory control sample (LCS) recovery.

M6 Matrix spike and Matrix spike duplicate recovery not evaluated against control limits due to sample dilution.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Ash Ponds

Pace Project No.: 262423

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
262423001	DGWC-37	EPA 3005A	2138	EPA 6020B	2324
262423003	DGWC-23	EPA 3005A	2138	EPA 6020B	2324
262423005	DGWC-47	EPA 3005A	2138	EPA 6020B	2324
262423007	DGWC-39	EPA 3005A	2138	EPA 6020B	2324
262423009	DGWC-38	EPA 3005A	2138	EPA 6020B	2324
262423011	FD-3	EPA 3005A	2138	EPA 6020B	2324
262423013	FB-3	EPA 3005A	2138	EPA 6020B	2324
262423015	EB-3	EPA 3005A	2138	EPA 6020B	2324
262423017	DGWC-67	EPA 3005A	2138	EPA 6020B	2324
262423019	DGWC-68A	EPA 3005A	2138	EPA 6020B	2324
262423021	DGWC-69	EPA 3005A	2138	EPA 6020B	2324
262423023	DGWC-40	EPA 3005A	2138	EPA 6020B	2324
262423025	DGWC-48	EPA 3005A	2138	EPA 6020B	2324
262423001	DGWC-37	EPA 7470A	2176	EPA 7470A	2433
262423003	DGWC-23	EPA 7470A	2176	EPA 7470A	2433
262423005	DGWC-47	EPA 7470A	2176	EPA 7470A	2433
262423007	DGWC-39	EPA 7470A	2176	EPA 7470A	2433
262423009	DGWC-38	EPA 7470A	2176	EPA 7470A	2433
262423011	FD-3	EPA 7470A	2176	EPA 7470A	2433
262423013	FB-3	EPA 7470A	2176	EPA 7470A	2433
262423015	EB-3	EPA 7470A	2176	EPA 7470A	2433
262423017	DGWC-67	EPA 7470A	2176	EPA 7470A	2433
262423019	DGWC-68A	EPA 7470A	2176	EPA 7470A	2433
262423021	DGWC-69	EPA 7470A	2176	EPA 7470A	2433
262423023	DGWC-40	EPA 7470A	2176	EPA 7470A	2433
262423025	DGWC-48	EPA 7470A	2176	EPA 7470A	2433
262423002	DGWC-37	EPA 9315	290897		
262423004	DGWC-23	EPA 9315	290897		
262423006	DGWC-47	EPA 9315	290897		
262423008	DGWC-39	EPA 9315	290897		
262423010	DGWC-38	EPA 9315	290897		
262423012	FD-3	EPA 9315	290897		
262423014	FB-3	EPA 9315	290897		
262423016	EB-3	EPA 9315	290897		
262423018	DGWC-67	EPA 9315	290897		
262423020	DGWC-68A	EPA 9315	290897		
262423022	DGWC-69	EPA 9315	290897		
262423024	DGWC-40	EPA 9315	290897		
262423026	DGWC-48	EPA 9315	290897		
262423002	DGWC-37	EPA 9320	290899		
262423004	DGWC-23	EPA 9320	290899		
262423006	DGWC-47	EPA 9320	290899		
262423008	DGWC-39	EPA 9320	290899		
262423010	DGWC-38	EPA 9320	290899		
262423012	FD-3	EPA 9320	290899		
262423014	FB-3	EPA 9320	290899		
262423016	EB-3	EPA 9320	290899		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Ash Ponds
Pace Project No.: 262423

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
262423018	DGWC-67	EPA 9320	290899		
262423020	DGWC-68A	EPA 9320	290899		
262423022	DGWC-69	EPA 9320	291249		
262423024	DGWC-40	EPA 9320	291249		
262423026	DGWC-48	EPA 9320	291249		
262423002	DGWC-37	Total Radium Calculation	292214		
262423004	DGWC-23	Total Radium Calculation	292214		
262423006	DGWC-47	Total Radium Calculation	292214		
262423008	DGWC-39	Total Radium Calculation	292214		
262423010	DGWC-38	Total Radium Calculation	292214		
262423012	FD-3	Total Radium Calculation	292214		
262423014	FB-3	Total Radium Calculation	292214		
262423016	EB-3	Total Radium Calculation	292214		
262423018	DGWC-67	Total Radium Calculation	292214		
262423020	DGWC-68A	Total Radium Calculation	292214		
262423022	DGWC-69	Total Radium Calculation	292657		
262423024	DGWC-40	Total Radium Calculation	292657		
262423026	DGWC-48	Total Radium Calculation	292657		
262423001	DGWC-37	SM 2540C	400840		
262423003	DGWC-23	SM 2540C	400840		
262423005	DGWC-47	SM 2540C	400840		
262423007	DGWC-39	SM 2540C	400840		
262423009	DGWC-38	SM 2540C	400840		
262423011	FD-3	SM 2540C	401129		
262423013	FB-3	SM 2540C	401129		
262423015	EB-3	SM 2540C	401129		
262423017	DGWC-67	SM 2540C	401129		
262423019	DGWC-68A	SM 2540C	401129		
262423021	DGWC-69	SM 2540C	401129		
262423023	DGWC-40	SM 2540C	401129		
262423025	DGWC-48	SM 2540C	401129		
262423001	DGWC-37	EPA 300.0	1994		
262423003	DGWC-23	EPA 300.0	1994		
262423005	DGWC-47	EPA 300.0	1994		
262423007	DGWC-39	EPA 300.0	1994		
262423009	DGWC-38	EPA 300.0	1994		
262423011	FD-3	EPA 300.0	1994		
262423013	FB-3	EPA 300.0	1994		
262423015	EB-3	EPA 300.0	1994		
262423017	DGWC-67	EPA 300.0	1994		
262423019	DGWC-68A	EPA 300.0	1994		
262423021	DGWC-69	EPA 300.0	1994		
262423023	DGWC-40	EPA 300.0	1994		
262423025	DGWC-48	EPA 300.0	1994		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.ast-lab.com

CHAIN OF CUSTODY RECORD

CLIENT NAME:
 Georgia Power
 CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER:
 241 Ralph McGill Blvd SE B10185
 Atlanta, GA 30308
 404-506-7239
 REPORT TO:
 Dawn Prell (Dawn_Prell@golder.com) kturnko@golder.com
 REQUESTED COMPLETION DATE: PO # laburcht@southernco.com

PROJECT NAME/STATE: Plant McDonough AP
 PROJECT #: Phase II CCR

Collection DATE	Collection TIME	MATRIX CODE*	C O M P	G R A B	SAMPLE IDENTIFICATION
03/01/18	0950	GW	x		DGWC-37
03/01/18	1005	GW	x		DGWC-23
03/01/18	1245	GW	x		DGWC-47
03/01/18	1315	GW	x		DGWC-39
03/01/18	1140	GW	x		DGWC-38
03/01/18	-	GW	x		FD-3
03/01/18	0955	W	x		FB-3
03/01/18	1355	W	x		EB-3
03/02/18	0940	GW	x		DGWC-67
03/02/18	1110	GW	x		DGWC-68A
03/02/18	1230	GW	x		DGWC-69
03/02/18	0940	GW	x		DGWC-40
03/02/18	1105	GW	x		DGWC-48

SAMPLED BY AND TITLE: Ben Hodges Field Lead
 RECEIVED BY: [Signature]
 DATE/TIME: 3/2/2018
 DATE/TIME: [Signature]
 RECEIVED BY LAB: [Signature]
 DATE/TIME: 3/2/18 1530
 Temperature: Min: 15.2 Max: [Signature]
 Location: [Signature]
 No. of Containers: 1530
 SAMPLE SHIPPED VIA: UPS COURIER
 RELINQUISHED BY: [Signature] DATE/TIME: 1530 3/2/18

CONTAINER TYPE	P	P	P	P	P	ANALYSIS REQUESTED	CONTAINER TYPE	PRESERVATION	PRESERVATION
# of	3	7	3				A	P - PLASTIC	1 - HCl, ≤6°C
C O N T A I N E R S	1	1	1	1	1	1	B	A - AMBER GLASS	2 - H ₂ SO ₄ , ≤6°C
							I	G - CLEAR GLASS	3 - HNO ₃
							D	V - VOA VIAL	4 - NaOH, ≤6°C
							N	S - STERILE	5 - NaOH/ZnAc, ≤6°C
							U	O - OTHER	6 - Na ₂ S ₂ O ₈ , ≤6°C
							M	*MATRIX CODES:	
							B	DW - DRINKING WATER	S - SOIL
							E	WW - WASTEWATER	SL - SLUDGE
							R	GW - GROUNDWATER	SD - SOLID
								SW - SURFACE WATER	A - AIR
								ST - STORM WATER	L - LIQUID
								W - WATER	P - PRODUCT
								REMARKS/ADDITIONAL INFORMATION	
								Extra Radium	
								WO#: 262423	
								262423	

Sample Condition Upon Receipt



Client Name: GIA Power

Project # _____

WO#: 262423

Courier: Fed Ex UPS USPS Client Commercial Pace Other

Tracking #: _____

PM: BM

Due Date: 03/09/18

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

CLIENT: GAPower-CCR

Packing Material: Bubble Wrap Bubble Bags None Other

Thermometer Used 8.3

Type of Ice: Wet Blue None

Samples on ice, cooling process has begun

Cooler Temperature 3.2

Biological Tissue Is Frozen: Yes No

Date and Initials of person examining contents: 3/2/18 MR

Temp should be above freezing to 6°C

Comments:

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.
-Includes date/time/ID/Analysis Matrix: <u>GIW</u>		
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed
		Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	
Pace Trip Blank Lot # (if purchased):		

Client Notification/ Resolution:

Field Data Required?

Y / N

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: _____

Project Manager Review: _____

Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: JC2
Date: 3/13/2018
Worklist: 40438
Matrix: DW

Method Blank Assessment	
MB Sample ID	1424476
MB concentration:	0.259
M/B Counting Uncertainty:	0.232
MB MDC:	0.428
MB Numerical Performance Indicator:	2.19
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment		LCS (Y or N)?	N
		LCS40438	LCS40438
Count Date:	3/14/2018		
Spike I.D.:	17-030		
Spike Concentration (pCi/mL):	80.175		
Volume Used (mL):	0.10		
Aliquot Volume (L, g, F):	0.508		
Target Conc. (pCi/L, g, F):	15.792		
Uncertainty (Calculated):	1.455		
Result (pCi/L, g, F):	13.680		
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	1.154		
Numerical Performance Indicator:	-2.23		
Percent Recovery:	86.63%		
Status vs Numerical Indicator:	N/A		
Status vs Recovery:	Pass		

Duplicate Sample Assessment	
Sample I.D.:	262423006
Duplicate Sample I.D.:	262423006DUP
Sample Result (pCi/L, g, F):	1.030
Sample Result Counting Uncertainty (pCi/L, g, F):	0.365
Sample Duplicate Result (pCi/L, g, F):	0.981
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.346
Are sample and/or duplicate results below MDC?	See Below ##
Duplicate Numerical Performance Indicator:	0.194
Duplicate RPD:	4.95%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Pass

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Sample Matrix Spike Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Sample Matrix Spike Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	

Handwritten notes:
C
3/15/18

Handwritten notes:
JWW
3-14-18

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-228
Analyst: JLW
Date: 3/15/2018
Worklist: 40440
Matrix: DW

Method Blank Assessment	
MB Sample ID	1424478
MB concentration:	0.410
M/B Counting Uncertainty:	0.328
MB MDC:	0.667
MB Numerical Performance Indicator:	2.45
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment		LCS40440	Y
Count Date:	3/20/2018	LCS40440	
Spike I.D.:	17-033	3/20/2018	
Spike Concentration (pCi/mL):	22.099	17-033	
Volume Used (mL):	0.20	22.099	
Aliquot Volume (L, g, F):	0.812	0.20	
Target Conc. (pCi/L, g, F):	5.442	0.805	
Uncertainty (Calculated):	0.392	5.488	
Result (pCi/L, g, F):	6.878	0.395	
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.719	5.209	
Numerical Performance Indicator:	3.44	0.639	
Percent Recovery:	126.39%	94.91%	
Status vs Numerical Indicator:	N/A	N/A	
Status vs Recovery:	Pass	Pass	

Duplicate Sample Assessment	
Sample I.D.:	LCS40440
Duplicate Sample I.D.:	LCS40440
Sample Result (pCi/L, g, F):	6.878
Sample Duplicate Result (pCi/L, g, F):	0.719
Sample Duplicate Counting Uncertainty (pCi/L, g, F):	5.209
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.639
Are sample and/or duplicate results below MDC?:	NO
Duplicate Numerical Performance Indicator:	3.399
(Based on the LCS/LCSD Percent Recoveries) Duplicate RPD:	28.45%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Pass

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

3/20/18

5/17 3-20-18

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Counting Uncertainty (pCi/L, g, F):	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
(Based on the Percent Recoveries) MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-228
Analyst: JLW
Date: 3/21/2018
Worklist: 40510
Matrix: DW

Method Blank Assessment	
MB Sample ID	1425571
MB concentration:	0.247
M/B Counting Uncertainty:	0.301
MB MDC:	0.638
MB Numerical Performance Indicator:	1.61
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment		LCS (Y or N)?
Count Date:	3/26/2018	LCS40510
Spike I.D.:	17-033	3/26/2018
Spike Concentration (pCi/mL):	22.054	17-033
Volume Used (mL):	0.20	22.054
Aliquot Volume (L, g, F):	0.804	0.20
Target Conc. (pCi/L, g, F):	5.487	0.806
Uncertainty (Calculated):	0.395	5.472
Result (pCi/L, g, F):	4.634	0.394
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.650	5.129
Numerical Performance Indicator:	-2.20	0.644
Percent Recovery:	84.45%	-0.89
Status vs Numerical Indicator:	N/A	93.73%
Status vs Recovery:	Pass	N/A

Duplicate Sample Assessment	
Duplicate Sample I.D.:	LCS40510
Duplicate Sample I.D.:	LCS40510
Sample Result (pCi/L, g, F):	4.634
Sample Result Counting Uncertainty (pCi/L, g, F):	0.650
Sample Duplicate Result (pCi/L, g, F):	5.129
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.644
Are sample and/or duplicate results below MDC?	NO
Duplicate Numerical Performance Indicator:	-1.060
(Based on the LCS/LCSD Percent Recoveries) Duplicate RPD:	10.41%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Pass

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Sample Matrix Spike Duplicate Result:	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
(Based on the Percent Recoveries) MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	

557
3-27-18

CHIEF

July 05, 2019

Joju Abraham
Georgia Power - Coal Combustion Residuals
2480 Maner Road
Atlanta, GA 30339

RE: Project: Plant McDonough Ash Ponds
Pace Project No.: 262659

Dear Joju Abraham:

Enclosed are the analytical results for sample(s) received by the laboratory on March 08, 2018. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

REV07052019_report revised per consultant request to correct MDL settings.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Betsy McDaniel
betsy.mcdaniel@pacelabs.com
(770)734-4200
Project Manager

Enclosures

cc: Kristen Jurinko, Golder Associates Inc.
Julie Lehrman, Golder Associates Inc.
Dawn Prell, Golder Associates Inc.
Tim Richards, Golder Associates - Atlanta
Rebecca Thornton, Pace Analytical Atlanta



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262659

Atlanta Certification IDs

110 Technology Parkway Peachtree Corners, GA 30092	North Carolina Certification #: 381
Florida DOH Certification #: E87315	South Carolina Certification #: 98011001
Georgia DW Inorganics Certification #: 812	Virginia Certification #: 460204
Georgia DW Microbiology Certification #: 812	

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601	Missouri Certification #: 235
ANAB DOD-ELAP Rad Accreditation #: L2417	Montana Certification #: Cert0082
Alabama Certification #: 41590	Nebraska Certification #: NE-OS-29-14
Arizona Certification #: AZ0734	Nevada Certification #: PA014572018-1
Arkansas Certification	New Hampshire/TNI Certification #: 297617
California Certification #: 04222CA	New Jersey/TNI Certification #: PA051
Colorado Certification #: PA01547	New Mexico Certification #: PA01457
Connecticut Certification #: PH-0694	New York/TNI Certification #: 10888
Delaware Certification	North Carolina Certification #: 42706
EPA Region 4 DW Rad	North Dakota Certification #: R-190
Florida/TNI Certification #: E87683	Ohio EPA Rad Approval: #41249
Georgia Certification #: C040	Oregon/TNI Certification #: PA200002-010
Guam Certification	Pennsylvania/TNI Certification #: 65-00282
Florida: Cert E871149 SEKS WET	Puerto Rico Certification #: PA01457
Hawaii Certification	Rhode Island Certification #: 65-00282
Idaho Certification	South Dakota Certification
Illinois Certification	Tennessee Certification #: 02867
Indiana Certification	Texas/TNI Certification #: T104704188-17-3
Iowa Certification #: 391	Utah/TNI Certification #: PA014572017-9
Kansas/TNI Certification #: E-10358	USDA Soil Permit #: P330-17-00091
Kentucky Certification #: KY90133	Vermont Dept. of Health: ID# VT-0282
KY WW Permit #: KY0098221	Virgin Island/PADEP Certification
KY WW Permit #: KY0000221	Virginia/VELAP Certification #: 9526
Louisiana DHH/TNI Certification #: LA180012	Washington Certification #: C868
Louisiana DEQ/TNI Certification #: 4086	West Virginia DEP Certification #: 143
Maine Certification #: 2017020	West Virginia DHHR Certification #: 9964C
Maryland Certification #: 308	Wisconsin Approve List for Rad
Massachusetts Certification #: M-PA1457	Wyoming Certification #: 8TMS-L
Michigan/PADEP Certification #: 9991	

Asheville Certification IDs

2225 Riverside Drive, Asheville, NC 28804	North Carolina Wastewater Certification #: 40
Florida/NELAP Certification #: E87648	South Carolina Certification #: 99030001
Massachusetts Certification #: M-NC030	Virginia/VELAP Certification #: 460222
North Carolina Drinking Water Certification #: 37712	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: Plant McDonough Ash Ponds
Pace Project No.: 262659

Lab ID	Sample ID	Matrix	Date Collected	Date Received
262659001	DGWA-53	Water	03/08/18 12:55	03/08/18 15:10
262659002	DGWA-53	Water	03/08/18 12:55	03/08/18 15:10

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds

Pace Project No.: 262659

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
262659001	DGWA-53	EPA 6020B	CSW	14	PASI-GA
		EPA 7470A	MTC	1	PASI-GA
		SM 2540C	EJJ	1	PASI-A
		EPA 300.0	RLC	3	PASI-GA
262659002	DGWA-53	EPA 9315	JC2	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 262659

Sample: DGWA-53		Lab ID: 262659001		Collected: 03/08/18 12:55		Received: 03/08/18 15:10		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	03/14/18 10:10	03/17/18 17:55	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	03/14/18 10:10	03/17/18 17:55	7440-38-2		
Barium	0.19	mg/L	0.010	0.00078	1	03/14/18 10:10	03/17/18 17:55	7440-39-3		
Beryllium	ND	mg/L	0.015	0.00025	5	03/14/18 10:10	03/20/18 12:59	7440-41-7	D3	
Boron	0.13J	mg/L	0.20	0.020	5	03/14/18 10:10	03/20/18 12:59	7440-42-8	D3	
Cadmium	ND	mg/L	0.0010	0.000093	1	03/14/18 10:10	03/17/18 17:55	7440-43-9		
Calcium	39.8	mg/L	25.0	0.69	50	03/14/18 10:10	03/17/18 18:01	7440-70-2	M6	
Chromium	ND	mg/L	0.010	0.0016	1	03/14/18 10:10	03/17/18 17:55	7440-47-3		
Cobalt	0.027	mg/L	0.010	0.00052	1	03/14/18 10:10	03/17/18 17:55	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	03/14/18 10:10	03/17/18 17:55	7439-92-1		
Lithium	0.011J	mg/L	0.25	0.0049	5	03/14/18 10:10	03/20/18 12:59	7439-93-2	D3	
Molybdenum	0.035	mg/L	0.010	0.0019	1	03/14/18 10:10	03/17/18 17:55	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	03/14/18 10:10	03/17/18 17:55	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	03/14/18 10:10	03/17/18 17:55	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	03/16/18 11:47	03/16/18 15:47	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	213	mg/L	25.0	25.0	1		03/14/18 00:17			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	2.4	mg/L	0.25	0.024	1		03/13/18 22:28	16887-00-6		
Fluoride	0.25J	mg/L	0.30	0.029	1		03/13/18 22:28	16984-48-8		
Sulfate	9.7	mg/L	1.0	0.017	1		03/13/18 22:28	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 262659

QC Batch: 2540

Analysis Method: EPA 7470A

QC Batch Method: EPA 7470A

Analysis Description: 7470 Mercury

Associated Lab Samples: 262659001

METHOD BLANK: 13358

Matrix: Water

Associated Lab Samples: 262659001

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Mercury	mg/L	ND	0.00050	0.000036	03/16/18 15:09	

LABORATORY CONTROL SAMPLE: 13359

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Mercury	mg/L	0.0025	0.0024	97	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 13429 13430

Parameter	Units	262779001 Result	MS	MSD	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
			Spike Conc.	Spike Conc.								
Mercury	mg/L	ND	0.0025	0.0025	0.0024	0.0024	98	97	75-125	0	20	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 262659

QC Batch: 2491 Analysis Method: EPA 6020B
QC Batch Method: EPA 3005A Analysis Description: 6020B MET
Associated Lab Samples: 262659001

METHOD BLANK: 13190 Matrix: Water
Associated Lab Samples: 262659001

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Antimony	mg/L	ND	0.0030	0.00078	03/17/18 17:44	
Arsenic	mg/L	ND	0.0050	0.00057	03/17/18 17:44	
Barium	mg/L	ND	0.010	0.00078	03/17/18 17:44	
Beryllium	mg/L	ND	0.0030	0.000050	03/17/18 17:44	
Boron	mg/L	ND	0.040	0.0039	03/17/18 17:44	
Cadmium	mg/L	ND	0.0010	0.000093	03/17/18 17:44	
Calcium	mg/L	ND	0.50	0.014	03/17/18 17:44	
Chromium	mg/L	ND	0.010	0.0016	03/17/18 17:44	
Cobalt	mg/L	ND	0.010	0.00052	03/17/18 17:44	
Lead	mg/L	ND	0.0050	0.00027	03/17/18 17:44	
Lithium	mg/L	ND	0.050	0.00097	03/17/18 17:44	
Molybdenum	mg/L	ND	0.010	0.0019	03/17/18 17:44	
Selenium	mg/L	ND	0.010	0.0014	03/17/18 17:44	
Thallium	mg/L	ND	0.0010	0.00014	03/17/18 17:44	

LABORATORY CONTROL SAMPLE: 13191

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Antimony	mg/L	0.1	0.10	104	80-120	
Arsenic	mg/L	0.1	0.099	99	80-120	
Barium	mg/L	0.1	0.10	100	80-120	
Beryllium	mg/L	0.1	0.097	97	80-120	
Boron	mg/L	1	1.0	101	80-120	
Cadmium	mg/L	0.1	0.10	104	80-120	
Calcium	mg/L	1	1.0	102	80-120	
Chromium	mg/L	0.1	0.11	109	80-120	
Cobalt	mg/L	0.1	0.11	107	80-120	
Lead	mg/L	0.1	0.098	98	80-120	
Lithium	mg/L	0.1	0.10	101	80-120	
Molybdenum	mg/L	0.1	0.11	105	80-120	
Selenium	mg/L	0.1	0.10	100	80-120	
Thallium	mg/L	0.1	0.099	99	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 13245 13246

Parameter	Units	262659001 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
Antimony	mg/L	ND	0.1	0.1	0.11	0.10	105	103	75-125	2	20	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 262659

Parameter	Units	MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 13245		13246		MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
		262659001 Result	MS Spike Conc.	MSD Spike Conc.	MS Result								
Arsenic	mg/L	ND	0.1	0.1	0.10	0.10	102	99	75-125	2	20		
Barium	mg/L	0.19	0.1	0.1	0.29	0.29	99	98	75-125	0	20		
Beryllium	mg/L	ND	0.1	0.1	0.091	0.10	91	104	75-125	14	20		
Boron	mg/L	0.13J	1	1	0.99	1.2	86	103	75-125	15	20		
Cadmium	mg/L	ND	0.1	0.1	0.10	0.10	105	103	75-125	2	20		
Calcium	mg/L	39.8	1	1	37.2	37.2	-267	-265	75-125	0	20	M6	
Chromium	mg/L	ND	0.1	0.1	0.10	0.10	104	104	75-125	0	20		
Cobalt	mg/L	0.027	0.1	0.1	0.13	0.13	103	103	75-125	0	20		
Lead	mg/L	ND	0.1	0.1	0.097	0.097	97	97	75-125	0	20		
Lithium	mg/L	0.011J	0.1	0.1	0.10	0.11J	90	100	75-125		20		
Molybdenum	mg/L	0.035	0.1	0.1	0.14	0.14	104	105	75-125	1	20		
Selenium	mg/L	ND	0.1	0.1	0.10	0.10	102	101	75-125	1	20		
Thallium	mg/L	ND	0.1	0.1	0.099	0.096	98	96	75-125	2	20		

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 262659

QC Batch: 401810 Analysis Method: SM 2540C
QC Batch Method: SM 2540C Analysis Description: 2540C Total Dissolved Solids
Associated Lab Samples: 262659001

METHOD BLANK: 2228706 Matrix: Water
Associated Lab Samples: 262659001

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Total Dissolved Solids	mg/L	ND	25.0	25.0	03/14/18 00:17	

LABORATORY CONTROL SAMPLE: 2228707

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	250	242	97	90-110	

SAMPLE DUPLICATE: 2228708

Parameter	Units	262612001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	76.0	72.0	5	5	

SAMPLE DUPLICATE: 2228709

Parameter	Units	92376343001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	153	150	2	5	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 262659

QC Batch: 2447	Analysis Method: EPA 300.0
QC Batch Method: EPA 300.0	Analysis Description: 300.0 IC Anions
Associated Lab Samples: 262659001	

METHOD BLANK: 12983 Matrix: Water
Associated Lab Samples: 262659001

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Chloride	mg/L	0.058J	0.25	0.024	03/13/18 21:05	
Fluoride	mg/L	ND	0.30	0.029	03/13/18 21:05	
Sulfate	mg/L	0.018J	1.0	0.017	03/13/18 21:05	

LABORATORY CONTROL SAMPLE: 12984

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	10	10.4	104	90-110	
Fluoride	mg/L	10	10.1	101	90-110	
Sulfate	mg/L	10	9.9	99	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 12985 12986

Parameter	Units	262659001 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
Chloride	mg/L	2.4	10	10	12.2	12.2	98	97	90-110	0	15	
Fluoride	mg/L	0.25J	10	10	10.4	10.4	102	101	90-110	1	15	
Sulfate	mg/L	9.7	10	10	18.8	18.7	91	91	90-110	0	15	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262659

Sample: DGWA-53 **Lab ID: 262659002** Collected: 03/08/18 12:55 Received: 03/08/18 15:10 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.372 ± 0.199 (0.282) C:86% T:NA	pCi/L	03/19/18 08:23	13982-63-3	
Radium-228	EPA 9320	1.77 ± 0.547 (0.688) C:77% T:89%	pCi/L	03/27/18 14:58	15262-20-1	
Total Radium	Total Radium Calculation	2.14 ± 0.746 (0.970)	pCi/L	03/28/18 13:56	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262659

QC Batch: 291352

Analysis Method: EPA 9315

QC Batch Method: EPA 9315

Analysis Description: 9315 Total Radium

Associated Lab Samples: 262659002

METHOD BLANK: 1425981

Matrix: Water

Associated Lab Samples: 262659002

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.280 ± 0.165 (0.214) C:87% T:NA	pCi/L	03/19/18 08:20	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 262659

QC Batch: 291249

Analysis Method: EPA 9320

QC Batch Method: EPA 9320

Analysis Description: 9320 Radium 228

Associated Lab Samples: 262659002

METHOD BLANK: 1425571

Matrix: Water

Associated Lab Samples: 262659002

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.247 ± 0.304 (0.638) C:75% T:80%	pCi/L	03/26/18 15:46	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: Plant McDonough Ash Ponds

Pace Project No.: 262659

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

LABORATORIES

PASI-A Pace Analytical Services - Asheville

PASI-GA Pace Analytical Services - Atlanta, GA

PASI-PA Pace Analytical Services - Greensburg

ANALYTE QUALIFIERS

D3 Sample was diluted due to the presence of high levels of non-target analytes or other matrix interference.

M6 Matrix spike and Matrix spike duplicate recovery not evaluated against control limits due to sample dilution.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Ash Ponds
Pace Project No.: 262659

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
262659001	DGWA-53	EPA 3005A	2491	EPA 6020B	2728
262659001	DGWA-53	EPA 7470A	2540	EPA 7470A	2686
262659002	DGWA-53	EPA 9315	291352		
262659002	DGWA-53	EPA 9320	291249		
262659002	DGWA-53	Total Radium Calculation	292811		
262659001	DGWA-53	SM 2540C	401810		
262659001	DGWA-53	EPA 300.0	2447		

REPORT OF LABORATORY ANALYSIS


This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CHAIN OF CUSTODY RECORD

CLIENT NAME: Georgia Power CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185 Atlanta, GA 30308 404-506-7239 REPORT TO: Dawn Prell (Dawn_Prell@golder.com) REQUESTED COMPLETION DATE: Standard TAT PROJECT NAME/STATE: Plant McDonough AP		ANALYSIS REQUESTED <table border="1"> <tr> <th>CONTAINER TYPE:</th> <th>P</th> <th>P</th> <th>P</th> <th>P</th> </tr> <tr> <td>PRESERVATION:</td> <td>3</td> <td>7</td> <td>3</td> <td>7</td> </tr> <tr> <td># of</td> <td></td> <td></td> <td></td> <td></td> </tr> </table>		CONTAINER TYPE:	P	P	P	P	PRESERVATION:	3	7	3	7	# of					CONTAINER TYPE P - PLASTIC A - AMBER GLASS G - CLEAR GLASS V - VOA VIAL S - STERILE O - OTHER PRESERVATION 1 - HCl, ≤6°C 2 - H ₂ SO ₄ , ≤6°C 3 - HNO ₃ 4 - NaOH, ≤6°C 5 - NaOH/ZnAc, ≤6°C 6 - Na ₂ S ₂ O ₃ , ≤6°C 7 - ≤6°C not frozen	
CONTAINER TYPE:	P	P	P	P																
PRESERVATION:	3	7	3	7																
# of																				
PROJECT #: Phase II CCR		CONTAINER TYPE DW - DRINKING WATER WW - WASTEWATER GW - GROUNDWATER SW - SURFACE WATER ST - STORM WATER W - WATER S - SOIL SL - SLUDGE SD - SOLID A - AIR L - LIQUID P - PRODUCT		REMARKS/ADDITIONAL INFORMATION																
Collection DATE 03/08/18 Collection TIME 1:55 MATRIX CODE* GW SAMPLE IDENTIFICATION DGWA-53		CONTAINER TYPE L A B I D N U M B E R 3 7 3 7 1 1 2 1 Metals App. III & IV (EPA 6020/7470) Cl, F, SO ₄ & TDS-K ₂ (EPA 300.0 & SM 2540C) Radium 226 & 228 (SW-846 9315/9320)		RECEIVED BY LAB: Karim Minkara RECEIVED BY: Field Lead DATE/TIME: 3/2/2018 DATE/TIME: 03/08/18 1510 TEMPERATURE: 4.9 Min: Max:																
RELINQUISHED BY: Yusef		RELINQUISHED BY: Yusef		DATE/TIME: 5-8-18 / 1510 DATE/TIME:																
SAMPLE SHIPPED VIA: UPS SHIPMENT #: 181510		COURIER CLIENT		OTHER FS OTHER FS																
RECEIVED BY LAB: Karim Minkara RECEIVED BY: Karim Minkara		DATE/TIME: 03/08/18 1510 TEMPERATURE: 4.9 Min: Max:		LAB #: Entered Into LIMS: Tracking #:																

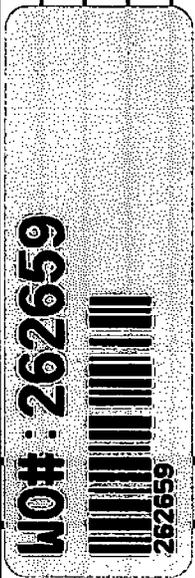

Sample Condition Upon Receipt



Client Name: GAPower

Project # _____

WO#: 262659

PM: **BM**

Due Date: **03/15/18**

CLIENT: **GAPower-CCR**

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: _____

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other _____

Thermometer Used 83 Type of Ice: Wet Blue None Samples on ice, cooling process has begun

Cooler Temperature 4.9 Biological Tissue Is Frozen: Yes No

Temp should be above freezing to 6°C

Date and Initials of person examining contents: 3/8/18 MR

Comments: _____

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.	
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.	
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.	
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.	
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.	
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.	
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.	
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.	
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.	
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.	
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.	
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.	
-Includes date/time/ID/Analysis Matrix: <u>GLW</u>			
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.	
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed	Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.	
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.	
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.	
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A		
Pace Trip Blank Lot # (if purchased):			

Client Notification/ Resolution:

Field Data Required? Y / N

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: _____

Project Manager Review: _____

Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

Quality Control Sample Performance Assessment



Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-228
Analyst: JLW
Date: 3/21/2018
Worklist: 40510
Matrix: DW

Method Blank Assessment	
MB Sample ID	1425571
MB concentration:	0.247
M/B Counting Uncertainty:	0.301
MB MDC:	0.638
MB Numerical Performance Indicator:	1.61
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	Pass

Laboratory Control Sample Assessment		LCS (Y or N)?
Count Date:	3/26/2018	LCS40510
Spike I.D.:	17-033	3/26/2018
Spike Concentration (pCi/mL):	22.054	17-033
Volume Used (mL):	0.20	22.054
Aliquot Volume (L, g, F):	0.804	0.20
Target Conc. (pCi/L, g, F):	5.487	0.806
Uncertainty (Calculated):	0.395	5.472
Result (pCi/L, g, F):	4.634	0.394
LCS/LCSD Counting Uncertainty (pCi/L, g, F):	0.650	5.129
Numerical Performance Indicator:	-2.20	0.644
Percent Recovery:	84.45%	-0.89
Status vs Numerical Indicator:	N/A	93.73%
Status vs Recovery:	Pass	N/A

Duplicate Sample Assessment	
Sample I.D.:	LCS40510
Duplicate Sample I.D.:	LCS40510
Sample Result (pCi/L, g, F):	4.634
Sample Duplicate Result (pCi/L, g, F):	0.650
Sample Result Counting Uncertainty (pCi/L, g, F):	5.129
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.644
Are sample and/or duplicate results below MDC?	NO
Duplicate Numerical Performance Indicator:	-1.060
(Based on the LCS/LCSD Percent Recoveries) Duplicate RPD:	10.41%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Pass

Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC.

Comments:

Sample Matrix Spike Control Assessment	
Sample Collection Date:	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Spike I.D.:	
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	
Spike Volume Used in MS (mL):	
Spike Volume Used in MSD (mL):	
MS Aliquot (L, g, F):	
MS Target Conc. (pCi/L, g, F):	
MSD Aliquot (L, g, F):	
MSD Target Conc. (pCi/L, g, F):	
Spike uncertainty (calculated):	
Sample Result:	
Sample Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Result:	
Sample Matrix Spike Duplicate Result:	
MS Numerical Performance Indicator:	
MSD Numerical Performance Indicator:	
MS Percent Recovery:	
MSD Percent Recovery:	
MS Status vs Numerical Indicator:	
MSD Status vs Numerical Indicator:	
MS Status vs Recovery:	
MSD Status vs Recovery:	

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.:	
Sample MS I.D.:	
Sample MSD I.D.:	
Sample Matrix Spike Result:	
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	
Sample Matrix Spike Duplicate Result:	
Sample Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):	
Duplicate Numerical Performance Indicator:	
(Based on the Percent Recoveries) MS/MSD Duplicate RPD:	
MS/MSD Duplicate Status vs Numerical Indicator:	
MS/MSD Duplicate Status vs RPD:	

557
3-27-18

CHIEF



Quality Control Sample Performance Assessment

Analyst Must Manually Enter All Fields Highlighted in Yellow.

Test: Ra-226
Analyst: JC2
Date: 3/16/2018
Worklist: 40531
Matrix: DW

Method Blank Assessment	
MB Sample ID	1425981
MB concentration:	0.280
MB Counting Uncertainty:	0.160
MB MDC:	0.214
MB Numerical Performance Indicator:	3.43
MB Status vs Numerical Indicator:	N/A
MB Status vs. MDC:	See Comment*

Laboratory Control Sample Assessment	
LCSD (Y or N)?	Y
LCSD40531	LCSD40531
Count Date:	3/19/2018
Spike I.D.:	17-030
Spike Concentration (pCi/mL):	80.175
Volume Used (mL):	0.10
Aliquot Volume (L, g, F):	0.503
Target Conc. (pCi/L, g, F):	15.945
Uncertainty (Calculated):	1.469
Result (pCi/L, g, F):	13.458
LCSD Counting Uncertainty (pCi/L, g, F):	0.991
Numerical Performance Indicator:	-2.69
Percent Recovery:	84.77%
Status vs Numerical Indicator:	N/A
Status vs Recovery:	Pass

Sample Matrix Spike Control Assessment	
Sample Collection Date:	Sample I.D.
Sample MS I.D.	Sample MS I.D.
Sample MSD I.D.	Sample MSD I.D.
Spike I.D.:	Spike I.D.:
MS/MSD Decay Corrected Spike Concentration (pCi/mL):	Spike Volume Used in MS (mL):
Spike Volume Used in MSD (mL):	MS Aliquot (L, g, F):
MS Target Conc.(pCi/L, g, F):	MSD Aliquot (L, g, F):
MSD Target Conc. (pCi/L, g, F):	Spike uncertainty (calculated):
Sample Result:	Sample Result Counting Uncertainty (pCi/L, g, F):
Sample Matrix Spike Result:	Sample Matrix Spike Duplicate Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
MS Numerical Performance Indicator:	MS Percent Recovery:
MSD Numerical Performance Indicator:	MSD Percent Recovery:
MS Status vs Numerical Indicator:	MS Status vs Recovery:
MSD Status vs Numerical Indicator:	MSD Status vs Recovery:

Duplicate Sample Assessment	
Sample I.D.:	LCSD40531
Duplicate Sample I.D.:	LCSD40531
Sample Result (pCi/L, g, F):	13.517
Sample Result Counting Uncertainty (pCi/L, g, F):	0.991
Sample Duplicate Result (pCi/L, g, F):	13.458
Sample Duplicate Result Counting Uncertainty (pCi/L, g, F):	0.966
Are sample and/or duplicate results below MDC?	NO
Duplicate Numerical Performance Indicator:	0.083
Duplicate RPD:	0.43%
Duplicate Status vs Numerical Indicator:	N/A
Duplicate Status vs RPD:	Pass

Matrix Spike/Matrix Spike Duplicate Sample Assessment	
Sample I.D.	Sample MS I.D.
Sample MS I.D.	Sample MSD I.D.
Sample MSD I.D.	Sample Matrix Spike Result:
Sample Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	Sample Matrix Spike Duplicate Result:
Matrix Spike Result Counting Uncertainty (pCi/L, g, F):	Matrix Spike Duplicate Result Counting Uncertainty (pCi/L, g, F):
MS Numerical Performance Indicator:	Duplicate Numerical Performance Indicator:
MSD Numerical Performance Indicator:	Duplicate Numerical Performance Indicator:
MS Status vs Numerical Indicator:	MS/MSD Duplicate Status vs RPD:
MSD Status vs Numerical Indicator:	MS/MSD Duplicate Status vs Numerical Indicator:

Comments: # Evaluation of duplicate precision is not applicable if either the sample or duplicate results are below the MDC. *The method blank result is below the reporting limit for this analysis and is acceptable.

MM3-20-18

JWC
3-20-18

LABORATORY ANALYTICAL DATA

July 2018

July 18, 2018

Joju Abraham
Georgia Power - Coal Combustion Residuals
2480 Maner Road
Atlanta, GA 30339

RE: Project: Plant McDonough Ash Ponds
Pace Project No.: 266979

Dear Joju Abraham:

Enclosed are the analytical results for sample(s) received by the laboratory on July 11, 2018. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Betsy McDaniel
betsy.mcdaniel@pacelabs.com
(770)734-4200
Project Manager

Enclosures

cc: Kristen Jurinko, Golder Associates Inc.
Julie Lehrman, Golder Associates Inc.
Maria Padilla, Georgia Power
Dawn Prell, Golder Associates Inc.
Tim Richards, Golder Associates - Atlanta
Rebecca Thornton, Pace Analytical Atlanta



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: Plant McDonough Ash Ponds

Pace Project No.: 266979

Atlanta Certification IDs

110 Technology Parkway Peachtree Corners, GA 30092

Florida DOH Certification #: E87315

Georgia DW Inorganics Certification #: 812

Georgia DW Microbiology Certification #: 812

North Carolina Certification #: 381

South Carolina Certification #: 98011001

Texas Certification #: T104704397-08-TX

Virginia Certification #: 460204

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: Plant McDonough Ash Ponds

Pace Project No.: 266979

Lab ID	Sample ID	Matrix	Date Collected	Date Received
266979001	DGWA-70A	Water	07/10/18 11:00	07/11/18 10:45
266979002	DGWA-71	Water	07/10/18 09:40	07/11/18 10:45
266979003	DGWC-4	Water	07/10/18 09:25	07/11/18 10:45
266979004	DGWC-5	Water	07/10/18 11:05	07/11/18 10:45
266979005	DGWC-8	Water	07/10/18 14:10	07/11/18 10:45
266979006	FD-1	Water	07/10/18 00:00	07/11/18 10:45
266979007	FB-1	Water	07/10/18 11:50	07/11/18 10:45
266979008	EB-1	Water	07/10/18 15:35	07/11/18 10:45
266979009	DGWC-10	Water	07/10/18 12:50	07/11/18 10:45
266979010	DGWC-11	Water	07/10/18 15:00	07/11/18 10:45
266979011	DGWC-13	Water	07/10/18 15:00	07/11/18 10:45

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds
Pace Project No.: 266979

Lab ID	Sample ID	Method	Analysts	Analytes Reported
266979001	DGWA-70A	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
266979002	DGWA-71	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
266979003	DGWC-4	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	MWB, RLC	3
266979004	DGWC-5	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	MWB, RLC	3
266979005	DGWC-8	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	MWB, RLC	3
266979006	FD-1	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	MWB, RLC	3
266979007	FB-1	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
266979008	EB-1	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
266979009	DGWC-10	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	MWB, RLC	3
266979010	DGWC-11	EPA 6020B	CSW	14

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds

Pace Project No.: 266979

Lab ID	Sample ID	Method	Analysts	Analytes Reported
266979011	DGWC-13	EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	MWB, RLC	3
		EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	MWB, RLC	3

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 266979

Sample: DGWA-70A		Lab ID: 266979001		Collected: 07/10/18 11:00		Received: 07/11/18 10:45		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	mg/L	0.0030	0.00078	1	07/13/18 10:44	07/16/18 15:02	7440-36-0	
Arsenic	ND	mg/L	0.0050	0.00057	1	07/13/18 10:44	07/16/18 15:02	7440-38-2	
Barium	0.037	mg/L	0.010	0.00078	1	07/13/18 10:44	07/16/18 15:02	7440-39-3	
Beryllium	0.000095J	mg/L	0.0030	0.000050	1	07/13/18 10:44	07/16/18 15:02	7440-41-7	
Boron	0.0077J	mg/L	0.040	0.0039	1	07/13/18 10:44	07/16/18 15:02	7440-42-8	
Cadmium	ND	mg/L	0.0010	0.000093	1	07/13/18 10:44	07/16/18 15:02	7440-43-9	
Calcium	5.0	mg/L	0.50	0.014	1	07/13/18 10:44	07/16/18 15:02	7440-70-2	
Chromium	ND	mg/L	0.010	0.0016	1	07/13/18 10:44	07/16/18 15:02	7440-47-3	
Cobalt	ND	mg/L	0.010	0.00052	1	07/13/18 10:44	07/16/18 15:02	7440-48-4	
Lead	ND	mg/L	0.0050	0.00027	1	07/13/18 10:44	07/16/18 15:02	7439-92-1	
Lithium	ND	mg/L	0.050	0.00097	1	07/13/18 10:44	07/16/18 15:02	7439-93-2	
Molybdenum	ND	mg/L	0.010	0.0019	1	07/13/18 10:44	07/16/18 15:02	7439-98-7	
Selenium	ND	mg/L	0.010	0.0014	1	07/13/18 10:44	07/16/18 15:02	7782-49-2	
Thallium	ND	mg/L	0.0010	0.00014	1	07/13/18 10:44	07/16/18 15:02	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	0.000055J	mg/L	0.00050	0.000036	1	07/12/18 09:30	07/13/18 12:09	7439-97-6	B
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	80.0	mg/L	25.0	10.0	1		07/14/18 09:58		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	1.9	mg/L	0.25	0.024	1		07/12/18 16:01	16887-00-6	B
Fluoride	0.082J	mg/L	0.30	0.029	1		07/12/18 16:01	16984-48-8	
Sulfate	0.25J	mg/L	1.0	0.017	1		07/12/18 16:01	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 266979

Sample: DGWA-71		Lab ID: 266979002		Collected: 07/10/18 09:40		Received: 07/11/18 10:45		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	07/13/18 10:44	07/16/18 15:14	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	07/13/18 10:44	07/16/18 15:14	7440-38-2		
Barium	0.027	mg/L	0.010	0.00078	1	07/13/18 10:44	07/16/18 15:14	7440-39-3		
Beryllium	0.000091J	mg/L	0.0030	0.000050	1	07/13/18 10:44	07/16/18 15:14	7440-41-7		
Boron	0.0059J	mg/L	0.040	0.0039	1	07/13/18 10:44	07/16/18 15:14	7440-42-8		
Cadmium	ND	mg/L	0.0010	0.000093	1	07/13/18 10:44	07/16/18 15:14	7440-43-9		
Calcium	5.7	mg/L	2.5	0.069	5	07/13/18 10:44	07/17/18 14:39	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	07/13/18 10:44	07/16/18 15:14	7440-47-3		
Cobalt	ND	mg/L	0.010	0.00052	1	07/13/18 10:44	07/16/18 15:14	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	07/13/18 10:44	07/16/18 15:14	7439-92-1		
Lithium	0.0012J	mg/L	0.050	0.00097	1	07/13/18 10:44	07/16/18 15:14	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	07/13/18 10:44	07/16/18 15:14	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	07/13/18 10:44	07/16/18 15:14	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	07/13/18 10:44	07/16/18 15:14	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	0.00010J	mg/L	0.00050	0.000036	1	07/12/18 09:30	07/13/18 12:28	7439-97-6	B	
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	88.0	mg/L	25.0	10.0	1		07/14/18 09:58			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	2.5	mg/L	0.25	0.024	1		07/12/18 17:03	16887-00-6	B	
Fluoride	ND	mg/L	0.30	0.029	1		07/12/18 17:03	16984-48-8		
Sulfate	7.2	mg/L	1.0	0.017	1		07/12/18 17:03	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 266979

Sample: DGWC-4		Lab ID: 266979003		Collected: 07/10/18 09:25		Received: 07/11/18 10:45		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	07/13/18 10:44	07/16/18 15:25	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	07/13/18 10:44	07/16/18 15:25	7440-38-2		
Barium	0.036	mg/L	0.010	0.00078	1	07/13/18 10:44	07/16/18 15:25	7440-39-3		
Beryllium	0.00017J	mg/L	0.0030	0.000050	1	07/13/18 10:44	07/16/18 15:25	7440-41-7		
Boron	4.5	mg/L	0.040	0.0039	1	07/13/18 10:44	07/16/18 15:25	7440-42-8		
Cadmium	0.00065J	mg/L	0.0010	0.000093	1	07/13/18 10:44	07/16/18 15:25	7440-43-9		
Calcium	275	mg/L	125	3.4	250	07/13/18 10:44	07/17/18 14:45	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	07/13/18 10:44	07/16/18 15:25	7440-47-3		
Cobalt	0.0018J	mg/L	0.010	0.00052	1	07/13/18 10:44	07/16/18 15:25	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	07/13/18 10:44	07/16/18 15:25	7439-92-1		
Lithium	0.0030J	mg/L	0.050	0.00097	1	07/13/18 10:44	07/16/18 15:25	7439-93-2		
Molybdenum	0.0044J	mg/L	0.010	0.0019	1	07/13/18 10:44	07/16/18 15:25	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	07/13/18 10:44	07/16/18 15:25	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	07/13/18 10:44	07/16/18 15:25	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	0.000055J	mg/L	0.00050	0.000036	1	07/12/18 09:30	07/13/18 12:30	7439-97-6	B	
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	1390	mg/L	25.0	10.0	1		07/14/18 09:58			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	24.9	mg/L	0.25	0.024	1		07/12/18 17:24	16887-00-6		
Fluoride	0.36	mg/L	0.30	0.029	1		07/12/18 17:24	16984-48-8		
Sulfate	787	mg/L	50.0	0.85	50		07/16/18 21:29	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 266979

Sample: DGWC-5		Lab ID: 266979004		Collected: 07/10/18 11:05		Received: 07/11/18 10:45		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	mg/L	0.0030	0.00078	1	07/13/18 10:44	07/16/18 15:36	7440-36-0	
Arsenic	0.0057	mg/L	0.0050	0.00057	1	07/13/18 10:44	07/16/18 15:36	7440-38-2	
Barium	0.015	mg/L	0.010	0.00078	1	07/13/18 10:44	07/16/18 15:36	7440-39-3	
Beryllium	0.0048	mg/L	0.0030	0.000050	1	07/13/18 10:44	07/16/18 15:36	7440-41-7	
Boron	3.2	mg/L	0.040	0.0039	1	07/13/18 10:44	07/16/18 15:36	7440-42-8	
Cadmium	0.00034J	mg/L	0.0010	0.000093	1	07/13/18 10:44	07/16/18 15:36	7440-43-9	
Calcium	71.4	mg/L	25.0	0.69	50	07/13/18 10:44	07/16/18 15:42	7440-70-2	
Chromium	ND	mg/L	0.010	0.0016	1	07/13/18 10:44	07/16/18 15:36	7440-47-3	
Cobalt	0.025	mg/L	0.010	0.00052	1	07/13/18 10:44	07/16/18 15:36	7440-48-4	
Lead	ND	mg/L	0.0050	0.00027	1	07/13/18 10:44	07/16/18 15:36	7439-92-1	
Lithium	0.0034J	mg/L	0.050	0.00097	1	07/13/18 10:44	07/16/18 15:36	7439-93-2	
Molybdenum	ND	mg/L	0.010	0.0019	1	07/13/18 10:44	07/16/18 15:36	7439-98-7	
Selenium	0.019	mg/L	0.010	0.0014	1	07/13/18 10:44	07/16/18 15:36	7782-49-2	
Thallium	ND	mg/L	0.0010	0.00014	1	07/13/18 10:44	07/16/18 15:36	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	0.00018J	mg/L	0.00050	0.000036	1	07/12/18 09:30	07/13/18 12:32	7439-97-6	B
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	635	mg/L	25.0	10.0	1		07/14/18 09:58		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	9.7	mg/L	0.25	0.024	1		07/12/18 17:45	16887-00-6	
Fluoride	0.42	mg/L	0.30	0.029	1		07/12/18 17:45	16984-48-8	
Sulfate	400	mg/L	20.0	0.34	20		07/16/18 21:50	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 266979

Sample: DGWC-8		Lab ID: 266979005		Collected: 07/10/18 14:10		Received: 07/11/18 10:45		Matrix: Water	
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual
			Limit	MDL	DF				
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	mg/L	0.0030	0.00078	1	07/13/18 10:44	07/16/18 16:01	7440-36-0	
Arsenic	ND	mg/L	0.0050	0.00057	1	07/13/18 10:44	07/16/18 16:01	7440-38-2	
Barium	0.030	mg/L	0.010	0.00078	1	07/13/18 10:44	07/16/18 16:01	7440-39-3	
Beryllium	0.0030	mg/L	0.0030	0.000050	1	07/13/18 10:44	07/16/18 16:01	7440-41-7	
Boron	1.8	mg/L	0.040	0.0039	1	07/13/18 10:44	07/16/18 16:01	7440-42-8	
Cadmium	0.0025	mg/L	0.0010	0.000093	1	07/13/18 10:44	07/16/18 16:01	7440-43-9	
Calcium	59.3	mg/L	25.0	0.69	50	07/13/18 10:44	07/16/18 16:07	7440-70-2	
Chromium	ND	mg/L	0.010	0.0016	1	07/13/18 10:44	07/16/18 16:01	7440-47-3	
Cobalt	0.072	mg/L	0.010	0.00052	1	07/13/18 10:44	07/16/18 16:01	7440-48-4	
Lead	ND	mg/L	0.0050	0.00027	1	07/13/18 10:44	07/16/18 16:01	7439-92-1	
Lithium	0.0061J	mg/L	0.050	0.00097	1	07/13/18 10:44	07/16/18 16:01	7439-93-2	
Molybdenum	ND	mg/L	0.010	0.0019	1	07/13/18 10:44	07/16/18 16:01	7439-98-7	
Selenium	ND	mg/L	0.010	0.0014	1	07/13/18 10:44	07/16/18 16:01	7782-49-2	
Thallium	0.00027J	mg/L	0.0010	0.00014	1	07/13/18 10:44	07/16/18 16:01	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	0.000082J	mg/L	0.00050	0.000036	1	07/12/18 09:30	07/13/18 12:35	7439-97-6	B
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	472	mg/L	25.0	10.0	1		07/14/18 09:58		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	8.7	mg/L	0.25	0.024	1		07/12/18 18:05	16887-00-6	
Fluoride	0.14J	mg/L	0.30	0.029	1		07/12/18 18:05	16984-48-8	
Sulfate	280	mg/L	10.0	0.17	10		07/16/18 22:10	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 266979

Sample: FD-1		Lab ID: 266979006		Collected: 07/10/18 00:00		Received: 07/11/18 10:45		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	mg/L	0.0030	0.00078	1	07/13/18 10:44	07/16/18 16:12	7440-36-0	
Arsenic	ND	mg/L	0.0050	0.00057	1	07/13/18 10:44	07/16/18 16:12	7440-38-2	
Barium	0.076	mg/L	0.010	0.00078	1	07/13/18 10:44	07/16/18 16:12	7440-39-3	
Beryllium	0.000072J	mg/L	0.0030	0.000050	1	07/13/18 10:44	07/16/18 16:12	7440-41-7	
Boron	1.2	mg/L	0.040	0.0039	1	07/13/18 10:44	07/16/18 16:12	7440-42-8	
Cadmium	ND	mg/L	0.0010	0.000093	1	07/13/18 10:44	07/16/18 16:12	7440-43-9	
Calcium	59.5	mg/L	25.0	0.69	50	07/13/18 10:44	07/16/18 16:18	7440-70-2	
Chromium	ND	mg/L	0.010	0.0016	1	07/13/18 10:44	07/16/18 16:12	7440-47-3	
Cobalt	ND	mg/L	0.010	0.00052	1	07/13/18 10:44	07/16/18 16:12	7440-48-4	
Lead	ND	mg/L	0.0050	0.00027	1	07/13/18 10:44	07/16/18 16:12	7439-92-1	
Lithium	0.0020J	mg/L	0.050	0.00097	1	07/13/18 10:44	07/16/18 16:12	7439-93-2	
Molybdenum	ND	mg/L	0.010	0.0019	1	07/13/18 10:44	07/16/18 16:12	7439-98-7	
Selenium	ND	mg/L	0.010	0.0014	1	07/13/18 10:44	07/16/18 16:12	7782-49-2	
Thallium	ND	mg/L	0.0010	0.00014	1	07/13/18 10:44	07/16/18 16:12	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	0.000051J	mg/L	0.00050	0.000036	1	07/12/18 09:30	07/13/18 12:37	7439-97-6	B
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	408	mg/L	25.0	10.0	1		07/14/18 09:59		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	13.7	mg/L	0.25	0.024	1		07/12/18 18:26	16887-00-6	
Fluoride	0.057J	mg/L	0.30	0.029	1		07/12/18 18:26	16984-48-8	
Sulfate	225	mg/L	10.0	0.17	10		07/16/18 22:31	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 266979

Sample: FB-1		Lab ID: 266979007		Collected: 07/10/18 11:50		Received: 07/11/18 10:45		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	mg/L	0.0030	0.00078	1	07/13/18 10:44	07/16/18 16:24	7440-36-0	
Arsenic	ND	mg/L	0.0050	0.00057	1	07/13/18 10:44	07/16/18 16:24	7440-38-2	
Barium	ND	mg/L	0.010	0.00078	1	07/13/18 10:44	07/16/18 16:24	7440-39-3	
Beryllium	ND	mg/L	0.0030	0.000050	1	07/13/18 10:44	07/16/18 16:24	7440-41-7	
Boron	0.0044J	mg/L	0.040	0.0039	1	07/13/18 10:44	07/16/18 16:24	7440-42-8	
Cadmium	ND	mg/L	0.0010	0.000093	1	07/13/18 10:44	07/16/18 16:24	7440-43-9	
Calcium	0.021J	mg/L	0.50	0.014	1	07/13/18 10:44	07/16/18 16:24	7440-70-2	
Chromium	ND	mg/L	0.010	0.0016	1	07/13/18 10:44	07/16/18 16:24	7440-47-3	
Cobalt	ND	mg/L	0.010	0.00052	1	07/13/18 10:44	07/16/18 16:24	7440-48-4	
Lead	ND	mg/L	0.0050	0.00027	1	07/13/18 10:44	07/16/18 16:24	7439-92-1	
Lithium	ND	mg/L	0.050	0.00097	1	07/13/18 10:44	07/16/18 16:24	7439-93-2	
Molybdenum	ND	mg/L	0.010	0.0019	1	07/13/18 10:44	07/16/18 16:24	7439-98-7	
Selenium	ND	mg/L	0.010	0.0014	1	07/13/18 10:44	07/16/18 16:24	7782-49-2	
Thallium	ND	mg/L	0.0010	0.00014	1	07/13/18 10:44	07/16/18 16:24	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	0.000053J	mg/L	0.00050	0.000036	1	07/12/18 09:30	07/13/18 12:40	7439-97-6	B
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	19.0J	mg/L	25.0	10.0	1		07/14/18 09:59		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	0.29	mg/L	0.25	0.024	1		07/12/18 18:47	16887-00-6	B
Fluoride	ND	mg/L	0.30	0.029	1		07/12/18 18:47	16984-48-8	
Sulfate	ND	mg/L	1.0	0.017	1		07/12/18 18:47	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 266979

Sample: EB-1		Lab ID: 266979008		Collected: 07/10/18 15:35		Received: 07/11/18 10:45		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	07/13/18 10:44	07/16/18 16:29	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	07/13/18 10:44	07/16/18 16:29	7440-38-2		
Barium	ND	mg/L	0.010	0.00078	1	07/13/18 10:44	07/16/18 16:29	7440-39-3		
Beryllium	ND	mg/L	0.0030	0.000050	1	07/13/18 10:44	07/16/18 16:29	7440-41-7		
Boron	ND	mg/L	0.040	0.0039	1	07/13/18 10:44	07/16/18 16:29	7440-42-8		
Cadmium	ND	mg/L	0.0010	0.000093	1	07/13/18 10:44	07/16/18 16:29	7440-43-9		
Calcium	0.030J	mg/L	0.50	0.014	1	07/13/18 10:44	07/16/18 16:29	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	07/13/18 10:44	07/16/18 16:29	7440-47-3		
Cobalt	ND	mg/L	0.010	0.00052	1	07/13/18 10:44	07/16/18 16:29	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	07/13/18 10:44	07/16/18 16:29	7439-92-1		
Lithium	ND	mg/L	0.050	0.00097	1	07/13/18 10:44	07/16/18 16:29	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	07/13/18 10:44	07/16/18 16:29	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	07/13/18 10:44	07/16/18 16:29	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	07/13/18 10:44	07/16/18 16:29	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	0.000045J	mg/L	0.00050	0.000036	1	07/12/18 09:30	07/13/18 12:42	7439-97-6	B	
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	ND	mg/L	25.0	10.0	1		07/14/18 09:59			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	0.32	mg/L	0.25	0.024	1		07/12/18 19:07	16887-00-6	B	
Fluoride	ND	mg/L	0.30	0.029	1		07/12/18 19:07	16984-48-8		
Sulfate	0.090J	mg/L	1.0	0.017	1		07/12/18 19:07	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 266979

Sample: DGWC-10		Lab ID: 266979009		Collected: 07/10/18 12:50		Received: 07/11/18 10:45		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	07/13/18 10:44	07/16/18 16:35	7440-36-0		
Arsenic	0.0036J	mg/L	0.0050	0.00057	1	07/13/18 10:44	07/16/18 16:35	7440-38-2		
Barium	0.027	mg/L	0.010	0.00078	1	07/13/18 10:44	07/16/18 16:35	7440-39-3		
Beryllium	0.012	mg/L	0.0030	0.000050	1	07/13/18 10:44	07/16/18 16:35	7440-41-7		
Boron	2.4	mg/L	0.040	0.0039	1	07/13/18 10:44	07/16/18 16:35	7440-42-8		
Cadmium	0.0016	mg/L	0.0010	0.000093	1	07/13/18 10:44	07/16/18 16:35	7440-43-9		
Calcium	95.3	mg/L	25.0	0.69	50	07/13/18 10:44	07/16/18 16:41	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	07/13/18 10:44	07/16/18 16:35	7440-47-3		
Cobalt	0.20	mg/L	0.010	0.00052	1	07/13/18 10:44	07/16/18 16:35	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	07/13/18 10:44	07/16/18 16:35	7439-92-1		
Lithium	0.0047J	mg/L	0.050	0.00097	1	07/13/18 10:44	07/16/18 16:35	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	07/13/18 10:44	07/16/18 16:35	7439-98-7		
Selenium	0.023	mg/L	0.010	0.0014	1	07/13/18 10:44	07/16/18 16:35	7782-49-2		
Thallium	0.00032J	mg/L	0.0010	0.00014	1	07/13/18 10:44	07/16/18 16:35	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	0.000051J	mg/L	0.00050	0.000036	1	07/12/18 09:30	07/13/18 12:44	7439-97-6	B	
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	510	mg/L	25.0	10.0	1		07/14/18 09:59			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	11.0	mg/L	0.25	0.024	1		07/12/18 20:51	16887-00-6		
Fluoride	2.0	mg/L	0.30	0.029	1		07/12/18 20:51	16984-48-8		
Sulfate	301	mg/L	20.0	0.34	20		07/16/18 22:52	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 266979

Sample: DGWC-11		Lab ID: 266979010		Collected: 07/10/18 15:00		Received: 07/11/18 10:45		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	mg/L	0.0030	0.00078	1	07/13/18 10:44	07/16/18 16:47	7440-36-0	
Arsenic	ND	mg/L	0.0050	0.00057	1	07/13/18 10:44	07/16/18 16:47	7440-38-2	
Barium	0.073	mg/L	0.010	0.00078	1	07/13/18 10:44	07/16/18 16:47	7440-39-3	
Beryllium	0.000076J	mg/L	0.0030	0.000050	1	07/13/18 10:44	07/16/18 16:47	7440-41-7	
Boron	1.1	mg/L	0.040	0.0039	1	07/13/18 10:44	07/16/18 16:47	7440-42-8	
Cadmium	ND	mg/L	0.0010	0.000093	1	07/13/18 10:44	07/16/18 16:47	7440-43-9	
Calcium	56.2	mg/L	25.0	0.69	50	07/13/18 10:44	07/16/18 16:52	7440-70-2	M6
Chromium	ND	mg/L	0.010	0.0016	1	07/13/18 10:44	07/16/18 16:47	7440-47-3	
Cobalt	ND	mg/L	0.010	0.00052	1	07/13/18 10:44	07/16/18 16:47	7440-48-4	
Lead	ND	mg/L	0.0050	0.00027	1	07/13/18 10:44	07/16/18 16:47	7439-92-1	
Lithium	0.0019J	mg/L	0.050	0.00097	1	07/13/18 10:44	07/16/18 16:47	7439-93-2	
Molybdenum	ND	mg/L	0.010	0.0019	1	07/13/18 10:44	07/16/18 16:47	7439-98-7	
Selenium	ND	mg/L	0.010	0.0014	1	07/13/18 10:44	07/16/18 16:47	7782-49-2	
Thallium	ND	mg/L	0.0010	0.00014	1	07/13/18 10:44	07/16/18 16:47	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	0.000047J	mg/L	0.00050	0.000036	1	07/12/18 09:30	07/13/18 12:47	7439-97-6	B
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	422	mg/L	25.0	10.0	1		07/14/18 09:59		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	13.7	mg/L	0.25	0.024	1		07/12/18 21:11	16887-00-6	
Fluoride	0.047J	mg/L	0.30	0.029	1		07/12/18 21:11	16984-48-8	
Sulfate	240	mg/L	10.0	0.17	10		07/16/18 23:12	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 266979

Sample: DGWC-13		Lab ID: 266979011		Collected: 07/10/18 15:00		Received: 07/11/18 10:45		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	0.0014J	mg/L	0.0030	0.00078	1	07/13/18 10:44	07/16/18 17:56	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	07/13/18 10:44	07/16/18 17:56	7440-38-2		
Barium	0.035	mg/L	0.010	0.00078	1	07/13/18 10:44	07/16/18 17:56	7440-39-3		
Beryllium	0.000050J	mg/L	0.0030	0.000050	1	07/13/18 10:44	07/16/18 17:56	7440-41-7		
Boron	0.72	mg/L	0.20	0.020	5	07/13/18 10:44	07/17/18 14:50	7440-42-8		
Cadmium	ND	mg/L	0.0010	0.000093	1	07/13/18 10:44	07/16/18 17:56	7440-43-9		
Calcium	42.6	mg/L	25.0	0.69	50	07/13/18 10:44	07/16/18 18:02	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	07/13/18 10:44	07/16/18 17:56	7440-47-3		
Cobalt	ND	mg/L	0.010	0.00052	1	07/13/18 10:44	07/16/18 17:56	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	07/13/18 10:44	07/16/18 17:56	7439-92-1		
Lithium	0.0028J	mg/L	0.050	0.00097	1	07/13/18 10:44	07/16/18 17:56	7439-93-2		
Molybdenum	0.024	mg/L	0.010	0.0019	1	07/13/18 10:44	07/16/18 17:56	7439-98-7		
Selenium	0.0028J	mg/L	0.010	0.0014	1	07/13/18 10:44	07/16/18 17:56	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	07/13/18 10:44	07/16/18 17:56	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	0.000054J	mg/L	0.00050	0.000036	1	07/12/18 09:30	07/13/18 13:36	7439-97-6	B	
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	306	mg/L	25.0	10.0	1		07/14/18 09:59			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	14.8	mg/L	0.25	0.024	1		07/12/18 21:53	16887-00-6		
Fluoride	0.32	mg/L	0.30	0.029	1		07/12/18 21:53	16984-48-8		
Sulfate	152	mg/L	10.0	0.17	10		07/16/18 23:33	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 266979

QC Batch: 9654 Analysis Method: EPA 7470A
QC Batch Method: EPA 7470A Analysis Description: 7470 Mercury
Associated Lab Samples: 266979001, 266979002, 266979003, 266979004, 266979005, 266979006, 266979007, 266979008, 266979009, 266979010, 266979011

METHOD BLANK: 43845 Matrix: Water
Associated Lab Samples: 266979001, 266979002, 266979003, 266979004, 266979005, 266979006, 266979007, 266979008, 266979009, 266979010, 266979011

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Mercury	mg/L	0.000060J	0.00050	0.000036	07/13/18 12:04	

LABORATORY CONTROL SAMPLE: 43846

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Mercury	mg/L	.0025	0.0028	112	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 43847 43848

Parameter	Units	266979001 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
Mercury	mg/L	0.000055J	.0025	.0025	0.0023	0.0024	88	95	75-125	7	20	

SAMPLE DUPLICATE: 43850

Parameter	Units	266946001 Result	Dup Result	RPD	Max RPD	Qualifiers
Mercury	mg/L	ND	0.000054J		20	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 266979

QC Batch: 9743 Analysis Method: EPA 6020B
 QC Batch Method: EPA 3005A Analysis Description: 6020B MET
 Associated Lab Samples: 266979001, 266979002, 266979003, 266979004, 266979005, 266979006, 266979007, 266979008, 266979009, 266979010, 266979011

METHOD BLANK: 44231 Matrix: Water
 Associated Lab Samples: 266979001, 266979002, 266979003, 266979004, 266979005, 266979006, 266979007, 266979008, 266979009, 266979010, 266979011

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Antimony	mg/L	ND	0.0030	0.00078	07/16/18 14:51	
Arsenic	mg/L	ND	0.0050	0.00057	07/16/18 14:51	
Barium	mg/L	ND	0.010	0.00078	07/16/18 14:51	
Beryllium	mg/L	ND	0.0030	0.000050	07/16/18 14:51	
Boron	mg/L	ND	0.040	0.0039	07/16/18 14:51	
Cadmium	mg/L	ND	0.0010	0.000093	07/16/18 14:51	
Calcium	mg/L	ND	0.50	0.014	07/16/18 14:51	
Chromium	mg/L	ND	0.010	0.0016	07/16/18 14:51	
Cobalt	mg/L	ND	0.010	0.00052	07/16/18 14:51	
Lead	mg/L	ND	0.0050	0.00027	07/16/18 14:51	
Lithium	mg/L	ND	0.050	0.00097	07/16/18 14:51	
Molybdenum	mg/L	ND	0.010	0.0019	07/16/18 14:51	
Selenium	mg/L	ND	0.010	0.0014	07/16/18 14:51	
Thallium	mg/L	ND	0.0010	0.00014	07/16/18 14:51	

LABORATORY CONTROL SAMPLE: 44232

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Antimony	mg/L	.1	0.10	104	80-120	
Arsenic	mg/L	.1	0.10	105	80-120	
Barium	mg/L	.1	0.098	98	80-120	
Beryllium	mg/L	.1	0.10	104	80-120	
Boron	mg/L	1	1.0	103	80-120	
Cadmium	mg/L	.1	0.10	104	80-120	
Calcium	mg/L	1	1.0	100	80-120	
Chromium	mg/L	.1	0.10	101	80-120	
Cobalt	mg/L	.1	0.10	101	80-120	
Lead	mg/L	.1	0.10	103	80-120	
Lithium	mg/L	.1	0.10	103	80-120	
Molybdenum	mg/L	.1	0.10	103	80-120	
Selenium	mg/L	.1	0.11	106	80-120	
Thallium	mg/L	.1	0.10	102	80-120	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 266979

Parameter	Units	MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 44233		44234		MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	Max RPD	RPD	Qual
		266979010 Result	MS Spike Conc.	MSD Spike Conc.	MS Result								
Antimony	mg/L	ND	.1	.1	0.11	0.11	110	112	75-125	2	20		
Arsenic	mg/L	ND	.1	.1	0.11	0.11	107	108	75-125	1	20		
Barium	mg/L	0.073	.1	.1	0.19	0.20	119	124	75-125	3	20		
Beryllium	mg/L	0.000076J	.1	.1	0.10	0.11	102	105	75-125	3	20		
Boron	mg/L	1.1	1	1	2.1	2.1	95	96	75-125	0	20		
Cadmium	mg/L	ND	.1	.1	0.11	0.11	108	106	75-125	2	20		
Calcium	mg/L	56.2	1	1	62.7	62.4	658	621	75-125	1	20	M6	
Chromium	mg/L	ND	.1	.1	0.11	0.11	108	107	75-125	1	20		
Cobalt	mg/L	ND	.1	.1	0.11	0.11	106	106	75-125	0	20		
Lead	mg/L	ND	.1	.1	0.11	0.10	105	104	75-125	1	20		
Lithium	mg/L	0.0019J	.1	.1	0.11	0.11	107	105	75-125	2	20		
Molybdenum	mg/L	ND	.1	.1	0.10	0.11	105	107	75-125	2	20		
Selenium	mg/L	ND	.1	.1	0.11	0.11	108	108	75-125	0	20		
Thallium	mg/L	ND	.1	.1	0.11	0.11	107	107	75-125	0	20		

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 266979

QC Batch: 9832 Analysis Method: SM 2540C
 QC Batch Method: SM 2540C Analysis Description: 2540C Total Dissolved Solids
 Associated Lab Samples: 266979001, 266979002, 266979003, 266979004, 266979005, 266979006, 266979007, 266979008, 266979009,
 266979010, 266979011

LABORATORY CONTROL SAMPLE: 44632

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	400	401	100	84-108	

SAMPLE DUPLICATE: 44633

Parameter	Units	267013001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	659	646	2	10	

SAMPLE DUPLICATE: 44888

Parameter	Units	266979008 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	ND	ND		10	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 266979

QC Batch:	9668	Analysis Method:	EPA 300.0
QC Batch Method:	EPA 300.0	Analysis Description:	300.0 IC Anions
Associated Lab Samples:	266979001, 266979002, 266979003, 266979004, 266979005, 266979006, 266979007, 266979008, 266979009, 266979010, 266979011		

METHOD BLANK:	43921	Matrix:	Water
Associated Lab Samples:	266979001, 266979002, 266979003, 266979004, 266979005, 266979006, 266979007, 266979008, 266979009, 266979010, 266979011		

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Chloride	mg/L	0.29	0.25	0.024	07/12/18 15:20	
Fluoride	mg/L	ND	0.30	0.029	07/12/18 15:20	
Sulfate	mg/L	ND	1.0	0.017	07/12/18 15:20	

LABORATORY CONTROL SAMPLE: 43922

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	10	10.0	100	90-110	
Fluoride	mg/L	10	10.2	102	90-110	
Sulfate	mg/L	10	9.9	99	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 43923 43924

Parameter	Units	266979001 Result	MS		MSD		MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
			Spike Conc.	MS Result	MSD Result	MSD Result						
Chloride	mg/L	1.9	10	10	12.0	12.0	100	101	90-110	0	15	
Fluoride	mg/L	0.082J	10	10	10.5	10.5	104	104	90-110	0	15	
Sulfate	mg/L	0.25J	10	10	10.2	10.1	99	99	90-110	0	15	

MATRIX SPIKE SAMPLE: 43925

Parameter	Units	266979002 Result	Spike Conc.	MS Result	MS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	2.5	10	12.5	100	90-110	
Fluoride	mg/L	ND	10	10.2	102	90-110	
Sulfate	mg/L	7.2	10	16.3	92	90-110	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: Plant McDonough Ash Ponds

Pace Project No.: 266979

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

ANALYTE QUALIFIERS

B Analyte was detected in the associated method blank.

M6 Matrix spike and Matrix spike duplicate recovery not evaluated against control limits due to sample dilution.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Ash Ponds
Pace Project No.: 266979

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
266979001	DGWA-70A	EPA 3005A	9743	EPA 6020B	9880
266979002	DGWA-71	EPA 3005A	9743	EPA 6020B	9880
266979003	DGWC-4	EPA 3005A	9743	EPA 6020B	9880
266979004	DGWC-5	EPA 3005A	9743	EPA 6020B	9880
266979005	DGWC-8	EPA 3005A	9743	EPA 6020B	9880
266979006	FD-1	EPA 3005A	9743	EPA 6020B	9880
266979007	FB-1	EPA 3005A	9743	EPA 6020B	9880
266979008	EB-1	EPA 3005A	9743	EPA 6020B	9880
266979009	DGWC-10	EPA 3005A	9743	EPA 6020B	9880
266979010	DGWC-11	EPA 3005A	9743	EPA 6020B	9880
266979011	DGWC-13	EPA 3005A	9743	EPA 6020B	9880
266979001	DGWA-70A	EPA 7470A	9654	EPA 7470A	9687
266979002	DGWA-71	EPA 7470A	9654	EPA 7470A	9687
266979003	DGWC-4	EPA 7470A	9654	EPA 7470A	9687
266979004	DGWC-5	EPA 7470A	9654	EPA 7470A	9687
266979005	DGWC-8	EPA 7470A	9654	EPA 7470A	9687
266979006	FD-1	EPA 7470A	9654	EPA 7470A	9687
266979007	FB-1	EPA 7470A	9654	EPA 7470A	9687
266979008	EB-1	EPA 7470A	9654	EPA 7470A	9687
266979009	DGWC-10	EPA 7470A	9654	EPA 7470A	9687
266979010	DGWC-11	EPA 7470A	9654	EPA 7470A	9687
266979011	DGWC-13	EPA 7470A	9654	EPA 7470A	9687
266979001	DGWA-70A	SM 2540C	9832		
266979002	DGWA-71	SM 2540C	9832		
266979003	DGWC-4	SM 2540C	9832		
266979004	DGWC-5	SM 2540C	9832		
266979005	DGWC-8	SM 2540C	9832		
266979006	FD-1	SM 2540C	9832		
266979007	FB-1	SM 2540C	9832		
266979008	EB-1	SM 2540C	9832		
266979009	DGWC-10	SM 2540C	9832		
266979010	DGWC-11	SM 2540C	9832		
266979011	DGWC-13	SM 2540C	9832		
266979001	DGWA-70A	EPA 300.0	9668		
266979002	DGWA-71	EPA 300.0	9668		
266979003	DGWC-4	EPA 300.0	9668		
266979004	DGWC-5	EPA 300.0	9668		
266979005	DGWC-8	EPA 300.0	9668		
266979006	FD-1	EPA 300.0	9668		
266979007	FB-1	EPA 300.0	9668		
266979008	EB-1	EPA 300.0	9668		
266979009	DGWC-10	EPA 300.0	9668		
266979010	DGWC-11	EPA 300.0	9668		
266979011	DGWC-13	EPA 300.0	9668		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CHAIN OF CUSTODY RECORD

CLIENT NAME: Georgia Power			CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185 Atlanta, GA 30308 404-506-7239			REPORT TO: Dawn Prell (Dawn_Prell@golder.com)			REQUESTED COMPLETION DATE: laburch@southernco.com			PROJECT NAME/STATE: Plant McDonough AP			PROJECT #: Phase II CCR		
CC: kiurinko@golder.com			PO #: laburch@southernco.com			ANALYSIS REQUESTED			CONTAINER TYPE: PRESERVATION			CONTAINER TYPE PRESERVATION					
Collection DATE	Collection TIME	MATRIX CODE*	C O M P	G R A B	SAMPLE IDENTIFICATION	Metals App. III & IV (EPA 6020/7470)	C, F, SO ₄ & TDS (EPA 3000 & SM 2540C)	P 7	P 3	P 3	P 7	P 3	P 3	P 3	P 3	P 3	
07/10/18	1100	GW	X	X	DGWA-70A	1	1	1	2	4	1	1	2	4	1	2	
07/10/18	0940	GW	X	X	DGWA-71	1	1	1	4	4	1	1	4	4	1	4	
07/10/18	0925	GW	X	X	DGWC-4	1	1	1	2	4	1	1	2	4	1	2	
07/10/18	1105	GW	X	X	DGWC-5	1	1	1	2	4	1	1	2	4	1	2	
07/10/18	1410	GW	X	X	DGWC-8	1	1	1	2	4	1	1	2	4	1	2	
07/10/18	-	GW	X	X	FD-1	1	1	1	2	4	1	1	2	4	1	2	
07/10/18	1150	W	X	X	FB-1	1	1	1	2	4	1	1	2	4	1	2	
07/10/18	1535	W	X	X	EB-1	1	1	1	2	4	1	1	2	4	1	2	
07/10/18	1250	GW	X	X	DGWC-10	1	1	1	2	4	1	1	2	4	1	2	
07/10/18	1500	GW	X	X	DGWC-11	1	1	1	2	4	1	1	2	4	1	2	
07/10/18	1500	GW	X	X	DGWC-13	1	1	1	2	4	1	1	2	4	1	2	

WO#: 266979

SAMPLED BY AND TITLE: Ben Hodges Field Lead	DATE/TIME: 7/10/18 1700	RELINQUISHED BY: Ben Hodges	DATE/TIME: 5/11/18 0815
RECEIVED BY: M. BAH	DATE/TIME: 7-11-18 8:20	RELINQUISHED BY: M. BAH	DATE/TIME: 7-11-18 10:45
RECEIVED BY LAB: Bahman	DATE/TIME: 7/11/18 1045	SAMPLE SHIPPED VIA: UPS	COURIER Not Coolers
Checked: Yes No NA	Temperature: Min: 1.1 Max:	CUSTOMER ID: Cooler ID:	CLIENT OTHER FS

July 10 2018 Plant McDonough COC Phase II CCR



Sample Condition Upon Receipt

Client Name: GPA Power

Project # _____

WO#: **266979**

Courier: Fed Ex UPS USPS Client Commercial Pace Other

Tracking #: _____

PM: **BM** Due Date: **07/18/18**

Custody Seal on Cooler/Box Present: yes no Seals intact: yes

CLIENT: **GAPower-CCR**

Packing Material: Bubble Wrap Bubble Bags None Other

Thermometer Used 83

Type of Ice: Wet Blue None

Samples on ice, cooling process has begun

Cooler Temperature 1.1

Biological Tissue is Frozen: Yes No

Date and Initials of person examining contents: 7/11/18 MR

Temp should be above freezing to 6°C

Comments: _____

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.		
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.		
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.		
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.		
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.		
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.		
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.		
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.		
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.		
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.		
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.		
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.		
-Includes date/time/ID/Analysis Matrix:	<u>GW</u>			
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.		
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed	Lot # of added preservative	
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.		
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.		
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.		
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A			
Pace Trip Blank Lot # (if purchased):	_____			

Client Notification/ Resolution:

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: _____

Field Data Required? Y N

Project Manager Review: _____ Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office i.e. out of hold, incorrect preservative, out of temp, incorrect containers.

August 08, 2018

Joju Abraham
Georgia Power - Coal Combustion Residuals
2480 Maner Road
Atlanta, GA 30339

RE: Project: Plant McDonough Ash Ponds
Pace Project No.: 266980

Dear Joju Abraham:

Enclosed are the analytical results for sample(s) received by the laboratory on July 11, 2018. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Betsy McDaniel
betsy.mcdaniel@pacelabs.com
(770)734-4200
Project Manager

Enclosures

cc: Kristen Jurinko, Golder Associates Inc.
Julie Lehrman, Golder Associates Inc.
Maria Padilla, Georgia Power
Dawn Prell, Golder Associates Inc.
Tim Richards, Golder Associates - Atlanta
Rebecca Thornton, Pace Analytical Atlanta



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: Plant McDonough Ash Ponds

Pace Project No.: 266980

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601

ANAB DOD-ELAP Rad Accreditation #: L2417

Alabama Certification #: 41590

Arizona Certification #: AZ0734

Arkansas Certification

California Certification #: 04222CA

Colorado Certification #: PA01547

Connecticut Certification #: PH-0694

Delaware Certification

EPA Region 4 DW Rad

Florida/TNI Certification #: E87683

Georgia Certification #: C040

Guam Certification

Hawaii Certification

Idaho Certification

Illinois Certification

Indiana Certification

Iowa Certification #: 391

Kansas/TNI Certification #: E-10358

Kentucky Certification #: KY90133

KY WW Permit #: KY0098221

KY WW Permit #: KY0000221

Louisiana DHH/TNI Certification #: LA180012

Louisiana DEQ/TNI Certification #: 4086

Maine Certification #: 2017020

Maryland Certification #: 308

Massachusetts Certification #: M-PA1457

Michigan/PADEP Certification #: 9991

Missouri Certification #: 235

Montana Certification #: Cert0082

Nebraska Certification #: NE-OS-29-14

Nevada Certification #: PA014572018-1

New Hampshire/TNI Certification #: 297617

New Jersey/TNI Certification #: PA051

New Mexico Certification #: PA01457

New York/TNI Certification #: 10888

North Carolina Certification #: 42706

North Dakota Certification #: R-190

Ohio EPA Rad Approval: #41249

Oregon/TNI Certification #: PA200002-010

Pennsylvania/TNI Certification #: 65-00282

Puerto Rico Certification #: PA01457

Rhode Island Certification #: 65-00282

South Dakota Certification

Tennessee Certification #: 02867

Texas/TNI Certification #: T104704188-17-3

Utah/TNI Certification #: PA014572017-9

USDA Soil Permit #: P330-17-00091

Vermont Dept. of Health: ID# VT-0282

Virgin Island/PADEP Certification

Virginia/VELAP Certification #: 9526

Washington Certification #: C868

West Virginia DEP Certification #: 143

West Virginia DHHR Certification #: 9964C

Wisconsin Approve List for Rad

Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: Plant McDonough Ash Ponds

Pace Project No.: 266980

Lab ID	Sample ID	Matrix	Date Collected	Date Received
266980001	DGWA-70A	Water	07/10/18 11:00	07/11/18 10:45
266980002	DGWA-71	Water	07/10/18 09:40	07/11/18 10:45
266980003	DGWC-4	Water	07/10/18 09:25	07/11/18 10:45
266980004	DGWC-5	Water	07/10/18 11:05	07/11/18 10:45
266980005	DGWC-8	Water	07/10/18 14:10	07/11/18 10:45
266980006	FD-1	Water	07/10/18 00:00	07/11/18 10:45
266980007	FB-1	Water	07/10/18 11:50	07/11/18 10:45
266980008	EB-1	Water	07/10/18 15:35	07/11/18 10:45
266980009	DGWC-10	Water	07/10/18 12:50	07/11/18 10:45
266980010	DGWC-11	Water	07/10/18 15:00	07/11/18 10:45
266980011	DGWC-13	Water	07/10/18 15:00	07/11/18 10:45

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds
Pace Project No.: 266980

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
266980001	DGWA-70A	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
266980002	DGWA-71	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
266980003	DGWC-4	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
266980004	DGWC-5	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
266980005	DGWC-8	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
266980006	FD-1	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
266980007	FB-1	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
266980008	EB-1	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
266980009	DGWC-10	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
266980010	DGWC-11	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
266980011	DGWC-13	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 266980

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.362 ± 0.166 (0.195) C:100% T:NA	pCi/L	07/24/18 08:23	13982-63-3	
Radium-228	EPA 9320	-0.0842 ± 0.333 (0.794) C:73% T:84%	pCi/L	08/01/18 15:00	15262-20-1	
Total Radium	Total Radium Calculation	0.362 ± 0.499 (0.989)	pCi/L	08/03/18 15:07	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 266980

Sample: DGWA-71 **Lab ID: 266980002** Collected: 07/10/18 09:40 Received: 07/11/18 10:45 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.324 ± 0.161 (0.203) C:94% T:NA	pCi/L	07/24/18 08:23	13982-63-3	
Radium-228	EPA 9320	0.102 ± 0.479 (1.09) C:71% T:65%	pCi/L	08/01/18 15:00	15262-20-1	
Total Radium	Total Radium Calculation	0.426 ± 0.640 (1.29)	pCi/L	08/03/18 15:07	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 266980

Sample: DGWC-4 **Lab ID: 266980003** Collected: 07/10/18 09:25 Received: 07/11/18 10:45 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.588 ± 0.225 (0.242) C:90% T:NA	pCi/L	07/24/18 08:23	13982-63-3	
Radium-228	EPA 9320	0.777 ± 0.459 (0.852) C:72% T:81%	pCi/L	08/01/18 15:00	15262-20-1	
Total Radium	Total Radium Calculation	1.37 ± 0.684 (1.09)	pCi/L	08/03/18 15:07	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 266980

Sample: DGWC-5 **Lab ID: 266980004** Collected: 07/10/18 11:05 Received: 07/11/18 10:45 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.357 ± 0.165 (0.188) C:99% T:NA	pCi/L	07/24/18 08:23	13982-63-3	
Radium-228	EPA 9320	0.677 ± 0.526 (1.06) C:78% T:76%	pCi/L	08/01/18 15:00	15262-20-1	
Total Radium	Total Radium Calculation	1.03 ± 0.691 (1.25)	pCi/L	08/03/18 15:07	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 266980

Sample: DGWC-8 **Lab ID: 266980005** Collected: 07/10/18 14:10 Received: 07/11/18 10:45 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.363 ± 0.167 (0.189) C:93% T:NA	pCi/L	07/24/18 08:23	13982-63-3	
Radium-228	EPA 9320	-0.0736 ± 0.355 (0.844) C:73% T:84%	pCi/L	08/01/18 15:00	15262-20-1	
Total Radium	Total Radium Calculation	0.363 ± 0.522 (1.03)	pCi/L	08/03/18 15:07	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 266980

Sample: FD-1 **Lab ID: 266980006** Collected: 07/10/18 00:00 Received: 07/11/18 10:45 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.374 ± 0.188 (0.266) C:89% T:NA	pCi/L	07/24/18 08:23	13982-63-3	
Radium-228	EPA 9320	0.216 ± 0.387 (0.847) C:72% T:76%	pCi/L	08/01/18 15:00	15262-20-1	
Total Radium	Total Radium Calculation	0.590 ± 0.575 (1.11)	pCi/L	08/03/18 15:07	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 266980

Sample: FB-1 **Lab ID: 266980007** Collected: 07/10/18 11:50 Received: 07/11/18 10:45 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.104 ± 0.110 (0.216) C:100% T:NA	pCi/L	07/24/18 08:23	13982-63-3	
Radium-228	EPA 9320	0.226 ± 0.449 (0.988) C:74% T:70%	pCi/L	08/01/18 15:00	15262-20-1	
Total Radium	Total Radium Calculation	0.330 ± 0.559 (1.20)	pCi/L	08/03/18 15:07	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 266980

Sample: EB-1 **Lab ID: 266980008** Collected: 07/10/18 15:35 Received: 07/11/18 10:45 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.275 ± 0.150 (0.209) C:97% T:NA	pCi/L	07/24/18 08:23	13982-63-3	
Radium-228	EPA 9320	-0.0851 ± 0.437 (1.04) C:69% T:67%	pCi/L	08/01/18 15:00	15262-20-1	
Total Radium	Total Radium Calculation	0.275 ± 0.587 (1.25)	pCi/L	08/03/18 15:07	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 266980

Sample: DGWC-10 **Lab ID: 266980009** Collected: 07/10/18 12:50 Received: 07/11/18 10:45 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.685 ± 0.233 (0.198) C:97% T:NA	pCi/L	07/24/18 08:23	13982-63-3	
Radium-228	EPA 9320	0.960 ± 0.442 (0.737) C:72% T:85%	pCi/L	08/01/18 15:00	15262-20-1	
Total Radium	Total Radium Calculation	1.65 ± 0.675 (0.935)	pCi/L	08/03/18 15:07	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 266980

Sample: DGWC-11 **Lab ID: 266980010** Collected: 07/10/18 15:00 Received: 07/11/18 10:45 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.277 ± 0.174 (0.292) C:95% T:NA	pCi/L	07/24/18 08:54	13982-63-3	
Radium-228	EPA 9320	0.218 ± 0.423 (0.928) C:76% T:79%	pCi/L	08/01/18 15:01	15262-20-1	
Total Radium	Total Radium Calculation	0.495 ± 0.597 (1.22)	pCi/L	08/03/18 15:07	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 266980

Sample: DGWC-13 **Lab ID: 266980011** Collected: 07/10/18 15:00 Received: 07/11/18 10:45 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.327 ± 0.164 (0.231) C:100% T:NA	pCi/L	07/24/18 08:53	13982-63-3	
Radium-228	EPA 9320	0.419 ± 0.389 (0.791) C:71% T:79%	pCi/L	08/01/18 15:01	15262-20-1	
Total Radium	Total Radium Calculation	0.746 ± 0.553 (1.02)	pCi/L	08/03/18 15:07	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 266980

QC Batch:	306308	Analysis Method:	EPA 9320
QC Batch Method:	EPA 9320	Analysis Description:	9320 Radium 228
Associated Lab Samples:	266980001, 266980002, 266980003, 266980004, 266980005, 266980006, 266980007, 266980008, 266980009, 266980010, 266980011		

METHOD BLANK:	1497598	Matrix:	Water
Associated Lab Samples:	266980001, 266980002, 266980003, 266980004, 266980005, 266980006, 266980007, 266980008, 266980009, 266980010, 266980011		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.0802 ± 0.324 (0.736) C:75% T:82%	pCi/L	08/01/18 15:00	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 266980

QC Batch:	306307	Analysis Method:	EPA 9315
QC Batch Method:	EPA 9315	Analysis Description:	9315 Total Radium
Associated Lab Samples:	266980001, 266980002, 266980003, 266980004, 266980005, 266980006, 266980007, 266980008, 266980009, 266980010, 266980011		

METHOD BLANK:	1497597	Matrix:	Water
Associated Lab Samples:	266980001, 266980002, 266980003, 266980004, 266980005, 266980006, 266980007, 266980008, 266980009, 266980010, 266980011		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.203 ± 0.124 (0.168) C:102% T:NA	pCi/L	07/24/18 08:23	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: Plant McDonough Ash Ponds

Pace Project No.: 266980

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

LABORATORIES

PASI-PA Pace Analytical Services - Greensburg

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Ash Ponds

Pace Project No.: 266980

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
266980001	DGWA-70A	EPA 9315	306307		
266980002	DGWA-71	EPA 9315	306307		
266980003	DGWC-4	EPA 9315	306307		
266980004	DGWC-5	EPA 9315	306307		
266980005	DGWC-8	EPA 9315	306307		
266980006	FD-1	EPA 9315	306307		
266980007	FB-1	EPA 9315	306307		
266980008	EB-1	EPA 9315	306307		
266980009	DGWC-10	EPA 9315	306307		
266980010	DGWC-11	EPA 9315	306307		
266980011	DGWC-13	EPA 9315	306307		
266980001	DGWA-70A	EPA 9320	306308		
266980002	DGWA-71	EPA 9320	306308		
266980003	DGWC-4	EPA 9320	306308		
266980004	DGWC-5	EPA 9320	306308		
266980005	DGWC-8	EPA 9320	306308		
266980006	FD-1	EPA 9320	306308		
266980007	FB-1	EPA 9320	306308		
266980008	EB-1	EPA 9320	306308		
266980009	DGWC-10	EPA 9320	306308		
266980010	DGWC-11	EPA 9320	306308		
266980011	DGWC-13	EPA 9320	306308		
266980001	DGWA-70A	Total Radium Calculation	308377		
266980002	DGWA-71	Total Radium Calculation	308377		
266980003	DGWC-4	Total Radium Calculation	308377		
266980004	DGWC-5	Total Radium Calculation	308377		
266980005	DGWC-8	Total Radium Calculation	308377		
266980006	FD-1	Total Radium Calculation	308377		
266980007	FB-1	Total Radium Calculation	308377		
266980008	EB-1	Total Radium Calculation	308377		
266980009	DGWC-10	Total Radium Calculation	308377		
266980010	DGWC-11	Total Radium Calculation	308377		
266980011	DGWC-13	Total Radium Calculation	308377		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

PAGE: 1 OF 1

CHAIN OF CUSTODY RECORD

CLIENT NAME:		ANALYSIS REQUESTED		CONTAINER TYPE		PRESERVATION	
Georgia Power		P P P P		P - PLASTIC		1 - HCl, 56°C	
CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER:		P P P P		A - AMBER GLASS		2 - H ₂ SO ₄ , 56°C	
241 Ralph McGill Blvd SE B10185		3 7 3		G - CLEAR GLASS		3 - HNO ₃	
Atlanta, GA 30308		# of		V - VOA VIAL		4 - NaOH, 56°C	
404-508-7239		CONTAINERS		S - STERILE		5 - NaOH/ZnAc, 56°C	
REPORT TO:				O - OTHER		6 - Na ₂ S ₂ O ₃ , 56°C	
Dawn Prell (Dawn_Prell@golder.com)						7 - 56°C not frozen	
REQUESTED COMPLETION DATE:							
PO #:							
laburch@southernco.com							
PROJECT NAME/STATE:							
Plant McDonough AP							
PROJECT #:							
Phase II CCR							
Collection DATE	Collection TIME	MATRIX CODE*	C O M P	G R A B	SAMPLE IDENTIFICATION	RELINQUISHED BY:	DATE/TIME:
07/10/18	1100	GW	X	X	DGWA-70A	Ben Hodges	7/10/18 1700
07/10/18	0940	GW	X	X	DGWA-71	M. BAH	7-11-18 8:20
07/10/18	0925	GW	X	X	DGWC-4	M. Bahman	7/11/18 1045
07/10/18	1105	GW	X	X	DGWC-5		
07/10/18	1410	GW	X	X	DGWC-8		
07/10/18	-	GW	X	X	FD-1		
07/10/18	1150	W	X	X	FB-1		
07/10/18	1535	W	X	X	EB-1		
07/10/18	1250	GW	X	X	DGWC-10		
07/10/18	1500	GW	X	X	DGWC-11		
07/10/18	1500	GW	X	X	DGWC-13		
SAMPLED BY AND TITLE:		Field Lead		RELINQUISHED BY: Ben Hodges		DATE/TIME: 7/11/18 0815	
RECEIVED BY: M. BAH		Temperature: 7-11-18 1045		RELINQUISHED BY: M. BAH		DATE/TIME: 7-11-18 1045	
RECEIVED BY: M. Bahman		Temperature: Min: 11 Max: 11		COURIER: M. BAH		CLIENT: OTHER FS	
Checked: Yes No NA		Intact Broken Not Present		Cooler ID:		Entered into JMS: Tracking #:	

WO#: 266980

266980

FOR LAB USE ONLY
 LAB #:
 DATE/TIME: 7-11-18 0815
 DATE/TIME: 7-11-18 1045

July 10 2018 Plant McDonough COC Phase II CCR

Sample Condition Upon Receipt

Face Analytical

Client Name: GAP Power

Project # _____

Courier: Fed Ex UPS USPS Client Commercial Pace Other

WO#: 266980

Tracking #: _____

PM: **BM**

Due Date: **08/08/18**

Custody Seal on Cooler/Box Present: yes no Seals intact: yes

CLIENT: **GAPower-CCR**

Packing Material: Bubble Wrap Bubble Bags None Other

Thermometer Used 8.3

Type of Ice: Wet Blue None

Samples on ice, cooling process has begun

Cooler Temperature 1.1

Biological Tissue is Frozen: Yes No

Date and Initials of person examining contents: 7/11/18 MK

Temp should be above freezing to 6°C

Comments: _____

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.	
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.	
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.	
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.	
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.	
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.	
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.	
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.	
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.	
Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.	
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.	
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.	
Includes date/time/ID/Analysis Matrix:	<u>GW</u>		
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.	
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed	Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.	
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.	
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.	
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A		
Pace Trip Blank Lot # (if purchased):	_____		

Client Notification/ Resolution:

Person Contacted: _____ Date/Time _____

Field Data Required? Y N

Comments/ Resolution: _____

Project Manager Review: _____

Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

July 21, 2018

Joju Abraham
Georgia Power - Coal Combustion Residuals
2480 Maner Road
Atlanta, GA 30339

RE: Project: Plant McDonough Ash Ponds
Pace Project No.: 267122

Dear Joju Abraham:

Enclosed are the analytical results for sample(s) received by the laboratory on July 13, 2018. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Betsy McDaniel
betsy.mcdaniel@pacelabs.com
(770)734-4200
Project Manager

Enclosures

cc: Kristen Jurinko, Golder Associates Inc.
Julie Lehrman, Golder Associates Inc.
Maria Padilla, Georgia Power
Dawn Prell, Golder Associates Inc.
Tim Richards, Golder Associates - Atlanta
Rebecca Thornton, Pace Analytical Atlanta



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: Plant McDonough Ash Ponds

Pace Project No.: 267122

Atlanta Certification IDs

110 Technology Parkway Peachtree Corners, GA 30092

Florida DOH Certification #: E87315

Georgia DW Inorganics Certification #: 812

Georgia DW Microbiology Certification #: 812

North Carolina Certification #: 381

South Carolina Certification #: 98011001

Texas Certification #: T104704397-08-TX

Virginia Certification #: 460204

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: Plant McDonough Ash Ponds
Pace Project No.: 267122

Lab ID	Sample ID	Matrix	Date Collected	Date Received
267122001	DGWA-53	Water	07/12/18 08:40	07/13/18 11:10
267122002	DGWC-37	Water	07/12/18 13:35	07/13/18 11:10
267122003	DGWC-38	Water	07/12/18 13:40	07/13/18 11:10
267122004	DGWC-39	Water	07/12/18 11:30	07/13/18 11:10
267122005	DGWC-40	Water	07/12/18 12:40	07/13/18 11:10
267122006	FD-3	Water	07/12/18 00:00	07/13/18 11:10
267122007	FB-3	Water	07/12/18 10:25	07/13/18 11:10
267122008	EB-3	Water	07/12/18 14:00	07/13/18 11:10
267122009	DGWC-47	Water	07/12/18 08:45	07/13/18 11:10
267122010	DGWC-48	Water	07/12/18 10:55	07/13/18 11:10
267122011	DGWC-23	Water	07/12/18 10:15	07/13/18 11:10
267122012	DGWC-22	Water	07/12/18 08:40	07/13/18 11:10

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds
Pace Project No.: 267122

Lab ID	Sample ID	Method	Analysts	Analytes Reported
267122001	DGWA-53	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
267122002	DGWC-37	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
267122003	DGWC-38	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
267122004	DGWC-39	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
267122005	DGWC-40	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
267122006	FD-3	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
267122007	FB-3	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
267122008	EB-3	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
267122009	DGWC-47	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
267122010	DGWC-48	EPA 6020B	CSW	14

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds
Pace Project No.: 267122

Lab ID	Sample ID	Method	Analysts	Analytes Reported
267122011	DGWC-23	EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
		EPA 6020B	CSW	14
		EPA 7470A	DRB	1
267122012	DGWC-22	SM 2540C	JPT	1
		EPA 300.0	RLC	3
		EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 267122

Sample: DGWA-53		Lab ID: 267122001		Collected: 07/12/18 08:40		Received: 07/13/18 11:10		Matrix: Water	
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual
			Limit	MDL	DF				
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	mg/L	0.0030	0.00078	1	07/17/18 11:31	07/19/18 20:59	7440-36-0	
Arsenic	ND	mg/L	0.0050	0.00057	1	07/17/18 11:31	07/19/18 20:59	7440-38-2	
Barium	0.18	mg/L	0.050	0.0039	5	07/17/18 11:31	07/20/18 13:34	7440-39-3	
Beryllium	ND	mg/L	0.0030	0.000050	1	07/17/18 11:31	07/19/18 20:59	7440-41-7	
Boron	0.076	mg/L	0.040	0.0039	1	07/17/18 11:31	07/19/18 20:59	7440-42-8	
Cadmium	0.00013J	mg/L	0.0010	0.000093	1	07/17/18 11:31	07/19/18 20:59	7440-43-9	
Calcium	34.7	mg/L	2.5	0.069	5	07/17/18 11:31	07/20/18 13:34	7440-70-2	
Chromium	ND	mg/L	0.010	0.0016	1	07/17/18 11:31	07/19/18 20:59	7440-47-3	
Cobalt	0.024	mg/L	0.010	0.00052	1	07/17/18 11:31	07/19/18 20:59	7440-48-4	
Lead	ND	mg/L	0.0050	0.00027	1	07/17/18 11:31	07/19/18 20:59	7439-92-1	
Lithium	0.0084J	mg/L	0.050	0.00097	1	07/17/18 11:31	07/19/18 20:59	7439-93-2	
Molybdenum	0.034	mg/L	0.010	0.0019	1	07/17/18 11:31	07/19/18 20:59	7439-98-7	
Selenium	ND	mg/L	0.010	0.0014	1	07/17/18 11:31	07/19/18 20:59	7782-49-2	
Thallium	ND	mg/L	0.0010	0.00014	1	07/17/18 11:31	07/19/18 20:59	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	ND	mg/L	0.00050	0.000036	1	07/18/18 10:37	07/18/18 17:30	7439-97-6	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	198	mg/L	25.0	10.0	1		07/17/18 12:13		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	2.2	mg/L	0.25	0.024	1		07/17/18 21:18	16887-00-6	
Fluoride	0.071J	mg/L	0.30	0.029	1		07/17/18 21:18	16984-48-8	
Sulfate	8.0	mg/L	1.0	0.017	1		07/17/18 21:18	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 267122

Sample: DGWC-37		Lab ID: 267122002		Collected: 07/12/18 13:35		Received: 07/13/18 11:10		Matrix: Water	
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual
			Limit	MDL	DF				
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	mg/L	0.0030	0.00078	1	07/17/18 11:31	07/19/18 21:10	7440-36-0	
Arsenic	ND	mg/L	0.0050	0.00057	1	07/17/18 11:31	07/19/18 21:10	7440-38-2	
Barium	0.11	mg/L	0.010	0.00078	1	07/17/18 11:31	07/19/18 21:10	7440-39-3	
Beryllium	0.000070J	mg/L	0.0030	0.000050	1	07/17/18 11:31	07/19/18 21:10	7440-41-7	
Boron	1.5	mg/L	0.040	0.0039	1	07/17/18 11:31	07/19/18 21:10	7440-42-8	
Cadmium	ND	mg/L	0.0010	0.000093	1	07/17/18 11:31	07/19/18 21:10	7440-43-9	
Calcium	59.1	mg/L	25.0	0.69	50	07/17/18 11:31	07/19/18 21:16	7440-70-2	
Chromium	ND	mg/L	0.010	0.0016	1	07/17/18 11:31	07/19/18 21:10	7440-47-3	
Cobalt	ND	mg/L	0.010	0.00052	1	07/17/18 11:31	07/19/18 21:10	7440-48-4	
Lead	ND	mg/L	0.0050	0.00027	1	07/17/18 11:31	07/19/18 21:10	7439-92-1	
Lithium	0.0028J	mg/L	0.050	0.00097	1	07/17/18 11:31	07/19/18 21:10	7439-93-2	
Molybdenum	ND	mg/L	0.010	0.0019	1	07/17/18 11:31	07/19/18 21:10	7439-98-7	
Selenium	ND	mg/L	0.010	0.0014	1	07/17/18 11:31	07/19/18 21:10	7782-49-2	
Thallium	ND	mg/L	0.0010	0.00014	1	07/17/18 11:31	07/19/18 21:10	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	0.000044J	mg/L	0.00050	0.000036	1	07/18/18 10:37	07/18/18 17:32	7439-97-6	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	290	mg/L	25.0	10.0	1		07/17/18 12:13		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	5.8	mg/L	0.25	0.024	1		07/17/18 21:38	16887-00-6	
Fluoride	0.32	mg/L	0.30	0.029	1		07/17/18 21:38	16984-48-8	
Sulfate	89.2	mg/L	5.0	0.085	5		07/20/18 14:03	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 267122

Sample: DGWC-38		Lab ID: 267122003		Collected: 07/12/18 13:40		Received: 07/13/18 11:10		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	07/17/18 11:31	07/19/18 21:22	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	07/17/18 11:31	07/19/18 21:22	7440-38-2		
Barium	0.034	mg/L	0.010	0.00078	1	07/17/18 11:31	07/19/18 21:22	7440-39-3		
Beryllium	ND	mg/L	0.0030	0.000050	1	07/17/18 11:31	07/19/18 21:22	7440-41-7		
Boron	2.8	mg/L	0.040	0.0039	1	07/17/18 11:31	07/19/18 21:22	7440-42-8		
Cadmium	0.00024J	mg/L	0.0010	0.000093	1	07/17/18 11:31	07/19/18 21:22	7440-43-9		
Calcium	86.7	mg/L	25.0	0.69	50	07/17/18 11:31	07/19/18 21:28	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	07/17/18 11:31	07/19/18 21:22	7440-47-3		
Cobalt	0.0015J	mg/L	0.010	0.00052	1	07/17/18 11:31	07/19/18 21:22	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	07/17/18 11:31	07/19/18 21:22	7439-92-1		
Lithium	0.0034J	mg/L	0.050	0.00097	1	07/17/18 11:31	07/19/18 21:22	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	07/17/18 11:31	07/19/18 21:22	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	07/17/18 11:31	07/19/18 21:22	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	07/17/18 11:31	07/19/18 21:22	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	0.000040J	mg/L	0.00050	0.000036	1	07/18/18 10:37	07/18/18 18:42	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	478	mg/L	25.0	10.0	1		07/17/18 12:13			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	8.0	mg/L	0.25	0.024	1		07/17/18 21:59	16887-00-6		
Fluoride	0.23J	mg/L	0.30	0.029	1		07/17/18 21:59	16984-48-8		
Sulfate	256	mg/L	10.0	0.17	10		07/20/18 14:24	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 267122

Sample: DGWC-39		Lab ID: 267122004		Collected: 07/12/18 11:30		Received: 07/13/18 11:10		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	07/17/18 11:31	07/19/18 21:33	7440-36-0		
Arsenic	0.00057J	mg/L	0.0050	0.00057	1	07/17/18 11:31	07/19/18 21:33	7440-38-2		
Barium	0.094	mg/L	0.010	0.00078	1	07/17/18 11:31	07/19/18 21:33	7440-39-3		
Beryllium	ND	mg/L	0.0030	0.000050	1	07/17/18 11:31	07/19/18 21:33	7440-41-7		
Boron	3.0	mg/L	0.040	0.0039	1	07/17/18 11:31	07/19/18 21:33	7440-42-8		
Cadmium	ND	mg/L	0.0010	0.000093	1	07/17/18 11:31	07/19/18 21:33	7440-43-9		
Calcium	89.8	mg/L	25.0	0.69	50	07/17/18 11:31	07/19/18 21:39	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	07/17/18 11:31	07/19/18 21:33	7440-47-3		
Cobalt	0.0059J	mg/L	0.010	0.00052	1	07/17/18 11:31	07/19/18 21:33	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	07/17/18 11:31	07/19/18 21:33	7439-92-1		
Lithium	ND	mg/L	0.050	0.00097	1	07/17/18 11:31	07/19/18 21:33	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	07/17/18 11:31	07/19/18 21:33	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	07/17/18 11:31	07/19/18 21:33	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	07/17/18 11:31	07/19/18 21:33	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	07/18/18 10:37	07/18/18 18:45	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	463	mg/L	25.0	10.0	1		07/17/18 12:13			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	7.7	mg/L	0.25	0.024	1		07/17/18 22:19	16887-00-6		
Fluoride	0.13J	mg/L	0.30	0.029	1		07/17/18 22:19	16984-48-8		
Sulfate	169	mg/L	10.0	0.17	10		07/20/18 14:44	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 267122

Sample: DGWC-40		Lab ID: 267122005		Collected: 07/12/18 12:40		Received: 07/13/18 11:10		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	07/17/18 11:31	07/19/18 21:56	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	07/17/18 11:31	07/19/18 21:56	7440-38-2		
Barium	0.018	mg/L	0.010	0.00078	1	07/17/18 11:31	07/19/18 21:56	7440-39-3		
Beryllium	0.0032	mg/L	0.0030	0.000050	1	07/17/18 11:31	07/19/18 21:56	7440-41-7		
Boron	0.92	mg/L	0.040	0.0039	1	07/17/18 11:31	07/19/18 21:56	7440-42-8		
Cadmium	0.00087J	mg/L	0.0010	0.000093	1	07/17/18 11:31	07/19/18 21:56	7440-43-9		
Calcium	47.1	mg/L	25.0	0.69	50	07/17/18 11:31	07/19/18 22:02	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	07/17/18 11:31	07/19/18 21:56	7440-47-3		
Cobalt	0.044	mg/L	0.010	0.00052	1	07/17/18 11:31	07/19/18 21:56	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	07/17/18 11:31	07/19/18 21:56	7439-92-1		
Lithium	0.0022J	mg/L	0.050	0.00097	1	07/17/18 11:31	07/19/18 21:56	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	07/17/18 11:31	07/19/18 21:56	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	07/17/18 11:31	07/19/18 21:56	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	07/17/18 11:31	07/19/18 21:56	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	0.000045J	mg/L	0.00050	0.000036	1	07/18/18 10:37	07/18/18 18:47	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	365	mg/L	25.0	10.0	1		07/17/18 12:13			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	19.9	mg/L	0.25	0.024	1		07/17/18 22:40	16887-00-6		
Fluoride	0.57	mg/L	0.30	0.029	1		07/17/18 22:40	16984-48-8		
Sulfate	222	mg/L	10.0	0.17	10		07/20/18 15:05	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 267122

Sample: FD-3		Lab ID: 267122006		Collected: 07/12/18 00:00		Received: 07/13/18 11:10		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	07/17/18 11:31	07/19/18 22:08	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	07/17/18 11:31	07/19/18 22:08	7440-38-2		
Barium	0.032	mg/L	0.010	0.00078	1	07/17/18 11:31	07/19/18 22:08	7440-39-3		
Beryllium	ND	mg/L	0.0030	0.000050	1	07/17/18 11:31	07/19/18 22:08	7440-41-7		
Boron	2.6	mg/L	0.040	0.0039	1	07/17/18 11:31	07/19/18 22:08	7440-42-8		
Cadmium	0.00019J	mg/L	0.0010	0.000093	1	07/17/18 11:31	07/19/18 22:08	7440-43-9		
Calcium	80.7	mg/L	25.0	0.69	50	07/17/18 11:31	07/19/18 22:13	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	07/17/18 11:31	07/19/18 22:08	7440-47-3		
Cobalt	0.0014J	mg/L	0.010	0.00052	1	07/17/18 11:31	07/19/18 22:08	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	07/17/18 11:31	07/19/18 22:08	7439-92-1		
Lithium	0.0032J	mg/L	0.050	0.00097	1	07/17/18 11:31	07/19/18 22:08	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	07/17/18 11:31	07/19/18 22:08	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	07/17/18 11:31	07/19/18 22:08	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	07/17/18 11:31	07/19/18 22:08	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	0.000042J	mg/L	0.00050	0.000036	1	07/18/18 10:37	07/18/18 18:50	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	511	mg/L	25.0	10.0	1		07/17/18 12:14			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	8.0	mg/L	0.25	0.024	1		07/18/18 00:23	16887-00-6		
Fluoride	0.23J	mg/L	0.30	0.029	1		07/18/18 00:23	16984-48-8		
Sulfate	253	mg/L	10.0	0.17	10		07/20/18 15:25	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 267122

Sample: FB-3		Lab ID: 267122007		Collected: 07/12/18 10:25		Received: 07/13/18 11:10		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	mg/L	0.0030	0.00078	1	07/17/18 11:24	07/19/18 19:08	7440-36-0	
Arsenic	ND	mg/L	0.0050	0.00057	1	07/17/18 11:24	07/19/18 19:08	7440-38-2	
Barium	ND	mg/L	0.010	0.00078	1	07/17/18 11:24	07/19/18 19:08	7440-39-3	
Beryllium	ND	mg/L	0.0030	0.000050	1	07/17/18 11:24	07/19/18 19:08	7440-41-7	
Boron	0.0069J	mg/L	0.040	0.0039	1	07/17/18 11:24	07/19/18 19:08	7440-42-8	
Cadmium	0.00017J	mg/L	0.0010	0.000093	1	07/17/18 11:24	07/19/18 19:08	7440-43-9	
Calcium	0.021J	mg/L	0.50	0.014	1	07/17/18 11:24	07/19/18 19:08	7440-70-2	
Chromium	ND	mg/L	0.010	0.0016	1	07/17/18 11:24	07/19/18 19:08	7440-47-3	
Cobalt	ND	mg/L	0.010	0.00052	1	07/17/18 11:24	07/19/18 19:08	7440-48-4	
Lead	ND	mg/L	0.0050	0.00027	1	07/17/18 11:24	07/19/18 19:08	7439-92-1	
Lithium	ND	mg/L	0.050	0.00097	1	07/17/18 11:24	07/19/18 19:08	7439-93-2	
Molybdenum	ND	mg/L	0.010	0.0019	1	07/17/18 11:24	07/19/18 19:08	7439-98-7	
Selenium	ND	mg/L	0.010	0.0014	1	07/17/18 11:24	07/19/18 19:08	7782-49-2	
Thallium	ND	mg/L	0.0010	0.00014	1	07/17/18 11:24	07/19/18 19:08	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	ND	mg/L	0.00050	0.000036	1	07/18/18 10:37	07/18/18 18:52	7439-97-6	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	ND	mg/L	25.0	10.0	1		07/17/18 12:14		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	0.13J	mg/L	0.25	0.024	1		07/18/18 00:44	16887-00-6	B
Fluoride	ND	mg/L	0.30	0.029	1		07/18/18 00:44	16984-48-8	
Sulfate	ND	mg/L	1.0	0.017	1		07/18/18 00:44	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 267122

Sample: EB-3		Lab ID: 267122008		Collected: 07/12/18 14:00		Received: 07/13/18 11:10		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	07/17/18 11:24	07/19/18 19:14	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	07/17/18 11:24	07/19/18 19:14	7440-38-2		
Barium	ND	mg/L	0.010	0.00078	1	07/17/18 11:24	07/19/18 19:14	7440-39-3		
Beryllium	ND	mg/L	0.0030	0.000050	1	07/17/18 11:24	07/19/18 19:14	7440-41-7		
Boron	0.0056J	mg/L	0.040	0.0039	1	07/17/18 11:24	07/19/18 19:14	7440-42-8		
Cadmium	ND	mg/L	0.0010	0.000093	1	07/17/18 11:24	07/19/18 19:14	7440-43-9		
Calcium	0.071J	mg/L	0.50	0.014	1	07/17/18 11:24	07/19/18 19:14	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	07/17/18 11:24	07/19/18 19:14	7440-47-3		
Cobalt	ND	mg/L	0.010	0.00052	1	07/17/18 11:24	07/19/18 19:14	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	07/17/18 11:24	07/19/18 19:14	7439-92-1		
Lithium	ND	mg/L	0.050	0.00097	1	07/17/18 11:24	07/19/18 19:14	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	07/17/18 11:24	07/19/18 19:14	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	07/17/18 11:24	07/19/18 19:14	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	07/17/18 11:24	07/19/18 19:14	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	07/18/18 10:37	07/18/18 18:54	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	14.0J	mg/L	25.0	10.0	1		07/17/18 12:14			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	0.12J	mg/L	0.25	0.024	1		07/18/18 01:25	16887-00-6	B	
Fluoride	ND	mg/L	0.30	0.029	1		07/18/18 01:25	16984-48-8		
Sulfate	ND	mg/L	1.0	0.017	1		07/18/18 01:25	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 267122

Sample: DGWC-47		Lab ID: 267122009		Collected: 07/12/18 08:45		Received: 07/13/18 11:10		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	07/17/18 11:24	07/19/18 19:19	7440-36-0		
Arsenic	0.0023J	mg/L	0.0050	0.00057	1	07/17/18 11:24	07/19/18 19:19	7440-38-2		
Barium	0.015	mg/L	0.010	0.00078	1	07/17/18 11:24	07/19/18 19:19	7440-39-3		
Beryllium	0.013	mg/L	0.0030	0.000050	1	07/17/18 11:24	07/19/18 19:19	7440-41-7		
Boron	0.26	mg/L	0.040	0.0039	1	07/17/18 11:24	07/19/18 19:19	7440-42-8		
Cadmium	0.0021	mg/L	0.0010	0.000093	1	07/17/18 11:24	07/19/18 19:19	7440-43-9		
Calcium	41.6	mg/L	25.0	0.69	50	07/17/18 11:24	07/19/18 19:25	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	07/17/18 11:24	07/19/18 19:19	7440-47-3		
Cobalt	0.36	mg/L	0.010	0.00052	1	07/17/18 11:24	07/19/18 19:19	7440-48-4		
Lead	0.0010J	mg/L	0.0050	0.00027	1	07/17/18 11:24	07/19/18 19:19	7439-92-1		
Lithium	0.073	mg/L	0.050	0.00097	1	07/17/18 11:24	07/19/18 19:19	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	07/17/18 11:24	07/19/18 19:19	7439-98-7		
Selenium	0.015	mg/L	0.010	0.0014	1	07/17/18 11:24	07/19/18 19:19	7782-49-2		
Thallium	0.00031J	mg/L	0.0010	0.00014	1	07/17/18 11:24	07/19/18 19:19	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	07/18/18 10:37	07/18/18 18:57	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	372	mg/L	25.0	10.0	1		07/17/18 12:14			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	9.5	mg/L	0.25	0.024	1		07/18/18 01:46	16887-00-6		
Fluoride	0.96	mg/L	0.30	0.029	1		07/18/18 01:46	16984-48-8		
Sulfate	240	mg/L	10.0	0.17	10		07/20/18 15:46	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 267122

Sample: DGWC-48		Lab ID: 267122010		Collected: 07/12/18 10:55		Received: 07/13/18 11:10		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	07/17/18 11:24	07/19/18 19:31	7440-36-0		
Arsenic	0.0015J	mg/L	0.0050	0.00057	1	07/17/18 11:24	07/19/18 19:31	7440-38-2		
Barium	0.013	mg/L	0.010	0.00078	1	07/17/18 11:24	07/19/18 19:31	7440-39-3		
Beryllium	0.0086	mg/L	0.0030	0.000050	1	07/17/18 11:24	07/19/18 19:31	7440-41-7		
Boron	0.82	mg/L	0.040	0.0039	1	07/17/18 11:24	07/19/18 19:31	7440-42-8		
Cadmium	0.0032	mg/L	0.0010	0.000093	1	07/17/18 11:24	07/19/18 19:31	7440-43-9		
Calcium	89.1	mg/L	25.0	0.69	50	07/17/18 11:24	07/19/18 19:37	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	07/17/18 11:24	07/19/18 19:31	7440-47-3		
Cobalt	0.46	mg/L	0.010	0.00052	1	07/17/18 11:24	07/19/18 19:31	7440-48-4		
Lead	0.0014J	mg/L	0.0050	0.00027	1	07/17/18 11:24	07/19/18 19:31	7439-92-1		
Lithium	0.12	mg/L	0.050	0.00097	1	07/17/18 11:24	07/19/18 19:31	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	07/17/18 11:24	07/19/18 19:31	7439-98-7		
Selenium	0.013	mg/L	0.010	0.0014	1	07/17/18 11:24	07/19/18 19:31	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	07/17/18 11:24	07/19/18 19:31	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	07/18/18 10:37	07/18/18 18:59	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	705	mg/L	25.0	10.0	1		07/17/18 12:14			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	11.7	mg/L	0.25	0.024	1		07/18/18 02:07	16887-00-6		
Fluoride	0.65	mg/L	0.30	0.029	1		07/18/18 02:07	16984-48-8		
Sulfate	409	mg/L	10.0	0.17	10		07/20/18 16:07	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 267122

Sample: DGWC-23		Lab ID: 267122011		Collected: 07/12/18 10:15		Received: 07/13/18 11:10		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	07/17/18 11:24	07/19/18 19:42	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	07/17/18 11:24	07/19/18 19:42	7440-38-2		
Barium	0.022	mg/L	0.010	0.00078	1	07/17/18 11:24	07/19/18 19:42	7440-39-3		
Beryllium	0.00035J	mg/L	0.0030	0.000050	1	07/17/18 11:24	07/19/18 19:42	7440-41-7		
Boron	4.0	mg/L	0.040	0.0039	1	07/17/18 11:24	07/19/18 19:42	7440-42-8		
Cadmium	0.00028J	mg/L	0.0010	0.000093	1	07/17/18 11:24	07/19/18 19:42	7440-43-9		
Calcium	72.0	mg/L	25.0	0.69	50	07/17/18 11:24	07/19/18 19:48	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	07/17/18 11:24	07/19/18 19:42	7440-47-3		
Cobalt	ND	mg/L	0.010	0.00052	1	07/17/18 11:24	07/19/18 19:42	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	07/17/18 11:24	07/19/18 19:42	7439-92-1		
Lithium	0.0047J	mg/L	0.050	0.00097	1	07/17/18 11:24	07/19/18 19:42	7439-93-2		
Molybdenum	0.012	mg/L	0.010	0.0019	1	07/17/18 11:24	07/19/18 19:42	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	07/17/18 11:24	07/19/18 19:42	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	07/17/18 11:24	07/19/18 19:42	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	0.00016J	mg/L	0.00050	0.000036	1	07/18/18 10:37	07/18/18 19:01	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	432	mg/L	25.0	10.0	1		07/17/18 12:14			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	15.2	mg/L	0.25	0.024	1		07/18/18 02:27	16887-00-6		
Fluoride	0.25J	mg/L	0.30	0.029	1		07/18/18 02:27	16984-48-8		
Sulfate	202	mg/L	10.0	0.17	10		07/20/18 16:27	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 267122

Sample: DGWC-22		Lab ID: 267122012		Collected: 07/12/18 08:40		Received: 07/13/18 11:10		Matrix: Water	
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual
			Limit	MDL	DF				
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	mg/L	0.0030	0.00078	1	07/17/18 11:24	07/19/18 20:05	7440-36-0	
Arsenic	ND	mg/L	0.0050	0.00057	1	07/17/18 11:24	07/19/18 20:05	7440-38-2	
Barium	0.036	mg/L	0.010	0.00078	1	07/17/18 11:24	07/19/18 20:05	7440-39-3	
Beryllium	0.00018J	mg/L	0.0030	0.000050	1	07/17/18 11:24	07/19/18 20:05	7440-41-7	
Boron	3.6	mg/L	0.040	0.0039	1	07/17/18 11:24	07/19/18 20:05	7440-42-8	
Cadmium	0.00091J	mg/L	0.0010	0.000093	1	07/17/18 11:24	07/19/18 20:05	7440-43-9	
Calcium	71.0	mg/L	25.0	0.69	50	07/17/18 11:24	07/19/18 20:11	7440-70-2	M6
Chromium	ND	mg/L	0.010	0.0016	1	07/17/18 11:24	07/19/18 20:05	7440-47-3	
Cobalt	0.011	mg/L	0.010	0.00052	1	07/17/18 11:24	07/19/18 20:05	7440-48-4	
Lead	ND	mg/L	0.0050	0.00027	1	07/17/18 11:24	07/19/18 20:05	7439-92-1	
Lithium	0.0036J	mg/L	0.050	0.00097	1	07/17/18 11:24	07/19/18 20:05	7439-93-2	
Molybdenum	ND	mg/L	0.010	0.0019	1	07/17/18 11:24	07/19/18 20:05	7439-98-7	
Selenium	0.0017J	mg/L	0.010	0.0014	1	07/17/18 11:24	07/19/18 20:05	7782-49-2	
Thallium	ND	mg/L	0.0010	0.00014	1	07/17/18 11:24	07/19/18 20:05	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	0.000055J	mg/L	0.00050	0.000036	1	07/18/18 10:37	07/18/18 19:09	7439-97-6	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	486	mg/L	25.0	10.0	1		07/17/18 12:14		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	26.1	mg/L	0.25	0.024	1		07/18/18 02:48	16887-00-6	
Fluoride	0.13J	mg/L	0.30	0.029	1		07/18/18 02:48	16984-48-8	
Sulfate	197	mg/L	10.0	0.17	10		07/20/18 18:11	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 267122

QC Batch: 10002

Analysis Method: EPA 7470A

QC Batch Method: EPA 7470A

Analysis Description: 7470 Mercury

Associated Lab Samples: 267122001, 267122002, 267122003, 267122004, 267122005, 267122006, 267122007, 267122008, 267122009, 267122010, 267122011, 267122012

METHOD BLANK: 45320

Matrix: Water

Associated Lab Samples: 267122001, 267122002, 267122003, 267122004, 267122005, 267122006, 267122007, 267122008, 267122009, 267122010, 267122011, 267122012

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Mercury	mg/L	ND	0.00050	0.000036	07/18/18 17:11	

LABORATORY CONTROL SAMPLE: 45321

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Mercury	mg/L	.0025	0.0025	101	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 45322 45323

Parameter	Units	267107001 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
Mercury	mg/L	ND	.0025	.0025	0.0025	0.0025	97	100	75-125	2	20	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 267122

QC Batch: 9923 Analysis Method: EPA 6020B
QC Batch Method: EPA 3005A Analysis Description: 6020B MET
Associated Lab Samples: 267122001, 267122002, 267122003, 267122004, 267122005, 267122006

METHOD BLANK: 44985 Matrix: Water
Associated Lab Samples: 267122001, 267122002, 267122003, 267122004, 267122005, 267122006

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Antimony	mg/L	ND	0.0030	0.00078	07/19/18 17:08	
Arsenic	mg/L	ND	0.0050	0.00057	07/19/18 17:08	
Barium	mg/L	ND	0.010	0.00078	07/19/18 17:08	
Beryllium	mg/L	ND	0.0030	0.000050	07/19/18 17:08	
Boron	mg/L	ND	0.040	0.0039	07/19/18 17:08	
Cadmium	mg/L	ND	0.0010	0.000093	07/19/18 17:08	
Calcium	mg/L	ND	0.50	0.014	07/19/18 17:08	
Chromium	mg/L	ND	0.010	0.0016	07/19/18 17:08	
Cobalt	mg/L	ND	0.010	0.00052	07/19/18 17:08	
Lead	mg/L	ND	0.0050	0.00027	07/19/18 17:08	
Lithium	mg/L	ND	0.050	0.00097	07/19/18 17:08	
Molybdenum	mg/L	ND	0.010	0.0019	07/19/18 17:08	
Selenium	mg/L	ND	0.010	0.0014	07/19/18 17:08	
Thallium	mg/L	ND	0.0010	0.00014	07/19/18 17:08	

LABORATORY CONTROL SAMPLE: 44986

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Antimony	mg/L	.1	0.11	108	80-120	
Arsenic	mg/L	.1	0.10	104	80-120	
Barium	mg/L	.1	0.10	104	80-120	
Beryllium	mg/L	.1	0.11	113	80-120	
Boron	mg/L	1	1.1	106	80-120	
Cadmium	mg/L	.1	0.11	106	80-120	
Calcium	mg/L	1	1.1	108	80-120	
Chromium	mg/L	.1	0.11	107	80-120	
Cobalt	mg/L	.1	0.11	105	80-120	
Lead	mg/L	.1	0.11	107	80-120	
Lithium	mg/L	.1	0.11	110	80-120	
Molybdenum	mg/L	.1	0.11	105	80-120	
Selenium	mg/L	.1	0.11	107	80-120	
Thallium	mg/L	.1	0.11	107	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 44987 44988

Parameter	Units	267107001 Result	MS		MSD		MS % Rec	MSD % Rec	% Rec Limits	Max RPD	Qual
			Spike Conc.	MS Result	MSD Result	MSD Result					
Antimony	mg/L	ND	.1	.1	0.11	0.11	109	106	75-125	2	20

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 267122

Parameter	Units	MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 44987		44988		MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	Max RPD	RPD	Qual
		267107001 Result	MS Spike Conc.	MSD Spike Conc.	MS Result								
Arsenic	mg/L	ND	.1	.1	0.10	0.10	103	101	75-125	1	20		
Barium	mg/L	0.057	.1	.1	0.17	0.16	112	101	75-125	7	20		
Beryllium	mg/L	ND	.1	.1	0.094	0.096	94	96	75-125	3	20		
Boron	mg/L	0.64	1	1	1.4	1.5	79	82	75-125	2	20		
Cadmium	mg/L	ND	.1	.1	0.10	0.10	103	103	75-125	0	20		
Calcium	mg/L	140	1	1	141	138	122	-184	75-125	2	20	M6	
Chromium	mg/L	ND	.1	.1	0.10	0.10	101	100	75-125	1	20		
Cobalt	mg/L	ND	.1	.1	0.099	0.099	99	99	75-125	0	20		
Lead	mg/L	ND	.1	.1	0.10	0.099	100	99	75-125	1	20		
Lithium	mg/L	0.013J	.1	.1	0.11	0.11	95	96	75-125	1	20		
Molybdenum	mg/L	0.0022J	.1	.1	0.11	0.11	108	104	75-125	4	20		
Selenium	mg/L	ND	.1	.1	0.10	0.10	104	102	75-125	2	20		
Thallium	mg/L	0.00077J	.1	.1	0.10	0.10	102	100	75-125	2	20		

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 267122

QC Batch: 9925 Analysis Method: EPA 6020B
QC Batch Method: EPA 3005A Analysis Description: 6020B MET
Associated Lab Samples: 267122007, 267122008, 267122009, 267122010, 267122011, 267122012

METHOD BLANK: 44989 Matrix: Water
Associated Lab Samples: 267122007, 267122008, 267122009, 267122010, 267122011, 267122012

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Antimony	mg/L	ND	0.0030	0.00078	07/19/18 18:57	
Arsenic	mg/L	ND	0.0050	0.00057	07/19/18 18:57	
Barium	mg/L	ND	0.010	0.00078	07/19/18 18:57	
Beryllium	mg/L	ND	0.0030	0.000050	07/19/18 18:57	
Boron	mg/L	ND	0.040	0.0039	07/19/18 18:57	
Cadmium	mg/L	ND	0.0010	0.000093	07/19/18 18:57	
Calcium	mg/L	ND	0.50	0.014	07/19/18 18:57	
Chromium	mg/L	ND	0.010	0.0016	07/19/18 18:57	
Cobalt	mg/L	ND	0.010	0.00052	07/19/18 18:57	
Lead	mg/L	ND	0.0050	0.00027	07/19/18 18:57	
Lithium	mg/L	ND	0.050	0.00097	07/19/18 18:57	
Molybdenum	mg/L	ND	0.010	0.0019	07/19/18 18:57	
Selenium	mg/L	ND	0.010	0.0014	07/19/18 18:57	
Thallium	mg/L	ND	0.0010	0.00014	07/19/18 18:57	

LABORATORY CONTROL SAMPLE: 44990

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Antimony	mg/L	.1	0.10	104	80-120	
Arsenic	mg/L	.1	0.10	101	80-120	
Barium	mg/L	.1	0.10	101	80-120	
Beryllium	mg/L	.1	0.10	105	80-120	
Boron	mg/L	1	1.1	105	80-120	
Cadmium	mg/L	.1	0.11	105	80-120	
Calcium	mg/L	1	1.0	104	80-120	
Chromium	mg/L	.1	0.099	99	80-120	
Cobalt	mg/L	.1	0.10	100	80-120	
Lead	mg/L	.1	0.10	102	80-120	
Lithium	mg/L	.1	0.10	100	80-120	
Molybdenum	mg/L	.1	0.11	105	80-120	
Selenium	mg/L	.1	0.11	105	80-120	
Thallium	mg/L	.1	0.10	103	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 44993 44994

Parameter	Units	267122012 Result	MS		MSD		MS % Rec	MSD % Rec	% Rec Limits	Max RPD	Qual
			Spike Conc.	MSD Spike Conc.	MS Result	MSD Result					
Antimony	mg/L	ND	.1	.1	0.11	0.11	106	109	75-125	3	20

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 267122

Parameter	Units	MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 44993		44994		MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	Max RPD	RPD	Qual
		267122012 Result	MS Spike Conc.	MSD Spike Conc.	MS Result								
Arsenic	mg/L	ND	.1	.1	0.11	0.11	108	110	75-125	2	20		
Barium	mg/L	0.036	.1	.1	0.14	0.13	101	98	75-125	2	20		
Beryllium	mg/L	0.00018J	.1	.1	0.094	0.095	94	95	75-125	2	20		
Boron	mg/L	3.6	1	1	4.5	4.5	92	96	75-125	1	20		
Cadmium	mg/L	0.00091J	.1	.1	0.11	0.11	105	109	75-125	3	20		
Calcium	mg/L	71.0	1	1	69.6	69.9	-140	-112	75-125	0	20	M6	
Chromium	mg/L	ND	.1	.1	0.098	0.099	97	98	75-125	1	20		
Cobalt	mg/L	0.011	.1	.1	0.11	0.11	98	100	75-125	2	20		
Lead	mg/L	ND	.1	.1	0.10	0.10	100	100	75-125	0	20		
Lithium	mg/L	0.0036J	.1	.1	0.094	0.097	90	93	75-125	3	20		
Molybdenum	mg/L	ND	.1	.1	0.10	0.11	104	108	75-125	3	20		
Selenium	mg/L	0.0017J	.1	.1	0.11	0.11	105	108	75-125	4	20		
Thallium	mg/L	ND	.1	.1	0.10	0.10	102	103	75-125	1	20		

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 267122

QC Batch: 9943 Analysis Method: SM 2540C
QC Batch Method: SM 2540C Analysis Description: 2540C Total Dissolved Solids
Associated Lab Samples: 267122001, 267122002, 267122003, 267122004, 267122005, 267122006, 267122007, 267122008, 267122009, 267122010, 267122011, 267122012

LABORATORY CONTROL SAMPLE: 45065

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	400	415	104	84-108	

SAMPLE DUPLICATE: 45066

Parameter	Units	267107001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	523	522	0	10	

SAMPLE DUPLICATE: 45067

Parameter	Units	267122011 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	432	437	1	10	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 267122

QC Batch: 9906 Analysis Method: EPA 300.0
QC Batch Method: EPA 300.0 Analysis Description: 300.0 IC Anions
Associated Lab Samples: 267122001, 267122002, 267122003, 267122004, 267122005, 267122006, 267122007, 267122008, 267122009, 267122010, 267122011, 267122012

METHOD BLANK: 44919 Matrix: Water
Associated Lab Samples: 267122001, 267122002, 267122003, 267122004, 267122005, 267122006, 267122007, 267122008, 267122009, 267122010, 267122011, 267122012

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Chloride	mg/L	0.095J	0.25	0.024	07/17/18 18:53	
Fluoride	mg/L	ND	0.30	0.029	07/17/18 18:53	
Sulfate	mg/L	ND	1.0	0.017	07/17/18 18:53	

LABORATORY CONTROL SAMPLE: 44920

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	10	10.2	102	90-110	
Fluoride	mg/L	10	10.1	101	90-110	
Sulfate	mg/L	10	9.9	99	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 44921 44922

Parameter	Units	MS		MSD		MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
		267107001 Result	Spike Conc.	Spike Conc.	MS Result						
Chloride	mg/L	6.3	10	10	15.8	15.8	95	95	90-110	0	15
Fluoride	mg/L	0.17J	10	10	10.1	10.0	99	99	90-110	0	15
Sulfate	mg/L	84.9	10	10	84.5	84.4	-4	-5	90-110	0	15 E,M1

MATRIX SPIKE SAMPLE: 44923

Parameter	Units	267107002 Result	Spike Conc.	MS Result	MS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	6.3	10	15.7	94	90-110	
Fluoride	mg/L	0.18J	10	10.0	98	90-110	
Sulfate	mg/L	86.0	10	83.9	-21	90-110 E,M1	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: Plant McDonough Ash Ponds

Pace Project No.: 267122

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

ANALYTE QUALIFIERS

B Analyte was detected in the associated method blank.

E Analyte concentration exceeded the calibration range. The reported result is estimated.

M1 Matrix spike recovery exceeded QC limits. Batch accepted based on laboratory control sample (LCS) recovery.

M6 Matrix spike and Matrix spike duplicate recovery not evaluated against control limits due to sample dilution.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Ash Ponds
Pace Project No.: 267122

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
267122001	DGWA-53	EPA 3005A	9923	EPA 6020B	10127
267122002	DGWC-37	EPA 3005A	9923	EPA 6020B	10127
267122003	DGWC-38	EPA 3005A	9923	EPA 6020B	10127
267122004	DGWC-39	EPA 3005A	9923	EPA 6020B	10127
267122005	DGWC-40	EPA 3005A	9923	EPA 6020B	10127
267122006	FD-3	EPA 3005A	9923	EPA 6020B	10127
267122007	FB-3	EPA 3005A	9925	EPA 6020B	10137
267122008	EB-3	EPA 3005A	9925	EPA 6020B	10137
267122009	DGWC-47	EPA 3005A	9925	EPA 6020B	10137
267122010	DGWC-48	EPA 3005A	9925	EPA 6020B	10137
267122011	DGWC-23	EPA 3005A	9925	EPA 6020B	10137
267122012	DGWC-22	EPA 3005A	9925	EPA 6020B	10137
267122001	DGWA-53	EPA 7470A	10002	EPA 7470A	10028
267122002	DGWC-37	EPA 7470A	10002	EPA 7470A	10028
267122003	DGWC-38	EPA 7470A	10002	EPA 7470A	10028
267122004	DGWC-39	EPA 7470A	10002	EPA 7470A	10028
267122005	DGWC-40	EPA 7470A	10002	EPA 7470A	10028
267122006	FD-3	EPA 7470A	10002	EPA 7470A	10028
267122007	FB-3	EPA 7470A	10002	EPA 7470A	10028
267122008	EB-3	EPA 7470A	10002	EPA 7470A	10028
267122009	DGWC-47	EPA 7470A	10002	EPA 7470A	10028
267122010	DGWC-48	EPA 7470A	10002	EPA 7470A	10028
267122011	DGWC-23	EPA 7470A	10002	EPA 7470A	10028
267122012	DGWC-22	EPA 7470A	10002	EPA 7470A	10028
267122001	DGWA-53	SM 2540C	9943		
267122002	DGWC-37	SM 2540C	9943		
267122003	DGWC-38	SM 2540C	9943		
267122004	DGWC-39	SM 2540C	9943		
267122005	DGWC-40	SM 2540C	9943		
267122006	FD-3	SM 2540C	9943		
267122007	FB-3	SM 2540C	9943		
267122008	EB-3	SM 2540C	9943		
267122009	DGWC-47	SM 2540C	9943		
267122010	DGWC-48	SM 2540C	9943		
267122011	DGWC-23	SM 2540C	9943		
267122012	DGWC-22	SM 2540C	9943		
267122001	DGWA-53	EPA 300.0	9906		
267122002	DGWC-37	EPA 300.0	9906		
267122003	DGWC-38	EPA 300.0	9906		
267122004	DGWC-39	EPA 300.0	9906		
267122005	DGWC-40	EPA 300.0	9906		
267122006	FD-3	EPA 300.0	9906		
267122007	FB-3	EPA 300.0	9906		
267122008	EB-3	EPA 300.0	9906		
267122009	DGWC-47	EPA 300.0	9906		
267122010	DGWC-48	EPA 300.0	9906		
267122011	DGWC-23	EPA 300.0	9906		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Ash Ponds

Pace Project No.: 267122

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
267122012	DGWC-22	EPA 300.0	9906		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CHAIN OF CUSTODY RECORD

Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CLIENT NAME: Georgia Power
CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185
 Atlanta, GA 30308
 404-506-7239
REPORT TO: Dawn Prell (Dawn_Prell@golder.com)
REQUESTED COMPLETION DATE: laburch@southernco.com
PROJECT NAME/STATE: Plant McDonough AP
PROJECT #: Phase II CCR

CONTAINER TYPE: P 3
PRESERVATION: P 7
ANALYSIS REQUESTED: P 3
CONTAINERS: C O N T A I N E R S

CONTAINER TYPE: P - PLASTIC
 A - AMBER GLASS
 G - CLEAR GLASS
 V - VOA VIAL
 S - STERILE
 O - OTHER
PRESERVATION: 1 - HCl, 56°C
 2 - H₂SO₄, 56°C
 3 - HNO₃
 4 - NaOH, 56°C
 5 - NaOH/ZnAc, 56°C
 6 - Na₂S₂O₃, 56°C
 7 - 56°C not frozen

Collection DATE	Collection TIME	MATRIX CODE*	C O R M P	SAMPLE IDENTIFICATION	Metals App. III & IV (EPA 620/7470)	Cl, T, SO ₄ & TDS (EPA 300.0 & SM 2540C)	Radium 226 & 228 (SW-846 9315/9320)
07/12/18	0840	GW	X	DGWA-53	1	1	2
07/12/18	1335	GW	X	DGWC-37	1	1	2
07/12/18	1340	GW	X	DGWC-38	1	1	2
07/12/18	1130	GW	X	DGWC-39	1	1	2
07/12/18	1240	GW	X	DGWC-40	1	1	2
07/12/18	-	GW	X	FD-3	1	1	2
07/12/18	1025	W	X	FB-3	1	1	2
07/12/18	1400	W	X	EB-3	1	1	2
07/12/18	0845	GW	X	DGWC-47	1	1	4
07/12/18	1055	GW	X	DGWC-48	1	1	2
07/12/18	1015	GW	X	DGWC-23	1	1	2
07/12/18	0840	GW	X	DGWC-22	1	1	2

RELINQUISHED BY: [Signature] DATE/TIME: 7/12/18 1800
RELINQUISHED BY: [Signature] DATE/TIME: 7/13/18 0920
SAMPLE SHIPPED VIA: UPS FED-EX USPS COURIER Pace CLIENT OTHER FS
RECEIVED BY LAB: Mike Naysa DATE/TIME: 07/13/18 1110
RECEIVED BY: [Signature] DATE/TIME: 7/13/18 0920
 Temperature: Min: 1.5 Max: [Blank]
 Custody Seal: Intact Broken Not Present
 Cooler ID: [Blank]
FOR LAB USE ONLY
WO#: 267122
267122



Sample Condition Upon Receipt

Client Name: GIA Power

Project #

WO#: **267122**

Courier: Fed Ex UPS USPS Client Commercial Pace Other

Tracking #: _____

PH: **BM**

Due Date: **07/20/18**

Custody Seal on Cooler/Box Present: yes no Seals intact: yes

CLIENT: **GAPower-CCR**

Packing Material: Bubble Wrap Bubble Bags None Other

Thermometer Used 8.3 Type of Ice: Wet Blue None

Samples on ice, cooling process has begun

Cooler Temperature 1.5 Biological Tissue is Frozen: Yes No

Date and Initials of person examining contents: 7/13/18 MK

Temp should be above freezing to 6°C

Comments:

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.		
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.		
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.		
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.		
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.		
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.		
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.		
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.		
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.		
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.		
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.		
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.		
-Includes date/time/ID/Analysis Matrix:	<u>GW</u>			
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.		
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed	Lot # of added preservative	
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.		
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.		
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.		
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A			
Pace Trip Blank Lot # (if purchased):				

Client Notification/ Resolution:

Person Contacted: _____ Date/Time: _____

Field Data Required?

Y N

Comments/ Resolution: _____

Project Manager Review: _____

Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office i.e. out of hold, incorrect preservative, out of temp, incorrect containers

August 09, 2018

Joju Abraham
Georgia Power - Coal Combustion Residuals
2480 Maner Road
Atlanta, GA 30339

RE: Project: Plant McDonough Ash Ponds
Pace Project No.: 267124

Dear Joju Abraham:

Enclosed are the analytical results for sample(s) received by the laboratory on July 13, 2018. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Betsy McDaniel
betsy.mcdaniel@pacelabs.com
(770)734-4200
Project Manager

Enclosures

cc: Kristen Jurinko, Golder Associates Inc.
Julie Lehrman, Golder Associates Inc.
Maria Padilla, Georgia Power
Dawn Prell, Golder Associates Inc.
Tim Richards, Golder Associates - Atlanta
Rebecca Thornton, Pace Analytical Atlanta



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: Plant McDonough Ash Ponds
Pace Project No.: 267124

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601
ANAB DOD-ELAP Rad Accreditation #: L2417
Alabama Certification #: 41590
Arizona Certification #: AZ0734
Arkansas Certification
California Certification #: 04222CA
Colorado Certification #: PA01547
Connecticut Certification #: PH-0694
Delaware Certification
EPA Region 4 DW Rad
Florida/TNI Certification #: E87683
Georgia Certification #: C040
Guam Certification
Hawaii Certification
Idaho Certification
Illinois Certification
Indiana Certification
Iowa Certification #: 391
Kansas/TNI Certification #: E-10358
Kentucky Certification #: KY90133
KY WW Permit #: KY0098221
KY WW Permit #: KY0000221
Louisiana DHH/TNI Certification #: LA180012
Louisiana DEQ/TNI Certification #: 4086
Maine Certification #: 2017020
Maryland Certification #: 308
Massachusetts Certification #: M-PA1457
Michigan/PADEP Certification #: 9991

Missouri Certification #: 235
Montana Certification #: Cert0082
Nebraska Certification #: NE-OS-29-14
Nevada Certification #: PA014572018-1
New Hampshire/TNI Certification #: 297617
New Jersey/TNI Certification #: PA051
New Mexico Certification #: PA01457
New York/TNI Certification #: 10888
North Carolina Certification #: 42706
North Dakota Certification #: R-190
Ohio EPA Rad Approval: #41249
Oregon/TNI Certification #: PA200002-010
Pennsylvania/TNI Certification #: 65-00282
Puerto Rico Certification #: PA01457
Rhode Island Certification #: 65-00282
South Dakota Certification
Tennessee Certification #: 02867
Texas/TNI Certification #: T104704188-17-3
Utah/TNI Certification #: PA014572017-9
USDA Soil Permit #: P330-17-00091
Vermont Dept. of Health: ID# VT-0282
Virgin Island/PADEP Certification
Virginia/VELAP Certification #: 9526
Washington Certification #: C868
West Virginia DEP Certification #: 143
West Virginia DHHR Certification #: 9964C
Wisconsin Approve List for Rad
Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: Plant McDonough Ash Ponds
Pace Project No.: 267124

Lab ID	Sample ID	Matrix	Date Collected	Date Received
267124001	DGWA-53	Water	07/12/18 08:40	07/13/18 11:10
267124002	DGWC-37	Water	07/12/18 13:35	07/13/18 11:10
267124003	DGWC-38	Water	07/12/18 13:40	07/13/18 11:10
267124004	DGWC-39	Water	07/12/18 11:30	07/13/18 11:10
267124005	DGWC-40	Water	07/12/18 12:40	07/13/18 11:10
267124006	FD-3	Water	07/12/18 00:00	07/13/18 11:10
267124007	FB-3	Water	07/12/18 10:25	07/13/18 11:10
267124008	EB-3	Water	07/12/18 14:00	07/13/18 11:10
267124009	DGWC-47	Water	07/12/18 08:45	07/13/18 11:10
267124010	DGWC-48	Water	07/12/18 10:55	07/13/18 11:10
267124011	DGWC-23	Water	07/12/18 10:15	07/13/18 11:10
267124012	DGWC-22	Water	07/12/18 08:40	07/13/18 11:10

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds
Pace Project No.: 267124

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
267124001	DGWA-53	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
267124002	DGWC-37	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
267124003	DGWC-38	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
267124004	DGWC-39	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
267124005	DGWC-40	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
267124006	FD-3	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
267124007	FB-3	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
267124008	EB-3	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
267124009	DGWC-47	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
267124010	DGWC-48	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
267124011	DGWC-23	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
267124012	DGWC-22	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267124

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	2.18 ± 0.467 (0.174) C:86% T:NA	pCi/L	07/30/18 09:31	13982-63-3	
Radium-228	EPA 9320	2.47 ± 0.878 (1.27) C:49% T:82%	pCi/L	08/02/18 16:27	15262-20-1	
Total Radium	Total Radium Calculation	4.65 ± 1.35 (1.44)	pCi/L	08/06/18 12:27	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267124

Sample: DGWC-37 **Lab ID: 267124002** Collected: 07/12/18 13:35 Received: 07/13/18 11:10 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.273 ± 0.135 (0.167) C:91% T:NA	pCi/L	07/30/18 09:31	13982-63-3	
Radium-228	EPA 9320	0.293 ± 0.583 (1.28) C:59% T:83%	pCi/L	08/02/18 18:48	15262-20-1	
Total Radium	Total Radium Calculation	0.566 ± 0.718 (1.45)	pCi/L	08/06/18 12:27	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267124

Sample: DGWC-38 **Lab ID: 267124003** Collected: 07/12/18 13:40 Received: 07/13/18 11:10 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.283 ± 0.133 (0.156) C:96% T:NA	pCi/L	07/30/18 09:31	13982-63-3	
Radium-228	EPA 9320	0.332 ± 0.702 (1.55) C:56% T:74%	pCi/L	08/02/18 18:48	15262-20-1	
Total Radium	Total Radium Calculation	0.615 ± 0.835 (1.71)	pCi/L	08/06/18 12:27	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267124

Sample: DGWC-39 **Lab ID: 267124004** Collected: 07/12/18 11:30 Received: 07/13/18 11:10 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.196 ± 0.121 (0.167) C:80% T:NA	pCi/L	07/30/18 09:31	13982-63-3	
Radium-228	EPA 9320	0.739 ± 0.683 (1.38) C:57% T:76%	pCi/L	08/02/18 18:48	15262-20-1	
Total Radium	Total Radium Calculation	0.935 ± 0.804 (1.55)	pCi/L	08/06/18 12:27	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267124

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.231 ± 0.128 (0.171) C:85% T:NA	pCi/L	07/30/18 09:31	13982-63-3	
Radium-228	EPA 9320	-0.236 ± 0.628 (1.53) C:54% T:79%	pCi/L	08/02/18 18:48	15262-20-1	
Total Radium	Total Radium Calculation	0.231 ± 0.756 (1.70)	pCi/L	08/06/18 12:27	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267124

Sample: FD-3 **Lab ID: 267124006** Collected: 07/12/18 00:00 Received: 07/13/18 11:10 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.414 ± 0.172 (0.209) C:91% T:NA	pCi/L	07/30/18 09:31	13982-63-3	
Radium-228	EPA 9320	-0.0728 ± 0.665 (1.53) C:58% T:80%	pCi/L	08/02/18 13:09	15262-20-1	
Total Radium	Total Radium Calculation	0.414 ± 0.837 (1.74)	pCi/L	08/06/18 12:27	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267124

Sample: FB-3 **Lab ID: 267124007** Collected: 07/12/18 10:25 Received: 07/13/18 11:10 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.139 ± 0.0987 (0.169) C:123% T:NA	pCi/L	07/30/18 09:31	13982-63-3	
Radium-228	EPA 9320	0.819 ± 0.543 (1.05) C:63% T:83%	pCi/L	08/02/18 13:09	15262-20-1	
Total Radium	Total Radium Calculation	0.958 ± 0.642 (1.22)	pCi/L	08/06/18 12:27	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267124

Sample: EB-3 **Lab ID: 267124008** Collected: 07/12/18 14:00 Received: 07/13/18 11:10 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.111 ± 0.0981 (0.180) C:97% T:NA	pCi/L	07/30/18 09:31	13982-63-3	
Radium-228	EPA 9320	0.421 ± 0.636 (1.37) C:51% T:80%	pCi/L	08/02/18 13:09	15262-20-1	
Total Radium	Total Radium Calculation	0.532 ± 0.734 (1.55)	pCi/L	08/06/18 12:27	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267124

Sample: DGWC-47 **Lab ID: 267124009** Collected: 07/12/18 08:45 Received: 07/13/18 11:10 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.435 ± 0.180 (0.208) C:87% T:NA	pCi/L	07/30/18 09:31	13982-63-3	
Radium-228	EPA 9320	1.29 ± 0.567 (0.935) C:66% T:76%	pCi/L	08/02/18 13:03	15262-20-1	
Total Radium	Total Radium Calculation	1.73 ± 0.747 (1.14)	pCi/L	08/06/18 12:31	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267124

Sample: DGWC-48 **Lab ID: 267124010** Collected: 07/12/18 10:55 Received: 07/13/18 11:10 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.401 ± 0.158 (0.155) C:89% T:NA	pCi/L	07/30/18 12:11	13982-63-3	
Radium-228	EPA 9320	1.41 ± 0.674 (1.21) C:65% T:82%	pCi/L	08/02/18 13:09	15262-20-1	
Total Radium	Total Radium Calculation	1.81 ± 0.832 (1.37)	pCi/L	08/06/18 12:31	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267124

Sample: DGWC-23 **Lab ID: 267124011** Collected: 07/12/18 10:15 Received: 07/13/18 11:10 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.335 ± 0.155 (0.198) C:88% T:NA	pCi/L	07/30/18 12:11	13982-63-3	
Radium-228	EPA 9320	0.583 ± 0.601 (1.26) C:66% T:73%	pCi/L	08/02/18 13:09	15262-20-1	
Total Radium	Total Radium Calculation	0.918 ± 0.756 (1.46)	pCi/L	08/06/18 12:31	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267124

Sample: DGWC-22 **Lab ID: 267124012** Collected: 07/12/18 08:40 Received: 07/13/18 11:10 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.374 ± 0.114 (0.0938) C:96% T:NA	pCi/L	07/30/18 13:25	13982-63-3	
Radium-228	EPA 9320	0.607 ± 0.558 (1.15) C:65% T:76%	pCi/L	08/02/18 13:09	15262-20-1	
Total Radium	Total Radium Calculation	0.981 ± 0.672 (1.24)	pCi/L	08/06/18 12:31	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267124

QC Batch:	306540	Analysis Method:	EPA 9315
QC Batch Method:	EPA 9315	Analysis Description:	9315 Total Radium
Associated Lab Samples:	267124001, 267124002, 267124003, 267124004, 267124005, 267124006, 267124007, 267124008, 267124009, 267124010, 267124011, 267124012		

METHOD BLANK:	1498647	Matrix:	Water
Associated Lab Samples:	267124001, 267124002, 267124003, 267124004, 267124005, 267124006, 267124007, 267124008, 267124009, 267124010, 267124011, 267124012		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.216 ± 0.130 (0.183) C:89% T:NA	pCi/L	07/30/18 08:58	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267124

QC Batch: 306539

Analysis Method: EPA 9320

QC Batch Method: EPA 9320

Analysis Description: 9320 Radium 228

Associated Lab Samples: 267124001, 267124002, 267124003, 267124004, 267124005, 267124006, 267124007, 267124008, 267124009, 267124010, 267124011, 267124012

METHOD BLANK: 1498646

Matrix: Water

Associated Lab Samples: 267124001, 267124002, 267124003, 267124004, 267124005, 267124006, 267124007, 267124008, 267124009, 267124010, 267124011, 267124012

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.687 ± 0.426 (0.797) C:69% T:81%	pCi/L	08/02/18 13:03	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: Plant McDonough Ash Ponds

Pace Project No.: 267124

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

LABORATORIES

PASI-PA Pace Analytical Services - Greensburg

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Ash Ponds
Pace Project No.: 267124

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
267124001	DGWA-53	EPA 9315	306540		
267124002	DGWC-37	EPA 9315	306540		
267124003	DGWC-38	EPA 9315	306540		
267124004	DGWC-39	EPA 9315	306540		
267124005	DGWC-40	EPA 9315	306540		
267124006	FD-3	EPA 9315	306540		
267124007	FB-3	EPA 9315	306540		
267124008	EB-3	EPA 9315	306540		
267124009	DGWC-47	EPA 9315	306540		
267124010	DGWC-48	EPA 9315	306540		
267124011	DGWC-23	EPA 9315	306540		
267124012	DGWC-22	EPA 9315	306540		
267124001	DGWA-53	EPA 9320	306539		
267124002	DGWC-37	EPA 9320	306539		
267124003	DGWC-38	EPA 9320	306539		
267124004	DGWC-39	EPA 9320	306539		
267124005	DGWC-40	EPA 9320	306539		
267124006	FD-3	EPA 9320	306539		
267124007	FB-3	EPA 9320	306539		
267124008	EB-3	EPA 9320	306539		
267124009	DGWC-47	EPA 9320	306539		
267124010	DGWC-48	EPA 9320	306539		
267124011	DGWC-23	EPA 9320	306539		
267124012	DGWC-22	EPA 9320	306539		
267124001	DGWA-53	Total Radium Calculation	308501		
267124002	DGWC-37	Total Radium Calculation	308501		
267124003	DGWC-38	Total Radium Calculation	308501		
267124004	DGWC-39	Total Radium Calculation	308501		
267124005	DGWC-40	Total Radium Calculation	308501		
267124006	FD-3	Total Radium Calculation	308501		
267124007	FB-3	Total Radium Calculation	308501		
267124008	EB-3	Total Radium Calculation	308501		
267124009	DGWC-47	Total Radium Calculation	308504		
267124010	DGWC-48	Total Radium Calculation	308504		
267124011	DGWC-23	Total Radium Calculation	308504		
267124012	DGWC-22	Total Radium Calculation	308504		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CHAIN OF CUSTODY RECORD



Pace Analytical Services, Inc.
110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
(770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CLIENT NAME:
Georgia Power

CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER:
241 Ralph McGill Blvd SE B10185
Atlanta, GA 30308
404-506-7239

REPORT TO:
Dawn Pirell (Dawn_Pirell@golder.com)
REQUESTED COMPLETION DATE: laburchi@southernco.com

PROJECT NAME/STATE:
Plant McDonough AP

CONTAINER TYPE	ANALYSIS REQUESTED			L A B I D N U M B E R	PRESERVATION
	P	P	P		
P - PLASTIC	3	7	3		1 - HCl, 56°C
A - AMBER GLASS					2 - H ₂ SO ₄ , 56°C
G - CLEAR GLASS					3 - HNO ₃
V - VOA VIAL					4 - NaOH, 56°C
S - STERILE					5 - NaOH/ZnAc, 56°C
O - OTHER					6 - Na ₂ S ₂ O ₃ , 56°C
					7 - 56°C not frozen

Collection DATE	Collection TIME	MATRIX CODE*	SAMPLE IDENTIFICATION				RELINQUISHED BY:	DATE/TIME:
			C	G	O	R		
07/12/18	0840	GW	x				7/12/18 1800	
07/12/18	1335	GW	x				7/13/18 0920	
07/12/18	1340	GW	x				7/13/18 1110	
07/12/18	1130	GW	x					
07/12/18	1240	GW	x					
07/12/18	-	GW	x					
07/12/18	1025	W	x					
07/12/18	1400	W	x					
07/12/18	0845	GW	x					
07/12/18	1055	GW	x					
07/12/18	1015	GW	x					
07/12/18	0840	GW	x					

PROJECT #: Phase II CCR

RELINQUISHED BY: [Signature] DATE/TIME: 7/13/18 0920

RELINQUISHED BY: [Signature] DATE/TIME: 7/13/18 0920

SAMPLE SHIPPED VIA: UPS FED-EX USPS COURIER Pace CLIENT OTHER FS

RECEIVED BY: Mikee Norman DATE/TIME: 7/13/18 0920

RECEIVED BY LAB: Ben Hodges DATE/TIME: 07/13/18 1110

Temperature: Min: 1.5 Max:

Intact: **Broken:** **Not Present:**

Cooler ID: [Blank]

WO#: 267124



July 12 2018 Plant McDonough COC Phase II CCR

Sample Condition Upon Receipt

Face Analytical

Client Name: GIA Power

Project # _____

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: _____

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other _____

Thermometer Used 8.3 Type of Ice: Wet Blue None

Cooler Temperature 1.5 Biological Tissue is Frozen: Yes No

Temp should be above freezing to 6°C

WO#: 267124

PM: BM

Due Date: 08/10/18

CLIENT: GAPower-CCR

Samples on ice, cooling process has begun

Date and Initials of person examining contents: 7/13/18 MK

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.		
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.		
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.		
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.		
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.		
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.		
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.		
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.		
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.		
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.		
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.		
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.		
-Includes date/time/ID/Analysis Matrix:	<u>GW</u>			
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.		
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed	Lot # of added preservative	
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.		
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.		
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.		
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A			
Pace Trip Blank Lot # (if purchased):	_____			

Client Notification/ Resolution:

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: _____

Field Data Required? Y N

Project Manager Review: _____

Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples a copy of this form will be sent to the North Carolina DEHNR Certification Office i.e. out of hold, incorrect preservative, out of temp, incorrect containers

July 21, 2018

Joju Abraham
Georgia Power - Coal Combustion Residuals
2480 Maner Road
Atlanta, GA 30339

RE: Project: Plant McDonough Ash Ponds
Pace Project No.: 267125

Dear Joju Abraham:

Enclosed are the analytical results for sample(s) received by the laboratory on July 13, 2018. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Betsy McDaniel
betsy.mcdaniel@pacelabs.com
(770)734-4200
Project Manager

Enclosures

cc: Kristen Jurinko, Golder Associates Inc.
Julie Lehrman, Golder Associates Inc.
Maria Padilla, Georgia Power
Dawn Prell, Golder Associates Inc.
Tim Richards, Golder Associates - Atlanta
Rebecca Thornton, Pace Analytical Atlanta



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: Plant McDonough Ash Ponds

Pace Project No.: 267125

Atlanta Certification IDs

110 Technology Parkway Peachtree Corners, GA 30092

Florida DOH Certification #: E87315

Georgia DW Inorganics Certification #: 812

Georgia DW Microbiology Certification #: 812

North Carolina Certification #: 381

South Carolina Certification #: 98011001

Texas Certification #: T104704397-08-TX

Virginia Certification #: 460204

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267125

Lab ID	Sample ID	Matrix	Date Collected	Date Received
267125001	DGWC-67	Water	07/13/18 08:25	07/13/18 11:10
267125002	DGWC-68A	Water	07/13/18 08:15	07/13/18 11:10
267125003	DGWC-69	Water	07/13/18 08:20	07/13/18 11:10

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds

Pace Project No.: 267125

Lab ID	Sample ID	Method	Analysts	Analytes Reported
267125001	DGWC-67	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
267125002	DGWC-68A	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
267125003	DGWC-69	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 267125

Sample: DGWC-67		Lab ID: 267125001		Collected: 07/13/18 08:25		Received: 07/13/18 11:10		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	0.0023J	mg/L	0.0030	0.00078	1	07/17/18 11:24	07/19/18 20:45	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	07/17/18 11:24	07/19/18 20:45	7440-38-2		
Barium	0.11	mg/L	0.010	0.00078	1	07/17/18 11:24	07/19/18 20:45	7440-39-3		
Beryllium	ND	mg/L	0.0030	0.000050	1	07/17/18 11:24	07/19/18 20:45	7440-41-7		
Boron	3.1	mg/L	0.040	0.0039	1	07/17/18 11:24	07/19/18 20:45	7440-42-8		
Cadmium	ND	mg/L	0.0010	0.000093	1	07/17/18 11:24	07/19/18 20:45	7440-43-9		
Calcium	43.3	mg/L	25.0	0.69	50	07/17/18 11:24	07/19/18 20:51	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	07/17/18 11:24	07/19/18 20:45	7440-47-3		
Cobalt	0.0017J	mg/L	0.010	0.00052	1	07/17/18 11:24	07/19/18 20:45	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	07/17/18 11:24	07/19/18 20:45	7439-92-1		
Lithium	0.0041J	mg/L	0.050	0.00097	1	07/17/18 11:24	07/19/18 20:45	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	07/17/18 11:24	07/19/18 20:45	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	07/17/18 11:24	07/19/18 20:45	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	07/17/18 11:24	07/19/18 20:45	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	07/17/18 08:20	07/17/18 16:27	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	297	mg/L	25.0	10.0	1		07/17/18 12:14			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	5.9	mg/L	0.25	0.024	1		07/18/18 03:09	16887-00-6		
Fluoride	0.25J	mg/L	0.30	0.029	1		07/18/18 03:09	16984-48-8		
Sulfate	136	mg/L	5.0	0.085	5		07/20/18 18:31	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 267125

Sample: DGWC-68A		Lab ID: 267125002		Collected: 07/13/18 08:15		Received: 07/13/18 11:10		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	07/17/18 11:24	07/19/18 21:08	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	07/17/18 11:24	07/19/18 21:08	7440-38-2		
Barium	0.091	mg/L	0.010	0.00078	1	07/17/18 11:24	07/19/18 21:08	7440-39-3		
Beryllium	0.000084J	mg/L	0.0030	0.000050	1	07/17/18 11:24	07/19/18 21:08	7440-41-7		
Boron	1.7	mg/L	0.040	0.0039	1	07/17/18 11:24	07/19/18 21:08	7440-42-8		
Cadmium	0.00019J	mg/L	0.0010	0.000093	1	07/17/18 11:24	07/19/18 21:08	7440-43-9		
Calcium	52.4	mg/L	25.0	0.69	50	07/17/18 11:24	07/19/18 21:14	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	07/17/18 11:24	07/19/18 21:08	7440-47-3		
Cobalt	ND	mg/L	0.010	0.00052	1	07/17/18 11:24	07/19/18 21:08	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	07/17/18 11:24	07/19/18 21:08	7439-92-1		
Lithium	ND	mg/L	0.050	0.00097	1	07/17/18 11:24	07/19/18 21:08	7439-93-2		
Molybdenum	0.22	mg/L	0.010	0.0019	1	07/17/18 11:24	07/19/18 21:08	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	07/17/18 11:24	07/19/18 21:08	7782-49-2		
Thallium	0.00015J	mg/L	0.0010	0.00014	1	07/17/18 11:24	07/19/18 21:08	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	07/17/18 08:20	07/17/18 16:29	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	275	mg/L	25.0	10.0	1		07/17/18 12:14			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	4.0	mg/L	0.25	0.024	1		07/18/18 03:29	16887-00-6		
Fluoride	0.099J	mg/L	0.30	0.029	1		07/18/18 03:29	16984-48-8		
Sulfate	43.3	mg/L	1.0	0.017	1		07/18/18 03:29	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 267125

Sample: DGWC-69		Lab ID: 267125003		Collected: 07/13/18 08:20		Received: 07/13/18 11:10		Matrix: Water	
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual
			Limit	MDL	DF				
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	mg/L	0.0030	0.00078	1	07/17/18 11:24	07/19/18 21:20	7440-36-0	
Arsenic	0.017	mg/L	0.0050	0.00057	1	07/17/18 11:24	07/19/18 21:20	7440-38-2	
Barium	0.074	mg/L	0.010	0.00078	1	07/17/18 11:24	07/19/18 21:20	7440-39-3	
Beryllium	0.000058J	mg/L	0.0030	0.000050	1	07/17/18 11:24	07/19/18 21:20	7440-41-7	
Boron	0.043	mg/L	0.040	0.0039	1	07/17/18 11:24	07/19/18 21:20	7440-42-8	
Cadmium	ND	mg/L	0.0010	0.000093	1	07/17/18 11:24	07/19/18 21:20	7440-43-9	
Calcium	7.9	mg/L	0.50	0.014	1	07/17/18 11:24	07/19/18 21:20	7440-70-2	
Chromium	ND	mg/L	0.010	0.0016	1	07/17/18 11:24	07/19/18 21:20	7440-47-3	
Cobalt	ND	mg/L	0.010	0.00052	1	07/17/18 11:24	07/19/18 21:20	7440-48-4	
Lead	ND	mg/L	0.0050	0.00027	1	07/17/18 11:24	07/19/18 21:20	7439-92-1	
Lithium	0.0026J	mg/L	0.050	0.00097	1	07/17/18 11:24	07/19/18 21:20	7439-93-2	
Molybdenum	0.0070J	mg/L	0.010	0.0019	1	07/17/18 11:24	07/19/18 21:20	7439-98-7	
Selenium	ND	mg/L	0.010	0.0014	1	07/17/18 11:24	07/19/18 21:20	7782-49-2	
Thallium	ND	mg/L	0.0010	0.00014	1	07/17/18 11:24	07/19/18 21:20	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	ND	mg/L	0.00050	0.000036	1	07/17/18 08:20	07/17/18 16:32	7439-97-6	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	95.0	mg/L	25.0	10.0	1		07/17/18 12:14		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	5.3	mg/L	0.25	0.024	1		07/18/18 05:13	16887-00-6	
Fluoride	0.19J	mg/L	0.30	0.029	1		07/18/18 05:13	16984-48-8	
Sulfate	8.6	mg/L	1.0	0.017	1		07/18/18 05:13	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 267125

QC Batch: 9896 Analysis Method: EPA 7470A
QC Batch Method: EPA 7470A Analysis Description: 7470 Mercury
Associated Lab Samples: 267125001, 267125002, 267125003

METHOD BLANK: 44864 Matrix: Water

Associated Lab Samples: 267125001, 267125002, 267125003

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Mercury	mg/L	ND	0.00050	0.000036	07/17/18 12:59	

LABORATORY CONTROL SAMPLE: 44865

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Mercury	mg/L	.0025	0.0026	103	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 44866 44867

Parameter	Units	267060002 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	Max RPD	RPD	Qual
Mercury	mg/L	ND	.0025	.0025	0.0025	0.0028	100	111	75-125	10	20	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 267125

QC Batch: 9925 Analysis Method: EPA 6020B
QC Batch Method: EPA 3005A Analysis Description: 6020B MET
Associated Lab Samples: 267125001, 267125002, 267125003

METHOD BLANK: 44989 Matrix: Water
Associated Lab Samples: 267125001, 267125002, 267125003

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Antimony	mg/L	ND	0.0030	0.00078	07/19/18 18:57	
Arsenic	mg/L	ND	0.0050	0.00057	07/19/18 18:57	
Barium	mg/L	ND	0.010	0.00078	07/19/18 18:57	
Beryllium	mg/L	ND	0.0030	0.000050	07/19/18 18:57	
Boron	mg/L	ND	0.040	0.0039	07/19/18 18:57	
Cadmium	mg/L	ND	0.0010	0.000093	07/19/18 18:57	
Calcium	mg/L	ND	0.50	0.014	07/19/18 18:57	
Chromium	mg/L	ND	0.010	0.0016	07/19/18 18:57	
Cobalt	mg/L	ND	0.010	0.00052	07/19/18 18:57	
Lead	mg/L	ND	0.0050	0.00027	07/19/18 18:57	
Lithium	mg/L	ND	0.050	0.00097	07/19/18 18:57	
Molybdenum	mg/L	ND	0.010	0.0019	07/19/18 18:57	
Selenium	mg/L	ND	0.010	0.0014	07/19/18 18:57	
Thallium	mg/L	ND	0.0010	0.00014	07/19/18 18:57	

LABORATORY CONTROL SAMPLE: 44990

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Antimony	mg/L	.1	0.10	104	80-120	
Arsenic	mg/L	.1	0.10	101	80-120	
Barium	mg/L	.1	0.10	101	80-120	
Beryllium	mg/L	.1	0.10	105	80-120	
Boron	mg/L	1	1.1	105	80-120	
Cadmium	mg/L	.1	0.11	105	80-120	
Calcium	mg/L	1	1.0	104	80-120	
Chromium	mg/L	.1	0.099	99	80-120	
Cobalt	mg/L	.1	0.10	100	80-120	
Lead	mg/L	.1	0.10	102	80-120	
Lithium	mg/L	.1	0.10	100	80-120	
Molybdenum	mg/L	.1	0.11	105	80-120	
Selenium	mg/L	.1	0.11	105	80-120	
Thallium	mg/L	.1	0.10	103	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 44993 44994

Parameter	Units	267122012 Result	MS		MSD		MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
			Spike Conc.	MS Result	MSD Result							
Antimony	mg/L	ND	.1	0.11	0.11	106	109	75-125	3	20		

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 267125

Parameter	Units	MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 44993		44994		MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	Max RPD	RPD	Qual
		267122012 Result	MS Spike Conc.	MSD Spike Conc.	MS Result								
Arsenic	mg/L	ND	.1	.1	0.11	0.11	108	110	75-125	2	20		
Barium	mg/L	0.036	.1	.1	0.14	0.13	101	98	75-125	2	20		
Beryllium	mg/L	0.00018J	.1	.1	0.094	0.095	94	95	75-125	2	20		
Boron	mg/L	3.6	1	1	4.5	4.5	92	96	75-125	1	20		
Cadmium	mg/L	0.00091J	.1	.1	0.11	0.11	105	109	75-125	3	20		
Calcium	mg/L	71.0	1	1	69.6	69.9	-140	-112	75-125	0	20	M6	
Chromium	mg/L	ND	.1	.1	0.098	0.099	97	98	75-125	1	20		
Cobalt	mg/L	0.011	.1	.1	0.11	0.11	98	100	75-125	2	20		
Lead	mg/L	ND	.1	.1	0.10	0.10	100	100	75-125	0	20		
Lithium	mg/L	0.0036J	.1	.1	0.094	0.097	90	93	75-125	3	20		
Molybdenum	mg/L	ND	.1	.1	0.10	0.11	104	108	75-125	3	20		
Selenium	mg/L	0.0017J	.1	.1	0.11	0.11	105	108	75-125	4	20		
Thallium	mg/L	ND	.1	.1	0.10	0.10	102	103	75-125	1	20		

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 267125

QC Batch:	9943	Analysis Method:	SM 2540C
QC Batch Method:	SM 2540C	Analysis Description:	2540C Total Dissolved Solids
Associated Lab Samples:	267125001, 267125002, 267125003		

LABORATORY CONTROL SAMPLE: 45065

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	400	415	104	84-108	

SAMPLE DUPLICATE: 45066

Parameter	Units	267107001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	523	522	0	10	

SAMPLE DUPLICATE: 45067

Parameter	Units	267122011 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	432	437	1	10	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 267125

QC Batch: 9906 Analysis Method: EPA 300.0
QC Batch Method: EPA 300.0 Analysis Description: 300.0 IC Anions
Associated Lab Samples: 267125001, 267125002, 267125003

METHOD BLANK: 44919 Matrix: Water
Associated Lab Samples: 267125001, 267125002, 267125003

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Chloride	mg/L	0.095J	0.25	0.024	07/17/18 18:53	
Fluoride	mg/L	ND	0.30	0.029	07/17/18 18:53	
Sulfate	mg/L	ND	1.0	0.017	07/17/18 18:53	

LABORATORY CONTROL SAMPLE: 44920

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	10	10.2	102	90-110	
Fluoride	mg/L	10	10.1	101	90-110	
Sulfate	mg/L	10	9.9	99	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 44921 44922

Parameter	Units	267107001 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
Chloride	mg/L	6.3	10	10	15.8	15.8	95	95	90-110	0	15	
Fluoride	mg/L	0.17J	10	10	10.1	10.0	99	99	90-110	0	15	
Sulfate	mg/L	84.9	10	10	84.5	84.4	-4	-5	90-110	0	15	E,M1

MATRIX SPIKE SAMPLE: 44923

Parameter	Units	267107002 Result	Spike Conc.	MS Result	MS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	6.3	10	15.7	94	90-110	
Fluoride	mg/L	0.18J	10	10.0	98	90-110	
Sulfate	mg/L	86.0	10	83.9	-21	90-110	E,M1

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: Plant McDonough Ash Ponds

Pace Project No.: 267125

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

ANALYTE QUALIFIERS

E Analyte concentration exceeded the calibration range. The reported result is estimated.

M1 Matrix spike recovery exceeded QC limits. Batch accepted based on laboratory control sample (LCS) recovery.

M6 Matrix spike and Matrix spike duplicate recovery not evaluated against control limits due to sample dilution.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Ash Ponds

Pace Project No.: 267125

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
267125001	DGWC-67	EPA 3005A	9925	EPA 6020B	10137
267125002	DGWC-68A	EPA 3005A	9925	EPA 6020B	10137
267125003	DGWC-69	EPA 3005A	9925	EPA 6020B	10137
267125001	DGWC-67	EPA 7470A	9896	EPA 7470A	9944
267125002	DGWC-68A	EPA 7470A	9896	EPA 7470A	9944
267125003	DGWC-69	EPA 7470A	9896	EPA 7470A	9944
267125001	DGWC-67	SM 2540C	9943		
267125002	DGWC-68A	SM 2540C	9943		
267125003	DGWC-69	SM 2540C	9943		
267125001	DGWC-67	EPA 300.0	9906		
267125002	DGWC-68A	EPA 300.0	9906		
267125003	DGWC-69	EPA 300.0	9906		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

Sample Condition Upon Receipt

Face Analytical

Client Name: GIA Power

Project # _____

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: _____

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other _____

Thermometer Used 8.3 Type of Ice: Wet Blue None Samples on ice, cooling process has begun

Cooler Temperature 1.5 Biological Tissue is Frozen: Yes No

Temp should be above freezing to 6°C

Comments: _____

WO#: 267125

PM: BM

Due Date: 07/20/18

CLIENT: GAPower=CCR

Date and Initials of person examining contents: 7/13/18 MR

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.		
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.		
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.		
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.		
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.		
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.		
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.		
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.		
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.		
Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.		
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.		
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.		
-Includes date/time/ID/Analysis Matrix:	<u>GW</u>			
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.		
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed	Lot # of added preservative	
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.		
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.		
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.		
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A			
Pace Trip Blank Lot # (if purchased):				

Client Notification/ Resolution:

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: _____

Field Data Required? Y N

Project Manager Review: _____

Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEH-NR Certification Office i.e. out of hold, incorrect preservative, out of temp, incorrect containers

August 09, 2018

Joju Abraham
Georgia Power - Coal Combustion Residuals
2480 Maner Road
Atlanta, GA 30339

RE: Project: Plant McDonough Ash Ponds
Pace Project No.: 267126

Dear Joju Abraham:

Enclosed are the analytical results for sample(s) received by the laboratory on July 13, 2018. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Betsy McDaniel
betsy.mcdaniel@pacelabs.com
(770)734-4200
Project Manager

Enclosures

cc: Kristen Jurinko, Golder Associates Inc.
Julie Lehrman, Golder Associates Inc.
Maria Padilla, Georgia Power
Dawn Prell, Golder Associates Inc.
Tim Richards, Golder Associates - Atlanta
Rebecca Thornton, Pace Analytical Atlanta



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: Plant McDonough Ash Ponds
Pace Project No.: 267126

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601
ANAB DOD-ELAP Rad Accreditation #: L2417
Alabama Certification #: 41590
Arizona Certification #: AZ0734
Arkansas Certification
California Certification #: 04222CA
Colorado Certification #: PA01547
Connecticut Certification #: PH-0694
Delaware Certification
EPA Region 4 DW Rad
Florida/TNI Certification #: E87683
Georgia Certification #: C040
Guam Certification
Hawaii Certification
Idaho Certification
Illinois Certification
Indiana Certification
Iowa Certification #: 391
Kansas/TNI Certification #: E-10358
Kentucky Certification #: KY90133
KY WW Permit #: KY0098221
KY WW Permit #: KY0000221
Louisiana DHH/TNI Certification #: LA180012
Louisiana DEQ/TNI Certification #: 4086
Maine Certification #: 2017020
Maryland Certification #: 308
Massachusetts Certification #: M-PA1457
Michigan/PADEP Certification #: 9991

Missouri Certification #: 235
Montana Certification #: Cert0082
Nebraska Certification #: NE-OS-29-14
Nevada Certification #: PA014572018-1
New Hampshire/TNI Certification #: 297617
New Jersey/TNI Certification #: PA051
New Mexico Certification #: PA01457
New York/TNI Certification #: 10888
North Carolina Certification #: 42706
North Dakota Certification #: R-190
Ohio EPA Rad Approval: #41249
Oregon/TNI Certification #: PA200002-010
Pennsylvania/TNI Certification #: 65-00282
Puerto Rico Certification #: PA01457
Rhode Island Certification #: 65-00282
South Dakota Certification
Tennessee Certification #: 02867
Texas/TNI Certification #: T104704188-17-3
Utah/TNI Certification #: PA014572017-9
USDA Soil Permit #: P330-17-00091
Vermont Dept. of Health: ID# VT-0282
Virgin Island/PADEP Certification
Virginia/VELAP Certification #: 9526
Washington Certification #: C868
West Virginia DEP Certification #: 143
West Virginia DHHR Certification #: 9964C
Wisconsin Approve List for Rad
Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: Plant McDonough Ash Ponds
Pace Project No.: 267126

Lab ID	Sample ID	Matrix	Date Collected	Date Received
267126001	DGWC-67	Water	07/13/18 08:25	07/13/18 11:10
267126002	DGWC-68A	Water	07/13/18 08:15	07/13/18 11:10
267126003	DGWC-69	Water	07/13/18 08:20	07/13/18 11:10

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds

Pace Project No.: 267126

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
267126001	DGWC-67	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
267126002	DGWC-68A	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
267126003	DGWC-69	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267126

Sample: DGWC-67 **Lab ID: 267126001** Collected: 07/13/18 08:25 Received: 07/13/18 11:10 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.228 ± 0.145 (0.248) C:98% T:NA	pCi/L	07/30/18 08:58	13982-63-3	
Radium-228	EPA 9320	0.439 ± 0.512 (1.08) C:61% T:77%	pCi/L	08/02/18 16:26	15262-20-1	
Total Radium	Total Radium Calculation	0.667 ± 0.657 (1.33)	pCi/L	08/06/18 12:27	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267126

Sample: DGWC-68A **Lab ID: 267126002** Collected: 07/13/18 08:15 Received: 07/13/18 11:10 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.175 ± 0.143 (0.269) C:84% T:NA	pCi/L	07/30/18 08:58	13982-63-3	
Radium-228	EPA 9320	0.232 ± 0.490 (1.08) C:61% T:78%	pCi/L	08/02/18 16:26	15262-20-1	
Total Radium	Total Radium Calculation	0.407 ± 0.633 (1.35)	pCi/L	08/06/18 12:27	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267126

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.694 ± 0.227 (0.220) C:93% T:NA	pCi/L	07/30/18 09:31	13982-63-3	
Radium-228	EPA 9320	0.664 ± 0.570 (1.15) C:57% T:85%	pCi/L	08/02/18 16:27	15262-20-1	
Total Radium	Total Radium Calculation	1.36 ± 0.797 (1.37)	pCi/L	08/06/18 12:27	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267126

QC Batch: 306540

Analysis Method: EPA 9315

QC Batch Method: EPA 9315

Analysis Description: 9315 Total Radium

Associated Lab Samples: 267126001, 267126002, 267126003

METHOD BLANK: 1498647

Matrix: Water

Associated Lab Samples: 267126001, 267126002, 267126003

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.216 ± 0.130 (0.183) C:89% T:NA	pCi/L	07/30/18 08:58	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267126

QC Batch: 306539

Analysis Method: EPA 9320

QC Batch Method: EPA 9320

Analysis Description: 9320 Radium 228

Associated Lab Samples: 267126001, 267126002, 267126003

METHOD BLANK: 1498646

Matrix: Water

Associated Lab Samples: 267126001, 267126002, 267126003

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.687 ± 0.426 (0.797) C:69% T:81%	pCi/L	08/02/18 13:03	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: Plant McDonough Ash Ponds
Pace Project No.: 267126

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

LABORATORIES

PASI-PA Pace Analytical Services - Greensburg

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Ash Ponds
Pace Project No.: 267126

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
267126001	DGWC-67	EPA 9315	306540		
267126002	DGWC-68A	EPA 9315	306540		
267126003	DGWC-69	EPA 9315	306540		
267126001	DGWC-67	EPA 9320	306539		
267126002	DGWC-68A	EPA 9320	306539		
267126003	DGWC-69	EPA 9320	306539		
267126001	DGWC-67	Total Radium Calculation	308501		
267126002	DGWC-68A	Total Radium Calculation	308501		
267126003	DGWC-69	Total Radium Calculation	308501		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CHAIN OF CUSTODY RECORD

Pace Analytical Services, Inc.
 110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
 (770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CLIENT NAME: Georgia Power CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185 Atlanta, GA 30308 404-506-7239 REPORT TO: Dawn Prell (Dawn_Prell@golder.com) REQUESTED COMPLETION DATE: kitirinko@golder.com FO #: laburch@southernco.com PROJECT NAME/STATE: Plant McDonough AP PROJECT #: Phase II CCR		CONTAINER TYPE: PRESERVATION: # of C O N T A I N E R S		ANALYSIS REQUESTED			CONTAINER TYPE P - PLASTIC A - AMBER GLASS G - CLEAR GLASS V - VOA VIAL S - STERILE O - OTHER PRESERVATION 1 - HCl, 56°C 2 - H ₂ SO ₄ , 56°C 3 - HNO ₃ 4 - NaOH, 56°C 5 - NaOH/ZnAc, 56°C 6 - Na ₂ S ₂ O ₃ , 56°C 7 - 56°C not frozen	
Collection DATE 07/13/18 07/13/18 07/13/18	Collection TIME 0825 0815 0820	MATRIX CODE* GW GW GW	COG O R M A P B	SAMPLE IDENTIFICATION DGWC-67 DGWC-68A DGWC-69	Metals App. III & IV (EPA 6020/7470) Cl, T, SO ₄ & TDS (EPA 300.0 & SM 2540C) Radium 226 & 228 (SW-845 9315/9320)	3 7 3	P P P	LAB #: 0920
SAMPLED BY AND TITLE: Ben Hodges Field Lead			RELINQUISHED BY: <i>[Signature]</i>			DATE/TIME: 7/13/18 0920		FOR LAB USE ONLY LAB #: Entered into LIMS: Tracking #:
RECEIVED BY: Mike Navra			RELINQUISHED BY: <i>[Signature]</i>			DATE/TIME: 7/13/18 0920		
RECEIVED BY LAB: Pace Analytical			SAMPLE SHIPPED VIA: UPS Courier			DATE/TIME: 7/13/18 1100		OTHER FS
Checked: No NA No NA Yes Yes			Temperature: Min: 1.5 Max:			Other FS		

W0#: 267126



July 13 2018 Plant McDonough COC Phase II CCR

Sample Condition Upon Receipt

Face Analytical

Client Name: GIA Power

Project #

WO#: 267126

PM: BM

Due Date: 08/10/18

CLIENT: GA Power-CCR

Courier: Fed Ex UPS USPS Client Commercial Pace Other

Tracking #: _____

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other

Thermometer Used 8.3 Type of Ice: Wet Blue None Samples on ice, cooling process has begun

Cooler Temperature 1.5 Biological Tissue is Frozen: Yes No

Temp should be above freezing to 6°C

Comments:

Date and Initials of person examining contents: 7/13/18 MR

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.		
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.		
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.		
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.		
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.		
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.		
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.		
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.		
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.		
Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.		
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.		
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.		
Includes date/time/ID/Analysis Matrix:	<u>GIA</u>			
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.		
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed	Lot # of added preservative	
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.		
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.		
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.		
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A			
Pace Trip Blank Lot # (if purchased):	_____			

Client Notification/ Resolution:

Field Data Required?

Y N

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: _____

Project Manager Review: _____

Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office i.e. out of hold, incorrect preservative, out of temp, incorrect containers.

August 09, 2018

Joju Abraham
Georgia Power - Coal Combustion Residuals
2480 Maner Road
Atlanta, GA 30339

RE: Project: Plant McDonough Ash Ponds
Pace Project No.: 267129

Dear Joju Abraham:

Enclosed are the analytical results for sample(s) received by the laboratory on July 13, 2018. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Betsy McDaniel
betsy.mcdaniel@pacelabs.com
(770)734-4200
Project Manager

Enclosures

cc: Kristen Jurinko, Golder Associates Inc.
Julie Lehrman, Golder Associates Inc.
Maria Padilla, Georgia Power
Dawn Prell, Golder Associates Inc.
Tim Richards, Golder Associates - Atlanta
Rebecca Thornton, Pace Analytical Atlanta



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: Plant McDonough Ash Ponds
Pace Project No.: 267129

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601
ANAB DOD-ELAP Rad Accreditation #: L2417
Alabama Certification #: 41590
Arizona Certification #: AZ0734
Arkansas Certification
California Certification #: 04222CA
Colorado Certification #: PA01547
Connecticut Certification #: PH-0694
Delaware Certification
EPA Region 4 DW Rad
Florida/TNI Certification #: E87683
Georgia Certification #: C040
Guam Certification
Hawaii Certification
Idaho Certification
Illinois Certification
Indiana Certification
Iowa Certification #: 391
Kansas/TNI Certification #: E-10358
Kentucky Certification #: KY90133
KY WW Permit #: KY0098221
KY WW Permit #: KY0000221
Louisiana DHH/TNI Certification #: LA180012
Louisiana DEQ/TNI Certification #: 4086
Maine Certification #: 2017020
Maryland Certification #: 308
Massachusetts Certification #: M-PA1457
Michigan/PADEP Certification #: 9991

Missouri Certification #: 235
Montana Certification #: Cert0082
Nebraska Certification #: NE-OS-29-14
Nevada Certification #: PA014572018-1
New Hampshire/TNI Certification #: 297617
New Jersey/TNI Certification #: PA051
New Mexico Certification #: PA01457
New York/TNI Certification #: 10888
North Carolina Certification #: 42706
North Dakota Certification #: R-190
Ohio EPA Rad Approval: #41249
Oregon/TNI Certification #: PA200002-010
Pennsylvania/TNI Certification #: 65-00282
Puerto Rico Certification #: PA01457
Rhode Island Certification #: 65-00282
South Dakota Certification
Tennessee Certification #: 02867
Texas/TNI Certification #: T104704188-17-3
Utah/TNI Certification #: PA014572017-9
USDA Soil Permit #: P330-17-00091
Vermont Dept. of Health: ID# VT-0282
Virgin Island/PADEP Certification
Virginia/VELAP Certification #: 9526
Washington Certification #: C868
West Virginia DEP Certification #: 143
West Virginia DHHR Certification #: 9964C
Wisconsin Approve List for Rad
Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267129

Lab ID	Sample ID	Matrix	Date Collected	Date Received
267129001	DGWA-53 Filtered	Water	07/12/18 08:40	07/13/18 11:10

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds
Pace Project No.: 267129

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
267129001	DGWA-53 Filtered	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267129

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	1.97 ± 0.426 (0.209) C:94% T:NA	pCi/L	07/30/18 08:58	13982-63-3	
Radium-228	EPA 9320	0.946 ± 0.611 (1.17) C:57% T:76%	pCi/L	08/02/18 13:03	15262-20-1	
Total Radium	Total Radium Calculation	2.92 ± 1.04 (1.38)	pCi/L	08/06/18 12:27	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267129

QC Batch: 306540

Analysis Method: EPA 9315

QC Batch Method: EPA 9315

Analysis Description: 9315 Total Radium

Associated Lab Samples: 267129001

METHOD BLANK: 1498647

Matrix: Water

Associated Lab Samples: 267129001

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.216 ± 0.130 (0.183) C:89% T:NA	pCi/L	07/30/18 08:58	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 267129

QC Batch: 306539

Analysis Method: EPA 9320

QC Batch Method: EPA 9320

Analysis Description: 9320 Radium 228

Associated Lab Samples: 267129001

METHOD BLANK: 1498646

Matrix: Water

Associated Lab Samples: 267129001

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.687 ± 0.426 (0.797) C:69% T:81%	pCi/L	08/02/18 13:03	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: Plant McDonough Ash Ponds
Pace Project No.: 267129

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

LABORATORIES

PASI-PA Pace Analytical Services - Greensburg

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Ash Ponds

Pace Project No.: 267129

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
267129001	DGWA-53 Filtered	EPA 9315	306540		
267129001	DGWA-53 Filtered	EPA 9320	306539		
267129001	DGWA-53 Filtered	Total Radium Calculation	308501		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



Pace Analytical Services, Inc.
110 TECHNOLOGY PARKWAY, PEACHTREE CORNERS, GA 30092
(770) 734-4200 : FAX (770) 734-4201 : www.asi-lab.com

CHAIN OF CUSTODY RECORD

CLIENT NAME: Georgia Power CLIENT ADDRESS/PHONE NUMBER/FAX NUMBER: 241 Ralph McGill Blvd SE B10185 Atlanta, GA 30308 404-506-7239 REPORT TO: Dawn Prell (Dawn_Prell@golder.com) REQUESTED COMPLETION DATE: laburchi@southernco.com PROJECT NAME/STATE: Plant McDonough AP PROJECT #: Phase II CCR		ANALYSIS REQUESTED CONTAINER TYPE: 3 PRESERVATION: 3 # of CONTAINERS: 4		CONTAINER TYPE P - PLASTIC A - AMBER GLASS G - CLEAR GLASS V - VOA VIAL S - STERILE O - OTHER		PRESERVATION 1 - HCl, 56°C 2 - H ₂ SO ₄ , 56°C 3 - HNO ₃ 4 - NaOH, 58°C 5 - NaOH/ZnAc, 56°C 6 - Na ₂ S ₂ O ₃ , 56°C 7 - 56°C not frozen	
CONTAINER TYPE DW - DRINKING WATER WW - WASTEWATER GW - GROUNDWATER SW - SURFACE WATER ST - STORM WATER W - WATER		MATRIX CODES: S - SOIL SL - SLUDGE SD - SOLID A - AIR L - LIQUID P - PRODUCT		REMARKS/ADDITIONAL INFORMATION FIELD FILTERED		LAB #: 267129 	
RELINQUISHED BY: DATE/TIME: 7/12/18 1800 RELINQUISHED BY: DATE/TIME: 7/17/18 0920		SAMPLE SHIPPED VIA: UPS FED-EX USPS COURIER CLIENT OTHER FS Intact Broken Not Present		COOLER ID: # of Coolers		ENTERED INTO LIMS: Tracking #:	
SAMPLED BY AND TITLE: Ben Hodges Field Lead RECEIVED BY LAB: Mike Nguyen RECEIVED BY: Mike Nguyen Temperature: 1.5 Max: 1.5 Min: 1.5		DATE/TIME: 7/12/18 1800 DATE/TIME: 7/17/18 0920		DATE/TIME: 7/17/18 0920 DATE/TIME: 7/17/18 0920		DATE/TIME: 7/17/18 0920 DATE/TIME: 7/17/18 0920	
Collection DATE 07/12/18 Collection TIME 0840 MATRIX CODE GW GRA x OR AB SAMPLE IDENTIFICATION DGWA-53 FILTERED		Analysis Requested Dissolved Metals App. III & IV (EPA 6020/7470) Cl, F, SO ₄ & TDS (EPA 300.0 & SM 2540C) Radium 226 & 228 (SW-846 9815/9320)		Container Type P 3 A 7 G 3		Analysis Requested P 3 A 7 G 3	

Sample Condition Upon Receipt

Face Analytical

Client Name: GLA Power

Project # _____

Courier: Fed Ex UPS USPS Client Commercial Face Other

Tracking #: _____

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other _____

Thermometer Used 83 Type of Ice: Wet Blue None

Cooler Temperature 1.5 Biological Tissue is Frozen: Yes No

Temp should be above freezing to 6°C

Comments: _____

WO#: 267129

PM: **BM**

Due Date: **08/10/18**

CLIENT: **GA Power=CCR**

Samples on ice, cooling process has begun

Date and Initials of person examining contents: 7/13/18 MR

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.		
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.		
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.		
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.		
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.		
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.		
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.		
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.		
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.		
-Face Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.		
Filtered volume received for Dissolved tests	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.		
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.		
-Includes date/time/ID/Analysis Matrix: <u>GLW</u>				
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.		
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed	Lot # of added preservative	
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.		
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.		
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.		
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A			
Face Trip Blank Lot # (if purchased): _____				

Client Notification/ Resolution:

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: _____

Field Data Required? Y N

Project Manager Review: _____

Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples a copy of this form will be sent to the North Carolina DEHNP Certification Office i.e. out of hold, incorrect preservative, out of temp, incorrect containers

LABORATORY ANALYTICAL DATA

November 2018

November 15, 2018

Joju Abraham
Georgia Power - Coal Combustion Residuals
2480 Maner Road
Atlanta, GA 30339


RE: Project: Plant McDonough Ash Ponds
Pace Project No.: 2611272

Dear Joju Abraham:

Enclosed are the analytical results for sample(s) received by the laboratory on November 07, 2018. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Betsy McDaniel
betsy.mcdaniel@pacelabs.com
(770)734-4200
Project Manager

Enclosures

cc: Kristen Jurinko, Golder Associates Inc.
Julie Lehrman, Golder Associates Inc.
Maria Padilla, Georgia Power
Dawn Prell, Golder Associates Inc.
Tim Richards, Golder Associates - Atlanta
Rebecca Thornton, Pace Analytical Atlanta



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611272

Atlanta Certification IDs

110 Technology Parkway Peachtree Corners, GA 30092

Florida DOH Certification #: E87315

Georgia DW Inorganics Certification #: 812

Georgia DW Microbiology Certification #: 812

North Carolina Certification #: 381

South Carolina Certification #: 98011001

Texas Certification #: T104704397-08-TX

Virginia Certification #: 460204

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611272

Lab ID	Sample ID	Matrix	Date Collected	Date Received
2611272001	DGWA-70A	Water	11/06/18 12:30	11/07/18 10:30
2611272002	DGWA-71	Water	11/06/18 13:45	11/07/18 10:30

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611272

Lab ID	Sample ID	Method	Analysts	Analytes Reported
2611272001	DGWA-70A	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
2611272002	DGWA-71	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611272

Sample: DGWA-70A		Lab ID: 2611272001		Collected: 11/06/18 12:30		Received: 11/07/18 10:30		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	11/12/18 14:18	11/13/18 17:16	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	11/12/18 14:18	11/13/18 17:16	7440-38-2		
Barium	0.037	mg/L	0.010	0.00078	1	11/12/18 14:18	11/13/18 17:16	7440-39-3		
Beryllium	0.00012J	mg/L	0.0030	0.000050	1	11/12/18 14:18	11/13/18 17:16	7440-41-7		
Boron	0.0065J	mg/L	0.040	0.0039	1	11/12/18 14:18	11/13/18 17:16	7440-42-8		
Cadmium	ND	mg/L	0.0010	0.000093	1	11/12/18 14:18	11/13/18 17:16	7440-43-9		
Calcium	5.5	mg/L	2.5	0.069	5	11/12/18 14:18	11/14/18 18:27	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	11/12/18 14:18	11/13/18 17:16	7440-47-3		
Cobalt	ND	mg/L	0.010	0.00052	1	11/12/18 14:18	11/13/18 17:16	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	11/12/18 14:18	11/13/18 17:16	7439-92-1		
Lithium	ND	mg/L	0.050	0.00097	1	11/12/18 14:18	11/13/18 17:16	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	11/12/18 14:18	11/13/18 17:16	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	11/12/18 14:18	11/13/18 17:16	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	11/12/18 14:18	11/13/18 17:16	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	11/12/18 10:45	11/12/18 16:28	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	65.0	mg/L	25.0	10.0	1		11/12/18 09:58			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	2.3	mg/L	0.25	0.024	1		11/13/18 16:59	16887-00-6		
Fluoride	ND	mg/L	0.30	0.029	1		11/13/18 16:59	16984-48-8		
Sulfate	0.12J	mg/L	1.0	0.017	1		11/13/18 16:59	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611272

Sample: DGWA-71		Lab ID: 2611272002		Collected: 11/06/18 13:45		Received: 11/07/18 10:30		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	11/12/18 14:18	11/13/18 17:28	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	11/12/18 14:18	11/13/18 17:28	7440-38-2		
Barium	0.026	mg/L	0.010	0.00078	1	11/12/18 14:18	11/13/18 17:28	7440-39-3		
Beryllium	0.00013J	mg/L	0.0030	0.000050	1	11/12/18 14:18	11/13/18 17:28	7440-41-7		
Boron	0.0067J	mg/L	0.040	0.0039	1	11/12/18 14:18	11/13/18 17:28	7440-42-8		
Cadmium	ND	mg/L	0.0010	0.000093	1	11/12/18 14:18	11/13/18 17:28	7440-43-9		
Calcium	5.7	mg/L	2.5	0.069	5	11/12/18 14:18	11/14/18 18:33	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	11/12/18 14:18	11/13/18 17:28	7440-47-3		
Cobalt	ND	mg/L	0.010	0.00052	1	11/12/18 14:18	11/13/18 17:28	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	11/12/18 14:18	11/13/18 17:28	7439-92-1		
Lithium	0.0014J	mg/L	0.050	0.00097	1	11/12/18 14:18	11/13/18 17:28	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	11/12/18 14:18	11/13/18 17:28	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	11/12/18 14:18	11/13/18 17:28	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	11/12/18 14:18	11/13/18 17:28	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	0.000041J	mg/L	0.00050	0.000036	1	11/12/18 10:45	11/12/18 16:45	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	85.0	mg/L	25.0	10.0	1		11/12/18 09:58			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	2.6	mg/L	0.25	0.024	1		11/13/18 18:01	16887-00-6		
Fluoride	ND	mg/L	0.30	0.029	1		11/13/18 18:01	16984-48-8		
Sulfate	7.3	mg/L	1.0	0.017	1		11/13/18 18:01	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611272

QC Batch: 16833

Analysis Method: EPA 7470A

QC Batch Method: EPA 7470A

Analysis Description: 7470 Mercury

Associated Lab Samples: 2611272001, 2611272002

METHOD BLANK: 75562

Matrix: Water

Associated Lab Samples: 2611272001, 2611272002

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Mercury	mg/L	ND	0.00050	0.000036	11/12/18 16:19	

LABORATORY CONTROL SAMPLE: 75563

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Mercury	mg/L	.0025	0.0025	102	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 75564

75565

Parameter	Units	2611272001		2611272002		MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	Max RPD	Qual
		Result	MS Spike Conc.	MSD Spike Conc.	MSD Spike Conc.							
Mercury	mg/L	ND	.0025	.0025	0.0022	0.0025	90	101	75-125	11	20	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611272

QC Batch: 16990 Analysis Method: EPA 6020B
QC Batch Method: EPA 3005A Analysis Description: 6020B MET
Associated Lab Samples: 2611272001, 2611272002

METHOD BLANK: 76661 Matrix: Water
Associated Lab Samples: 2611272001, 2611272002

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Antimony	mg/L	ND	0.0030	0.00078	11/13/18 17:05	
Arsenic	mg/L	ND	0.0050	0.00057	11/13/18 17:05	
Barium	mg/L	ND	0.010	0.00078	11/13/18 17:05	
Beryllium	mg/L	ND	0.0030	0.000050	11/13/18 17:05	
Boron	mg/L	ND	0.040	0.0039	11/13/18 17:05	
Cadmium	mg/L	ND	0.0010	0.000093	11/13/18 17:05	
Calcium	mg/L	ND	0.50	0.014	11/13/18 17:05	
Chromium	mg/L	ND	0.010	0.0016	11/13/18 17:05	
Cobalt	mg/L	ND	0.010	0.00052	11/13/18 17:05	
Lead	mg/L	ND	0.0050	0.00027	11/13/18 17:05	
Lithium	mg/L	ND	0.050	0.00097	11/13/18 17:05	
Molybdenum	mg/L	ND	0.010	0.0019	11/13/18 17:05	
Selenium	mg/L	ND	0.010	0.0014	11/13/18 17:05	
Thallium	mg/L	ND	0.0010	0.00014	11/13/18 17:05	

LABORATORY CONTROL SAMPLE: 76662

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Antimony	mg/L	.1	0.099	99	80-120	
Arsenic	mg/L	.1	0.10	102	80-120	
Barium	mg/L	.1	0.098	98	80-120	
Beryllium	mg/L	.1	0.10	101	80-120	
Boron	mg/L	1	0.99	99	80-120	
Cadmium	mg/L	.1	0.098	98	80-120	
Calcium	mg/L	1	0.99	99	80-120	
Chromium	mg/L	.1	0.10	100	80-120	
Cobalt	mg/L	.1	0.10	100	80-120	
Lead	mg/L	.1	0.099	99	80-120	
Lithium	mg/L	.1	0.10	102	80-120	
Molybdenum	mg/L	.1	0.10	101	80-120	
Selenium	mg/L	.1	0.10	104	80-120	
Thallium	mg/L	.1	0.099	99	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 76663 76664

Parameter	Units	2611389006 Result	MS		MSD		MS % Rec	MSD % Rec	% Rec Limits	Max RPD	Qual
			Spike Conc.	MS Result	MSD Spike Conc.	MSD Result					
Antimony	mg/L	ND	.1	0.099	.1	0.10	99	100	75-125	1	20

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611272

Parameter	Units	2611389006		76663		76664		% Rec	% Rec	% Rec	Limits	RPD	Max RPD	Qual
		MS Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec							
Arsenic	mg/L	0.0012J	.1	.1	0.10	0.11	100	104	75-125	4	20			
Barium	mg/L	0.024	.1	.1	0.12	0.12	95	96	75-125	1	20			
Beryllium	mg/L	0.0020J	.1	.1	0.10	0.10	100	100	75-125	1	20			
Boron	mg/L	2.6	1	1	3.2	3.1	56	51	75-125	2	20	M1		
Cadmium	mg/L	0.00031J	.1	.1	0.096	0.097	95	97	75-125	1	20			
Calcium	mg/L	81.7	1	1	83.3	79.1	159	-263	75-125	5	20	M6		
Chromium	mg/L	0.0028J	.1	.1	0.10	0.10	97	97	75-125	0	20			
Cobalt	mg/L	0.048	.1	.1	0.14	0.14	96	95	75-125	0	20			
Lead	mg/L	ND	.1	.1	0.094	0.093	94	93	75-125	0	20			
Lithium	mg/L	0.0034J	.1	.1	0.10	0.10	99	100	75-125	1	20			
Molybdenum	mg/L	ND	.1	.1	0.098	0.099	98	99	75-125	2	20			
Selenium	mg/L	0.0068J	.1	.1	0.11	0.12	103	109	75-125	5	20			
Thallium	mg/L	0.00052J	.1	.1	0.093	0.095	92	94	75-125	2	20			

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611272

QC Batch: 16943 Analysis Method: SM 2540C
QC Batch Method: SM 2540C Analysis Description: 2540C Total Dissolved Solids
Associated Lab Samples: 2611272001, 2611272002

LABORATORY CONTROL SAMPLE: 76546

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	400	405	101	84-108	

SAMPLE DUPLICATE: 76547

Parameter	Units	2611269010 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	23.0J	18.0J	24	10	D6

SAMPLE DUPLICATE: 76548

Parameter	Units	2611389001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	504	495	2	10	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611272

QC Batch: 17032 Analysis Method: EPA 300.0
QC Batch Method: EPA 300.0 Analysis Description: 300.0 IC Anions
Associated Lab Samples: 2611272001, 2611272002

METHOD BLANK: 76760 Matrix: Water
Associated Lab Samples: 2611272001, 2611272002

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Chloride	mg/L	0.12J	0.25	0.024	11/13/18 16:17	
Fluoride	mg/L	ND	0.30	0.029	11/13/18 16:17	
Sulfate	mg/L	ND	1.0	0.017	11/13/18 16:17	

LABORATORY CONTROL SAMPLE: 76761

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	10	10.2	102	90-110	
Fluoride	mg/L	10	9.9	99	90-110	
Sulfate	mg/L	10	9.9	99	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 76762 76763

Parameter	Units	2611272001 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
Chloride	mg/L	2.3	10	10	12.4	12.5	101	102	90-110	0	15	
Fluoride	mg/L	ND	10	10	10.3	10.3	103	103	90-110	0	15	
Sulfate	mg/L	0.12J	10	10	10.4	10.8	103	107	90-110	4	15	

MATRIX SPIKE SAMPLE: 76764

Parameter	Units	2611272002 Result	Spike Conc.	MS Result	MS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L		2.6	10	13.0	105	90-110
Fluoride	mg/L		ND	10	10.2	102	90-110
Sulfate	mg/L		7.3	10	17.7	104	90-110

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611272

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

ANALYTE QUALIFIERS

D6 The precision between the sample and sample duplicate exceeded laboratory control limits.

M1 Matrix spike recovery exceeded QC limits. Batch accepted based on laboratory control sample (LCS) recovery.

M6 Matrix spike and Matrix spike duplicate recovery not evaluated against control limits due to sample dilution.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611272

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
2611272001	DGWA-70A	EPA 3005A	16990	EPA 6020B	17017
2611272002	DGWA-71	EPA 3005A	16990	EPA 6020B	17017
2611272001	DGWA-70A	EPA 7470A	16833	EPA 7470A	17021
2611272002	DGWA-71	EPA 7470A	16833	EPA 7470A	17021
2611272001	DGWA-70A	SM 2540C	16943		
2611272002	DGWA-71	SM 2540C	16943		
2611272001	DGWA-70A	EPA 300.0	17032		
2611272002	DGWA-71	EPA 300.0	17032		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



CHAIN-OF-CUSTODY / Analytical Request Document

The Chain-of-Custody is a LEGAL DOCUMENT. All relevant fields must be completed accurately.

Section A Required Client Information: **Section B** Required Project Information: **Section C** Invoice Information:

Company: **GA Power - CCR** Report To: **Joju Abraham** Attention: **SCSInvoices@southnet.com**
 Address: **2480 Maner Road** Copy To: **Goldie** Company Name: **REGULATORY AGENCY**
 Atlanta, GA 30339 Purchase Order No.: **SGS 10348606** Address: **NPDES GROUND WATER DRINKING WATER OTHER**
 Email To: **JABRAHAM@southnet.com** Project Name: **Plant McDonough Background** Site Location: **UST RCRA**
 Phone: **404-506-7411** Project Number: **166849618** State: **GA**
 Requested Due Date/TAT: **Standard** Face Project Manager: **petsy.mcdonald@epa.gov**

Page: **1** of **1**

2176019

ITEM #	Section D Required Client Information	Matrix Codes MATRIX / CODE	COLLECTED		SAMPLE TYPE (G-GRAB C-COMP)	MATRIX CODE (see valid codes to left)	SAMPLE TEMP AT COLLECTION		# OF CONTAINERS	Preservatives	Requested Analysis Filtered (Y/N)	Y/N	Analysis Tests	Face Project No./ Lab I.D.												
			COMPOSITE START	COMPOSITE END/GRAB			DATE	TIME							DATE	TIME										
1	D6WA-70A	DW			G	WT G	11/6/18	1230	6	H2SO4 HNO3 HCl NaOH Na2SO3 Methanol Other	X	X	X	X	X	X	X	X								
2	D6WA-71	WW			G	WT G	11/6/18	1345	4	Unpreserved - ICE	X	X	X	X	X	X	X	X	X	X						
3		WP																								
4		AR																								
5		TS																								
6		OT																								
7																										
8																										
9																										
10																										
11																										
12																										

WO#: 2611272

2611272

ADDITIONAL COMMENTS	RELINQUISHED BY / AFFILIATION		ACCEPTED BY / AFFILIATION		SAMPLE CONDITIONS		
	DATE	TIME	DATE	TIME	Received on Ice (Y/N)	Sealed/Cooled (Y/N)	Samples Intact (Y/N)
Karim	11-7-18	0956	Mike Nugun/Pace	11/7/18 0956			
Mike Nugun/Pace	11/7/18	1030	Michaelman	11/07/18 1030			
					0.8	X	X

SAMPLER NAME AND SIGNATURE
 PRINT Name of SAMPLER: **Karim Minkara**
 SIGNATURE of SAMPLER: *[Signature]*

ORIGINAL

*Important Note: By signing this form you are accepting Pace's NET 30 day payment terms and agreeing to late charges of 1.5% per month for any invoices not paid within 30 days.



Sample Condition Upon Receipt

Client Name: GIA Power

Project # _____

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____
Tracking #: _____

WO# : 2611272

PM: **BM** Due Date: **11/14/18**

Custody Seal on Cooler/Box Present: yes no Seals intact: yes

CLIENT: **GAPower-CCR**

Packing Material: Bubble Wrap Bubble Bags None Other _____

Thermometer Used 85 Type of Ice: Wet Blue None Samples on ice, cooling process has begun

Cooler Temperature 0.8 Biological Tissue is Frozen: Yes No

Date and Initials of person examining contents: 11/07/18 MR

Temp should be above freezing to 6°C

Comments: _____

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.		
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.		
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.		
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.		
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.		
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.		
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.		
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.		
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.		
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.		
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.		
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.		
-Includes date/time/ID/Analysis Matrix:	<u>W</u>			
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.		
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed		Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.		
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.		
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.		
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A			
Pace Trip Blank Lot # (if purchased):	_____			

Client Notification/ Resolution:

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: _____

Field Data Required? Y / N

Project Manager Review: _____ **Date:** _____

December 03, 2018

Joju Abraham
Georgia Power - Coal Combustion Residuals
2480 Maner Road
Atlanta, GA 30339

RE: Project: Plant McDonough Ash Ponds
Pace Project No.: 2611273

Dear Joju Abraham:

Enclosed are the analytical results for sample(s) received by the laboratory on November 07, 2018. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Betsy McDaniel
betsy.mcdaniel@pacelabs.com
(770)734-4200
Project Manager

Enclosures

cc: Kristen Jurinko, Golder Associates Inc.
Julie Lehrman, Golder Associates Inc.
Maria Padilla, Georgia Power
Dawn Prell, Golder Associates Inc.
Tim Richards, Golder Associates - Atlanta
Rebecca Thornton, Pace Analytical Atlanta



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611273

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601
ANAB DOD-ELAP Rad Accreditation #: L2417
Alabama Certification #: 41590
Arizona Certification #: AZ0734
Arkansas Certification
California Certification #: 04222CA
Colorado Certification #: PA01547
Connecticut Certification #: PH-0694
Delaware Certification
EPA Region 4 DW Rad
Florida/TNI Certification #: E87683
Georgia Certification #: C040
Guam Certification
Hawaii Certification
Idaho Certification
Illinois Certification
Indiana Certification
Iowa Certification #: 391
Kansas/TNI Certification #: E-10358
Kentucky Certification #: KY90133
KY WW Permit #: KY0098221
KY WW Permit #: KY0000221
Louisiana DHH/TNI Certification #: LA180012
Louisiana DEQ/TNI Certification #: 4086
Maine Certification #: 2017020
Maryland Certification #: 308
Massachusetts Certification #: M-PA1457
Michigan/PADEP Certification #: 9991

Missouri Certification #: 235
Montana Certification #: Cert0082
Nebraska Certification #: NE-OS-29-14
Nevada Certification #: PA014572018-1
New Hampshire/TNI Certification #: 297617
New Jersey/TNI Certification #: PA051
New Mexico Certification #: PA01457
New York/TNI Certification #: 10888
North Carolina Certification #: 42706
North Dakota Certification #: R-190
Ohio EPA Rad Approval: #41249
Oregon/TNI Certification #: PA200002-010
Pennsylvania/TNI Certification #: 65-00282
Puerto Rico Certification #: PA01457
Rhode Island Certification #: 65-00282
South Dakota Certification
Tennessee Certification #: 02867
Texas/TNI Certification #: T104704188-17-3
Utah/TNI Certification #: PA014572017-9
USDA Soil Permit #: P330-17-00091
Vermont Dept. of Health: ID# VT-0282
Virgin Island/PADEP Certification
Virginia/VELAP Certification #: 9526
Washington Certification #: C868
West Virginia DEP Certification #: 143
West Virginia DHHR Certification #: 9964C
Wisconsin Approve List for Rad
Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611273

Lab ID	Sample ID	Matrix	Date Collected	Date Received
2611273001	DGWA-70A	Water	11/06/18 12:30	11/07/18 10:30
2611273002	DGWA-71	Water	11/06/18 13:45	11/07/18 10:30

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611273

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
2611273001	DGWA-70A	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
2611273002	DGWA-71	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611273

Sample: DGWA-70A **Lab ID: 2611273001** Collected: 11/06/18 12:30 Received: 11/07/18 10:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.328 ± 0.213 (0.300) C:97% T:NA	pCi/L	11/29/18 08:41	13982-63-3	
Radium-228	EPA 9320	0.531 ± 0.312 (0.561) C:79% T:87%	pCi/L	11/27/18 15:07	15262-20-1	
Total Radium	Total Radium Calculation	0.859 ± 0.525 (0.861)	pCi/L	11/30/18 13:24	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611273

Sample: DGWA-71 **Lab ID: 2611273002** Collected: 11/06/18 13:45 Received: 11/07/18 10:30 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.130 ± 0.174 (0.366) C:95% T:NA	pCi/L	11/29/18 08:41	13982-63-3	
Radium-228	EPA 9320	0.325 ± 0.271 (0.539) C:78% T:100%	pCi/L	11/27/18 15:07	15262-20-1	
Total Radium	Total Radium Calculation	0.455 ± 0.445 (0.905)	pCi/L	11/30/18 13:24	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611273

QC Batch: 320566

Analysis Method: EPA 9315

QC Batch Method: EPA 9315

Analysis Description: 9315 Total Radium

Associated Lab Samples: 2611273001, 2611273002

METHOD BLANK: 1563548

Matrix: Water

Associated Lab Samples: 2611273001, 2611273002

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.196 ± 0.119 (0.189) C:97% T:NA	pCi/L	11/28/18 21:08	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611273

QC Batch: 320542

Analysis Method: EPA 9320

QC Batch Method: EPA 9320

Analysis Description: 9320 Radium 228

Associated Lab Samples: 2611273001, 2611273002

METHOD BLANK: 1563498

Matrix: Water

Associated Lab Samples: 2611273001, 2611273002

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.727 ± 0.361 (0.610) C:86% T:77%	pCi/L	11/27/18 11:48	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611273

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

LABORATORIES

PASI-PA Pace Analytical Services - Greensburg

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611273

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
2611273001	DGWA-70A	EPA 9315	320566		
2611273002	DGWA-71	EPA 9315	320566		
2611273001	DGWA-70A	EPA 9320	320542		
2611273002	DGWA-71	EPA 9320	320542		
2611273001	DGWA-70A	Total Radium Calculation	322354		
2611273002	DGWA-71	Total Radium Calculation	322354		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CHAIN-OF-CUSTODY / Analytical Request Document

The Chain-of-Custody is a LEGAL DOCUMENT. All relevant fields must be completed accurately.



Section A Required Client Information: Company: GA Power - CCR Address: 2480 Maner Road Atlanta, GA 30339 Email To: JABRAHAM@southwestern.com Phone: 404-506-7411 Fax: Requested Due Date/TAT: Standard

Section B Required Project Information: Report To: Juju Abraham Copy To: Golder Purchase Order No.: SCS 10348606 Project Name: Plant McDough Beckstrand Project Number: 166849618

Section C Invoice Information: Attention: SCSinvoic@southwestern.com Company Name: Address: Pace Quote Reference: Pace Project Manager: petya.mcdough@pacelabs.com Pace Profile #: 332.12 REGULATORY AGENCY: NPDES GROUND WATER RCRA OTHER DRINKING WATER USF RCRA OTHER STATE: 6A

Page: 1 of 1 2176019

ITEM #	Section D Required Client Information	Matrix Codes MATRIX J CODE	SAMPLE ID (A-Z, 0-9 / -)	COLLECTED		SAMPLE TYPE (G=GRAB C=COMP)	MATRIX CODE (see valid codes to left)	SAMPLER TEMP AT COLLECTION		# OF CONTAINERS	Preservatives	Requested Analysis Filtered (Y/N)	Temp in °C	Received on	Custody Sealed Cooler (Y/N)	Samples Intact (Y/N)
				COMPOSITE START	COMPOSITE END/GRAB			DATE	TIME							
1	06WA-70A	DW			11/6/18	1230	WT G			6	Unpreserved - ICE	X	0.8	11/7/18	Y	Y
2	06WA-71	WT			11/6/18	1345	WT G			4	H ₂ SO ₄ HNO ₃ HCl NaOH Na ₂ S ₂ O ₃ Methanol Other	X X X X X X X X				
3																
4																
5																
6																
7																
8																
9																
10																
11																
12																

WO#: 2611273

2611273

RELINQUISHED BY / AFFILIATION: Mike Nguyen/Pace DATE: 11/7/18 TIME: 0956

ACCEPTED BY / AFFILIATION: Mike Nguyen/Pace DATE: 11/07/18 TIME: 181030

ADDITIONAL COMMENTS: Karim Minkora


SAMPLER NAME AND SIGNATURE: Karim Minkora PRINT Name of SAMPLER: Karim Minkora SIGNATURE of SAMPLER: [Signature]

DATE Signed (MM/DD/YYYY): 11/7/18

ORIGINAL

*Important Note: By signing this form you are accepting Pace's NET 30 day payment terms and agreeing to late charges of 1.5% per month for any invoices not paid within 30 days. F-ALL-Q-020rev.07, 15-May-2007

Sample Condition Upon Receipt



Client Name: GIA Power

Project # _____

Courier: Fed Ex UPS USPS Client Commercial Pace Other

Tracking #: _____

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other

Thermometer Used 25 Type of Ice: Wet Blue None

Cooler Temperature 0.8 Biological Tissue is Frozen: Yes No

Temp should be above freezing to 6°C

WO#: 2611273

PM: 8M

Due Date: 12/07/18

CLIENT: GAPower-CCR

Samples on ice, cooling process has begun

Date and Initials of person examining contents: 11/07/18 [Signature]

Comments: _____

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.		
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.		
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.		
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.		
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.		
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.		
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.		
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.		
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.		
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.		
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.		
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.		
-Includes date/time/ID/Analysis Matrix: <u>W</u>				
All containers needing preservation have been checked.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.		
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed		Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.		
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.		
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.		
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A			
Pace Trip Blank Lot # (if purchased): _____				

Client Notification/ Resolution:

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: _____

Field Data Required? Y / N

Project Manager Review: _____

Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

November 15, 2018

Joju Abraham
Georgia Power - Coal Combustion Residuals
2480 Maner Road
Atlanta, GA 30339

RE: Project: Plant McDonough
Pace Project No.: 2611388

Dear Joju Abraham:

Enclosed are the analytical results for sample(s) received by the laboratory on November 08, 2018. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Betsy McDaniel
betsy.mcdaniel@pacelabs.com
(770)734-4200
Project Manager

Enclosures

cc: Kristen Jurinko, Golder Associates Inc.
Julie Lehrman, Golder Associates Inc.
Maria Padilla, Georgia Power
Dawn Prell, Golder Associates Inc.
Tim Richards, Golder Associates - Atlanta
Rebecca Thornton, Pace Analytical Atlanta



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: Plant McDonough

Pace Project No.: 2611388

Atlanta Certification IDs

110 Technology Parkway Peachtree Corners, GA 30092

Florida DOH Certification #: E87315

Georgia DW Inorganics Certification #: 812

Georgia DW Microbiology Certification #: 812

North Carolina Certification #: 381

South Carolina Certification #: 98011001

Texas Certification #: T104704397-08-TX

Virginia Certification #: 460204

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: Plant McDonough

Pace Project No.: 2611388

Lab ID	Sample ID	Matrix	Date Collected	Date Received
2611388001	DGWA-53 Filtered	Water	11/07/18 08:50	11/08/18 15:00

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough

Pace Project No.: 2611388

Lab ID	Sample ID	Method	Analysts	Analytes Reported
2611388001	DGWA-53 Filtered	EPA 6020B	CSW	14
		EPA 7470A	DRB	1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough
Pace Project No.: 2611388

Sample: DGWA-53 Filtered Lab ID: 2611388001 Collected: 11/07/18 08:50 Received: 11/08/18 15:00 Matrix: Water											
Parameters	Results	Units	Report Limit			MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS, Dissolved Analytical Method: EPA 6020B Preparation Method: EPA 3005A											
Antimony, Dissolved	ND	mg/L	0.0030	0.00078	1	11/13/18 11:13	11/14/18 15:50	7440-36-0			
Arsenic, Dissolved	ND	mg/L	0.0050	0.00057	1	11/13/18 11:13	11/14/18 15:50	7440-38-2			
Barium, Dissolved	0.15	mg/L	0.010	0.00078	1	11/13/18 11:13	11/14/18 15:50	7440-39-3	M1		
Beryllium, Dissolved	ND	mg/L	0.0030	0.000050	1	11/13/18 11:13	11/14/18 15:50	7440-41-7			
Boron, Dissolved	0.085	mg/L	0.040	0.0039	1	11/13/18 11:13	11/14/18 15:50	7440-42-8			
Cadmium, Dissolved	ND	mg/L	0.0010	0.000093	1	11/13/18 11:13	11/14/18 15:50	7440-43-9			
Calcium, Dissolved	30.7	mg/L	25.0	0.69	50	11/13/18 11:13	11/14/18 15:56	7440-70-2	M6		
Chromium, Dissolved	ND	mg/L	0.010	0.0016	1	11/13/18 11:13	11/14/18 15:50	7440-47-3			
Cobalt, Dissolved	0.019	mg/L	0.010	0.00052	1	11/13/18 11:13	11/14/18 15:50	7440-48-4			
Lead, Dissolved	ND	mg/L	0.0050	0.00027	1	11/13/18 11:13	11/14/18 15:50	7439-92-1			
Lithium, Dissolved	0.0095J	mg/L	0.050	0.00097	1	11/13/18 11:13	11/14/18 15:50	7439-93-2			
Molybdenum, Dissolved	0.030	mg/L	0.010	0.0019	1	11/13/18 11:13	11/14/18 15:50	7439-98-7			
Selenium, Dissolved	ND	mg/L	0.010	0.0014	1	11/13/18 11:13	11/14/18 15:50	7782-49-2			
Thallium, Dissolved	ND	mg/L	0.0010	0.00014	1	11/13/18 11:13	11/14/18 15:50	7440-28-0			
7470 Mercury, Dissolved Analytical Method: EPA 7470A Preparation Method: EPA 7470A											
Mercury, Dissolved	ND	mg/L	0.00020	0.000036	1	11/14/18 09:40	11/14/18 13:56	7439-97-6			

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough

Pace Project No.: 2611388

QC Batch: 17130

Analysis Method: EPA 7470A

QC Batch Method: EPA 7470A

Analysis Description: 7470 Mercury Dissolved

Associated Lab Samples: 2611388001

METHOD BLANK: 77113

Matrix: Water

Associated Lab Samples: 2611388001

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Mercury, Dissolved	mg/L	ND	0.00020	0.000036	11/14/18 13:51	

LABORATORY CONTROL SAMPLE: 77114

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Mercury, Dissolved	mg/L	.0025	0.0025	100	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 77115

77116

Parameter	Units	2611388001 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
Mercury, Dissolved	mg/L	ND	.0025	.0025	0.0025	0.0026	100	102	75-125	2	20	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough
Pace Project No.: 2611388

QC Batch: 17057 Analysis Method: EPA 6020B
QC Batch Method: EPA 3005A Analysis Description: 6020B MET Dissolved
Associated Lab Samples: 2611388001

METHOD BLANK: 76816 Matrix: Water
Associated Lab Samples: 2611388001

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Antimony, Dissolved	mg/L	ND	0.0030	0.00078	11/14/18 15:38	
Arsenic, Dissolved	mg/L	ND	0.0050	0.00057	11/14/18 15:38	
Barium, Dissolved	mg/L	ND	0.010	0.00078	11/14/18 15:38	
Beryllium, Dissolved	mg/L	ND	0.0030	0.000050	11/14/18 15:38	
Boron, Dissolved	mg/L	ND	0.040	0.0039	11/14/18 15:38	
Cadmium, Dissolved	mg/L	ND	0.0010	0.000093	11/14/18 15:38	
Calcium, Dissolved	mg/L	ND	0.50	0.014	11/14/18 15:38	
Chromium, Dissolved	mg/L	ND	0.010	0.0016	11/14/18 15:38	
Cobalt, Dissolved	mg/L	ND	0.010	0.00052	11/14/18 15:38	
Lead, Dissolved	mg/L	ND	0.0050	0.00027	11/14/18 15:38	
Lithium, Dissolved	mg/L	ND	0.050	0.00097	11/14/18 15:38	
Molybdenum, Dissolved	mg/L	ND	0.010	0.0019	11/14/18 15:38	
Selenium, Dissolved	mg/L	ND	0.010	0.0014	11/14/18 15:38	
Thallium, Dissolved	mg/L	ND	0.0010	0.00014	11/14/18 15:38	

LABORATORY CONTROL SAMPLE: 76817

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Antimony, Dissolved	mg/L	.1	0.11	110	80-120	
Arsenic, Dissolved	mg/L	.1	0.10	103	80-120	
Barium, Dissolved	mg/L	.1	0.11	107	80-120	
Beryllium, Dissolved	mg/L	.1	0.11	108	80-120	
Boron, Dissolved	mg/L	1	1.1	106	80-120	
Cadmium, Dissolved	mg/L	.1	0.10	103	80-120	
Calcium, Dissolved	mg/L	1	1.1	106	80-120	
Chromium, Dissolved	mg/L	.1	0.10	104	80-120	
Cobalt, Dissolved	mg/L	.1	0.11	105	80-120	
Lead, Dissolved	mg/L	.1	0.10	104	80-120	
Lithium, Dissolved	mg/L	.1	0.11	106	80-120	
Molybdenum, Dissolved	mg/L	.1	0.10	103	80-120	
Selenium, Dissolved	mg/L	.1	0.10	104	80-120	
Thallium, Dissolved	mg/L	.1	0.10	104	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 76818 76819

Parameter	Units	2611388001 Result	MS		MSD		MS % Rec	MSD % Rec	% Rec Limits	Max RPD	Qual
			Spike Conc.	MS Result	MSD Result	MSD Result					
Antimony, Dissolved	mg/L	ND	.1	.1	0.11	0.11	114	111	75-125	3	20

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough

Pace Project No.: 2611388

Parameter	Units	MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 76818		76819		MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	Max RPD	RPD	Qual
		2611388001 Result	MS Spike Conc.	MSD Spike Conc.									
Arsenic, Dissolved	mg/L	ND	.1	.1	0.10	0.10	103	104	75-125	1	20		
Barium, Dissolved	mg/L	0.15	.1	.1	0.29	0.28	143	133	75-125	4	20	M1	
Beryllium, Dissolved	mg/L	ND	.1	.1	0.11	0.10	106	103	75-125	3	20		
Boron, Dissolved	mg/L	0.085	1	1	1.1	1.1	103	106	75-125	2	20		
Cadmium, Dissolved	mg/L	ND	.1	.1	0.11	0.10	107	104	75-125	2	20		
Calcium, Dissolved	mg/L	30.7	1	1	32.7	31.4	203	72	75-125	4	20	M6	
Chromium, Dissolved	mg/L	ND	.1	.1	0.10	0.11	102	106	75-125	3	20		
Cobalt, Dissolved	mg/L	0.019	.1	.1	0.12	0.12	100	104	75-125	3	20		
Lead, Dissolved	mg/L	ND	.1	.1	0.10	0.10	105	101	75-125	4	20		
Lithium, Dissolved	mg/L	0.0095J	.1	.1	0.11	0.11	103	102	75-125	1	20		
Molybdenum, Dissolved	mg/L	0.030	.1	.1	0.14	0.13	109	103	75-125	5	20		
Selenium, Dissolved	mg/L	ND	.1	.1	0.10	0.11	105	105	75-125	0	20		
Thallium, Dissolved	mg/L	ND	.1	.1	0.10	0.10	103	101	75-125	2	20		

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: Plant McDonough

Pace Project No.: 2611388

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

ANALYTE QUALIFIERS

M1 Matrix spike recovery exceeded QC limits. Batch accepted based on laboratory control sample (LCS) recovery.

M6 Matrix spike and Matrix spike duplicate recovery not evaluated against control limits due to sample dilution.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough

Pace Project No.: 2611388

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
2611388001	DGWA-53 Filtered	EPA 3005A	17057	EPA 6020B	17122
2611388001	DGWA-53 Filtered	EPA 7470A	17130	EPA 7470A	17194

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



CHAIN-OF-CUSTODY / Analytical Request Document

The Chain-of-Custody is a LEGAL DOCUMENT. All relevant fields must be completed accurately.

Section A
Required Client Information:
 Company: Georgia Power - Coal Combustion Residuals
 Address: 2480 Manier Road
 Atlanta, GA 30339
 Email: jabraham@southernco.com
 Phone: (404)506-7239
 Requested Due Date: Standard TAT

Section B
Required Project Information:
 Report To: Jisu Abraham
 Copy To: Golder
 Purchase Order #: SCS10348806
 Project Name: Plant McDonough Background
 Project #: 166849618

Section C
Invoice Information:
 Attention: scsinvoices@southernco.com
 Company Name:
 Address:
 Pace Project Manager: betsy.mcdaniel@pacelabs.com
 Pace Profile #: 332.1.2

Regulatory Agency: GA
 State / Location: GA

Page: 1 Of 1

#	ITEM	MATRIX CODE (see valid codes to left)	SAMPLE TYPE (G=GRAB C=COMP)	DATE	TIME	DATE	TIME	ACCEPTED BY / AFFILIATION	Requested Analysis Filtered (Y/N)	
									Analyses Test	Preservatives
1	DGWA-S3 FILTERED	WT	G	11/7/2018	8:50	11/8/2018	15:00	<i>Y. Adelman</i>	11/08/18	1500
2										
3										
4										
5										
6										
7										
8										
9										
10										
11										
12										

ADDITIONAL COMMENTS
 Sampled by: *Chris Tronai 11-7-18*

RELINQUISHED BY / AFFILIATION
[Signature]

DATE 11/8/2018 **TIME** 15:00

ACCEPTED BY / AFFILIATION
Y. Adelman

DATE 11/08/18 **TIME** 1500

TEMP in C 1.5

Received on 11/08/18

Temp in C 1.5

Sealed (Y/N)

Custody (Y/N)

Samples Intact (Y/N)

DATE Signed:

W0#: 2611388

2611388



Sample Condition Upon Receipt

Client Name: GIA Power

Project # _____

WO#: **2611388**

PM: **BM**

Due Date: **11/15/18**

CLIENT: **GAPower-CCR**

Courier: Fed Ex UPS USPS Client Commercial Pace Other

Tracking #: _____

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other

Thermometer Used 83 Type of Ice: Wet Blue None

Cooler Temperature 1.3 Biological Tissue is Frozen: Yes No

Temp should be above freezing to 6°C

Samples on ice, cooling process has begun

Date and Initials of person examining contents: 11/08/18 [Signature]

Comments: _____

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.		
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.		
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.		
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.		
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.		
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.		
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.		
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.		
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.		
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.		
Filtered volume received for Dissolved tests	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	11.		
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.		
-Includes date/time/ID/Analysis Matrix:	<u>W</u>			
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.		
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed		Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.		
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.		
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.		
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A			
Pace Trip Blank Lot # (if purchased):	_____			

Client Notification/ Resolution: _____

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: _____

Field Data Required? Y / N

Project Manager Review: _____ Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e out of hold, incorrect preservative, out of temp, incorrect containers)

November 16, 2018

Joju Abraham
Georgia Power - Coal Combustion Residuals
2480 Maner Road
Atlanta, GA 30339

RE: Project: Plant McDonough Ash Ponds
Pace Project No.: 2611391

Dear Joju Abraham:

Enclosed are the analytical results for sample(s) received by the laboratory on November 08, 2018. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Betsy McDaniel
betsy.mcdaniel@pacelabs.com
(770)734-4200
Project Manager

Enclosures

cc: Kristen Jurinko, Golder Associates Inc.
Julie Lehrman, Golder Associates Inc.
Maria Padilla, Georgia Power
Dawn Prell, Golder Associates Inc.
Tim Richards, Golder Associates - Atlanta
Rebecca Thornton, Pace Analytical Atlanta



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611391

Atlanta Certification IDs

110 Technology Parkway Peachtree Corners, GA 30092

Florida DOH Certification #: E87315

Georgia DW Inorganics Certification #: 812

Georgia DW Microbiology Certification #: 812

North Carolina Certification #: 381

South Carolina Certification #: 98011001

Texas Certification #: T104704397-08-TX

Virginia Certification #: 460204

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611391

Lab ID	Sample ID	Matrix	Date Collected	Date Received
2611391001	DGWA-53	Water	11/07/18 08:50	11/08/18 15:00

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611391

Lab ID	Sample ID	Method	Analysts	Analytes Reported
2611391001	DGWA-53	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611391

Sample: DGWA-53		Lab ID: 2611391001		Collected: 11/07/18 08:50		Received: 11/08/18 15:00		Matrix: Water	
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual
			Limit	MDL	DF				
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	mg/L	0.0030	0.00078	1	11/13/18 13:10	11/15/18 18:06	7440-36-0	
Arsenic	0.00090J	mg/L	0.0050	0.00057	1	11/13/18 13:10	11/15/18 18:06	7440-38-2	
Barium	0.15	mg/L	0.010	0.00078	1	11/13/18 13:10	11/15/18 18:06	7440-39-3	
Beryllium	ND	mg/L	0.0030	0.000050	1	11/13/18 13:10	11/15/18 18:06	7440-41-7	
Boron	0.073	mg/L	0.040	0.0039	1	11/13/18 13:10	11/15/18 18:06	7440-42-8	
Cadmium	ND	mg/L	0.0010	0.000093	1	11/13/18 13:10	11/15/18 18:06	7440-43-9	
Calcium	28.6	mg/L	25.0	0.69	50	11/13/18 13:10	11/15/18 18:12	7440-70-2	
Chromium	ND	mg/L	0.010	0.0016	1	11/13/18 13:10	11/15/18 18:06	7440-47-3	
Cobalt	0.018	mg/L	0.010	0.00052	1	11/13/18 13:10	11/15/18 18:06	7440-48-4	
Lead	ND	mg/L	0.0050	0.00027	1	11/13/18 13:10	11/15/18 18:06	7439-92-1	
Lithium	0.0077J	mg/L	0.050	0.00097	1	11/13/18 13:10	11/15/18 18:06	7439-93-2	
Molybdenum	0.029	mg/L	0.010	0.0019	1	11/13/18 13:10	11/15/18 18:06	7439-98-7	
Selenium	ND	mg/L	0.010	0.0014	1	11/13/18 13:10	11/15/18 18:06	7782-49-2	
Thallium	ND	mg/L	0.0010	0.00014	1	11/13/18 13:10	11/15/18 18:06	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	ND	mg/L	0.00050	0.000036	1	11/12/18 10:45	11/12/18 17:16	7439-97-6	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	200	mg/L	25.0	10.0	1		11/13/18 15:40		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	2.3	mg/L	0.25	0.024	1		11/15/18 08:49	16887-00-6	
Fluoride	ND	mg/L	0.30	0.029	1		11/15/18 08:49	16984-48-8	
Sulfate	12.8	mg/L	1.0	0.017	1		11/15/18 08:49	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611391

QC Batch: 16833 Analysis Method: EPA 7470A
QC Batch Method: EPA 7470A Analysis Description: 7470 Mercury
Associated Lab Samples: 2611391001

METHOD BLANK: 75562 Matrix: Water
Associated Lab Samples: 2611391001

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Mercury	mg/L	ND	0.00050	0.000036	11/12/18 16:19	

LABORATORY CONTROL SAMPLE: 75563

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Mercury	mg/L	.0025	0.0025	102	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 75564 75565

Parameter	Units	2611272001		75565		MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
		MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result						
Mercury	mg/L	ND	.0025	.0025	0.0022	0.0025	90	101	75-125	11	20

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611391

QC Batch: 17097 Analysis Method: EPA 6020B
QC Batch Method: EPA 3005A Analysis Description: 6020B MET
Associated Lab Samples: 2611391001

METHOD BLANK: 76972 Matrix: Water
Associated Lab Samples: 2611391001

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Antimony	mg/L	ND	0.0030	0.00078	11/15/18 16:12	
Arsenic	mg/L	ND	0.0050	0.00057	11/15/18 16:12	
Barium	mg/L	ND	0.010	0.00078	11/15/18 16:12	
Beryllium	mg/L	ND	0.0030	0.000050	11/15/18 16:12	
Boron	mg/L	ND	0.040	0.0039	11/15/18 16:12	
Cadmium	mg/L	ND	0.0010	0.000093	11/15/18 16:12	
Calcium	mg/L	ND	0.50	0.014	11/15/18 16:12	
Chromium	mg/L	ND	0.010	0.0016	11/15/18 16:12	
Cobalt	mg/L	ND	0.010	0.00052	11/15/18 16:12	
Lead	mg/L	ND	0.0050	0.00027	11/15/18 16:12	
Lithium	mg/L	ND	0.050	0.00097	11/15/18 16:12	
Molybdenum	mg/L	ND	0.010	0.0019	11/15/18 16:12	
Selenium	mg/L	ND	0.010	0.0014	11/15/18 16:12	
Thallium	mg/L	ND	0.0010	0.00014	11/15/18 16:12	

LABORATORY CONTROL SAMPLE: 76973

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Antimony	mg/L	.1	0.11	112	80-120	
Arsenic	mg/L	.1	0.10	104	80-120	
Barium	mg/L	.1	0.11	107	80-120	
Beryllium	mg/L	.1	0.099	99	80-120	
Boron	mg/L	1	1.0	100	80-120	
Cadmium	mg/L	.1	0.10	102	80-120	
Calcium	mg/L	1	0.99	99	80-120	
Chromium	mg/L	.1	0.10	102	80-120	
Cobalt	mg/L	.1	0.10	102	80-120	
Lead	mg/L	.1	0.10	100	80-120	
Lithium	mg/L	.1	0.10	100	80-120	
Molybdenum	mg/L	.1	0.10	104	80-120	
Selenium	mg/L	.1	0.11	108	80-120	
Thallium	mg/L	.1	0.10	101	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 76974 76975

Parameter	Units	2611389011 Result	MS		MSD		MS % Rec	MSD % Rec	% Rec Limits	Max RPD	Qual
			Spike Conc.	MS Result	MSD Result	MSD Result					
Antimony	mg/L	ND	.1	.1	0.11	0.10	113	104	75-125	8	20

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611391

Parameter	Units	MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 76974		76975		MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	Max RPD	RPD	Qual
		2611389011 Result	MS Spike Conc.	MSD Spike Conc.	MS Result								
Arsenic	mg/L	0.0022J	.1	.1	0.11	0.10	107	100	75-125	6	20		
Barium	mg/L	0.020	.1	.1	0.12	0.12	104	95	75-125	7	20		
Beryllium	mg/L	0.014	.1	.1	0.12	0.11	103	96	75-125	6	20		
Boron	mg/L	0.30	1	1	1.3	1.2	98	90	75-125	7	20		
Cadmium	mg/L	0.0016	.1	.1	0.11	0.097	104	95	75-125	9	20		
Calcium	mg/L	38.6	1	1	38.1	35.8	-53	-276	75-125	6	20	M6	
Chromium	mg/L	ND	.1	.1	0.10	0.093	102	92	75-125	10	20		
Cobalt	mg/L	0.35	.1	.1	0.43	0.40	75	51	75-125	6	20	M1	
Lead	mg/L	0.00091J	.1	.1	0.10	0.093	99	92	75-125	8	20		
Lithium	mg/L	0.082	.1	.1	0.18	0.17	97	88	75-125	5	20		
Molybdenum	mg/L	ND	.1	.1	0.10	0.096	103	96	75-125	7	20		
Selenium	mg/L	0.0045J	.1	.1	0.11	0.10	109	98	75-125	10	20		
Thallium	mg/L	0.00032J	.1	.1	0.10	0.093	100	92	75-125	8	20		

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611391

QC Batch: 17079	Analysis Method: SM 2540C
QC Batch Method: SM 2540C	Analysis Description: 2540C Total Dissolved Solids
Associated Lab Samples: 2611391001	

LABORATORY CONTROL SAMPLE: 76893

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	400	412	103	84-108	

SAMPLE DUPLICATE: 76894

Parameter	Units	2611389007 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	834	860	3	10	

SAMPLE DUPLICATE: 76895

Parameter	Units	2611393007 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	112	112	0	10	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611391

QC Batch: 17167 Analysis Method: EPA 300.0
QC Batch Method: EPA 300.0 Analysis Description: 300.0 IC Anions
Associated Lab Samples: 2611391001

METHOD BLANK: 77239 Matrix: Water
Associated Lab Samples: 2611391001

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Chloride	mg/L	0.081J	0.25	0.024	11/15/18 03:18	
Fluoride	mg/L	ND	0.30	0.029	11/15/18 03:18	
Sulfate	mg/L	ND	1.0	0.017	11/15/18 03:18	

LABORATORY CONTROL SAMPLE: 77240

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	10	10.2	102	90-110	
Fluoride	mg/L	10	10.0	100	90-110	
Sulfate	mg/L	10	10.0	100	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 77241 77242

Parameter	Units	2611389009 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	Max		
										RPD	RPD	Qual
Chloride	mg/L	25.8	10	10	33.0	32.8	72	70	90-110	0	15	M1
Fluoride	mg/L	ND	10	10	9.7	9.5	97	95	90-110	2	15	
Sulfate	mg/L	320	10	10	190	190	-1300	-1290	90-110	0	15	E,M1

MATRIX SPIKE SAMPLE: 77243

Parameter	Units	2611389010 Result	Spike Conc.	MS Result	MS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	28.6	10	35.7	72	90-110	M1
Fluoride	mg/L	ND	10	10.1	101	90-110	
Sulfate	mg/L	439	10	226	-2140	90-110	E,M1

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611391

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

ANALYTE QUALIFIERS

E Analyte concentration exceeded the calibration range. The reported result is estimated.

M1 Matrix spike recovery exceeded QC limits. Batch accepted based on laboratory control sample (LCS) recovery.

M6 Matrix spike and Matrix spike duplicate recovery not evaluated against control limits due to sample dilution.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611391

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
2611391001	DGWA-53	EPA 3005A	17097	EPA 6020B	17226
2611391001	DGWA-53	EPA 7470A	16833	EPA 7470A	17021
2611391001	DGWA-53	SM 2540C	17079		
2611391001	DGWA-53	EPA 300.0	17167		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

Sample Condition Upon Receipt



Client Name: GIA Power

Project # _____

WO#: 2611391

PM: **BM** Due Date: **11/15/18**

CLIENT: **GAPower-CCR**

Courier: Fed Ex UPS USPS Client Commercial Pace Other _____

Tracking #: _____

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other _____

Thermometer Used 83 Type of Ice: Wet Blue None Samples on ice, cooling process has begun

Cooler Temperature 1.3 Biological Tissue is Frozen: Yes No Date and Initials of person examining contents: 11/08/18 MK

Temp should be above freezing to 6°C

Comments: _____

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.		
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.		
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.		
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.		
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.		
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.		
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.		
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.		
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.		
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.		
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.		
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.		
-Includes date/time/ID/Analysis Matrix:	<u>W</u>			
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.		
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed		Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.		
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.		
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.		
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A			
Pace Trip Blank Lot # (if purchased):	_____			

Client Notification/ Resolution: _____

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: _____

Field Data Required? Y / N

Project Manager Review: _____ **Date:** _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

December 10, 2018

Joju Abraham
Georgia Power - Coal Combustion Residuals
2480 Maner Road
Atlanta, GA 30339

RE: Project: Plant McDonough Ash Ponds
Pace Project No.: 2611392

Dear Joju Abraham:

Enclosed are the analytical results for sample(s) received by the laboratory on November 08, 2018. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Betsy McDaniel
betsy.mcdaniel@pacelabs.com
(770)734-4200
Project Manager

Enclosures

cc: Kristen Jurinko, Golder Associates Inc.
Julie Lehrman, Golder Associates Inc.
Maria Padilla, Georgia Power
Dawn Prell, Golder Associates Inc.
Tim Richards, Golder Associates - Atlanta
Rebecca Thornton, Pace Analytical Atlanta



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611392

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601

ANAB DOD-ELAP Rad Accreditation #: L2417

Alabama Certification #: 41590

Arizona Certification #: AZ0734

Arkansas Certification

California Certification #: 04222CA

Colorado Certification #: PA01547

Connecticut Certification #: PH-0694

Delaware Certification

EPA Region 4 DW Rad

Florida/TNI Certification #: E87683

Georgia Certification #: C040

Guam Certification

Hawaii Certification

Idaho Certification

Illinois Certification

Indiana Certification

Iowa Certification #: 391

Kansas/TNI Certification #: E-10358

Kentucky Certification #: KY90133

KY WW Permit #: KY0098221

KY WW Permit #: KY0000221

Louisiana DHH/TNI Certification #: LA180012

Louisiana DEQ/TNI Certification #: 4086

Maine Certification #: 2017020

Maryland Certification #: 308

Massachusetts Certification #: M-PA1457

Michigan/PADEP Certification #: 9991

Missouri Certification #: 235

Montana Certification #: Cert0082

Nebraska Certification #: NE-OS-29-14

Nevada Certification #: PA014572018-1

New Hampshire/TNI Certification #: 297617

New Jersey/TNI Certification #: PA051

New Mexico Certification #: PA01457

New York/TNI Certification #: 10888

North Carolina Certification #: 42706

North Dakota Certification #: R-190

Ohio EPA Rad Approval: #41249

Oregon/TNI Certification #: PA200002-010

Pennsylvania/TNI Certification #: 65-00282

Puerto Rico Certification #: PA01457

Rhode Island Certification #: 65-00282

South Dakota Certification

Tennessee Certification #: 02867

Texas/TNI Certification #: T104704188-17-3

Utah/TNI Certification #: PA014572017-9

USDA Soil Permit #: P330-17-00091

Vermont Dept. of Health: ID# VT-0282

Virgin Island/PADEP Certification

Virginia/VELAP Certification #: 9526

Washington Certification #: C868

West Virginia DEP Certification #: 143

West Virginia DHHR Certification #: 9964C

Wisconsin Approve List for Rad

Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611392

Lab ID	Sample ID	Matrix	Date Collected	Date Received
2611392001	DGWA-53	Water	11/07/18 08:50	11/08/18 15:00

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611392

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
2611392001	DGWA-53	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611392

Sample: DGWA-53 **Lab ID: 2611392001** Collected: 11/07/18 08:50 Received: 11/08/18 15:00 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	2.23 ± 0.504 (0.218) C:99% T:NA	pCi/L	12/03/18 10:33	13982-63-3	
Radium-228	EPA 9320	0.819 ± 0.553 (1.05) C:79% T:88%	pCi/L	12/05/18 19:50	15262-20-1	
Total Radium	Total Radium Calculation	3.05 ± 1.06 (1.27)	pCi/L	12/06/18 14:35	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611392

QC Batch: 321126

Analysis Method: EPA 9315

QC Batch Method: EPA 9315

Analysis Description: 9315 Total Radium

Associated Lab Samples: 2611392001

METHOD BLANK: 1566262

Matrix: Water

Associated Lab Samples: 2611392001

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.177 ± 0.121 (0.173) C:101% T:NA	pCi/L	12/03/18 09:20	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611392

QC Batch: 320740

Analysis Method: EPA 9320

QC Batch Method: EPA 9320

Analysis Description: 9320 Radium 228

Associated Lab Samples: 2611392001

METHOD BLANK: 1564310

Matrix: Water

Associated Lab Samples: 2611392001

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.621 ± 0.363 (0.669) C:84% T:82%	pCi/L	12/05/18 12:56	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611392

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

LABORATORIES

PASI-PA Pace Analytical Services - Greensburg

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611392

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
2611392001	DGWA-53	EPA 9315	321126		
2611392001	DGWA-53	EPA 9320	320740		
2611392001	DGWA-53	Total Radium Calculation	323093		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



CHAIN-OF-CUSTODY / Analytical Request Document

The Chain-of-Custody is a LEGAL DOCUMENT. All relevant fields must be completed accurately.

Section A
Required Client Information:
 Company: Georgia Power - Coal Combustion Residuals
 Address: 2480 Maner Road
 Atlanta, GA 30339
 Email: jabraham@southenco.com
 Phone: (404)505-7239
 Requested Due Date: Standard TAT

Section B
Required Project Information:
 Report To: Jojo Abraham
 Copy To: Gotter
 Purchase Order #: SCS10349606
 Project Name: Plant McDonough Background
 Project #: 166849618

Section C
Invoice Information:
 Attention: scsvoices@southenco.com
 Company Name:
 Address:
 Pace Quote:
 Pace Project Manager: betsy.mcdaniel@pacelabs.com
 Pace Profile #: 332.1.2

Page: 1 Of 1

Regulatory Agency
 State / Location: GA

ITEM #	MATRIX Drinking Water Wastewater Surface Water Soil/Sediment DUI Wheat Aur Omer Tissue	CODEN DWI WWT WPC PW SLD CUD WPL ARL OTD TS	SAMPLE TYPE (G=GRAB C=COMP)	DATE	TIME	SAMPLE TEMP AT COLLECTION	# OF CONTAINERS	Preservatives H2SO4 HNO3 HCl NaOH Na2S2O3 Methanol Other	Analyzes Test Metals App. III & App. IV TD5 Cl. F. S04 Residual Chlorine (Y/N)	Requested Analysis Filtered (Y/N)	
										Y	N
1			G	11/17/2018	850		4			X	X
2										X	
3											
4											
5											
6											
7											
8											
9											
10											
11											
12											

WO#: 2611392

2611392

RELINQUISHED BY / AFFILIATION	DATE	TIME	ACCEPTED BY / AFFILIATION	DATE	TIME	TEMP in C	Received on (Y/N)	Custody Sealed (Y/N)	Samples Intact (Y/N)
Chris Tighe	11/17/18		MDalman	11/08/18	1500	1.3			

Additional Comments:
 Samples ok
 Chris Tighe
 11/17/18

DATE Signed: _____

Sample Condition Upon Receipt



Client Name: GIA Power

Project # _____

WO#: 2611392

PM: **BM**

Due Date: **12/10/18**

CLIENT: **GAPower-CCR**

Courier: Fed Ex UPS USPS Client Commercial Pace Other

Tracking #: _____ Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other

Thermometer Used 83 Type of Ice: Wet Blue None Samples on ice, cooling process, has begun

Cooler Temperature 1.3 Biological Tissue is Frozen: Yes No

Temp should be above freezing to 6°C

Date and Initials of person examining contents: 11/08/18 MK

Comments: _____

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.	
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.	
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.	
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.	
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.	
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.	
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.	
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.	
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.	
-Pace Containers Used:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.	
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.	
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.	
-Includes date/time/ID/Analysis Matrix: <u>W</u>			
All containers needing preservation have been checked.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.	
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A		
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed	Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.	
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.	
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.	
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A		
Pace Trip Blank Lot # (if purchased): _____			

Client Notification/ Resolution:

Person Contacted: _____ Date/Time: _____
 Comments/ Resolution: _____

Field Data Required? Y / N

Project Manager Review: _____

Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e out of hold, incorrect preservative, out of temp, incorrect containers)

November 16, 2018

Joju Abraham
Georgia Power - Coal Combustion Residuals
2480 Maner Road
Atlanta, GA 30339

RE: Project: Plant McDonough Ash Ponds
Pace Project No.: 2611393

Dear Joju Abraham:

Enclosed are the analytical results for sample(s) received by the laboratory on November 08, 2018. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Betsy McDaniel
betsy.mcdaniel@pacelabs.com
(770)734-4200
Project Manager

Enclosures

cc: Kristen Jurinko, Golder Associates Inc.
Julie Lehrman, Golder Associates Inc.
Maria Padilla, Georgia Power
Dawn Prell, Golder Associates Inc.
Tim Richards, Golder Associates - Atlanta
Rebecca Thornton, Pace Analytical Atlanta



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611393

Atlanta Certification IDs

110 Technology Parkway Peachtree Corners, GA 30092

Florida DOH Certification #: E87315

Georgia DW Inorganics Certification #: 812

Georgia DW Microbiology Certification #: 812

North Carolina Certification #: 381

South Carolina Certification #: 98011001

Texas Certification #: T104704397-08-TX

Virginia Certification #: 460204

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611393

Lab ID	Sample ID	Matrix	Date Collected	Date Received
2611393001	DGWC-37	Water	11/08/18 09:35	11/08/18 15:00
2611393002	DGWC-38	Water	11/08/18 11:00	11/08/18 15:00
2611393003	DGWC-39	Water	11/08/18 09:50	11/08/18 15:00
2611393004	DGWC-40	Water	11/08/18 08:10	11/08/18 15:00
2611393005	DGWC-67	Water	11/08/18 11:00	11/08/18 15:00
2611393006	DGWC-68A	Water	11/08/18 09:40	11/08/18 15:00
2611393007	DGWC-69	Water	11/08/18 08:25	11/08/18 15:00
2611393008	FD-3	Water	11/08/18 00:00	11/08/18 15:00
2611393009	FB-3	Water	11/08/18 11:10	11/08/18 15:00
2611393010	EB-3	Water	11/08/18 10:30	11/08/18 15:00

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611393

Lab ID	Sample ID	Method	Analysts	Analytes Reported
2611393001	DGWC-37	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
2611393002	DGWC-38	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
2611393003	DGWC-39	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
2611393004	DGWC-40	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
2611393005	DGWC-67	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
2611393006	DGWC-68A	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
2611393007	DGWC-69	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
2611393008	FD-3	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
2611393009	FB-3	EPA 6020B	CSW	14
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3
2611393010	EB-3	EPA 6020B	CSW	14

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611393

Lab ID	Sample ID	Method	Analysts	Analytes Reported
		EPA 7470A	DRB	1
		SM 2540C	JPT	1
		EPA 300.0	RLC	3

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611393

Sample: DGWC-37 **Lab ID: 2611393001** Collected: 11/08/18 09:35 Received: 11/08/18 15:00 Matrix: Water

Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual
			Limit	MDL	DF				
6020B MET ICPMS Analytical Method: EPA 6020B Preparation Method: EPA 3005A									
Antimony	ND	mg/L	0.0030	0.00078	1	11/13/18 13:10	11/15/18 18:29	7440-36-0	
Arsenic	ND	mg/L	0.0050	0.00057	1	11/13/18 13:10	11/15/18 18:29	7440-38-2	
Barium	0.11	mg/L	0.010	0.00078	1	11/13/18 13:10	11/15/18 18:29	7440-39-3	
Beryllium	ND	mg/L	0.0030	0.000050	1	11/13/18 13:10	11/15/18 18:29	7440-41-7	
Boron	1.4	mg/L	0.040	0.0039	1	11/13/18 13:10	11/15/18 18:29	7440-42-8	
Cadmium	ND	mg/L	0.0010	0.000093	1	11/13/18 13:10	11/15/18 18:29	7440-43-9	
Calcium	53.6	mg/L	25.0	0.69	50	11/13/18 13:10	11/15/18 18:35	7440-70-2	
Chromium	ND	mg/L	0.010	0.0016	1	11/13/18 13:10	11/15/18 18:29	7440-47-3	
Cobalt	ND	mg/L	0.010	0.00052	1	11/13/18 13:10	11/15/18 18:29	7440-48-4	
Lead	ND	mg/L	0.0050	0.00027	1	11/13/18 13:10	11/15/18 18:29	7439-92-1	
Lithium	0.0023J	mg/L	0.050	0.00097	1	11/13/18 13:10	11/15/18 18:29	7439-93-2	
Molybdenum	ND	mg/L	0.010	0.0019	1	11/13/18 13:10	11/15/18 18:29	7439-98-7	
Selenium	ND	mg/L	0.010	0.0014	1	11/13/18 13:10	11/15/18 18:29	7782-49-2	
Thallium	ND	mg/L	0.0010	0.00014	1	11/13/18 13:10	11/15/18 18:29	7440-28-0	
7470 Mercury Analytical Method: EPA 7470A Preparation Method: EPA 7470A									
Mercury	ND	mg/L	0.00050	0.000036	1	11/12/18 12:26	11/12/18 18:34	7439-97-6	
2540C Total Dissolved Solids Analytical Method: SM 2540C									
Total Dissolved Solids	295	mg/L	25.0	10.0	1		11/13/18 15:40		
300.0 IC Anions 28 Days Analytical Method: EPA 300.0									
Chloride	5.8	mg/L	0.25	0.024	1		11/15/18 09:09	16887-00-6	
Fluoride	ND	mg/L	0.30	0.029	1		11/15/18 09:09	16984-48-8	
Sulfate	102	mg/L	10.0	0.17	10		11/15/18 11:00	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611393

Sample: DGWC-38		Lab ID: 2611393002		Collected: 11/08/18 11:00		Received: 11/08/18 15:00		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	11/13/18 13:10	11/15/18 18:41	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	11/13/18 13:10	11/15/18 18:41	7440-38-2		
Barium	0.035	mg/L	0.010	0.00078	1	11/13/18 13:10	11/15/18 18:41	7440-39-3		
Beryllium	ND	mg/L	0.0030	0.000050	1	11/13/18 13:10	11/15/18 18:41	7440-41-7		
Boron	3.4	mg/L	2.0	0.20	50	11/13/18 13:10	11/15/18 18:46	7440-42-8		
Cadmium	0.00024J	mg/L	0.0010	0.000093	1	11/13/18 13:10	11/15/18 18:41	7440-43-9		
Calcium	86.6	mg/L	25.0	0.69	50	11/13/18 13:10	11/15/18 18:46	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	11/13/18 13:10	11/15/18 18:41	7440-47-3		
Cobalt	0.0016J	mg/L	0.010	0.00052	1	11/13/18 13:10	11/15/18 18:41	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	11/13/18 13:10	11/15/18 18:41	7439-92-1		
Lithium	0.0030J	mg/L	0.050	0.00097	1	11/13/18 13:10	11/15/18 18:41	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	11/13/18 13:10	11/15/18 18:41	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	11/13/18 13:10	11/15/18 18:41	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	11/13/18 13:10	11/15/18 18:41	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	11/12/18 12:26	11/12/18 18:37	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	507	mg/L	25.0	10.0	1		11/13/18 15:40			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	8.1	mg/L	0.25	0.024	1		11/15/18 09:51	16887-00-6		
Fluoride	ND	mg/L	0.30	0.029	1		11/15/18 09:51	16984-48-8		
Sulfate	291	mg/L	20.0	0.34	20		11/15/18 11:24	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611393

Sample: DGWC-39		Lab ID: 2611393003		Collected: 11/08/18 09:50		Received: 11/08/18 15:00		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	11/13/18 13:10	11/15/18 18:52	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	11/13/18 13:10	11/15/18 18:52	7440-38-2		
Barium	0.10	mg/L	0.010	0.00078	1	11/13/18 13:10	11/15/18 18:52	7440-39-3		
Beryllium	ND	mg/L	0.0030	0.000050	1	11/13/18 13:10	11/15/18 18:52	7440-41-7		
Boron	3.4	mg/L	2.0	0.20	50	11/13/18 13:10	11/15/18 18:58	7440-42-8		
Cadmium	ND	mg/L	0.0010	0.000093	1	11/13/18 13:10	11/15/18 18:52	7440-43-9		
Calcium	89.0	mg/L	25.0	0.69	50	11/13/18 13:10	11/15/18 18:58	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	11/13/18 13:10	11/15/18 18:52	7440-47-3		
Cobalt	0.0062J	mg/L	0.010	0.00052	1	11/13/18 13:10	11/15/18 18:52	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	11/13/18 13:10	11/15/18 18:52	7439-92-1		
Lithium	ND	mg/L	0.050	0.00097	1	11/13/18 13:10	11/15/18 18:52	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	11/13/18 13:10	11/15/18 18:52	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	11/13/18 13:10	11/15/18 18:52	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	11/13/18 13:10	11/15/18 18:52	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	11/12/18 12:26	11/12/18 18:39	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	485	mg/L	25.0	10.0	1		11/13/18 15:40			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	7.7	mg/L	0.25	0.024	1		11/15/18 10:11	16887-00-6		
Fluoride	0.072J	mg/L	0.30	0.029	1		11/15/18 10:11	16984-48-8		
Sulfate	200	mg/L	20.0	0.34	20		11/15/18 11:47	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611393

Sample: DGWC-40		Lab ID: 2611393004		Collected: 11/08/18 08:10		Received: 11/08/18 15:00		Matrix: Water	
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual
			Limit	MDL	DF				
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Antimony	ND	mg/L	0.0030	0.00078	1	11/13/18 13:10	11/15/18 19:03	7440-36-0	
Arsenic	ND	mg/L	0.0050	0.00057	1	11/13/18 13:10	11/15/18 19:03	7440-38-2	
Barium	0.017	mg/L	0.010	0.00078	1	11/13/18 13:10	11/15/18 19:03	7440-39-3	
Beryllium	0.0027J	mg/L	0.0030	0.000050	1	11/13/18 13:10	11/15/18 19:03	7440-41-7	
Boron	0.80	mg/L	0.040	0.0039	1	11/13/18 13:10	11/15/18 19:03	7440-42-8	
Cadmium	0.00076J	mg/L	0.0010	0.000093	1	11/13/18 13:10	11/15/18 19:03	7440-43-9	
Calcium	43.5	mg/L	25.0	0.69	50	11/13/18 13:10	11/15/18 19:09	7440-70-2	
Chromium	ND	mg/L	0.010	0.0016	1	11/13/18 13:10	11/15/18 19:03	7440-47-3	
Cobalt	0.036	mg/L	0.010	0.00052	1	11/13/18 13:10	11/15/18 19:03	7440-48-4	
Lead	ND	mg/L	0.0050	0.00027	1	11/13/18 13:10	11/15/18 19:03	7439-92-1	
Lithium	0.0020J	mg/L	0.050	0.00097	1	11/13/18 13:10	11/15/18 19:03	7439-93-2	
Molybdenum	ND	mg/L	0.010	0.0019	1	11/13/18 13:10	11/15/18 19:03	7439-98-7	
Selenium	0.0016J	mg/L	0.010	0.0014	1	11/13/18 13:10	11/15/18 19:03	7782-49-2	
Thallium	ND	mg/L	0.0010	0.00014	1	11/13/18 13:10	11/15/18 19:03	7440-28-0	
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A							
Mercury	ND	mg/L	0.00050	0.000036	1	11/12/18 12:26	11/12/18 18:41	7439-97-6	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	399	mg/L	25.0	10.0	1		11/13/18 15:40		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	19.3	mg/L	0.25	0.024	1		11/15/18 10:32	16887-00-6	
Fluoride	0.11J	mg/L	0.30	0.029	1		11/15/18 10:32	16984-48-8	
Sulfate	273	mg/L	20.0	0.34	20		11/15/18 12:11	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611393

Sample: DGWC-67		Lab ID: 2611393005		Collected: 11/08/18 11:00		Received: 11/08/18 15:00		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	11/13/18 13:10	11/15/18 19:15	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	11/13/18 13:10	11/15/18 19:15	7440-38-2		
Barium	0.11	mg/L	0.010	0.00078	1	11/13/18 13:10	11/15/18 19:15	7440-39-3		
Beryllium	ND	mg/L	0.0030	0.000050	1	11/13/18 13:10	11/15/18 19:15	7440-41-7		
Boron	3.5	mg/L	2.0	0.20	50	11/13/18 13:10	11/15/18 19:21	7440-42-8		
Cadmium	ND	mg/L	0.0010	0.000093	1	11/13/18 13:10	11/15/18 19:15	7440-43-9		
Calcium	40.1	mg/L	25.0	0.69	50	11/13/18 13:10	11/15/18 19:21	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	11/13/18 13:10	11/15/18 19:15	7440-47-3		
Cobalt	0.0020J	mg/L	0.010	0.00052	1	11/13/18 13:10	11/15/18 19:15	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	11/13/18 13:10	11/15/18 19:15	7439-92-1		
Lithium	0.0039J	mg/L	0.050	0.00097	1	11/13/18 13:10	11/15/18 19:15	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	11/13/18 13:10	11/15/18 19:15	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	11/13/18 13:10	11/15/18 19:15	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	11/13/18 13:10	11/15/18 19:15	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	11/12/18 12:30	11/12/18 18:56	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	295	mg/L	25.0	10.0	1		11/13/18 15:40			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	6.1	mg/L	0.25	0.024	1		11/15/18 10:53	16887-00-6		
Fluoride	0.50	mg/L	0.30	0.029	1		11/15/18 10:53	16984-48-8		
Sulfate	118	mg/L	10.0	0.17	10		11/15/18 12:35	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611393

Sample: DGWC-68A		Lab ID: 2611393006		Collected: 11/08/18 09:40		Received: 11/08/18 15:00		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	11/13/18 13:10	11/15/18 19:38	7440-36-0		
Arsenic	0.00060J	mg/L	0.0050	0.00057	1	11/13/18 13:10	11/15/18 19:38	7440-38-2		
Barium	0.092	mg/L	0.010	0.00078	1	11/13/18 13:10	11/15/18 19:38	7440-39-3		
Beryllium	ND	mg/L	0.0030	0.000050	1	11/13/18 13:10	11/15/18 19:38	7440-41-7		
Boron	1.8	mg/L	0.040	0.0039	1	11/13/18 13:10	11/15/18 19:38	7440-42-8		
Cadmium	0.00025J	mg/L	0.0010	0.000093	1	11/13/18 13:10	11/15/18 19:38	7440-43-9		
Calcium	46.8	mg/L	25.0	0.69	50	11/13/18 13:10	11/15/18 19:44	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	11/13/18 13:10	11/15/18 19:38	7440-47-3		
Cobalt	ND	mg/L	0.010	0.00052	1	11/13/18 13:10	11/15/18 19:38	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	11/13/18 13:10	11/15/18 19:38	7439-92-1		
Lithium	ND	mg/L	0.050	0.00097	1	11/13/18 13:10	11/15/18 19:38	7439-93-2		
Molybdenum	0.20	mg/L	0.010	0.0019	1	11/13/18 13:10	11/15/18 19:38	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	11/13/18 13:10	11/15/18 19:38	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	11/13/18 13:10	11/15/18 19:38	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	11/12/18 12:30	11/12/18 19:10	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	277	mg/L	25.0	10.0	1		11/13/18 15:40			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	ND	mg/L	0.25	0.024	1		11/15/18 11:13	16887-00-6		
Fluoride	0.040J	mg/L	0.30	0.029	1		11/15/18 11:13	16984-48-8		
Sulfate	43.5	mg/L	1.0	0.017	1		11/15/18 11:13	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611393

Sample: DGWC-69		Lab ID: 2611393007		Collected: 11/08/18 08:25		Received: 11/08/18 15:00		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	11/13/18 13:10	11/15/18 19:49	7440-36-0		
Arsenic	0.020	mg/L	0.0050	0.00057	1	11/13/18 13:10	11/15/18 19:49	7440-38-2		
Barium	0.072	mg/L	0.010	0.00078	1	11/13/18 13:10	11/15/18 19:49	7440-39-3		
Beryllium	ND	mg/L	0.0030	0.000050	1	11/13/18 13:10	11/15/18 19:49	7440-41-7		
Boron	0.054	mg/L	0.040	0.0039	1	11/13/18 13:10	11/15/18 19:49	7440-42-8		
Cadmium	ND	mg/L	0.0010	0.000093	1	11/13/18 13:10	11/15/18 19:49	7440-43-9		
Calcium	8.5	mg/L	0.50	0.014	1	11/13/18 13:10	11/15/18 19:49	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	11/13/18 13:10	11/15/18 19:49	7440-47-3		
Cobalt	ND	mg/L	0.010	0.00052	1	11/13/18 13:10	11/15/18 19:49	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	11/13/18 13:10	11/15/18 19:49	7439-92-1		
Lithium	0.0025J	mg/L	0.050	0.00097	1	11/13/18 13:10	11/15/18 19:49	7439-93-2		
Molybdenum	0.0059J	mg/L	0.010	0.0019	1	11/13/18 13:10	11/15/18 19:49	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	11/13/18 13:10	11/15/18 19:49	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	11/13/18 13:10	11/15/18 19:49	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	11/12/18 12:30	11/12/18 19:12	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	112	mg/L	25.0	10.0	1		11/13/18 15:40			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	5.9	mg/L	0.25	0.024	1		11/15/18 11:34	16887-00-6		
Fluoride	0.12J	mg/L	0.30	0.029	1		11/15/18 11:34	16984-48-8		
Sulfate	9.7	mg/L	1.0	0.017	1		11/15/18 11:34	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611393

Sample: FD-3		Lab ID: 2611393008		Collected: 11/08/18 00:00	Received: 11/08/18 15:00	Matrix: Water				
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	11/13/18 13:10	11/15/18 20:01	7440-36-0		
Arsenic	0.020	mg/L	0.0050	0.00057	1	11/13/18 13:10	11/15/18 20:01	7440-38-2		
Barium	0.075	mg/L	0.010	0.00078	1	11/13/18 13:10	11/15/18 20:01	7440-39-3		
Beryllium	ND	mg/L	0.0030	0.000050	1	11/13/18 13:10	11/15/18 20:01	7440-41-7		
Boron	0.056	mg/L	0.040	0.0039	1	11/13/18 13:10	11/15/18 20:01	7440-42-8		
Cadmium	ND	mg/L	0.0010	0.000093	1	11/13/18 13:10	11/15/18 20:01	7440-43-9		
Calcium	8.7	mg/L	0.50	0.014	1	11/13/18 13:10	11/15/18 20:01	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	11/13/18 13:10	11/15/18 20:01	7440-47-3		
Cobalt	ND	mg/L	0.010	0.00052	1	11/13/18 13:10	11/15/18 20:01	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	11/13/18 13:10	11/15/18 20:01	7439-92-1		
Lithium	0.0026J	mg/L	0.050	0.00097	1	11/13/18 13:10	11/15/18 20:01	7439-93-2		
Molybdenum	0.0060J	mg/L	0.010	0.0019	1	11/13/18 13:10	11/15/18 20:01	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	11/13/18 13:10	11/15/18 20:01	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	11/13/18 13:10	11/15/18 20:01	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	11/12/18 12:30	11/12/18 19:14	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	111	mg/L	25.0	10.0	1		11/13/18 15:40			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	5.9	mg/L	0.25	0.024	1		11/15/18 11:55	16887-00-6		
Fluoride	0.036J	mg/L	0.30	0.029	1		11/15/18 11:55	16984-48-8		
Sulfate	9.7	mg/L	1.0	0.017	1		11/15/18 11:55	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611393

Sample: FB-3		Lab ID: 2611393009		Collected: 11/08/18 11:10		Received: 11/08/18 15:00		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	11/13/18 13:10	11/15/18 20:12	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	11/13/18 13:10	11/15/18 20:12	7440-38-2		
Barium	ND	mg/L	0.010	0.00078	1	11/13/18 13:10	11/15/18 20:12	7440-39-3		
Beryllium	ND	mg/L	0.0030	0.000050	1	11/13/18 13:10	11/15/18 20:12	7440-41-7		
Boron	ND	mg/L	0.040	0.0039	1	11/13/18 13:10	11/15/18 20:12	7440-42-8		
Cadmium	ND	mg/L	0.0010	0.000093	1	11/13/18 13:10	11/15/18 20:12	7440-43-9		
Calcium	ND	mg/L	0.50	0.014	1	11/13/18 13:10	11/15/18 20:12	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	11/13/18 13:10	11/15/18 20:12	7440-47-3		
Cobalt	ND	mg/L	0.010	0.00052	1	11/13/18 13:10	11/15/18 20:12	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	11/13/18 13:10	11/15/18 20:12	7439-92-1		
Lithium	ND	mg/L	0.050	0.00097	1	11/13/18 13:10	11/15/18 20:12	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	11/13/18 13:10	11/15/18 20:12	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	11/13/18 13:10	11/15/18 20:12	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	11/13/18 13:10	11/15/18 20:12	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	11/12/18 12:30	11/12/18 19:17	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	30.0	mg/L	25.0	10.0	1		11/13/18 15:40			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	0.099J	mg/L	0.25	0.024	1		11/15/18 13:41	16887-00-6	B	
Fluoride	ND	mg/L	0.30	0.029	1		11/15/18 13:41	16984-48-8		
Sulfate	ND	mg/L	1.0	0.017	1		11/15/18 13:41	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611393

Sample: EB-3		Lab ID: 2611393010		Collected: 11/08/18 10:30		Received: 11/08/18 15:00		Matrix: Water		
Parameters	Results	Units	Report			Prepared	Analyzed	CAS No.	Qual	
			Limit	MDL	DF					
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Antimony	ND	mg/L	0.0030	0.00078	1	11/13/18 13:10	11/15/18 20:18	7440-36-0		
Arsenic	ND	mg/L	0.0050	0.00057	1	11/13/18 13:10	11/15/18 20:18	7440-38-2		
Barium	ND	mg/L	0.010	0.00078	1	11/13/18 13:10	11/15/18 20:18	7440-39-3		
Beryllium	ND	mg/L	0.0030	0.000050	1	11/13/18 13:10	11/15/18 20:18	7440-41-7		
Boron	ND	mg/L	0.040	0.0039	1	11/13/18 13:10	11/15/18 20:18	7440-42-8		
Cadmium	ND	mg/L	0.0010	0.000093	1	11/13/18 13:10	11/15/18 20:18	7440-43-9		
Calcium	ND	mg/L	0.50	0.014	1	11/13/18 13:10	11/15/18 20:18	7440-70-2		
Chromium	ND	mg/L	0.010	0.0016	1	11/13/18 13:10	11/15/18 20:18	7440-47-3		
Cobalt	ND	mg/L	0.010	0.00052	1	11/13/18 13:10	11/15/18 20:18	7440-48-4		
Lead	ND	mg/L	0.0050	0.00027	1	11/13/18 13:10	11/15/18 20:18	7439-92-1		
Lithium	ND	mg/L	0.050	0.00097	1	11/13/18 13:10	11/15/18 20:18	7439-93-2		
Molybdenum	ND	mg/L	0.010	0.0019	1	11/13/18 13:10	11/15/18 20:18	7439-98-7		
Selenium	ND	mg/L	0.010	0.0014	1	11/13/18 13:10	11/15/18 20:18	7782-49-2		
Thallium	ND	mg/L	0.0010	0.00014	1	11/13/18 13:10	11/15/18 20:18	7440-28-0		
7470 Mercury		Analytical Method: EPA 7470A Preparation Method: EPA 7470A								
Mercury	ND	mg/L	0.00050	0.000036	1	11/12/18 12:30	11/12/18 19:19	7439-97-6		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	ND	mg/L	25.0	10.0	1		11/13/18 15:48			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	0.096J	mg/L	0.25	0.024	1		11/15/18 14:03	16887-00-6	B	
Fluoride	ND	mg/L	0.30	0.029	1		11/15/18 14:03	16984-48-8		
Sulfate	ND	mg/L	1.0	0.017	1		11/15/18 14:03	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611393

QC Batch: 16934 Analysis Method: EPA 7470A
QC Batch Method: EPA 7470A Analysis Description: 7470 Mercury
Associated Lab Samples: 2611393001, 2611393002, 2611393003, 2611393004

METHOD BLANK: 76505 Matrix: Water
Associated Lab Samples: 2611393001, 2611393002, 2611393003, 2611393004

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Mercury	mg/L	ND	0.00050	0.000036	11/12/18 17:35	

LABORATORY CONTROL SAMPLE: 76506

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Mercury	mg/L	.0025	0.0024	97	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 76507 76508

Parameter	Units	2611389001 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
Mercury	mg/L	0.000045J	.0025	.0025	0.0025	0.0025	97	100	75-125	3	20	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611393

QC Batch: 16941

Analysis Method: EPA 7470A

QC Batch Method: EPA 7470A

Analysis Description: 7470 Mercury

Associated Lab Samples: 2611393005, 2611393006, 2611393007, 2611393008, 2611393009, 2611393010

METHOD BLANK: 76539

Matrix: Water

Associated Lab Samples: 2611393005, 2611393006, 2611393007, 2611393008, 2611393009, 2611393010

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Mercury	mg/L	ND	0.00050	0.000036	11/12/18 18:51	

LABORATORY CONTROL SAMPLE: 76540

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Mercury	mg/L	.0025	0.0025	100	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 76541 76542

Parameter	Units	2611393005 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
Mercury	mg/L	ND	.0025	.0025	0.0025	0.0025	101	101	75-125	0	20	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611393

QC Batch: 17097 Analysis Method: EPA 6020B
 QC Batch Method: EPA 3005A Analysis Description: 6020B MET
 Associated Lab Samples: 2611393001, 2611393002, 2611393003, 2611393004, 2611393005, 2611393006, 2611393007, 2611393008, 2611393009, 2611393010

METHOD BLANK: 76972 Matrix: Water
 Associated Lab Samples: 2611393001, 2611393002, 2611393003, 2611393004, 2611393005, 2611393006, 2611393007, 2611393008, 2611393009, 2611393010

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Antimony	mg/L	ND	0.0030	0.00078	11/15/18 16:12	
Arsenic	mg/L	ND	0.0050	0.00057	11/15/18 16:12	
Barium	mg/L	ND	0.010	0.00078	11/15/18 16:12	
Beryllium	mg/L	ND	0.0030	0.000050	11/15/18 16:12	
Boron	mg/L	ND	0.040	0.0039	11/15/18 16:12	
Cadmium	mg/L	ND	0.0010	0.000093	11/15/18 16:12	
Calcium	mg/L	ND	0.50	0.014	11/15/18 16:12	
Chromium	mg/L	ND	0.010	0.0016	11/15/18 16:12	
Cobalt	mg/L	ND	0.010	0.00052	11/15/18 16:12	
Lead	mg/L	ND	0.0050	0.00027	11/15/18 16:12	
Lithium	mg/L	ND	0.050	0.00097	11/15/18 16:12	
Molybdenum	mg/L	ND	0.010	0.0019	11/15/18 16:12	
Selenium	mg/L	ND	0.010	0.0014	11/15/18 16:12	
Thallium	mg/L	ND	0.0010	0.00014	11/15/18 16:12	

LABORATORY CONTROL SAMPLE: 76973

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Antimony	mg/L	.1	0.11	112	80-120	
Arsenic	mg/L	.1	0.10	104	80-120	
Barium	mg/L	.1	0.11	107	80-120	
Beryllium	mg/L	.1	0.099	99	80-120	
Boron	mg/L	1	1.0	100	80-120	
Cadmium	mg/L	.1	0.10	102	80-120	
Calcium	mg/L	1	0.99	99	80-120	
Chromium	mg/L	.1	0.10	102	80-120	
Cobalt	mg/L	.1	0.10	102	80-120	
Lead	mg/L	.1	0.10	100	80-120	
Lithium	mg/L	.1	0.10	100	80-120	
Molybdenum	mg/L	.1	0.10	104	80-120	
Selenium	mg/L	.1	0.11	108	80-120	
Thallium	mg/L	.1	0.10	101	80-120	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611393

Parameter	Units	MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 76974		76975		MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	Max RPD	RPD	Qual
		2611389011 Result	MS Spike Conc.	MSD Spike Conc.									
Antimony	mg/L	ND	.1	.1	0.11	0.10	113	104	75-125	8	20		
Arsenic	mg/L	0.0022J	.1	.1	0.11	0.10	107	100	75-125	6	20		
Barium	mg/L	0.020	.1	.1	0.12	0.12	104	95	75-125	7	20		
Beryllium	mg/L	0.014	.1	.1	0.12	0.11	103	96	75-125	6	20		
Boron	mg/L	0.30	1	1	1.3	1.2	98	90	75-125	7	20		
Cadmium	mg/L	0.0016	.1	.1	0.11	0.097	104	95	75-125	9	20		
Calcium	mg/L	38.6	1	1	38.1	35.8	-53	-276	75-125	6	20	M6	
Chromium	mg/L	ND	.1	.1	0.10	0.093	102	92	75-125	10	20		
Cobalt	mg/L	0.35	.1	.1	0.43	0.40	75	51	75-125	6	20	M1	
Lead	mg/L	0.00091J	.1	.1	0.10	0.093	99	92	75-125	8	20		
Lithium	mg/L	0.082	.1	.1	0.18	0.17	97	88	75-125	5	20		
Molybdenum	mg/L	ND	.1	.1	0.10	0.096	103	96	75-125	7	20		
Selenium	mg/L	0.0045J	.1	.1	0.11	0.10	109	98	75-125	10	20		
Thallium	mg/L	0.00032J	.1	.1	0.10	0.093	100	92	75-125	8	20		

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611393

QC Batch: 17079 Analysis Method: SM 2540C
 QC Batch Method: SM 2540C Analysis Description: 2540C Total Dissolved Solids
 Associated Lab Samples: 2611393001, 2611393002, 2611393003, 2611393004, 2611393005, 2611393006, 2611393007, 2611393008, 2611393009

LABORATORY CONTROL SAMPLE: 76893

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	400	412	103	84-108	

SAMPLE DUPLICATE: 76894

Parameter	Units	2611389007 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	834	860	3	10	

SAMPLE DUPLICATE: 76895

Parameter	Units	2611393007 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	112	112	0	10	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611393

QC Batch: 17114	Analysis Method: SM 2540C
QC Batch Method: SM 2540C	Analysis Description: 2540C Total Dissolved Solids
Associated Lab Samples: 2611393010	

LABORATORY CONTROL SAMPLE: 77047

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	400	402	100	84-108	

SAMPLE DUPLICATE: 77048

Parameter	Units	2611393010 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	ND	ND		10	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611393

QC Batch: 17167 Analysis Method: EPA 300.0
QC Batch Method: EPA 300.0 Analysis Description: 300.0 IC Anions
Associated Lab Samples: 2611393001, 2611393002, 2611393003, 2611393004, 2611393005, 2611393006, 2611393007, 2611393008, 2611393009, 2611393010

METHOD BLANK: 77239 Matrix: Water
Associated Lab Samples: 2611393001, 2611393002, 2611393003, 2611393004, 2611393005, 2611393006, 2611393007, 2611393008, 2611393009, 2611393010

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Chloride	mg/L	0.081J	0.25	0.024	11/15/18 03:18	
Fluoride	mg/L	ND	0.30	0.029	11/15/18 03:18	
Sulfate	mg/L	ND	1.0	0.017	11/15/18 03:18	

LABORATORY CONTROL SAMPLE: 77240

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	10	10.2	102	90-110	
Fluoride	mg/L	10	10.0	100	90-110	
Sulfate	mg/L	10	10.0	100	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 77241 77242

Parameter	Units	2611389009 Result	MS		MSD		MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
			Spike Conc.	MS Result	MSD Result	MSD Result						
Chloride	mg/L	25.8	10	10	33.0	32.8	72	70	90-110	0	15	M1
Fluoride	mg/L	ND	10	10	9.7	9.5	97	95	90-110	2	15	
Sulfate	mg/L	320	10	10	190	190	-1300	-1290	90-110	0	15	E,M1

MATRIX SPIKE SAMPLE: 77243

Parameter	Units	2611389010 Result	Spike Conc.	MS Result	MS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	28.6	10	35.7	72	90-110	M1
Fluoride	mg/L	ND	10	10.1	101	90-110	
Sulfate	mg/L	439	10	226	-2140	90-110	E,M1

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611393

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

ANALYTE QUALIFIERS

B Analyte was detected in the associated method blank.

E Analyte concentration exceeded the calibration range. The reported result is estimated.

M1 Matrix spike recovery exceeded QC limits. Batch accepted based on laboratory control sample (LCS) recovery.

M6 Matrix spike and Matrix spike duplicate recovery not evaluated against control limits due to sample dilution.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611393

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
2611393001	DGWC-37	EPA 3005A	17097	EPA 6020B	17226
2611393002	DGWC-38	EPA 3005A	17097	EPA 6020B	17226
2611393003	DGWC-39	EPA 3005A	17097	EPA 6020B	17226
2611393004	DGWC-40	EPA 3005A	17097	EPA 6020B	17226
2611393005	DGWC-67	EPA 3005A	17097	EPA 6020B	17226
2611393006	DGWC-68A	EPA 3005A	17097	EPA 6020B	17226
2611393007	DGWC-69	EPA 3005A	17097	EPA 6020B	17226
2611393008	FD-3	EPA 3005A	17097	EPA 6020B	17226
2611393009	FB-3	EPA 3005A	17097	EPA 6020B	17226
2611393010	EB-3	EPA 3005A	17097	EPA 6020B	17226
2611393001	DGWC-37	EPA 7470A	16934	EPA 7470A	17026
2611393002	DGWC-38	EPA 7470A	16934	EPA 7470A	17026
2611393003	DGWC-39	EPA 7470A	16934	EPA 7470A	17026
2611393004	DGWC-40	EPA 7470A	16934	EPA 7470A	17026
2611393005	DGWC-67	EPA 7470A	16941	EPA 7470A	17037
2611393006	DGWC-68A	EPA 7470A	16941	EPA 7470A	17037
2611393007	DGWC-69	EPA 7470A	16941	EPA 7470A	17037
2611393008	FD-3	EPA 7470A	16941	EPA 7470A	17037
2611393009	FB-3	EPA 7470A	16941	EPA 7470A	17037
2611393010	EB-3	EPA 7470A	16941	EPA 7470A	17037
2611393001	DGWC-37	SM 2540C	17079		
2611393002	DGWC-38	SM 2540C	17079		
2611393003	DGWC-39	SM 2540C	17079		
2611393004	DGWC-40	SM 2540C	17079		
2611393005	DGWC-67	SM 2540C	17079		
2611393006	DGWC-68A	SM 2540C	17079		
2611393007	DGWC-69	SM 2540C	17079		
2611393008	FD-3	SM 2540C	17079		
2611393009	FB-3	SM 2540C	17079		
2611393010	EB-3	SM 2540C	17114		
2611393001	DGWC-37	EPA 300.0	17167		
2611393002	DGWC-38	EPA 300.0	17167		
2611393003	DGWC-39	EPA 300.0	17167		
2611393004	DGWC-40	EPA 300.0	17167		
2611393005	DGWC-67	EPA 300.0	17167		
2611393006	DGWC-68A	EPA 300.0	17167		
2611393007	DGWC-69	EPA 300.0	17167		
2611393008	FD-3	EPA 300.0	17167		
2611393009	FB-3	EPA 300.0	17167		
2611393010	EB-3	EPA 300.0	17167		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



CHAIN-OF-CUSTODY / Analytical Request Document

The Chain-of-Custody is a LEGAL DOCUMENT. All relevant fields must be completed accurately.

Section A Required Client Information:	Section B Required Project Information:	Section C Invoice Information:	Page : 1 Of 1
Company: Georgia Power - Coal Combustion Residuals	Report To: John Abraham	Attention: sctinvoic@southernco.com	
Address: 2480 Maner Road Atlanta, GA 30339	Copy To: Goldier	Company Name: Address:	
Email: j.abraham@southernco.com	Purchase Order #:	Pace Quote:	Regulatory Agency
Phone: (404)506-7239 Fax	Project Name: Plant McDonough AP-1	Pace Project Manager: betsy.mcdaniel@pacelabs.com	State / Location GA
Requested Due Date: Standard TAT	Project #: 168849618	Pace Profile #: 332.1.2	

ITEM #	MATRIX	CODED	SAMPLE TYPE (G-RAB C-COMP)	DATE	TIME	# OF CONTAINERS	PRESERVATIVES										ANALYSES TEST	Requested Analysis Filtered (Y/N)	Residual Chlorine (Y/N)	Extra Radium			
							H2SO4	HNO3	HCl	NaOH	Na2S2O3	Methanol	Other	Metals App. III & App. IV	TDS, Cl, F, SO4	Radom 226/228							
1	DGWC-37	✓	G	11/6/2018	935	6	X	X								X	X	X					
2	DGWC-38	✓	G	11/6/2018	1100	4	X	X								X	X	X					
3	DGWC-39	✓	G	11/6/2018	850	4	X	X								X	X	X					
4	DGWC-40	✓	G	11/6/2018	810	4	X	X								X	X	X					
5	DGWC-67	✓	G	11/6/2018	1100	4	X	X								X	X	X					
6	DGWC-88A	✓	G	11/6/2018	940	4	X	X								X	X	X					
7	DGWC-89	✓	G	11/6/2018	825	4	X	X								X	X	X					
8	FD-3	✓	G	11/6/2018	-	4	X	X								X	X	X					
9	FB-3	✓	G	11/6/2018	1110	4	X	X								X	X	X					
10	EB-3	✓	G	11/6/2018	1030	4	X	X								X	X	X					
11																							
12																							

NO# : 2611393

2611393

ADDITIONAL COMMENTS	RELINQUISHED BY / AFFILIATION	DATE	TIME	ACCEPTED BY / AFFILIATION	DATE	TIME	SAMPLE CONDITIONS						
							Received on	Temp in C	Custody	Sealed	Cooled	Intact	
Sampled by: Chris T. Hall 11/8/18	<i>[Signature]</i>	11-8-18	15:00	Mcdaniel	11/8/18	15:00	Received on	Temp in C	Custody	Sealed	Cooled	Intact	



Sample Condition Upon Receipt

Client Name: GIA POWER

Project # _____

Courier: Fed Ex UPS USPS Client Commercial Pace Other
Tracking #: _____

WO#: **2611393**

PM: **BM** Due Date: **11/15/18**
CLIENT: **GAPower-CCR**

Custody Seal on Cooler/Box Present: yes no Seals intact: yes

Packing Material: Bubble Wrap Bubble Bags None Other

Thermometer Used 83 Type of Ice: Wet Blue None Samples on ice, cooling process has begun

Cooler Temperature 1.3 Biological Tissue is Frozen: Yes No

Temp should be above freezing to 6°C

Date and Initials of person examining contents: 11/08/18 MK

Comments: _____

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.		
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.		
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.		
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.		
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.		
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.		
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.		
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.		
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.		
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.		
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.		
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.		
-Includes date/time/ID/Analysis Matrix: <u>W</u>				
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.		
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed		Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.		
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.		
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.		
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A			
Pace Trip Blank Lot # (if purchased): _____				

Client Notification/ Resolution:

Field Data Required? Y / N

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: _____

Project Manager Review: _____

Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

December 10, 2018

Joju Abraham
Georgia Power - Coal Combustion Residuals
2480 Maner Road
Atlanta, GA 30339

RE: Project: Plant McDonough Ash Ponds
Pace Project No.: 2611395

Dear Joju Abraham:

Enclosed are the analytical results for sample(s) received by the laboratory on November 08, 2018. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Betsy McDaniel
betsy.mcdaniel@pacelabs.com
(770)734-4200
Project Manager

Enclosures

cc: Kristen Jurinko, Golder Associates Inc.
Julie Lehrman, Golder Associates Inc.
Maria Padilla, Georgia Power
Dawn Prell, Golder Associates Inc.
Tim Richards, Golder Associates - Atlanta
Rebecca Thornton, Pace Analytical Atlanta



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611395

Pennsylvania Certification IDs

1638 Roseytown Rd Suites 2,3&4, Greensburg, PA 15601

ANAB DOD-ELAP Rad Accreditation #: L2417

Alabama Certification #: 41590

Arizona Certification #: AZ0734

Arkansas Certification

California Certification #: 04222CA

Colorado Certification #: PA01547

Connecticut Certification #: PH-0694

Delaware Certification

EPA Region 4 DW Rad

Florida/TNI Certification #: E87683

Georgia Certification #: C040

Guam Certification

Hawaii Certification

Idaho Certification

Illinois Certification

Indiana Certification

Iowa Certification #: 391

Kansas/TNI Certification #: E-10358

Kentucky Certification #: KY90133

KY WW Permit #: KY0098221

KY WW Permit #: KY0000221

Louisiana DHH/TNI Certification #: LA180012

Louisiana DEQ/TNI Certification #: 4086

Maine Certification #: 2017020

Maryland Certification #: 308

Massachusetts Certification #: M-PA1457

Michigan/PADEP Certification #: 9991

Missouri Certification #: 235

Montana Certification #: Cert0082

Nebraska Certification #: NE-OS-29-14

Nevada Certification #: PA014572018-1

New Hampshire/TNI Certification #: 297617

New Jersey/TNI Certification #: PA051

New Mexico Certification #: PA01457

New York/TNI Certification #: 10888

North Carolina Certification #: 42706

North Dakota Certification #: R-190

Ohio EPA Rad Approval: #41249

Oregon/TNI Certification #: PA200002-010

Pennsylvania/TNI Certification #: 65-00282

Puerto Rico Certification #: PA01457

Rhode Island Certification #: 65-00282

South Dakota Certification

Tennessee Certification #: 02867

Texas/TNI Certification #: T104704188-17-3

Utah/TNI Certification #: PA014572017-9

USDA Soil Permit #: P330-17-00091

Vermont Dept. of Health: ID# VT-0282

Virgin Island/PADEP Certification

Virginia/VELAP Certification #: 9526

Washington Certification #: C868

West Virginia DEP Certification #: 143

West Virginia DHHR Certification #: 9964C

Wisconsin Approve List for Rad

Wyoming Certification #: 8TMS-L

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611395

Lab ID	Sample ID	Matrix	Date Collected	Date Received
2611395001	DGWC-37	Water	11/08/18 09:35	11/08/18 15:00
2611395002	DGWC-38	Water	11/08/18 11:00	11/08/18 15:00
2611395003	DGWC-39	Water	11/08/18 09:50	11/08/18 15:00
2611395004	DGWC-40	Water	11/08/18 08:10	11/08/18 15:00
2611395005	DGWC-67	Water	11/08/18 11:00	11/08/18 15:00
2611395006	DGWC-68A	Water	11/08/18 09:40	11/08/18 15:00
2611395007	DGWC-69	Water	11/08/18 08:25	11/08/18 15:00
2611395008	FD-3	Water	11/08/18 00:00	11/08/18 15:00
2611395009	FB-3	Water	11/08/18 11:10	11/08/18 15:00
2611395010	EB-3	Water	11/08/18 10:30	11/08/18 15:00

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611395

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
2611395001	DGWC-37	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
2611395002	DGWC-38	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
2611395003	DGWC-39	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
2611395004	DGWC-40	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
2611395005	DGWC-67	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
2611395006	DGWC-68A	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
2611395007	DGWC-69	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
2611395008	FD-3	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
2611395009	FB-3	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA
2611395010	EB-3	EPA 9315	LAL	1	PASI-PA
		EPA 9320	JLW	1	PASI-PA
		Total Radium Calculation	CMC	1	PASI-PA

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611395

Sample: DGWC-37 **Lab ID: 2611395001** Collected: 11/08/18 09:35 Received: 11/08/18 15:00 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.451 ± 0.218 (0.282) C:85% T:NA	pCi/L	12/03/18 08:58	13982-63-3	
Radium-228	EPA 9320	0.172 ± 0.357 (0.787) C:75% T:90%	pCi/L	12/04/18 12:59	15262-20-1	
Total Radium	Total Radium Calculation	0.623 ± 0.575 (1.07)	pCi/L	12/05/18 13:38	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611395

Sample: DGWC-38 **Lab ID: 2611395002** Collected: 11/08/18 11:00 Received: 11/08/18 15:00 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.422 ± 0.208 (0.261) C:83% T:NA	pCi/L	12/03/18 08:58	13982-63-3	
Radium-228	EPA 9320	0.158 ± 0.391 (0.871) C:73% T:79%	pCi/L	12/04/18 13:19	15262-20-1	
Total Radium	Total Radium Calculation	0.580 ± 0.599 (1.13)	pCi/L	12/05/18 13:38	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611395

Sample: DGWC-39 **Lab ID: 2611395003** Collected: 11/08/18 09:50 Received: 11/08/18 15:00 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.540 ± 0.233 (0.268) C:86% T:NA	pCi/L	12/03/18 08:58	13982-63-3	
Radium-228	EPA 9320	0.609 ± 0.577 (1.20) C:78% T:74%	pCi/L	12/04/18 15:59	15262-20-1	
Total Radium	Total Radium Calculation	1.15 ± 0.810 (1.47)	pCi/L	12/05/18 13:38	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611395

Sample: DGWC-40 **Lab ID: 2611395004** Collected: 11/08/18 08:10 Received: 11/08/18 15:00 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.328 ± 0.172 (0.220) C:91% T:NA	pCi/L	12/03/18 08:58	13982-63-3	
Radium-228	EPA 9320	0.137 ± 0.398 (0.889) C:75% T:88%	pCi/L	12/04/18 15:59	15262-20-1	
Total Radium	Total Radium Calculation	0.465 ± 0.570 (1.11)	pCi/L	12/05/18 13:38	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611395

Sample: DGWC-67 **Lab ID: 2611395005** Collected: 11/08/18 11:00 Received: 11/08/18 15:00 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.360 ± 0.205 (0.319) C:82% T:NA	pCi/L	12/03/18 08:58	13982-63-3	
Radium-228	EPA 9320	0.551 ± 0.484 (0.987) C:75% T:76%	pCi/L	12/04/18 15:59	15262-20-1	
Total Radium	Total Radium Calculation	0.911 ± 0.689 (1.31)	pCi/L	12/05/18 13:38	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611395

Sample: DGWC-68A **Lab ID: 2611395006** Collected: 11/08/18 09:40 Received: 11/08/18 15:00 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.393 ± 0.200 (0.281) C:86% T:NA	pCi/L	12/03/18 08:59	13982-63-3	
Radium-228	EPA 9320	-0.0363 ± 0.454 (1.05) C:76% T:82%	pCi/L	12/04/18 15:59	15262-20-1	
Total Radium	Total Radium Calculation	0.393 ± 0.654 (1.33)	pCi/L	12/05/18 13:38	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611395

Sample: DGWC-69 **Lab ID: 2611395007** Collected: 11/08/18 08:25 Received: 11/08/18 15:00 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.719 ± 0.254 (0.228) C:90% T:NA	pCi/L	12/03/18 08:59	13982-63-3	
Radium-228	EPA 9320	-0.368 ± 0.486 (1.16) C:80% T:76%	pCi/L	12/04/18 15:59	15262-20-1	
Total Radium	Total Radium Calculation	0.719 ± 0.740 (1.39)	pCi/L	12/05/18 13:38	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611395

Sample: FD-3 **Lab ID: 2611395008** Collected: 11/08/18 00:00 Received: 11/08/18 15:00 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.918 ± 0.309 (0.312) C:89% T:NA	pCi/L	12/03/18 08:59	13982-63-3	
Radium-228	EPA 9320	0.165 ± 0.345 (0.761) C:80% T:88%	pCi/L	12/04/18 16:03	15262-20-1	
Total Radium	Total Radium Calculation	1.08 ± 0.654 (1.07)	pCi/L	12/05/18 13:38	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611395

Sample: FB-3 **Lab ID: 2611395009** Collected: 11/08/18 11:10 Received: 11/08/18 15:00 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.299 ± 0.169 (0.232) C:86% T:NA	pCi/L	12/03/18 08:59	13982-63-3	
Radium-228	EPA 9320	0.430 ± 0.422 (0.870) C:80% T:73%	pCi/L	12/04/18 16:03	15262-20-1	
Total Radium	Total Radium Calculation	0.729 ± 0.591 (1.10)	pCi/L	12/06/18 14:20	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611395

Sample: EB-3 **Lab ID: 2611395010** Collected: 11/08/18 10:30 Received: 11/08/18 15:00 Matrix: Water
PWS: Site ID: Sample Type:

Parameters	Method	Act ± Unc (MDC) Carr Trac	Units	Analyzed	CAS No.	Qual
Radium-226	EPA 9315	0.449 ± 0.202 (0.221) C:86% T:NA	pCi/L	12/03/18 08:59	13982-63-3	
Radium-228	EPA 9320	0.248 ± 0.411 (0.894) C:80% T:71%	pCi/L	12/04/18 16:24	15262-20-1	
Total Radium	Total Radium Calculation	0.697 ± 0.613 (1.12)	pCi/L	12/06/18 14:20	7440-14-4	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611395

QC Batch:	320739	Analysis Method:	EPA 9320
QC Batch Method:	EPA 9320	Analysis Description:	9320 Radium 228
Associated Lab Samples:	2611395001, 2611395002, 2611395003, 2611395004, 2611395005, 2611395006, 2611395007, 2611395008, 2611395009, 2611395010		

METHOD BLANK:	1564308	Matrix:	Water
Associated Lab Samples:	2611395001, 2611395002, 2611395003, 2611395004, 2611395005, 2611395006, 2611395007, 2611395008, 2611395009, 2611395010		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-228	0.402 ± 0.356 (0.722) C:83% T:79%	pCi/L	12/04/18 13:19	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL - RADIOCHEMISTRY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2611395

QC Batch:	321124	Analysis Method:	EPA 9315
QC Batch Method:	EPA 9315	Analysis Description:	9315 Total Radium
Associated Lab Samples:	2611395001, 2611395002, 2611395003, 2611395004, 2611395005, 2611395006, 2611395007, 2611395008, 2611395009, 2611395010		

METHOD BLANK:	1566261	Matrix:	Water
Associated Lab Samples:	2611395001, 2611395002, 2611395003, 2611395004, 2611395005, 2611395006, 2611395007, 2611395008, 2611395009, 2611395010		

Parameter	Act ± Unc (MDC) Carr Trac	Units	Analyzed	Qualifiers
Radium-226	0.323 ± 0.164 (0.201) C:101% T:NA	pCi/L	12/03/18 08:58	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611395

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Act - Activity

Unc - Uncertainty: SDWA = 1.96 sigma count uncertainty, all other matrices = Expanded Uncertainty (95% confidence interval).

Gamma Spec = Expanded Uncertainty (95.4% Confidence Interval)

(MDC) - Minimum Detectable Concentration

Trac - Tracer Recovery (%)

Carr - Carrier Recovery (%)

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

LABORATORIES

PASI-PA Pace Analytical Services - Greensburg

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Ash Ponds
Pace Project No.: 2611395

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
2611395001	DGWC-37	EPA 9315	321124		
2611395002	DGWC-38	EPA 9315	321124		
2611395003	DGWC-39	EPA 9315	321124		
2611395004	DGWC-40	EPA 9315	321124		
2611395005	DGWC-67	EPA 9315	321124		
2611395006	DGWC-68A	EPA 9315	321124		
2611395007	DGWC-69	EPA 9315	321124		
2611395008	FD-3	EPA 9315	321124		
2611395009	FB-3	EPA 9315	321124		
2611395010	EB-3	EPA 9315	321124		
2611395001	DGWC-37	EPA 9320	320739		
2611395002	DGWC-38	EPA 9320	320739		
2611395003	DGWC-39	EPA 9320	320739		
2611395004	DGWC-40	EPA 9320	320739		
2611395005	DGWC-67	EPA 9320	320739		
2611395006	DGWC-68A	EPA 9320	320739		
2611395007	DGWC-69	EPA 9320	320739		
2611395008	FD-3	EPA 9320	320739		
2611395009	FB-3	EPA 9320	320739		
2611395010	EB-3	EPA 9320	320739		
2611395001	DGWC-37	Total Radium Calculation	322908		
2611395002	DGWC-38	Total Radium Calculation	322908		
2611395003	DGWC-39	Total Radium Calculation	322908		
2611395004	DGWC-40	Total Radium Calculation	322908		
2611395005	DGWC-67	Total Radium Calculation	322908		
2611395006	DGWC-68A	Total Radium Calculation	322908		
2611395007	DGWC-69	Total Radium Calculation	322908		
2611395008	FD-3	Total Radium Calculation	322908		
2611395009	FB-3	Total Radium Calculation	323089		
2611395010	EB-3	Total Radium Calculation	323089		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



CHAIN-OF-CUSTODY / Analytical Request Document

The Chain-of-Custody is a LEGAL DOCUMENT. All relevant fields must be completed accurately.

Section A
Required Client Information:
 Company: Georgia Power - Coal Combustion Residuals
 Address: 2480 Maner Road
 Atlanta, GA 30339
 Email: abraham@southernco.com
 Phone: (404)506-7239
 Project Name: Plant McDonough AP-1
 Requested Due Date: Standard TAT

Section B
Required Project Information:
 Report To: Jov Abraham
 Copy To: Goldier
 Purchase Order #: 168849618
 Project #: 168849618

Section C
Invoice Information:
 Attention: scsinvoices@southernco.com
 Company Name:
 Address:
 Pace Quote
 Pace Project Manager: betsy.mcdaniel@pacealabs.com
 State / Location: GA
 Regulatory Agency:

ITEM #	MATRIX	CODEN	MATERIAL TYPE (G=GRAB C=COMP)	DATE	TIME	# OF CONTAINERS	PRESERVATIVES										ANALYSES TEST Y/N	Requested Analysis Filtered (Y/N)	Residuals (Y/N)	Extra Radium				
							Unpreserved	H2SO4	HNO3	HCl	NaOH	Na2S2O3	Methanol	Other	Meq's App. III & App. IV	TDS, Cl, F, SO4					Radium 226/228			
1	DGWC-37	✓	G	11/8/2018	935	6	X																	
2	DGWC-38	✓	G	11/8/2018	1100	4	X																	
3	DGWC-39	✓	G	11/8/2018	950	4	X																	
4	DGWC-40	✓	G	11/8/2018	810	4	X																	
5	DGWC-67	✓	G	11/8/2018	1100	4	X																	
6	DGWC-68A	✓	G	11/8/2018	940	4	X																	
7	DGWC-69	✓	G	11/8/2018	825	4	X																	
8	FD-3	✓	G	11/8/2018	-	4	X																	
9	FB-3	✓	G	11/8/2018	1110	4	X																	
10	EB-3	✓	G	11/8/2018	1030	4	X																	
11																								
12																								

WO#: 2611395



RELINQUISHED BY / AFFILIATION	DATE	TIME	ACCEPTED BY / AFFILIATION	DATE	TIME	TEMP °C	Received on	Sealed	Custody	Samples
<i>[Signature]</i>	11-8-18	15:00	<i>M. Mahan</i>	11/8/18	15:00	1.3	X	X	X	X
Sampled by: <i>Chris Todd</i>	11/8/18									

Sample Condition Upon Receipt

Face Analytical

Client Name: GA Power

Project # _____

WO#: 2611395

PM: **BM**

Due Date: **12/10/18**

CLIENT: **GAPower-CCR**

Courier: Fed Ex UPS USPS Client Commercial Pace Other

Tracking #: _____

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other

Thermometer Used 83

Type of Ice: Wet Blue None

Samples on ice, cooling process has begun

Cooler Temperature 1.3

Biological Tissue is Frozen: Yes No

Temp should be above freezing to 6°C

Comments: _____

Date and Initials of person examining contents: 11/08/18 MK

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.		
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.		
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.		
Sampler Name & Signature on COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	4.		
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.		
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.		
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.		
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.		
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.		
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.		
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.		
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.		
-Includes date/time/ID/Analysis Matrix:	<u>W</u>			
All containers needing preservation have been checked.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.		
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed		Lot # of added preservative
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.		
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.		
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.		
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A			
Pace Trip Blank Lot # (if purchased):	_____			

Client Notification/ Resolution:

Field Data Required? Y / N

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: _____

Project Manager Review: _____

Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

LABORATORY ANALYTICAL DATA

March 2019

March 20, 2019

Joju Abraham
Georgia Power - Coal Combustion Residuals
2480 Maner Road
Atlanta, GA 30339

RE: Project: Plant McDonough Ash Ponds
Pace Project No.: 2616035

Dear Joju Abraham:

Enclosed are the analytical results for sample(s) received by the laboratory on March 13, 2019. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Betsy McDaniel
betsy.mcdaniel@pacelabs.com
(770)734-4200
Project Manager

Enclosures

cc: Kristen Jurinko, Golder Associates Inc.
Julie Lehrman, Golder Associates Inc.
Dawn Prell, Golder Associates Inc.
Tim Richards, Golder Associates - Atlanta
Rebecca Thornton, Pace Analytical Atlanta



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: Plant McDonough Ash Ponds

Pace Project No.: 2616035

Atlanta Certification IDs

110 Technology Parkway Peachtree Corners, GA 30092

Florida DOH Certification #: E87315

Georgia DW Inorganics Certification #: 812

Georgia DW Microbiology Certification #: 812

North Carolina Certification #: 381

South Carolina Certification #: 98011001

Virginia Certification #: 460204

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: Plant McDonough Ash Ponds

Pace Project No.: 2616035

Lab ID	Sample ID	Matrix	Date Collected	Date Received
2616035001	DGWA-70A	Water	03/12/19 11:25	03/13/19 14:00
2616035002	DGWA-71	Water	03/12/19 12:55	03/13/19 14:00
2616035003	FD-1	Water	03/12/19 00:00	03/13/19 14:00
2616035004	EB-1	Water	03/12/19 11:50	03/13/19 14:00

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Ash Ponds

Pace Project No.: 2616035

Lab ID	Sample ID	Method	Analysts	Analytes Reported
2616035001	DGWA-70A	EPA 6020B	CSW	2
		SM 2540C	RLC	1
		EPA 300.0	RLC	3
2616035002	DGWA-71	EPA 6020B	CSW	2
		SM 2540C	RLC	1
		EPA 300.0	RLC	3
2616035003	FD-1	EPA 6020B	CSW	2
		SM 2540C	RLC	1
		EPA 300.0	RLC	3
2616035004	EB-1	EPA 6020B	CSW	2
		SM 2540C	RLC	1
		EPA 300.0	RLC	3

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 2616035

Sample: DGWA-70A		Lab ID: 2616035001		Collected: 03/12/19 11:25		Received: 03/13/19 14:00		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Boron	0.0073J	mg/L	0.040	0.0039	1	03/14/19 14:26	03/15/19 22:32	7440-42-8	
Calcium	5.1	mg/L	0.50	0.014	1	03/14/19 14:26	03/15/19 22:32	7440-70-2	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	43.0	mg/L	25.0	10.0	1		03/18/19 17:01		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	2.5	mg/L	0.25	0.024	1		03/16/19 03:48	16887-00-6	B
Fluoride	0.039J	mg/L	0.30	0.029	1		03/16/19 03:48	16984-48-8	
Sulfate	0.35J	mg/L	1.0	0.017	1		03/16/19 03:48	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 2616035

Sample: DGWA-71		Lab ID: 2616035002		Collected: 03/12/19 12:55	Received: 03/13/19 14:00	Matrix: Water				
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual	
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Boron	0.0068J	mg/L	0.040	0.0039	1	03/14/19 14:26	03/15/19 22:44	7440-42-8		
Calcium	5.5	mg/L	0.50	0.014	1	03/14/19 14:26	03/15/19 22:44	7440-70-2		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	74.0	mg/L	25.0	10.0	1		03/18/19 17:01			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	3.3	mg/L	0.25	0.024	1		03/16/19 04:11	16887-00-6		
Fluoride	ND	mg/L	0.30	0.029	1		03/16/19 04:11	16984-48-8		
Sulfate	7.0	mg/L	1.0	0.017	1		03/16/19 04:11	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 2616035

Sample: FD-1		Lab ID: 2616035003		Collected: 03/12/19 00:00	Received: 03/13/19 14:00	Matrix: Water				
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual	
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Boron	ND	mg/L	0.040	0.0039	1	03/14/19 14:26	03/15/19 23:07	7440-42-8		
Calcium	5.2	mg/L	0.50	0.014	1	03/14/19 14:26	03/15/19 23:07	7440-70-2		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	50.0	mg/L	25.0	10.0	1		03/18/19 17:01			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	2.9	mg/L	0.25	0.024	1		03/16/19 04:34	16887-00-6	B	
Fluoride	0.045J	mg/L	0.30	0.029	1		03/16/19 04:34	16984-48-8		
Sulfate	0.37J	mg/L	1.0	0.017	1		03/16/19 04:34	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Ash Ponds

Pace Project No.: 2616035

Sample: EB-1		Lab ID: 2616035004		Collected: 03/12/19 11:50		Received: 03/13/19 14:00		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Boron	ND	mg/L	0.040	0.0039	1	03/14/19 14:26	03/15/19 23:18	7440-42-8	
Calcium	0.029J	mg/L	0.50	0.014	1	03/14/19 14:26	03/15/19 23:18	7440-70-2	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	17.0J	mg/L	25.0	10.0	1		03/18/19 17:01		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	0.37	mg/L	0.25	0.024	1		03/16/19 04:56	16887-00-6	B
Fluoride	ND	mg/L	0.30	0.029	1		03/16/19 04:56	16984-48-8	
Sulfate	1.1	mg/L	1.0	0.017	1		03/16/19 04:56	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds
Pace Project No.: 2616035

QC Batch: 24312 Analysis Method: EPA 6020B
QC Batch Method: EPA 3005A Analysis Description: 6020B MET
Associated Lab Samples: 2616035001, 2616035002, 2616035003, 2616035004

METHOD BLANK: 108896 Matrix: Water
Associated Lab Samples: 2616035001, 2616035002, 2616035003, 2616035004

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Boron	mg/L	ND	0.040	0.0039	03/15/19 18:30	
Calcium	mg/L	ND	0.50	0.014	03/15/19 18:30	

LABORATORY CONTROL SAMPLE: 108897

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Boron	mg/L	1	0.99	99	80-120	
Calcium	mg/L	1	1.0	103	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 108898 108899

Parameter	Units	2616034004		108899		MS		MSD		% Rec Limits	RPD	Max RPD	Qual
		Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	% Rec	% Rec					
Boron	mg/L	1.5	1	1	2.5	2.5	100	103	75-125	1	20		
Calcium	mg/L	54.3	1	1	54.7	56.0	38	170	75-125	2	20	M6	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Ash Ponds

Pace Project No.: 2616035

QC Batch: 24402 Analysis Method: EPA 300.0
 QC Batch Method: EPA 300.0 Analysis Description: 300.0 IC Anions
 Associated Lab Samples: 2616035001, 2616035002, 2616035003, 2616035004

METHOD BLANK: 109496 Matrix: Water
 Associated Lab Samples: 2616035001, 2616035002, 2616035003, 2616035004

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Chloride	mg/L	0.31	0.25	0.024	03/15/19 20:10	
Fluoride	mg/L	ND	0.30	0.029	03/15/19 20:10	
Sulfate	mg/L	ND	1.0	0.017	03/15/19 20:10	

LABORATORY CONTROL SAMPLE: 109497

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	10	10.2	102	90-110	
Fluoride	mg/L	10	10.4	104	90-110	
Sulfate	mg/L	10	10.9	109	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 109498 109499

Parameter	Units	2616034001 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
Chloride	mg/L	3.1	10	10	13.2	13.2	101	101	90-110	0	15	
Fluoride	mg/L	0.052J	10	10	10.4	10.4	103	103	90-110	0	15	
Sulfate	mg/L	159	10	10	126	125	-335	-335	90-110	0	15 M1	

MATRIX SPIKE SAMPLE: 109500

Parameter	Units	2616034002 Result	Spike Conc.	MS Result	MS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	24.2	10	32.3	81	90-110	M1
Fluoride	mg/L	0.082J	10	10.1	100	90-110	
Sulfate	mg/L	987	10	403	-5840	90-110	M1

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: Plant McDonough Ash Ponds

Pace Project No.: 2616035

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

ANALYTE QUALIFIERS

B Analyte was detected in the associated method blank.

M1 Matrix spike recovery exceeded QC limits. Batch accepted based on laboratory control sample (LCS) recovery.

M6 Matrix spike and Matrix spike duplicate recovery not evaluated against control limits due to sample dilution.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Ash Ponds

Pace Project No.: 2616035

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
2616035001	DGWA-70A	EPA 3005A	24312	EPA 6020B	24340
2616035002	DGWA-71	EPA 3005A	24312	EPA 6020B	24340
2616035003	FD-1	EPA 3005A	24312	EPA 6020B	24340
2616035004	EB-1	EPA 3005A	24312	EPA 6020B	24340
2616035001	DGWA-70A	SM 2540C	24469		
2616035002	DGWA-71	SM 2540C	24469		
2616035003	FD-1	SM 2540C	24469		
2616035004	EB-1	SM 2540C	24469		
2616035001	DGWA-70A	EPA 300.0	24402		
2616035002	DGWA-71	EPA 300.0	24402		
2616035003	FD-1	EPA 300.0	24402		
2616035004	EB-1	EPA 300.0	24402		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



Sample Condition Upon Receipt

Client Name: GLA Power

Project #

WO#: **2616035**

PM: **BM**

Due Date: **03/20/19**

CLIENT: **GLA Power-CCR**

Courier: Fed Ex UPS USPS Client Commercial Pace Other

Tracking #: _____

Custody Seal on Cooler/Box Present: yes no Seals intact: yes

Packing Material: Bubble Wrap Bubble Bags None Other

Thermometer Used 83 Type of Ice: Wet Blue None

Cooler Temperature 0.5 Biological Tissue is Frozen: Yes No

Temp should be above freezing to 6°C

Samples on ice, cooling process has begun

Date and Initials of person examining contents: 3/13/19 m

Comments:

Chain of Custody Present:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	1.		
Chain of Custody Filled Out:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	2.		
Chain of Custody Relinquished:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	3.		
Sampler Name & Signature on COC:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	4.		
Samples Arrived within Hold Time:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	5.		
Short Hold Time Analysis (<72hr):	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	6.		
Rush Turn Around Time Requested:	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A	7.		
Sufficient Volume:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	8.		
Correct Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	9.		
-Pace Containers Used:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
Containers Intact:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	10.		
Filtered volume received for Dissolved tests	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	11.		
Sample Labels match COC:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	12.		
-Includes date/time/ID/Analysis Matrix:	<u>W</u>			
All containers needing preservation have been checked.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	13.		
All containers needing preservation are found to be in compliance with EPA recommendation.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
exceptions: VOA, coliform, TOC, O&G, WI-DRO (water)	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Initial when completed	Lot # of added preservative	
Samples checked for dechlorination:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	14.		
Headspace in VOA Vials (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	15.		
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	16.		
Trip Blank Custody Seals Present	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A			
Pace Trip Blank Lot # (if purchased):				

Client Notification/ Resolution:

Field Data Required? Y / N

Person Contacted: _____ Date/Time: _____

Comments/ Resolution: _____

Project Manager Review: _____

Date: _____

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

March 27, 2019

Joju Abraham
Georgia Power - Coal Combustion Residuals
2480 Maner Road
Atlanta, GA 30339

RE: Project: Plant McDonough Background
Pace Project No.: 2616156

Dear Joju Abraham:

Enclosed are the analytical results for sample(s) received by the laboratory on March 15, 2019. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Betsy McDaniel
betsy.mcdaniel@pacelabs.com
(770)734-4200
Project Manager

Enclosures

cc: Kristen Jurinko, Golder Associates Inc.
Julie Lehrman, Golder Associates Inc.
Dawn Prell, Golder Associates Inc.
Tim Richards, Golder Associates - Atlanta
Rebecca Thornton, Pace Analytical Atlanta



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: Plant McDonough Background

Pace Project No.: 2616156

Atlanta Certification IDs

110 Technology Parkway Peachtree Corners, GA 30092

Florida DOH Certification #: E87315

Georgia DW Inorganics Certification #: 812

Georgia DW Microbiology Certification #: 812

North Carolina Certification #: 381

South Carolina Certification #: 98011001

Virginia Certification #: 460204

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: Plant McDonough Background

Pace Project No.: 2616156

Lab ID	Sample ID	Matrix	Date Collected	Date Received
2616156001	DGWA-53	Water	03/13/19 09:35	03/15/19 09:20
2616156002	FB-2	Water	03/13/19 09:45	03/15/19 09:20

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough Background
Pace Project No.: 2616156

Lab ID	Sample ID	Method	Analysts	Analytes Reported
2616156001	DGWA-53	EPA 6020B	CSW	2
		SM 2540C	RLC	1
		EPA 300.0	MWB	3
2616156002	FB-2	EPA 6020B	CSW	2
		SM 2540C	RLC	1
		EPA 300.0	MWB	3

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Background

Pace Project No.: 2616156

Sample: DGWA-53		Lab ID: 2616156001		Collected: 03/13/19 09:35		Received: 03/15/19 09:20		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Boron	0.080	mg/L	0.040	0.0039	1	03/18/19 13:34	03/20/19 16:18	7440-42-8	
Calcium	26.7	mg/L	25.0	0.69	50	03/18/19 13:34	03/20/19 16:24	7440-70-2	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	201	mg/L	25.0	10.0	1		03/19/19 17:56		1A,L1
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	3.6	mg/L	0.25	0.024	1		03/19/19 21:56	16887-00-6	
Fluoride	0.13J	mg/L	0.30	0.029	1		03/19/19 21:56	16984-48-8	
Sulfate	23.7	mg/L	1.0	0.017	1		03/19/19 21:56	14808-79-8	M1

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough Background

Pace Project No.: 2616156

Sample: FB-2		Lab ID: 2616156002		Collected: 03/13/19 09:45	Received: 03/15/19 09:20	Matrix: Water				
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual	
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Boron	ND	mg/L	0.040	0.0039	1	03/18/19 13:34	03/20/19 16:41	7440-42-8		
Calcium	0.031J	mg/L	0.50	0.014	1	03/18/19 13:34	03/20/19 16:41	7440-70-2		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	87.0	mg/L	25.0	10.0	1		03/23/19 19:14		2A, H1, H4	
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	0.34	mg/L	0.25	0.024	1		03/19/19 23:04	16887-00-6	B	
Fluoride	ND	mg/L	0.30	0.029	1		03/19/19 23:04	16984-48-8		
Sulfate	0.11J	mg/L	1.0	0.017	1		03/19/19 23:04	14808-79-8	B	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Background

Pace Project No.: 2616156

QC Batch: 24489 Analysis Method: EPA 6020B
QC Batch Method: EPA 3005A Analysis Description: 6020B MET
Associated Lab Samples: 2616156001, 2616156002

METHOD BLANK: 109939 Matrix: Water

Associated Lab Samples: 2616156001, 2616156002

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Boron	mg/L	0.0042J	0.040	0.0039	03/20/19 14:21	
Calcium	mg/L	ND	0.50	0.014	03/20/19 14:21	

LABORATORY CONTROL SAMPLE: 109940

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Boron	mg/L	1	1.0	101	80-120	
Calcium	mg/L	1	0.97	97	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 109941 109942

Parameter	Units	109941		109942		MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
		2616120008 Result	MS Spike Conc.	MSD Spike Conc.	MS Result						
Boron	mg/L	1.0	1	1	2.1	2.1	103	111	75-125	4	20
Calcium	mg/L	77.7	1	1	76.3	78.4	-134	77	75-125	3	20

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Background

Pace Project No.: 2616156

QC Batch: 24551

Analysis Method: SM 2540C

QC Batch Method: SM 2540C

Analysis Description: 2540C Total Dissolved Solids

Associated Lab Samples: 2616156001

LABORATORY CONTROL SAMPLE: 110196

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	400	439	110	84-108	L1

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Background

Pace Project No.: 2616156

QC Batch: 24973	Analysis Method: SM 2540C
QC Batch Method: SM 2540C	Analysis Description: 2540C Total Dissolved Solids
Associated Lab Samples: 2616156002	

LABORATORY CONTROL SAMPLE: 112717

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	400	426	106	84-108	

SAMPLE DUPLICATE: 112718

Parameter	Units	2616191001 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	306	323	5	10	H5

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough Background
Pace Project No.: 2616156

QC Batch: 24628 Analysis Method: EPA 300.0
QC Batch Method: EPA 300.0 Analysis Description: 300.0 IC Anions
Associated Lab Samples: 2616156001, 2616156002

METHOD BLANK: 110613 Matrix: Water
Associated Lab Samples: 2616156001, 2616156002

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Chloride	mg/L	0.32	0.25	0.024	03/19/19 21:10	
Fluoride	mg/L	ND	0.30	0.029	03/19/19 21:10	
Sulfate	mg/L	0.10J	1.0	0.017	03/19/19 21:10	

LABORATORY CONTROL SAMPLE: 110614

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	10	10.2	102	90-110	
Fluoride	mg/L	10	10.6	106	90-110	
Sulfate	mg/L	10	10.9	109	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 110615 110616

Parameter	Units	2616156001		110616		MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
		Result	MS Spike Conc.	MSD Spike Conc.	MS Result						
Chloride	mg/L	3.6	10	10	13.4	13.3	99	98	90-110	1	15
Fluoride	mg/L	0.13J	10	10	10.5	10.5	104	104	90-110	0	15
Sulfate	mg/L	23.7	10	10	31.9	32.0	82	83	90-110	0	15 M1

MATRIX SPIKE SAMPLE: 110617

Parameter	Units	2616156002 Result	Spike Conc.	MS Result	MS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	0.34	10	9.7	94	90-110	
Fluoride	mg/L	ND	10	10.0	100	90-110	
Sulfate	mg/L	0.11J	10	10.4	102	90-110	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: Plant McDonough Background
Pace Project No.: 2616156

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

ANALYTE QUALIFIERS

- | | |
|----|---|
| 1A | Out of hold rerun result confirms original. Original reported. |
| 2A | Sample was originally analyzed in hold. |
| B | Analyte was detected in the associated method blank. |
| H1 | Analysis conducted outside the EPA method holding time. |
| H4 | Sample re-extracted and analyzed outside of EPA method holding time. |
| H5 | Reanalysis conducted in excess of EPA method holding time. Results confirm original analysis performed in hold time. |
| L1 | Analyte recovery in the laboratory control sample (LCS) was above QC limits. Results for this analyte in associated samples may be biased high. |
| M1 | Matrix spike recovery exceeded QC limits. Batch accepted based on laboratory control sample (LCS) recovery. |

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough Background

Pace Project No.: 2616156

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
2616156001	DGWA-53	EPA 3005A	24489	EPA 6020B	24530
2616156002	FB-2	EPA 3005A	24489	EPA 6020B	24530
2616156001	DGWA-53	SM 2540C	24551		
2616156002	FB-2	SM 2540C	24973		
2616156001	DGWA-53	EPA 300.0	24628		
2616156002	FB-2	EPA 300.0	24628		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

WO#: 2616156



CHAIN-OF-CUSTODY / Analytical Request Doc
The Chain-of-Custody is a LEGAL DOCUMENT. All relevant fields must t

Section A
 Required Client Information:
 Company: Georgia Power - Coal Combustion Residuals
 Address: 2480 Maner Road
 Atlanta, GA 30339
 Email: jabraham@southernco.com
 Phone: (404)506-7239
 Requested Due Date: Standard TAT

Section B
 Required Project Information:
 Report To: Jolu Abraham
 Copy To: Golder
 Purchase Order #: SCS10348808
 Project Name: Plant McDonough Background
 Project #: 166846818

Section C
 Invoice Information:
 Attention: sscinvoic@southernco.com
 Company Name:
 Address:
 Pace Quota:
 Pace Project Manager: betsy.modama@pccelabs.com
 Pace Profile #: 332.1.2

Regulatory Agency:
 State / Location: GA

Page: 1 Of 1

ITEM #	MATRIX CODE (see valid codes to left)	SAMPLE TYPE (G=GRAB C=COMP)	DATE	TIME	# OF CONTAINERS	PRESERVATIVES										ANALYSES TEST	RESIDUAL CHLORINE (VN)
						H2SO4	HNO3	HCl	NaOH	Na2S2O3	Methanol	Other	Metals App. III	TDS, Cl, F, SO4			
1	DGWA-53	G	3/13/2019	935	2	X	X	X	X	X	X	X	X	X	X	X	1
2	FB-2	G	3/13/2019	945	2	X	X	X	X	X	X	X	X	X	X	X	2
3																	
4																	
5																	
6																	
7																	
8																	
9																	
10																	
11																	
12																	

RELINQUISHED BY / APPLICATION: *[Signature]* DATE: 3-15-19 9:20
 RECEIVED BY / APPLICATION: *Charles Frank* DATE: 3/15/19 09:00:23
 SAMPLE CONDITION: X N Y

Received on: _____
 Temp in C: _____
 DATE SIGNED: _____



Sample Condition Upon Receipt

WO#: 2616156

Client Name: GA Power - CCR

PM: BM Due Date: 03/22/19
CLIENT: GAPower-CCR

Courier: Fed Ex UPS USPS Client Commercial Pace Other
Tracking #:

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other

Thermometer Used 002 Type of Ice: Wet Blue None

Cooler Temperature 0.3 C Biological Tissue is Frozen: Yes No
Temp should be above freezing to 6 C

Proj. Due Date:
Proj. Name:

Samples on ice, cooling process has begun
Date and Initials of person examining contents: 3/15/19 JW

Table with 16 rows and 3 columns. Rows include Chain of Custody Present, Chain of Custody Filled Out, Chain of Custody Relinquished, Sampler Name & Signature on COC, Samples Arrived within Hold Time, Short Hold Time Analysis (<72hr), Rush Turn Around Time Requested, Sufficient Volume, Correct Containers Used, Containers Intact, Filtered volume received for Dissolved tests, Sample Labels match COC, All containers needing preservation have been checked, All containers needing preservation are found to be in compliance with EPA recommendation, exceptions: VOA, coliform, TOC, O&G, WI-DRO (water), Samples checked for dechlorination, Headspace in VOA Vials (>6mm), Trip Blank Present, Trip Blank Custody Seals Present, Pace Trip Blank Lot # (if purchased).

Client Notification/ Resolution:
Person Contacted: Date/Time:
Comments/ Resolution:

Field Data Required? Y / N

Project Manager Review: Date:

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)

April 11, 2019

Joju Abraham
Georgia Power - Coal Combustion Residuals
2480 Maner Road
Atlanta, GA 30339

RE: Project: Plant McDonough AP-1
Pace Project No.: 2616158

Dear Joju Abraham:

Enclosed are the analytical results for sample(s) received by the laboratory on March 15, 2019. The results relate only to the samples included in this report. Results reported herein conform to the most current, applicable TNI/NELAC standards and the laboratory's Quality Assurance Manual, where applicable, unless otherwise noted in the body of the report.

This report replaces the report issued on 3/26/2019. It has been revised to provide TDS data from the original in-hold run that was confirmed by reanalysis. No other changes have been made to this report.

If you have any questions concerning this report, please feel free to contact me.

Sincerely,



Betsy McDaniel
betsy.mcdaniel@pacelabs.com
(770)734-4200
Project Manager

Enclosures

cc: Kristen Jurinko, Golder Associates Inc.
Julie Lehrman, Golder Associates Inc.
Dawn Prell, Golder Associates Inc.
Tim Richards, Golder Associates - Atlanta
Rebecca Thornton, Pace Analytical Atlanta



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

CERTIFICATIONS

Project: Plant McDonough AP-1

Pace Project No.: 2616158

Atlanta Certification IDs

110 Technology Parkway Peachtree Corners, GA 30092

Florida DOH Certification #: E87315

Georgia DW Inorganics Certification #: 812

Georgia DW Microbiology Certification #: 812

North Carolina Certification #: 381

South Carolina Certification #: 98011001

Virginia Certification #: 460204

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE SUMMARY

Project: Plant McDonough AP-1

Pace Project No.: 2616158

Lab ID	Sample ID	Matrix	Date Collected	Date Received
2616158001	DGWC-37	Water	03/13/19 10:10	03/15/19 09:20
2616158002	DGWC-38	Water	03/13/19 13:21	03/15/19 09:20
2616158003	DGWC-39	Water	03/13/19 10:35	03/15/19 09:20
2616158004	DGWC-40	Water	03/13/19 14:40	03/15/19 09:20
2616158005	DGWC-67	Water	03/13/19 11:25	03/15/19 09:20
2616158006	DGWC-68A	Water	03/13/19 13:20	03/15/19 09:20
2616158007	DGWC-69	Water	03/13/19 11:30	03/15/19 09:20
2616158008	EB-3	Water	03/13/19 10:55	03/15/19 09:20
2616158009	FD-3	Water	03/13/19 00:00	03/15/19 09:20

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

SAMPLE ANALYTE COUNT

Project: Plant McDonough AP-1

Pace Project No.: 2616158

Lab ID	Sample ID	Method	Analysts	Analytes Reported
2616158001	DGWC-37	EPA 6020B	CSW	2
		SM 2540C	RLC	1
		EPA 300.0	MWB	3
2616158002	DGWC-38	EPA 6020B	CSW	2
		SM 2540C	RLC	1
		EPA 300.0	MWB	3
2616158003	DGWC-39	EPA 6020B	CSW	2
		SM 2540C	RLC	1
		EPA 300.0	MWB	3
2616158004	DGWC-40	EPA 6020B	CSW	2
		SM 2540C	RLC	1
		EPA 300.0	MWB	3
2616158005	DGWC-67	EPA 6020B	CSW	2
		SM 2540C	RLC	1
		EPA 300.0	MWB	3
2616158006	DGWC-68A	EPA 6020B	CSW	2
		SM 2540C	RLC	1
		EPA 300.0	MWB	3
2616158007	DGWC-69	EPA 6020B	CSW	2
		SM 2540C	RLC	1
		EPA 300.0	MWB	3
2616158008	EB-3	EPA 6020B	CSW	2
		SM 2540C	RLC	1
		EPA 300.0	MWB	3
2616158009	FD-3	EPA 6020B	CSW	2
		SM 2540C	RLC	1
		EPA 300.0	MWB	3

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough AP-1

Pace Project No.: 2616158

Sample: DGWC-37		Lab ID: 2616158001		Collected: 03/13/19 10:10		Received: 03/15/19 09:20		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Boron	1.8	mg/L	0.040	0.0039	1	03/18/19 13:34	03/20/19 16:47	7440-42-8	
Calcium	54.8	mg/L	25.0	0.69	50	03/18/19 13:34	03/20/19 16:53	7440-70-2	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	286	mg/L	25.0	10.0	1		03/19/19 17:56		1A,L1
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	6.9	mg/L	0.25	0.024	1		03/19/19 23:27	16887-00-6	
Fluoride	0.080J	mg/L	0.30	0.029	1		03/19/19 23:27	16984-48-8	
Sulfate	92.2	mg/L	10.0	0.17	10		03/20/19 09:45	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough AP-1

Pace Project No.: 2616158

Sample: DGWC-38		Lab ID: 2616158002		Collected: 03/13/19 13:21		Received: 03/15/19 09:20		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Boron	2.9	mg/L	0.040	0.0039	1	03/18/19 13:34	03/20/19 16:58	7440-42-8	
Calcium	85.3	mg/L	25.0	0.69	50	03/18/19 13:34	03/20/19 17:04	7440-70-2	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	487	mg/L	25.0	10.0	1		03/19/19 17:56		1A,L1
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	9.1	mg/L	0.25	0.024	1		03/19/19 23:50	16887-00-6	
Fluoride	0.084J	mg/L	0.30	0.029	1		03/19/19 23:50	16984-48-8	
Sulfate	300	mg/L	20.0	0.34	20		03/20/19 10:08	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough AP-1

Pace Project No.: 2616158

Sample: DGWC-39		Lab ID: 2616158003		Collected: 03/13/19 10:35	Received: 03/15/19 09:20	Matrix: Water				
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual	
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Boron	3.4	mg/L	0.040	0.0039	1	03/18/19 13:34	03/20/19 17:10	7440-42-8		
Calcium	96.3	mg/L	25.0	0.69	50	03/18/19 13:34	03/20/19 17:16	7440-70-2		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	526	mg/L	25.0	10.0	1		03/19/19 17:56		1A,L1	
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	8.2	mg/L	0.25	0.024	1		03/20/19 00:13	16887-00-6		
Fluoride	0.085J	mg/L	0.30	0.029	1		03/20/19 00:13	16984-48-8		
Sulfate	265	mg/L	20.0	0.34	20		03/20/19 10:31	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough AP-1

Pace Project No.: 2616158

Sample: DGWC-40		Lab ID: 2616158004		Collected: 03/13/19 14:40		Received: 03/15/19 09:20		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Boron	0.80	mg/L	0.040	0.0039	1	03/18/19 13:34	03/20/19 17:21	7440-42-8	
Calcium	41.0	mg/L	25.0	0.69	50	03/18/19 13:34	03/20/19 17:27	7440-70-2	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	351	mg/L	25.0	10.0	1		03/19/19 17:56		1A,L1
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	19.7	mg/L	0.25	0.024	1		03/20/19 00:36	16887-00-6	
Fluoride	0.15J	mg/L	0.30	0.029	1		03/20/19 00:36	16984-48-8	
Sulfate	445	mg/L	20.0	0.34	20		03/20/19 10:53	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough AP-1

Pace Project No.: 2616158

Sample: DGWC-67		Lab ID: 2616158005		Collected: 03/13/19 11:25		Received: 03/15/19 09:20		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Boron	3.5	mg/L	0.040	0.0039	1	03/18/19 13:34	03/20/19 17:45	7440-42-8	
Calcium	41.2	mg/L	25.0	0.69	50	03/18/19 13:34	03/20/19 17:50	7440-70-2	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	278	mg/L	25.0	10.0	1		03/19/19 17:57		1A, L1
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	6.8	mg/L	0.25	0.024	1		03/20/19 00:59	16887-00-6	
Fluoride	0.070J	mg/L	0.30	0.029	1		03/20/19 00:59	16984-48-8	
Sulfate	233	mg/L	10.0	0.17	10		03/20/19 11:16	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough AP-1

Pace Project No.: 2616158

Sample: DGWC-68A		Lab ID: 2616158006		Collected: 03/13/19 13:20		Received: 03/15/19 09:20		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Boron	1.9	mg/L	0.040	0.0039	1	03/19/19 12:15	03/20/19 19:10	7440-42-8	
Calcium	47.5	mg/L	25.0	0.69	50	03/19/19 12:15	03/20/19 19:15	7440-70-2	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	267	mg/L	25.0	10.0	1		03/19/19 17:57		1A,L1
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	4.6	mg/L	0.25	0.024	1		03/20/19 01:22	16887-00-6	
Fluoride	0.12J	mg/L	0.30	0.029	1		03/20/19 01:22	16984-48-8	
Sulfate	44.1	mg/L	1.0	0.017	1		03/20/19 01:22	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough AP-1

Pace Project No.: 2616158

Sample: DGWC-69		Lab ID: 2616158007		Collected: 03/13/19 11:30		Received: 03/15/19 09:20		Matrix: Water	
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A							
Boron	0.028J	mg/L	0.040	0.0039	1	03/19/19 12:15	03/20/19 19:21	7440-42-8	
Calcium	7.6	mg/L	0.50	0.014	1	03/19/19 12:15	03/20/19 19:21	7440-70-2	
2540C Total Dissolved Solids		Analytical Method: SM 2540C							
Total Dissolved Solids	95.0	mg/L	25.0	10.0	1		03/20/19 19:51		
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0							
Chloride	6.2	mg/L	0.25	0.024	1		03/20/19 03:16	16887-00-6	
Fluoride	0.086J	mg/L	0.30	0.029	1		03/20/19 03:16	16984-48-8	
Sulfate	8.4	mg/L	1.0	0.017	1		03/20/19 03:16	14808-79-8	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough AP-1

Pace Project No.: 2616158

Sample: EB-3		Lab ID: 2616158008		Collected: 03/13/19 10:55	Received: 03/15/19 09:20	Matrix: Water				
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual	
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Boron	ND	mg/L	0.040	0.0039	1	03/19/19 12:15	03/20/19 19:33	7440-42-8		
Calcium	ND	mg/L	0.50	0.014	1	03/19/19 12:15	03/20/19 19:33	7440-70-2		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	ND	mg/L	25.0	10.0	1		03/20/19 19:51			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	0.31	mg/L	0.25	0.024	1		03/20/19 03:39	16887-00-6	B	
Fluoride	ND	mg/L	0.30	0.029	1		03/20/19 03:39	16984-48-8		
Sulfate	ND	mg/L	1.0	0.017	1		03/20/19 03:39	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

ANALYTICAL RESULTS

Project: Plant McDonough AP-1

Pace Project No.: 2616158

Sample: FD-3		Lab ID: 2616158009		Collected: 03/13/19 00:00	Received: 03/15/19 09:20	Matrix: Water				
Parameters	Results	Units	Report Limit	MDL	DF	Prepared	Analyzed	CAS No.	Qual	
6020B MET ICPMS		Analytical Method: EPA 6020B Preparation Method: EPA 3005A								
Boron	0.027J	mg/L	0.040	0.0039	1	03/19/19 12:15	03/20/19 19:38	7440-42-8		
Calcium	7.7	mg/L	0.50	0.014	1	03/19/19 12:15	03/20/19 19:38	7440-70-2		
2540C Total Dissolved Solids		Analytical Method: SM 2540C								
Total Dissolved Solids	85.0	mg/L	25.0	10.0	1		03/20/19 19:51			
300.0 IC Anions 28 Days		Analytical Method: EPA 300.0								
Chloride	6.2	mg/L	0.25	0.024	1		03/20/19 04:25	16887-00-6		
Fluoride	0.090J	mg/L	0.30	0.029	1		03/20/19 04:25	16984-48-8		
Sulfate	8.4	mg/L	1.0	0.017	1		03/20/19 04:25	14808-79-8		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough AP-1

Pace Project No.: 2616158

QC Batch: 24489 Analysis Method: EPA 6020B
QC Batch Method: EPA 3005A Analysis Description: 6020B MET
Associated Lab Samples: 2616158001, 2616158002, 2616158003, 2616158004, 2616158005

METHOD BLANK: 109939 Matrix: Water
Associated Lab Samples: 2616158001, 2616158002, 2616158003, 2616158004, 2616158005

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Boron	mg/L	0.0042J	0.040	0.0039	03/20/19 14:21	
Calcium	mg/L	ND	0.50	0.014	03/20/19 14:21	

LABORATORY CONTROL SAMPLE: 109940

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Boron	mg/L	1	1.0	101	80-120	
Calcium	mg/L	1	0.97	97	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 109941 109942

Parameter	Units	109941		109942		MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
		2616120008 Result	MS Spike Conc.	MSD Spike Conc.	MS Result						
Boron	mg/L	1.0	1	1	2.1	2.1	103	111	75-125	4	20
Calcium	mg/L	77.7	1	1	76.3	78.4	-134	77	75-125	3	20

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough AP-1

Pace Project No.: 2616158

QC Batch: 24594 Analysis Method: EPA 6020B
QC Batch Method: EPA 3005A Analysis Description: 6020B MET
Associated Lab Samples: 2616158006, 2616158007, 2616158008, 2616158009

METHOD BLANK: 110479 Matrix: Water
Associated Lab Samples: 2616158006, 2616158007, 2616158008, 2616158009

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Boron	mg/L	ND	0.040	0.0039	03/20/19 18:52	
Calcium	mg/L	ND	0.50	0.014	03/20/19 18:52	

LABORATORY CONTROL SAMPLE: 110480

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Boron	mg/L	1	1.0	102	80-120	
Calcium	mg/L	1	1.0	100	80-120	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 110481 110482

Parameter	Units	2616160006 Result	MS		MSD		MS		MSD		% Rec Limits	RPD	Max RPD	Qual
			Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	% Rec	% Rec						
Boron	mg/L	6.2	1	1	7.0	6.7	85	49	75-125	5	20	M1		
Calcium	mg/L	79.9	1	1	78.0	76.7	-192	-327	75-125	2	20	M6		

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough AP-1

Pace Project No.: 2616158

QC Batch: 24551

Analysis Method: SM 2540C

QC Batch Method: SM 2540C

Analysis Description: 2540C Total Dissolved Solids

Associated Lab Samples: 2616158001, 2616158002, 2616158003, 2616158004, 2616158005, 2616158006

LABORATORY CONTROL SAMPLE: 110196

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	400	439	110	84-108	L1

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough AP-1
Pace Project No.: 2616158

QC Batch: 24657 Analysis Method: SM 2540C
QC Batch Method: SM 2540C Analysis Description: 2540C Total Dissolved Solids
Associated Lab Samples: 2616158007, 2616158008, 2616158009

LABORATORY CONTROL SAMPLE: 110746

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Total Dissolved Solids	mg/L	400	411	103	84-108	

SAMPLE DUPLICATE: 110747

Parameter	Units	2616158007 Result	Dup Result	RPD	Max RPD	Qualifiers
Total Dissolved Solids	mg/L	95.0	90.0	5	10	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA

Project: Plant McDonough AP-1
Pace Project No.: 2616158

QC Batch: 24628 Analysis Method: EPA 300.0
QC Batch Method: EPA 300.0 Analysis Description: 300.0 IC Anions
Associated Lab Samples: 2616158001, 2616158002, 2616158003, 2616158004, 2616158005, 2616158006, 2616158007, 2616158008, 2616158009

METHOD BLANK: 110613 Matrix: Water
Associated Lab Samples: 2616158001, 2616158002, 2616158003, 2616158004, 2616158005, 2616158006, 2616158007, 2616158008, 2616158009

Parameter	Units	Blank Result	Reporting Limit	MDL	Analyzed	Qualifiers
Chloride	mg/L	0.32	0.25	0.024	03/19/19 21:10	
Fluoride	mg/L	ND	0.30	0.029	03/19/19 21:10	
Sulfate	mg/L	0.10J	1.0	0.017	03/19/19 21:10	

LABORATORY CONTROL SAMPLE: 110614

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	10	10.2	102	90-110	
Fluoride	mg/L	10	10.6	106	90-110	
Sulfate	mg/L	10	10.9	109	90-110	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 110615 110616

Parameter	Units	2616156001		110616		MS % Rec	MSD % Rec	% Rec Limits	RPD	Max RPD	Qual
		MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result						
Chloride	mg/L	3.6	10	10	13.4	13.3	99	98	90-110	1	15
Fluoride	mg/L	0.13J	10	10	10.5	10.5	104	104	90-110	0	15
Sulfate	mg/L	23.7	10	10	31.9	32.0	82	83	90-110	0	15 M1

MATRIX SPIKE SAMPLE: 110617

Parameter	Units	2616156002 Result	Spike Conc.	MS Result	MS % Rec	% Rec Limits	Qualifiers
Chloride	mg/L	0.34	10	9.7	94	90-110	
Fluoride	mg/L	ND	10	10.0	100	90-110	
Sulfate	mg/L	0.11J	10	10.4	102	90-110	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALIFIERS

Project: Plant McDonough AP-1
Pace Project No.: 2616158

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

J - Estimated concentration above the adjusted method detection limit and below the adjusted reporting limit.

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

ANALYTE QUALIFIERS

- | | |
|----|---|
| 1A | Out of hold rerun result confirms original. Original reported. |
| B | Analyte was detected in the associated method blank. |
| L1 | Analyte recovery in the laboratory control sample (LCS) was above QC limits. Results for this analyte in associated samples may be biased high. |
| M1 | Matrix spike recovery exceeded QC limits. Batch accepted based on laboratory control sample (LCS) recovery. |
| M6 | Matrix spike and Matrix spike duplicate recovery not evaluated against control limits due to sample dilution. |

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.

QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: Plant McDonough AP-1
Pace Project No.: 2616158

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
2616158001	DGWC-37	EPA 3005A	24489	EPA 6020B	24530
2616158002	DGWC-38	EPA 3005A	24489	EPA 6020B	24530
2616158003	DGWC-39	EPA 3005A	24489	EPA 6020B	24530
2616158004	DGWC-40	EPA 3005A	24489	EPA 6020B	24530
2616158005	DGWC-67	EPA 3005A	24489	EPA 6020B	24530
2616158006	DGWC-68A	EPA 3005A	24594	EPA 6020B	24646
2616158007	DGWC-69	EPA 3005A	24594	EPA 6020B	24646
2616158008	EB-3	EPA 3005A	24594	EPA 6020B	24646
2616158009	FD-3	EPA 3005A	24594	EPA 6020B	24646
2616158001	DGWC-37	SM 2540C	24551		
2616158002	DGWC-38	SM 2540C	24551		
2616158003	DGWC-39	SM 2540C	24551		
2616158004	DGWC-40	SM 2540C	24551		
2616158005	DGWC-67	SM 2540C	24551		
2616158006	DGWC-68A	SM 2540C	24551		
2616158007	DGWC-69	SM 2540C	24657		
2616158008	EB-3	SM 2540C	24657		
2616158009	FD-3	SM 2540C	24657		
2616158001	DGWC-37	EPA 300.0	24628		
2616158002	DGWC-38	EPA 300.0	24628		
2616158003	DGWC-39	EPA 300.0	24628		
2616158004	DGWC-40	EPA 300.0	24628		
2616158005	DGWC-67	EPA 300.0	24628		
2616158006	DGWC-68A	EPA 300.0	24628		
2616158007	DGWC-69	EPA 300.0	24628		
2616158008	EB-3	EPA 300.0	24628		
2616158009	FD-3	EPA 300.0	24628		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



WO#: 2616158

CHAIN-OF-CUSTODY / Analytical R
The Chain-of-Custody is a LEGAL DOCUMENT. All reit

Section A		Section B		Section C	
Required Client Information:		Required Project Information:		Invoice Information:	
Company: Georgia Power - Coal Combustion Residuals	Report To: Jaju Abraham	Attention: scsinvoices@southernco.com	Company Name:	Invoice #:	2616158
Address: 2480 Manor Road	Copy To: Golder	Address:	Project Name: Plant McDonough AP-1	State/Location:	GA
Request Due Date: Standard TAT	Project #: 166849618	Project #: 332.1.2	Requester (Analytical/Filtered (Y/N)):	Requested (Analytical/Filtered (Y/N)):	
Purchase Order #: SCS10348606		Place Quote:		Regulatory/Agency:	
Email: jabraham@southernco.com	Project Name: Plant McDonough AP-1	Place Project Manager: batsy.mcdonough@pacalabs.com		State/Location:	
Phone: (404)506-7239	Project #: 166849618	Place Profile #: 332.1.2		State/Location:	

ITEM #	MATRIX	CODE	DATE	TIME	SAMPLE TYPE (G-GRAB C-COMP)	DATE	TIME	# OF CONTAINERS	PRESERVATIVES	ANALYSES TEST	METHODS	RESIDUAL CHIRMS (Y/N)	TEMP IN C	SAMPLE CONDITIONS			
														Received on (Y/N)	Custody (Y/N)	Sealed (Y/N)	Cooled (Y/N)
1	DGWC-37	WT	3/13/2019	1010	G	3/13/2019	1010	2	H2SO4 HNO3 HCl NaOH Na2S2O3 Methanol Oint	X X X X X X X	X X X X X X X						
2	DGWC-38	WT	3/13/2019	1321	G	3/13/2019	1321	2	H2SO4 HNO3 HCl NaOH Na2S2O3 Methanol Oint	X X X X X X X	X X X X X X X						
3	DGWC-39	WT	3/13/2019	1035	G	3/13/2019	1035	2	H2SO4 HNO3 HCl NaOH Na2S2O3 Methanol Oint	X X X X X X X	X X X X X X X						
4	DGWC-40	WT	3/13/2019	1440	G	3/13/2019	1440	2	H2SO4 HNO3 HCl NaOH Na2S2O3 Methanol Oint	X X X X X X X	X X X X X X X						
5	DGWC-67	WT	3/13/2019	1125	G	3/13/2019	1125	2	H2SO4 HNO3 HCl NaOH Na2S2O3 Methanol Oint	X X X X X X X	X X X X X X X						
6	DGWC-68A	WT	3/13/2019	1320	G	3/13/2019	1320	2	H2SO4 HNO3 HCl NaOH Na2S2O3 Methanol Oint	X X X X X X X	X X X X X X X						
7	DGWC-69	WT	3/13/2019	1130	G	3/13/2019	1130	2	H2SO4 HNO3 HCl NaOH Na2S2O3 Methanol Oint	X X X X X X X	X X X X X X X						
8	EB-3	WT	3/13/2019	1055	G	3/13/2019	1055	2	H2SO4 HNO3 HCl NaOH Na2S2O3 Methanol Oint	X X X X X X X	X X X X X X X						
9	FD-3	WT	3/13/2019	-	G	3/13/2019	-	2	H2SO4 HNO3 HCl NaOH Na2S2O3 Methanol Oint	X X X X X X X	X X X X X X X						
10																	
11																	
12																	

APPROVAL COMMENTS: [Signature]

RELINQUISHED BY: [Signature] **DATE:** 3/14/2019 **TIME:** 9:20

ACCEPTED BY: Charles Hunter **DATE:** 3/15/2019 **TIME:** 3:15

DATE SIGNED: _____



Sample Condition Upon Receipt

WO#: 2616158

Client Name: GA Power - CCR

PM: BM Due Date: 03/22/19
CLIENT: GAPower-CCR

Courier: Fed Ex UPS USPS Client Commercial Pace Other

Tracking #: _____

Custody Seal on Cooler/Box Present: yes no Seals intact: yes no

Packing Material: Bubble Wrap Bubble Bags None Other

Thermometer Used 082 Type of Ice: Wet Blue None

Cooler Temperature 0.3 C Biological Tissue is Frozen: Yes No

Temp should be above freezing to 6 C

Optional Proj. Due Date: Proj. Name:

Samples on ice, cooling process has begun Date and Initials of person examining contents: 3/15/19 jw

Table with 16 rows of checklist items (Chain of Custody Present, Filled Out, Relinquished, etc.) and checkboxes for Yes, No, N/A.

Client Notification/ Resolution: Person Contacted: Date/Time: Comments/ Resolution: Field Data Required? Y / N

Project Manager Review: Date:

Note: Whenever there is a discrepancy affecting North Carolina compliance samples, a copy of this form will be sent to the North Carolina DEHNR Certification Office (i.e. out of hold, incorrect preservative, out of temp, incorrect containers)



State of Florida

Department of Health, Bureau of Public Health Laboratories
This is to certify that



E87315

**ANALYTICAL SERVICES, INC.
110 TECHNOLOGY PARKWAY
NORCROSS, GA 30092**

**has complied with Florida Administrative Code 64E-1,
for the examination of environmental samples in the following categories**

DRINKING WATER - MICROBIOLOGY, DRINKING WATER - PRIMARY INORGANIC CONTAMINANTS, DRINKING WATER - SECONDARY INORGANIC CONTAMINANTS, NON-POTABLE WATER - EXTRACTABLE ORGANICS, NON-POTABLE WATER - GENERAL CHEMISTRY, NON-POTABLE WATER - METALS, NON-POTABLE WATER - MICROBIOLOGY, NON-POTABLE WATER - PESTICIDES-HERBICIDES-PCB'S, NON-POTABLE WATER - VOLATILE ORGANICS, SOLID AND CHEMICAL MATERIALS - EXTRACTABLE ORGANICS, SOLID AND CHEMICAL MATERIALS - GENERAL CHEMISTRY, SOLID AND CHEMICAL MATERIALS - METALS, SOLID AND CHEMICAL MATERIALS - MICROBIOLOGY, SOLID AND CHEMICAL MATERIALS - PESTICIDES-HERBICIDES-PCB'S, SOLID AND CHEMICAL MATERIALS - VOLATILE ORGANICS

Continued certification is contingent upon successful on-going compliance with the NELAC Standards and FAC Rule 64E-1 regulations. Specific methods and analytes certified are cited on the Laboratory Scope of Accreditation for this laboratory and are on file at the Bureau of Public Health Laboratories, P. O. Box 210, Jacksonville, Florida 32231. Clients and customers are urged to verify with this agency the laboratory's certification status in Florida for particular methods and analytes.

Date Issued: July 01, 2015 Expiration Date: June 30, 2016




Carina Blackmore, DVM, PhD, Dipl. ACVPM, CPM
Chief, Bureau of Public Health Laboratories
DH Form 1697, 7/04
NON-TRANSFERABLE E87315-31-07/01/2015
Supersedes all previously issued certificates



State of Florida
 Department of Health, Bureau of Public Health Laboratories
 This is to certify that



E87315

PACE ANALYTICAL SERVICES, INC. - ATLANTA
 110 TECHNOLOGY PARKWAY
 PEACHTREE CORNERS, GA 30092

has complied with Florida Administrative Code 64E-1,
 for the examination of environmental samples in the following categories

DRINKING WATER - MICROBIOLOGY, DRINKING WATER - PRIMARY INORGANIC CONTAMINANTS, DRINKING WATER - SECONDARY INORGANIC CONTAMINANTS, NON-POTABLE WATER - EXTRACTABLE ORGANICS, NON-POTABLE WATER - GENERAL CHEMISTRY, NON-POTABLE WATER - METALS, NON-POTABLE WATER - MICROBIOLOGY, NON-POTABLE WATER - PESTICIDES-HERBICIDES-PCB'S, NON-POTABLE WATER - VOLATILE ORGANICS, SOLID AND CHEMICAL MATERIALS - EXTRACTABLE ORGANICS, SOLID AND CHEMICAL MATERIALS - GENERAL CHEMISTRY, SOLID AND CHEMICAL MATERIALS - METALS, SOLID AND CHEMICAL MATERIALS - MICROBIOLOGY, SOLID AND CHEMICAL MATERIALS - PESTICIDES-HERBICIDES-PCB'S, SOLID AND CHEMICAL MATERIALS - VOLATILE ORGANICS

Continued certification is contingent upon successful on-going compliance with the NELAC Standards and FAC Rule 64E-1 regulations. Specific methods and analytes certified are cited on the Laboratory Scope of Accreditation for this laboratory and are on file at the Bureau of Public Health Laboratories, P. O. Box 210, Jacksonville, Florida 32231. Clients and customers are urged to verify with this agency the laboratory's certification status in Florida for particular methods and analytes.

Date Issued: July 01, 2016 Expiration Date: June 30, 2017



Susanne Crowe

Susanne Crowe, MHA
 Acting Chief, Bureau of Public Health Laboratories
 DH Form 1697, 7/04
 NON-TRANSFERABLE E87315-33-07/01/2016
 Supersedes all previously issued certificates



State of Florida
Department of Health, Bureau of Public Health Laboratories
This is to certify that



E87315

PACE ANALYTICAL SERVICES, LLC- ATLANTA GA
110 TECHNOLOGY PARKWAY
PEACHTREE CORNERS, GA 30092

has complied with Florida Administrative Code 64E-1,
for the examination of environmental samples in the following categories

DRINKING WATER - MICROBIOLOGY, DRINKING WATER - PRIMARY INORGANIC CONTAMINANTS, DRINKING WATER - SECONDARY INORGANIC CONTAMINANTS, NON-POTABLE WATER - EXTRACTABLE ORGANICS, NON-POTABLE WATER - GENERAL CHEMISTRY, NON-POTABLE WATER - METALS, NON-POTABLE WATER - MICROBIOLOGY, NON-POTABLE WATER - PESTICIDES-HERBICIDES-PCB'S, NON-POTABLE WATER - VOLATILE ORGANICS, SOLID AND CHEMICAL MATERIALS - EXTRACTABLE ORGANICS, SOLID AND CHEMICAL MATERIALS - GENERAL CHEMISTRY, SOLID AND CHEMICAL MATERIALS - METALS, SOLID AND CHEMICAL MATERIALS - MICROBIOLOGY, SOLID AND CHEMICAL MATERIALS - PESTICIDES-HERBICIDES-PCB'S, SOLID AND CHEMICAL MATERIALS - VOLATILE ORGANICS

Continued certification is contingent upon successful on-going compliance with the NELAC Standards and FAC Rule 64E-1 regulations. Specific methods and analytes certified are cited on the Laboratory Scope of Accreditation for this laboratory and are on file at the Bureau of Public Health Laboratories, P. O. Box 210, Jacksonville, Florida 32231. Clients and customers are urged to verify with this agency the laboratory's certification status in Florida for particular methods and analytes.

Date Issued: July 01, 2017 Expiration Date: June 30, 2018



A handwritten signature in blue ink that reads "Susanne Crowe".

Susanne Crowe, MHA
Acting Chief, Bureau of Public Health Laboratories
DH Form 1697, 7/04

NON-TRANSFERABLE E87315-37-07/01/2017
Supersedes all previously issued certificates



State of Florida
 Department of Health, Bureau of Public Health Laboratories
 This is to certify that



E87315

PACE ANALYTICAL SERVICES, LLC- ATLANTA GA
 110 TECHNOLOGY PARKWAY
 PEACHTREE CORNERS, GA 30092

has complied with Florida Administrative Code 64E-1,
 for the examination of environmental samples in the following categories

DRINKING WATER - MICROBIOLOGY, DRINKING WATER - PRIMARY INORGANIC CONTAMINANTS, DRINKING WATER - SECONDARY INORGANIC CONTAMINANTS, NON-POTABLE WATER - EXTRACTABLE ORGANICS, NON-POTABLE WATER - GENERAL CHEMISTRY, NON-POTABLE WATER - METALS, NON-POTABLE WATER - MICROBIOLOGY, NON-POTABLE WATER - PESTICIDES-HERBICIDES-PCB'S, NON-POTABLE WATER - VOLATILE ORGANICS, SOLID AND CHEMICAL MATERIALS - EXTRACTABLE ORGANICS, SOLID AND CHEMICAL MATERIALS - GENERAL CHEMISTRY, SOLID AND CHEMICAL MATERIALS - METALS, SOLID AND CHEMICAL MATERIALS - MICROBIOLOGY, SOLID AND CHEMICAL MATERIALS - PESTICIDES-HERBICIDES-PCB'S, SOLID AND CHEMICAL MATERIALS - VOLATILE ORGANICS

Continued certification is contingent upon successful on-going compliance with the NELAC Standards and FAC Rule 64E-1 regulations. Specific methods and analytes certified are cited on the Laboratory Scope of Accreditation for this laboratory and are on file at the Bureau of Public Health Laboratories, P. O. Box 210, Jacksonville, Florida 32231. Clients and customers are urged to verify with this agency the laboratory's certification status in Florida for particular methods and analytes.

Date Issued: July 01, 2018 Expiration Date: June 30, 2019



Patty A. Lewandowski, MBA, MT(ASCP)
 Chief Bureau of Public Health Laboratories
 DH Form 1697, 7/04

NON-TRANSFERABLE E87315-39-07/01/2018
 Supersedes all previously issued certificates

FIELD DATA FORMS

August – September 2016

Low-Flow Test Report:

Test Date / Time: 2016-09-08 22:10:16

Project: Plant McDonough CCR

Operator Name: Golder

Location Name: DGWC-37 Latitude: Longitude: Well Diameter: 2 IN Casing Type: PVC Screen Length: 10 FT Top of Screen: 33.05 FT Total Depth: 43.05 FT Initial Depth to Water: 13.20 FT	Pump Type: Geoump Tubing Type: Polyethylene Tubing Inner Diameter: 0.125 IN Tubing Length: Pump Intake From TOC: 38 FT Estimated Total Volume Pumped: 3250 ML Flow Cell Volume: 90 ML Final Flow Rate: 130 ML_PER_MIN Final Draw Down: 0.2 FT	Instrument Used: SmarTROLL MP Serial Number: 339100
---	--	--

Test Notes:

Golder

Plant McDonough

Lamotte 2020

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth To Water	Flow
		+/- 0.1	+/- 10 %	+/- 5 %	+/- 0.2	+/- 10	+/- 10 %	+/- 5	
2016-08-13 22:10:16	00:00	6.48 pH	21.49 °C	483.31 µS/cm	0.99 mg/L	4.14 NTU	110.2 mV	13.35 ft	130.00 ml/min
2016-08-13 22:15:16	04:59	6.32 pH	20.66 °C	476.84 µS/cm	0.36 mg/L	3.38 NTU	74.4 mV	13.36 ft	130.00 ml/min
2016-08-13 22:20:16	10:00	6.32 pH	20.67 °C	477.87 µS/cm	0.26 mg/L	2.38 NTU	62.1 mV	13.39 ft	130.00 ml/min
2016-08-13 22:25:16	14:59	6.32 pH	20.70 °C	475.16 µS/cm	0.24 mg/L	1.29 NTU	55.2 mV	13.40 ft	130.00 ml/min
2016-08-13 22:30:16	19:59	6.32 pH	20.70 °C	473.49 µS/cm	0.21 mg/L	2.73 NTU	58.2 mV	13.40 ft	130.00 ml/min
2016-08-13 22:35:16	24:59	6.32 pH	20.74 °C	471.70 µS/cm	0.19 mg/L	2.32 NTU	54.3 mV	13.40 ft	130.00 ml/min

Samples

Sample ID:	Description:
DGWC-37	Sampled at 925 2.32 NTU

Low-Flow Test Report:

Test Date / Time: 2016-09-08 08:44:21

Project: Plant McDonough CCR

Operator Name: Golder

Location Name: DGWC-38 Latitude: Longitude: Well Diameter: 2 IN Casing Type: PVC Screen Length: 10 FT Top of Screen: 18.09 FT Total Depth: 28.09 FT Initial Depth to Water: 6.16 FT	Pump Type: Geopump Tubing Type: Polyethylene Tubing Inner Diameter: 0.125 IN Tubing Length: Pump Intake From TOC: 22 FT Estimated Total Volume Pumped: 3500 ML Flow Cell Volume: 90 ML Final Flow Rate: 100 ML_PER_MIN Final Draw Down: 0.17 FT	Instrument Used: SmarTROLL MP Serial Number: 416162
--	--	--

Test Notes:

Golder

Plant McDonough

Lamotte 2020

Weather Conditions:

80 sunny

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth To Water	Flow
		+/- 0.1	+/- 10 %	+/- 5 %	+/- 0.2	+/- 10	+/- 10 %	+/- 5	
2016-09-08 08:44:21	00:00	6.38 pH	23.37 °C	651.93 µS/cm	1.34 mg/L	2.93 NTU	186.4 mV	6.24 ft	140.00 ml/min
2016-09-08 08:49:21	04:59	6.03 pH	21.09 °C	680.31 µS/cm	0.43 mg/L	2.30 NTU	78.4 mV	6.25 ft	140.00 ml/min
2016-09-08 08:54:21	09:59	6.02 pH	21.09 °C	677.18 µS/cm	0.34 mg/L	1.91 NTU	70.2 mV	6.35 ft	100.00 ml/min
2016-09-08 08:59:21	15:00	6.01 pH	21.09 °C	681.50 µS/cm	0.34 mg/L	1.66 NTU	65.5 mV	6.31 ft	100.00 ml/min
2016-09-08 09:04:21	20:00	6.01 pH	21.91 °C	676.76 µS/cm	0.30 mg/L	1.60 NTU	63.7 mV	6.33 ft	100.00 ml/min
2016-09-08 09:09:21	25:00	6.01 pH	22.17 °C	673.30 µS/cm	0.28 mg/L	1.56 NTU	62.7 mV	6.33 ft	100.00 ml/min
2016-09-08 09:14:21	30:00	6.01 pH	22.16 °C	675.85 µS/cm	0.23 mg/L	1.53 NTU	63.0 mV	6.33 ft	100.00 ml/min

Samples

Sample ID:	Description:
------------	--------------

Low-Flow Test Report:

Test Date / Time: 2016-09-08 23:14:30

Project: Plant McDonough CCR

Operator Name: Golder

Location Name: DGWC-39 Latitude: Longitude: Well Diameter: 2 IN Casing Type: PVC Screen Length: 10 FT Top of Screen: 14.69 FT Total Depth: 24.69 FT Initial Depth to Water: 7.91 FT	Pump Type: Geopump Tubing Type: Polyethylene Tubing Inner Diameter: 0.125 IN Tubing Length: Pump Intake From TOC: 19 FT Estimated Total Volume Pumped: 3000 ML Flow Cell Volume: 90 ML Final Flow Rate: 100 ML_PER_MIN Final Draw Down: 0.49 FT	Instrument Used: SmarTROLL MP Serial Number: 339100
--	--	--

Test Notes:

Golder

Plant McDonough

Lamotte 2020

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth To Water	Flow
		+/- 0.1	+/- 10 %	+/- 5 %	+/- 0.2	+/- 10	+/- 10 %	+/- 5	
2016-08-13 23:14:30	00:00	6.39 pH	26.95 °C	761.11 µS/cm	2.41 mg/L	3.46 NTU	-30.4 mV	8.19 ft	100.00 ml/min
2016-08-13 23:19:30	04:59	6.46 pH	23.49 °C	859.91 µS/cm	0.45 mg/L	2.28 NTU	-36.6 mV	8.30 ft	100.00 ml/min
2016-08-13 23:24:30	09:59	6.47 pH	23.56 °C	861.92 µS/cm	0.36 mg/L	1.54 NTU	-35.8 mV	8.31 ft	100.00 ml/min
2016-08-13 23:29:30	14:59	6.47 pH	23.48 °C	861.31 µS/cm	0.29 mg/L	1.13 NTU	-34.1 mV	8.32 ft	100.00 ml/min
2016-08-13 23:34:30	19:59	6.47 pH	23.51 °C	859.32 µS/cm	0.26 mg/L	1.19 NTU	-32.3 mV	8.34 ft	100.00 ml/min
2016-08-13 23:39:30	25:00	6.47 pH	23.49 °C	858.90 µS/cm	0.28 mg/L	1.22 NTU	-31.0 mV	8.37 ft	100.00 ml/min
2016-08-13 23:44:30	29:59	6.47 pH	23.51 °C	854.01 µS/cm	0.37 mg/L	1.09 NTU	-29.3 mV	8.40 ft	100.00 ml/min

Samples

Sample ID:	Description:
DGWC-39	Sampled at 1035 1.09 NTU

Low-Flow Test Report:

Test Date / Time: 2016-09-02 04:42:15

Project: Plant McDonough CCR

Operator Name: Golder

Location Name: DGWC - 40 Latitude: Longitude: Well Diameter: 2 IN Casing Type: PVC Screen Length: 10 FT Top of Screen: 28.38 FT Total Depth: 38.38 FT Initial Depth to Water: 18.04 FT	Pump Type: Geopump Tubing Type: Polyethylene Tubing Inner Diameter: 0.125 IN Tubing Length: Pump Intake From TOC: 32 FT Estimated Total Volume Pumped: 4900 ML Flow Cell Volume: 90 ML Final Flow Rate: 140 ML_PER_MIN Final Draw Down: 0.05 FT	Instrument Used: SmarTROLL MP Serial Number: 416162
---	--	--

Test Notes:

Golder

Plant McDonough

Lamotte 2020

1.59 NTU

Sampled at 12:45

Weather Conditions:

80 overcast

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth To Water	Flow
		+/- 0.1	+/- 10 %	+/- 5 %	+/- 0.2	+/- 10	+/- 10 %	+/- 5	
2016-09-02 04:42:15	00:00	5.12 pH	22.79 °C	510.11 µS/cm	1.23 mg/L	1.60 NTU	261.1 mV	18.09 ft	140.00 ml/min
2016-09-02 04:47:15	05:00	4.87 pH	22.54 °C	522.94 µS/cm	1.34 mg/L	3.21 NTU	172.2 mV	18.09 ft	140.00 ml/min
2016-09-02 04:52:15	09:59	4.82 pH	22.52 °C	519.59 µS/cm	1.30 mg/L	2.26 NTU	164.1 mV	18.09 ft	140.00 ml/min
2016-09-02 04:57:15	14:59	4.80 pH	22.47 °C	521.19 µS/cm	1.29 mg/L	2.05 NTU	165.9 mV	18.09 ft	140.00 ml/min
2016-09-02 05:02:15	19:59	4.80 pH	22.61 °C	519.43 µS/cm	1.27 mg/L	1.96 NTU	168.9 mV	18.09 ft	140.00 ml/min
2016-09-02 05:07:15	24:59	4.78 pH	22.52 °C	519.90 µS/cm	1.29 mg/L	1.27 NTU	165.5 mV	18.09 ft	140.00 ml/min
2016-09-02 05:12:15	29:59	4.77 pH	22.47 °C	520.89 µS/cm	1.31 mg/L	1.57 NTU	167.8 mV	18.09 ft	140.00 ml/min

Samples

Sample ID:	Description:
------------	--------------

Created using VuSitu from In-Situ, Inc.

FIELD DATA FORMS

December 2016

Product Name: Low-Flow System

Date: 2016-12-07 13:05:11

Project Information:

Operator Name K. Jurinko
Company Name Golder
Project Name Plant McDonough
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 457516
Turbidity Make/Model Lamotte 2020

Pump Information:

Pump Model/Type ALEXIS
Tubing Type polyethylene
Tubing Diameter 0.125 in
Tubing Length 38 ft

Pump placement from TOC 38 ft

Well Information:

Well ID DGWC-37
Well diameter 2 in
Well Total Depth 43.05 ft
Screen Length 10 ft
Depth to Water 12.92 ft

Pumping Information:

Final Pumping Rate 140 mL/min
Total System Volume 0.181701 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 2.4 in
Total Volume Pumped 3.5 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	12:40:34	300.12	19.52	6.34	463.15	1.39	13.11	0.45	89.23
Last 5	12:45:34	600.02	19.01	6.33	468.38	0.65	13.11	0.26	71.73
Last 5	12:50:34	900.02	18.99	6.32	470.92	0.55	13.12	0.19	50.98
Last 5	12:55:34	1200.02	18.89	6.32	474.51	0.39	13.12	0.15	56.98
Last 5	13:00:34	1500.02	18.97	6.32	475.96	1.14	13.12	0.14	56.59
Variance 0			-0.02	-0.01	2.55			-0.07	-20.75
Variance 1			-0.10	0.00	3.58			-0.03	5.99
Variance 2			0.07	0.00	1.46			-0.01	-0.38

Notes

Sampled at 1305 by KJ on 12/7/16.

Grab Samples

Product Name: Low-Flow System

Date: 2016-12-07 14:13:56

Project Information:

Operator Name K. Jurinko
Company Name Golder
Project Name Plant McDonough
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 457516
Turbidity Make/Model Lamotte 2020

Pump Information:

Pump Model/Type ALEXIS
Tubing Type polyethylene
Tubing Diameter 0.125 in
Tubing Length 23 ft

Pump placement from TOC 23 ft

Well Information:

Well ID DGWC-38
Well diameter 2 in
Well Total Depth 28.08 ft
Screen Length 10 ft
Depth to Water 6.17 ft

Pumping Information:

Final Pumping Rate 140 mL/min
Total System Volume 0.1455032 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 2.28 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	13:56:26	300.12	18.10	6.11	693.98	0.80	6.36	0.30	78.75
Last 5	14:01:26	600.02	17.72	6.10	694.83	1.00	6.36	0.22	66.46
Last 5	14:06:26	900.02	17.50	6.05	692.23	0.64	6.36	0.18	60.91
Last 5	14:11:26	1200.02	17.61	6.07	695.23	0.52	6.36	0.16	56.93
Last 5									
Variance 0			-0.38	-0.02	0.84			-0.08	-12.29
Variance 1			-0.22	-0.04	-2.60			-0.04	-5.54
Variance 2			0.11	0.01	3.00			-0.02	-3.98

Notes

Sampled by KJ at 1415 on 12/7/16

Grab Samples

Product Name: Low-Flow System

Date: 2016-12-07 15:29:09

Project Information:

Operator Name K. Jurinko
Company Name Golder
Project Name Plant McDonough
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 457516
Turbidity Make/Model Lamotte 2020

Pump Information:

Pump Model/Type ALEXIS
Tubing Type polyethylene
Tubing Diameter 0.125 in
Tubing Length 19.5 ft

Pump placement from TOC 19.5 ft

Well Information:

Well ID DGWC-39
Well diameter 2 in
Well Total Depth 24.57 ft
Screen Length 10 ft
Depth to Water 7.02 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.1370571 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 6.96 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	15:07:30	300.13	18.79	6.39	863.51	1.27	7.50	0.36	-6.19
Last 5	15:12:30	600.02	18.88	6.41	864.62	1.64	7.56	0.22	-14.95
Last 5	15:17:30	900.02	18.98	6.43	865.84	2.38	7.60	0.18	-18.79
Last 5	15:22:30	1200.02	18.97	6.43	863.97	4.06	7.60	0.16	-21.52
Last 5									
Variance 0			0.08	0.03	1.11			-0.14	-8.76
Variance 1			0.10	0.01	1.22			-0.03	-3.83
Variance 2			-0.01	0.00	-1.87			-0.02	-2.73

Notes

Sampled at 1525 on 12/7/16 by KJ

Grab Samples

Product Name: Low-Flow System

Date: 2016-12-08 09:14:47

Project Information:

Operator Name K. Jurinko
Company Name Golder
Project Name Plant McDonough
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 457516
Turbidity Make/Model Lamotte 2020

Pump Information:

Pump Model/Type ALEXIS
Tubing Type polyethylene
Tubing Diameter 0.125 in
Tubing Length 33.4 ft

Pump placement from TOC 33.4 ft

Well Information:

Well ID DGWC-40
Well diameter 2 in
Well Total Depth 38.39 ft
Screen Length 10 ft
Depth to Water 17.86 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.1706003 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 0.72 in
Total Volume Pumped 3.75 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	08:47:12	300.12	15.35	5.22	574.10	1.26	17.92	0.74	134.99
Last 5	08:52:12	600.02	15.89	4.98	560.03	1.21	17.92	0.84	127.39
Last 5	08:57:12	900.02	16.03	4.85	553.93	0.71	17.92	0.95	127.22
Last 5	09:02:12	1200.02	16.03	4.79	549.84	0.84	17.92	0.99	126.58
Last 5	09:07:12	1500.02	16.00	4.77	550.25	0.82	17.92	1.00	125.18
Variance 0			0.14	-0.13	-6.10			0.11	-0.17
Variance 1			0.01	-0.06	-4.09			0.04	-0.64
Variance 2			-0.03	-0.02	0.41			0.01	-1.40

Notes

Sampled at 910 on 12/8/16 by KJ

Grab Samples

FIELD DATA FORMS

March – April 2017

Product Name: Low-Flow System

Date: 2017-03-28 14:05:52

Project Information:

Operator Name BH
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 365491
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis Peristaltic
Tubing Type Poly
Tubing Diameter .125 in
Tubing Length 29 ft

Pump placement from TOC 29 ft

Well Information:

Well ID DGWA-53
Well diameter 2 in
Well Total Depth 31.30 ft
Screen Length 10 ft
Depth to Water 9.42 ft

Pumping Information:

Final Pumping Rate 400 mL/min
Total System Volume 0.2194393 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 145 in
Total Volume Pumped 24 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 0
Last 5	13:44:42	2400.02	18.67	6.28	344.88	8.42	16.05	0.06	23.04
Last 5	13:49:42	2700.02	18.72	6.28	339.47	8.57	17.64	0.07	23.57
Last 5	13:54:42	3000.02	18.60	6.28	334.30	8.99	19.16	0.07	23.88
Last 5	13:59:42	3299.67	17.99	6.28	334.80	9.23	20.86	0.08	24.26
Last 5	14:04:42	3599.67	17.80	6.29	331.86	7.66	21.50	0.10	25.34
Variance 0			-0.12	0.00	-5.18			0.01	0.32
Variance 1			-0.61	-0.00	0.50			0.01	0.37
Variance 2			-0.19	0.01	-2.93			0.01	1.09

Notes

Sampled at 1405 per Pete Robinson

Grab Samples

Product Name: Low-Flow System

Date: 2017-03-28 10:04:51

Project Information:

Operator Name BH
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 365491
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis Peristaltic
Tubing Type Poly
Tubing Diameter 0.125 in
Tubing Length 45 ft

Pump placement from TOC 45 ft

Well Information:

Well ID DGWA-70
Well diameter 2 in
Well Total Depth 50.60 ft
Screen Length 10 ft
Depth to Water 26.06 ft

Pumping Information:

Final Pumping Rate 100 mL/min
Total System Volume 0.1985932 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 1.68 in
Total Volume Pumped 4 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 0
Last 5	09:42:12	900.02	17.94	5.91	81.05	5.18	26.20	1.85	-31.26
Last 5	09:47:12	1200.02	17.98	5.92	81.50	4.63	26.20	1.75	-38.39
Last 5	09:52:12	1500.02	18.30	5.91	81.63	4.24	26.20	2.39	-45.58
Last 5	09:57:12	1800.02	18.42	5.91	81.57	4.49	26.20	2.16	-50.74
Last 5	10:02:12	2100.02	18.52	5.90	81.61	4.11	26.20	2.33	-56.11
Variance 0			0.31	-0.01	0.14			0.64	-7.19
Variance 1			0.12	0.00	-0.07			-0.23	-5.16
Variance 2			0.10	-0.01	0.04			0.17	-5.37

Notes

Sampled at 1005

Grab Samples

Product Name: Low-Flow System

Date: 2017-03-28 17:41:44

Project Information:

Operator Name BH
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 365491
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type
Tubing Type Bladder
Tubing Diameter Bonded
Tubing Length .125 in
42 ft

Pump placement from TOC 42 ft

Well Information:

Well ID DGWA-71
Well diameter 2 in
Well Total Depth 47.79 ft
Screen Length 10 ft
Depth to Water 29.13 ft

Pumping Information:

Final Pumping Rate 250 mL/min
Total System Volume 0.4774638 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 6.72 in
Total Volume Pumped 21.25 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 0
Last 5	17:19:59	3899.74	18.82	5.93	138.15	9.69	29.69	0.74	-18.69
Last 5	17:24:59	4199.74	18.71	5.94	136.56	7.84	29.69	0.72	-20.75
Last 5	17:29:59	4499.74	18.65	5.95	134.43	6.54	29.69	0.73	-21.31
Last 5	17:34:59	4799.74	18.65	5.95	135.05	6.38	29.69	0.73	-22.28
Last 5	17:39:59	5099.74	18.65	5.94	134.53	4.84	29.69	0.74	-23.89
Variance 0			-0.06	0.01	-2.13			0.01	-0.56
Variance 1			0.00	0.00	0.62			-0.00	-0.97
Variance 2			0.00	-0.00	-0.52			0.02	-1.61

Notes

Sampled at 1740

Grab Samples

Product Name: Low-Flow System

Date: 2017-03-30 09:43:30

Project Information:

Operator Name DT
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463072
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis Peristaltic
Tubing Type Poly
Tubing Diameter .125in
Tubing Length 38 ft

Pump placement from TOC 38 ft

Well Information:

Well ID DGWC-37
Well diameter 2 in
Well Total Depth 43.08 ft
Screen Length 10 ft
Depth to Water 13.35 ft

Pumping Information:

Final Pumping Rate 140 mL/min
Total System Volume 0.09 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 1.92 in
Total Volume Pumped 7.7 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 0
Last 5	09:21:36	2100.02	18.07	6.20	485.07	0.13	13.51	0.18	59.67
Last 5	09:26:36	2400.02	18.12	6.21	484.46	0.09	13.51	0.18	58.83
Last 5	09:31:36	2700.02	18.16	6.22	483.39	0.12	13.51	0.17	58.03
Last 5	09:36:37	3001.02	18.26	6.22	483.71	0.05	13.51	0.16	57.49
Last 5	09:41:38	3302.02	18.30	6.22	483.28	0.07	23.51	0.16	57.52
Variance 0			0.05	0.01	-1.07			-0.01	-0.80
Variance 1			0.09	0.00	0.32			-0.01	-0.54
Variance 2			0.04	-0.00	-0.43			-0.00	0.03

Notes

Grab Samples

Product Name: Low-Flow System

Date: 2017-03-30 11:37:39

Project Information:

Operator Name DT
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463072
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis Peristaltic
Tubing Type Poly
Tubing Diameter .125 in
Tubing Length 23 ft

Pump placement from TOC 23 ft

Well Information:

Well ID DGWC-38
Well diameter 2 in
Well Total Depth 28.00 ft
Screen Length 10 ft
Depth to Water 6.45 ft

Pumping Information:

Final Pumping Rate 140 mL/min
Total System Volume 0.09 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 2.04 in
Total Volume Pumped 7 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 0
Last 5	11:16:07	1800.03	19.26	5.97	684.57	0.10	6.62	0.13	61.82
Last 5	11:21:07	2100.03	19.23	5.97	687.40	0.17	6.62	0.13	61.53
Last 5	11:26:07	2400.02	19.13	5.97	686.89	0.05	6.62	0.12	61.36
Last 5	11:31:07	2700.03	19.37	5.98	686.48	0.09	6.62	0.12	61.01
Last 5	11:36:07	3000.02	19.53	5.97	687.66	0.14	6.62	0.11	60.66
Variance 0			-0.10	0.00	-0.52			-0.00	-0.18
Variance 1			0.23	0.00	-0.40			-0.00	-0.35
Variance 2			0.16	-0.00	1.17			-0.01	-0.35

Notes

Grab Samples

Product Name: Low-Flow System

Date: 2017-03-30 16:01:29

Project Information:

Operator Name DT
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463072
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis Peristaltic
Tubing Type Poly
Tubing Diameter .125 in
Tubing Length 19 ft

Pump placement from TOC 19 ft

Well Information:

Well ID DGWC-39
Well diameter 2 in
Well Total Depth 24.60 ft
Screen Length 10 ft
Depth to Water 7.20 ft

Pumping Information:

Final Pumping Rate 140 mL/min
Total System Volume 0.09 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 6.6 in
Total Volume Pumped 8.4 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 0
Last 5	15:39:25	2400.02	21.10	6.41	800.51	6.72	7.75	0.09	-43.88
Last 5	15:44:25	2700.02	21.38	6.41	796.50	6.22	7.75	0.09	-43.31
Last 5	15:49:25	3000.02	21.41	6.42	795.92	5.40	7.75	0.08	-43.42
Last 5	15:54:29	3303.95	21.37	6.41	795.76	5.27	7.75	0.08	-42.92
Last 5	15:59:30	3604.95	20.84	6.42	796.77	4.77	7.75	0.08	-42.08
Variance 0			0.04	0.01	-0.58			-0.00	-0.11
Variance 1			-0.04	-0.00	-0.16			0.00	0.50
Variance 2			-0.53	0.00	1.01			0.00	0.84

Notes

Grab Samples

Product Name: Low-Flow System

Date: 2017-03-30 12:35:39

Project Information:

Operator Name D. Herrera
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 364456
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Geopump
Tubing Type polyethylene
Tubing Diameter 0.125 in
Tubing Length 35 ft

Pump placement from TOC 35 ft

Well Information:

Well ID DGWC-40
Well diameter 2 in
Well Total Depth 38.40 ft
Screen Length 10 ft
Depth to Water 17.20 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.1889405 L
Calculated Sample Rate 300 sec
Stabilization Drawdown .48 in
Total Volume Pumped 4.5 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 0
Last 5	12:12:58	600.02	21.81	4.88	544.34	0.61	17.24	1.79	149.14
Last 5	12:17:58	900.02	22.26	4.89	540.64	0.66	17.24	2.52	156.25
Last 5	12:22:58	1200.02	22.72	4.87	545.21	0.65	17.24	2.78	164.85
Last 5	12:27:58	1500.02	22.91	4.85	542.09	0.66	17.24	2.58	173.80
Last 5	12:32:58	1800.02	22.80	4.84	541.81	0.52	17.24	2.65	182.24
Variance 0			0.46	-0.02	4.56			0.26	8.60
Variance 1			0.19	-0.03	-3.12			-0.20	8.96
Variance 2			-0.12	-0.00	-0.28			0.07	8.43

Notes

DGWC-40 Sampled at 12:40 on 3/30/2017

Grab Samples

Product Name: Low-Flow System

Date: 2017-03-31 10:53:39

Project Information:

Operator Name BH
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 365491
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis Peristaltic
Tubing Type Poly
Tubing Diameter .125 in
Tubing Length 50 ft

Pump placement from TOC 50 ft

Well Information:

Well ID DGWC-67
Well diameter 2 in
Well Total Depth 55.48 ft
Screen Length 10 ft
Depth to Water 8.31 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.3131711 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 4.9 in
Total Volume Pumped 4.5 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 0
Last 5	10:30:49	600.02	18.60	6.27	426.89	4.75	8.59	0.44	13.38
Last 5	10:35:49	900.02	18.38	6.27	424.93	3.62	8.59	0.36	5.67
Last 5	10:40:49	1199.77	18.42	6.26	424.35	4.01	8.66	0.28	-0.85
Last 5	10:45:49	1499.77	18.52	6.25	424.16	3.58	8.71	0.22	-6.16
Last 5	10:50:49	1799.77	18.43	6.25	421.85	2.51	8.72	0.20	-10.85
Variance 0			0.03	-0.01	-0.58			-0.08	-6.52
Variance 1			0.10	-0.01	-0.19			-0.05	-5.31
Variance 2			-0.09	-0.00	-2.31			-0.03	-4.69

Notes

Sampled at 1050

Grab Samples

Product Name: Low-Flow System

Date: 2017-03-31 13:00:48

Project Information:

Operator Name DT
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463072
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis Peristaltic
Tubing Type Poly
Tubing Diameter 0.125 in
Tubing Length 13 ft

Pump placement from TOC 13 ft

Well Information:

Well ID DGWC-68
Well diameter 2 in
Well Total Depth 18.50 ft
Screen Length 10 ft
Depth to Water 3.28 ft

Pumping Information:

Final Pumping Rate 100 mL/min
Total System Volume 0.09 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 0.8 in
Total Volume Pumped 3.5 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 0
Last 5	12:38:08	900.02	18.52	6.64	424.70	4.54	3.35	0.16	-20.13
Last 5	12:43:08	1200.02	18.61	6.66	423.97	3.49	3.35	0.15	-24.96
Last 5	12:48:08	1499.97	18.55	6.67	421.51	2.39	3.35	0.15	-26.93
Last 5	12:53:08	1799.97	18.70	6.67	421.22	4.60	3.35	0.13	-29.80
Last 5	12:58:08	2099.97	18.61	6.68	424.85	1.98	3.35	0.13	-31.56
Variance 0			-0.06	0.01	-2.46			-0.00	-1.97
Variance 1			0.15	0.00	-0.30			-0.01	-2.87
Variance 2			-0.09	0.01	3.63			-0.00	-1.76

Notes

Grab Samples

Product Name: Low-Flow System

Date: 2017-04-12 12:37:03

Project Information:

Operator Name KNJ
Company Name Golder
Project Name
Site Name McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 449474
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis Peristaltic
Tubing Type poly
Tubing Diameter 0.125 in
Tubing Length 13.5 ft

Pump placement from TOC 13.5 ft

Well Information:

Well ID DGWC-68
Well diameter 2 in
Well Total Depth 18.5 ft
Screen Length 10 ft
Depth to Water 3.13 ft

Pumping Information:

Final Pumping Rate 100 mL/min
Total System Volume 0.122578 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 1.2 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	12:14:10	600.03	19.73	6.56	442.83	0.56	3.21	0.39	-17.50
Last 5	12:19:10	900.02	19.46	6.59	432.35	0.62	3.22	0.28	-19.36
Last 5	12:24:10	1200.02	19.19	6.61	430.47	0.67	3.23	0.24	-22.21
Last 5	12:29:11	1501.02	19.17	6.62	427.29	0.60	3.23	0.23	-22.91
Last 5	12:34:12	1802.02	19.41	6.63	425.37	0.81	3.23	0.21	-24.09
Variance 0			-0.27	0.02	-1.88			-0.04	-2.85
Variance 1			-0.02	0.01	-3.18			-0.02	-0.71
Variance 2			0.24	0.01	-1.92			-0.02	-1.18

Notes

Sampled by KJ at 1235 on 4/12/17

Grab Samples

Product Name: Low-Flow System

Date: 2017-04-12 13:49:38

Project Information:

Operator Name KNJ
Company Name Golder
Project Name
Site Name McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 449474
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis Peristaltic
Tubing Type poly
Tubing Diameter 0.125 in
Tubing Length 19.5 ft

Pump placement from TOC 19.5 ft

Well Information:

Well ID DGWC-69
Well diameter 2 in
Well Total Depth 24.50 ft
Screen Length 10 ft
Depth to Water 5.58 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.1370571 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 7.92 in
Total Volume Pumped 6 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	13:25:39	1199.90	20.11	6.21	150.31	8.25	6.20	0.40	43.25
Last 5	13:30:39	1499.90	19.86	6.20	148.63	3.87	6.21	0.42	30.87
Last 5	13:35:42	1802.90	20.04	6.20	149.00	4.60	6.23	0.47	29.99
Last 5	13:40:42	2102.90	19.79	6.19	148.31	1.77	6.25	0.52	32.96
Last 5	13:45:45	2405.90	19.77	6.19	148.06	1.87	6.24	0.61	37.76
Variance 0			0.18	-0.01	0.37			0.05	-0.87
Variance 1			-0.25	-0.01	-0.69			0.05	2.96
Variance 2			-0.02	-0.00	-0.26			0.09	4.80

Notes

Sampled by KNJ at 1346 on 4/12/17

Grab Samples

Product Name: Low-Flow System

Date: 2017-03-31 13:12:14

Project Information:

Operator Name BH
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 365491
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis Peristaltic
Tubing Type poly
Tubing Diameter .125 in
Tubing Length 20 ft

Pump placement from TOC 20 ft

Well Information:

Well ID DGWC-69
Well diameter 2 in
Well Total Depth 24.50 ft
Screen Length 10 ft
Depth to Water 5.47 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.1792685 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 6.5 in
Total Volume Pumped 5.25 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 0
Last 5	12:50:01	900.02	20.74	6.31	191.55	12.00	5.91	0.21	-35.73
Last 5	12:55:01	1200.02	20.48	6.29	190.86	8.93	5.98	0.19	-36.17
Last 5	13:00:01	1500.02	20.21	6.28	190.33	6.87	6.01	0.18	-37.18
Last 5	13:05:01	1800.02	20.22	6.27	193.61	5.73	6.01	0.21	-37.79
Last 5	13:10:01	2100.02	19.86	6.26	194.65	3.71	6.01	0.24	-38.67
Variance 0			-0.27	-0.01	-0.53			-0.01	-1.01
Variance 1			0.02	-0.01	3.29			0.03	-0.61
Variance 2			-0.36	-0.01	1.04			0.02	-0.88

Notes

Sampled at 1310

Grab Samples

FIELD DATA FORMS

May 2017

Product Name: Low-Flow System

Date: 2017-05-11 16:05:36

Project Information:

Operator Name DT
Company Name Golder Associates
Project Name New Background Sampling = 2
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 497259
Turbidity Make/Model LaMotte 2020

Pump Information:

Pump Model/Type Alexis Peristaltic
Tubing Type Poly
Tubing Diameter 0.125 in
Tubing Length 29 ft

Pump placement from TOC 29 ft

Well Information:

Well ID DGWA-53
Well diameter 2 in
Well Total Depth 31.30 ft
Screen Length 10 ft
Depth to Water 9.08 ft

Pumping Information:

Final Pumping Rate 400 mL/min
Total System Volume 0.1599823 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 159.84 in
Total Volume Pumped 42 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 0
Last 5	15:43:07	5099.90	20.12	6.60	371.71	1.25	22.40	8.34	-32.34
Last 5	15:48:08	5400.90	20.20	6.60	371.58	1.24	22.40	8.34	-32.74
Last 5	15:53:08	5700.90	20.37	6.60	371.09	1.24	22.40	8.28	-33.10
Last 5	15:58:08	6000.90	20.29	6.60	369.92	1.20	22.40	8.32	-32.42
Last 5	16:03:08	6300.90	20.31	6.60	370.35	1.06	22.40	8.33	-31.94
Variance 0			0.16	-0.00	-0.49			-0.06	-0.36
Variance 1			-0.08	0.00	-1.17			0.04	0.68
Variance 2			0.02	-0.00	0.43			0.01	0.48

Notes

Began purging DGWA-53 at 1254. SmarTroll disconnected at 1355 and iPad overheated at 1411. Stopped Purging DGWA-53 at 1603 and began sampling. Three Volume Method

Grab Samples

Product Name: Low-Flow System

Date: 2017-05-15 11:34:52

Project Information:

Operator Name KNJ
Company Name Golder Associates
Project Name New Background Sampling =2
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 497259
Turbidity Make/Model LaMotte 2020

Pump Information:

Pump Model/Type SamplePro Bladder Pump
Tubing Type Poly
Tubing Diameter 0.125 in
Tubing Length 55 ft

Pump placement from TOC 55 ft

Well Information:

Well ID DGWA-70A
Well diameter 2 in
Well Total Depth 60 ft
Screen Length 10 ft
Depth to Water 41.68 ft

Pumping Information:

Final Pumping Rate 100 mL/min
Total System Volume 0.312725 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 3.24 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 0
Last 5	11:09:12	600.03	22.55	5.67	80.36	11.25	41.92	5.28	125.47
Last 5	11:14:12	900.03	22.45	5.69	80.06	9.72	41.95	5.13	125.43
Last 5	11:19:12	1199.93	22.51	5.69	79.91	7.43	41.95	5.02	125.72
Last 5	11:24:12	1499.93	22.54	5.71	80.64	4.38	41.95	4.94	125.61
Last 5	11:29:12	1799.93	22.52	5.72	81.06	3.53	41.95	4.94	124.81
Variance 0			0.06	0.00	-0.15			-0.11	0.29
Variance 1			0.03	0.01	0.73			-0.08	-0.11
Variance 2			-0.02	0.01	0.42			-0.01	-0.81

Notes

Sampled at 1130 by KNJ on 5/15/17

Grab Samples

Product Name: Low-Flow System

Date: 2017-05-12 11:14:24

Project Information:

Operator Name DT
Company Name Golder Associates
Project Name New Background Sampling = 2
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 449471
Turbidity Make/Model LaMotte 2020

Pump Information:

Pump Model/Type SamplePro Bladder Pump
Tubing Type Poly
Tubing Diameter 0.125 in
Tubing Length 42 ft

Pump placement from TOC 42 ft

Well Information:

Well ID DGWA-71
Well diameter 2 in
Well Total Depth 47.79 ft
Screen Length 10 ft
Depth to Water 28.74 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.1913537 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 4.56 in
Total Volume Pumped 8.0 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 0
Last 5	10:48:49	1200.03	18.46	5.20	139.09	6.23	29.10	0.63	113.21
Last 5	10:53:49	1500.03	18.49	5.28	136.98	5.25	29.10	0.64	108.07
Last 5	10:58:49	1800.03	18.43	5.31	135.35	4.71	29.12	0.65	104.41
Last 5	11:03:49	2100.03	18.46	5.40	134.23	4.59	29.12	0.65	98.97
Last 5	11:08:49	2400.03	18.49	5.46	133.52	4.51	29.12	0.65	94.47
Variance 0			-0.06	0.04	-1.63			0.01	-3.66
Variance 1			0.04	0.08	-1.12			0.00	-5.44
Variance 2			0.03	0.06	-0.71			-0.00	-4.50

Notes

Began purging DGWA-71 at 1028

Stopped Purging DGWA-71 at 1108 and began sampling. SmarTroll did not record data at 1043 but turbidity and DTW were recorded

Grab Samples

Product Name: Low-Flow System

Date: 2017-05-12 16:21:36

Project Information:

Operator Name AME
Company Name Golder Associates
Project Name New Background Sampling =2
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 497259
Turbidity Make/Model LaMotte 2020

Pump Information:

Pump Model/Type Alexis Peristaltic
Tubing Type Poly
Tubing Diameter 0.170 in
Tubing Length 50 ft

Pump placement from TOC 50 ft

Well Information:

Well ID DGWC-67
Well diameter 2 in
Well Total Depth 55.50 ft
Screen Length 10 ft
Depth to Water 8.69 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.3131711 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 3.96 in
Total Volume Pumped 12 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 0
Last 5	15:58:11	3599.90	19.96	6.23	424.89	7.45	9.10	0.15	75.19
Last 5	16:03:11	3899.90	19.94	6.24	425.15	5.74	9.10	0.15	74.90
Last 5	16:08:11	4199.90	20.20	6.24	423.81	4.51	9.04	0.17	75.12
Last 5	16:13:11	4499.90	20.20	6.23	423.21	4.12	9.03	0.17	75.31
Last 5	16:18:11	4799.90	20.16	6.23	425.83	3.95	9.02	0.18	75.45
Variance 0			0.26	-0.01	-1.34			0.01	0.22
Variance 1			0.00	-0.00	-0.60			0.00	0.19
Variance 2			-0.04	-0.00	2.62			0.01	0.14

Notes

Sampled @ 1618

Grab Samples

Product Name: Low-Flow System

Date: 2017-05-12 13:22:50

Project Information:

Operator Name AME
Company Name Golder Associates
Project Name New Background Sampling =2
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 497259
Turbidity Make/Model LaMotte 2020

Pump Information:

Pump Model/Type Alexis Peristaltic
Tubing Type Poly
Tubing Diameter 0.125 in
Tubing Length 25 ft

Pump placement from TOC 25 ft

Well Information:

Well ID DGWC-68A
Well diameter 2 in
Well Total Depth 29.80 ft
Screen Length 10 ft
Depth to Water 9.85 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.2015856 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 3 in
Total Volume Pumped 6.00 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 0
Last 5	12:59:16	1200.03	18.90	6.62	465.45	7.55	10.10	0.17	57.36
Last 5	13:04:16	1500.03	18.79	6.62	468.66	6.48	10.10	0.15	55.75
Last 5	13:09:16	1799.95	19.12	6.62	467.52	4.76	10.10	0.15	54.31
Last 5	13:14:16	2099.95	19.62	6.62	469.10	2.84	10.10	0.15	52.84
Last 5	13:19:16	2399.95	19.07	6.63	464.96	3.79	10.10	0.15	52.38
Variance 0			0.33	-0.00	-1.14			-0.00	-1.44
Variance 1			0.50	-0.00	1.57			0.00	-1.47
Variance 2			-0.55	0.01	-4.14			-0.00	-0.46

Notes

Sampled @ 1321

Grab Samples

Product Name: Low-Flow System

Date: 2017-05-12 11:31:40

Project Information:

Operator Name AME
Company Name Golder Associates
Project Name New Background Sampling =2
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 497259
Turbidity Make/Model LaMotte 2020

Pump Information:

Pump Model/Type Alexis Peristaltic
Tubing Type Poly
Tubing Diameter 0.125 in
Tubing Length 19 ft

Pump placement from TOC 19 ft

Well Information:

Well ID DGWC-69
Well diameter 2 in
Well Total Depth 24.06 ft
Screen Length 10 ft
Depth to Water 5.82 ft

Pumping Information:

Final Pumping Rate 100 mL/min
Total System Volume 0.1358505 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 7.08 in
Total Volume Pumped 6.6 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 0
Last 5	11:08:09	2700.03	19.70	6.21	183.62	6.85	6.41	0.54	32.76
Last 5	11:13:09	3000.03	19.78	6.20	183.16	5.87	6.41	0.57	34.41
Last 5	11:18:09	3300.03	19.76	6.20	181.81	5.55	6.41	0.55	36.30
Last 5	11:23:09	3599.94	19.85	6.20	182.56	4.94	6.41	0.59	37.53
Last 5	11:28:09	3899.93	19.98	6.20	183.00	4.19	6.41	0.60	38.49
Variance 0			-0.02	0.00	-1.35			-0.02	1.90
Variance 1			0.09	-0.00	0.74			0.04	1.23
Variance 2			0.13	-0.00	0.44			0.01	0.96

Notes

Sampled @ 1129; 4.19 NTU

Grab Samples

FIELD DATA FORMS

June 2017

Product Name: Low-Flow System

Date: 2017-06-15 10:07:18

Project Information:

Operator Name BH
Company Name Golder
Project Name Alexis
Site Name McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 513028
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .170 in
Tubing Length 26 ft

Pump placement from TOC 26 ft

Well Information:

Well ID DGWA-53
Well diameter 2 in
Well Total Depth 31.30 ft
Screen Length 10 ft
Depth to Water 7.85 ft

Pumping Information:

Final Pumping Rate 500 mL/min
Total System Volume 0.206049 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 142 in
Total Volume Pumped 15.25 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0	+/- 0.1	+/- 5%	+/- 10		+/- 0.2	+/- 0
Last 5	09:45:23	1799.89	19.53	6.36	347.89	5.81	14.57	0.02	22.25
Last 5	09:50:23	2099.89	19.53	6.36	340.22	6.25	16.65	0.03	23.03
Last 5	09:55:23	2399.89	19.90	6.36	334.71	5.36	17.90	0.05	22.86
Last 5	10:00:23	2699.89	19.65	6.38	341.55	5.29	19.52	0.11	18.29
Last 5	10:05:23	2999.89	21.77	6.41	366.04	5.61	19.72	0.08	-14.61
Variance 0			0.37	0.01	-5.52			0.01	-0.17
Variance 1			-0.25	0.01	6.85			0.07	-4.57
Variance 2			2.12	0.03	24.48			-0.03	-32.89

Notes

Sampled at 1005 after pumping three well volumes per Pete

Grab Samples

Product Name: Low-Flow System

Date: 2017-06-15 15:37:38

Project Information:

Operator Name DH
Company Name Golder
Project Name SamplePro
Site Name McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463072
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type SamplePro
Tubing Type polyethylene
Tubing Diameter .170 in
Tubing Length 57 ft

Pump placement from TOC 57 ft

Well Information:

Well ID DGWA-70A
Well diameter 2 in
Well Total Depth 62.65 ft
Screen Length 10 ft
Depth to Water 41.92 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.7751225 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 4.8 in
Total Volume Pumped 17 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0	+/- 0.1	+/- 5%	+/- 10		+/- 0.2	+/- 0
Last 5	15:13:35	3600.93	22.19	5.74	64.71	14.60	42.32	4.21	24.29
Last 5	15:18:35	3900.93	22.58	5.74	64.63	12.50	42.32	4.17	24.33
Last 5	15:23:35	4200.93	22.62	5.74	64.14	11.00	42.32	4.13	25.26
Last 5	15:28:35	4500.93	22.93	5.75	63.79	9.06	42.32	4.09	25.03
Last 5	15:33:35	4800.93	22.34	5.74	62.88	9.12	42.32	4.12	26.60
Variance 0			0.04	-0.00	-0.48			-0.05	0.93
Variance 1			0.31	0.01	-0.35			-0.03	-0.23
Variance 2			-0.60	-0.01	-0.91			0.03	1.58

Notes

Sampled DGWA-70A on 6/15/17 at 15:35. Sampled FB-1 on 6/15/17 at 14:30

Grab Samples

Product Name: Low-Flow System

Date: 2017-06-16 09:27:44

Project Information:

Operator Name DH
Company Name Golder
Project Name SamplePro
Site Name McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463072
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type SamplePro
Tubing Type polyethylene
Tubing Diameter .170 in
Tubing Length 42 ft

Pump placement from TOC 42 ft

Well Information:

Well ID DGWA-71
Well diameter 2 in
Well Total Depth 47.49 ft
Screen Length 10 ft
Depth to Water 28.8 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.6724638 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 2.4 in
Total Volume Pumped 8 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0	+/- 0.1	+/- 5%	+/- 10		+/- 0.2	+/- 0
Last 5	09:05:39	1200.02	18.87	5.79	124.48	7.09	29.00	0.28	37.66
Last 5	09:10:39	1500.02	18.92	5.79	119.30	6.76	29.00	0.39	34.87
Last 5	09:15:39	1800.02	19.04	5.79	114.88	6.17	29.00	0.48	33.37
Last 5	09:20:39	2100.02	19.14	5.80	113.12	6.20	29.00	0.51	31.11
Last 5	09:25:40	2400.81	19.19	5.81	111.53	5.06	29.00	0.53	29.69
Variance 0			0.12	-0.01	-4.41			0.09	-1.50
Variance 1			0.10	0.01	-1.76			0.03	-2.26
Variance 2			0.04	0.01	-1.60			0.02	-1.42

Notes

Sampled DGWA-71 at 9:25 on 6/16/17

Grab Samples

Product Name: Low-Flow System

Date: 2017-06-16 09:21:31

Project Information:

Operator Name BH
Company Name Golder
Project Name Alexis
Site Name McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 513028
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .170 in
Tubing Length 50 ft

Pump placement from TOC 50 ft

Well Information:

Well ID DGWC-67
Well diameter 2 in
Well Total Depth 55.48 ft
Screen Length 10 ft
Depth to Water 8.40 ft

Pumping Information:

Final Pumping Rate 100 mL/min
Total System Volume 0.3131711 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 3.48 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0	+/- 0.1	+/- 5%	+/- 10		+/- 0.2	+/- 0
Last 5	08:59:10	599.86	19.72	6.22	421.97	3.56	8.65	0.23	-21.00
Last 5	09:04:10	899.85	19.63	6.22	423.79	0.52	8.68	0.16	-25.16
Last 5	09:09:10	1199.85	19.63	6.22	421.13	0.39	8.69	0.13	-26.94
Last 5	09:14:10	1499.85	19.70	6.22	422.20	1.89	8.69	0.13	-29.32
Last 5	09:19:10	1799.85	19.81	6.22	421.63	3.93	8.69	0.12	-31.10
Variance 0			-0.00	0.00	-2.66			-0.03	-1.78
Variance 1			0.08	-0.01	1.08			-0.00	-2.38
Variance 2			0.11	0.00	-0.57			-0.01	-1.78

Notes

Sampled at 0920

Grab Samples

Product Name: Low-Flow System

Date: 2017-06-16 11:08:01

Project Information:

Operator Name BH
Company Name Golder
Project Name Alexis
Site Name McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 513028
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .170 in
Tubing Length 25 ft

Pump placement from TOC 25 ft

Well Information:

Well ID DGWC-68A
Well diameter 2 in
Well Total Depth 29.80 ft
Screen Length 10 ft
Depth to Water 9.01 ft

Pumping Information:

Final Pumping Rate 100 mL/min
Total System Volume 0.2015856 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 2.16 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0	+/- 0.1	+/- 5%	+/- 10		+/- 0.2	+/- 0
Last 5	10:46:20	600.03	19.94	6.63	426.73	2.04	9.18	0.20	-2.55
Last 5	10:51:20	900.03	19.45	6.63	428.37	1.44	9.19	0.15	1.56
Last 5	10:56:20	1200.03	19.28	6.63	427.72	1.86	9.19	0.11	1.13
Last 5	11:01:20	1500.03	19.20	6.63	425.57	1.06	9.19	0.09	1.06
Last 5	11:06:20	1799.87	19.14	6.63	423.84	2.77	9.19	0.08	2.28
Variance 0			-0.17	0.00	-0.65			-0.04	-0.43
Variance 1			-0.07	-0.00	-2.15			-0.02	-0.07
Variance 2			-0.07	-0.00	-1.73			-0.01	1.22

Notes

Sampled at 1110

Grab Samples

Product Name: Low-Flow System

Date: 2017-06-16 11:32:22

Project Information:

Operator Name DH
Company Name Golder
Project Name Alexis
Site Name McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463072
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 19 ft

Pump placement from TOC 19 ft

Well Information:

Well ID DGWC-69
Well diameter 2 in
Well Total Depth 24.59 ft
Screen Length 10 ft
Depth to Water 6.35 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.09 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 4.08 in
Total Volume Pumped 3.75 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0	+/- 0.1	+/- 5%	+/- 10		+/- 0.2	+/- 0
Last 5	11:09:37	300.15	19.53	6.22	178.94	3.60	6.68	0.13	55.36
Last 5	11:14:37	600.02	19.50	6.21	178.64	1.50	6.69	0.16	53.05
Last 5	11:19:37	900.02	19.50	6.21	179.26	1.15	6.69	0.20	50.69
Last 5	11:24:37	1200.02	19.41	6.22	183.72	1.08	6.69	0.24	49.90
Last 5	11:29:37	1500.02	19.37	6.22	187.67	1.13	6.69	0.29	49.99
Variance 0			-0.00	0.00	0.62			0.04	-2.37
Variance 1			-0.09	0.01	4.45			0.05	-0.78
Variance 2			-0.04	0.01	3.95			0.05	0.09

Notes

Sampled DGWC-69 at 11:30 on 6/16/17

Grab Samples

FIELD DATA FORMS

July 2017

Product Name: Low-Flow System

Date: 2017-07-11 12:56:49

Project Information:

Operator Name B. Hodges
Company Name Golder Associates
Project Name McDonough
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 449622
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 26 ft

Pump placement from TOC 26 ft

Well Information:

Well ID DGWA-53
Well diameter 2 in
Well Total Depth 31.30 ft
Screen Length 10 ft
Depth to Water 6.28 ft

Pumping Information:

Final Pumping Rate 0 mL/min
Total System Volume 0.206049 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 0 in
Total Volume Pumped 33.8 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	12:33:42	4499.92	24.61	6.37	389.04	4.90	24.44	3.48	6.64
Last 5	12:38:46	4803.92	24.33	6.37	388.41	4.83	23.80	2.65	2.50
Last 5	12:43:46	5103.92	24.63	6.37	386.64	12.48	23.10	2.58	-2.56
Last 5	12:48:47	5404.92	24.50	6.34	389.42	10.66	22.90	2.59	-4.37
Last 5	12:53:47	5704.92	24.66	6.34	389.66	12.22	22.75	1.09	-11.40
Variance 0			0.30	-0.01	-1.78			-0.06	-5.06
Variance 1			-0.13	-0.02	2.79			0.01	-1.82
Variance 2			0.15	-0.01	0.24			-1.50	-7.03

Notes

Not sampled due to turbidity. Will return to sample.

Grab Samples

Product Name: Low-Flow System

Date: 2017-07-12 10:42:08

Project Information:

Operator Name B. Hodges
Company Name Golder Associates
Project Name McDonough
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 449622
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 26 ft

Pump placement from TOC 26 ft

Well Information:

Well ID DGWA-53
Well diameter 2 in
Well Total Depth 31.30 ft
Screen Length 10 ft
Depth to Water 6.28 ft

Pumping Information:

Final Pumping Rate 100 mL/min
Total System Volume 0.206049 L
Calculated Sample Rate 30 sec
Stabilization Drawdown 9 in
Total Volume Pumped 0 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	10:39:14	30.03	26.12	5.91	416.02	3.05	7.01	2.81	53.10
Last 5									
Last 5									
Last 5									
Last 5									
Variance 0			nan	nan	nan			nan	nan
Variance 1			0.00	0.00	0.00			0.00	0.00
Variance 2			0.00	0.00	0.00			0.00	0.00

Notes

Sampled after pumping dry. Turbidity rose to 6.37 after metals, 10.59 after inorganics, and 11.43 after radium. WL dropped 3.28 ft in 37 minutes

Grab Samples

Product Name: Low-Flow System

Date: 2017-07-11 10:19:31

Project Information:

Operator Name D. Herrera
Company Name Golder Associates
Project Name McDonough
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 497259
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type SamplePro
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 57 ft

Pump placement from TOC 57 ft

Well Information:

Well ID DGWA-70A
Well diameter 2 in
Well Total Depth 62.55 ft
Screen Length 10 ft
Depth to Water 41.26 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.4694151 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 8.28 in
Total Volume Pumped 5 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	09:54:22	300.15	21.63	5.56	70.43	5.59	41.85	5.24	43.15
Last 5	09:59:22	600.03	21.37	5.59	68.25	5.79	42.90	5.10	40.39
Last 5	10:04:22	900.03	20.90	5.59	68.24	4.65	41.95	5.05	39.70
Last 5	10:09:22	1200.03	21.10	5.61	68.63	4.62	41.95	5.01	38.36
Last 5	10:14:22	1499.82	21.16	5.62	68.77	3.55	41.95	4.97	38.60
Variance 0			-0.47	0.00	-0.01			-0.05	-0.69
Variance 1			0.20	0.02	0.38			-0.05	-1.34
Variance 2			0.06	0.01	0.14			-0.03	0.24

Notes

Sampled DGWA-70A at 1015 on 7/11/2017

Grab Samples

Product Name: Low-Flow System

Date: 2017-07-11 12:16:52

Project Information:

Operator Name D. Herrera
Company Name Golder Associates
Project Name McDonough
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 497259
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type SamplePro
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 42 ft

Pump placement from TOC 42 ft

Well Information:

Well ID DGWA-71
Well diameter 2 in
Well Total Depth 47.79 ft
Screen Length 10 ft
Depth to Water 28.05 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.4024638 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 7.2 in
Total Volume Pumped 6 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	11:53:24	600.03	21.51	5.73	109.64	5.76	28.60	0.71	19.86
Last 5	11:58:24	900.03	21.81	5.71	107.62	4.11	28.65	0.73	17.37
Last 5	12:03:24	1200.03	21.42	5.71	105.58	2.41	28.65	0.70	15.63
Last 5	12:08:24	1500.03	20.94	5.72	105.24	2.83	28.65	0.71	13.57
Last 5	12:13:24	1800.03	21.73	5.74	104.84	1.79	28.65	0.67	11.74
Variance 0			-0.39	-0.01	-2.04			-0.02	-1.74
Variance 1			-0.48	0.02	-0.34			0.01	-2.05
Variance 2			0.80	0.01	-0.40			-0.04	-1.84

Notes

Sampled DGWA-71 at 12:15 on 7/11/2017

Grab Samples

Product Name: Low-Flow System

Date: 2017-07-13 09:05:56

Project Information:

Operator Name D. Thomas
Company Name Golder Associates
Project Name McDonough
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 440279
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 38.0 ft

Pump placement from TOC 38.0 ft

Well Information:

Well ID DGWC-37
Well diameter 2 in
Well Total Depth 43.08 ft
Screen Length 10 ft
Depth to Water 13.14 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.2596101 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 1.92 in
Total Volume Pumped 5 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	08:43:52	300.16	21.82	6.28	496.97	0.16	13.30	0.37	90.96
Last 5	08:48:52	600.03	21.85	6.28	496.64	0.11	13.30	0.29	85.79
Last 5	08:53:52	900.03	21.91	6.29	488.39	0.22	13.30	0.24	83.55
Last 5	08:58:52	1199.99	21.91	6.29	491.55	0.06	13.30	0.25	82.02
Last 5	09:03:52	1499.99	21.78	6.30	493.25	0.04	13.30	0.24	80.80
Variance 0			0.06	0.02	-8.25			-0.04	-2.25
Variance 1			-0.00	-0.00	3.16			0.01	-1.53
Variance 2			-0.13	0.01	1.70			-0.01	-1.22

Notes

Began purging DGWC-37 at 0838
Stopped purging DGWC-37 at 0903 and began sampling

Grab Samples

Product Name: Low-Flow System

Date: 2017-07-13 10:32:21

Project Information:

Operator Name D. Thomas
Company Name Golder Associates
Project Name McDonough
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 440279
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 23.00 ft

Pump placement from TOC 23.00 ft

Well Information:

Well ID DGWC-38
Well diameter 2 in
Well Total Depth 28.0 ft
Screen Length 10 ft
Depth to Water 6.50 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.1926587 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 3.6 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	10:20:07	300.06	22.18	6.07	686.07	0.24	6.75	0.22	84.81
Last 5	10:25:07	600.03	21.91	6.08	692.89	0.26	6.80	0.19	84.42
Last 5	10:30:07	900.03	21.78	6.11	692.39	0.17	6.80	0.17	83.80
Last 5									
Last 5									
Variance 0			nan	nan	nan			nan	nan
Variance 1			-0.27	0.01	6.82			-0.03	-0.39
Variance 2			-0.13	0.03	-0.51			-0.02	-0.62

Notes

Began purging DGWC-38 at 1015
Stopped purging DGWC-38 at 1030 and began sampling

Grab Samples

Product Name: Low-Flow System

Date: 2017-07-13 11:45:48

Project Information:

Operator Name D. Thomas
Company Name Golder Associates
Project Name McDonough
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 440279
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 19.0 ft

Pump placement from TOC 19.0 ft

Well Information:

Well ID DGWC-39
Well diameter 2 in
Well Total Depth 24.65 ft
Screen Length 10 ft
Depth to Water 7.04 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.1748051 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 7.92 in
Total Volume Pumped 5 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	11:23:26	300.09	23.84	6.39	789.15	1.55	7.60	0.33	16.33
Last 5	11:28:26	600.03	23.73	6.42	787.91	1.60	7.65	0.24	4.61
Last 5	11:33:26	899.96	23.39	6.45	787.31	1.51	7.67	0.19	-1.81
Last 5	11:38:26	1199.96	22.66	6.47	788.87	1.46	7.70	0.17	-5.52
Last 5	11:43:26	1499.96	22.58	6.47	794.00	0.98	7.70	0.16	-9.15
Variance 0			-0.34	0.03	-0.59			-0.05	-6.42
Variance 1			-0.73	0.02	1.56			-0.02	-3.71
Variance 2			-0.08	0.00	5.13			-0.01	-3.63

Notes

Began purging DGWC-39 at 1118
Stopped purging DGWC-39 at 1143 and began sampling

Grab Samples

Product Name: Low-Flow System

Date: 2017-07-13 13:44:17

Project Information:

Operator Name D. Thomas
Company Name Golder Associates
Project Name McDonough
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 440279
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 33.0 ft

Pump placement from TOC 33.0 ft

Well Information:

Well ID DGWC-40
Well diameter 2 in
Well Total Depth 38.40 ft
Screen Length 10 ft
Depth to Water 16.20 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.237293 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 0.24 in
Total Volume Pumped 8 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	13:21:42	1200.03	24.08	5.00	554.00	0.34	16.22	1.58	126.71
Last 5	13:26:42	1500.03	24.16	4.92	547.87	0.46	16.22	1.58	129.06
Last 5	13:31:42	1800.03	23.98	4.87	552.00	0.24	16.22	1.61	130.63
Last 5	13:36:42	2100.03	24.65	4.86	549.63	0.13	16.22	1.59	131.89
Last 5	13:41:42	2399.94	24.42	4.85	545.38	0.08	16.22	1.54	132.86
Variance 0			-0.18	-0.05	4.14			0.02	1.57
Variance 1			0.67	-0.02	-2.38			-0.02	1.26
Variance 2			-0.23	-0.00	-4.25			-0.05	0.97

Notes

Began purging DGWC-40 at 1301
Stopped purging DGWC-40 at 1341 and began sampling

Grab Samples

Product Name: Low-Flow System

Date: 2017-07-13 10:45:49

Project Information:

Operator Name B. Hodges
Company Name Golder Associates
Project Name McDonough
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 449622
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 50 ft

Pump placement from TOC 50 ft

Well Information:

Well ID DGWC-67
Well diameter 2 in
Well Total Depth 55.51 ft
Screen Length 10 ft
Depth to Water 8.52 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.3131711 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 4.2 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	10:28:39	300.11	25.62	6.19	412.54	9.09	8.81	0.60	90.89
Last 5	10:33:39	600.02	25.28	6.24	415.96	4.57	8.84	0.34	89.27
Last 5	10:38:39	900.02	25.24	6.23	413.83	3.09	8.85	0.27	89.69
Last 5	10:43:39	1200.02	25.33	6.15	418.88	3.44	8.87	0.25	92.01
Last 5									
Variance 0			-0.33	0.05	3.42			-0.26	-1.62
Variance 1			-0.05	-0.01	-2.12			-0.07	0.42
Variance 2			0.09	-0.08	5.04			-0.03	2.31

Notes

Sampled at 1045

Grab Samples

Product Name: Low-Flow System

Date: 2017-07-13 13:23:27

Project Information:

Operator Name B. Hodges
Company Name Golder Associates
Project Name McDonough
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 449622
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 25 ft

Pump placement from TOC 25 ft

Well Information:

Well ID DGWC-68A
Well diameter 2 in
Well Total Depth 29.82 ft
Screen Length 10 ft
Depth to Water 9.65 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.2015856 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 2.28 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	13:07:17	300.70	25.75	6.84	434.91	1.09	9.82	0.45	59.42
Last 5	13:12:17	600.65	23.70	6.92	452.99	0.23	9.84	0.32	57.08
Last 5	13:17:17	900.66	25.08	6.85	456.68	0.43	9.84	0.26	54.70
Last 5	13:22:17	1200.66	24.88	6.84	451.09	1.38	9.84	0.21	54.94
Last 5									
Variance 0			-2.05	0.08	18.08			-0.13	-2.35
Variance 1			1.37	-0.07	3.69			-0.06	-2.38
Variance 2			-0.20	-0.01	-5.59			-0.04	0.24

Notes

Sampled at 1325

Grab Samples

Product Name: Low-Flow System

Date: 2017-07-13 14:45:12

Project Information:

Operator Name B. Hodges
Company Name Golder Associates
Project Name McDonough
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 449622
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 19 ft

Pump placement from TOC 19 ft

Well Information:

Well ID DGWC-69
Well diameter 2 in
Well Total Depth 24.09 ft
Screen Length 10 ft
Depth to Water 5.74 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.1748051 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 13.32 in
Total Volume Pumped 3.75 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	14:23:51	300.02	28.01	6.34	175.75	6.76	6.43	0.56	61.16
Last 5	14:28:51	600.02	25.69	6.34	175.58	6.15	6.65	0.43	59.58
Last 5	14:33:51	900.02	25.94	6.33	177.65	3.59	6.79	0.40	57.11
Last 5	14:38:51	1200.02	24.97	6.35	174.10	3.65	6.82	0.39	58.63
Last 5	14:43:51	1500.02	24.85	6.35	175.09	3.85	6.85	0.39	58.15
Variance 0			0.24	-0.00	2.07			-0.03	-2.46
Variance 1			-0.97	0.02	-3.55			-0.01	1.52
Variance 2			-0.11	-0.00	0.99			-0.00	-0.49

Notes

Sampled at 1445

Grab Samples

FIELD DATA FORMS

August 2017

Product Name: Low-Flow System

Date: 2017-08-08 10:31:29

Project Information:

Operator Name K Jurinko
Company Name Golder
Project Name 1668496
Site Name McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 449471
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type SamplePro
Tubing Type polyethylene
Tubing Diameter .170 in
Tubing Length 57 ft

Pump placement from TOC 57 ft

Well Information:

Well ID DGWA-70A
Well diameter 2 in
Well Total Depth 62.55 ft
Screen Length 10 ft
Depth to Water 41.54 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.4694151 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 8.88 in
Total Volume Pumped 4 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	09:58:43	300.16	20.93	5.64	74.37	22.80	42.10	5.49	198.32
Last 5	10:03:42	600.03	18.35	5.59	70.87	14.20	42.15	5.02	184.66
Last 5	10:08:42	900.03	18.02	5.60	72.73	6.97	42.30	4.92	173.01
Last 5	10:13:42	1200.03	17.82	5.60	73.05	4.02	42.28	4.92	169.80
Last 5									
Variance 0			-2.58	-0.06	-3.50			-0.46	-13.66
Variance 1			-0.33	0.01	1.85			-0.11	-11.65
Variance 2			-0.20	0.00	0.33			0.01	-3.20

Notes

Sampled at 1016 on 8/8/17 and FD-1

Grab Samples

Product Name: Low-Flow System

Date: 2017-08-08 13:13:14

Project Information:

Operator Name K Jurinko
Company Name Golder
Project Name 1668496
Site Name McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 449471
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Geopump
Tubing Type polyethylene
Tubing Diameter .170 in
Tubing Length 25 ft

Pump placement from TOC 25 ft

Well Information:

Well ID DGWC-68A
Well diameter 2 in
Well Total Depth 29.82 ft
Screen Length 10 ft
Depth to Water 9.63 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.2015856 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 2.64 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	12:49:34	300.15	19.41	6.56	458.57	0.78	9.83	0.28	30.50
Last 5	12:54:33	600.03	19.24	6.57	458.78	0.37	9.83	0.20	40.57
Last 5	12:59:33	900.03	18.94	6.57	457.65	0.62	9.84	0.17	37.85
Last 5	13:04:33	1200.03	18.79	6.57	457.76	0.13	9.85	0.14	35.99
Last 5									
Variance 0			-0.17	0.01	0.21			-0.08	10.07
Variance 1			-0.30	0.00	-1.12			-0.03	-2.72
Variance 2			-0.15	0.00	0.10			-0.02	-1.86

Notes

Sampled at 1306 on 8/8/17

Grab Samples

FIELD DATA FORMS

October – November 2017

Low-Flow

Date: 10/24/2017 12:35
 Operator Name: C. Gargan
 Pump Model/Type: Samplepro
 Company Name: Golder
 Tubing Type: polyethylene
 Project Name: 1668496
 Site Name: Plant McDonough
 Latitude: 0° 0' 0"
 Longitude: 0° 0' 0"
 Tubing Diameter: .17in
 Tubing Length: 26.3 ft
 Sonde SN: 440275
 Turbidity Make/Model: LaMotte
 Pump placement from TOC: 26.3 ft
 Well ID: DGWA-53
 Well diameter: 2 in
 Well Total Depth: 31.31 ft
 Screen Length: 10 ft
 Depth to Water: 9.49 ft
 Final Pumping Rate: 100 mL/min
 Total System Volume: 0.4270126 L
 Calculated Sample Rate: 300 sec
 Stabilization Drawdown: 16.32 in
 Total Volume Pumped: 3 L

Time	pH	ORP	Conductivi	DO	Temperatu	Turbidity	DTW
300	5.51	105.5	0	9.78	31.4	5.04	11.08
600	5.51	105.5	0	9.78	31.4	5	11.49
900	5.51	105.5	0	9.78	31.4	5.04	11.78
1200	5.51	105.5	0	9.78	31.4	4.43	11.94
1500	5.51	105.5	0	9.78	31.4	3.91	12.18
1800	5.51	105.5	0	9.78	31.4	3.29	12.44

Product Name: Low-Flow System

Date: 2017-10-24 15:37:04

Project Information:

Operator Name B. Hodges
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463453
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type SamplePro
Tubing Type polyethylene
Tubing Diameter .170 in
Tubing Length 57.5 ft

Pump placement from TOC 57.5 ft

Well Information:

Well ID DGWA-70A
Well diameter 2 in
Well Total Depth 62.54 ft
Screen Length 10 ft
Depth to Water 41.66 ft

Pumping Information:

Final Pumping Rate 100 mL/min
Total System Volume 0.4716468 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 3.6 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	15:15:54	600.32	20.04	5.71	72.70	3.05	41.95	5.00	230.96
Last 5	15:20:54	900.32	20.12	5.72	72.23	2.08	41.96	4.96	227.32
Last 5	15:25:54	1200.32	20.27	5.71	72.29	1.47	41.96	4.92	225.47
Last 5	15:30:54	1500.32	20.31	5.71	72.31	1.05	41.96	4.87	223.41
Last 5	15:35:54	1800.32	20.17	5.71	72.19	1.29	41.96	4.82	219.41
Variance 0			0.14	-0.01	0.07			-0.04	-1.85
Variance 1			0.05	-0.01	0.01			-0.05	-2.07
Variance 2			-0.15	0.01	-0.12			-0.05	-3.99

Notes

Sampled at 1540

Grab Samples

Product Name: Low-Flow System

Date: 2017-10-24 13:34:32

Project Information:

Operator Name B. Hodges
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463453
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type SamplePro
Tubing Type polyethylene
Tubing Diameter .170 in
Tubing Length 42.5 ft

Pump placement from TOC 42.5 ft

Well Information:

Well ID DGWA-71
Well diameter 2 in
Well Total Depth 47.79 ft
Screen Length 10 ft
Depth to Water 28.68 ft

Pumping Information:

Final Pumping Rate 100 mL/min
Total System Volume 0.4046955 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 3.6 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	13:12:24	600.02	18.03	5.86	102.29	3.07	28.98	2.05	133.11
Last 5	13:17:24	900.02	17.96	5.85	100.43	2.40	28.98	2.41	132.26
Last 5	13:22:24	1200.03	17.99	5.86	100.26	1.74	28.98	3.18	129.48
Last 5	13:27:24	1500.02	18.01	5.86	96.74	1.54	28.98	3.27	134.93
Last 5	13:32:24	1800.02	17.95	5.86	96.26	1.73	28.98	2.66	137.13
Variance 0			0.03	0.01	-0.18			0.77	-2.79
Variance 1			0.02	-0.01	-3.52			0.09	5.45
Variance 2			-0.07	0.00	-0.48			-0.61	2.20

Notes

Sampled at 1335 with Extra Radium

Grab Samples

Product Name: Low-Flow System

Date: 2017-10-26 13:29:27

Project Information:

Operator Name B. Hodges
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463453
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 23 ft

Pump placement from TOC 23 ft

Well Information:

Well ID DGWC-38
Well diameter 2 in
Well Total Depth 28.00 ft
Screen Length 10 ft
Depth to Water 6.58 ft

Pumping Information:

Final Pumping Rate 120 mL/min
Total System Volume 0.1926587 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 1.92 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	13:07:38	300.02	22.36	6.06	675.80	2.03	6.73	0.62	237.46
Last 5	13:12:38	600.02	21.60	6.06	684.44	2.48	6.74	0.38	286.60
Last 5	13:17:38	900.02	21.71	6.07	685.38	3.76	6.74	0.31	310.01
Last 5	13:22:38	1200.02	21.57	6.06	683.87	2.02	6.74	0.27	331.94
Last 5	13:27:38	1500.02	21.77	6.06	685.29	2.00	6.74	0.24	351.20
Variance 0			0.11	0.00	0.94			-0.07	23.41
Variance 1			-0.13	-0.00	-1.51			-0.04	21.93
Variance 2			0.20	-0.00	1.42			-0.03	19.26

Notes

Sampled at 1330

Grab Samples

Product Name: Low-Flow System

Date: 2017-10-26 14:41:31

Project Information:

Operator Name B. Hodges
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463453
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 19.5 ft

Pump placement from TOC 19.5 ft

Well Information:

Well ID DGWC-39
Well diameter 2 in
Well Total Depth 24.65 ft
Screen Length 10 ft
Depth to Water 7.39 ft

Pumping Information:

Final Pumping Rate 120 mL/min
Total System Volume 0.1770367 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 6.12 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	14:20:26	300.02	23.05	6.46	776.36	2.18	7.78	0.44	24.19
Last 5	14:25:26	600.02	22.27	6.46	782.08	2.81	7.86	0.30	25.74
Last 5	14:30:26	900.60	22.11	6.48	781.36	3.06	7.89	0.25	26.98
Last 5	14:35:26	1200.60	21.91	6.48	788.07	2.62	7.90	0.22	25.20
Last 5	14:40:26	1500.68	22.04	6.49	786.98	4.89	7.90	0.20	23.90
Variance 0			-0.16	0.02	-0.72			-0.05	1.23
Variance 1			-0.20	0.01	6.71			-0.02	-1.78
Variance 2			0.13	0.00	-1.09			-0.02	-1.30

Notes

Sampled at 1440

Grab Samples

Product Name: Low-Flow System

Date: 2017-10-26 12:06:56

Project Information:

Operator Name K. Minkara
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463068
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis Peristaltic
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 33 ft

Pump placement from TOC 33 ft

Well Information:

Well ID DGWC-40
Well diameter 2 in
Well Total Depth 38.40 ft
Screen Length 10 ft
Depth to Water 17.77 ft

Pumping Information:

Final Pumping Rate 120 mL/min
Total System Volume 0.237293 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 0.36 in
Total Volume Pumped 4.8 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	11:52:27	300.09	20.34	4.80	543.79	0.23	17.80	1.27	108.00
Last 5	11:57:27	600.03	20.45	4.82	545.66	0.10	17.80	1.22	107.91
Last 5	12:02:27	900.02	20.58	4.79	544.67	--	--	1.26	108.66
Last 5									
Variance 0			nan	nan	nan			nan	nan
Variance 1			0.11	0.02	1.88			-0.05	-0.08
Variance 2			0.13	-0.03	-0.99			0.03	0.75

Notes

Initial purge file froze timer after second reading with 2.5L removed at 120mL/min. This file has the final reading for DGWC-40

Grab Samples

Product Name: Low-Flow System

Date: 2017-10-26 10:09:35

Project Information:

Operator Name D. Thomas
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 449622
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 50 ft

Pump placement from TOC 50 ft

Well Information:

Well ID DGWC-67
Well diameter 2 in
Well Total Depth 55.49 ft
Screen Length 10 ft
Depth to Water 8.88 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.3131711 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 6.4 in
Total Volume Pumped 4.5 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	09:45:11	600.03	15.98	6.66	384.26	2.39	9.20	0.30	70.08
Last 5	09:50:11	900.02	16.06	6.65	383.70	2.03	9.26	0.23	69.20
Last 5	09:55:11	1200.01	16.97	6.65	382.35	1.67	9.26	0.19	67.64
Last 5	10:00:11	1500.01	17.50	6.66	378.13	0.89	9.26	0.17	65.48
Last 5	10:05:11	1800.00	17.66	6.64	378.07	0.71	9.26	0.15	65.38
Variance 0			0.91	-0.01	-1.35			-0.03	-1.56
Variance 1			0.53	0.01	-4.23			-0.02	-2.16
Variance 2			0.17	-0.01	-0.06			-0.02	-0.10

Notes

Stopped purging and began sampling

Grab Samples

Product Name: Low-Flow System

Date: 2017-10-26 12:02:53

Project Information:

Operator Name D. Thomas
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 449622
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 25 ft

Pump placement from TOC 25 ft

Well Information:

Well ID DGWC-68A
Well diameter 2 in
Well Total Depth 29.80 ft
Screen Length 10 ft
Depth to Water 9.73 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.2015856 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 2.16 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	11:45:11	300.03	20.33	7.03	401.00	1.30	9.91	0.18	51.45
Last 5	11:50:11	600.02	20.50	7.03	401.40	1.26	9.91	0.17	50.98
Last 5	11:55:11	900.02	20.40	7.04	400.27	0.96	9.91	0.15	49.84
Last 5	12:00:11	1200.01	20.48	7.01	397.84	0.60	9.91	0.14	51.12
Last 5									
Variance 0			0.17	0.00	0.40			-0.01	-0.47
Variance 1			-0.11	0.01	-1.13			-0.02	-1.14
Variance 2			0.09	-0.03	-2.43			-0.01	1.28

Notes

Began purging
Stopped purging and began sampling at 1200

Grab Samples

Product Name: Low-Flow System

Date: 2017-10-26 13:23:39

Project Information:

Operator Name D. Thomas
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 449622
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 19 ft

Pump placement from TOC 19 ft

Well Information:

Well ID DGWC-69
Well diameter 2 in
Well Total Depth 24.08 ft
Screen Length 10 ft
Depth to Water 6.08 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.1748051 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 15.36 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	13:05:03	300.04	22.09	6.65	296.01	2.79	7.36	0.23	35.82
Last 5	13:10:03	599.35	21.69	6.66	298.99	1.68	7.36	0.16	30.02
Last 5	13:15:03	899.36	21.55	6.70	297.50	1.85	7.36	0.15	26.03
Last 5	13:20:03	1199.35	21.69	6.69	299.20	--	--	0.15	23.22
Last 5									
Variance 0			-0.40	0.00	2.98			-0.07	-5.80
Variance 1			-0.13	0.04	-1.49			-0.01	-4.00
Variance 2			0.14	-0.00	1.70			0.00	-2.81

Notes

Began purging at 1300
Stopped purging and began sampling at 1320. Last NTU=2.75 and DTW= 7.36

Grab Samples

Product Name: Low-Flow System

Date: 2017-11-15 15:22:19

Project Information:

Operator Name B. Hodges
Company Name Golder
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463453
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 26 ft

Pump placement from TOC 26 ft

Well Information:

Well ID DGWA-53
Well diameter 2 in
Well Total Depth 31.29 ft
Screen Length 10 ft
Depth to Water 9.79 ft

Pumping Information:

Final Pumping Rate 0 mL/min
Total System Volume 0.206049 L
Calculated Sample Rate 30 sec
Stabilization Drawdown 0 in
Total Volume Pumped 0 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	15:21:10	30.13	18.74	6.50	450.61	3.20	17.17	1.65	-89.20
Last 5									
Last 5									
Last 5									
Last 5									
Variance 0			nan	nan	nan			nan	nan
Variance 1			0.00	0.00	0.00			0.00	0.00
Variance 2			0.00	0.00	0.00			0.00	0.00

Notes

Sampled at 1525 after pumping well dry

Grab Samples

Product Name: Low-Flow System

Date: 2017-11-15 11:06:13

Project Information:

Operator Name B. Hodges
Company Name Golder
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463453
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type SamplePro
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 43 ft

Pump placement from TOC 43 ft

Well Information:

Well ID DGWA-71
Well diameter 2 in
Well Total Depth 47.79 ft
Screen Length 10 ft
Depth to Water 28.91 ft

Pumping Information:

Final Pumping Rate 120 mL/min
Total System Volume 0.4069272 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 2.16 in
Total Volume Pumped 4.2 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C +/- 0.5	pH +/- 0.1	SpCond μ S/cm +/- 5%	Turb NTU +/- 10	DTW ft	RDO mg/L +/- 10%	ORP mV +/- 10
Stabilization									
Last 5	10:44:14	599.95	16.70	5.76	102.25	7.27	29.09	0.61	92.51
Last 5	10:49:14	899.95	16.76	5.77	99.93	6.31	29.09	0.51	90.90
Last 5	10:54:14	1199.95	16.83	5.77	98.35	5.75	29.09	0.48	90.59
Last 5	10:59:14	1499.96	16.87	5.77	97.54	5.49	29.09	0.54	88.17
Last 5	11:04:14	1799.95	16.91	5.77	95.67	4.72	29.09	0.81	89.50
Variance 0			0.07	0.00	-1.59			-0.03	-0.32
Variance 1			0.04	-0.00	-0.81			0.06	-2.42
Variance 2			0.04	0.01	-1.87			0.27	1.34

Notes

Sampled at 1105

Grab Samples

Product Name: Low-Flow System

Date: 2017-11-15 13:39:04

Project Information:

Operator Name K. Minkara
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 440279
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .170 in
Tubing Length 19 ft

Pump placement from TOC 19 ft

Well Information:

Well ID DGWC-69
Well diameter 2 in
Well Total Depth 24.05 ft
Screen Length 10 ft
Depth to Water 5.62 ft

Pumping Information:

Final Pumping Rate 120 mL/min
Total System Volume 0.1748051 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 14.64 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	13:14:43	300.04	20.84	5.98	320.60	71.80	6.54	0.64	44.39
Last 5	13:19:43	600.02	20.21	6.10	301.57	29.70	6.74	0.30	32.77
Last 5	13:24:43	900.01	19.95	6.17	296.99	11.40	6.80	0.23	25.48
Last 5	13:29:42	1200.01	19.90	6.20	295.22	6.00	6.84	0.20	21.06
Last 5	13:34:42	1500.00	19.50	6.22	293.89	4.62	6.84	0.18	18.29
Variance 0			-0.26	0.06	-4.58			-0.07	-7.29
Variance 1			-0.05	0.03	-1.77			-0.04	-4.42
Variance 2			-0.40	0.02	-1.34			-0.01	-2.76

Notes

DGWC-69 at 1335

Grab Samples

FIELD DATA FORMS

February – March 2018

Product Name: Low-Flow System

Date: 2018-03-08 12:59:48

Project Information:

Operator Name K. Minkara
Company Name Golder Associates
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 364452
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 26 ft

Pump placement from TOC 26 ft

Well Information:

Well ID DGWA-53
Well diameter 2 in
Well Total Depth 31.29 ft
Screen Length 10 ft
Depth to Water 8.15 ft

Pumping Information:

Final Pumping Rate 100 mL/min
Total System Volume 0.206049 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 66.12 in
Total Volume Pumped 8 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 5		+/- 10	+/- 10
Last 5	12:36:06	3626.98	15.53	6.16	376.48	8.77	12.96	0.13	39.49
Last 5	12:41:08	3928.98	15.55	6.14	380.79	7.77	13.13	0.12	38.62
Last 5	12:46:09	4229.97	15.21	6.17	378.13	7.35	13.37	0.13	36.62
Last 5	12:51:11	4531.97	15.98	6.18	380.32	7.22	13.51	0.12	34.27
Last 5	12:56:12	4832.96	16.51	6.18	378.52	7.95	13.66	0.11	32.50
Variance 0			-0.34	0.03	-2.66			0.00	-2.00
Variance 1			0.76	0.01	2.19			-0.01	-2.35
Variance 2			0.54	0.00	-1.80			-0.01	-1.77

Notes

Sampled DGWA-53 at 1255. Pete Robinson from SC authorized sampling if NTU < 10 due to previous purging experiences.

Grab Samples

Product Name: Low-Flow System

Date: 2018-02-27 10:38:07

Project Information:

Operator Name B. Hodges
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 364452
Turbidity Make/Model LaMotte 2020we

Pump Information:

Pump Model/Type SamplePro
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 57 ft

Pump placement from TOC 57 ft

Well Information:

Well ID DGWA-70A
Well diameter 2 in
Well Total Depth 62.54 ft
Screen Length 10 ft
Depth to Water 40.84 ft

Pumping Information:

Final Pumping Rate 120 mL/min
Total System Volume 0.4694151 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 4.8 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 10
Last 5	10:16:02	300.02	17.36	5.58	67.79	7.25	41.15	4.61	87.96
Last 5	10:21:02	600.02	17.41	5.53	67.30	4.41	41.21	4.50	87.36
Last 5	10:26:02	900.02	17.45	5.51	66.60	2.65	41.24	4.51	88.45
Last 5	10:31:02	1200.02	17.21	5.47	66.36	2.09	41.24	4.52	93.39
Last 5	10:36:02	1500.02	17.10	5.50	68.32	2.14	41.24	4.33	91.61
Variance 0			0.04	-0.02	-0.70			0.01	1.09
Variance 1			-0.24	-0.04	-0.24			0.01	4.94
Variance 2			-0.11	0.03	1.96			-0.19	-1.78

Notes

Sampled at 1035/FB-1

Grab Samples

Product Name: Low-Flow System

Date: 2018-02-27 08:59:42

Project Information:

Operator Name B. Hodges
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 364452
Turbidity Make/Model LaMotte 2020we

Pump Information:

Pump Model/Type SamplePro
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 43 ft

Pump placement from TOC 43 ft

Well Information:

Well ID DGWA-71
Well diameter 2 in
Well Total Depth 47.79 ft
Screen Length 10 ft
Depth to Water 28.41 ft

Pumping Information:

Final Pumping Rate 100 mL/min
Total System Volume 0.4069272 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 2.64 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 10
Last 5	08:37:31	600.02	15.62	5.77	92.72	1.79	28.62	0.91	86.41
Last 5	08:42:31	900.02	15.90	5.68	91.76	1.17	28.63	0.67	82.36
Last 5	08:47:31	1200.02	16.02	5.66	91.51	0.77	28.63	0.60	81.11
Last 5	08:52:31	1500.02	16.10	5.65	90.58	0.59	28.63	0.59	79.84
Last 5	08:57:31	1800.02	16.12	5.66	89.92	0.62	28.63	0.60	79.00
Variance 0			0.12	-0.03	-0.24			-0.07	-1.26
Variance 1			0.08	-0.01	-0.93			-0.01	-1.27
Variance 2			0.02	0.00	-0.66			0.01	-0.84

Notes

Sampled at 0900

Grab Samples

Product Name: Low-Flow System

Date: 2018-03-01 09:50:21

Project Information:

Operator Name D.Thomas
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 364452
Turbidity Make/Model LaMotte 2020we

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 38 ft

Pump placement from TOC 38 ft

Well Information:

Well ID DGWC-37
Well diameter 2 in
Well Total Depth 43.08 ft
Screen Length 10 ft
Depth to Water 13.05 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.2596101 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 2.4 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 10
Last 5	09:32:55	300.27	18.16	6.27	452.14	0.29	13.25	0.45	89.48
Last 5	09:37:55	600.19	18.17	6.25	454.16	0.41	13.25	0.35	87.61
Last 5	09:42:55	900.19	18.20	6.28	456.65	0.17	13.25	0.31	82.62
Last 5	09:47:55	1200.19	18.26	6.28	454.72	0.00	13.25	0.28	81.53
Last 5									
Variance 0			0.01	-0.02	2.02			-0.10	-1.87
Variance 1			0.03	0.02	2.48			-0.04	-4.99
Variance 2			0.06	0.00	-1.93			-0.03	-1.09

Notes

Started purging at 0927 DGWC-37

Grab Samples

Product Name: Low-Flow System

Date: 2018-03-01 11:39:48

Project Information:

Operator Name D.Thomas
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 364452
Turbidity Make/Model LaMotte 2020we

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 23 ft

Pump placement from TOC 23 ft

Well Information:

Well ID DGWC-38
Well diameter 2 in
Well Total Depth 28.0 ft
Screen Length 10 ft
Depth to Water 6.45 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.1926587 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 4.8 in
Total Volume Pumped 3.75 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 10
Last 5	11:17:06	300.08	18.79	6.07	637.63	0.45	6.65	0.38	83.26
Last 5	11:22:06	600.02	18.75	6.06	641.27	0.61	6.65	0.27	83.11
Last 5	11:27:06	900.02	18.65	6.05	638.77	0.70	6.65	0.25	83.67
Last 5	11:32:06	1200.02	18.55	6.06	640.04	0.60	6.65	0.22	82.79
Last 5	11:37:06	1500.02	18.57	6.05	643.37	0.44	6.65	0.21	82.75
Variance 0			-0.10	-0.01	-2.50			-0.02	0.56
Variance 1			-0.10	0.01	1.26			-0.04	-0.88
Variance 2			0.02	-0.01	3.33			-0.01	-0.05

Notes

Began purging at 1112
Stopped purging and began sampling

Grab Samples

Product Name: Low-Flow System

Date: 2018-03-01 13:17:55

Project Information:

Operator Name D.Thomas
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 364452
Turbidity Make/Model LaMotte 2020we

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 19 ft

Pump placement from TOC 19 ft

Well Information:

Well ID DGWC-39
Well diameter 2 in
Well Total Depth 24.65 ft
Screen Length 10 ft
Depth to Water 7.00 ft

Pumping Information:

Final Pumping Rate 120 mL/min
Total System Volume 0.1748051 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 7.8 in
Total Volume Pumped 4.2 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 10
Last 5	12:55:14	900.02	15.71	6.28	681.09	8.69	7.65	0.22	49.35
Last 5	13:00:14	1200.02	15.66	6.31	680.69	6.41	7.65	0.20	44.50
Last 5	13:05:14	1500.02	15.69	6.33	679.90	4.42	7.65	0.20	39.04
Last 5	13:10:14	1800.02	15.58	6.35	680.46	3.28	7.65	0.19	34.35
Last 5	13:15:14	2100.02	15.51	6.37	681.32	2.25	7.65	0.19	29.51
Variance 0			0.03	0.03	-0.79			0.00	-5.47
Variance 1			-0.11	0.02	0.55			-0.01	-4.69
Variance 2			-0.08	0.02	0.86			-0.00	-4.84

Notes

Began purging at 1240
stopped purging at 1315

Grab Samples

Product Name: Low-Flow System

Date: 2018-03-02 09:42:05

Project Information:

Operator Name D. Thomas
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 364452
Turbidity Make/Model LaMotte 2020we

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 33 ft

Pump placement from TOC 33 ft

Well Information:

Well ID DGWC-40
Well diameter 2 in
Well Total Depth 38.40 ft
Screen Length 10 ft
Depth to Water 16.40 ft

Pumping Information:

Final Pumping Rate 120 mL/min
Total System Volume 0.237293 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 0.6 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 10
Last 5	09:20:02	300.11	14.28	4.92	560.61	0.86	16.45	1.73	108.76
Last 5	09:25:02	600.03	14.58	4.77	551.60	0.46	16.45	1.77	107.28
Last 5	09:30:02	900.02	14.63	4.73	553.41	0.39	16.45	1.86	106.02
Last 5	09:35:02	1200.01	14.90	4.72	557.81	0.28	16.45	1.88	104.78
Last 5	09:40:02	1500.01	14.76	4.67	554.34	0.32	16.45	1.96	104.69
Variance 0			0.05	-0.04	1.80			0.08	-1.26
Variance 1			0.27	-0.01	4.41			0.03	-1.25
Variance 2			-0.14	-0.05	-3.47			0.08	-0.09

Notes

Began purging at 0915 at DGWC-40
Stopped purging and began sampling

Grab Samples

Product Name: Low-Flow System

Date: 2018-03-02 09:43:27

Project Information:

Operator Name K. Minkara
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 364456
Turbidity Make/Model LaMotte 2020we

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 50 ft

Pump placement from TOC 50 ft

Well Information:

Well ID DGWC-67
Well diameter 2 in
Well Total Depth 55.49 ft
Screen Length 10 ft
Depth to Water 8.83 ft

Pumping Information:

Final Pumping Rate 100 mL/min
Total System Volume 0.3131711 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 3.12 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 10
Last 5	09:22:04	600.03	15.21	6.16	427.96	0.70	9.07	0.49	104.26
Last 5	09:27:04	900.01	15.25	6.17	425.08	0.91	9.09	0.36	103.73
Last 5	09:32:04	1199.93	15.33	6.17	423.48	1.64	9.09	0.31	103.23
Last 5	09:37:04	1499.93	15.56	6.18	426.48	1.45	9.09	0.27	102.63
Last 5	09:42:05	1800.96	15.69	6.18	424.83	1.55	9.09	0.24	102.30
Variance 0			0.08	0.01	-1.60			-0.05	-0.49
Variance 1			0.24	0.00	3.00			-0.04	-0.61
Variance 2			0.13	0.01	-1.65			-0.03	-0.33

Notes

Sampled DGWC-67 at 0940, 3-2-18

Grab Samples

Product Name: Low-Flow System

Date: 2018-03-02 11:14:07

Project Information:

Operator Name K. Minkara
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 364456
Turbidity Make/Model LaMotte 2020we

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 25 ft

Pump placement from TOC 25 ft

Well Information:

Well ID DGWC-68A
Well diameter 2 in
Well Total Depth 29.8 ft
Screen Length 10 ft
Depth to Water 9.37 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.2015856 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 2.04 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 10
Last 5	10:56:14	300.03	16.96	6.60	442.00	1.09	9.52	0.38	99.49
Last 5	11:01:14	600.02	16.82	6.59	447.38	2.40	9.54	0.23	99.50
Last 5	11:06:14	900.02	16.82	6.59	446.43	2.84	9.54	0.18	99.29
Last 5	11:11:14	1200.02	16.87	6.58	446.55	1.32	9.54	0.16	99.11
Last 5									
Variance 0			-0.14	-0.01	5.38			-0.16	0.00
Variance 1			0.00	0.00	-0.95			-0.04	-0.20
Variance 2			0.05	-0.01	0.12			-0.03	-0.18

Notes

Sampled DGWC-68A at 1110, 3-2-18

Grab Samples

Product Name: Low-Flow System

Date: 2018-03-02 12:32:02

Project Information:

Operator Name K. Minkara
Company Name Golder Associates
Project Name 1668496
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 364456
Turbidity Make/Model LaMotte 2020we

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 19 ft

Pump placement from TOC 19 ft

Well Information:

Well ID DGWC-69
Well diameter 2 in
Well Total Depth 24.08 ft
Screen Length 10 ft
Depth to Water 5.54 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.1748051 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 17.64 in
Total Volume Pumped 3.75 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 10
Last 5	12:10:08	300.10	17.94	6.28	119.60	7.62	6.41	1.13	96.91
Last 5	12:15:08	600.03	17.40	6.15	120.53	6.98	6.64	0.99	97.14
Last 5	12:20:08	900.02	17.31	6.13	120.33	6.05	6.85	0.94	97.40
Last 5	12:25:08	1199.89	17.40	6.12	120.01	4.42	6.97	0.89	96.74
Last 5	12:30:08	1499.89	17.45	6.10	119.44	3.44	7.01	0.84	97.42
Variance 0			-0.09	-0.02	-0.19			-0.04	0.26
Variance 1			0.10	-0.00	-0.32			-0.06	-0.66
Variance 2			0.05	-0.02	-0.56			-0.04	0.68

Notes

Sampled DGWC-69 at 1230, 3-2-18.

Grab Samples

FIELD DATA FORMS

July 2018

Product Name: Low-Flow System

Date: 2018-07-12 08:46:03

Project Information:

Operator Name B. Hodges
Company Name Golder Associates
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 513028
Turbidity Make/Model LaMotte 2020we

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 26 ft

Pump placement from TOC 26 ft

Well Information:

Well ID DGWA-53
Well diameter 2 in
Well Total Depth 31.30 ft
Screen Length 10 ft
Depth to Water 9.85 ft

Pumping Information:

Final Pumping Rate 100 mL/min
Total System Volume 0.206049 L
Calculated Sample Rate 60 sec
Stabilization Drawdown 3.48 in
Total Volume Pumped 0.1 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 10
Last 5	08:44:27	60.03	24.29	6.33	388.06	27.60	10.14	0.72	-51.10
Last 5									
Last 5									
Last 5									
Last 5									
Variance 0			nan	nan	nan			nan	nan
Variance 1			0.00	0.00	0.00			0.00	0.00
Variance 2			0.00	0.00	0.00			0.00	0.00

Notes

Sampled filtered and total per Joju Abraham. Sampled after purging dry.

Grab Samples

Product Name: Low-Flow System

Date: 2018-07-10 11:02:19

Project Information:

Operator Name K. Minkara
Company Name Golder Associates
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 497259
Turbidity Make/Model LaMotte 2020we

Pump Information:

Pump Model/Type SamplePro
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 58 ft

Pump placement from TOC 58 ft

Well Information:

Well ID DGWA-70A
Well diameter 2 in
Well Total Depth 62.54 ft
Screen Length 10 ft
Depth to Water 39.9 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.4738785 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 8.4 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 10
Last 5	10:50:08	300.10	21.93	5.36	60.04	7.55	40.44	4.88	87.73
Last 5	10:55:08	600.03	20.29	5.41	60.38	5.51	40.57	4.83	85.19
Last 5	11:00:08	900.02	20.20	5.44	60.54	4.91	40.60	4.79	86.63
Last 5									
Last 5									
Variance 0			nan	nan	nan			nan	nan
Variance 1			-1.64	0.06	0.35			-0.05	-2.54
Variance 2			-0.09	0.03	0.15			-0.04	1.45

Notes

Sampled DGWA-70A at 1100

Grab Samples

Product Name: Low-Flow System

Date: 2018-07-10 09:42:24

Project Information:

Operator Name K. Minkara
Company Name Golder Associates
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 497259
Turbidity Make/Model LaMotte 2020we

Pump Information:

Pump Model/Type SamplePro
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 43 ft

Pump placement from TOC 43 ft

Well Information:

Well ID DGWA-71
Well diameter 2 in
Well Total Depth 47.79 ft
Screen Length 10 ft
Depth to Water 28.24 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.4069272 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 5.64 in
Total Volume Pumped 4 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 10
Last 5	09:25:09	300.11	20.10	5.67	78.80	3.83	28.62	1.02	88.89
Last 5	09:30:09	600.04	19.29	5.61	78.18	2.40	28.71	0.69	76.31
Last 5	09:35:09	900.03	19.28	5.62	77.14	2.68	28.71	0.57	75.06
Last 5	09:40:09	1200.03	19.13	5.63	76.29	2.22	28.71	0.63	75.18
Last 5									
Variance 0			-0.81	-0.06	-0.62			-0.32	-12.58
Variance 1			-0.01	0.01	-1.04			-0.12	-1.25
Variance 2			-0.15	0.02	-0.85			0.05	0.12

Notes

Sampled DGWA-71 at 0940

Grab Samples

Product Name: Low-Flow System

Date: 2018-07-12 13:37:44

Project Information:

Operator Name K. Minkara
Company Name Golder Associates
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 497259
Turbidity Make/Model LaMotte 2020we

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 38 ft

Pump placement from TOC 38 ft

Well Information:

Well ID DGWC-37
Well diameter 2 in
Well Total Depth 43.08 ft
Screen Length 10 ft
Depth to Water 13.48 ft

Pumping Information:

Final Pumping Rate 120 mL/min
Total System Volume 0.2596101 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 1.92 in
Total Volume Pumped 4.2 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 10
Last 5	13:14:06	900.02	26.52	6.35	435.18	11.28	13.64	1.10	109.77
Last 5	13:19:06	1200.00	25.88	6.43	438.33	7.39	13.64	1.79	109.35
Last 5	13:24:06	1500.00	25.43	6.43	435.93	4.52	13.64	0.78	109.58
Last 5	13:29:07	1801.00	25.28	6.44	432.57	3.18	13.64	0.79	110.03
Last 5	13:34:08	2101.99	25.49	6.43	434.43	4.12	13.64	0.85	109.85
Variance 0			-0.45	0.00	-2.40			-1.01	0.23
Variance 1			-0.16	0.01	-3.37			0.01	0.45
Variance 2			0.21	-0.00	1.86			0.06	-0.18

Notes

Yellow/orange particulates observed in tubing during initial 10min of purge (disconnected from SmarTroll). Sampled DGWC-37 at 1335

Grab Samples

Product Name: Low-Flow System

Date: 2018-07-12 13:41:20

Project Information:

Operator Name B. Hodges
Company Name Golder Associates
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 513028
Turbidity Make/Model LaMotte 2020we

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 23 ft

Pump placement from TOC 23 ft

Well Information:

Well ID DGWC-38
Well diameter 2 in
Well Total Depth 28.00 ft
Screen Length 10 ft
Depth to Water 6.72 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.1926587 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 3.36 in
Total Volume Pumped 5 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 10
Last 5	13:20:02	300.15	25.30	6.08	649.01	2.46	6.98	0.21	33.05
Last 5	13:25:02	600.02	24.30	6.05	662.36	3.40	6.99	0.15	35.85
Last 5	13:30:02	900.02	23.78	6.05	661.73	1.19	7.00	0.13	38.70
Last 5	13:35:02	1200.02	23.61	6.05	659.90	0.34	7.00	0.12	41.23
Last 5	13:40:03	1501.02	23.78	6.05	664.89	0.21	7.00	0.11	42.83
Variance 0			-0.52	-0.00	-0.62			-0.02	2.86
Variance 1			-0.18	0.00	-1.83			-0.01	2.53
Variance 2			0.18	-0.00	4.99			-0.01	1.60

Notes

Sampled at 1340 w FD-3

Grab Samples

Product Name: Low-Flow System

Date: 2018-07-12 11:30:47

Project Information:

Operator Name B. Hodges
Company Name Golder Associates
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 513028
Turbidity Make/Model LaMotte 2020we

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 20 ft

Pump placement from TOC 20 ft

Well Information:

Well ID DGWC-39
Well diameter 2 in
Well Total Depth 24.65 ft
Screen Length 10 ft
Depth to Water 7.16 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.1792685 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 12.96 in
Total Volume Pumped 5 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 10
Last 5	11:09:24	300.02	23.07	6.34	713.70	3.96	7.90	0.29	-24.50
Last 5	11:14:24	600.02	21.63	6.39	722.44	1.24	8.02	0.20	-35.99
Last 5	11:19:24	900.02	21.61	6.43	724.84	0.78	8.11	0.16	-42.20
Last 5	11:24:24	1200.02	21.39	6.44	720.19	0.32	8.16	0.13	-44.78
Last 5	11:29:24	1500.02	21.57	6.45	723.77	0.83	8.18	0.11	-47.11
Variance 0			-0.02	0.03	2.41			-0.04	-6.21
Variance 1			-0.22	0.02	-4.65			-0.03	-2.59
Variance 2			0.17	0.01	3.58			-0.02	-2.33

Notes

Sampled at 1130

Grab Samples

Product Name: Low-Flow System

Date: 2018-07-12 12:42:56

Project Information:

Operator Name D. Thomas
Company Name Golder Associates
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463453
Turbidity Make/Model LaMotte 2020we

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 33 ft

Pump placement from TOC 33 ft

Well Information:

Well ID DGWC-40
Well diameter 2 in
Well Total Depth 38.40 ft
Screen Length 10 ft
Depth to Water 15.26 ft

Pumping Information:

Final Pumping Rate 120 mL/min
Total System Volume 0.237293 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 0.48 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 10
Last 5	12:20:56	300.04	23.89	4.66	521.68	1.14	15.30	2.13	124.56
Last 5	12:25:56	600.03	23.23	4.65	519.68	1.10	15.30	2.11	139.37
Last 5	12:30:56	900.03	23.40	4.62	524.68	0.81	15.30	2.20	153.62
Last 5	12:35:56	1200.02	23.64	4.64	524.49	0.94	15.30	2.20	166.80
Last 5	12:40:56	1500.02	23.51	4.63	523.29	0.87	15.30	2.21	179.31
Variance 0			0.17	-0.03	4.99			0.10	14.25
Variance 1			0.24	0.02	-0.19			-0.00	13.17
Variance 2			-0.13	-0.01	-1.20			0.01	12.51

Notes

Started purging at 1215
Stopped purging and began sampling at 1240

Grab Samples

Product Name: Low-Flow System

Date: 2018-07-13 08:24:28

Project Information:

Operator Name D. Thomas
Company Name Golder Associates
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463453
Turbidity Make/Model LaMotte 2020we

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 50 ft

Pump placement from TOC 50 ft

Well Information:

Well ID DGWC-67
Well diameter 2 in
Well Total Depth 55.5 ft
Screen Length 10 ft
Depth to Water 9.41 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.3131711 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 4.32 in
Total Volume Pumped 3.75 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 10
Last 5	08:02:30	300.05	19.91	6.17	402.74	1.34	9.74	0.66	87.72
Last 5	08:07:30	600.04	19.85	6.17	399.56	1.76	9.76	0.50	86.16
Last 5	08:12:30	900.03	19.81	6.19	398.11	1.51	9.76	0.39	84.93
Last 5	08:17:30	1200.03	19.80	6.19	395.93	1.62	9.76	0.30	85.52
Last 5	08:22:30	1500.06	19.72	6.19	394.48	1.68	9.76	0.25	86.48
Variance 0			-0.03	0.01	-1.45			-0.11	-1.22
Variance 1			-0.01	0.00	-2.18			-0.09	0.59
Variance 2			-0.08	0.00	-1.45			-0.05	0.96

Notes

Started purging at 0757
Stopped purging and began sampling at 0825

Grab Samples

Product Name: Low-Flow System

Date: 2018-07-13 08:17:02

Project Information:

Operator Name K. Minkara
Company Name Golder Associates
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 497259
Turbidity Make/Model LaMotte 2020we

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 25 ft

Pump placement from TOC 25 ft

Well Information:

Well ID DGWC-68A
Well diameter 2 in
Well Total Depth 29.8 ft
Screen Length 10 ft
Depth to Water 9.96 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.2015856 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 2.16 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 10
Last 5	08:00:09	300.10	21.57	6.65	427.36	2.41	10.13	0.49	110.19
Last 5	08:05:08	600.05	20.03	6.62	427.22	3.40	10.14	0.28	98.21
Last 5	08:10:08	900.04	19.99	6.62	424.52	2.80	10.14	0.24	95.97
Last 5	08:15:09	1201.02	19.73	6.62	424.40	2.39	10.14	0.21	94.49
Last 5									
Variance 0			-1.54	-0.03	-0.14			-0.21	-11.98
Variance 1			-0.04	-0.00	-2.70			-0.04	-2.24
Variance 2			-0.26	-0.00	-0.11			-0.03	-1.49

Notes

Sampled DGWC-68A at 0815

Grab Samples

Product Name: Low-Flow System

Date: 2018-07-13 08:23:37

Project Information:

Operator Name B. Hodges
Company Name Golder Associates
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 513028
Turbidity Make/Model LaMotte 2020we

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .17 in
Tubing Length 19 ft

Pump placement from TOC 19 ft

Well Information:

Well ID DGWC-69
Well diameter 2 in
Well Total Depth 24.04 ft
Screen Length 10 ft
Depth to Water 5.89 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.1748051 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 21 in
Total Volume Pumped 3.75 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 5		+/- 10%	+/- 10
Last 5	07:58:49	300.15	21.10	6.05	108.53	1.87	6.67	1.49	101.75
Last 5	08:03:49	600.02	20.18	5.96	109.21	1.32	7.21	1.48	100.17
Last 5	08:08:49	900.02	20.11	5.95	108.90	1.98	7.45	1.49	101.31
Last 5	08:13:49	1200.02	19.86	5.95	108.72	2.08	7.56	1.47	102.43
Last 5	08:18:49	1500.02	19.83	5.95	108.69	1.53	7.64	1.45	103.59
Variance 0			-0.07	-0.01	-0.30			0.01	1.14
Variance 1			-0.25	0.00	-0.18			-0.02	1.13
Variance 2			-0.03	-0.00	-0.04			-0.01	1.15

Notes

Sampled at 0820

Grab Samples

FIELD DATA FORMS

November 2018

Product Name: Low-Flow System

Date: 2018-11-07 08:51:53

Project Information:

Operator Name K. Minkara
Company Name Golder Associates
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463068
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 30 ft

Pump placement from TOC 30 ft

Well Information:

Well ID DGWA-53
Well diameter 2 in
Well Total Depth 35.78 ft
Screen Length 10 ft
Depth to Water 14.91 ft

Pumping Information:

Final Pumping Rate 100 mL/min
Total System Volume 0.2239027 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 35.28 in
Total Volume Pumped 3.5 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	08:29:23	1200.02	17.21	6.18	353.43	13.53	17.29	0.27	39.02
Last 5	08:34:25	1502.02	17.63	6.19	351.10	15.68	17.49	0.29	35.42
Last 5	08:39:25	1802.02	17.78	6.21	340.64	15.40	17.73	0.50	33.42
Last 5	08:44:25	2102.02	17.73	6.22	333.10	15.70	18.02	0.59	32.04
Last 5	08:49:25	2402.02	17.81	6.22	334.24	17.90	18.15	0.61	30.57
Variance 0			0.16	0.02	-10.46			0.21	-2.00
Variance 1			-0.06	0.01	-7.54			0.09	-1.37
Variance 2			0.08	0.00	1.14			0.02	-1.47

Notes

Sampled DGWA-53 at 0850. Final readings. Sampled for dissolved metals per Joju Abraham.

Grab Samples

Product Name: Low-Flow System

Date: 2018-11-06 12:33:10

Project Information:

Operator Name K. Minkara
Company Name Golder Associates
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463068
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type SamplePro
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 57 ft

Pump placement from TOC 57 ft

Well Information:

Well ID DGWA-70A
Well diameter 2 in
Well Total Depth 62.54 ft
Screen Length 10 ft
Depth to Water 40.89 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.4694151 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 8.4 in
Total Volume Pumped 4 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	12:15:12	300.95	17.99	5.96	67.11	10.03	41.45	4.78	16.62
Last 5	12:20:12	600.94	17.67	5.80	67.31	5.25	41.48	4.71	27.32
Last 5	12:25:12	900.94	17.59	5.75	67.09	4.49	41.57	4.55	33.02
Last 5	12:30:12	1200.94	17.53	5.71	67.17	3.17	41.59	4.40	38.78
Last 5									
Variance 0			-0.32	-0.16	0.20			-0.07	10.69
Variance 1			-0.08	-0.05	-0.22			-0.16	5.70
Variance 2			-0.06	-0.03	0.08			-0.14	5.76

Notes

Sampled DGWA-70A at 1230

Grab Samples

Product Name: Low-Flow System

Date: 2018-11-06 13:48:00

Project Information:

Operator Name K. Minkara
Company Name Golder Associates
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463068
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type SamplePro
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 43 ft

Pump placement from TOC 43 ft

Well Information:

Well ID DGWA-71
Well diameter 2 in
Well Total Depth 47.79 ft
Screen Length 10 ft
Depth to Water 29.17 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.4069272 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 4.32 in
Total Volume Pumped 4 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	13:31:16	300.02	18.57	5.83	78.25	8.28	29.51	0.84	42.62
Last 5	13:36:16	600.02	18.35	5.81	78.21	5.30	29.53	0.63	38.17
Last 5	13:41:16	900.02	18.38	5.79	78.48	3.03	29.53	0.55	37.25
Last 5	13:46:17	1201.02	18.44	5.79	78.77	2.38	29.53	0.59	36.17
Last 5									
Variance 0			-0.23	-0.02	-0.04			-0.22	-4.45
Variance 1			0.03	-0.02	0.27			-0.08	-0.92
Variance 2			0.06	-0.01	0.30			0.05	-1.07

Notes

Sampled DGWA-71 at 1345

Grab Samples

Product Name: Low-Flow System

Date: 2018-11-08 09:36:17

Project Information:

Operator Name D. Thomas
Company Name Golder
Project Name 166849618
Site Name McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 597519
Turbidity Make/Model

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .170 in
Tubing Length 38 ft

Pump placement from TOC 38 ft

Well Information:

Well ID DGWC-37
Well diameter 2 in
Well Total Depth 43.08 ft
Screen Length 10 ft
Depth to Water 13.38 ft

Pumping Information:

Final Pumping Rate 120 mL/min
Total System Volume 0.2596101 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 1.2 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	09:13:20	300.04	18.26	6.35	436.28	7.45	13.50	1.38	79.39
Last 5	09:18:20	600.04	18.26	6.41	0.00	10.32	13.50	8.59	75.35
Last 5	09:23:20	900.03	18.33	6.35	433.37	6.34	13.50	1.09	80.63
Last 5	09:28:20	1200.03	18.44	6.34	432.68	4.92	13.50	1.01	78.72
Last 5	09:33:21	1501.02	18.53	6.36	426.34	3.20	13.50	1.16	77.97
Variance 0			0.07	-0.06	433.37			-7.50	5.27
Variance 1			0.10	-0.00	-0.69			-0.09	-1.91
Variance 2			0.10	0.01	-6.34			0.15	-0.75

Notes

Started purging at 0908
Stopped purging and began sampling at 0935

Grab Samples

Product Name: Low-Flow System

Date: 2018-11-08 10:57:36

Project Information:

Operator Name C. Tidwell
Company Name Golder
Project Name 166849618
Site Name McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463453
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .170 in
Tubing Length 23 ft

Pump placement from TOC 23 ft

Well Information:

Well ID DGWC-38
Well diameter 2 in
Well Total Depth 28.00 ft
Screen Length 10 ft
Depth to Water 6.15 ft

Pumping Information:

Final Pumping Rate 145 mL/min
Total System Volume 0.1926587 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 1.2 in
Total Volume Pumped 4.2 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	10:34:40	300.02	18.84	6.09	651.95	2.69	6.26	0.33	56.16
Last 5	10:39:40	600.01	18.88	6.10	654.76	2.70	6.25	0.24	63.87
Last 5	10:44:40	899.99	18.89	6.11	656.14	3.79	6.25	0.19	70.29
Last 5	10:49:40	1200.00	18.91	6.10	653.39	1.75	6.26	0.16	76.24
Last 5	10:54:40	1500.04	18.96	6.07	651.21	1.11	6.25	0.15	82.02
Variance 0			0.01	0.01	1.38			-0.05	6.43
Variance 1			0.02	-0.01	-2.75			-0.03	5.95
Variance 2			0.05	-0.03	-2.18			-0.01	5.78

Notes

Grab Samples

Product Name: Low-Flow System

Date: 2018-11-08 09:48:18

Project Information:

Operator Name C. Tidwell
Company Name Golder
Project Name 166849618
Site Name McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463453
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .170 in
Tubing Length 19 ft

Pump placement from TOC 19 ft

Well Information:

Well ID DGWC-39
Well diameter 2 in
Well Total Depth 24.65 ft
Screen Length 10 ft
Depth to Water 7.29 ft

Pumping Information:

Final Pumping Rate 140 mL/min
Total System Volume 0.1748051 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 5.52 in
Total Volume Pumped 4.5 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	09:27:05	600.02	18.84	6.43	723.31	3.24	7.74	0.25	27.56
Last 5	09:32:05	900.03	18.95	6.45	722.86	9.20	7.74	0.22	18.36
Last 5	09:37:05	1200.02	18.90	6.47	724.74	1.99	7.75	0.20	12.13
Last 5	09:42:05	1500.02	18.97	6.48	764.46	4.58	7.75	0.20	7.58
Last 5	09:47:05	1800.00	18.97	6.49	723.60	4.58	7.75	0.19	3.87
Variance 0			-0.05	0.02	1.88			-0.01	-6.23
Variance 1			0.08	0.01	39.72			-0.01	-4.56
Variance 2			-0.00	0.01	-40.86			-0.01	-3.70

Notes

Grab Samples

Product Name: Low-Flow System

Date: 2018-11-08 08:07:29

Project Information:

Operator Name C. Tidwell
Company Name Golder
Project Name 166849618
Site Name McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463453
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .170 in
Tubing Length 33 ft

Pump placement from TOC 33 ft

Well Information:

Well ID DGWC-40
Well diameter 2 in
Well Total Depth 38.40 ft
Screen Length 10 ft
Depth to Water 17.78 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.237293 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 0.36 in
Total Volume Pumped 4.5 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	07:45:47	300.04	18.97	5.12	522.27	0.78	17.81	1.97	139.07
Last 5	07:50:47	600.03	18.96	4.88	519.41	0.63	17.81	1.62	136.83
Last 5	07:55:47	900.02	18.97	4.84	519.83	0.39	17.82	1.68	138.44
Last 5	08:00:47	1200.02	19.06	4.82	519.28	0.79	17.81	1.71	140.41
Last 5	08:05:47	1500.01	18.92	4.79	518.47	0.32	17.81	1.79	143.07
Variance 0			0.01	-0.04	0.42			0.05	1.61
Variance 1			0.09	-0.02	-0.55			0.03	1.97
Variance 2			-0.14	-0.02	-0.82			0.08	2.66

Notes

Grab Samples

Product Name: Low-Flow System

Date: 2018-11-08 11:00:04

Project Information:

Operator Name D. Thomas
Company Name Golder
Project Name 166849618
Site Name McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 597519
Turbidity Make/Model

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter .170 in
Tubing Length 50 ft

Pump placement from TOC 50 ft

Well Information:

Well ID DGWC-67
Well diameter 2 in
Well Total Depth 55.5 ft
Screen Length 10 ft
Depth to Water 9.30 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.3131711 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 4.8 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	10:43:18	300.04	19.06	6.25	398.80	1.58	9.65	0.53	90.13
Last 5	10:48:18	600.04	18.97	6.24	398.08	1.33	9.68	0.34	86.51
Last 5	10:53:18	900.04	18.95	6.24	397.10	1.49	9.70	0.24	83.73
Last 5	10:58:18	1200.03	18.86	6.23	395.81	1.69	9.70	0.20	81.88
Last 5									
Variance 0			-0.10	-0.01	-0.72			-0.19	-3.63
Variance 1			-0.02	-0.00	-0.98			-0.09	-2.77
Variance 2			-0.09	-0.00	-1.29			-0.05	-1.86

Notes

Started purging at 1038
Stopped purging and began sampling at 1100

Grab Samples

Product Name: Low-Flow System

Date: 2018-11-08 09:44:04

Project Information:

Operator Name K. Minkara
Company Name Golder Associates
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463068
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 25 ft

Pump placement from TOC 25 ft

Well Information:

Well ID DGWC-68A
Well diameter 2 in
Well Total Depth 29.8 ft
Screen Length 10 ft
Depth to Water 9.65 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.2015856 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 3 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	09:32:01	300.09	17.96	6.48	446.17	1.25	9.88	0.24	106.07
Last 5	09:37:01	600.02	17.95	6.50	445.18	1.27	9.89	0.16	106.33
Last 5	09:42:01	900.02	17.94	6.50	444.17	1.28	9.90	0.15	106.44
Last 5									
Variance 0			nan	nan	nan			nan	nan
Variance 1			-0.01	0.01	-0.99			-0.08	0.26
Variance 2			-0.01	0.00	-1.01			-0.01	0.10

Notes

Sampled DGWC-68A at 0940

Grab Samples

Product Name: Low-Flow System

Date: 2018-11-08 08:26:39

Project Information:

Operator Name K. Minkara
Company Name Golder Associates
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 463068
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 19 ft

Pump placement from TOC 19 ft

Well Information:

Well ID DGWC-69
Well diameter 2 in
Well Total Depth 24.04 ft
Screen Length 10 ft
Depth to Water 5.57 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.1748051 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 19.8 in
Total Volume Pumped 5 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	08:04:06	300.09	18.79	6.32	123.87	2.46	6.36	1.57	94.56
Last 5	08:09:06	600.02	19.15	6.05	121.49	1.15	6.84	1.46	95.15
Last 5	08:14:06	900.02	19.06	6.01	121.44	0.88	7.07	1.47	95.95
Last 5	08:19:06	1200.02	18.92	6.00	121.05	0.51	7.16	1.45	97.17
Last 5	08:24:06	1500.02	18.72	6.00	121.02	0.49	7.22	1.49	97.69
Variance 0			-0.09	-0.04	-0.05			0.01	0.80
Variance 1			-0.15	-0.02	-0.39			-0.02	1.22
Variance 2			-0.20	0.00	-0.03			0.04	0.53

Notes

Sampled DGWC-69 at 0825. FD-3 here

Grab Samples

FIELD DATA FORMS

March 2019

Product Name: Low-Flow System

Date: 2019-03-13 09:38:26

Project Information:

Operator Name K. Minkara
Company Name Golder
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 513028
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 30 ft

Pump placement from TOC 30 ft

Well Information:

Well ID DGWA-53
Well diameter 2 in
Well Total Depth 35.71 ft
Screen Length 10 ft
Depth to Water 12.63 ft

Pumping Information:

Final Pumping Rate 120 mL/min
Total System Volume 0.2239027 L
Calculated Sample Rate 30 sec
Stabilization Drawdown 0 in
Total Volume Pumped 0 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	09:36:50	30.11	15.03	6.00	374.13	9.91	12.63	0.55	89.23
Last 5	09:37:20	60.03	15.03	6.02	374.88	--	--	0.49	86.16
Last 5									
Last 5									
Variance 0			nan	nan	nan			nan	nan
Variance 1			-0.00	0.02	0.75			-0.06	-3.07
Variance 2			0.00	0.00	0.00			0.00	0.00

Notes

Purged dry 3-12-19. Sampled at 0935

Grab Samples

Product Name: Low-Flow System

Date: 2019-03-12 11:30:02

Project Information:

Operator Name D. Thomas
Company Name Golder
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 501336
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type SamplePro
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 57 ft

Pump placement from TOC 57 ft

Well Information:

Well ID DGWA-70A
Well diameter 2 in
Well Total Depth 62.54 ft
Screen Length 10 ft
Depth to Water 36.62 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.4694151 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 1.2 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	11:15:46	300.08	18.11	5.51	61.85	2.85	37.20	5.12	130.22
Last 5	11:20:46	600.03	18.07	5.50	62.55	2.51	37.21	5.22	126.90
Last 5	11:25:46	900.02	18.11	5.52	63.30	1.93	37.21	5.31	127.83
Last 5									
Variance 0			nan	nan	nan			nan	nan
Variance 1			-0.04	-0.01	0.70			0.09	-3.33
Variance 2			0.04	0.02	0.75			0.10	0.94

Notes

Started purging at DGWA-70A
Sampled at 1125

Grab Samples

Product Name: Low-Flow System

Date: 2019-03-12 12:57:11

Project Information:

Operator Name D. Thomas
Company Name Golder
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 501336
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type SamplePro
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 43 ft

Pump placement from TOC 43 ft

Well Information:

Well ID DGWA-71
Well diameter 2 in
Well Total Depth 47.79 ft
Screen Length 10 ft
Depth to Water 26.20 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.4069272 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 4.8 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	12:43:26	300.04	18.07	5.76	78.38	3.17	26.60	0.51	91.64
Last 5	12:48:26	600.02	17.98	5.78	78.35	2.86	26.62	0.42	90.69
Last 5	12:53:26	900.03	17.96	5.74	78.40	2.71	26.60	0.39	92.63
Last 5									
Last 5									
Variance 0			nan	nan	nan			nan	nan
Variance 1			-0.09	0.02	-0.03			-0.09	-0.94
Variance 2			-0.02	-0.04	0.05			-0.04	1.93

Notes

Started purging at 1238
Stopped purging and began sampling

Grab Samples

Product Name: Low-Flow System

Date: 2019-03-13 10:07:41

Project Information:

Operator Name C. Tidwell
Company Name Golder
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 613229
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 38 ft

Pump placement from TOC 38 ft

Well Information:

Well ID DGWC-37
Well diameter 2 in
Well Total Depth 43.08 ft
Screen Length 10 ft
Depth to Water 12.71 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.2596101 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 1.4 in
Total Volume Pumped 6 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	09:45:11	600.02	15.84	6.22	466.92	0.94	12.82	0.63	81.24
Last 5	09:50:11	900.02	15.89	6.23	445.83	0.75	12.83	0.88	77.48
Last 5	09:55:11	1200.02	15.88	6.24	446.28	0.29	12.82	0.88	75.50
Last 5	10:00:11	1500.02	16.02	6.24	442.90	0.55	12.83	0.91	74.43
Last 5	10:05:11	1800.02	15.84	6.26	438.90	0.30	12.83	0.95	73.03
Variance 0			-0.00	0.00	0.45			0.00	-1.99
Variance 1			0.14	0.00	-3.39			0.04	-1.07
Variance 2			-0.18	0.02	-4.00			0.03	-1.40

Notes

Grab Samples

Product Name: Low-Flow System

Date: 2019-03-13 13:23:27

Project Information:

Operator Name D. Thomas
Company Name Golder
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 501336
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 23 ft

Pump placement from TOC 23 ft

Well Information:

Well ID DGWC-38
Well diameter 2 in
Well Total Depth 28 ft
Screen Length 10 ft
Depth to Water 4.42 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.1926587 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 2.5 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	13:06:06	300.03	18.11	6.11	669.72	1.09	4.61	0.28	52.19
Last 5	13:11:06	600.03	18.18	6.07	673.92	0.78	4.61	0.22	52.38
Last 5	13:16:06	900.02	18.16	6.05	672.02	0.60	4.62	0.19	53.80
Last 5	13:21:06	1200.02	18.07	6.05	673.55	1.22	4.62	0.17	54.65
Last 5									
Variance 0			0.08	-0.04	4.20			-0.06	0.20
Variance 1			-0.02	-0.02	-1.90			-0.03	1.41
Variance 2			-0.09	-0.01	1.53			-0.02	0.85

Notes

Started purging at 1301
Stopped purging and began sampling at 1321

Grab Samples

Product Name: Low-Flow System

Date: 2019-03-13 10:42:48

Project Information:

Operator Name D. Thomas
Company Name Golder
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 501336
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 19 ft

Pump placement from TOC 19 ft

Well Information:

Well ID DGWC-39
Well diameter 2 in
Well Total Depth 24.65 ft
Screen Length 10 ft
Depth to Water 4.70 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.1748051 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 11.4 in
Total Volume Pumped 8.25 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	10:15:35	2100.02	15.66	6.26	781.04	7.30	5.65	0.15	21.58
Last 5	10:20:35	2400.02	15.65	6.26	781.29	5.82	5.65	0.14	19.90
Last 5	10:25:35	2700.02	15.68	6.26	783.62	8.00	5.65	0.13	18.07
Last 5	10:30:35	3000.01	15.79	6.27	781.62	7.51	5.65	0.13	16.24
Last 5	10:35:35	3300.01	16.00	6.28	780.47	4.98	5.65	0.13	14.44
Variance 0			0.03	0.00	2.33			-0.00	-1.83
Variance 1			0.11	0.01	-2.00			-0.01	-1.83
Variance 2			0.21	0.01	-1.15			0.00	-1.80

Notes

Started purging at 0940
Stopped purging and began sampling

Grab Samples

Product Name: Low-Flow System

Date: 2019-03-13 14:43:33

Project Information:

Operator Name D. Thomas
Company Name Golder
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 501336
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 33 ft

Pump placement from TOC 33 ft

Well Information:

Well ID DGWC-40
Well diameter 2 in
Well Total Depth 38.40 ft
Screen Length 10 ft
Depth to Water 14.85 ft

Pumping Information:

Final Pumping Rate 150 mL/min
Total System Volume 0.237293 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 1.08 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	14:25:01	300.06	20.58	4.77	509.59	0.50	14.93	3.31	122.68
Last 5	14:30:01	600.03	20.67	4.68	510.09	0.42	14.94	3.22	130.41
Last 5	14:35:01	900.02	20.84	4.60	512.04	0.42	14.94	3.20	136.86
Last 5	14:40:01	1200.02	20.79	4.60	510.22	0.38	14.94	3.14	142.18
Last 5									
Variance 0			0.08	-0.09	0.49			-0.09	7.73
Variance 1			0.17	-0.08	1.95			-0.02	6.45
Variance 2			-0.05	-0.00	-1.82			-0.06	5.32

Notes

Started purging at 1420
Stopped purging and began sampling at 1440

Grab Samples

Product Name: Low-Flow System

Date: 2019-03-13 11:22:19

Project Information:

Operator Name C. Tidwell
Company Name Golder
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 613229
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 50.5 ft

Pump placement from TOC 50.5 ft

Well Information:

Well ID DGWC-67
Well diameter 2 in
Well Total Depth 55.5 ft
Screen Length 10 ft
Depth to Water 8.99 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.3154029 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 4.7 in
Total Volume Pumped 6 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	11:00:28	600.02	16.92	6.19	409.34	9.27	9.33	0.19	76.77
Last 5	11:05:28	900.02	17.05	6.19	408.49	5.28	9.36	0.14	75.68
Last 5	11:10:29	1200.43	17.32	6.18	407.17	4.96	9.38	0.11	74.92
Last 5	11:15:29	1500.43	17.80	6.18	405.12	4.67	9.38	0.09	74.08
Last 5	11:20:29	1800.43	18.07	6.19	403.46	4.19	9.38	0.07	73.31
Variance 0			0.27	-0.01	-1.32			-0.03	-0.76
Variance 1			0.48	0.00	-2.05			-0.02	-0.84
Variance 2			0.28	0.01	-1.66			-0.02	-0.77

Notes

Grab Samples

Product Name: Low-Flow System

Date: 2019-03-13 13:22:47

Project Information:

Operator Name K. Minkara
Company Name Golder
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 513028
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 25 ft

Pump placement from TOC 25 ft

Well Information:

Well ID DGWC-68A
Well diameter 2 in
Well Total Depth 29.79 ft
Screen Length 10 ft
Depth to Water 9.59 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.2015856 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 2.88 in
Total Volume Pumped 3 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	13:10:06	300.03	19.19	6.50	423.03	2.34	9.80	0.35	78.92
Last 5	13:15:07	600.67	18.26	6.55	429.93	1.15	9.82	0.17	79.37
Last 5	13:20:07	900.67	18.16	6.57	430.07	1.45	9.83	0.12	79.28
Last 5									
Variance 0			nan	nan	nan			nan	nan
Variance 1			-0.92	0.05	6.90			-0.17	0.44
Variance 2			-0.10	0.02	0.14			-0.05	-0.09

Notes

Sampled DGWC-68A at 1320

Grab Samples

Product Name: Low-Flow System

Date: 2019-03-13 11:33:42

Project Information:

Operator Name K. Minkara
Company Name Golder
Project Name 166849618
Site Name Plant McDonough
Latitude 0° 0' 0"
Longitude 0° 0' 0"
Sonde SN 513028
Turbidity Make/Model LaMotte

Pump Information:

Pump Model/Type Alexis
Tubing Type polyethylene
Tubing Diameter 0.170 in
Tubing Length 19 ft

Pump placement from TOC 19 ft

Well Information:

Well ID DGWC-69
Well diameter 2 in
Well Total Depth 24.03 ft
Screen Length 10 ft
Depth to Water 5.27 ft

Pumping Information:

Final Pumping Rate 200 mL/min
Total System Volume 0.1748051 L
Calculated Sample Rate 300 sec
Stabilization Drawdown 16.92 in
Total Volume Pumped 4 L

Low-Flow Sampling Stabilization Summary

	Time	Elapsed	Temp C	pH	SpCond μ S/cm	Turb NTU	DTW ft	RDO mg/L	ORP mV
Stabilization			+/- 0.5	+/- 0.1	+/- 5%	+/- 10		+/- 10%	+/- 10
Last 5	11:15:31	300.08	16.20	6.21	115.01	3.92	6.04	2.94	69.07
Last 5	11:20:31	600.02	16.65	6.12	114.22	3.15	6.40	2.75	69.81
Last 5	11:25:31	900.02	16.74	6.10	113.73	1.91	6.60	2.62	71.26
Last 5	11:30:31	1200.02	17.00	6.08	113.38	2.44	6.68	2.56	72.59
Last 5									
Variance 0			0.45	-0.09	-0.78			-0.18	0.74
Variance 1			0.09	-0.03	-0.50			-0.13	1.44
Variance 2			0.26	-0.01	-0.35			-0.06	1.33

Notes

FD-3 here. DGWC-69 sampled at 1130

Grab Samples

LEVEL 2A LABORATORY DATA VALIDATIONS

August 2016 – November 2018

**Stage 2A Data Verification Report
Georgia Power
McDonough Fossil Plant
Site Ash Pond
Coal Combustion Residuals Project
Groundwater Samples**

This quality assurance (QA) review is based upon an examination of the data generated from the analyses of the 239 groundwater samples collected as part of the eight rounds of 2016-2018 baseline monitoring, at the Georgia Power McDonough Fossil Plant facility. These samples were collectively analyzed by Pace Analytical Services, Inc. (Pace), of Peachtree Corners, Georgia, or Asheville, North Carolina, for total metals by SW-846 Method 6020B; for total mercury by SW-846 Method 7470A; for total dissolved solids (TDS) by Standard Methods (SM) 2540C; and for anions (specifically, chloride, fluoride, and sulfate) by US EPA Method 300.0. In addition, these samples were collectively analyzed by Pace of Greensburg, Pennsylvania, for total radium-226 by SW-846 Method 9315, for total radium-228 by SW-846 Method 9320, and for combined radium-226+228 by calculation.

This review was performed with guidance from the US EPA Region IV Environmental Investigations Standard Operating Procedures and Quality Assurance Manual (November 2001); the US EPA Region IV Data Validation Standard Operating Procedures (SOPs; US EPA Region IV, September 2011); and the applied analytical methods. These validation guidance documents, with the exception of the analytical methods, specifically address analyses performed in accordance with the Contract Laboratory Program (CLP) analytical methods and are not completely applicable to the type of analyses and analytical protocols performed for the SW-846, US EPA, and SM methods utilized by the laboratory for these samples. Environmental Standards, Inc. (Environmental Standards) used professional judgment to determine the usability of the analytical results and compliance relative to the SW-846, US EPA, and SM methods utilized by the laboratory.

Summary

The analytical results and associated laboratory quality control (QC) samples were reviewed to determine the integrity of the reported analytical results and to verify that the data met the established data quality objectives.

The following sampling events were evaluated as part of this QA review: Event 1, collected 8/30/2016 through 4/12/2017; Event 2, collected 12/6/2016 through 12/8/2016; Event 3, collected 3/28/2017 through 7/13/2017; Event 4, collected 7/11/2017 through 7/13/2017; Event 5, collected 10/24/2017 through 11/15/2017; Event 6, collected 2/28/2018 through 3/8/2018; Event 7, collected 7/10/2018 through 7/13/2018; Event 8, collected 11/6/2018 through 11/8/2018; a catch-up event, collected 5/11/2017, 5/12/2017, 5/15/2017, 6/15/2017, 6/16/2017, and 8/8/2017.

The following samples were evaluated as part of this QA review: DGWA-2, DGWA-53, DGWA-53 Filtered, DGWA-71, DGWC-4, DGWC-23, DGWC-67, DGWC-68A, DGWC-69, DGWA-70A, DGWA-9, DGWA-8, DGWC-5, DGWC-10, DGWC-11, DGWC-14, DGWC-12, DGWC-48, DGWC-19, DGWC-47, DGWC-20, DGWC-21, DGWC-22, DGWC-40, DGWC-13, DGWC-15, DGWC-17, DGWC-42, DGWC-37, DGWC-38, DGWC-39, DGWC-68, and DGWA-70.

The following Pace inorganic SDGs were evaluated as part of this QA review: AAE0439, AAE0482, AAE0498, AAF0649, AAH0318, AZH0942, AZI0006, AZI0051, AZI0088, AZI0168, AZI0192, AZI0227, AZL0284, AZL0383, AZL0437, AAC0995, AAC1051, AAC1096, AAC1126, AAD0425, AAG0277, AAG0338, AAG0388, AAJ0865, AAJ0905, AAJ0956, AAK0586, 262357, 262423, 262659, 266979, 267056, 267122, 267125, 2611269, 2611272, 2611388, 2611389, 2611391, and 2611393.

The following Pace radiological SDGs were evaluated as part of this QA review: 30218862, 30218988, 30219104, 30222152, 30226784, 30194832, 30195003, 30195126, 30195121, 30195376, 30195375, 30195546, 30204841, 30205162, 30205165, 30214647, 30214947, 30214952, 30215074, 30224002, 30224181, 30224380, 30234155, 30234319, 30234467, 30236435, 262357, 262423, 262659, 266980, 267057, 267124, 267126, 2611270, 2611273, 2611390, 2611392, and 2611395.

All data are considered usable as reported, or usable after integration of data validation qualifications.

Inorganic and Radiological Data Review

Data validation was performed for these samples based on the sample results, summary QC data, and raw data provided by the laboratory. The findings offered in this report for the inorganic analyses are based upon a review of the following QC measures:

- Sample condition upon laboratory receipt
- Chain-of-Custody (COC) Records
- Blank analysis results
- Laboratory control sample/laboratory control sample duplicate (LCS/LCSD) recoveries and precision
- Laboratory duplicate precision
- Total vs. dissolved results
- Sample holding times
- Case Narratives
- Chemical yield
- Matrix spike/matrix spike duplicate (MS/MSD) recoveries and precision
- Field duplicate precision

The above QC measures were evaluated against the analytical method requirements and QC acceptance criteria. The data were validated based on guidance from the US EPA Region IV Data Validation SOPs, the referenced procedures, and were qualified as appropriate as described in the sections below.

Comments and Exceptions

1. In the metals fraction, the laboratory did not report a set number of significant figures for results < 0.1 mg/L. All results that were < 0.1 mg/L were reported to four decimal places. As a result, reported sample results ranged from one to three significant figures. In addition, the anions results < 1 mg/L were reported to two decimal places, which led to sample results with one to two significant figures.
2. The data validator applied qualification to combined radium-226+228 based upon the QC samples associated with the analyses of the individual isotopes, radium-226 and radium-228. The electronic data deliverable (EDD) and the database only include the laboratory results for the combined radium-226+228; therefore, qualification of the individual isotopes is not addressed in this QA review.
3. SW-846 Method 9315 includes all alpha-emitting isotopes of radium. In order to analyze for only radium-226, a 21-day ingrowth period must be used. The radium-226 reported by the laboratory did not undergo a 21-day ingrowth; therefore, the results reported as radium-226 potentially contain additional alpha-emitting radium isotopes and could be high biased.
4. Combined radium-226+228 was reported as the summation of the calculated activities for radium-226 and radium-228. As consistent with routine radiological reporting conventions, negative activities were reported for the radium-226 and radium-228 analyses; however, all negative activities were entered as zero in the calculation of combined radium-226+228 activity.

5. The combined radium-226+228 sample-specific minimum detectable concentration (MDC) was reported as the summation of the MDCs for radium-226 and radium-228. Consequently, there may be instances where a detection was observed in one of the individual isotopes but the combined radium-226+228 result was reported as “not-detected” due to the laboratory’s reporting convention for combined radium-226+228.
6. The combined radium-226+228 result uncertainty was reported as the summation of the calculated uncertainties for radium-226 and radium-228. If routine statistical uncertainty reporting conventions were followed, the result uncertainty would have been reported as the root sum square (RSS; the square root of the sum of the squared individual uncertainties).
7. The laboratory did not flag results < the MDC as “not-detected” in the data package provided. The data validator qualified these samples as “U” on the data tables.
8. In the majority of SDGs, the laboratory did not provide a Case Narrative associated with the metals and general chemistry or radium analyses. As this item was not needed to complete the data validation, the laboratory had not been requested to provide this information. Qualification of data due to this issue was not warranted.
9. In SDG 30195375, the laboratory indicated that sample containers did not include the collection time for sample DGWC-17, the laboratory logged in the collection time based on the COC record. Qualification of data due to this issue was not warranted.
10. In SDG AZL0383, the COC record indicated that sample DGWC-14, sampled on 12/7/2016, had not been received. Per communication with the consultant, the laboratory determined this sample had been sampled on 12/6/2016, was received by the laboratory on 12/7/2016 and had been included in SDG AZL0284. Qualification of data due to this issue was not warranted.
11. The sample IDs DGWA-8 and DGWA-9 in sampling Events 1 and 2 had changed to DGWC-8 and DGWC-9 in the remaining sampling events. Notification of prior knowledge of this sample ID change had not been provided to Environmental Standards; therefore, the Southern Company point of contact had been notified of this sample ID change on 1/31/2019. Qualification of data due to this issue was not warranted.
12. In SDGs 30194832, 30195003, 30195126, 30195121, 30195376, 30195375, and 30195546, the laboratory did not provide the subcontracted COC record for transfer of the samples from Pace Atlanta to Pace Pittsburgh. As these items were not needed to complete the data validation, the laboratory had not been requested to provide this information. Qualification of data due to this issue was not warranted.
13. In SDGs 262357, 262423, and 262659, the laboratory did not provide the subcontracted COC record or Sample Login Receipt Checklist for transfer of the samples from Pace Atlanta to Pace Asheville. As these items were not needed to complete the data validation, the laboratory had not been requested to provide this information. Qualification of data due to this issue was not warranted.
14. In SDGs 262357, 262423, 262659, 266980, 267057, 267124, 267126, 2611270, 2611273, 2611390, 2611392, and 2611395, the laboratory did not provide the

- subcontracted COC record or Sample Login Receipt Checklist for transfer of the samples from Pace Atlanta to Pace Pittsburgh. As these items were not needed to complete the data validation, the laboratory had not been requested to provide this information. Qualification of data due to this issue was not warranted.
15. In SDGs 30234155, 30234319, 30234467, and 30236435, the laboratory did not provide the COC record associated with the initial sample shipment to Pace Atlanta. As these items were provided in the associated inorganic data package, they were not needed to complete the data validation. The laboratory had not been requested to provide this information. Qualification of data due to this issue was not warranted.
 16. In SDGs 30218862, 30218988, 30219104, 30222152, 30194832, 30195003, 30195126, 30195121, 30195376, 30195375, 30195546, 30204841, 30205162, 30205165, 30214647, 30214947, 30214952, 30215074, and 30224002, the laboratory did not provide the Sample Login Receipt Checklist from Pace Atlanta. As these items were not needed to complete the data validation, the laboratory had not been requested to provide this information. Qualification of data due to this issue was not warranted.
 17. In SDGs 30204841, 30205162, and 30205165, Pace Atlanta did not relinquish the samples to Pace Pittsburgh on the subcontracted COC record. As these items were not needed to complete the data validation, the laboratory had not been requested to provide this information. Qualification of data due to this issue was not warranted.
 18. In SDG 267057, the Sample Login Receipt Checklist indicated that two radium sample containers labeled DGWC-18 were logged in with sample ID DGWC-15, based upon the laboratory's comparison of collection date and time between the bottle labels and the COC record and the inorganic containers in the same shipment having identical collection dates and times with the sample ID DGWC-15. Qualification of data due to this issue as not warranted.
 19. In SDG AAE0498, the Login Sample Receipt Checklist indicated that the samples were received at temperatures $> 6^{\circ}\text{C}$. Samples to be analyzed for anions and TDS require thermal preservation at a temperature $\leq 6^{\circ}\text{C}$; however, the samples that were received at a temperature $> 6^{\circ}\text{C}$ had been received at the laboratory within 8 hours of sample collection while the cooling process had already begun. Qualification of data due to this issue was not warranted.
 20. In the anion fraction of SDG AZL0437, the laboratory performed matrix QC (MS/MSD) analyses on an associated equipment blank. Matrix QC analyses are performed to evaluate the impact of matrix interferences on target analyte results in investigative samples, which would not be present in an equipment blank sample. The data reviewer evaluated the MS/MSD analyses performed on the equipment blank, applying the evaluation technique and acceptance criteria established for LCS/LCSD analyses.
 21. The data package for the radium analyses in SDG 30195003 did not include Quality Control Sample Performance Assessment summaries for the analytical batches associated with sample DGWC-14. The summaries had been requested from the laboratory but had not been received at the time of report finalization. Laboratory analytical accuracy and precision could not be evaluated for radium-226 and radium-228 in the associated sample.

22. The following field duplicate pairs (see table) were submitted and analyzed for inorganic and radiological parameters with this data set. Acceptable precision and sample representativeness (the relative percent difference [RPD] between results was $\leq 20\%$ when both results were $\geq 5\times$ the reporting limit [RL], the difference between results was \leq the RL when at least one result was $< 5\times$ the RL, or replicate error ratio [RER] < 3) were demonstrated by the reported results in the field duplicate pair evaluation with the exception of the parameters indicated in the Overall Assessment of Data Section below.

<u>Laboratory SDG(s)</u>	<u>Sample</u>	<u>Field Duplicate</u>
AAF0649 30222152	DGWA-2	FD-1
AAE0482 30218988	DGWA-71	FD-1
AAH0318 30226784	DGWA-70A	FD-1
AZI0006 30195003	DGWC-14	FD-1
AZI0051 30195126	DGWC-48	FD-2
AZI0227 30195546	DGWC-38	FD-3
AZL0383 30205162	DGWC-12	FD-1
AZL0383 30205162	DGWC-19	FD-2
AZL0437 30205165	DGWC-21	FD-3
AAC1051 30214947	DGWC-10	FD-1
AAC1096 30214952	DGWC-40	FD-3
AAC1126 30215074	DGWC-47	FD-3
AAG0277 30224002	DGWA-70A	FD-1
AAG0338 30224181	DGWC-14	FD-2
AAG0388 30224380	DGWC-42	FD-3
AAJ0865 30234155	DGWC-8	FD-1

<u>Laboratory SDG(s)</u>	<u>Sample</u>	<u>Field Duplicate</u>
AAJ0905 30234319	DGWC-12	FD-2
AAJ0956 30234467	DGWC-67	FD-3
262357	DGWC-17	FD-2
262423	DGWC-37	FD-3
266979 266980	DGWC-11	FD-1
267056 267057	DGWC-9	FD-2
267122 267124	DGWC-38	FD-3
2611269 2611270	DGWC-9	FD-1
2611389 2611390	DGWC-17	FD-2
2611393 2611395	DGWC-69	FD-3



Overall Assessment of Data

Based on a review of the data, qualification of data was warranted as noted below.

<u>Laboratory SDG(s)</u>	<u>Event</u>	<u>Sample(s)</u>	<u>Analyte(s)</u>	<u>Qualifier(s)</u>	<u>Reason(s) for Qualification</u>
AAE0439	catch up	DGWA-2	mercury	U*	BL – Method blank contamination BE – Equipment blank contamination
AAE0482	catch up	DGWA-71, DGWC-4, and DGWC-23	mercury	U*	BL – Method blank contamination BE – Equipment blank contamination
AAF0649	catch up	DGWA-2, DGWA-53, DGWC-4, DGWC-23, DGWC-67, DGWC-68A, DGWA-71, and DGWC-69	antimony and mercury	U*	BL – Method blank contamination BF – Field blank contamination BE – Equipment blank contamination
AAF0649	catch up	DGWA-70A	mercury	U*	BL – Method blank contamination BF – Field blank contamination BE – Equipment blank contamination
30226784	catch up	DGWA-70A	combined radium-226+228	U*	BL – Method blank contamination BF – Field blank contamination
AAE0439	catch up	DGWA-2	chromium	U*	BF – Field blank contamination BE – Equipment blank contamination
AAE0482	catch up	DGWA-71, DGWC-23, and DGWC-67	chromium	U*	BF – Field blank contamination BE – Equipment blank contamination
AAE0498	catch up	DGWA-70A	chromium	U*	BF – Field blank contamination BE – Equipment blank contamination
AAE0439	catch up	DGWA-2	lead	U*	BE – Equipment blank contamination
AAE0482	catch up	DGWA-71, DGWC-67, and DGWC-69	lead	U*	BE – Equipment blank contamination

<u>Laboratory SDG(s)</u>	<u>Event</u>	<u>Sample(s)</u>	<u>Analyte(s)</u>	<u>Qualifier(s)</u>	<u>Reason(s) for Qualification</u>
AAE0498	catch up	DGWA-70A	lead	U*	BE – Equipment blank contamination
AAH0318	catch up	DGWA-70A	lead	U*	BE – Equipment blank contamination
AZI0006	1	all samples	mercury	U*	BF – Field blank contamination BL – Method blank contamination
30195126	1	DGWC-12	combined radium-226+228	U*	BL – Method blank contamination
AZH0942	1	DGWA-8	mercury	U*	BF – Field blank contamination
AZI0051	1	DGWC-12 and DGWC-19	mercury	U*	BF – Field blank contamination
AZI0088	1	DGWC-21, DGWC-22, and DGWC-40	mercury	U*	BF – Field blank contamination
30195375	1	DGWC-17	combined radium-226+228	U*	BF – Field blank contamination
AZL0284	2	all samples	mercury	U*	BF – Field blank contamination BE – Equipment blank contamination
30205165	2	DGWC-17	combined radium-226+228	U*	BF – Field blank contamination
AZL0437	2	DGWC-21, DGWC-22, and DGWC-42	fluoride	U*	BE – Equipment blank contamination
30205162	2	DGWC-15	combined radium-226+228	U*	BE – Equipment blank contamination
30205165	2	DGWC-17 and DGWC-40	combined radium-226+228	U*	BE – Equipment blank contamination
AAC0995	3	DGWC-5	mercury	U*	BF – Field blank contamination BE – Equipment blank contamination
AAC1051	3	all samples	mercury	U*	BF – Field blank contamination BE – Equipment blank contamination BL – Method blank contamination

<u>Laboratory SDG(s)</u>	<u>Event</u>	<u>Sample(s)</u>	<u>Analyte(s)</u>	<u>Qualifier(s)</u>	<u>Reason(s) for Qualification</u>
AAC1096	3	all samples	mercury	U*	BF – Field blank contamination BE – Equipment blank contamination BL – Method blank contamination
AAC1126	3	DGWC-42	mercury	U*	BF – Field blank contamination BE – Equipment blank contamination
AAC0995	3	DGWA-70, DGWC-4, and DGWC-9	chromium	U*	BF – Field blank contamination
AAC1051	3	DGWC-10 and DGWC-8	chromium	U*	BF – Field blank contamination
AAC1096	3	DGWA-2, DGWC-13, DGWC-15, DGWC-21, DGWC-40, and DGWC-23	chromium	U*	BF – Field blank contamination
AAC1126	3	DGWC-67, DGWC-42, and DGWC-47	chromium	U*	BF – Field blank contamination
30224380	4	DGWC-38	combined radium-226+228	U*	BF – Field blank contamination
30234155	5	DGWA-2 and DGWC-9	combined radium-226+228	U*	BL – Method blank contamination
AAJ0865	5	DGWA-70A and DGWA-71	boron	U*	BF – Field blank contamination
AAJ0905	5	DGWC-14	boron	U*	BF – Field blank contamination BE – Equipment blank contamination
262357	6	DGWC-17, DGWC-19, DGWC-42, and DGWC-22	arsenic	U*	BF – Field blank contamination BE – Equipment blank contamination
262423	6	DGWC-39	combined radium-226+228	U*	BF – Field blank contamination
262357	6	DGWC-13	boron	U*	BE – Equipment blank contamination

<u>Laboratory SDG(s)</u>	<u>Event</u>	<u>Sample(s)</u>	<u>Analyte(s)</u>	<u>Qualifier(s)</u>	<u>Reason(s) for Qualification</u>
266979	7	all samples	mercury	U*	BF – Field blank contamination BE – Equipment blank contamination BL – Method blank contamination
266979	7	DGWA-70A and DGWA-71	boron	U*	BF – Field blank contamination
267122	7	DGWA-53, DGWC-38, and DGWC-23	cadmium	U*	BF – Field blank contamination
267125	7	DGWC-68A	cadmium	U*	BF – Field blank contamination
266979	7	DGWA-70A	sulfate	U*	BE – Equipment blank contamination
266980	7	DGWC-4	combined radium-226+228	U*	BE – Equipment blank contamination
2611269	8	all samples, except DGWC-2	mercury	U*	BL – Method blank contamination
2611269	8	DGWC-4 and DGWC-11	beryllium	U*	BL – Method blank contamination
2611270	8	DGWC-2, DGWC-4, DGWC-9, DGWC-10, and DGWC-11	combined radium-226+228	U*	BL – Method blank contamination BF – Field blank contamination BE – Equipment blank contamination
2611269	8	all samples	mercury	U*	BF – Field blank contamination BE – Equipment blank contamination
2611272	8	DGWA-71	mercury	U*	BF – Field blank contamination BE – Equipment blank contamination
2611270	8	DGWC-5	combined radium-226+228	U*	BE – Equipment blank contamination
2611272	8	DGWA-70A and DGWA-71	boron	U*	BE – Equipment blank contamination
2611390	8	DGWC-19	combined radium-226+228	U*	BE – Equipment blank contamination BL – Method blank contamination

<u>Laboratory SDG(s)</u>	<u>Event</u>	<u>Sample(s)</u>	<u>Analyte(s)</u>	<u>Qualifier(s)</u>	<u>Reason(s) for Qualification</u>
2611389	8	DGWC-19 and DGWC-47	arsenic	U*	BE – Equipment blank contamination
2611389	8	DGWC-12, DGWC-13, DGWC-15, DGWC-21, and DGWC-22	beryllium	U*	BE – Equipment blank contamination
2611389	8	DGWC-12, DGWC-15, DGWC-19, DGWC-21, DGWC-22, DGWC-42, and DGWC-47	cadmium	U*	BE – Equipment blank contamination
2611389	8	DGWC-17	cobalt	U*	BE – Equipment blank contamination
2611389	8	DGWC-15, DGWC-19, DGWC-20, and DGWC-47	thallium	U*	BE – Equipment blank contamination
2611391	8	DGWA-53	arsenic	U*	BE – Equipment blank contamination
30195121	1	DGWC-22	combined radium-226+228	J	BL – Method blank contamination
30195376	1	DGWC-13	combined radium-226+228	J	BF – Field blank contamination
30205162	2	DGWC-13	combined radium-226+228	J	BE – Equipment blank contamination
30205165	2	DGWC-47 and DGWC-48	combined radium-226+228	J	BE – Equipment blank contamination
30224002	4	DGWC-4 and DGWC-5	combined radium-226+228	J	BF – Field blank contamination
30224181	4	DGWC-10	combined radium-226+228	J	BF – Field blank contamination BE – Equipment blank contamination
30224380	4	DGWC-48	combined radium-226+228	J	BF – Field blank contamination
30224002	4	DGWC-5	combined radium-226+228	J	BE – Equipment blank contamination
30234319	5	DGWC-22 and DGWC-42	combined radium-226+228	J	BE – Equipment blank contamination
30234467	5	DGWC-47 and DGWC-48	combined radium-226+228	J	BE – Equipment blank contamination
262659	6	DGWA-53	combined radium-226+228	J	BL – Method blank contamination

<u>Laboratory SDG(s)</u>	<u>Event</u>	<u>Sample(s)</u>	<u>Analyte(s)</u>	<u>Qualifier(s)</u>	<u>Reason(s) for Qualification</u>
262423	6	DGWC-47, DGWC-68A, and DGWC-48	combined radium-226+228	J	BF – Field blank contamination
262357	6	DGWC-15	combined radium-226+228	J	BE – Equipment blank contamination
267124	7	DGWC-47 and DGWC-48	combined radium-226+228	J	BL – Method blank contamination
266980	7	DGWC-10	combined radium-226+228	J	BE – Equipment blank contamination
2611390	8	DGWC-21	combined radium-226+228	J	BE – Equipment blank contamination BL – Method blank contamination
2611390	8	DGWC-23	combined radium-226+228	J	BF – Field blank contamination BE – Equipment blank contamination
30195003	1	DGWC-5, DGWC-10, and DGWC-11	combined radium-226+228	J	L+ – High LCS recovery
262423	6	DGWC-47, DGWC-39, and DGWC-68A	combined radium-226+228	J (unless previously flagged "U*")	L+ – High LCS recovery LP – LCS/LCSD imprecision
266980	7	DGWC-4 and DGWC-10	combined radium-226+228	J (unless previously flagged "U*")	L+ – High LCS recovery
30194832	1	all samples	combined radium-226+228	J/UJ	L- – Low LCS recovery
30204841	2	DGWA-8	combined radium-226+228	UJ	L- – Low LCS recovery
30205162	2	DGWC-12, DGWC-13, DGWC-15, DGWC-19, DGWC-20, and DGWC-37	combined radium-226+228	J/UJ	L- – Low LCS recovery
30224002	4	DGWC-9	combined radium-226+228	UJ	L- – Low LCS/LCSD recoveries
30224181	4	DGWC-13, DGWC-14, DGWC-15, DGWC-17, DGWC-19, DGWC-20, DGWC-21, and DGWC-23	combined radium-226+228	J/UJ	L- – Low LCS recovery

<u>Laboratory SDG(s)</u>	<u>Event</u>	<u>Sample(s)</u>	<u>Analyte(s)</u>	<u>Qualifier(s)</u>	<u>Reason(s) for Qualification</u>
30224380	4	DGWC-22, DGWC-37, DGWC-38, DGWC-39, DGWC-40, DGWC-42, DGWC-47, DGWC-48, and DGWC-67	combined radium-226+228	J/UJ (unless previously flagged "U*")	L- – Low LCS recovery
30234155	5	all samples	combined radium-226+228	J/UJ (unless previously flagged "U*")	L- – Low LCSD recovery
30234319	5	DGWC-5, DGWC-12, DGWC-14, DGWC-15, DGWC-17, DGWC-19, and DGWC-20	combined radium-226+228	J/UJ	L- – Low LCSD recovery
262357	6	DGWC-13, DGWC-15, DGWC-17, DGWC-19, DGWC-20, and DGWC-21	combined radium-226+228	J/UJ	L- – Low LCSD recovery
267124	7	all samples	combined radium-226+228	J/UJ	L- – Low LCSD recovery
267126	7	all samples	combined radium-226+228	UJ	L- – Low LCSD recovery
2611270	8	all samples	combined radium-226+228	J/UJ (unless previously flagged "U*")	L- – Low LCS/LCSD recoveries
2611273	8	all samples	combined radium-226+228	UJ	L- – Low LCS/LCSD recoveries
2611390	8	all samples	combined radium-226+228	J/UJ (unless previously flagged "U*")	L- – Low LCSD recoveries
2611392	8	DGWA-53	combined radium-226+228	J	L- – Low LCSD recovery LP – LCS/LCSD imprecision
2611395	8	all samples	combined radium-226+228	UJ	L- – Low LCSD recovery
2611390	8	DGWC-48 and DGWC-23	combined radium-226+228	J	LP – LCS/LCSD imprecision
AZH0942	1	all samples	fluoride	J	M+ – High MS/MSD recoveries

<u>Laboratory SDG(s)</u>	<u>Event</u>	<u>Sample(s)</u>	<u>Analyte(s)</u>	<u>Qualifier(s)</u>	<u>Reason(s) for Qualification</u>
AZI0168	1	all samples	fluoride	J	M+ – High MS/MSD recoveries
AZI0192	1	all samples	fluoride	J	M+ – High MS recovery
AZL0437	2	all samples	fluoride	J (unless previously flagged "U*")	M+ – High MS recovery
AAC0995	3	all samples	fluoride	J	M+ – High MS recovery
AAC1126	3	all samples	boron	J	M+ – High MS/MSD recoveries
AAG0277	4	all samples	fluoride	J	M+ – High MS recovery
AAG0388	4	all samples, except DGWC-42, DGWC-68A, and DGWC-69	fluoride	J	M+ – High MS recovery
AAJ0865	5	DGWA-2, DGWA-53, DGWC-8, DGWC-9, and DGWC-10	fluoride	J	M+ – High MS recovery
AAJ0905	5	DGWC-5, DGWC-12, DGWC-15, DGWC-17, DGWC-19, DGWC-20, DGWC-21, and DGWC-22	fluoride	J	M+ – High MS/MSD recoveries
AAJ0956	5	all samples, except DGWC-37 and DGWC-67	fluoride	J	M+ – High MS recovery
262357	6	DGWC-42 and DGWC-22	boron	J	M+ – High MS/MSD recoveries
2611388	8	DGWA-53 Filtered	dissolved barium	J	M+ – High MS/MSD recoveries
AAE0482	catch up	all samples	chloride	J	M- – Low MS/MSD recoveries
AAF0649	catch up	all samples	chloride	J	M- – Low MS recovery
AZL0383	2	all samples	chloride	J	M- – Low MS recovery
AZL0437	2	all samples	chloride	J	M- – Low MS recovery

<u>Laboratory SDG(s)</u>	<u>Event</u>	<u>Sample(s)</u>	<u>Analyte(s)</u>	<u>Qualifier(s)</u>	<u>Reason(s) for Qualification</u>
AAC0995	3	all samples	chloride	J	M- – Low MS recovery
AAC1096	3	all samples	chloride	J	M- – Low MS/MSD recoveries
AAC1096	3	all samples	boron	J	M- – Low MSD recovery
AAC1126	3	all samples	chloride	J	M- – Low MS/MSD recoveries
AAG0338	4	all samples, except DGWC-23	chloride	J	M- – Low MS/MSD recoveries
AAG0388	4	all samples, except DGWC-68A and DGWC-69	chloride	J	M- – Low MS recovery
AAJ0865	5	all samples, except DGWC-10	chloride	J	M- – Low MS/MSD recoveries
262357	6	DGWC-42 and DGWC-22	chloride	J	M- – Low MS/MSD recoveries
2611389	8	DGWC-12, DGWC-13, DGWC-14, DGWC-15, DGWC-17, DGWC-19, DGWC-20, DGWC-21, DGWC-22, and DGWC-42	boron	J	M- – Low MS/MSD recoveries
2611389	8	DGWC-47, DGWC-48, and DGWC-23	cobalt	J	M- – Low MSD recovery
2611389	8	DGWC-22, DGWC-42, DGWC-47, DGWC-48, and DGWC-23	chloride	J	M- – Low MS/MSD recoveries
AAE0482	catch up	all samples	TDS	J	LD – Laboratory duplicate imprecision
30222152	catch up	all samples	combined radium-226+228	J/UJ	LD – Laboratory duplicate imprecision
AAE0482	catch up	DGWA-71	TDS	J	FD – Field duplicate imprecision
AZL0383	2	DGWC-12	chloride and calcium	J	FD – Field duplicate imprecision
AZL0383	2	DGWC-19	calcium	J	FD – Field duplicate imprecision
AAC1126	3	DGWC-47	sulfate	J	FD – Field duplicate imprecision


<u>Laboratory SDG(s)</u>	<u>Event</u>	<u>Sample(s)</u>	<u>Analyte(s)</u>	<u>Qualifier(s)</u>	<u>Reason(s) for Qualification</u>
30224002	4	DGWA-70A	combined radium-226+228	UJ	FD – Field duplicate imprecision
AAJ0865	5	DGWC-8	TDS	J	FD – Field duplicate imprecision
AAJ0905	5	DGWC-12	fluoride	J	FD – Field duplicate imprecision
262357	6	DGWC-17	fluoride	J	FD – Field duplicate imprecision
262423	6	DGWC-37	fluoride	J	FD – Field duplicate imprecision
2611389	8	DGWC-17	boron, calcium and cobalt	J (unless previously flagged "U*")	FD – Field duplicate imprecision

- All inorganic positive results reported between the method detection limit (MDL) and RL have been flagged "J."
- All radiological results reported below the MDC have been flagged "U."

Report prepared by: Jessica T. Coello, Quality Assurance Chemist
 Report reviewed by: Alyssa M. Reed, Senior Quality Assurance Chemist/Project Manager
 Report approved by: David I. Thal, CEAC, CQA, Principal Chemist
 Date: 2/22/2019

INORGANIC AND RADIOLOGICAL DATA QUALIFIERS

- U - The analyte was analyzed for, but was not detected above the level of the reported sample reporting/method detection limit.
- U* - This analyte should be considered “not-detected” because it was detected in an associated blank at a similar level.
- UJ - The analyte was analyzed for, but was not detected above the level of the reported sample reporting/method detection limit. The reported method detection limit is approximate and may be inaccurate or imprecise.
- J - The analyte was positively identified but the result is an estimated quantity. The associated numerical value is the approximate concentration of the analyte in the sample.
- R - The data are unusable. The sample results are rejected due to serious analytical deficiencies in the ability to analyze the sample and meet quality control criteria. The analyte may or may not be present in the sample.
- UR - The analyte was analyzed for, but was not detected above the level of the reported sample reporting or method detection; however, the data are unusable. The sample results are rejected due to serious deficiencies in the ability to analyze the sample and meet quality control criteria. The analyte may or may not be present in the sample.

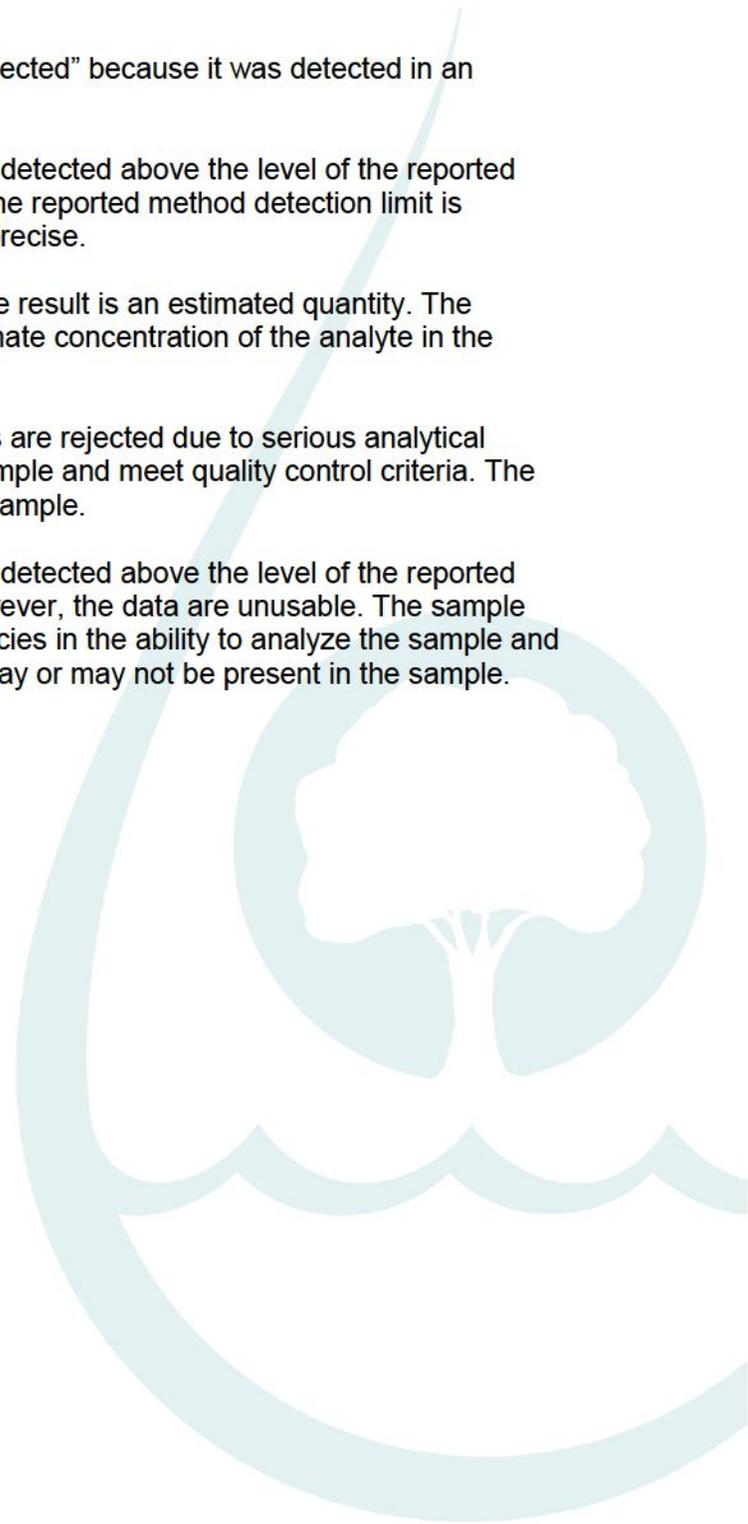

Reason Codes and Explanations

Reason Code	Explanation
BE	Equipment blank contamination. The result should be considered "not-detected."
BF	Field blank contamination. The result should be considered "not-detected."
BL	Laboratory blank contamination. The result should be considered "not-detected."
BN	Negative laboratory blank contamination.
C	Initial and/or continuing calibration issue, indeterminate bias.
C+	Initial and/or continuing calibration issue. The result may be biased high.
C-	Initial and/or continuing calibration issue. The result may be biased low.
FD	Field duplicate imprecision.
FG	Total versus dissolved imprecision.
H	Holding time exceeded.
I	Internal standard recovery outside of acceptance limits.
L	LCS and LCSD recoveries outside of acceptance limits, indeterminate bias.
L+	LCS and/or LCSD recoveries outside of acceptance limits. The result may be biased high.
L-	LCS and/or LCSD recoveries outside of acceptance limits. The result may be biased low.
LD	Laboratory duplicate imprecision.
LP	LCS/LCSD imprecision.
M	MS and MSD recoveries outside of acceptance limits, indeterminate bias.
M+	MS and/or MSD recoveries outside of acceptance limits. The result may be biased high.
M-	MS and/or MSD recoveries outside of acceptance limits. The result may be biased low.
MP	MS/MSD imprecision.
P	Post-digestion spike recoveries outside of acceptance limits, indeterminate bias.
P+	Post-digestion spike recovery outside of acceptance limits. The result may be biased high.
P-	Post-digestion spike recovery outside of acceptance limits. The result may be biased low.
Q	Chemical preservation issue.
R	RL standards outside of acceptance limits, indeterminate bias.
R+	RL standard(s) outside of acceptance limits. The result may be biased high.
R-	RL standard(s) outside of acceptance limits. The result may be biased low.
T	Temperature preservation issue.
SD	Serial dilution imprecision.
Y	Chemical yields outside of acceptance limits, indeterminate bias.
Y+	Chemical yield(s) outside of acceptance limits. The result may be biased high.
Y-	Chemical yield(s) outside of acceptance limits. The result may be biased low.
ZZ	Other

LEVEL 2A LABORATORY DATA VALIDATIONS

February - March 2018 (Revised)

Georgia Power Company - Plant McDonough Quality Control Review of Analytical Data – February - March 2018

This narrative presents results of the Quality Control (QC) data review performed on analytical data submitted by Pace Analytical Services, LLC for groundwater samples collected at Plant McDonough between February 27, 2018 and March 8, 2018. The chemical data were reviewed to identify quality issues which could affect the use of the data for decision making purposes.

Information regarding the primary sample locations, analytical parameters, QC samples, sampling dates, and laboratory sample delivery group (SDG) designations is summarized in Table 1. All SDGs associated with these samples were revised due to a laboratory reporting error where certain detections below the reporting limit (RL) but above the method detection limit (MDL) were initially reported as non-detect.

According to groundwater monitoring and corrective action procedures discussed in Title 40 CFR, Subpart D - Standards for the Disposal of Coal Combustion Residuals in Landfills and Surface Impoundments, the samples were analyzed for detection monitoring constituents listed in 40 CFR, Part 257 Appendix III and assessment monitoring constituents listed in 40 CFR, Part 257, Appendix IV. Test methods included Inductively Coupled Plasma- Mass Spectrometry (USEPA Method 6020B), Mercury in Liquid Wastes (USEPA Method 7470A), Determination of Inorganic Anions (USEPA Method 300.0), Solids in Water (Standard Methods 2540C), Radium-226 (USEPA Method 9315) and Radium-228 (USEPA Method 9320).

Data were reviewed in accordance with the US EPA Region IV Data Validation Standard Operating Procedures (for Contract Laboratory Program Inorganic Data by Inductively Coupled Plasma – Atomic Emission Spectroscopy and Inductively Coupled Plasma – Mass Spectroscopy (September 2011, Rev. 2.0)¹ and the National Functional Guidelines for Inorganic Superfund Methods Data Review². In addition, Southern Company Services, Inc. provided data validation guidance. The review included an assessment of the results for completeness, precision (laboratory duplicates, matrix spike/matrix spike duplicates), accuracy (laboratory control samples and matrix spike samples), and blank contamination (including laboratory blanks). Additionally, sample procedures, holding times and chains-of-custody were reviewed. Where there was a discrepancy between the QC criteria in the guidelines and the QC criterion established in the analytic methodology, method-specific criteria or professional judgment was used.

DATA QUALITY OBJECTIVES

Laboratory Precision:	Laboratory goals for precision were met.
Field Precision:	Field goals for precision were met with the exception of FD-2 (SDG 262357) as described in the qualifications sections below.
Accuracy:	Laboratory goals for accuracy were met, with the exception of barium, boron and chloride as described in the qualifications sections below.
Detection Limits:	Project goals for detection limits were met. Certain samples were diluted due to the concentration of the target analytes. Dilutions do not require qualifications based on USEPA guidelines. Detection and reporting limits of non-detect compounds are elevated proportional to the dilution when undiluted sample results are not provided by the laboratory. The data usability of diluted results was evaluated by the data user in the context of site-wide characterization.

Completeness: There were no rejected analytical results for this event, resulting in a completion of 100%.

Holding Times: All holding time requirements were met.

QUALIFICATIONS

In general, chemical results for the samples collected at the site were qualified on the basis of low precision or accuracy, or on the basis of professional judgment. The following definitions provide brief explanations of the qualifiers which may have been assigned to data by the laboratory during the data validation process.

- J** The analyte was positively identified above the method detection limit; however, the associated numerical value is the approximate concentration of the analyte in the sample
- J+** The analyte was positively identified above the method detection limit; however, the concentration reported is an estimated value that may be biased high.
- J-** The analyte was reported above the method detection limit; however, the concentration reported is an estimated value that may be biased low.
- U** The analyte was not detected above the method detection limit.

The data generated as part of this sampling event met the QC criteria established in the respective analytical methods and data validation guidelines. Although these qualifications were applied to some data from of the samples collected at the site, the qualifications may not have been required or applied to all samples collected. A summary of sample qualifications can be found in Table 2.

- Fluoride results in FD-2 and DGWC-17 (SDG 262357) were qualified as estimated (J) as the field duplicate RPD exceeded QC criteria.
- Certain barium and boron results in SDGs 262329 and 262357 were qualified as estimated biased high (J+) as the associated matrix spike/matrix spike duplicate (MS/MSD) recoveries exceeded QC criteria.
- Certain chloride results in SDG 262357 and 262423 were qualified as estimated biased low (J-) as the associated MS/MSD recoveries were below the QC criteria and above 10%.
- Certain boron, mercury, cobalt, and arsenic, results in SDGs 262329, and 262357 were qualified as non-detect (U) when the analyte was detected at a similar concentration in an associated blank sample. As shown in Table 2, when the original sample result was below the RL, the method detection limit was raised to the sample result as part of the qualification process. When the original sample result was above the RL, both the MDL and the RL were raised to the sample result as part of the qualification process.
- Certain radium-228, radium-226, and total radium results in SDGs 262329, 262357, 262659, and 262423 were qualified as non-detect (U) when either radium-226 or radium-228 was detected at a similar concentration in an associated blank sample. As shown in Table 2, the minimum detectable concentration (MDC) was raised to the sample result as part of the (U) qualification process.

- Certain total radium results in SDGs 262329, 262423 and 262659 were qualified estimated biased high (J+) for associated blank contaminations.

Golder reviewed the data from the at the Plant McDonough Ash Ponds between February 27, 2018 and March 8, 2018 in accordance with the analytical methods, the laboratory specific QC criteria, and the guidelines. As described above, the results were acceptable for project use.

REFERENCE

USEPA, September 2011, Region 4, Science and Ecosystem Support Division, Quality Assurance Section, MTSB, *Data Validation Standard Operating Procedures for Contract Laboratory Program Inorganic Data by Inductively Coupled Plasma – Atomic Emission Spectroscopy and Inductively Coupled Plasma – Mass Spectroscopy*, Revision 2.0.

USEPA, January 2017, National, Office of Superfund Remediation and Technology Innovation, *National Functional Guidelines for Inorganic Superfund Methods Data Review*, Revision 0.0.

TABLE 1
Georgia Power Company - Plant McDonough
Sample Summary Table - February-March 2018

SDGs	Field Identification	Collection Date	Lab Identification Number	Matrix	QC Samples	Analyses			
						TAL Metals + Hg (6020B, 7470A)	Anions (300.0)	TDS (2540C)	Radium 226, Radium 228 (9315, 9320)
262329	DGWA-70A	2/27/2018	262329001/262329002	GW	-	X	X	X	X
262329	DGWA-71	2/27/2018	262329003/262329004	GW	-	X	X	X	X
262329	DGWC-2	2/27/2018	262329005/262329006	GW	-	X	X	X	X
262329	DGWC-4	2/27/2018	262329007/262329008	GW	-	X	X	X	X
262329	DGWC-5	2/27/2018	262329009/262329010	GW	-	X	X	X	X
262329	DGWC-8	2/27/2018	262329011/262329012	GW	-	X	X	X	X
262329	DGWC-9	2/27/2018	262329013/262329014	GW	-	X	X	X	X
262329	FD-1	2/27/2018	262329015/262329016	GW	FD (DGWC-4)	X	X	X	X
262329	FB-1	2/27/2018	262329017/262329018	WQ	FB	X	X	X	X
262329	EB-1	2/27/2018	262329019/262329020	WQ	EB	X	X	X	X
262329	DGWC-10	2/27/2018	262329021/262329022	GW	-	X	X	X	X
262329	DGWC-11	2/27/2018	262329023/262329024	GW	-	X	X	X	X
262329	DGWC-12	2/27/2018	262329025/262329026	GW	-	X	X	X	X
262329	DGWC-14	2/27/2018	262329027/262329028	GW	-	X	X	X	X
262357	DGWC-13	2/28/2018	262357001, 262357002	GW	-	X	X	X	X
262357	DGWC-15	2/28/2018	262357003, 262357004	GW	-	X	X	X	X
262357	DGWC-17	2/28/2018	262357005, 262357006	GW	-	X	X	X	X
262357	DGWC-19	2/28/2018	262357007, 262357008	GW	-	X	X	X	X
262357	DGWC-20	2/28/2018	262357009, 262357010	GW	-	X	X	X	X
262357	DGWC-21	2/28/2018	262357011, 262357012	GW	-	X	X	X	X
262357	DGWC-42	2/28/2018	262357013, 262357014	GW	-	X	X	X	X
262357	FD-2	2/28/2018	262357015, 262357016	GW	FD (DGWC-17)	X	X	X	X
262357	FB-2	2/28/2018	262357017, 262357018	WQ	FB-2	X	X	X	X
262357	EB-2	2/28/2018	262357019, 262357020	WQ	EB	X	X	X	X
262357	DGWC-22	2/28/2018	262357021, 262357022	GW	-	X	X	X	X
262423	DGWC-37	3/1/2018	262423001/262423002	GW	-	X	X	X	X
262423	DGWC-23	3/1/2018	262423003/262423004	GW	-	X	X	X	X
262423	DGWC-47	3/1/2018	262423005/262423006	GW	-	X	X	X	X
262423	DGWC-39	3/1/2018	262423007/262423008	GW	-	X	X	X	X
262423	DGWC-38	3/1/2018	262423009/262423010	GW	-	X	X	X	X
262423	FD-3	3/1/2018	262423011/262423012	GW	FD (DGWC-37)	X	X	X	X
262423	FB-3	3/1/2018	262423013/262423014	WQ	FB	X	X	X	X
262423	EB-3	3/1/2018	262423015/262423016	WQ	EB	X	X	X	X
262423	DGWC-67	3/2/2018	262423017/262423018	GW	-	X	X	X	X
262423	DGWC-68A	3/2/2018	262423019/262423020	GW	-	X	X	X	X
262423	DGWC-69	3/2/2018	262423021/262423022	GW	-	X	X	X	X
262423	DGWC-40	3/2/2018	262423023/262423024	GW	-	X	X	X	X
262423	DGWC-48	3/2/2018	262423025/262423026	GW	-	X	X	X	X
262659	DGWA-53	3/8/2018	262659001/262659002	GW	-	X	X	X	X

Abbreviations:

FB - Field blank
 FD - Field duplicate
 GW - Groundwater
 Hg - Mercury
 WQ - Water quality control
 QC - Quality control
 EB - Equipment blank
 TAL - Target analyte list
 TDS - Total dissolved solids

TABLE 2
Georgia Power Company - Plant McDonough
Qualifier Summary Table - February-March 2018

SDG	Sample Name	Constituent	New RL	New MDL or MDC	Qualifier	Reason
262329	DGWA-70A	Boron	-	0.0062	U	Blank detection
262329	DGWA-71A	Boron	-	0.0069	U	Blank detection
262329	DGWC-14	Boron	0.0540	0.0540	U	Blank detection
262329	DGWC-12	Mercury	-	0.00006	U	Blank detection
262329	DGWC-9	Mercury	-	0.000042	U	Blank detection
262329	DGWC-8	Mercury	-	0.000042	U	Blank detection
262329	DGWC-5	Mercury	-	0.000090	U	Blank detection
262329	DGWA-70A	Radium-228	-	1.080	U	Blank detection
262329	DGWC-4	Radium-228	-	1.120	U	Blank detection
262329	DGWC-5	Radium-228	-	1.330	U	Blank detection
262329	DGWC-9	Radium-228	-	1.180	U	Blank detection
262329	DGWC-10	Radium-228	-	0.942	U	Blank detection
262329	DGWA-70A	Total Radium	-	1.22	U	Blank detection. Total radium is > MDC and non-qualified component is < MDC
262329	DGWC-4	Total Radium	-	-	J+	Blank detection. Total radium is > MDC and non-qualified component is > MDC
262329	DGWC-5	Total Radium	-	-	J+	Blank detection. Total radium is > MDC and non-qualified component is > MDC
262329	DGWC-9	Total Radium	-	-	J+	Blank detection. Total radium is > MDC and non-qualified component is > MDC
262329	DGWC-10	Total Radium	-	-	J+	Blank detection. Total radium is > MDC and non-qualified component is > MDC
262329	DGWA-70A	Barium	-	-	J+	MS and/or MSD recovery above QC criteria
262329	DGWA-71	Barium	-	-	J+	MS and/or MSD recovery above QC criteria
262329	DGWC-2	Barium	-	-	J+	MS and/or MSD recovery above QC criteria
262329	DGWC-4	Barium	-	-	J+	MS and/or MSD recovery above QC criteria
262329	DGWC-5	Barium	-	-	J+	MS and/or MSD recovery above QC criteria
262329	DGWC-8	Barium	-	-	J+	MS and/or MSD recovery above QC criteria
262329	DGWC-9	Barium	-	-	J+	MS and/or MSD recovery above QC criteria
262329	FD-1	Barium	-	-	J+	MS and/or MSD recovery above QC criteria
262329	DGWC-10	Barium	-	-	J+	MS and/or MSD recovery above QC criteria
262329	DGWC-11	Barium	-	-	J+	MS and/or MSD recovery above QC criteria
262329	DGWC-12	Barium	-	-	J+	MS and/or MSD recovery above QC criteria
262329	DGWC-14	Barium	-	-	J+	MS and/or MSD recovery above QC criteria
262357	DGWC-13	Boron	0.11	0.11	U	Blank detection
262357	DGWC-15	Cobalt	-	0.0016	U	Blank detection
262357	DGWC-17	Arsenic	-	0.00073	U	Blank detection
262357	DGWC-17	Cobalt	0.020	0.020	U	Blank detection
262357	DGWC-19	Arsenic	-	0.0028	U	Blank detection
262357	DGWC-21	Cobalt	-	0.0094	U	Blank detection
262357	DGWC-42	Arsenic	-	0.0011	U	Blank detection
262357	DGWC-42	Cobalt	0.017	0.017	U	Blank detection
262357	DGWC-22	Arsenic	-	0.0010	U	Blank detection
262357	DGWC-22	Cobalt	-	0.0098	U	Blank detection
262357	FD-2	Arsenic	-	0.0014	U	Blank detection
262357	FD-2	Cobalt	0.020	0.020	U	Blank detection
262357	DGWC-15	Radium-226	-	0.459	U	Blank detection
262357	DGWC-42	Radium-226	-	0.555	U	Blank detection
262357	DGWC-22	Radium-226	-	0.522	U	Blank detection
262357	DGWC-15	Total Radium	-	1.17	U	Blank detection. Total radium is > MDC and non-qualified component is < MDC
262357	FD-2	Boron	-	-	J+	MS and/or MSD recovery above QC criteria
262357	DGWC-42	Boron	-	-	J+	MS and/or MSD recovery above QC criteria
262357	DGWC-22	Boron	-	-	J+	MS and/or MSD recovery above QC criteria
262357	FD-2	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
262357	DGWC-42	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
262357	DGWC-22	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
262357	DGWC-17	Fluoride	-	-	J	Sample exceeds RPD field goals for precision
262357	FD-2	Fluoride	-	-	J	Sample exceeds RPD field goals for precision

Abbreviations:

MDC: Minimum detectable concentration
MS/MSD: Matrix spike / matrix spike duplicate
MDL: Method detection limit
RL : Reporting limit
SDG : Sample delivery group
RPD: Relative percent difference

Qualifiers:

J+ : Estimated result, biased high
J-: Estimated result, biased low
J: Estimated result
U : Non-detect result

New RL, MDL or MDC refers to raising respective RLs or MDLs to the sample result as part of the blank qualification process.

TABLE 2
Georgia Power Company - Plant McDonough
Qualifier Summary Table - February-March 2018

SDG	Sample Name	Constituent	New RL	New MDL or MDC	Qualifier	Reason
262659	DGWA-53	Radium-226	-	0.372	U	Blank detection
262659	DGWA-53	Total Radium	-	-	J+	Blank detection. Total radium is > MDC and non-qualified component is > MDC
262423	DGWC-47	Radium-228	-	1.18	U	Blank detection
262423	DGWC-39	Radium-228	-	1.10	U	Blank detection
262423	DGWC-38	Radium-228	-	0.847	U	Blank detection
262423	DGWC-68A	Radium-228	-	0.796	U	Blank detection
262423	DGWC-48	Radium-228	-	1.210	U	Blank detection
262423	DGWC-47	Total Radium	-	-	J+	Blank detection. Total radium is > MDC and non-qualified component is > MDC
262423	DGWC-39	Total Radium	-	1.24	U	Blank detection. Total radium is > MDC and non-qualified component is < MDC
262423	DGWC-68A	Total Radium	-	-	J+	Blank detection. Total radium is > MDC and non-qualified component is > MDC
262423	DGWC-48	Total Radium	-	-	J+	Blank detection. Total radium is > MDC and non-qualified component is > MDC
262423	DGWC-37	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
262423	DGWC-23	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
262423	DGWC-47	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
262423	DGWC-39	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
262423	DGWC-38	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
262423	DGWC-67	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
262423	DGWC-68A	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
262423	DGWC-69	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
262423	DGWC-40	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
262423	DGWC-48	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%

Abbreviations:

MDC: Minimum detectable concentration

MS/MSD: Matrix spike / matrix spike duplicate

MDL: Method detection limit

RL : Reporting limit

SDG : Sample delivery group

RPD: Relative percent difference

New RL, MDL or MDC refers to raising respective RLs or MDLs as part of the blank qualification process

Qualifiers:

J+ : Estimated result, biased high

J-: Estimated result, biased low

J: Estimated result

U : Non-detect result

LEVEL 2A LABORATORY DATA VALIDATIONS

March 2019

Georgia Power Company - Plant McDonough Quality Control Review of Analytical Data – March 2019

This narrative presents results of the Quality Control (QC) data review that was performed on the analytical data submitted by Pace Analytical Services, LLC for groundwater samples collected at Plant McDonough between March 12, 2019 and March 14, 2019. The chemical data were reviewed to identify quality issues which could affect the use of the data for decision making purposes.

Information regarding the primary sample locations, analytical parameters, QC samples, sampling dates, and laboratory sample delivery group (SDG) designations is summarized in Table 1. In accordance with groundwater monitoring and corrective action procedures discussed in Title 40 CFR, Subpart D - Standards for the Disposal of Coal Combustion Residuals in Landfills and Surface Impoundments, the samples were analyzed for detection monitoring constituents listed in 40 CFR, Part 257, Appendix III. Test methods included Inductively Coupled Plasma- Mass Spectrometry (USEPA Method 6020B), Determination of Inorganic Anions (USEPA Method 300.0), and Solids in Water (Standard Methods 2540C).

Data were reviewed in accordance with the US EPA Region IV Data Validation Standard Operating Procedures for Contract Laboratory Program Inorganic Data by Inductively Coupled Plasma – Atomic Emission Spectroscopy and Inductively Coupled Plasma – Mass Spectroscopy (September 2011, Rev. 2.0) and the National Functional Guidelines for Inorganic Superfund Methods Data Review (January 2017). In addition, Southern Company Services, Inc. provided data validation guidance. The review included an assessment of the results for completeness, precision (laboratory duplicates, matrix spike/matrix spike duplicates), accuracy (laboratory control samples and matrix spike samples), and blank contamination (including laboratory blanks). Additionally, sample procedures, holding times and chains-of-custody were reviewed. Where there was a discrepancy between the QC criteria in the guidelines and the QC criterion established in the analytic methodology, method-specific criteria or professional judgment was used.

DATA QUALITY OBJECTIVES

Laboratory Precision:	Laboratory goals for precision were met.
Field Precision:	Field goals for precision were met.
Accuracy:	Laboratory goals for accuracy were met, with the exception of total dissolved solids (TDS), sulfate, fluoride, and chloride as described in the qualifications sections below.
Detection Limits:	Project goals for detection limits were met. Certain samples were diluted due to the concentration of the target analytes. Dilutions do not require qualifications based on USEPA guidelines. Detection and reporting limits of non-detect compounds are elevated proportional to the dilution when undiluted sample results are not provided by the laboratory. The data usability of diluted results was evaluated by the data user in the context of site-wide characterization.
Completeness:	There were no rejected analytical results for this event, resulting in a completion of 100%.
Holding Times:	All holding time requirements were met, with the exception of TDS reanalysis in SDG 2616158.

QUALIFICATIONS

In general, chemical results for the samples collected at the site were qualified on the basis of low precision or accuracy, or on the basis of professional judgment. The following definitions provide brief explanations of the qualifiers which may have been assigned to data by the laboratory during the data validation process.

- J** The analyte was positively identified above the method detection limit; however, the associated numerical value is the approximate concentration of the analyte in the sample.
- J+** The analyte was positively identified above the method detection limit; however, the concentration reported is an estimated value that may be biased high.
- J-** The analyte was reported above the method detection limit; however, the concentration reported is an estimated value that may be biased low.
- U** The analyte was not detected above the method detection limit.

The data generated as part of this sampling event met the QC criteria established in the respective analytical methods and data validation guidelines except as specified below. Although these qualifications were applied to some data from the samples collected at the site, the qualifications may not have been required or applied to all samples collected. A summary of sample qualifications can be found in Table 2.

- Certain chloride and sulfate results in SDGs 2616034, 2616035, 2616156, 2616158, and 2616160 were qualified as estimated biased low (J-) as the associated matrix spike/matrix spike duplicate (MS/MSD) recoveries were below the QC criteria.
- Certain fluoride results in SDG 2616160 were qualified as estimated biased high (J+) when the associated MS/MSD recoveries exceeded QC criteria.
- Certain TDS results in SDG 2616158 were qualified as estimated biased high (J+) as the associated laboratory control sample/laboratory control sample duplicate (LCS/LCSD) recoveries were above the QC criteria.
- Certain TDS, fluoride, and sulfate results in SDGs 2616156, 2616034, and 2616035 were qualified non-detect (U) when the analyte was detected at a similar level in an associated blank sample. As shown in Table 2, when the original sample result was below the RL, the method detection limit was raised to the sample result as part of the qualification process. When the original sample result was above the RL, both the MDL and the RL were raised to the sample result as part of the qualification process.
- Certain TDS results in SDG 2616158 were reanalyzed out of analytical hold time due to a batch QC exceedance. These results confirmed the original results from the analyses conducted within analytical hold time. The out of holding time analyses were deemed non-reportable during the validation process.

Golder reviewed the data from samples collected at the Plant McDonough Ash Ponds between March 12, 2019 and March 14, 2019 in accordance with the analytical methods, the laboratory specific QC criteria, and the guidelines. As described above, results were acceptable for project use.

REFERENCE

USEPA, September 2011, Region 4, Science and Ecosystem Support Division, Quality Assurance Section, MTSB, *Data Validation Standard Operating Procedures for Contract Laboratory Program Inorganic Data By Inductively Coupled Plasma – Atomic Emission Spectroscopy and Inductively Coupled Plasma – Mass Spectroscopy*, Revision 2.0.

USEPA, January 2017, National, Office of Superfund Remediation and Technology Innovation, *National Functional Guidelines for Inorganic Superfund Methods Data Review*, Revision 0.0.

TABLE 1
Georgia Power Company - Plant McDonough
Sample Summary Table - March 2019

SDGs	Field Identification	Collection Date	Lab Identification Number	Matrix	QC Samples	Analyses		
						Select Metals (6020B)	Anions (300.0)	TDS (2540C)
2616034	DGWC-2	3/12/2019	2616034001	GW	-	X	X	X
2616034	DGWC-4	3/12/2019	2616034002	GW	-	X	X	X
2616034	DGWA-5	3/12/2019	2616034003	GW	-	X	X	X
2616034	DGWC-8	3/12/2019	2616034004	GW	-	X	X	X
2616034	DGWC-9	3/12/2019	2616034005	GW	-	X	X	X
2616034	DGWC-10	3/12/2019	2616034006	GW	-	X	X	X
2616034	DGWC-11	3/12/2019	2616034007	GW	-	X	X	X
2616034	DGWC-12	3/12/2019	2616034008	GW	-	X	X	X
2616034	FB-1	3/12/2019	2616034009	WQ	FB	X	X	X
2616034	EB-1	3/12/2019	2616034010	WQ	EB	X	X	X
2616034	FD-2	3/12/2019	2616034011	GW	FD (DGWC-4)	X	X	X
2616035	DGWA-70A	3/12/2019	2616035001	GW	-	X	X	X
2616035	DGWA-71	3/12/2019	2616035001	GW	-	X	X	X
2616035	FD-1	3/12/2019	2616035001	GW	FD (DGWA-70A)	X	X	X
2616035	EB-1	3/12/2019	2616035001	WQ	EB	X	X	X
2616158	DGWC-37	3/13/2019	2616158001	GW	-	X	X	X
2616158	DGWC-38	3/13/2019	2616158002	GW	-	X	X	X
2616158	DGWC-39	3/13/2019	2616158003	GW	-	X	X	X
2616158	DGWC-40	3/13/2019	2616158004	GW	-	X	X	X
2616158	DGWC-67	3/13/2019	2616158005	GW	-	X	X	X
2616158	DGWC-68A	3/13/2019	2616158006	GW	-	X	X	X
2616158	DGWC-69	3/13/2019	2616158007	GW	-	X	X	X
2616158	EB-3	3/13/2019	2616158008	WQ	EB	X	X	X
2616158	FD-3	3/13/2019	2616158009	GW	FD (DGWC-69)	X	X	X
2616156	DGWA-53	3/13/2019	2616156001	GW	-	X	X	X
2616156	FB-2	3/13/2019	2616156002	WQ	FB	X	X	X
2616160	DGWC-13	3/13/2019	2616160001	GW	-	X	X	X
2616160	DGWC-14	3/13/2019	2616160002	GW	-	X	X	X
2616160	DGWC-17	3/13/2019	2616160003	GW	-	X	X	X
2616160	DGWC-19	3/13/2019	2616160004	GW	-	X	X	X
2616160	DGWC-20	3/13/2019	2616160005	GW	-	X	X	X
2616160	DGWC-21	3/13/2019	2616160006	GW	-	X	X	X
2616160	DGWC-15	3/14/2019	2616160007	GW	-	X	X	X
2616160	DGWC-22	3/14/2019	2616160008	GW	-	X	X	X
2616160	DGWC-23	3/14/2019	2616160009	GW	-	X	X	X
2616160	DGWC-42	3/14/2019	2616160010	GW	-	X	X	X
2616160	DGWC-47	3/14/2019	2616160011	GW	-	X	X	X
2616160	DGWC-48	3/14/2019	2616160012	GW	-	X	X	X
2616160	FB-3	3/14/2019	2616160013	WQ	FB	X	X	X

Abbreviations:

FB - Field blank

FD - Field duplicate

GW - Groundwater

EB- Equipment blank

TDS - Total dissolved solids

WQ - Water quality control

QC - Quality control

TABLE 2
Georgia Power Company - Plant McDonough
Qualifier Summary Table - March 2019

SDG	Sample Name	Constituent	New RL	New MDL	Qualifier	Reason
2616156	DGWA-53	TDS	201	201	U	Blank contamination
2616158	DGWC-40	TDS	-	-	J+	LCS and/or LCSD recovered above QC criteria
2616158	DGWC-37	TDS	-	-	J+	LCS and/or LCSD recovered above QC criteria
2616158	DGWC-38	TDS	-	-	J+	LCS and/or LCSD recovered above QC criteria
2616158	DGWC-39	TDS	-	-	J+	LCS and/or LCSD recovered above QC criteria
2616158	DGWC-67	TDS	-	-	J+	LCS and/or LCSD recovered above QC criteria
2616158	DGWC-68A	TDS	-	-	J+	LCS and/or LCSD recovered above QC criteria
2616156	DGWA-53	Sulfate	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616158	DGWC-37	Sulfate	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616158	DGWC-38	Sulfate	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616158	DGWC-39	Sulfate	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616158	DGWC-40	Sulfate	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616158	DGWC-67	Sulfate	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616158	DGWC-68A	Sulfate	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616158	DGWC-69	Sulfate	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616158	FD-3	Sulfate	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616034	DGWC-2	Fluoride	-	0.052	U	Blank contamination
2616034	DGWC-4	Fluoride	-	0.082	U	Blank contamination
2616034	DGWC-11	Fluoride	-	0.052	U	Blank contamination
2616034	DGWC-12	Fluoride	-	0.065	U	Blank contamination
2616034	FD-2	Fluoride	-	0.083	U	Blank contamination
2616034	DGWC-2	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616034	DGWC-4	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616034	DGWA-5	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616034	DGWC-8	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616034	DGWC-9	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616034	DGWC-10	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616034	DGWC-11	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616034	DGWC-12	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616034	FD-2	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616035	DGWA-70A	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616035	DGWA-71	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616035	FD-1	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616035	DGWA-70A	TDS	43	43	U	Blank contamination
2616035	DGWA-71	TDS	74	74	U	Blank contamination
2616035	FD-1	TDS	50	50	U	Blank contamination
2616035	DGWA-70A	Sulfate	-	0.35	U	Blank contamination
2616035	FD-1	Sulfate	-	0.37	U	Blank contamination
2616160	DGWC-13	Sulfate	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616160	DGWC-14	Sulfate	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616160	DGWC-17	Sulfate	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616160	DGWC-19	Sulfate	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616160	DGWC-20	Sulfate	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616160	DGWC-21	Sulfate	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616160	DGWC-15	Sulfate	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616160	DGWC-22	Sulfate	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616160	DGWC-23	Sulfate	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616160	DGWC-42	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616160	DGWC-47	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616160	DGWC-48	Chloride	-	-	J-	MS and/or MSD recovered below QC criteria and above 10%
2616160	DGWC-47	Fluoride	-	-	J+	MS and/or MSD recovered above QC criteria
2616160	DGWC-48	Fluoride	-	-	J+	MS and/or MSD recovered above QC criteria

Abbreviations:

MDC: Minimum detectable concentration
MDL: Method detection limit
LCS/LCSD: Laboratory control sample / laboratory control sample duplicate
MS/MSD: Matrix spike / matrix spike duplicate
RL : Reporting limit
SDG : Sample delivery group
QC: Quality Control
RPD: Relative percent difference

Qualifiers:

J+ : Estimated result, biased high
J- : Estimated result, biased low
U : Non-detect result

New RL, MDL or MDC refers to raising respective RLs or MDLs to the sample result as part of the blank qualification process.

APPENDIX B

Statistical Analyses

Prediction Limit

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated Printed 7/6/2019, 3:07 PM


<u>Constituent</u>	<u>Well</u>	<u>Upper Lim.</u>	<u>Lower Lim.</u>	<u>Date</u>	<u>Observ.</u>	<u>Sig.</u>	<u>Bg N</u>	<u>%NDs</u>	<u>Transform</u>	<u>Alpha</u>	<u>Method</u>
Boron (mg/L)	DGWC-37	0.13	n/a	3/13/2019	1.8	Yes	28	10.71	n/a	0.002185	NP Inter (normality) ...
Boron (mg/L)	DGWC-38	0.13	n/a	3/13/2019	2.9	Yes	28	10.71	n/a	0.002185	NP Inter (normality) ...
Boron (mg/L)	DGWC-39	0.13	n/a	3/13/2019	3.4	Yes	28	10.71	n/a	0.002185	NP Inter (normality) ...
Boron (mg/L)	DGWC-40	0.13	n/a	3/13/2019	0.8	Yes	28	10.71	n/a	0.002185	NP Inter (normality) ...
Boron (mg/L)	DGWC-67	0.13	n/a	3/13/2019	3.5	Yes	28	10.71	n/a	0.002185	NP Inter (normality) ...
Boron (mg/L)	DGWC-68A	0.13	n/a	3/13/2019	1.9	Yes	28	10.71	n/a	0.002185	NP Inter (normality) ...
Calcium (mg/L)	DGWC-37	40.3	n/a	3/13/2019	54.8	Yes	29	0	n/a	0.00204	NP Inter (normality) ...
Calcium (mg/L)	DGWC-38	40.3	n/a	3/13/2019	85.3	Yes	29	0	n/a	0.00204	NP Inter (normality) ...
Calcium (mg/L)	DGWC-39	40.3	n/a	3/13/2019	96.3	Yes	29	0	n/a	0.00204	NP Inter (normality) ...
Calcium (mg/L)	DGWC-40	40.3	n/a	3/13/2019	41	Yes	29	0	n/a	0.00204	NP Inter (normality) ...
Calcium (mg/L)	DGWC-67	40.3	n/a	3/13/2019	41.2	Yes	29	0	n/a	0.00204	NP Inter (normality) ...
Calcium (mg/L)	DGWC-68A	40.3	n/a	3/13/2019	47.5	Yes	29	0	n/a	0.00204	NP Inter (normality) ...
Chloride (mg/L)	DGWC-37	4.024	n/a	3/13/2019	6.9	Yes	31	0	x^(1/3)	0.000...	Param Inter 1 of 2
Chloride (mg/L)	DGWC-38	4.024	n/a	3/13/2019	9.1	Yes	31	0	x^(1/3)	0.000...	Param Inter 1 of 2
Chloride (mg/L)	DGWC-39	4.024	n/a	3/13/2019	8.2	Yes	31	0	x^(1/3)	0.000...	Param Inter 1 of 2
Chloride (mg/L)	DGWC-40	4.024	n/a	3/13/2019	19.7	Yes	31	0	x^(1/3)	0.000...	Param Inter 1 of 2
Chloride (mg/L)	DGWC-67	4.024	n/a	3/13/2019	6.8	Yes	31	0	x^(1/3)	0.000...	Param Inter 1 of 2
Chloride (mg/L)	DGWC-69	4.024	n/a	3/13/2019	6.2	Yes	31	0	x^(1/3)	0.000...	Param Inter 1 of 2
Chloride (mg/L)	DGWC-68A	4.024	n/a	3/13/2019	4.6	Yes	31	0	x^(1/3)	0.000...	Param Inter 1 of 2
pH [field] (S.U.)	DGWC-40	6.537	5.181	3/13/2019	4.6	Yes	29	0	No	0.000...	Param Inter 1 of 2
pH [field] (S.U.)	DGWC-68A	6.537	5.181	3/13/2019	6.57	Yes	29	0	No	0.000...	Param Inter 1 of 2
Sulfate (mg/L)	DGWC-37	33.88	n/a	3/13/2019	92.2	Yes	31	0	sqrt(x)	0.000...	Param Inter 1 of 2
Sulfate (mg/L)	DGWC-38	33.88	n/a	3/13/2019	300	Yes	31	0	sqrt(x)	0.000...	Param Inter 1 of 2
Sulfate (mg/L)	DGWC-39	33.88	n/a	3/13/2019	265	Yes	31	0	sqrt(x)	0.000...	Param Inter 1 of 2
Sulfate (mg/L)	DGWC-40	33.88	n/a	3/13/2019	445	Yes	31	0	sqrt(x)	0.000...	Param Inter 1 of 2
Sulfate (mg/L)	DGWC-67	33.88	n/a	3/13/2019	233	Yes	31	0	sqrt(x)	0.000...	Param Inter 1 of 2
Sulfate (mg/L)	DGWC-68A	33.88	n/a	3/13/2019	44.1	Yes	31	0	sqrt(x)	0.000...	Param Inter 1 of 2
TDS (mg/L)	DGWC-38	408.5	n/a	3/13/2019	487	Yes	29	0	x^(1/3)	0.000...	Param Inter 1 of 2
TDS (mg/L)	DGWC-39	408.5	n/a	3/13/2019	526	Yes	29	0	x^(1/3)	0.000...	Param Inter 1 of 2

Prediction Limit

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated Printed 7/6/2019, 3:07 PM

Constituent	Well	Upper Lim.	Lower Lim.	Date	Observ.	Sig.	Bg N	%NDs	Transform	Alpha	Method
Boron (mg/L)	DGWC-37	0.13	n/a	3/13/2019	1.8	Yes	28	10.71	n/a	0.002185	NP Inter (normality) ...
Boron (mg/L)	DGWC-38	0.13	n/a	3/13/2019	2.9	Yes	28	10.71	n/a	0.002185	NP Inter (normality) ...
Boron (mg/L)	DGWC-39	0.13	n/a	3/13/2019	3.4	Yes	28	10.71	n/a	0.002185	NP Inter (normality) ...
Boron (mg/L)	DGWC-40	0.13	n/a	3/13/2019	0.8	Yes	28	10.71	n/a	0.002185	NP Inter (normality) ...
Boron (mg/L)	DGWC-67	0.13	n/a	3/13/2019	3.5	Yes	28	10.71	n/a	0.002185	NP Inter (normality) ...
Boron (mg/L)	DGWC-69	0.13	n/a	3/13/2019	0.028	No	28	10.71	n/a	0.002185	NP Inter (normality) ...
Boron (mg/L)	DGWC-68A	0.13	n/a	3/13/2019	1.9	Yes	28	10.71	n/a	0.002185	NP Inter (normality) ...
Calcium (mg/L)	DGWC-37	40.3	n/a	3/13/2019	54.8	Yes	29	0	n/a	0.00204	NP Inter (normality) ...
Calcium (mg/L)	DGWC-38	40.3	n/a	3/13/2019	85.3	Yes	29	0	n/a	0.00204	NP Inter (normality) ...
Calcium (mg/L)	DGWC-39	40.3	n/a	3/13/2019	96.3	Yes	29	0	n/a	0.00204	NP Inter (normality) ...
Calcium (mg/L)	DGWC-40	40.3	n/a	3/13/2019	41	Yes	29	0	n/a	0.00204	NP Inter (normality) ...
Calcium (mg/L)	DGWC-67	40.3	n/a	3/13/2019	41.2	Yes	29	0	n/a	0.00204	NP Inter (normality) ...
Calcium (mg/L)	DGWC-69	40.3	n/a	3/13/2019	7.6	No	29	0	n/a	0.00204	NP Inter (normality) ...
Calcium (mg/L)	DGWC-68A	40.3	n/a	3/13/2019	47.5	Yes	29	0	n/a	0.00204	NP Inter (normality) ...
Chloride (mg/L)	DGWC-37	4.024	n/a	3/13/2019	6.9	Yes	31	0	x^(1/3)	0.000...	Param Inter 1 of 2
Chloride (mg/L)	DGWC-38	4.024	n/a	3/13/2019	9.1	Yes	31	0	x^(1/3)	0.000...	Param Inter 1 of 2
Chloride (mg/L)	DGWC-39	4.024	n/a	3/13/2019	8.2	Yes	31	0	x^(1/3)	0.000...	Param Inter 1 of 2
Chloride (mg/L)	DGWC-40	4.024	n/a	3/13/2019	19.7	Yes	31	0	x^(1/3)	0.000...	Param Inter 1 of 2
Chloride (mg/L)	DGWC-67	4.024	n/a	3/13/2019	6.8	Yes	31	0	x^(1/3)	0.000...	Param Inter 1 of 2
Chloride (mg/L)	DGWC-69	4.024	n/a	3/13/2019	6.2	Yes	31	0	x^(1/3)	0.000...	Param Inter 1 of 2
Chloride (mg/L)	DGWC-68A	4.024	n/a	3/13/2019	4.6	Yes	31	0	x^(1/3)	0.000...	Param Inter 1 of 2
Fluoride (mg/L)	DGWC-37	0.3266	n/a	3/13/2019	0.08	No	29	37.93	x^(1/3)	0.000...	Param Inter 1 of 2
Fluoride (mg/L)	DGWC-38	0.3266	n/a	3/13/2019	0.084	No	29	37.93	x^(1/3)	0.000...	Param Inter 1 of 2
Fluoride (mg/L)	DGWC-39	0.3266	n/a	3/13/2019	0.085	No	29	37.93	x^(1/3)	0.000...	Param Inter 1 of 2
Fluoride (mg/L)	DGWC-40	0.3266	n/a	3/13/2019	0.15	No	29	37.93	x^(1/3)	0.000...	Param Inter 1 of 2
Fluoride (mg/L)	DGWC-67	0.3266	n/a	3/13/2019	0.07	No	29	37.93	x^(1/3)	0.000...	Param Inter 1 of 2
Fluoride (mg/L)	DGWC-69	0.3266	n/a	3/13/2019	0.086	No	29	37.93	x^(1/3)	0.000...	Param Inter 1 of 2
Fluoride (mg/L)	DGWC-68A	0.3266	n/a	3/13/2019	0.12	No	29	37.93	x^(1/3)	0.000...	Param Inter 1 of 2
pH [field] (S.U.)	DGWC-37	6.537	5.181	3/13/2019	6.26	No	29	0	No	0.000...	Param Inter 1 of 2
pH [field] (S.U.)	DGWC-38	6.537	5.181	3/13/2019	6.05	No	29	0	No	0.000...	Param Inter 1 of 2
pH [field] (S.U.)	DGWC-39	6.537	5.181	3/13/2019	6.28	No	29	0	No	0.000...	Param Inter 1 of 2
pH [field] (S.U.)	DGWC-40	6.537	5.181	3/13/2019	4.6	Yes	29	0	No	0.000...	Param Inter 1 of 2
pH [field] (S.U.)	DGWC-67	6.537	5.181	3/13/2019	6.19	No	29	0	No	0.000...	Param Inter 1 of 2
pH [field] (S.U.)	DGWC-69	6.537	5.181	3/13/2019	6.08	No	29	0	No	0.000...	Param Inter 1 of 2
pH [field] (S.U.)	DGWC-68A	6.537	5.181	3/13/2019	6.57	Yes	29	0	No	0.000...	Param Inter 1 of 2
Sulfate (mg/L)	DGWC-37	33.88	n/a	3/13/2019	92.2	Yes	31	0	sqrt(x)	0.000...	Param Inter 1 of 2
Sulfate (mg/L)	DGWC-38	33.88	n/a	3/13/2019	300	Yes	31	0	sqrt(x)	0.000...	Param Inter 1 of 2
Sulfate (mg/L)	DGWC-39	33.88	n/a	3/13/2019	265	Yes	31	0	sqrt(x)	0.000...	Param Inter 1 of 2
Sulfate (mg/L)	DGWC-40	33.88	n/a	3/13/2019	445	Yes	31	0	sqrt(x)	0.000...	Param Inter 1 of 2
Sulfate (mg/L)	DGWC-67	33.88	n/a	3/13/2019	233	Yes	31	0	sqrt(x)	0.000...	Param Inter 1 of 2
Sulfate (mg/L)	DGWC-69	33.88	n/a	3/13/2019	8.4	No	31	0	sqrt(x)	0.000...	Param Inter 1 of 2
Sulfate (mg/L)	DGWC-68A	33.88	n/a	3/13/2019	44.1	Yes	31	0	sqrt(x)	0.000...	Param Inter 1 of 2
TDS (mg/L)	DGWC-37	408.5	n/a	3/13/2019	286	No	29	0	x^(1/3)	0.000...	Param Inter 1 of 2
TDS (mg/L)	DGWC-38	408.5	n/a	3/13/2019	487	Yes	29	0	x^(1/3)	0.000...	Param Inter 1 of 2
TDS (mg/L)	DGWC-39	408.5	n/a	3/13/2019	526	Yes	29	0	x^(1/3)	0.000...	Param Inter 1 of 2
TDS (mg/L)	DGWC-40	408.5	n/a	3/13/2019	351	No	29	0	x^(1/3)	0.000...	Param Inter 1 of 2
TDS (mg/L)	DGWC-67	408.5	n/a	3/13/2019	278	No	29	0	x^(1/3)	0.000...	Param Inter 1 of 2
TDS (mg/L)	DGWC-69	408.5	n/a	3/13/2019	95	No	29	0	x^(1/3)	0.000...	Param Inter 1 of 2
TDS (mg/L)	DGWC-68A	408.5	n/a	3/13/2019	267	No	29	0	x^(1/3)	0.000...	Param Inter 1 of 2

Prediction Limit Interwell Non-parametric

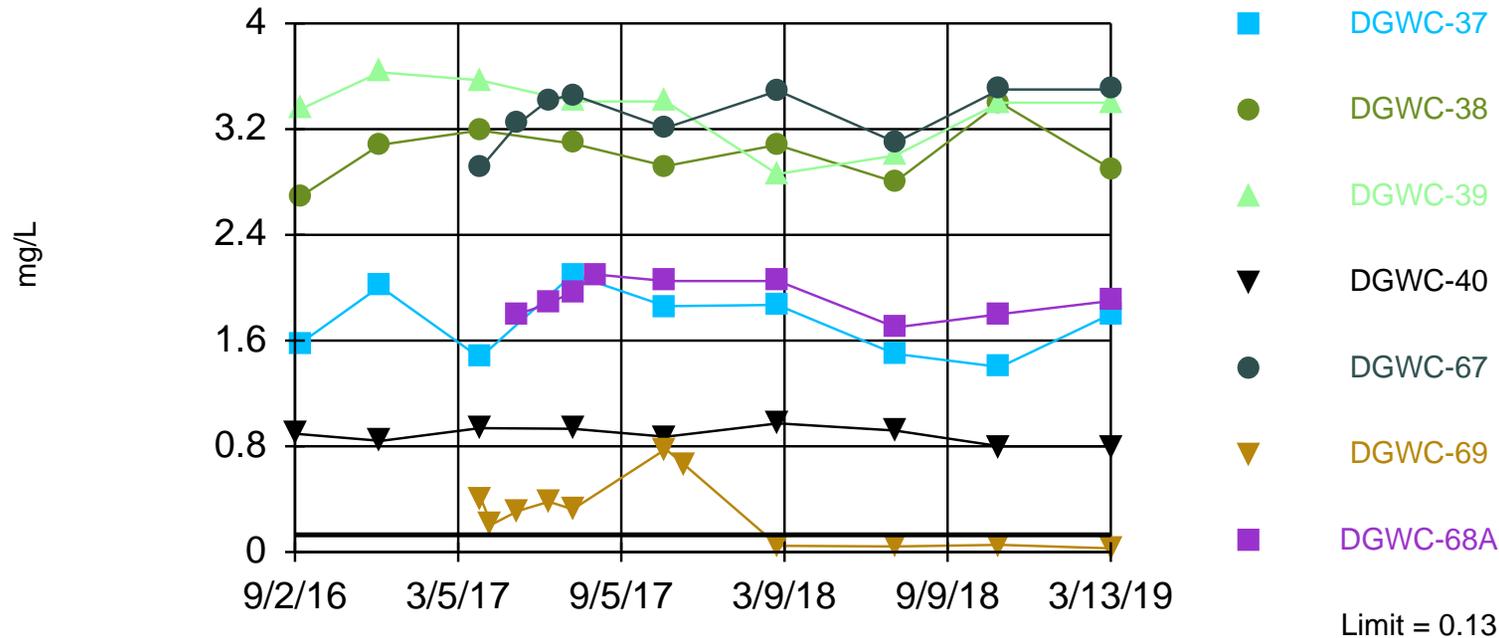


Non-parametric test used in lieu of parametric prediction limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 28 background values. 10.71% NDs. Annual per-constituent alpha = 0.03439. Individual comparison alpha = 0.002185 (1 of 2). Comparing 7 points to limit. Assumes 1 future value.

Constituent: Boron Analysis Run 7/6/2019 3:06 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Prediction Limit Interwell Non-parametric

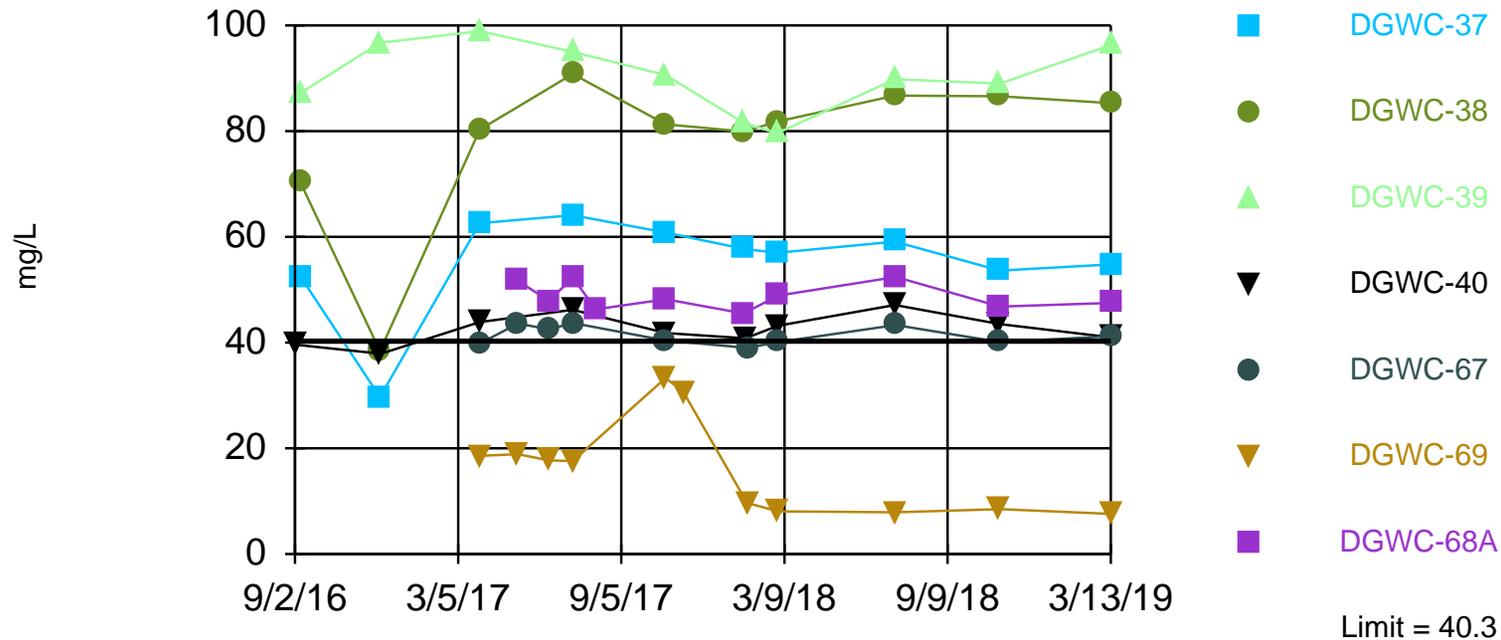


Non-parametric test used in lieu of parametric prediction limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 29 background values. Annual per-constituent alpha = 0.03214. Individual comparison alpha = 0.00204 (1 of 2). Comparing 7 points to limit. Assumes 1 future value.

Constituent: Calcium Analysis Run 7/6/2019 3:06 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Prediction Limit Interwell Parametric

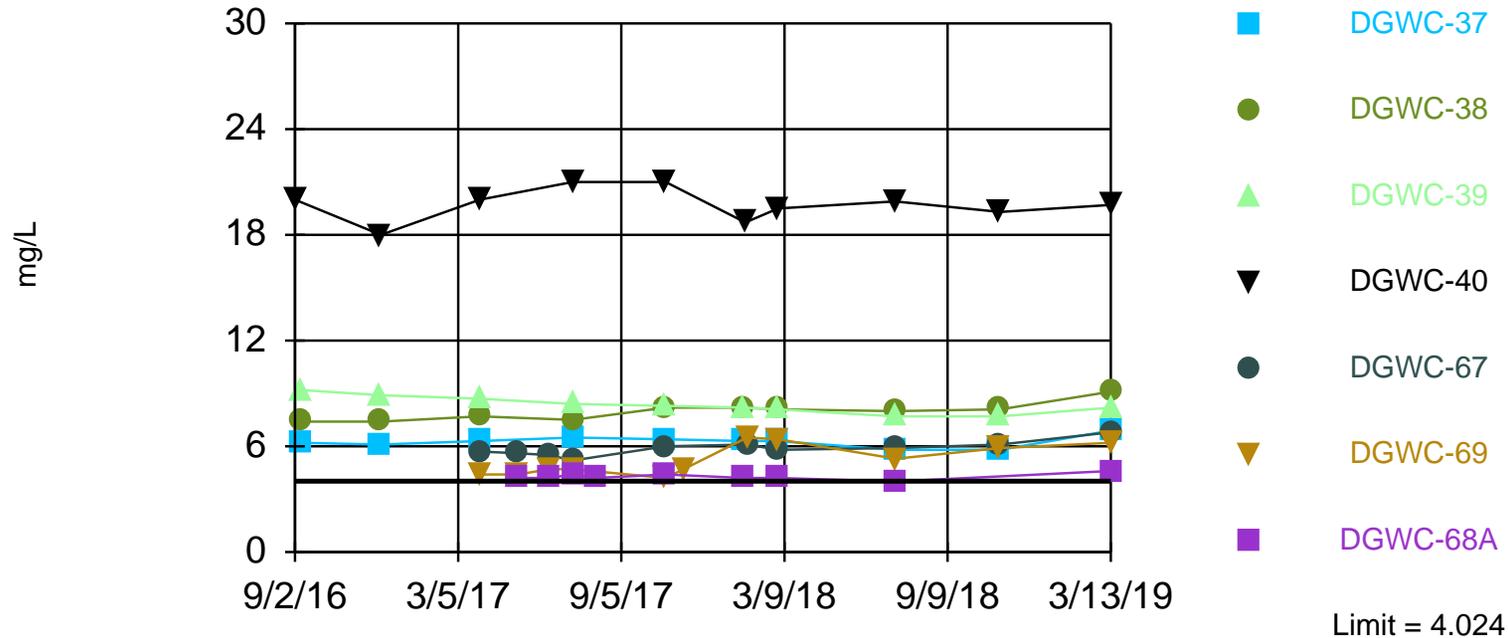


Background Data Summary (based on cube root transformation): Mean=1.39, Std. Dev.=0.09734, n=31. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.904, critical = 0.902. Kappa = 2.063 (c=7, w=8, 1 of 2, event alpha = 0.05132). Report alpha = 0.007498. Individual comparison alpha = 0.0009403. Comparing 7 points to limit. Assumes 1 future value.

Constituent: Chloride Analysis Run 7/6/2019 3:06 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Within Limit

Prediction Limit Interwell Parametric

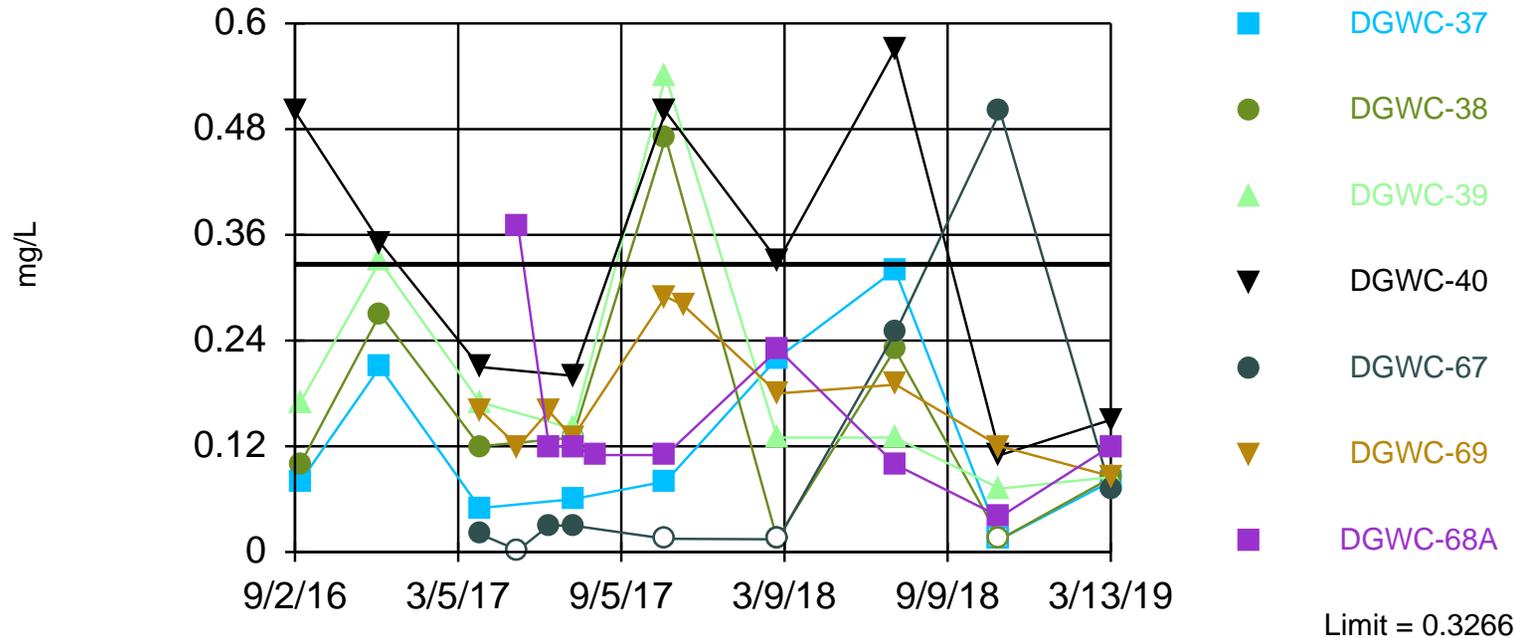


Background Data Summary (based on cube root transformation) (after Aitchison`s Adjustment):
 Mean=0.2409, Std. Dev.=0.2152, n=29, 37.93% NDs. Normality test: Shapiro Wilk @alpha = 0.01,
 calculated = 0.9266, critical = 0.898. Kappa = 2.081 (c=7, w=8, 1 of 2, event alpha = 0.05132). Report
 alpha = 0.007498. Individual comparison alpha = 0.0009403. Comparing 7 points to limit. Assumes 1
 future value.

Constituent: Fluoride Analysis Run 7/6/2019 3:06 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Prediction Limit Interwell Parametric

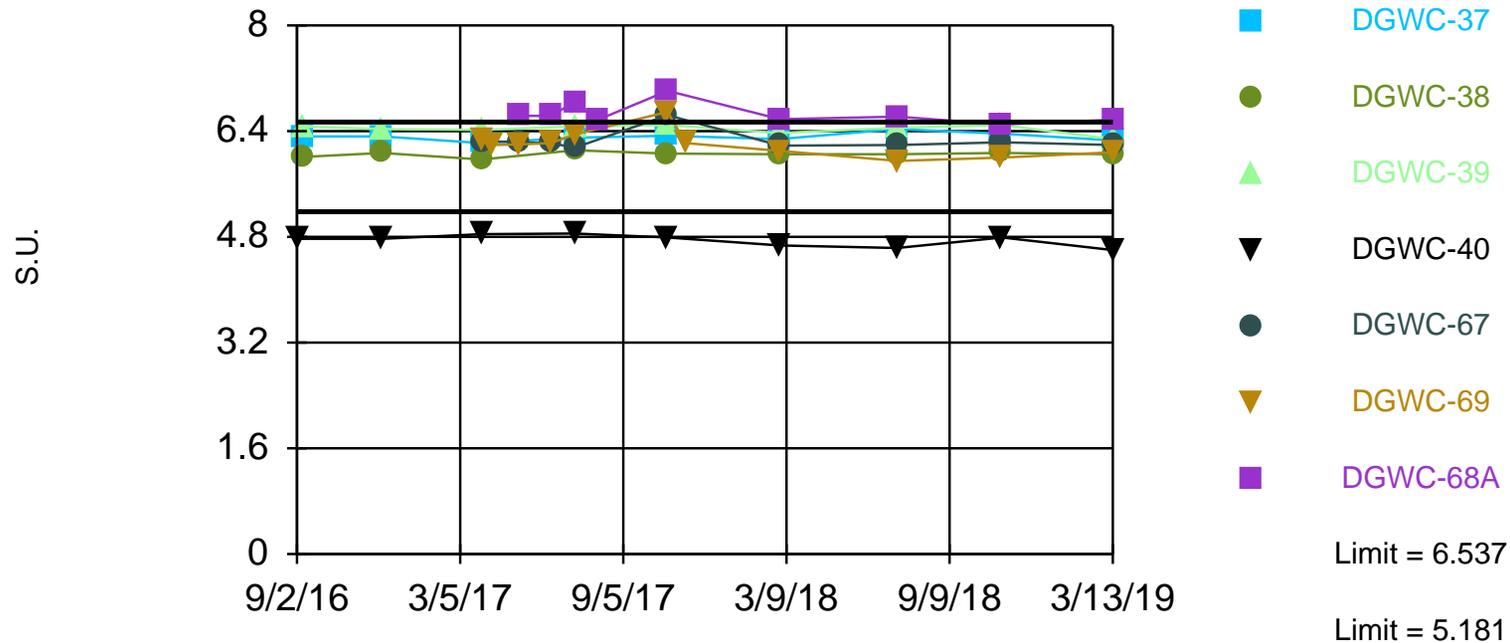


Background Data Summary: Mean=5.859, Std. Dev.=0.3258, n=29. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9016, critical = 0.898. Kappa = 2.081 (c=7, w=8, 1 of 2, event alpha = 0.05132). Report alpha = 0.007498. Individual comparison alpha = 0.0004701. Comparing 7 points to limit. Assumes 1 future value.

Constituent: pH [field] Analysis Run 7/6/2019 3:06 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Prediction Limit Interwell Parametric

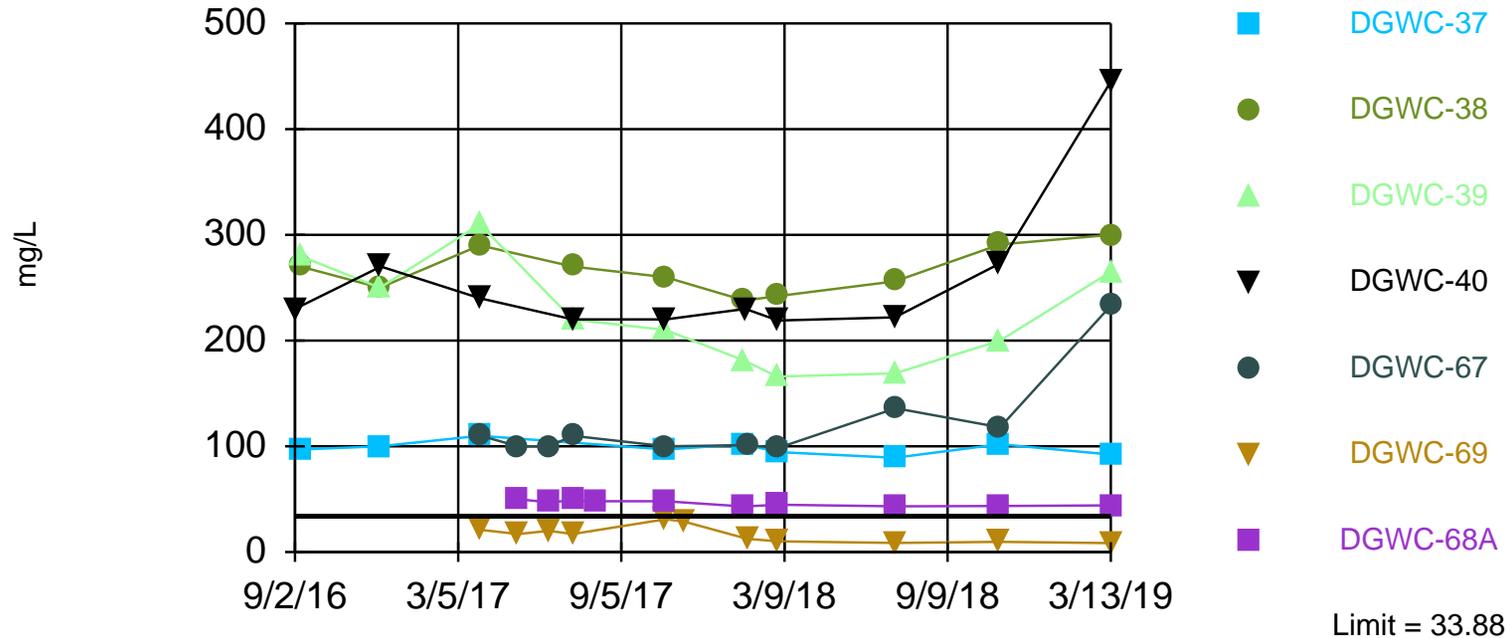


Background Data Summary (based on square root transformation): Mean=2.637, Std. Dev.=1.543, n=31. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9382, critical = 0.902. Kappa = 2.063 (c=7, w=8, 1 of 2, event alpha = 0.05132). Report alpha = 0.007498. Individual comparison alpha = 0.0009403. Comparing 7 points to limit. Assumes 1 future value.

Constituent: Sulfate Analysis Run 7/6/2019 3:06 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Prediction Limit Interwell Parametric

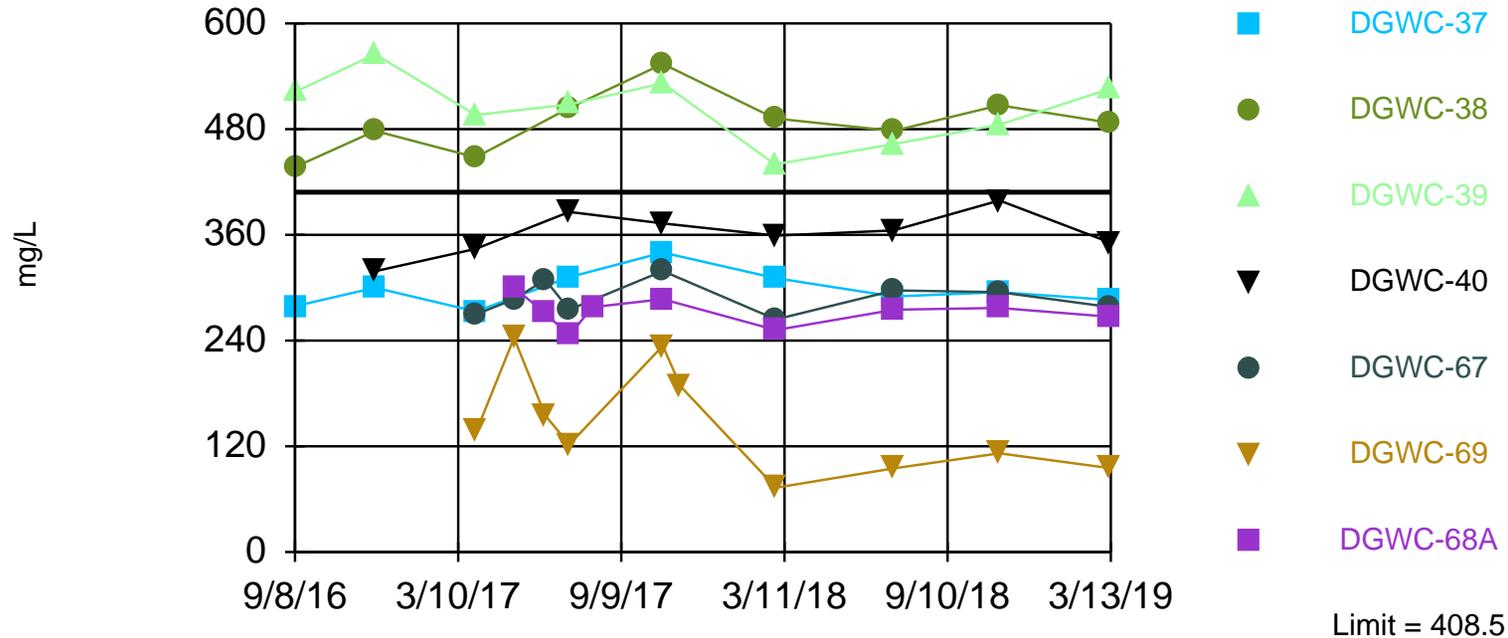


Background Data Summary (based on cube root transformation): Mean=4.872, Std. Dev.=1.225, n=29. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.8989, critical = 0.898. Kappa = 2.081 (c=7, w=8, 1 of 2, event alpha = 0.05132). Report alpha = 0.007498. Individual comparison alpha = 0.0009403. Comparing 7 points to limit. Assumes 1 future value.

Constituent: TDS Analysis Run 7/6/2019 3:06 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator

DGWC-37

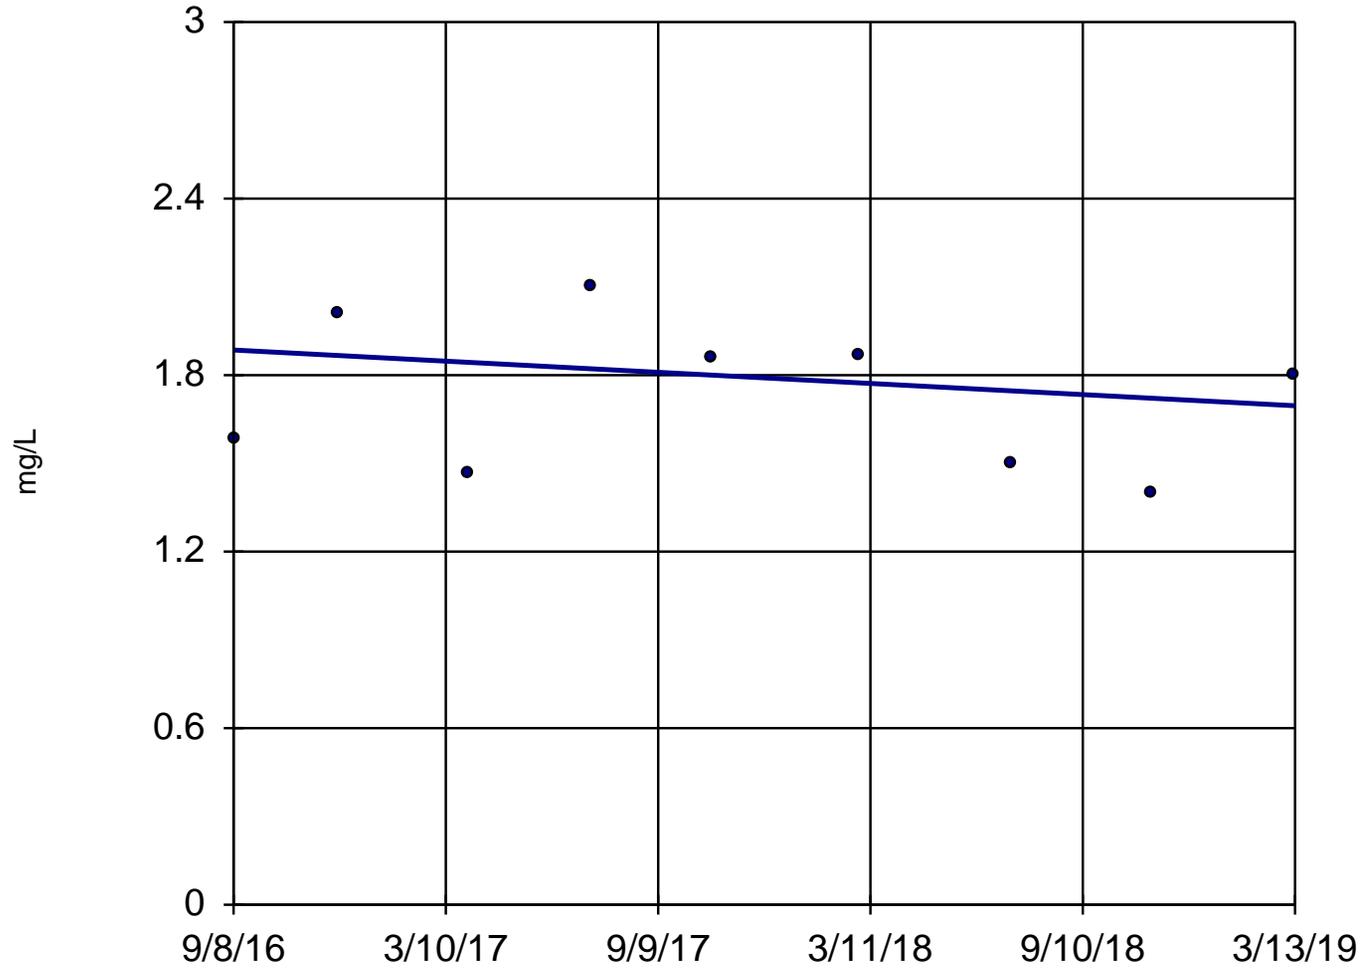

n = 9

Slope = -0.07542
units per year.

Mann-Kendall
statistic = -8
critical = -25


Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Boron Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator

DGWC-38

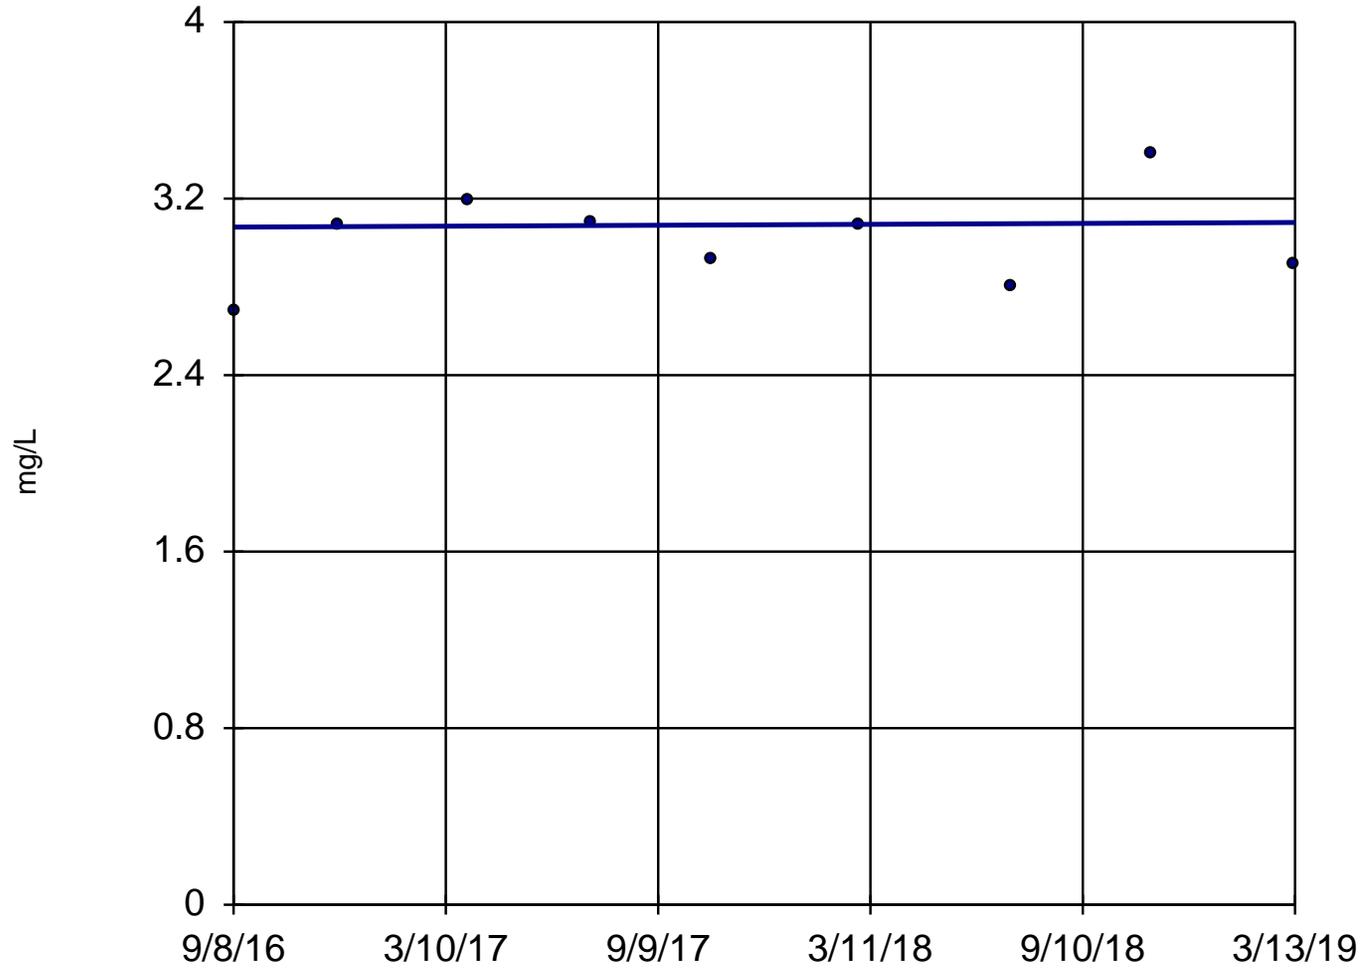

n = 9

Slope = 0.008372
units per year.

Mann-Kendall
statistic = 1
critical = 25


Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Boron Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator

DGWC-39

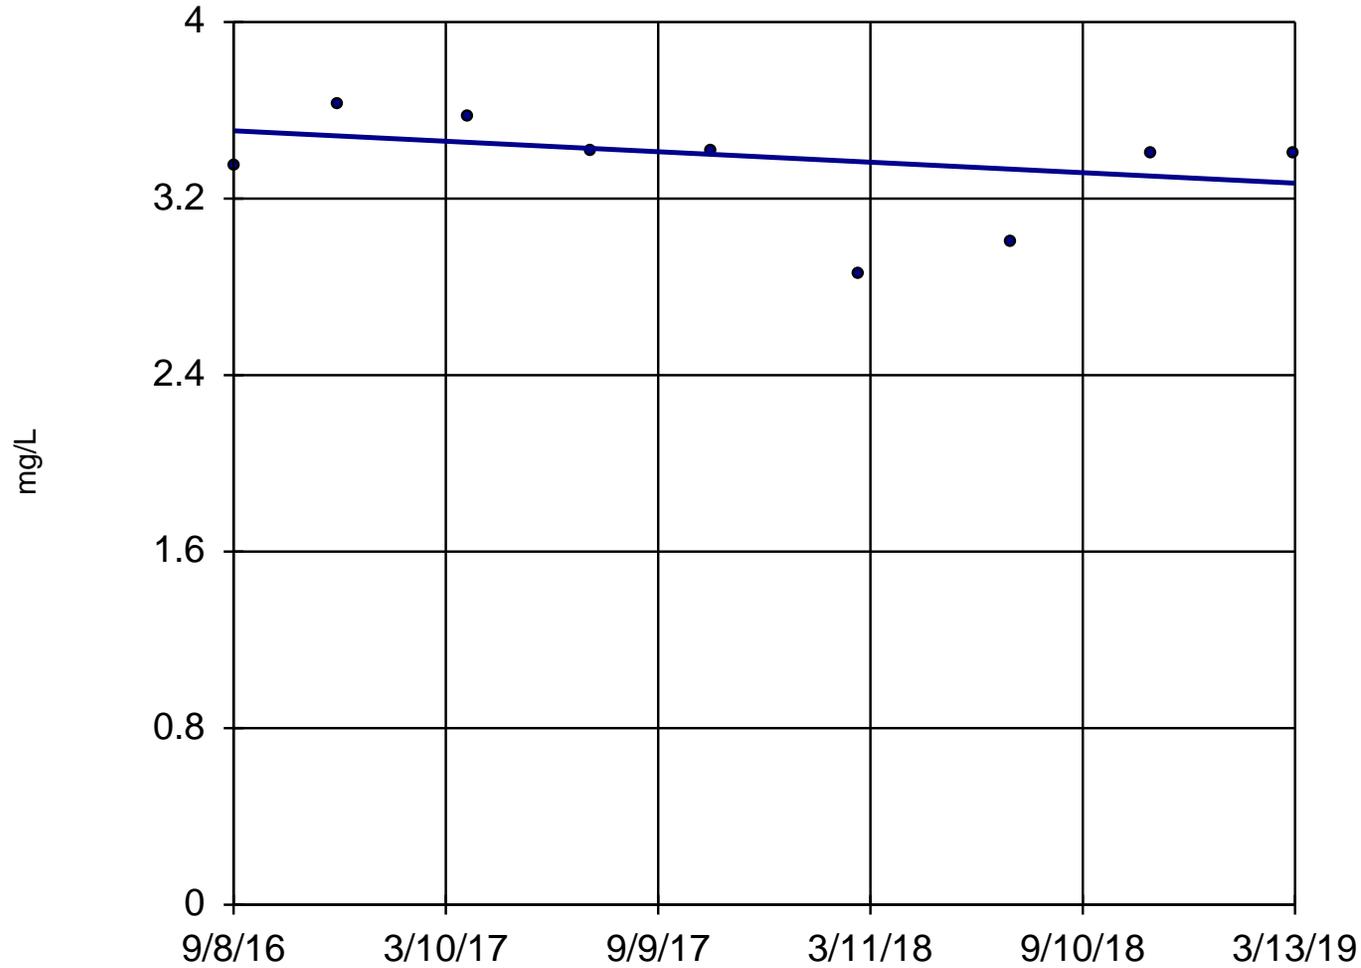

n = 9

Slope = -0.09433
units per year.

Mann-Kendall
statistic = -12
critical = -25


Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Boron Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator

DGWC-40

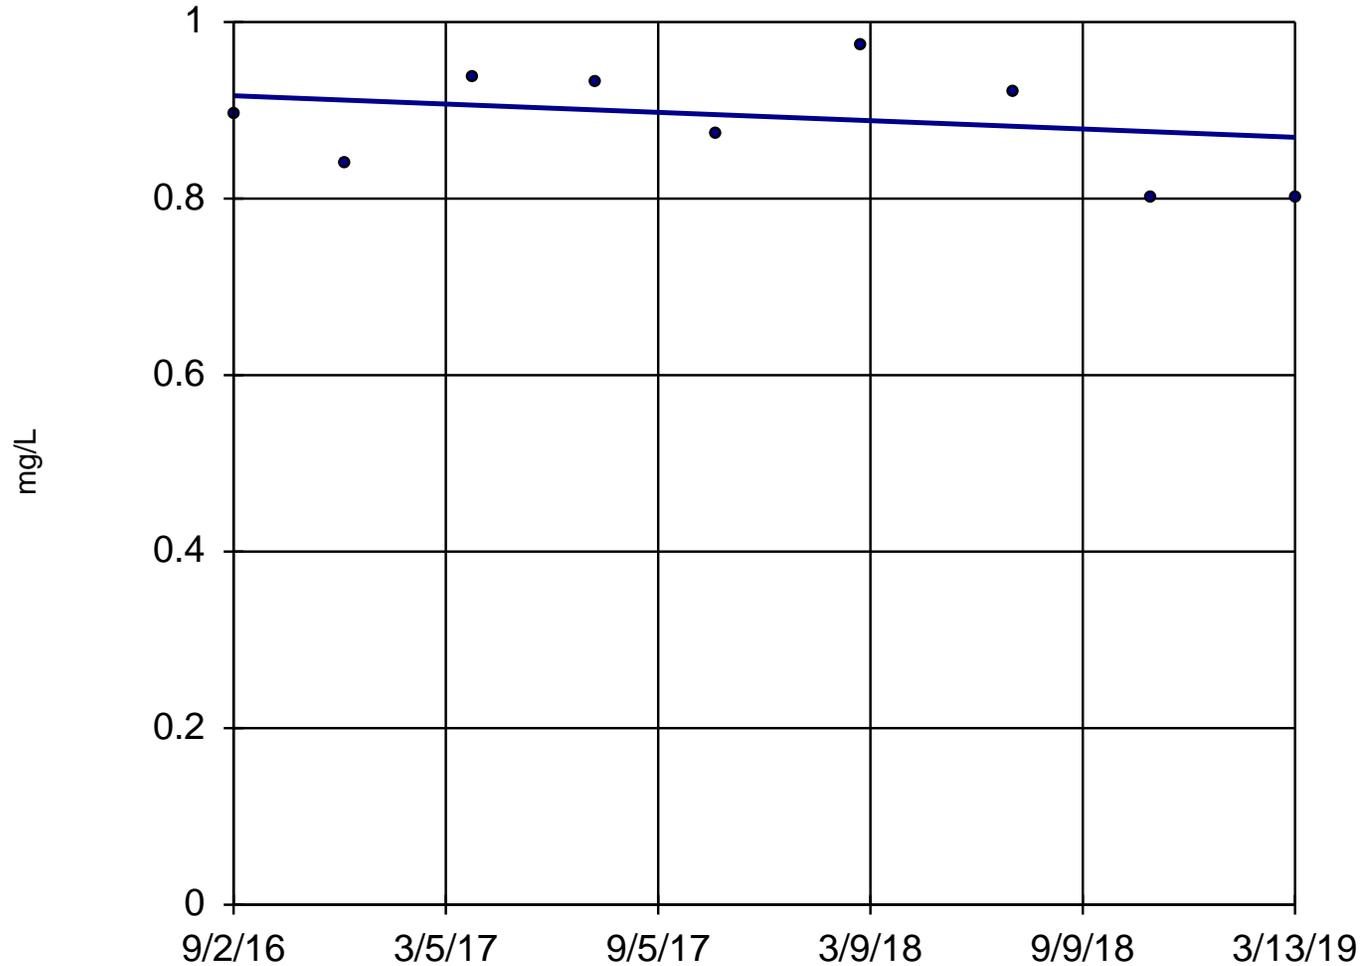

n = 9

Slope = -0.01865
units per year.


Mann-Kendall
statistic = -9
critical = -25

Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Boron Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1


McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator DGWA-53 (bg)

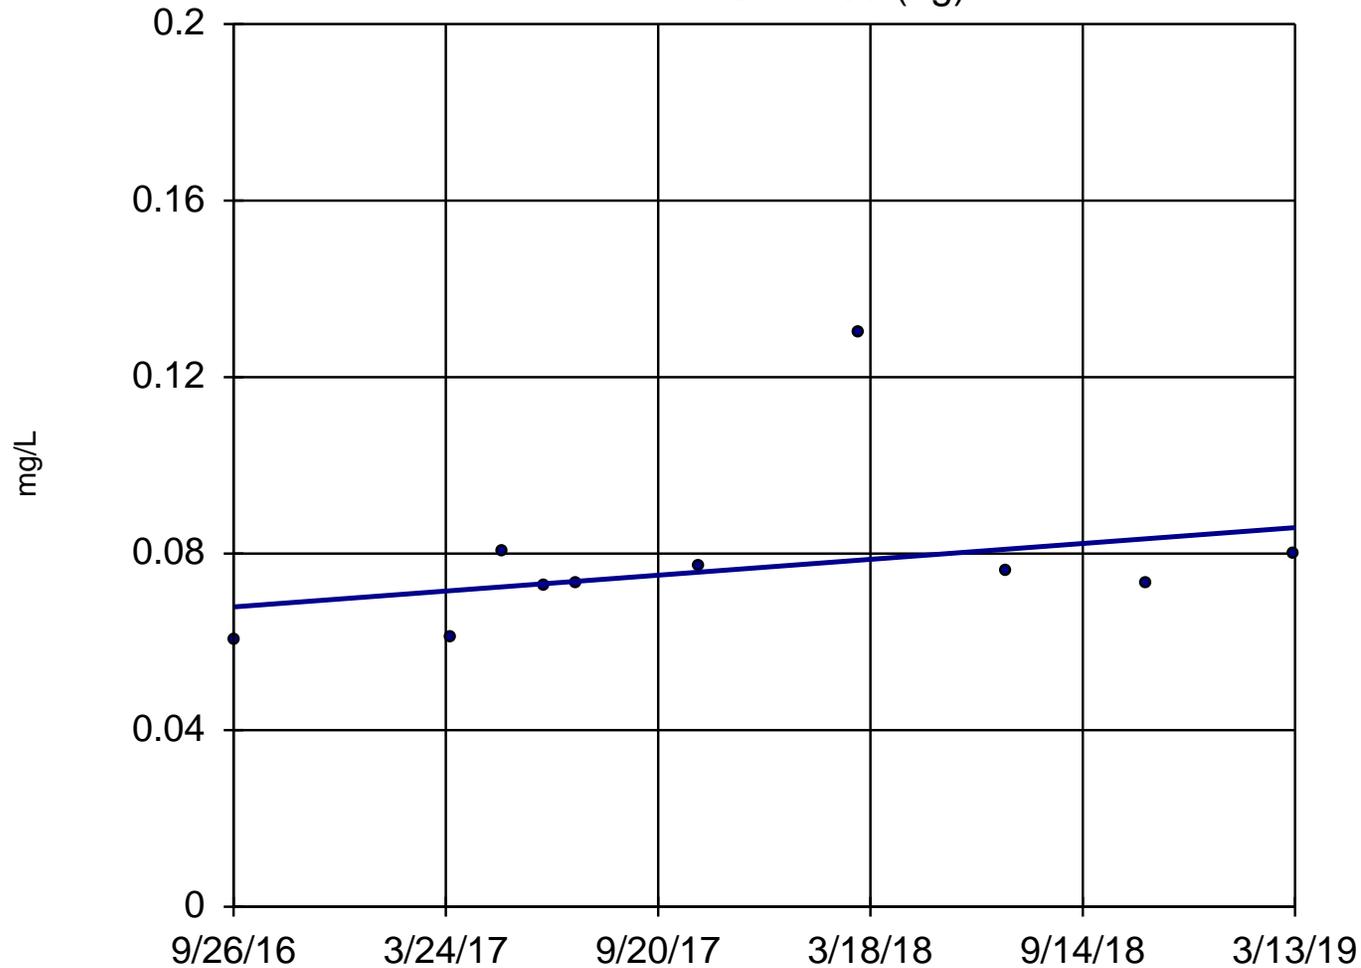

n = 10
Slope = 0.007312
units per year.
Mann-Kendall
statistic = 19
critical = 30
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).


Sen's Slope Estimator DGWA-71 (bg)

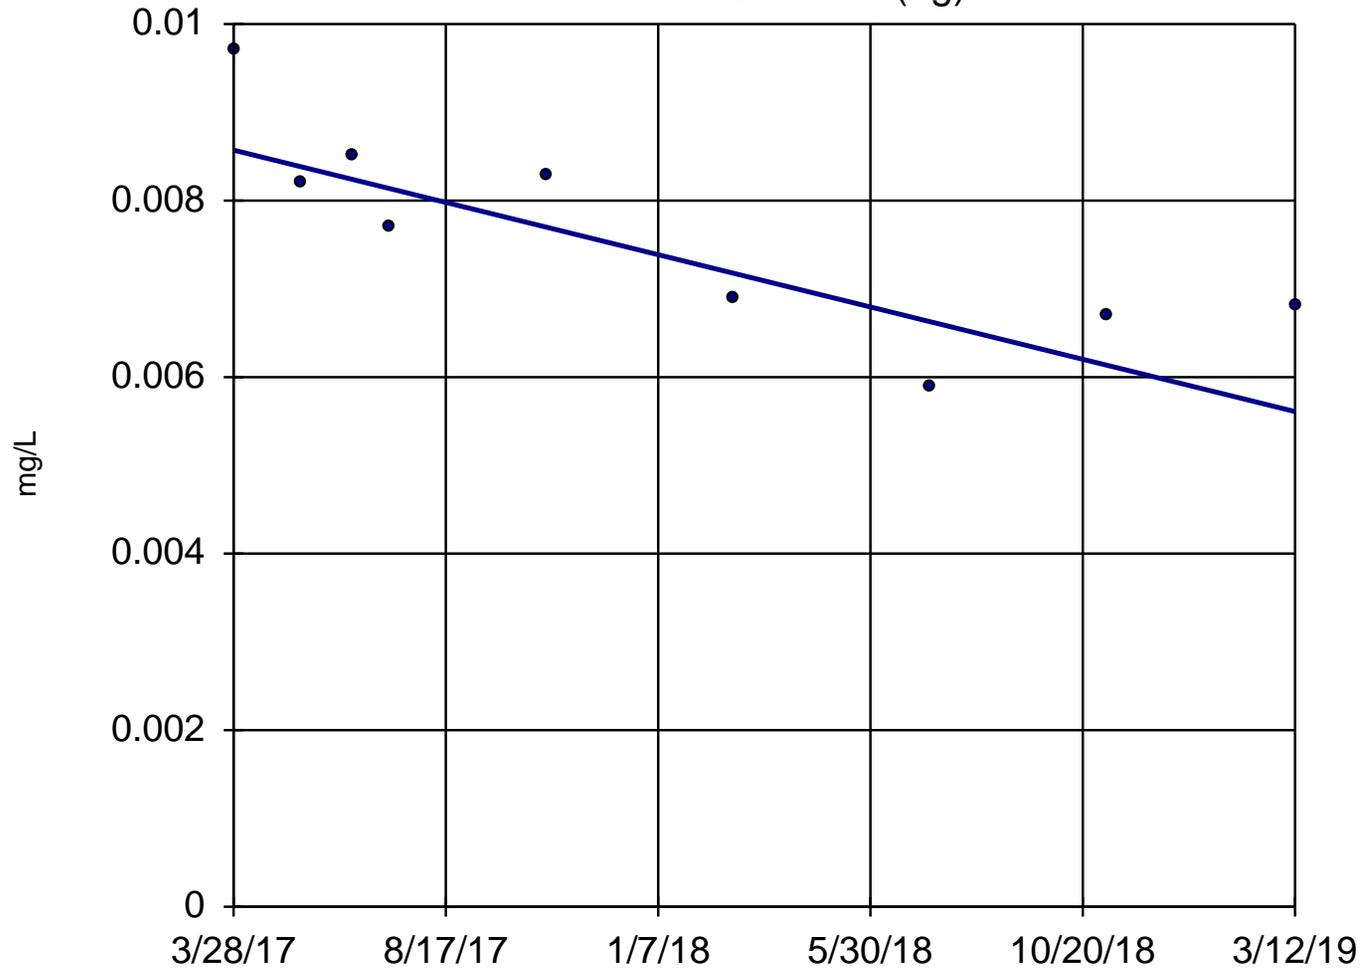

n = 9
Slope = -0.001514
units per year.
Mann-Kendall
statistic = -24
critical = -25
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Sen's Slope Estimator

DGWC-67

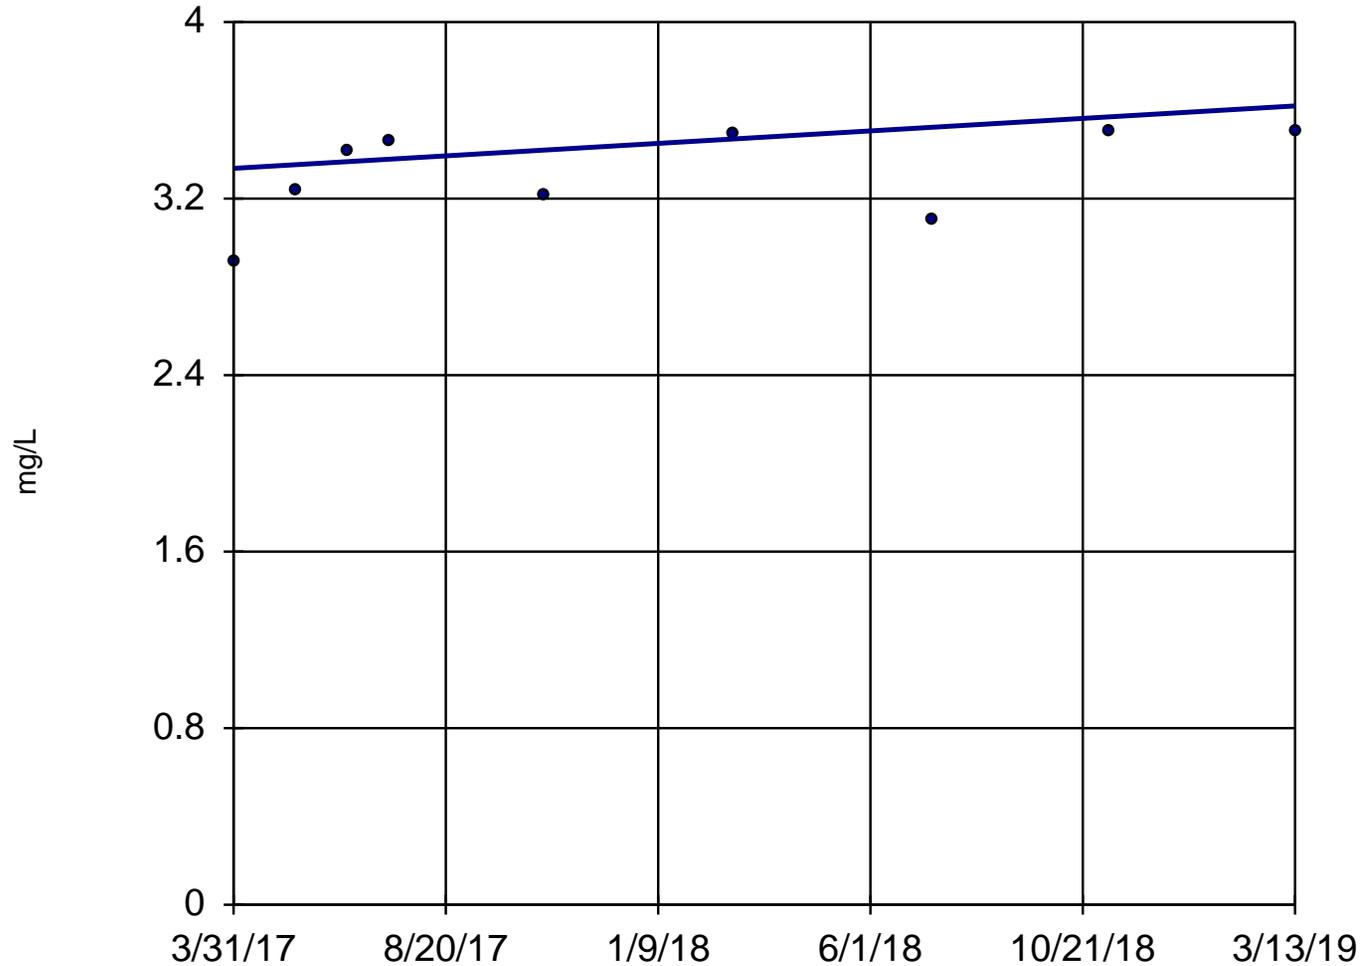

n = 9

Slope = 0.1448
units per year.


Mann-Kendall
statistic = 19
critical = 25

Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Boron Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated


Sen's Slope Estimator DGWA-70A (bg)

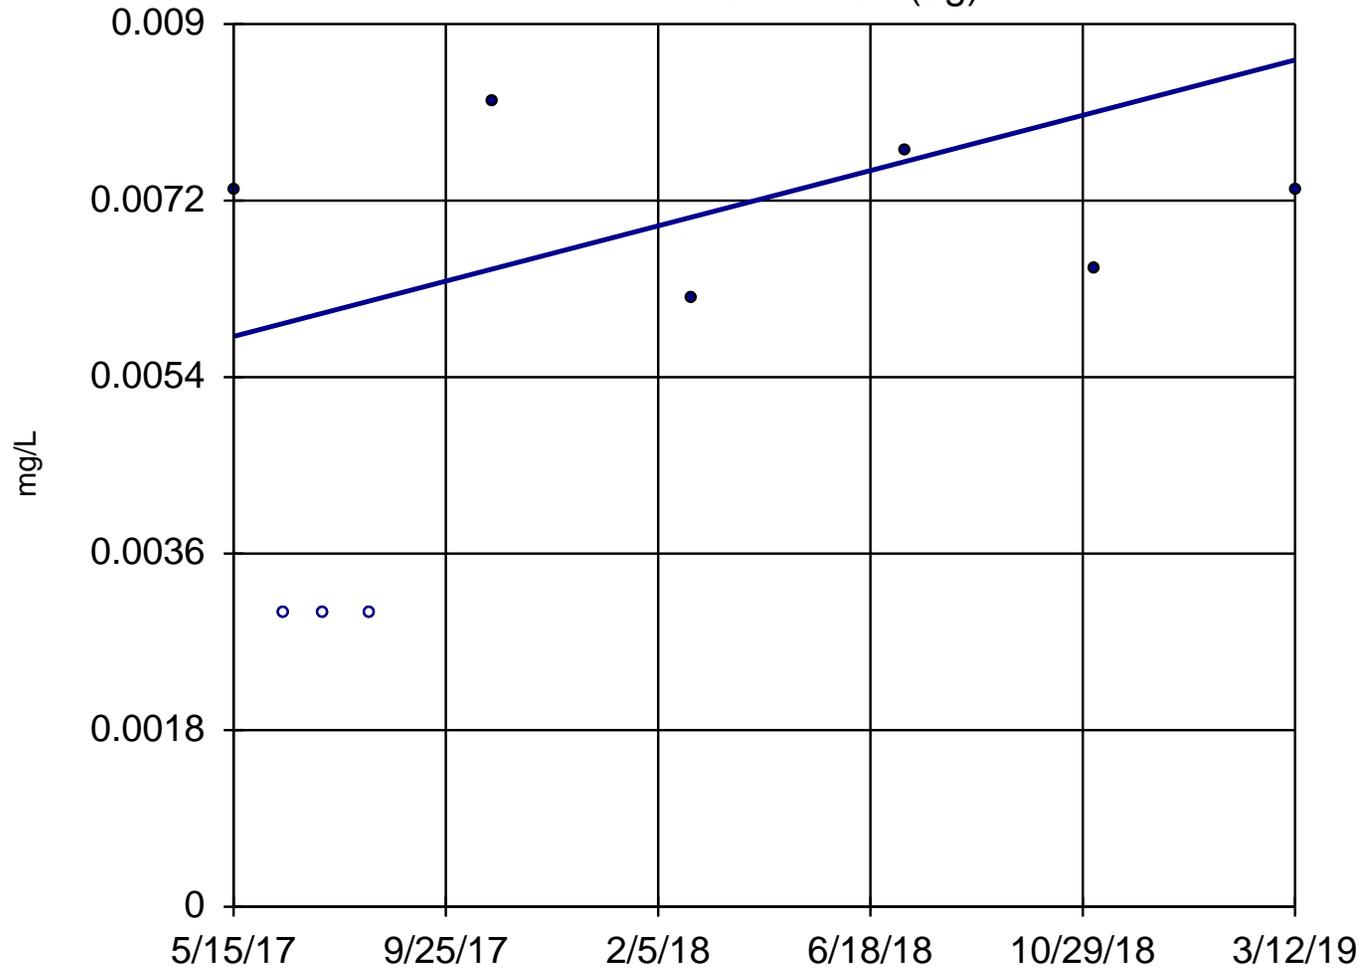

n = 9
Slope = 0.001545
units per year.
Mann-Kendall
statistic = 10
critical = 25
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Sen's Slope Estimator

DGWC-68A

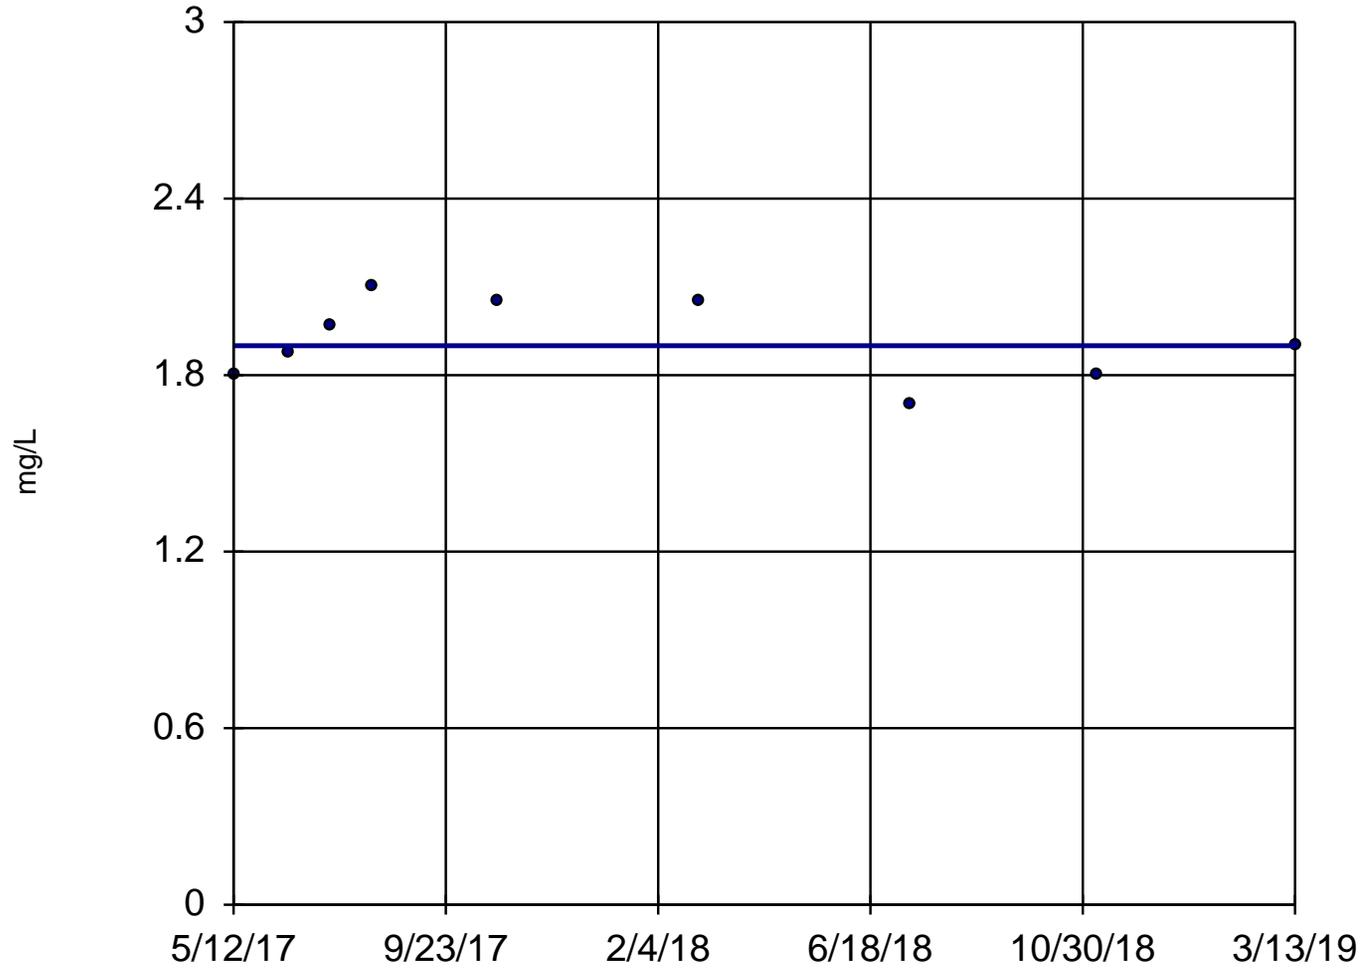

n = 9

Slope = 0
units per year.


Mann-Kendall
statistic = 0
critical = 25

Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Boron Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator DGWC-37

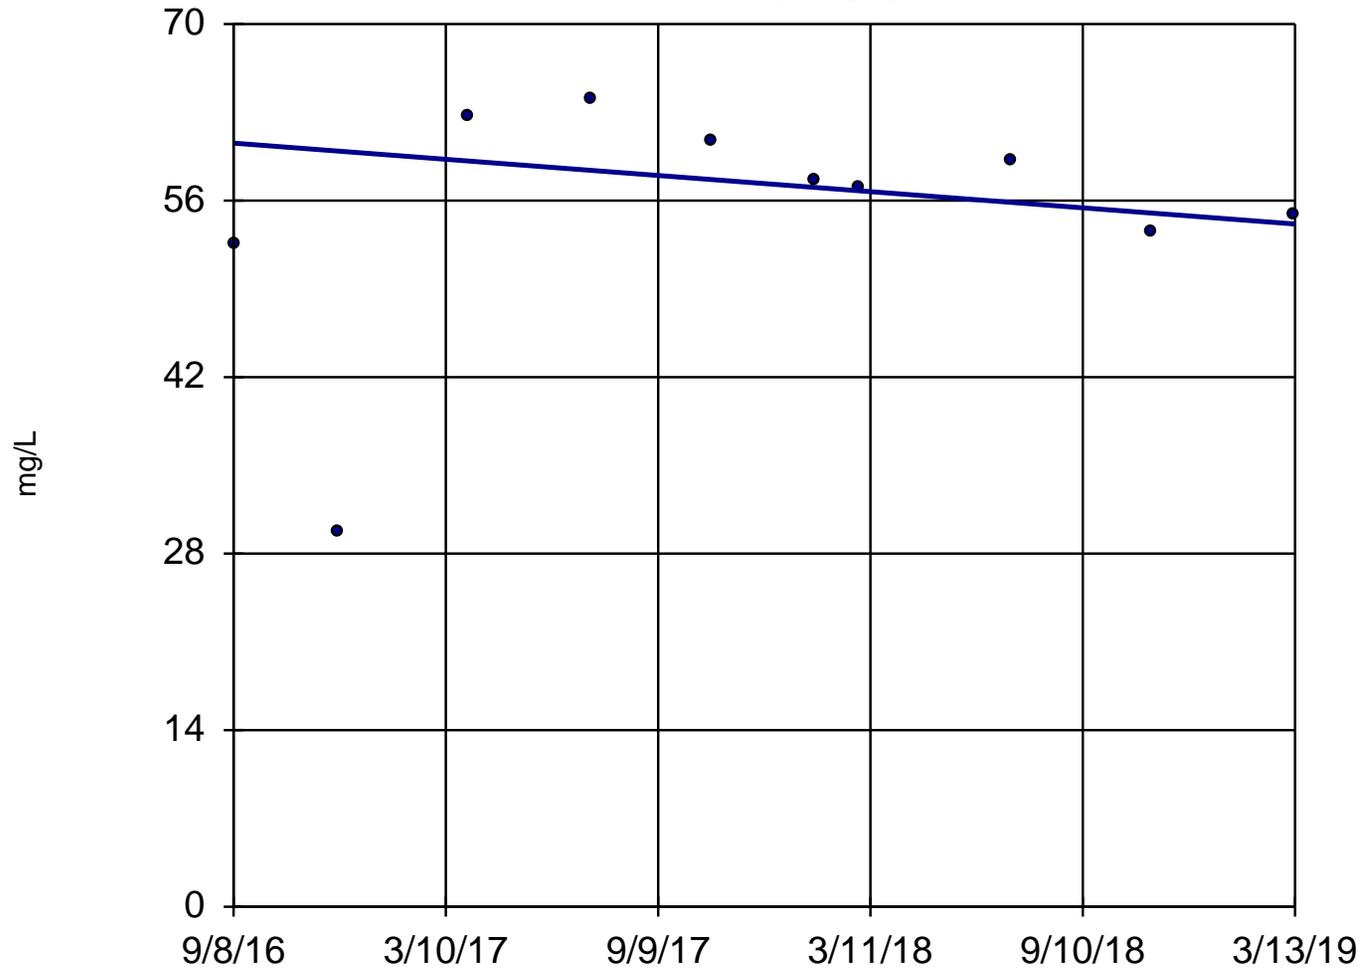

n = 10

Slope = -2.557
units per year.

Mann-Kendall
statistic = -5
critical = -30


Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Calcium Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator

DGWC-38

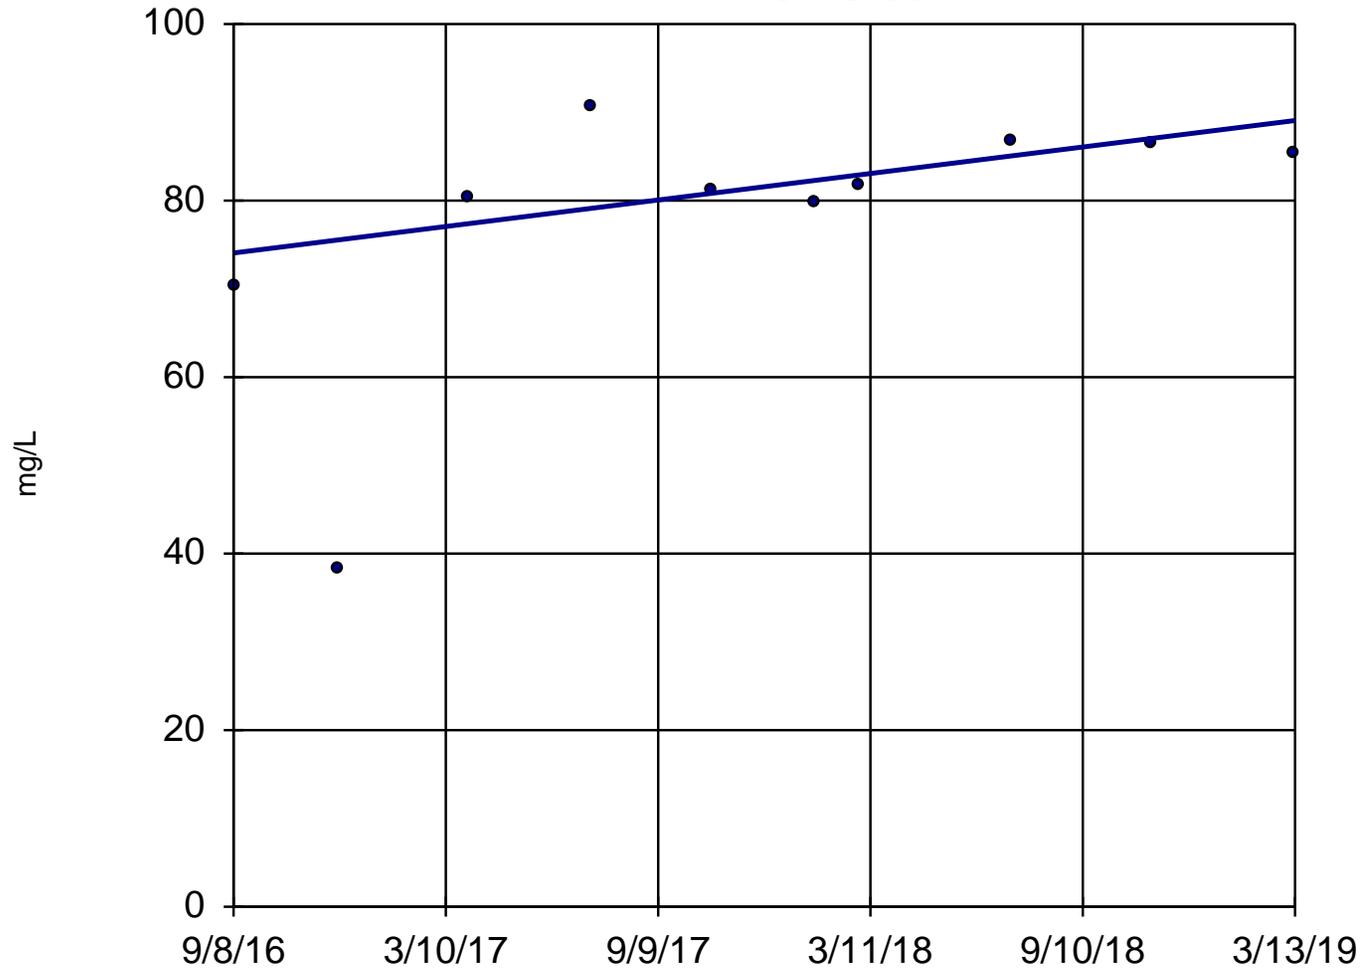

n = 10

Slope = 5.977
units per year.

Mann-Kendall
statistic = 21
critical = 30


Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Calcium Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator

DGWC-39

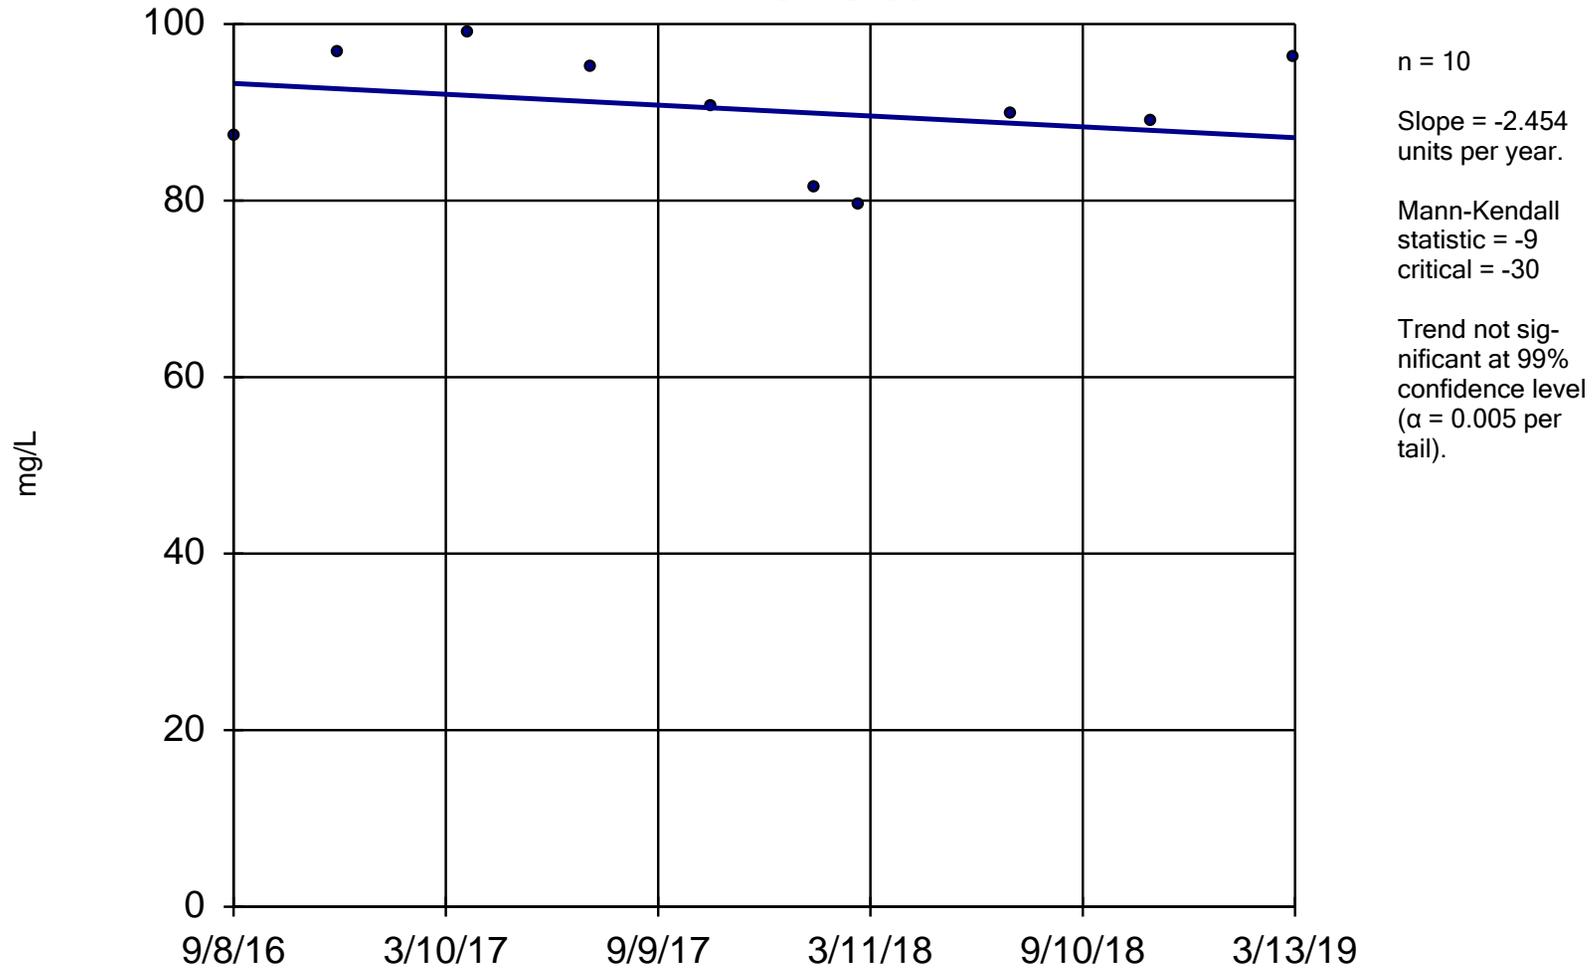


Constituent: Calcium Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator

DGWC-40

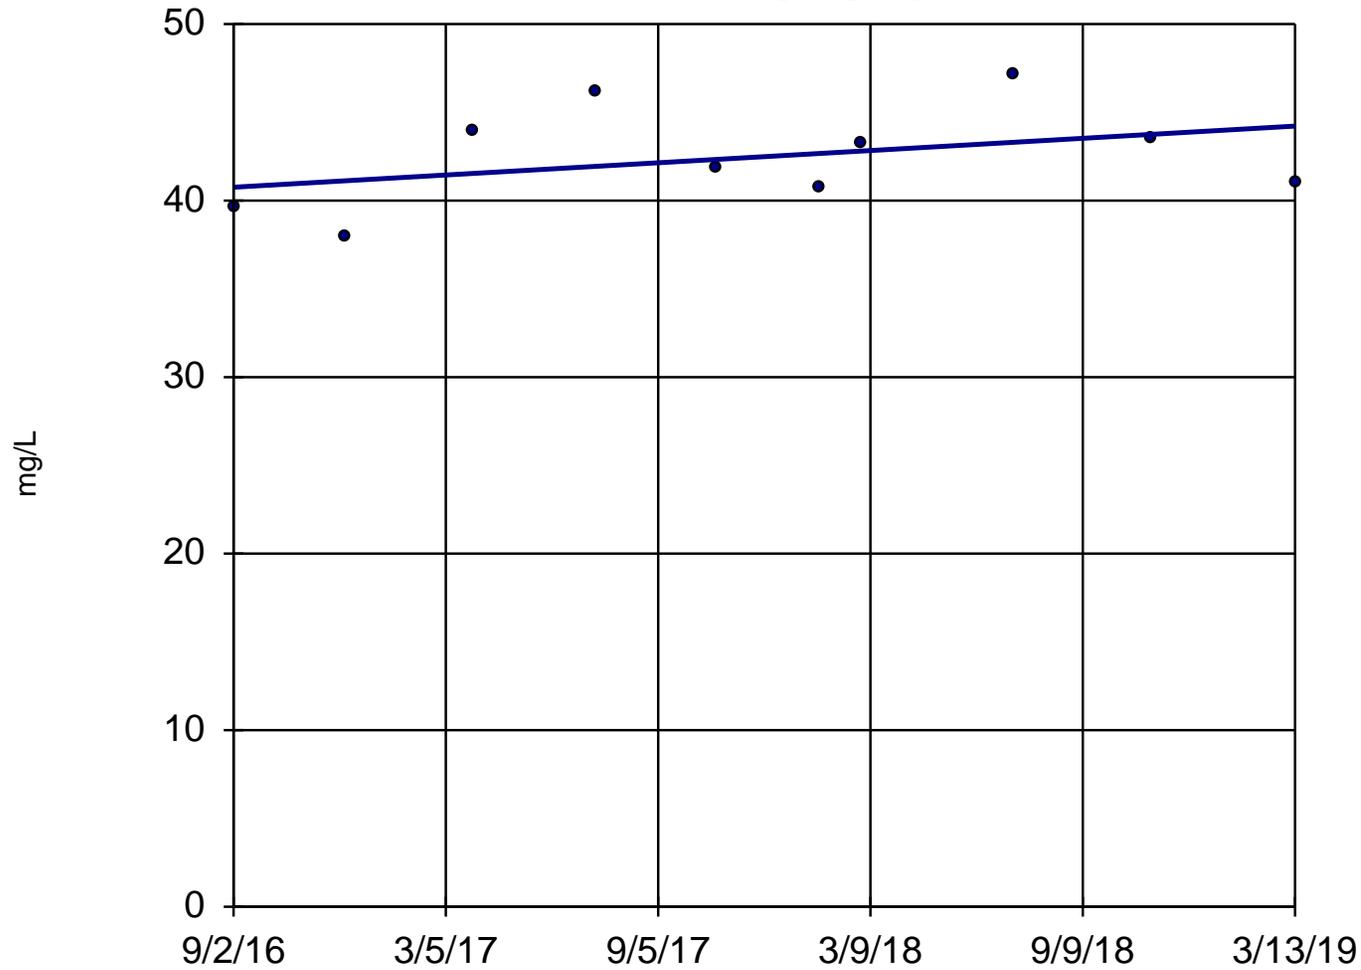

n = 10

Slope = 1.372
units per year.


Mann-Kendall
statistic = 11
critical = 30

Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Calcium Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated


Sen's Slope Estimator DGWA-53 (bg)

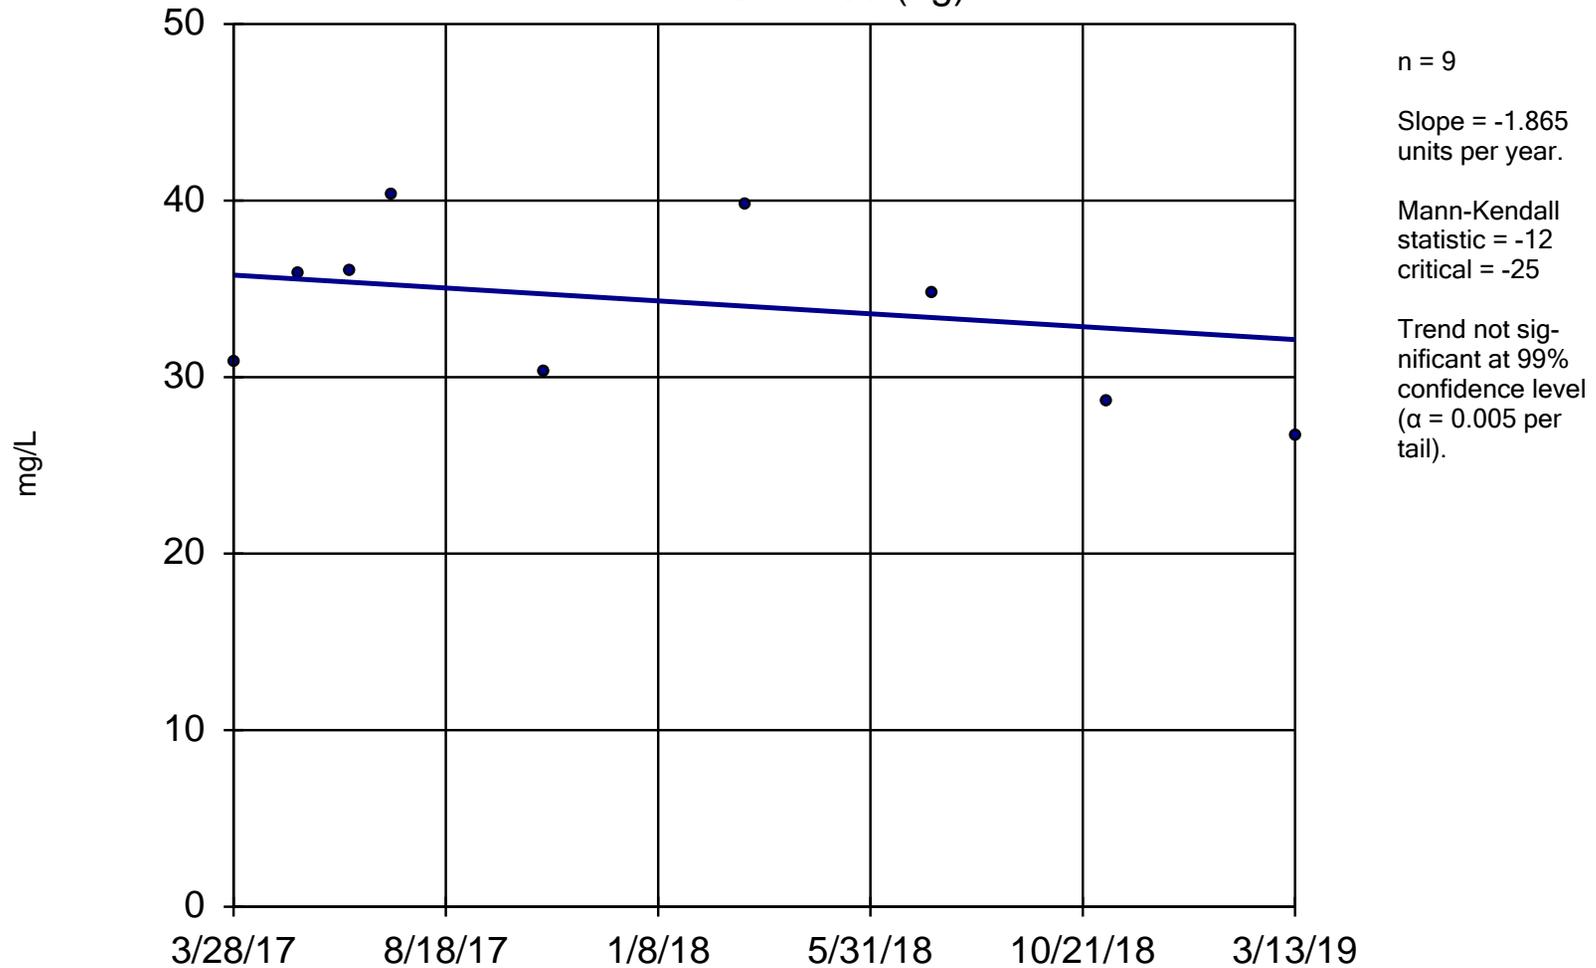

Constituent: Calcium Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator DGWA-71 (bg)

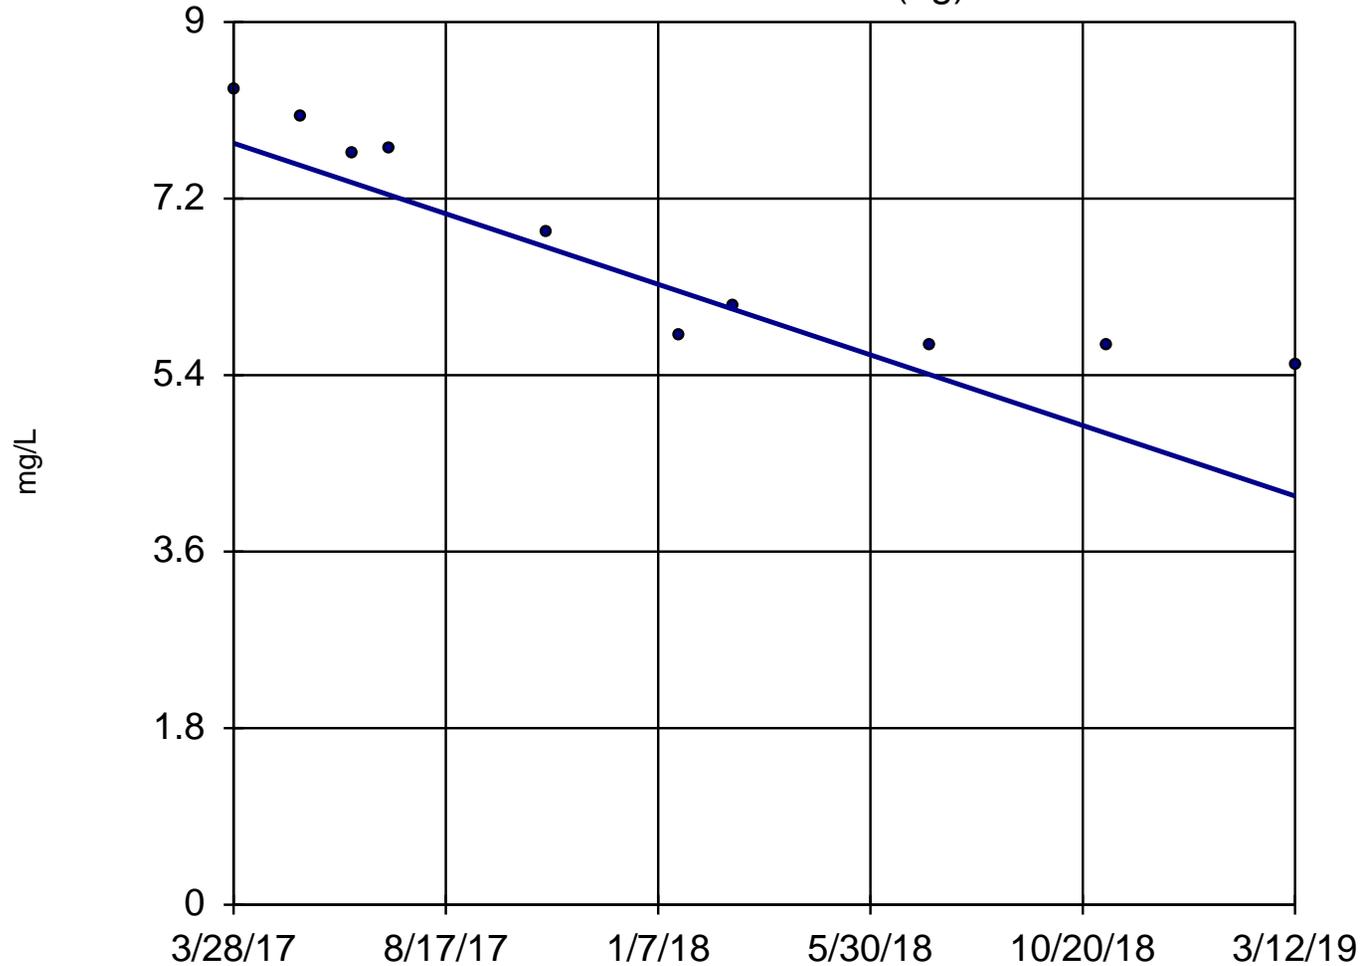

n = 10

Slope = -1.839
units per year.

Mann-Kendall
statistic = -40
critical = -30


Decreasing trend
significant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Calcium Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator

DGWC-67

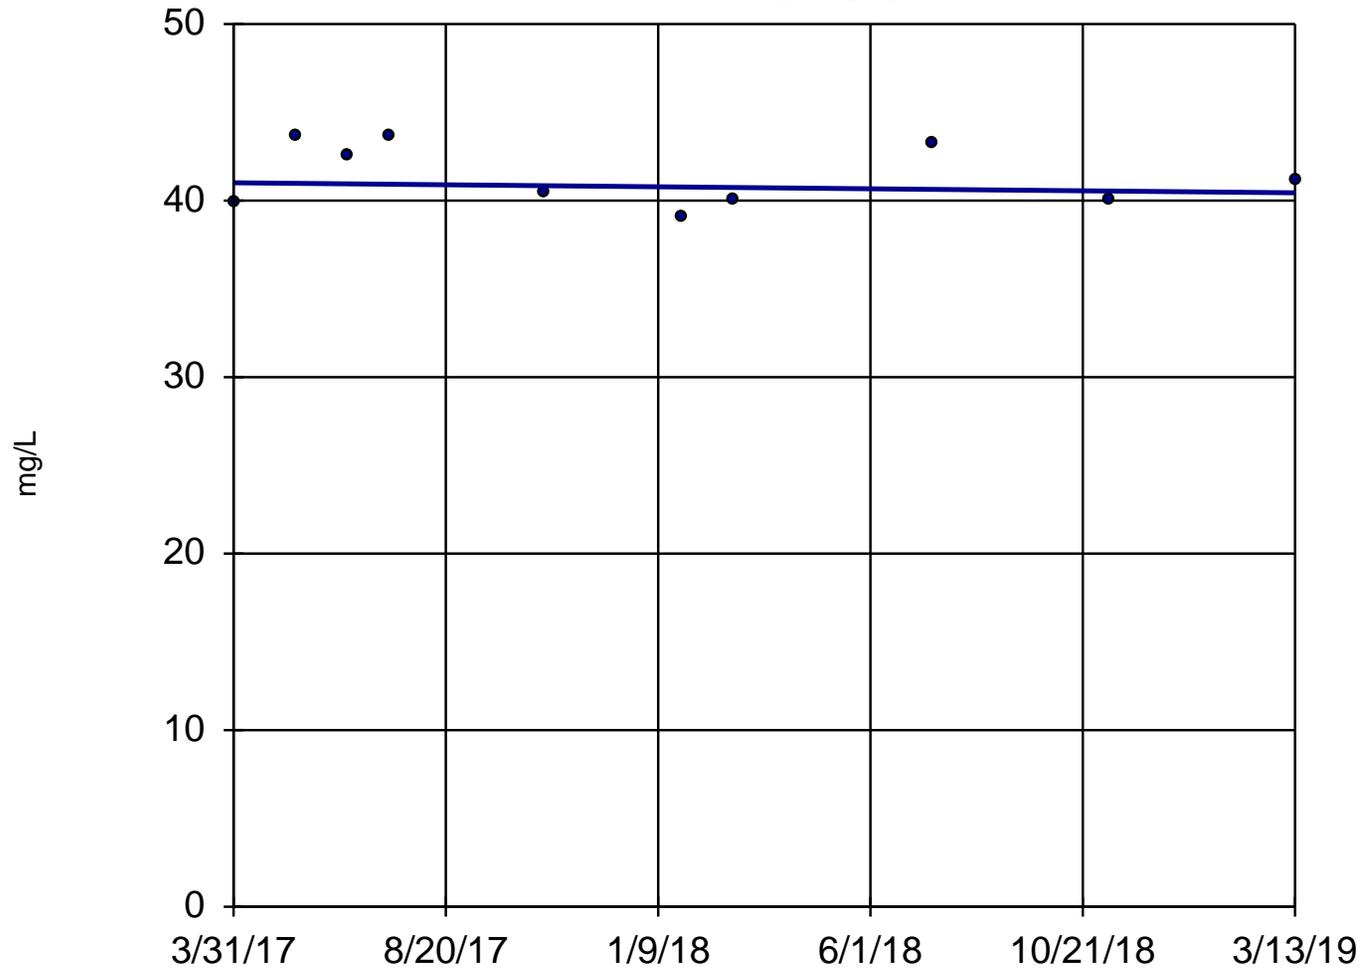

n = 10

Slope = -0.2897
units per year.


Mann-Kendall
statistic = -4
critical = -30

Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Calcium Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated


Sen's Slope Estimator DGWA-70A (bg)

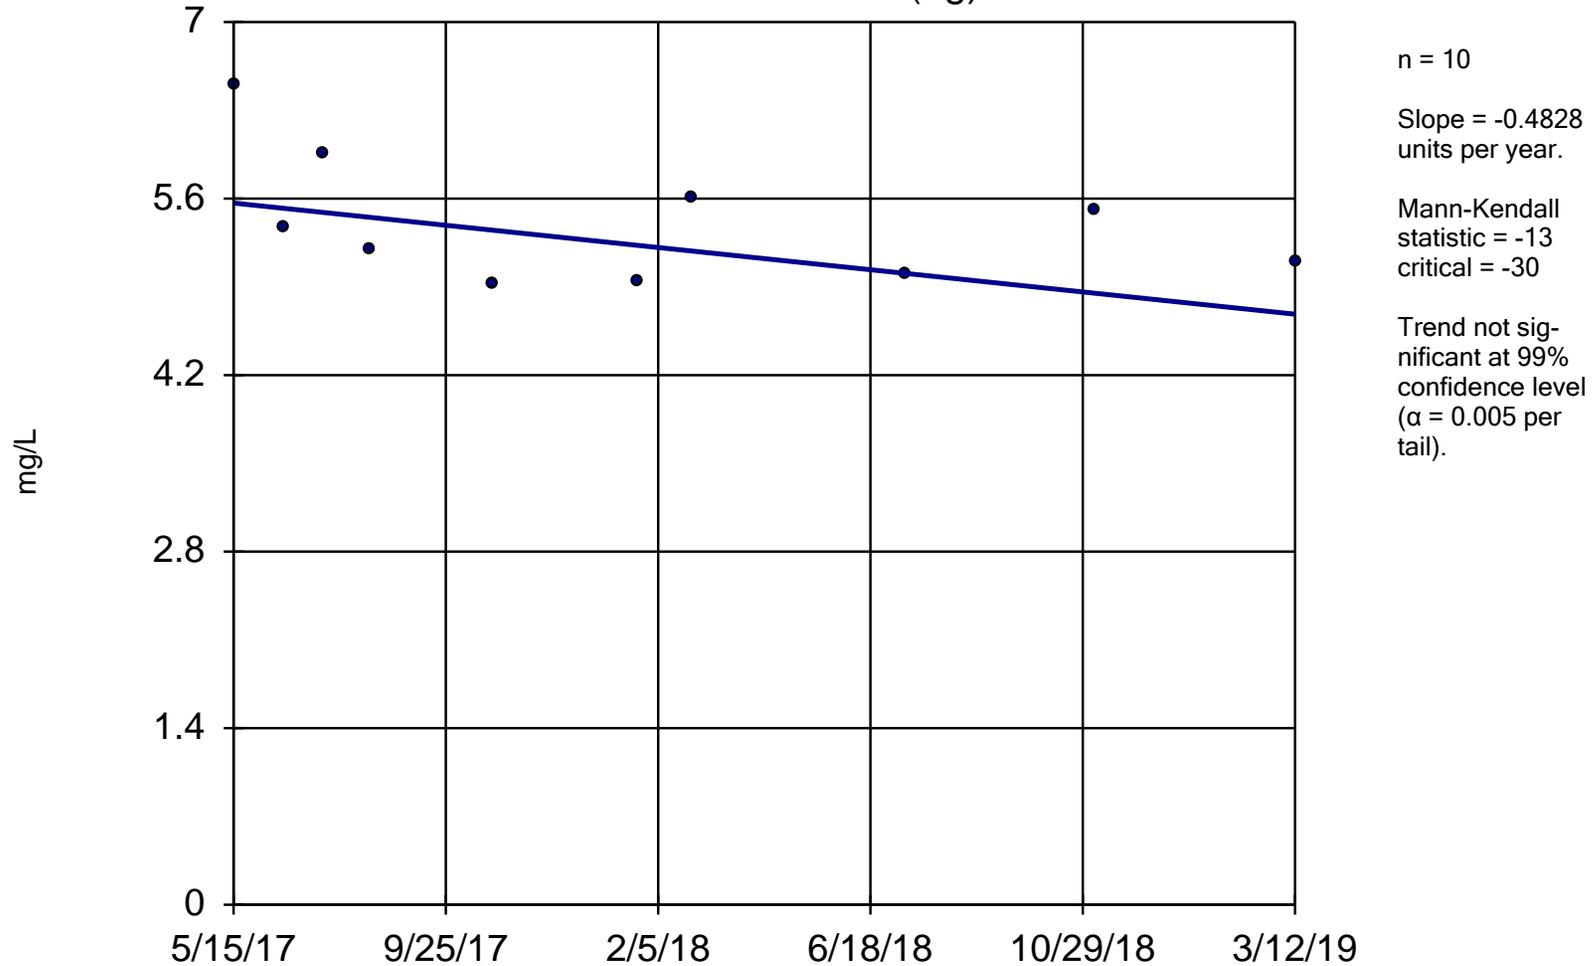

Constituent: Calcium Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1
McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator

DGWC-68A

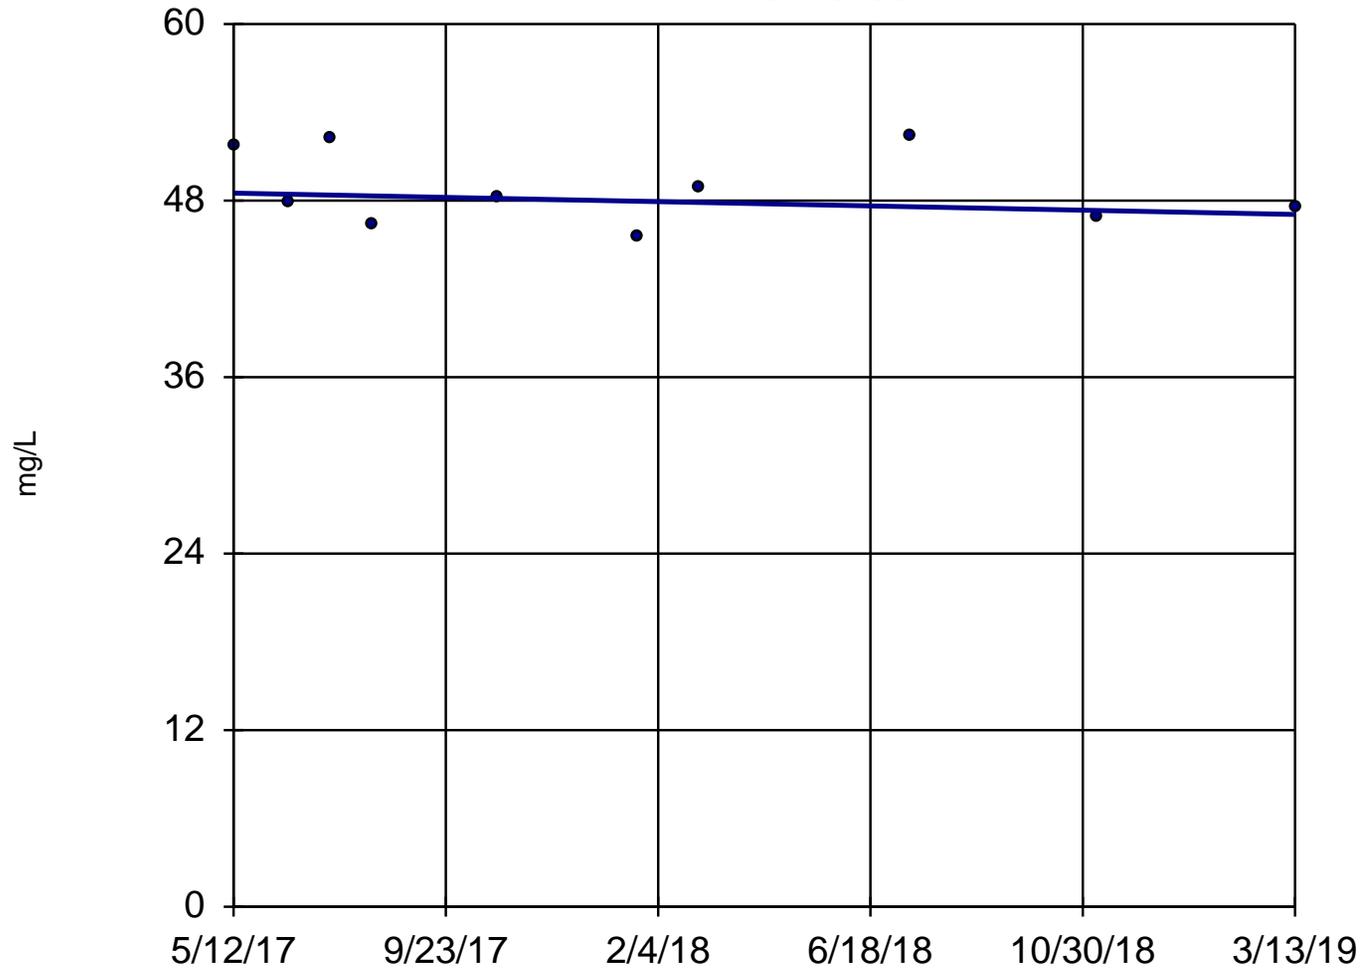

n = 10

Slope = -0.7873
units per year.

Mann-Kendall
statistic = -5
critical = -30


Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Calcium Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator

DGWC-37

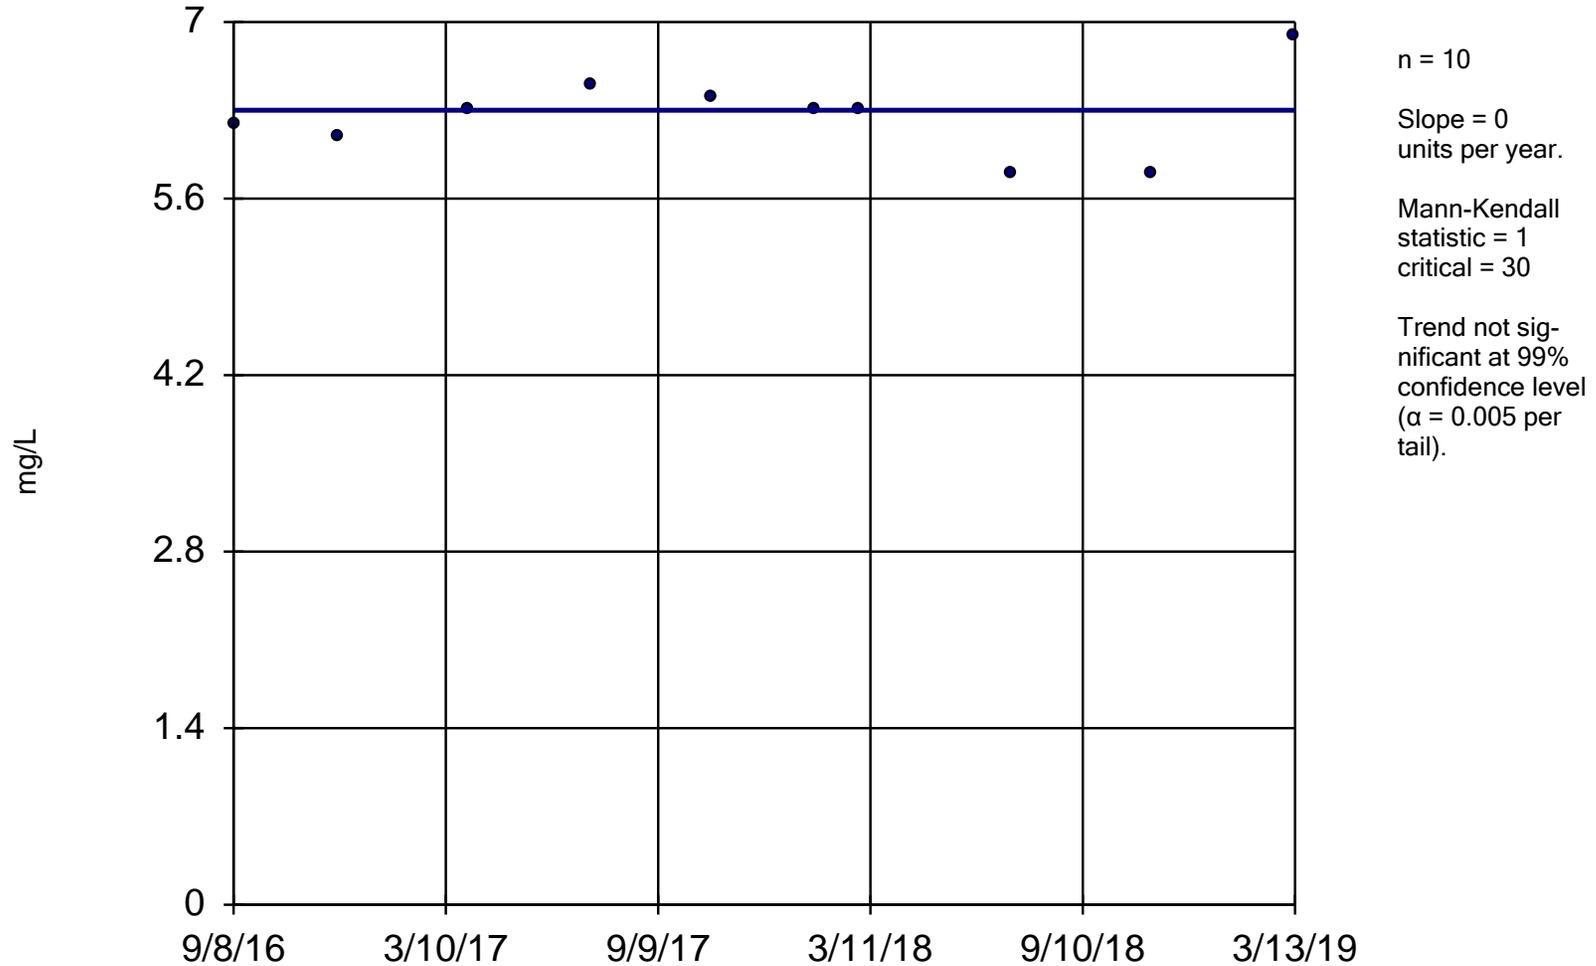


Constituent: Chloride Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator

DGWC-38

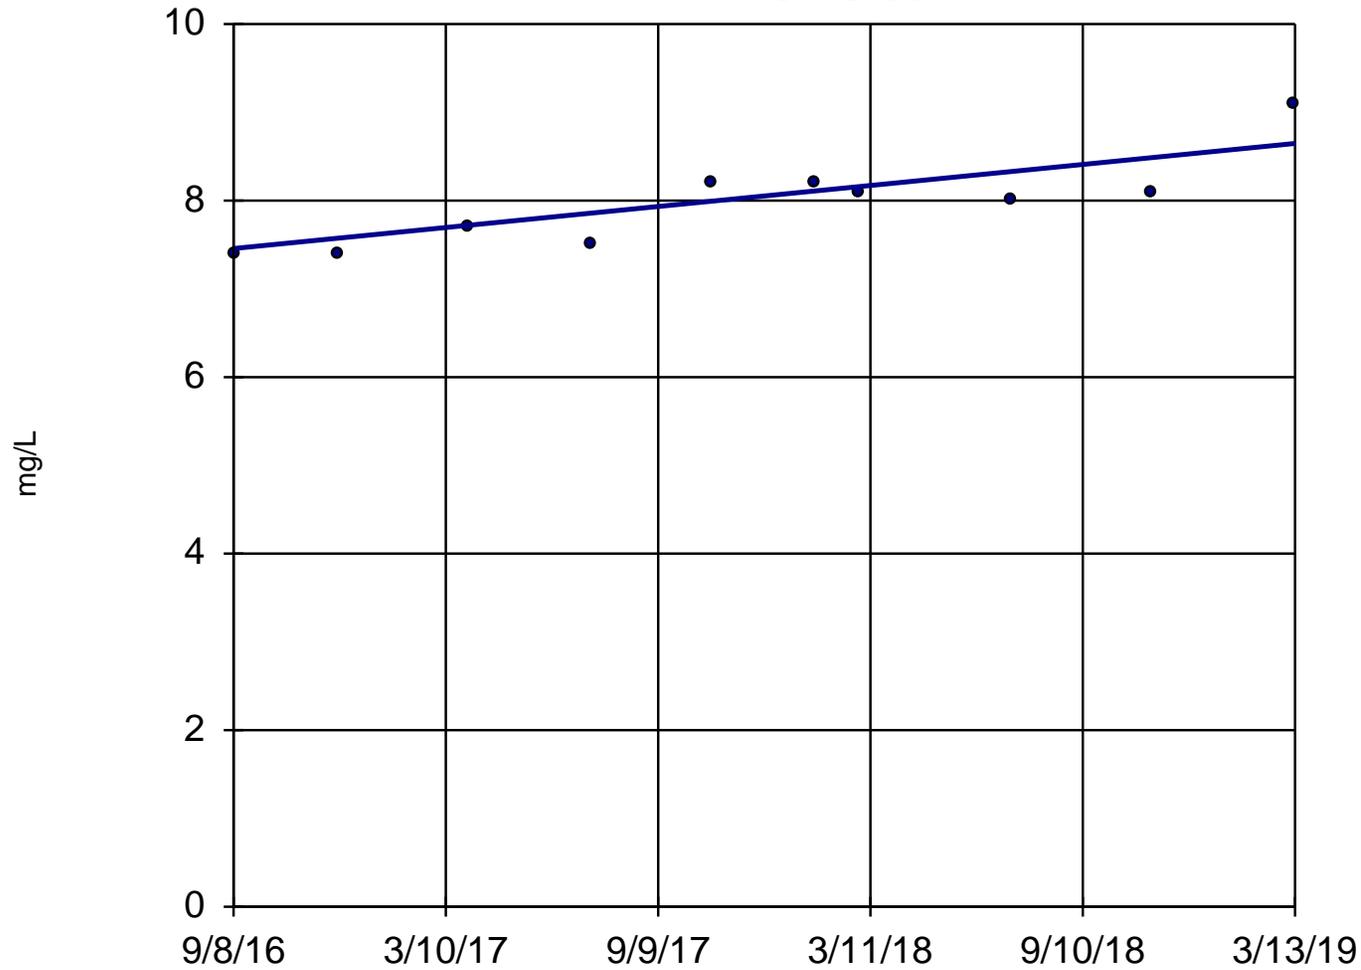

n = 10

Slope = 0.474
units per year.

Mann-Kendall
statistic = 26
critical = 30


Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Chloride Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator

DGWC-39

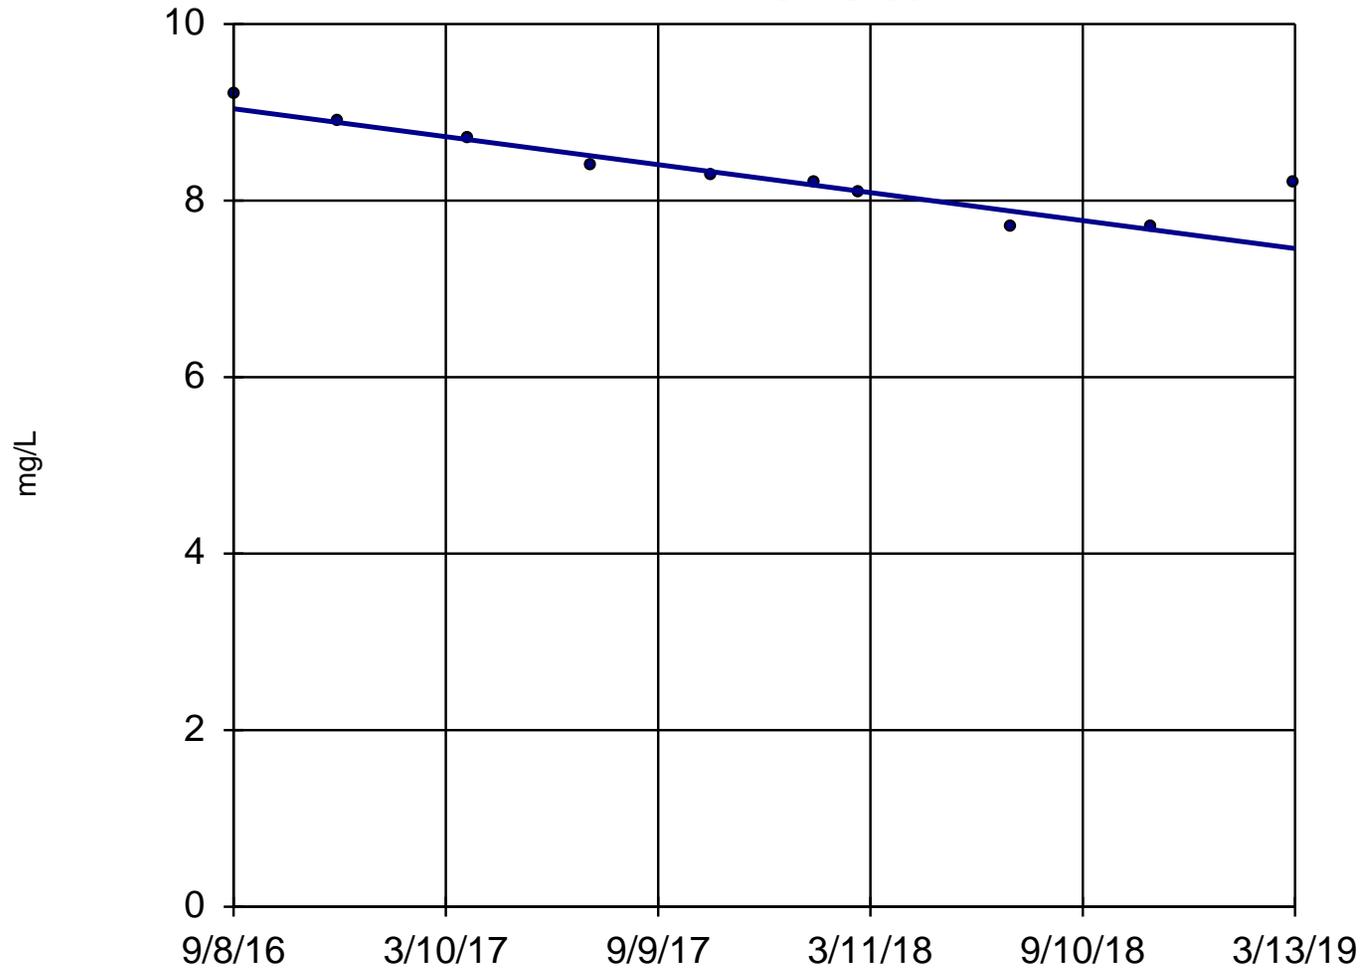

n = 10

Slope = -0.6315
units per year.

Mann-Kendall
statistic = -37
critical = -30


Decreasing trend
significant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Chloride Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator

DGWC-40

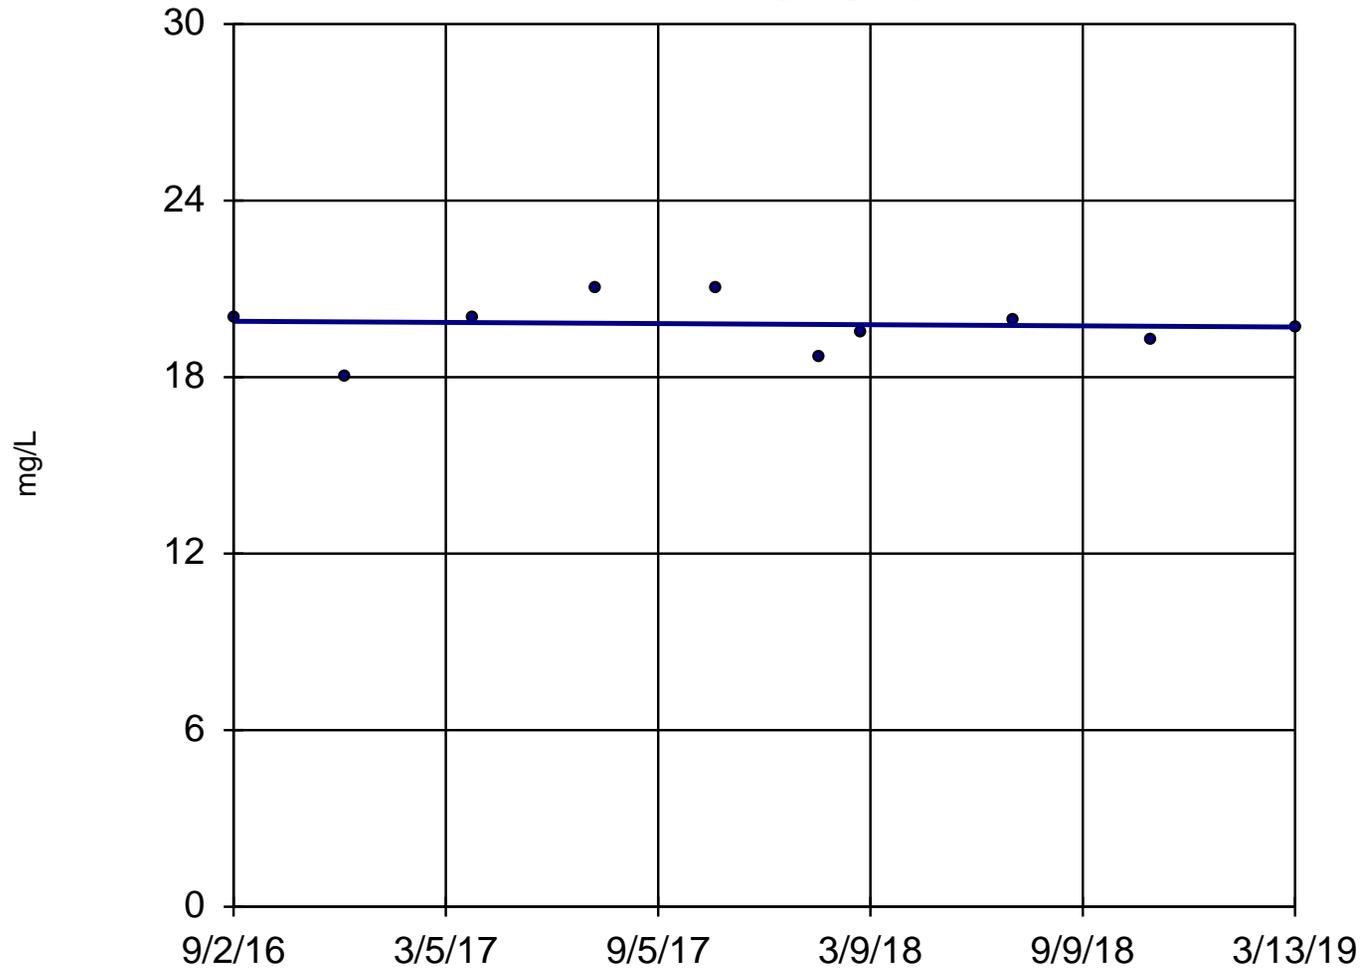

n = 10

Slope = -0.07783
units per year.


Mann-Kendall
statistic = -5
critical = -30

Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Chloride Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1


McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator DGWA-53 (bg)

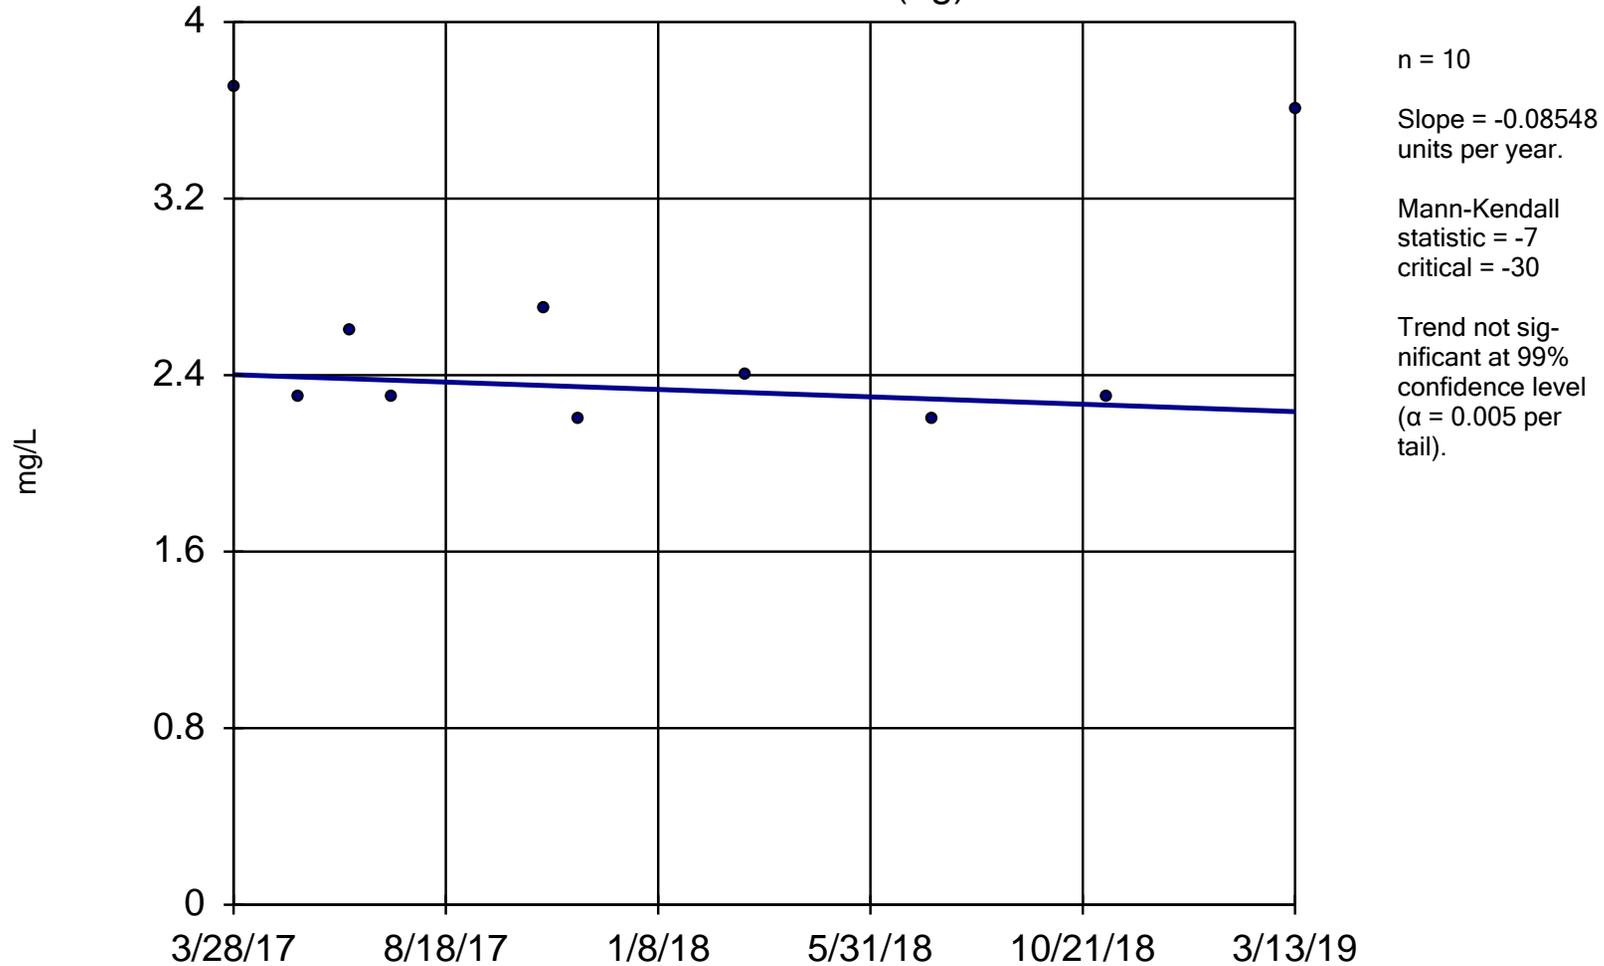

Constituent: Chloride Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1
McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated


Sen's Slope Estimator DGWA-71 (bg)

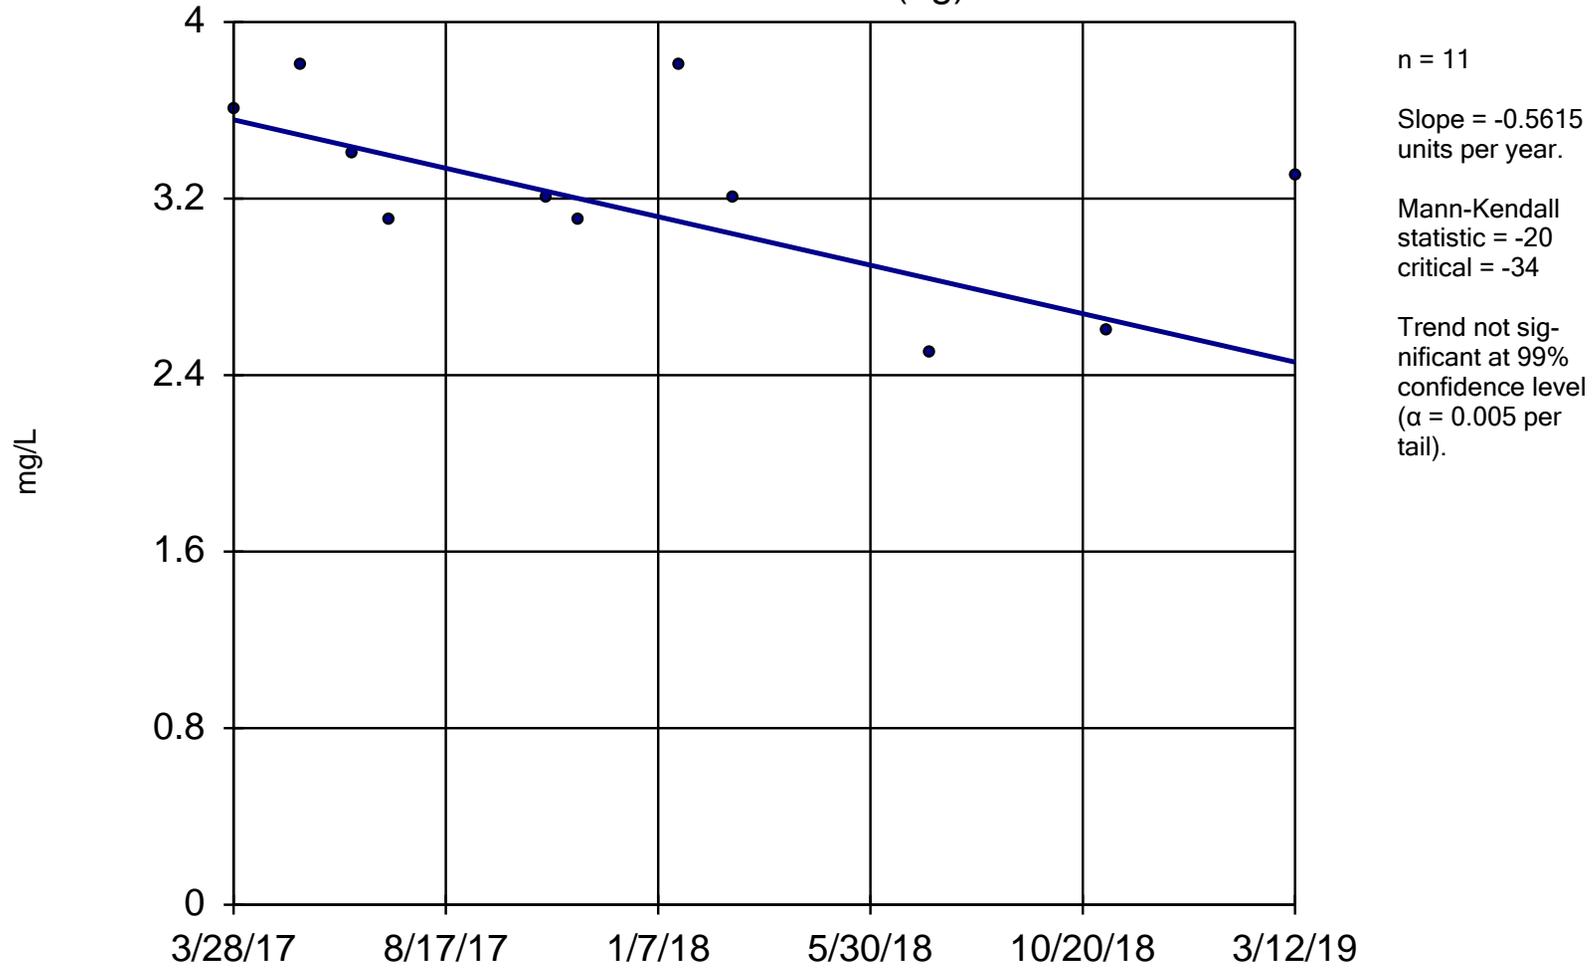

Constituent: Chloride Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1
McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator

DGWC-67

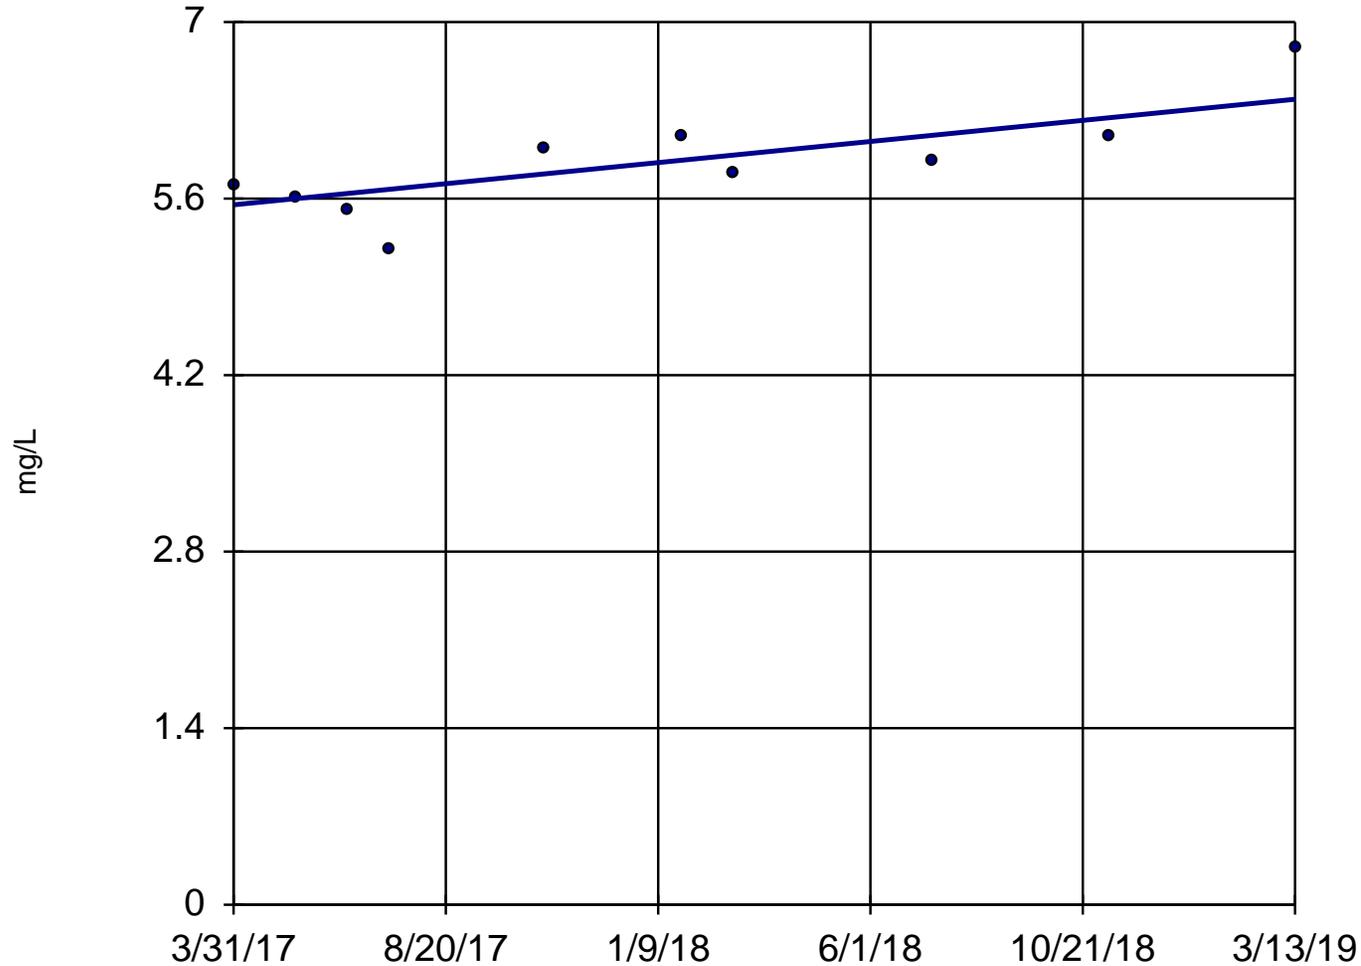

n = 10

Slope = 0.4294
units per year.

Mann-Kendall
statistic = 24
critical = 30


Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Chloride Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator

DGWC-69

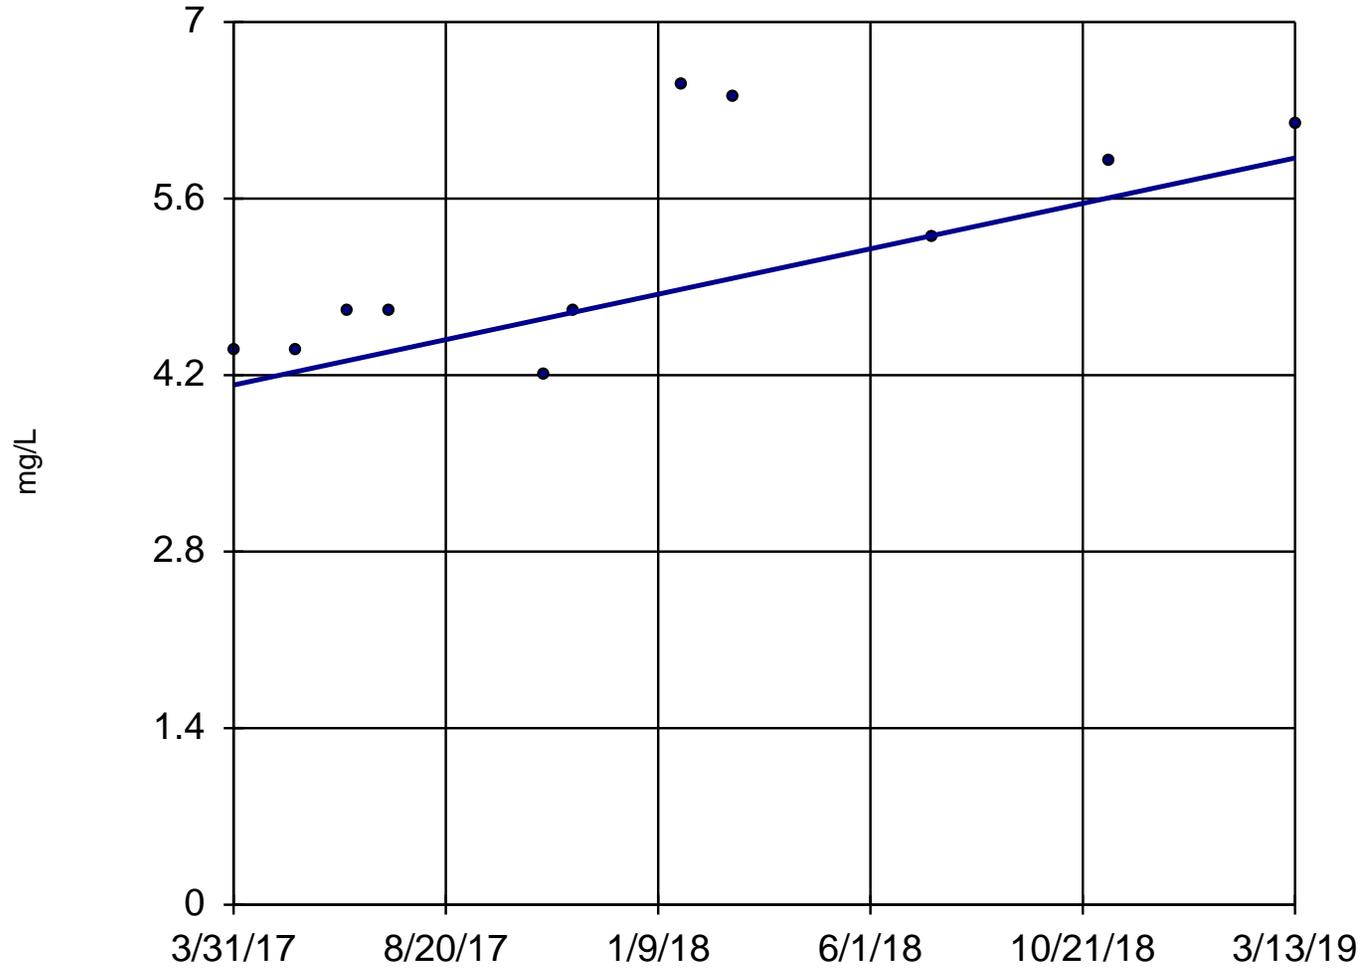

n = 11

Slope = 0.9228
units per year.


Mann-Kendall
statistic = 29
critical = 34

Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Chloride Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated


Sen's Slope Estimator DGWA-70A (bg)

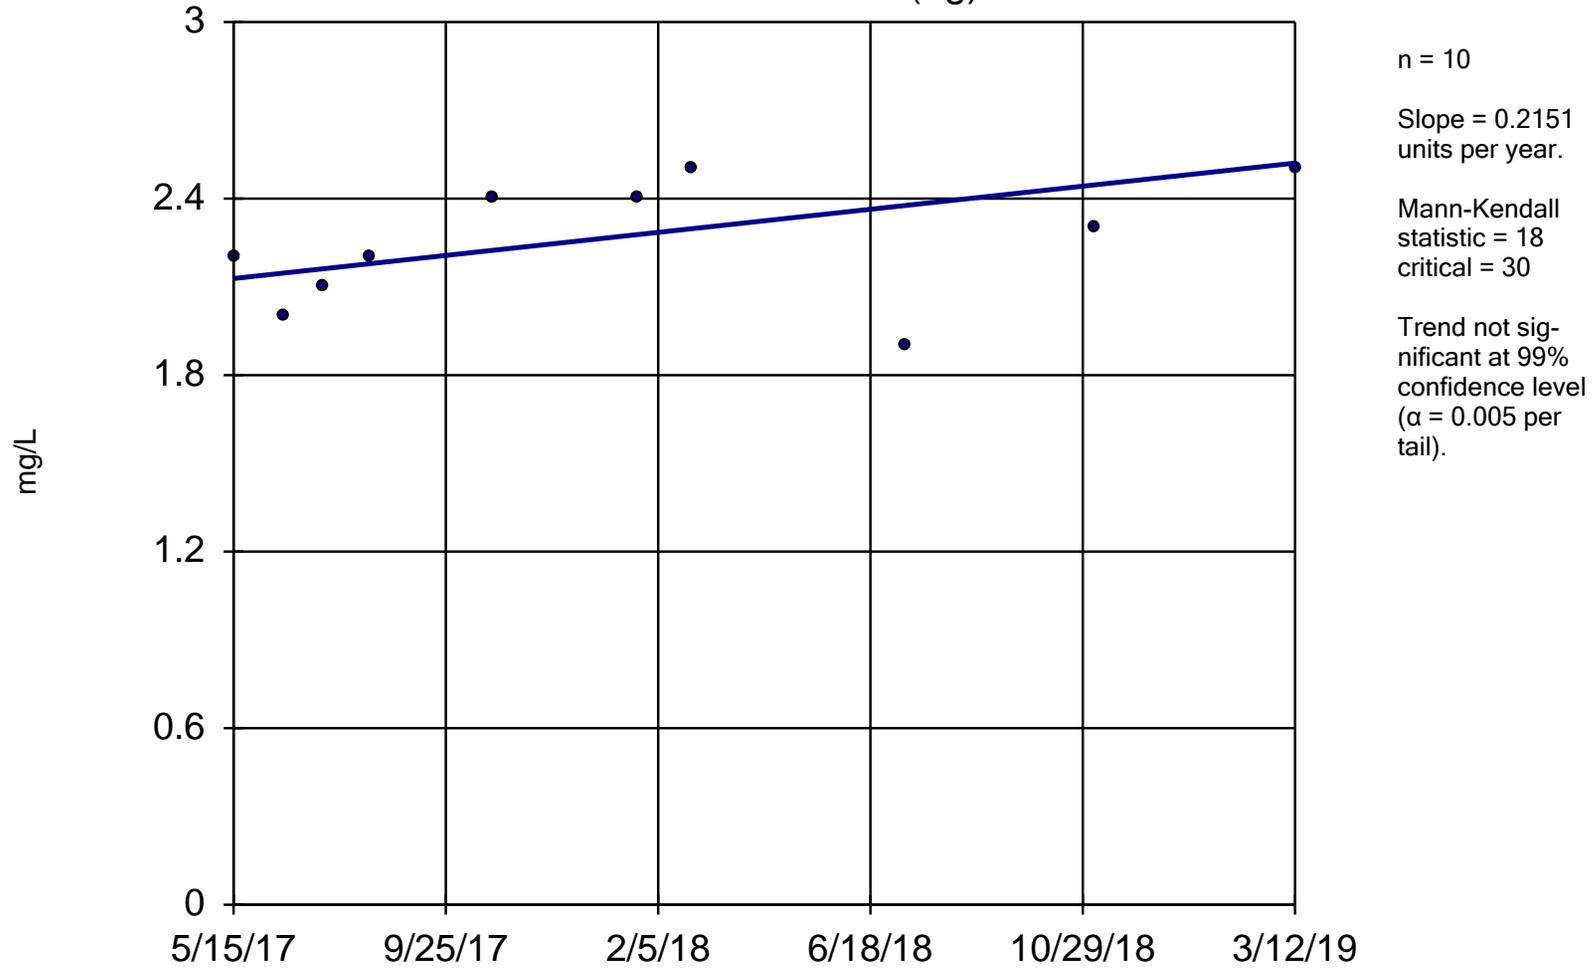

Constituent: Chloride Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1
McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator


DGWC-68A

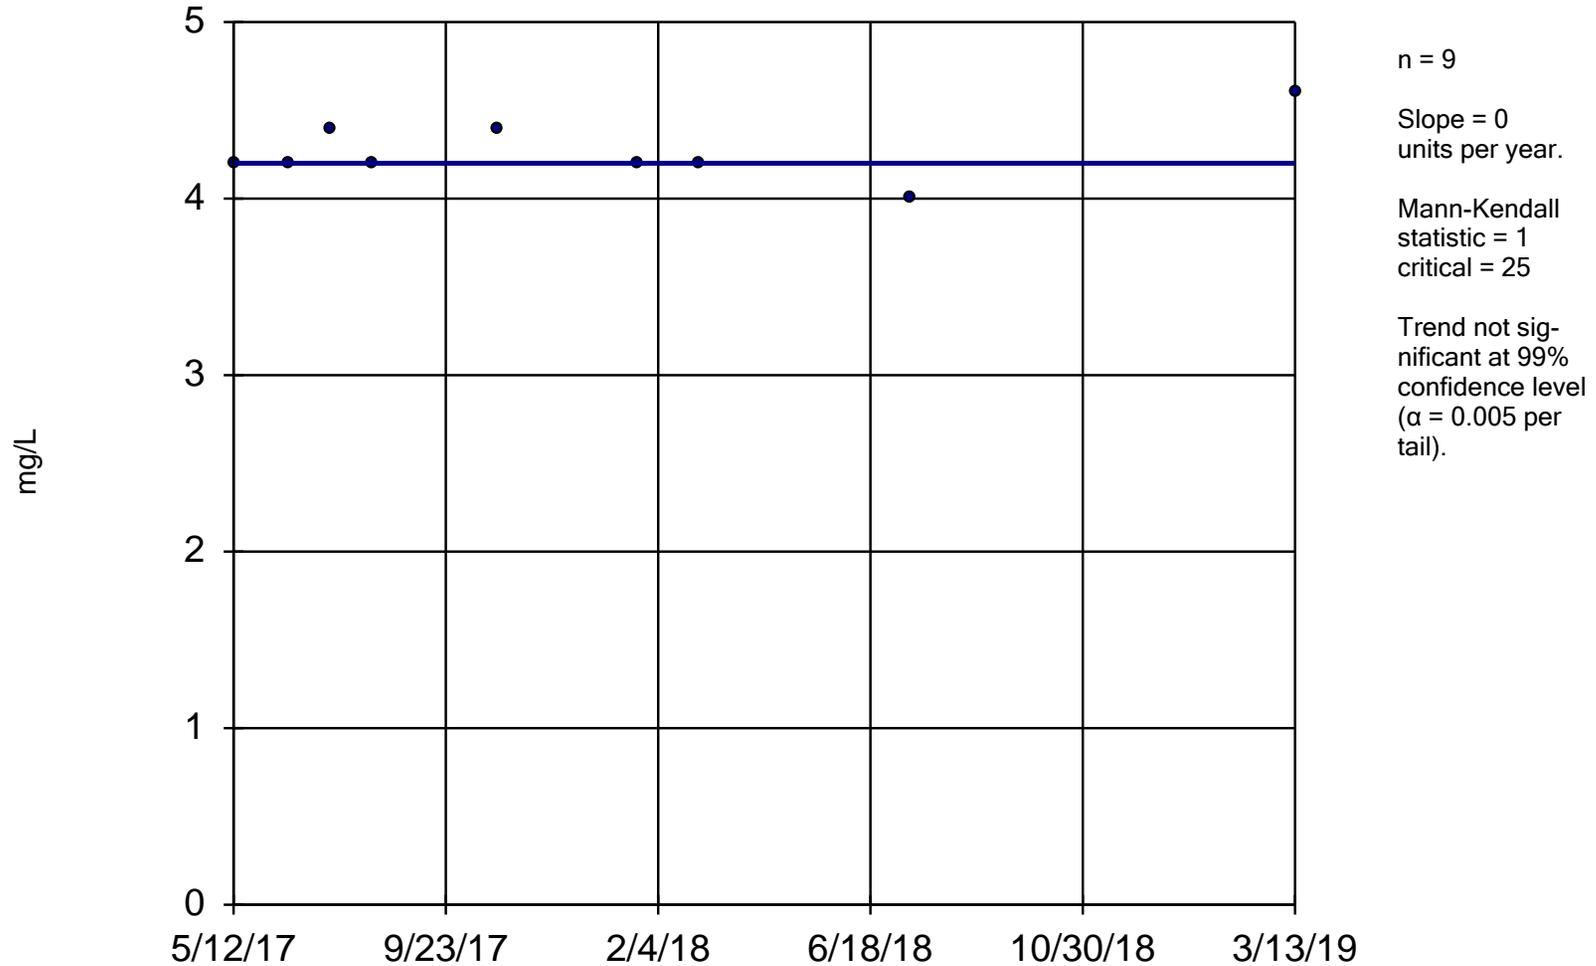

Constituent: Chloride Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1


McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator DGWA-53 (bg)

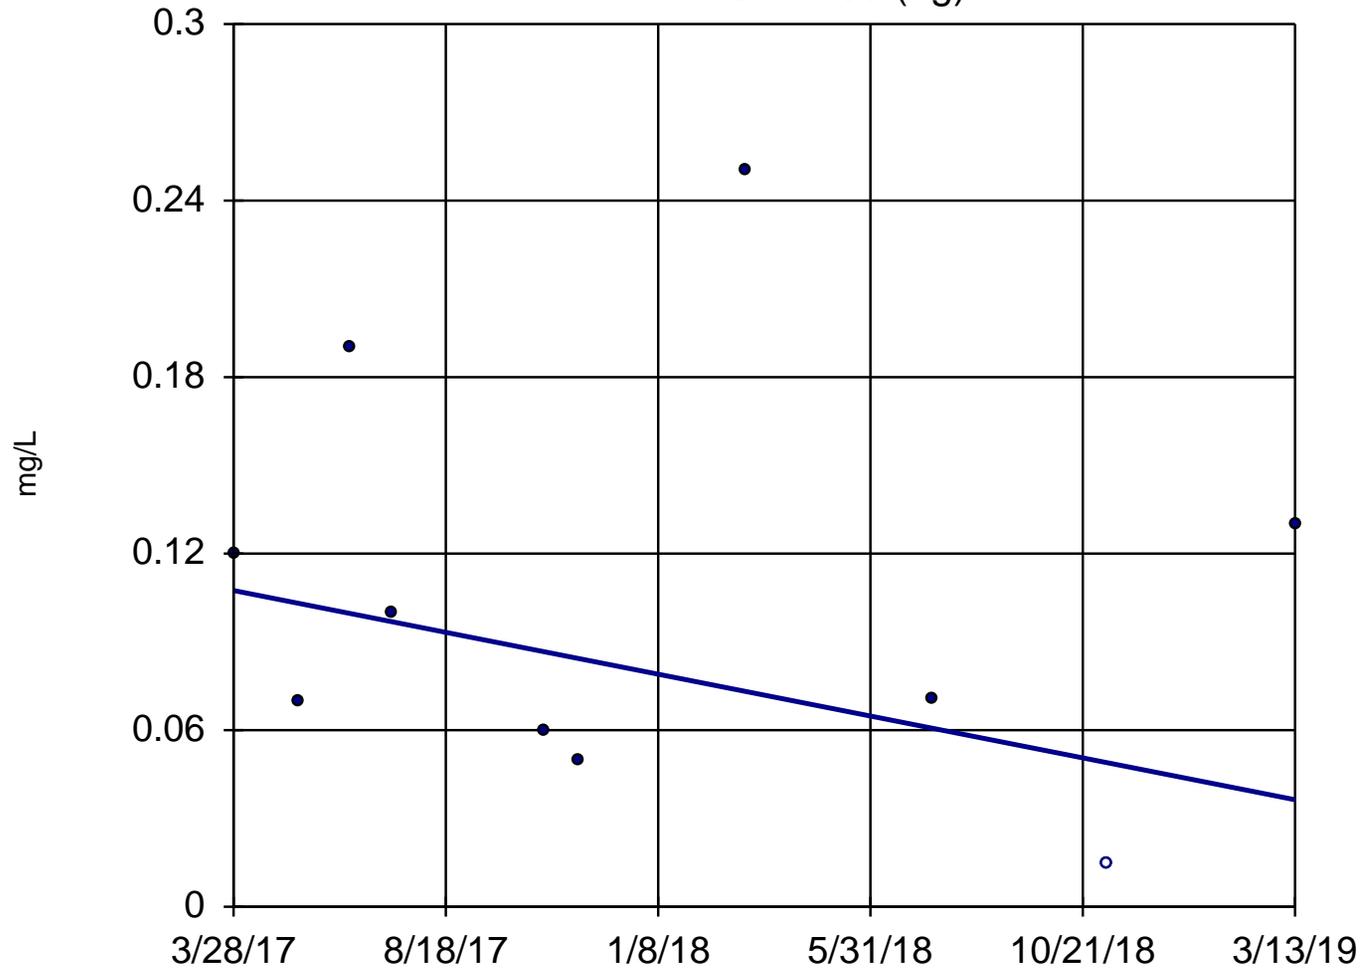

n = 10
Slope = -0.0363
units per year.
Mann-Kendall
statistic = -7
critical = -30
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).


Sen's Slope Estimator DGWA-71 (bg)

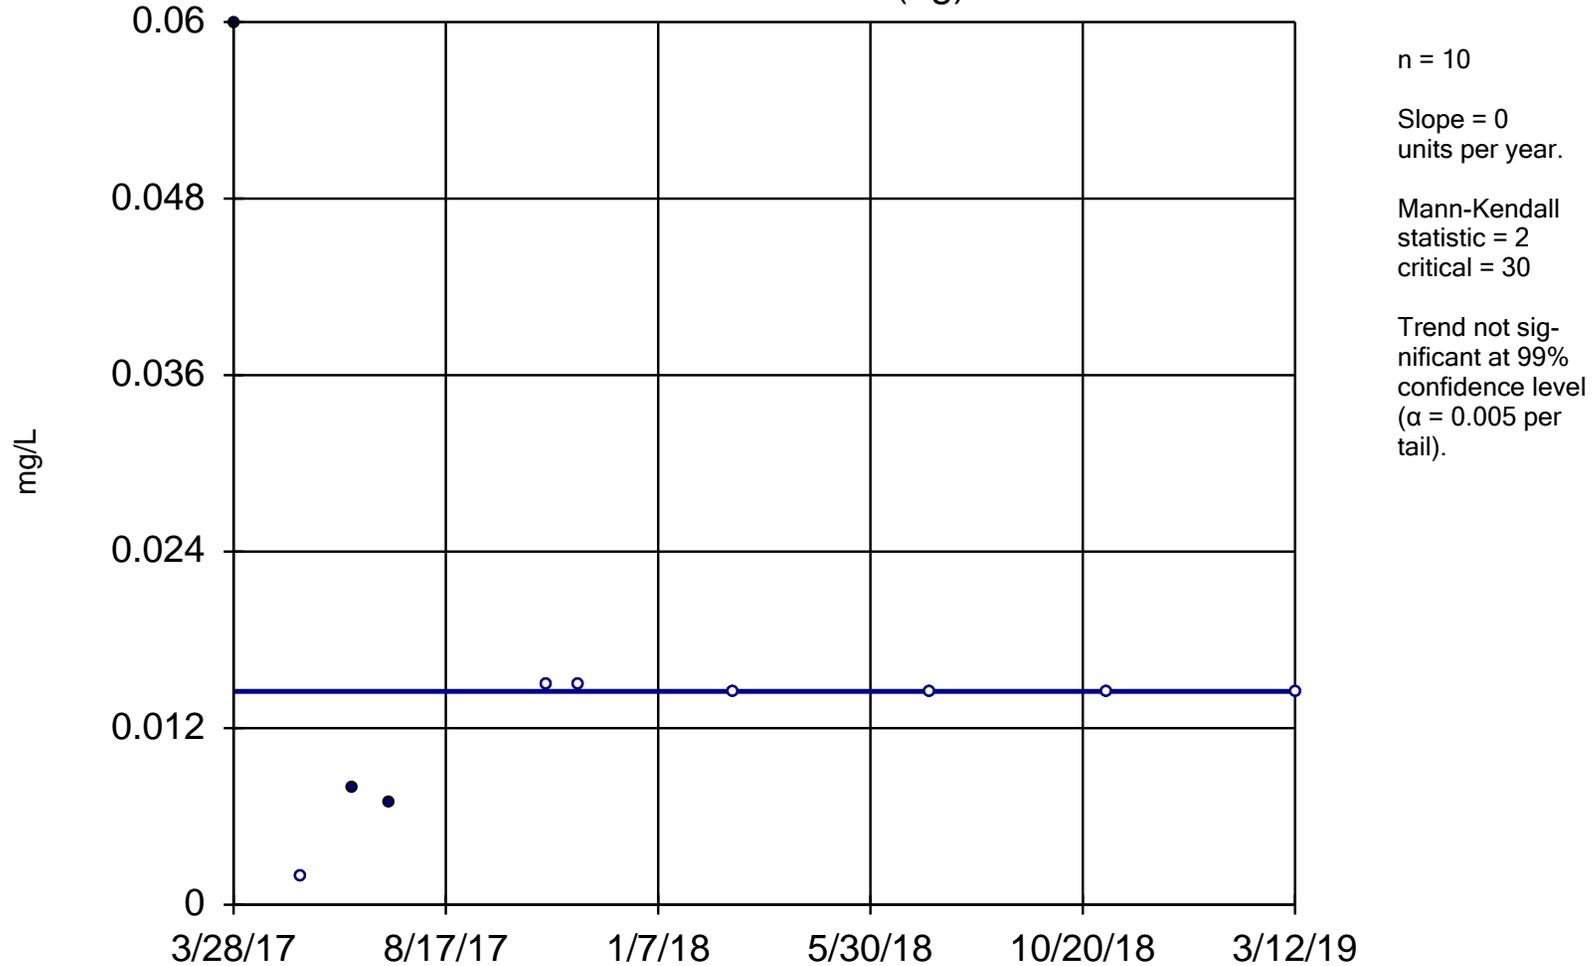

Constituent: Fluoride Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated


Sen's Slope Estimator DGWA-70A (bg)

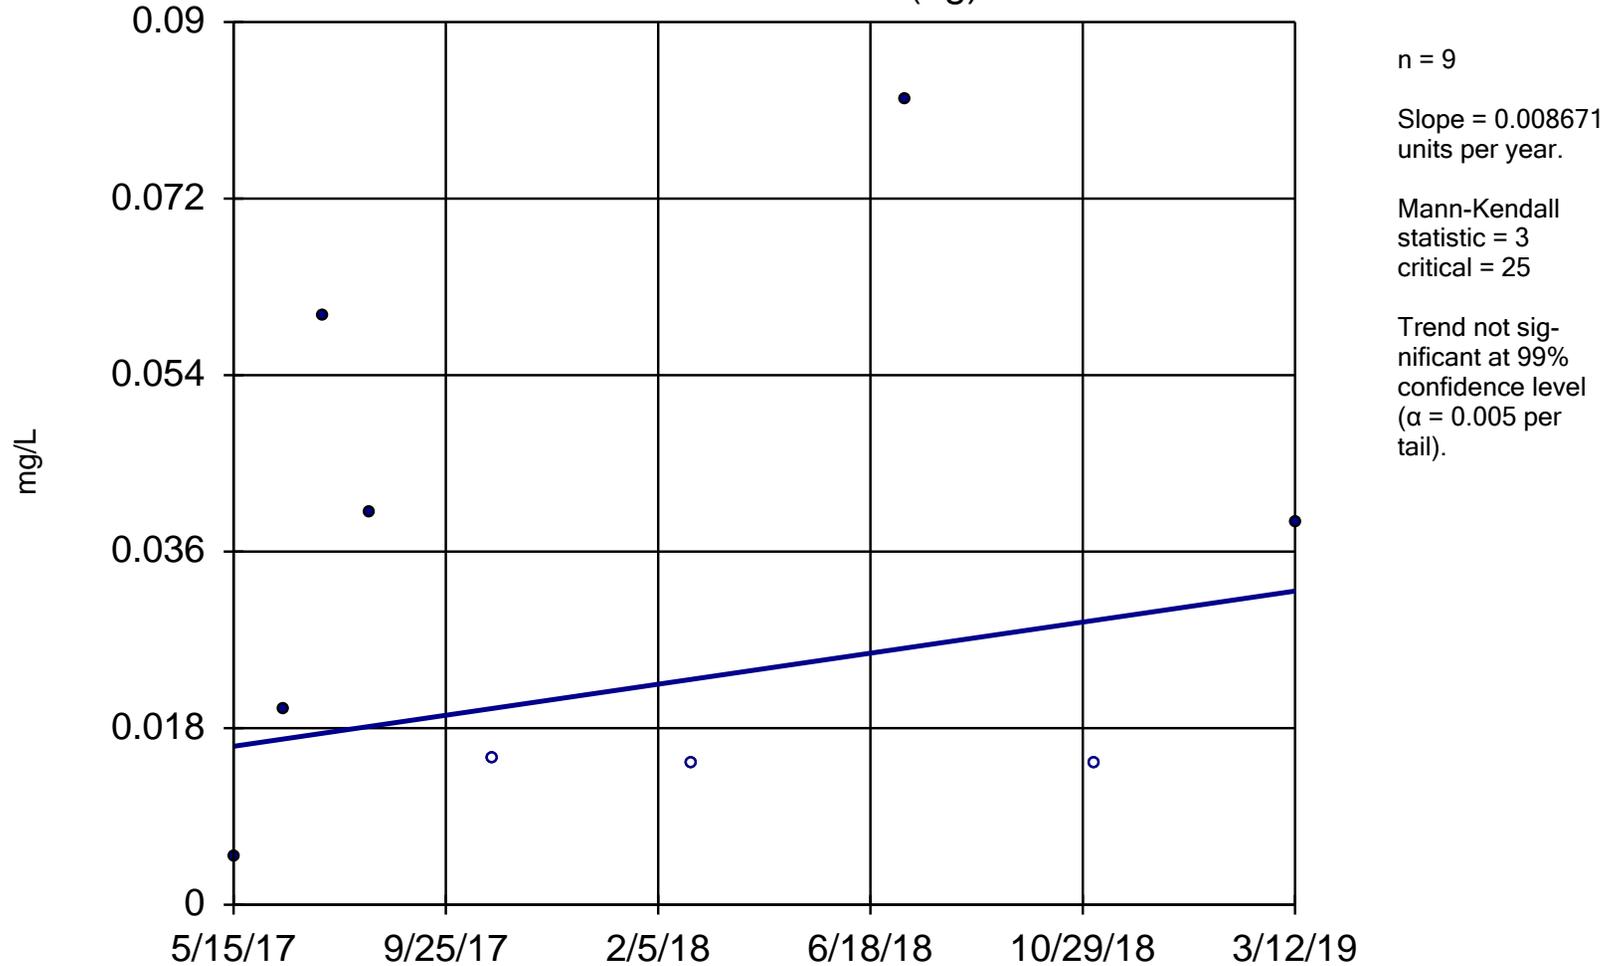

Constituent: Fluoride Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1
McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator

DGWC-40

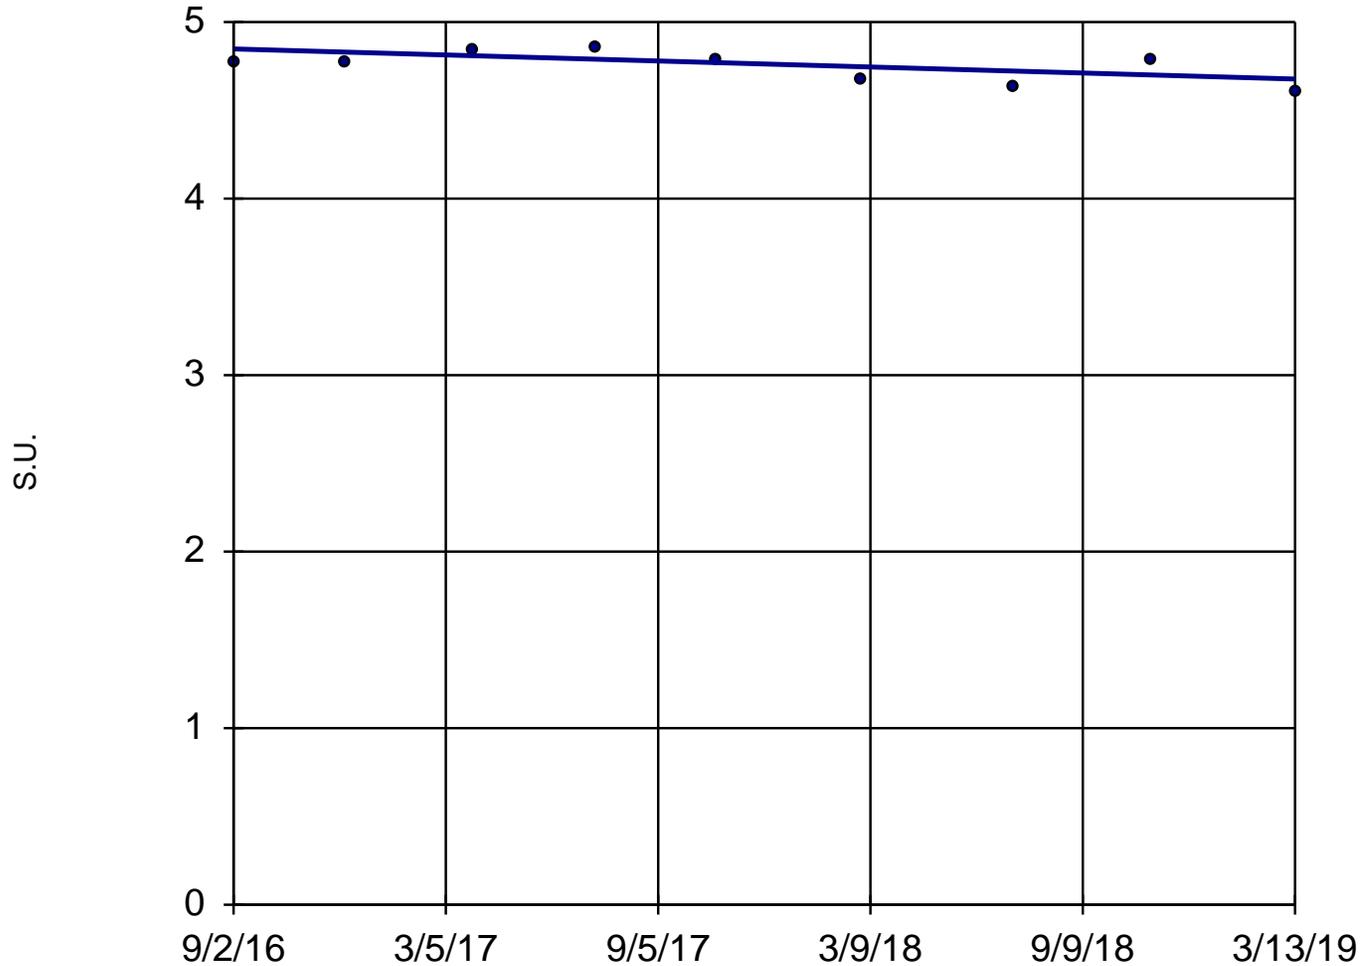

n = 9

Slope = -0.06763
units per year.


Mann-Kendall
statistic = -12
critical = -25

Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: pH [field] Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator DGWA-53 (bg)

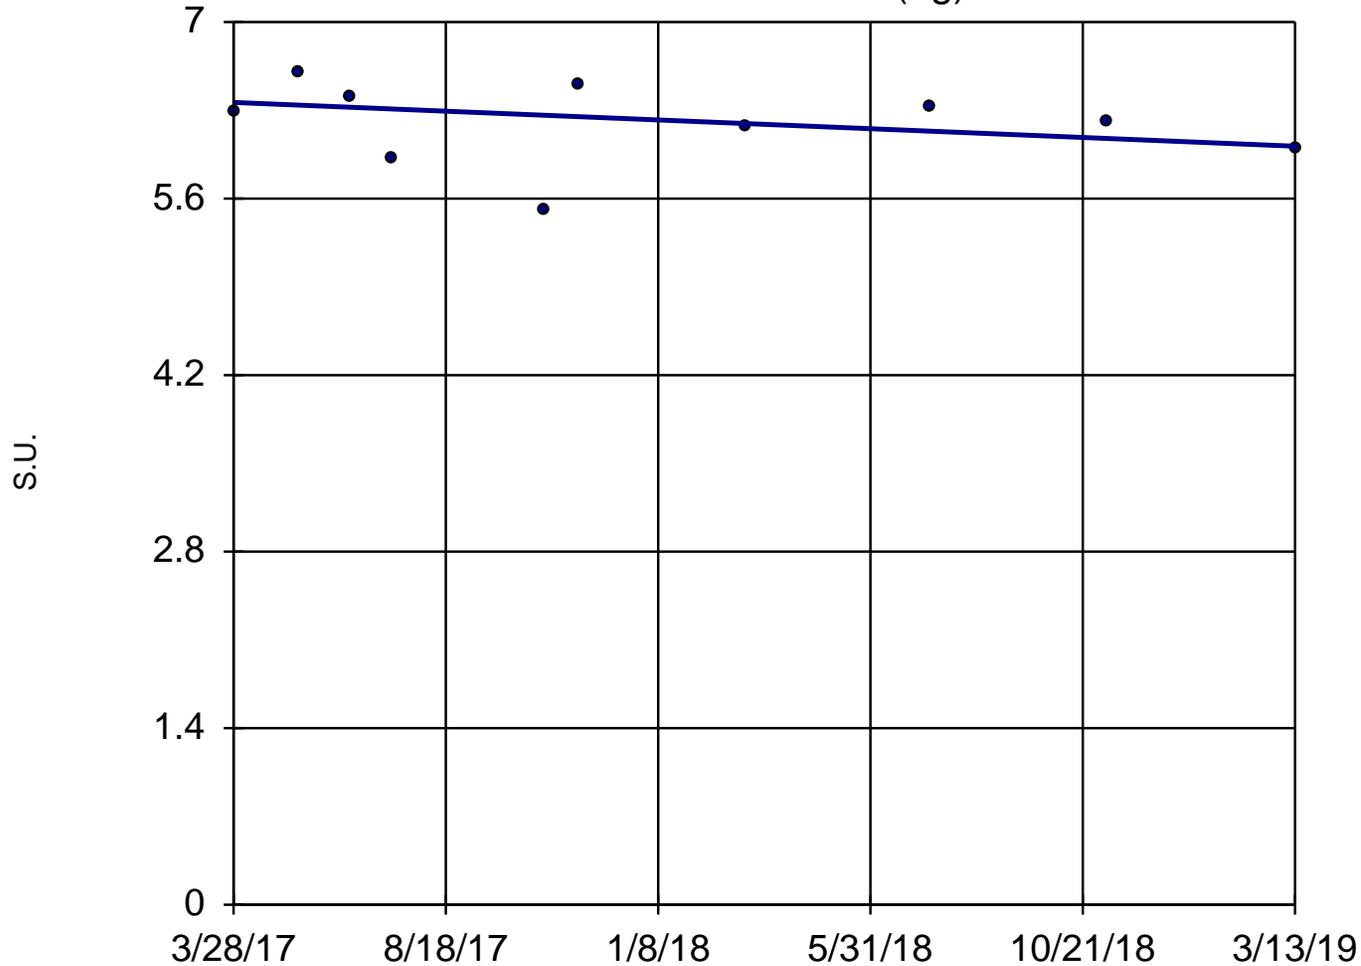


n = 10
Slope = -0.1776
units per year.
Mann-Kendall
statistic = -11
critical = -30
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: pH [field] Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator


DGWA-71 (bg)

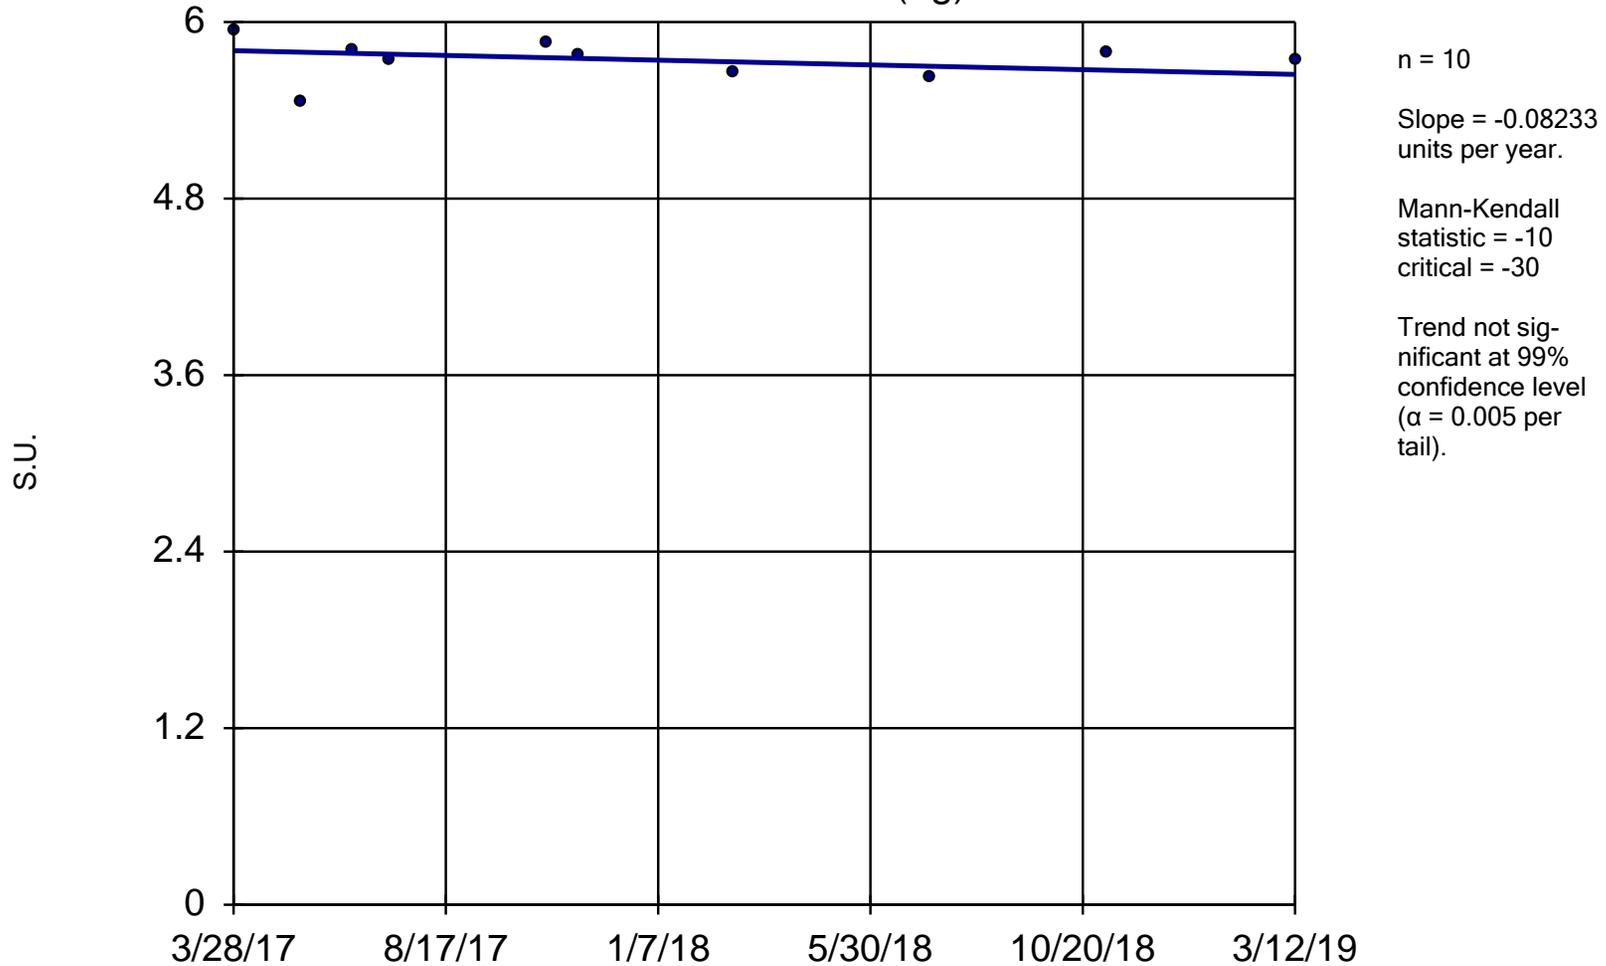

Constituent: pH [field] Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated


Sen's Slope Estimator DGWA-70A (bg)

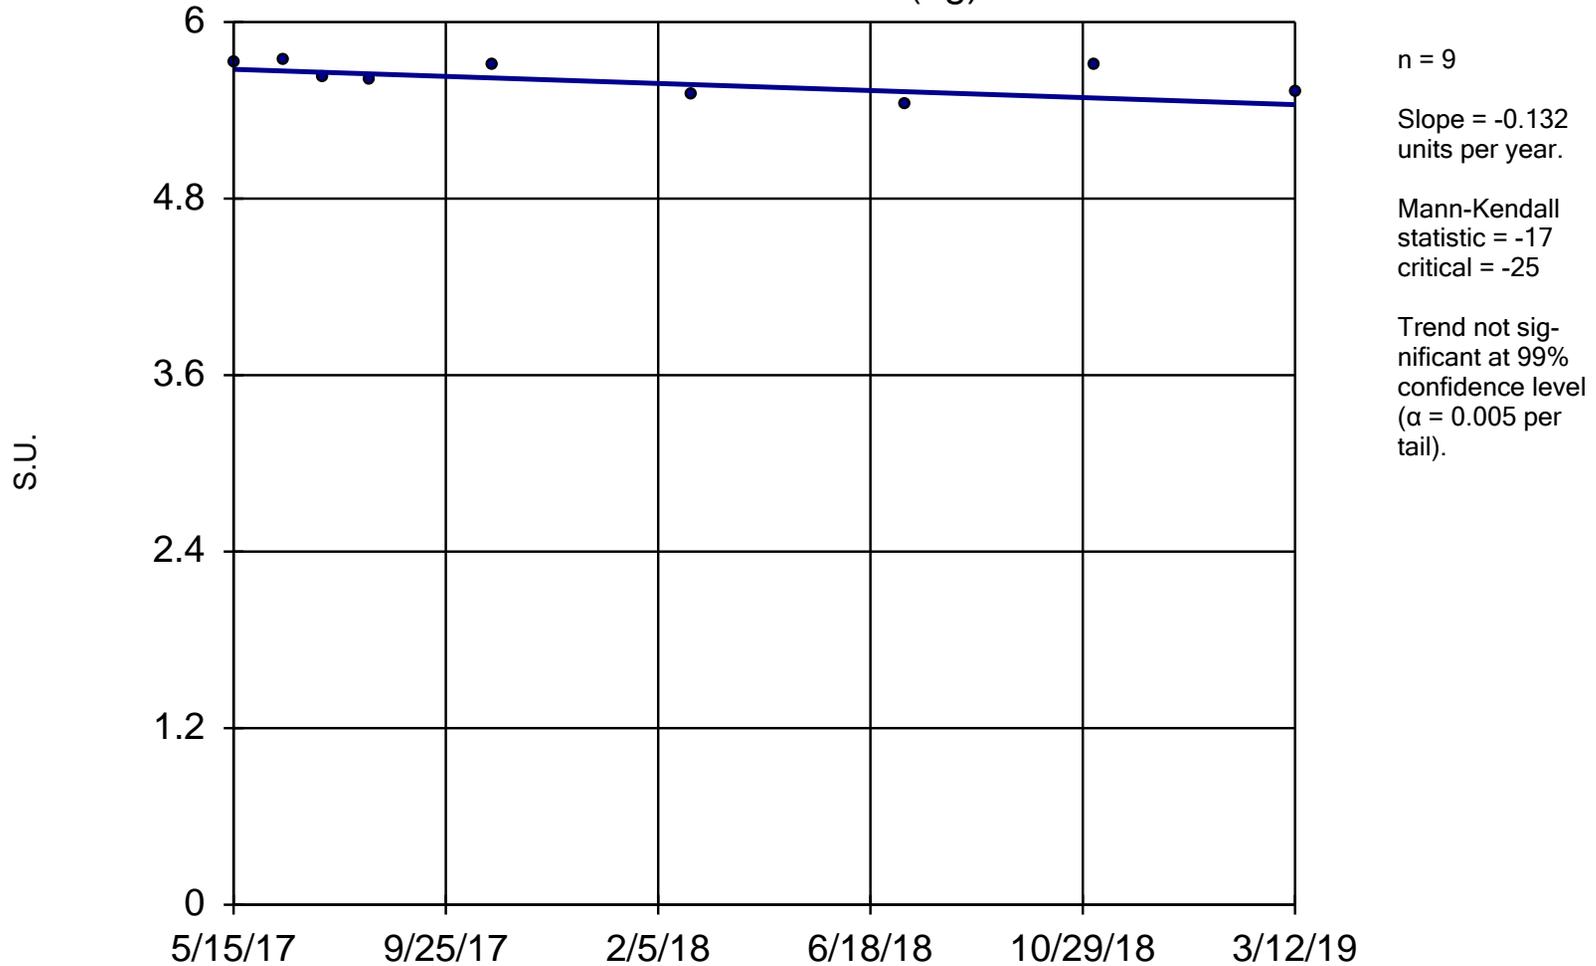

Constituent: pH [field] Analysis Run 7/26/2019 1:31 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator DGWC-68A

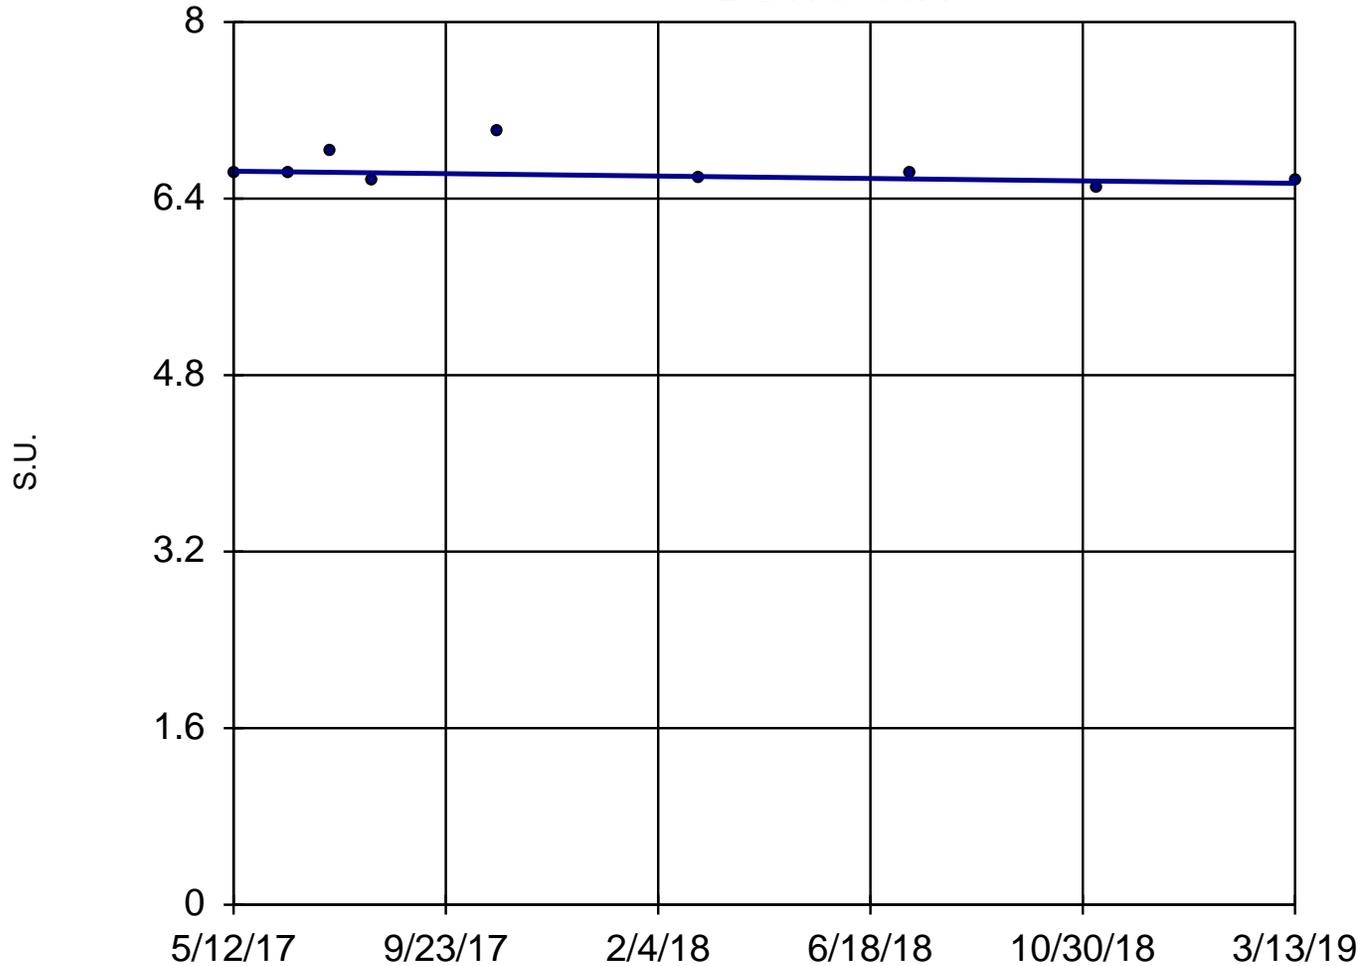

n = 9

Slope = -0.05899
units per year.

Mann-Kendall
statistic = -14
critical = -25


Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: pH [field] Analysis Run 7/29/2019 2:59 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator

DGWC-37

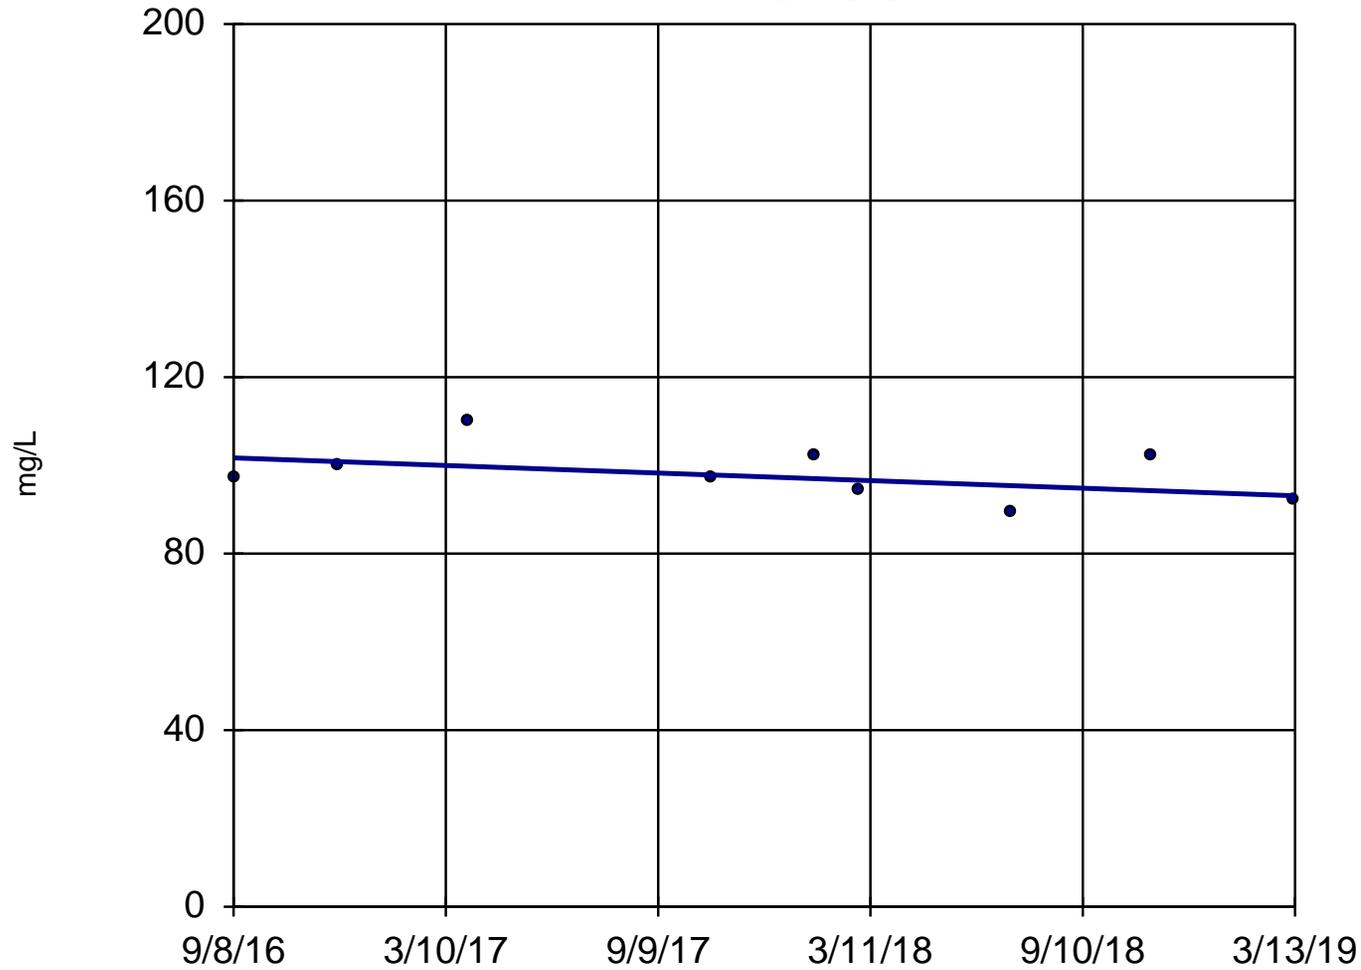

n = 9

Slope = -3.418
units per year.

Mann-Kendall
statistic = -10
critical = -25


Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Sulfate Analysis Run 7/26/2019 1:32 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator

DGWC-38

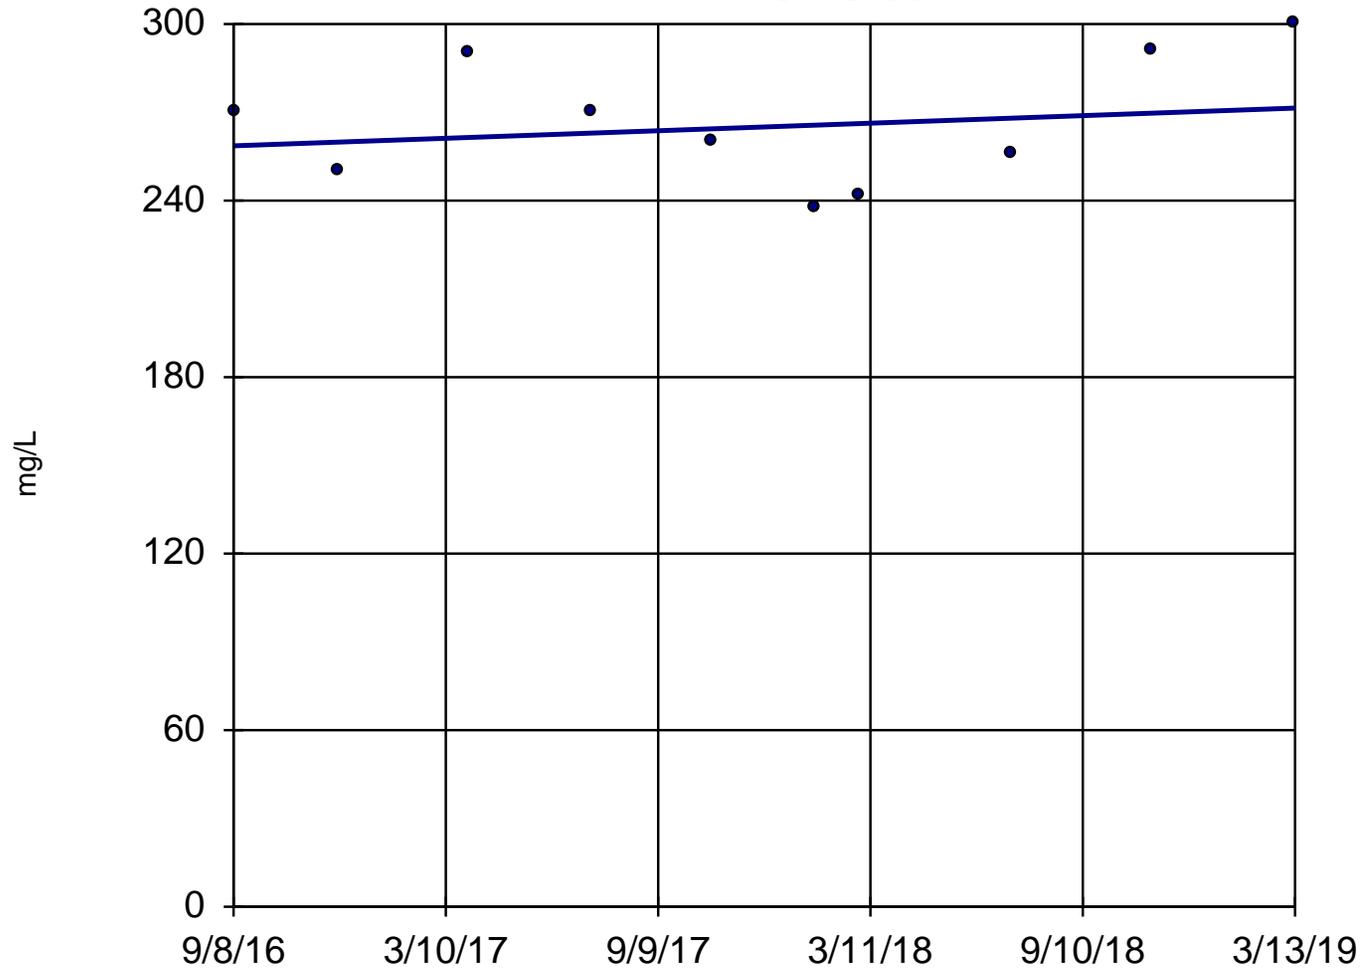

n = 10

Slope = 5.119
units per year.

Mann-Kendall
statistic = 6
critical = 30


Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Sulfate Analysis Run 7/26/2019 1:32 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator

DGWC-39

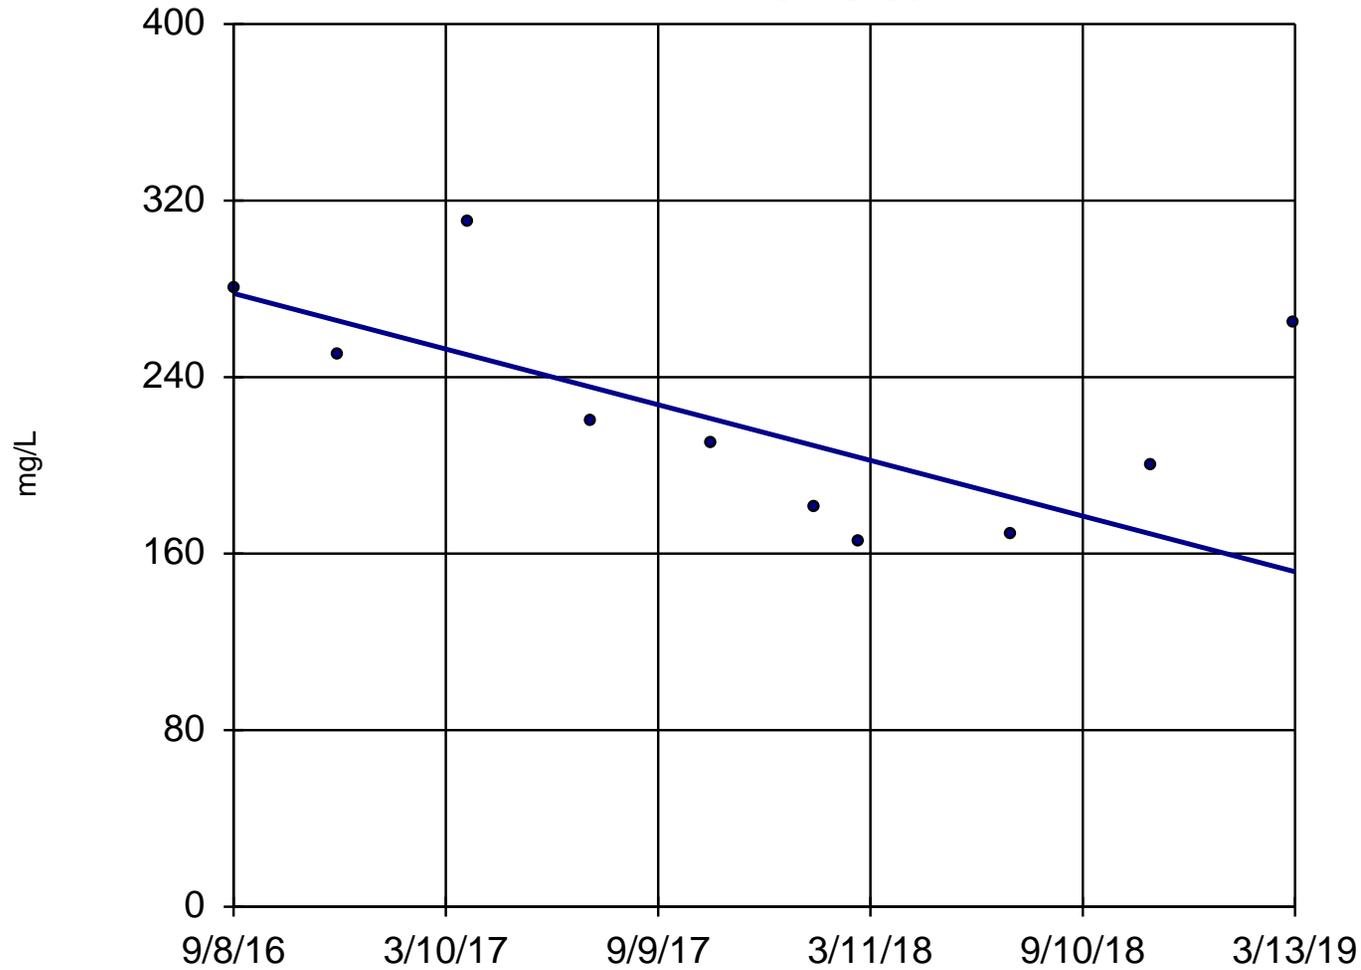

n = 10

Slope = -50.23
units per year.

Mann-Kendall
statistic = -19
critical = -30


Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Sulfate Analysis Run 7/26/2019 1:32 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator


DGWC-40

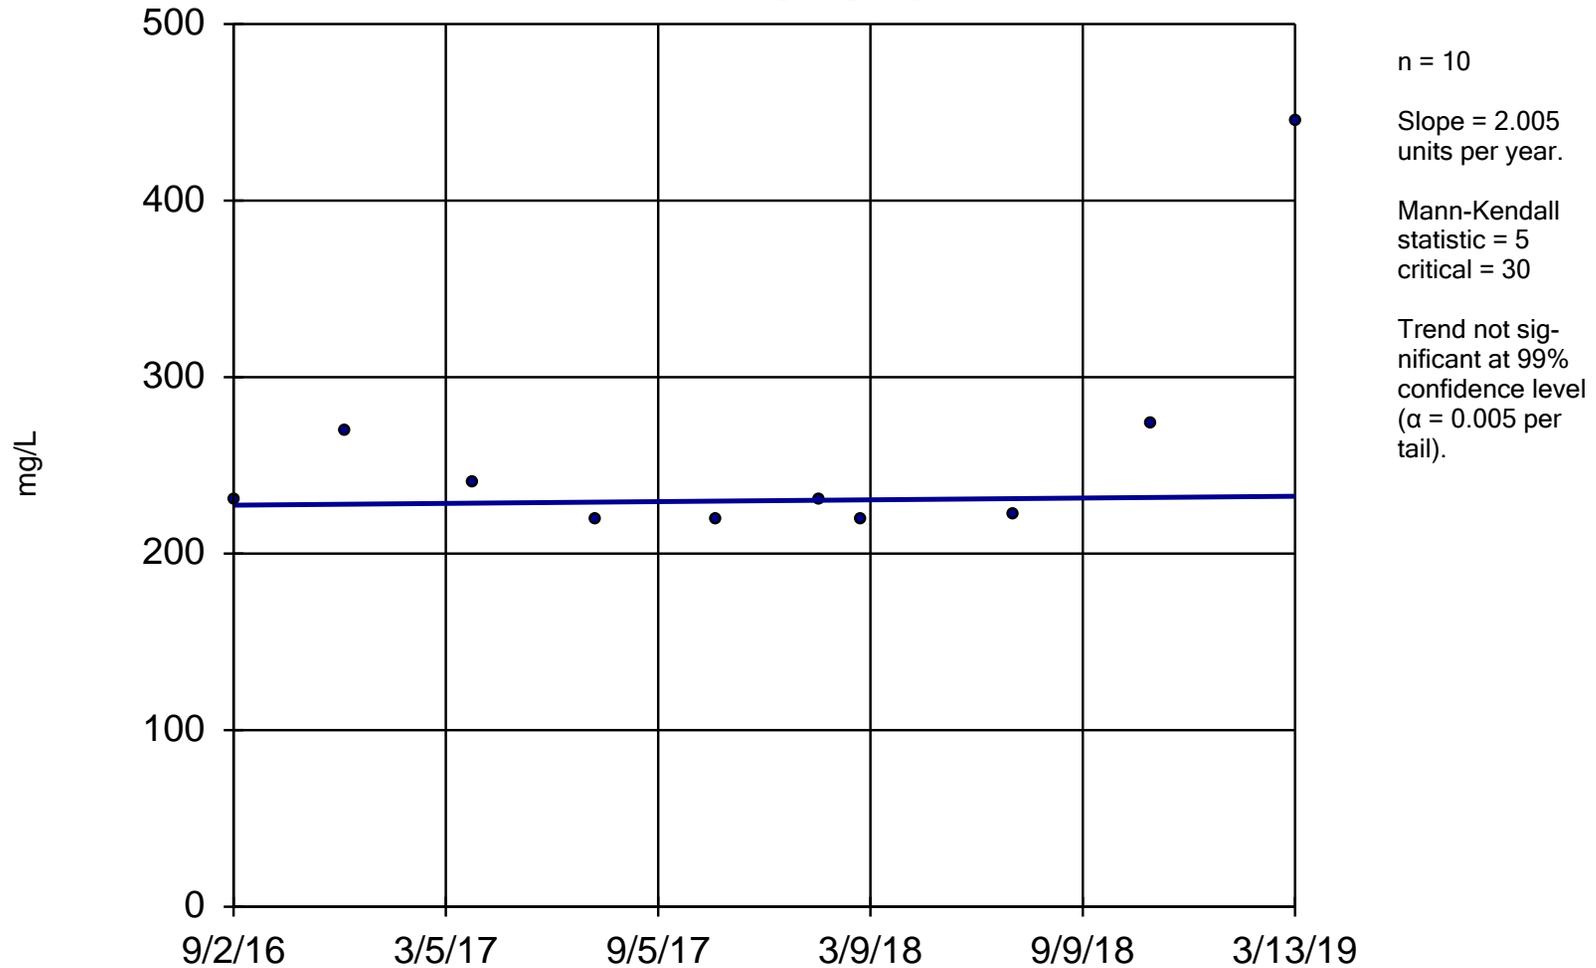

Constituent: Sulfate Analysis Run 7/26/2019 1:32 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator DGWA-53 (bg)

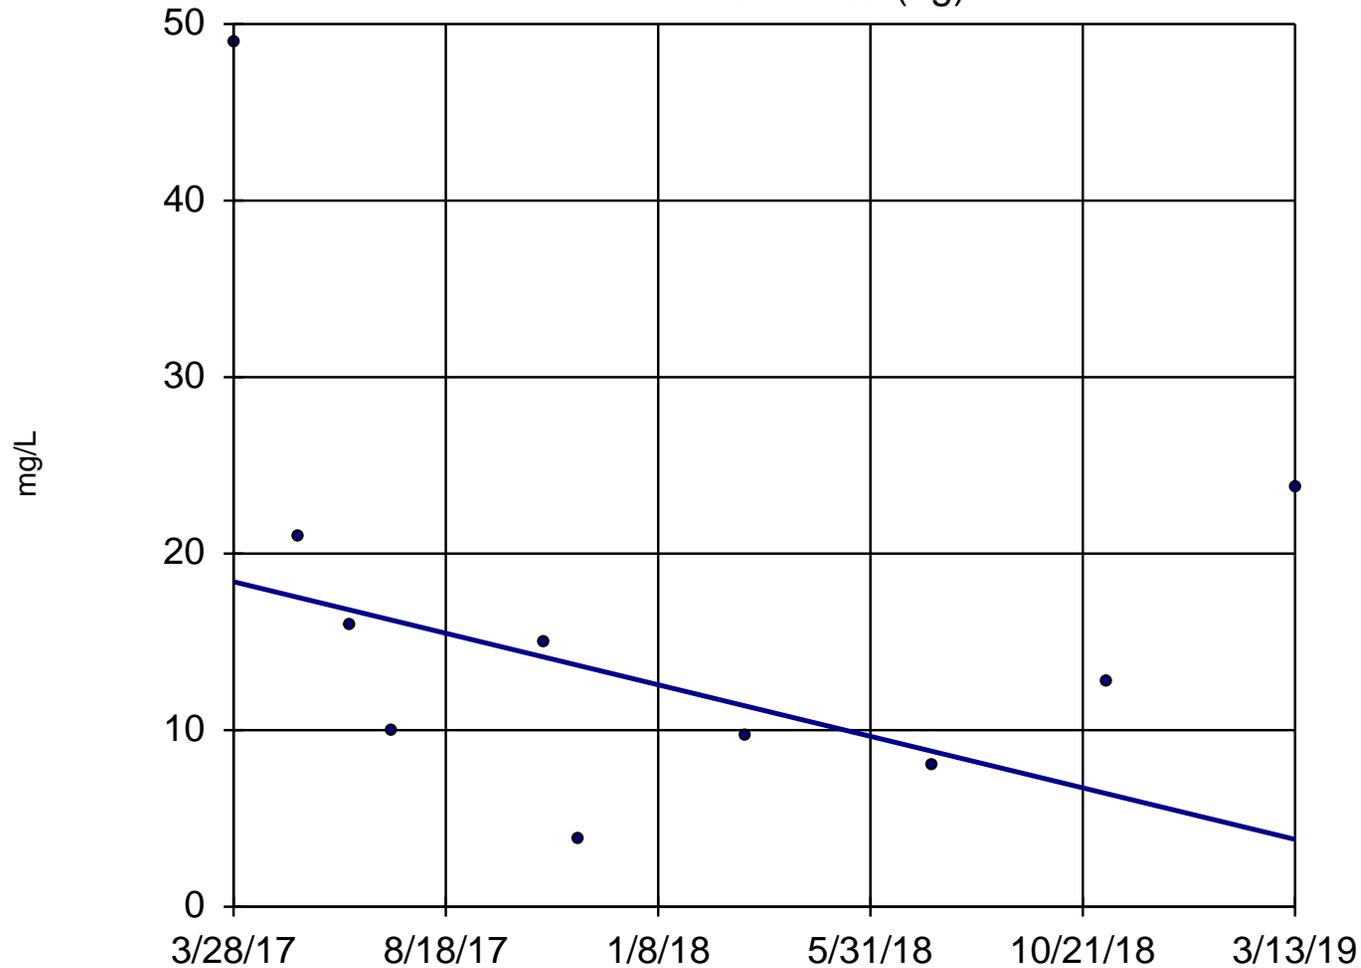

n = 10

Slope = -7.449
units per year.


Mann-Kendall
statistic = -15
critical = -30

Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Sulfate Analysis Run 7/26/2019 1:32 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator DGWA-71 (bg)

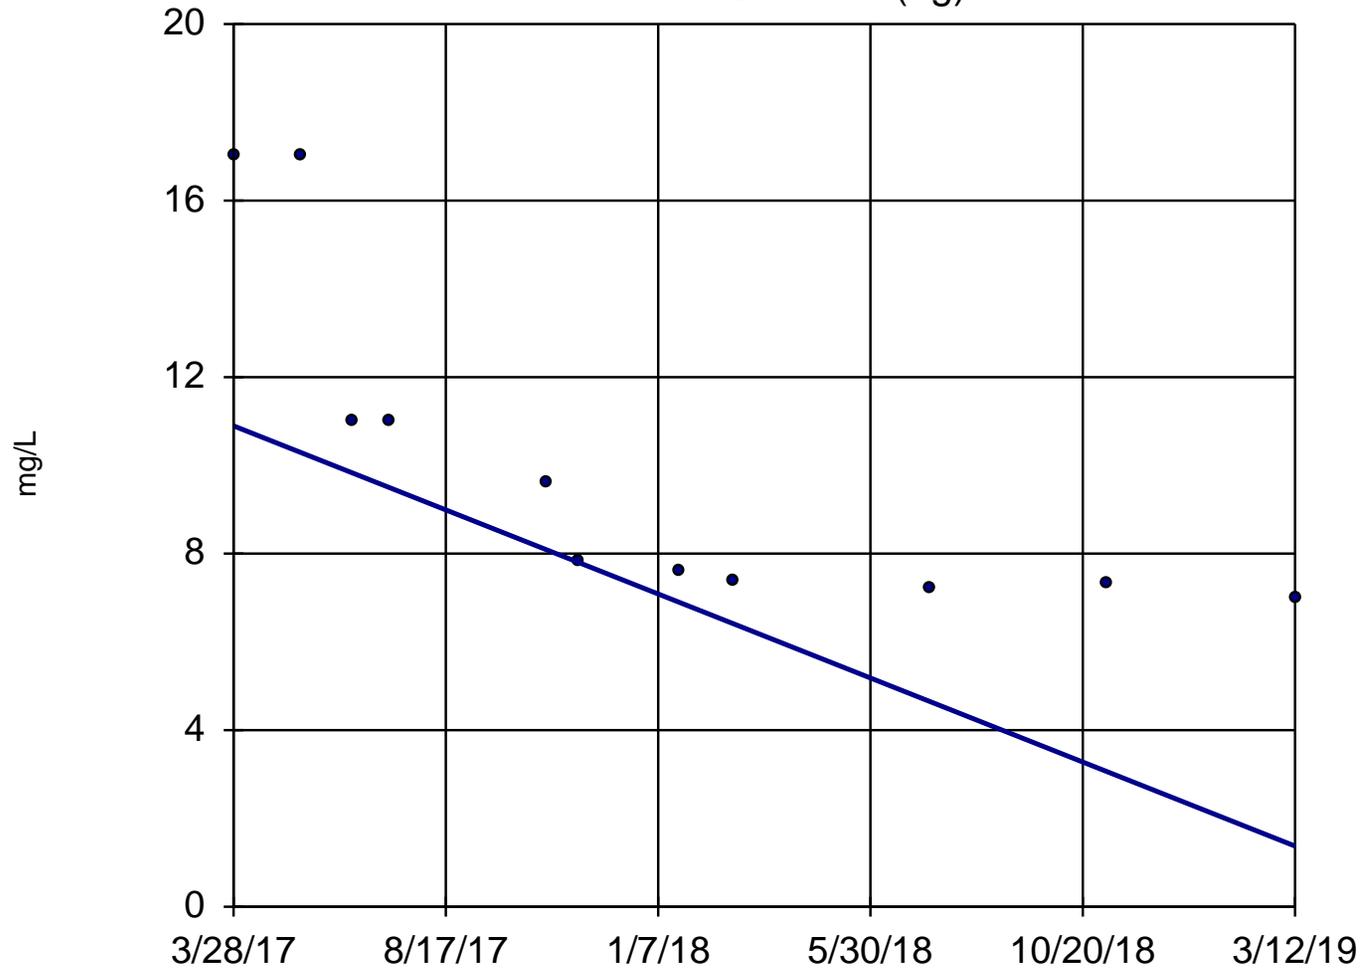

n = 11

Slope = -4.867
units per year.

Mann-Kendall
statistic = -51
critical = -34


Decreasing trend
significant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Sulfate Analysis Run 7/26/2019 1:32 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator


DGWC-67

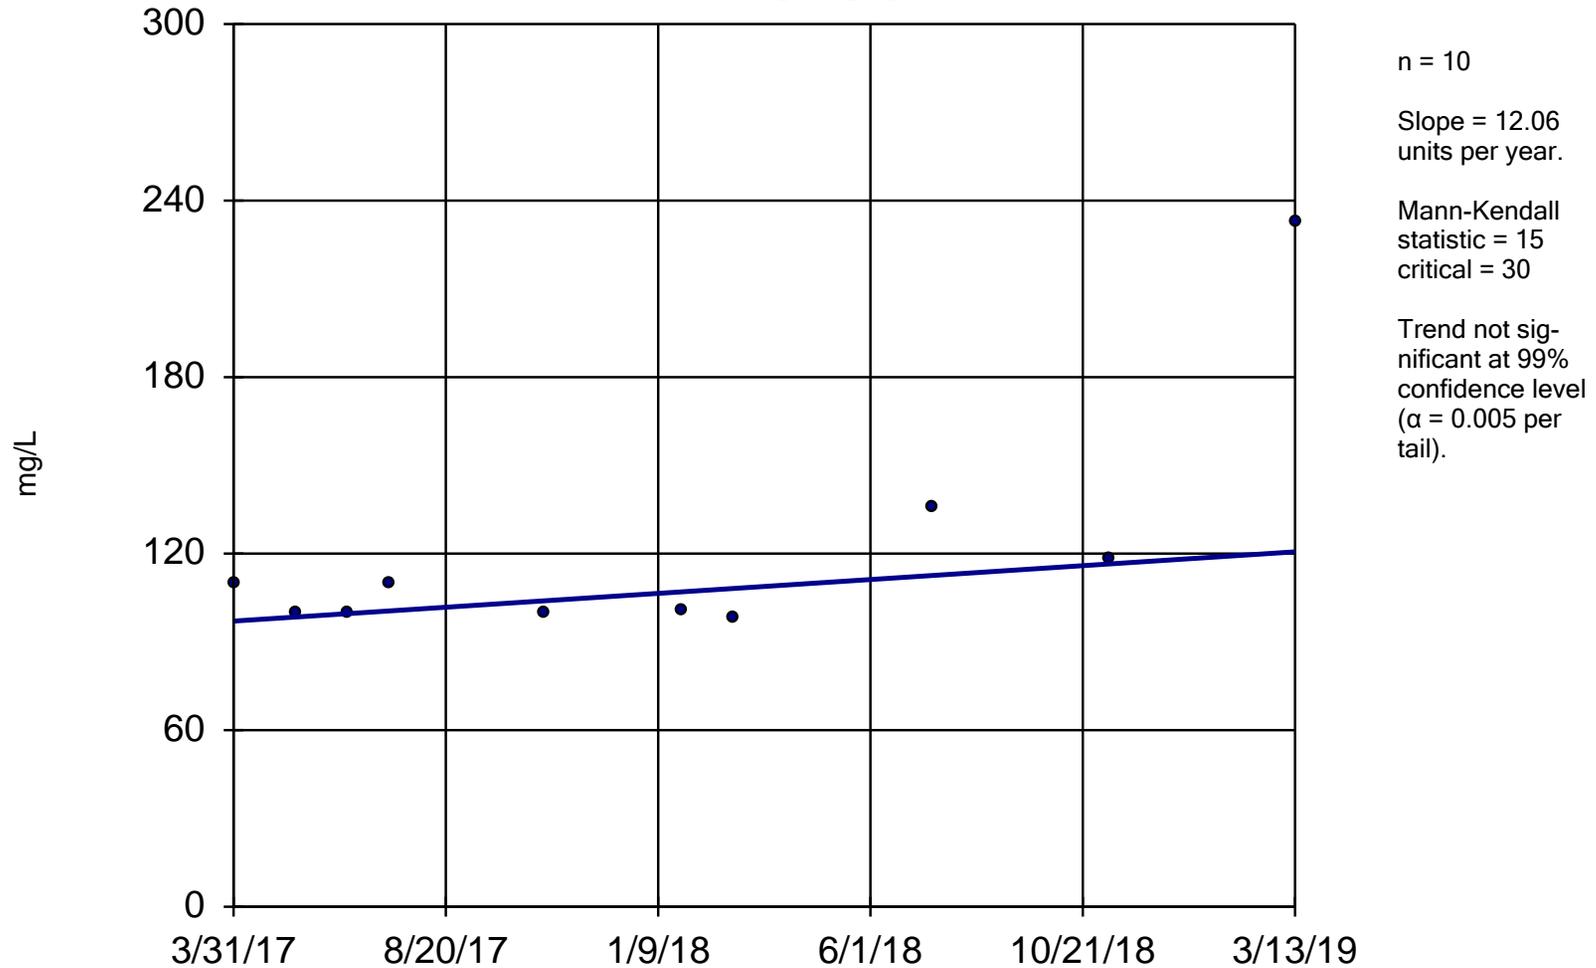

Constituent: Sulfate Analysis Run 7/26/2019 1:32 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator DGWA-70A (bg)

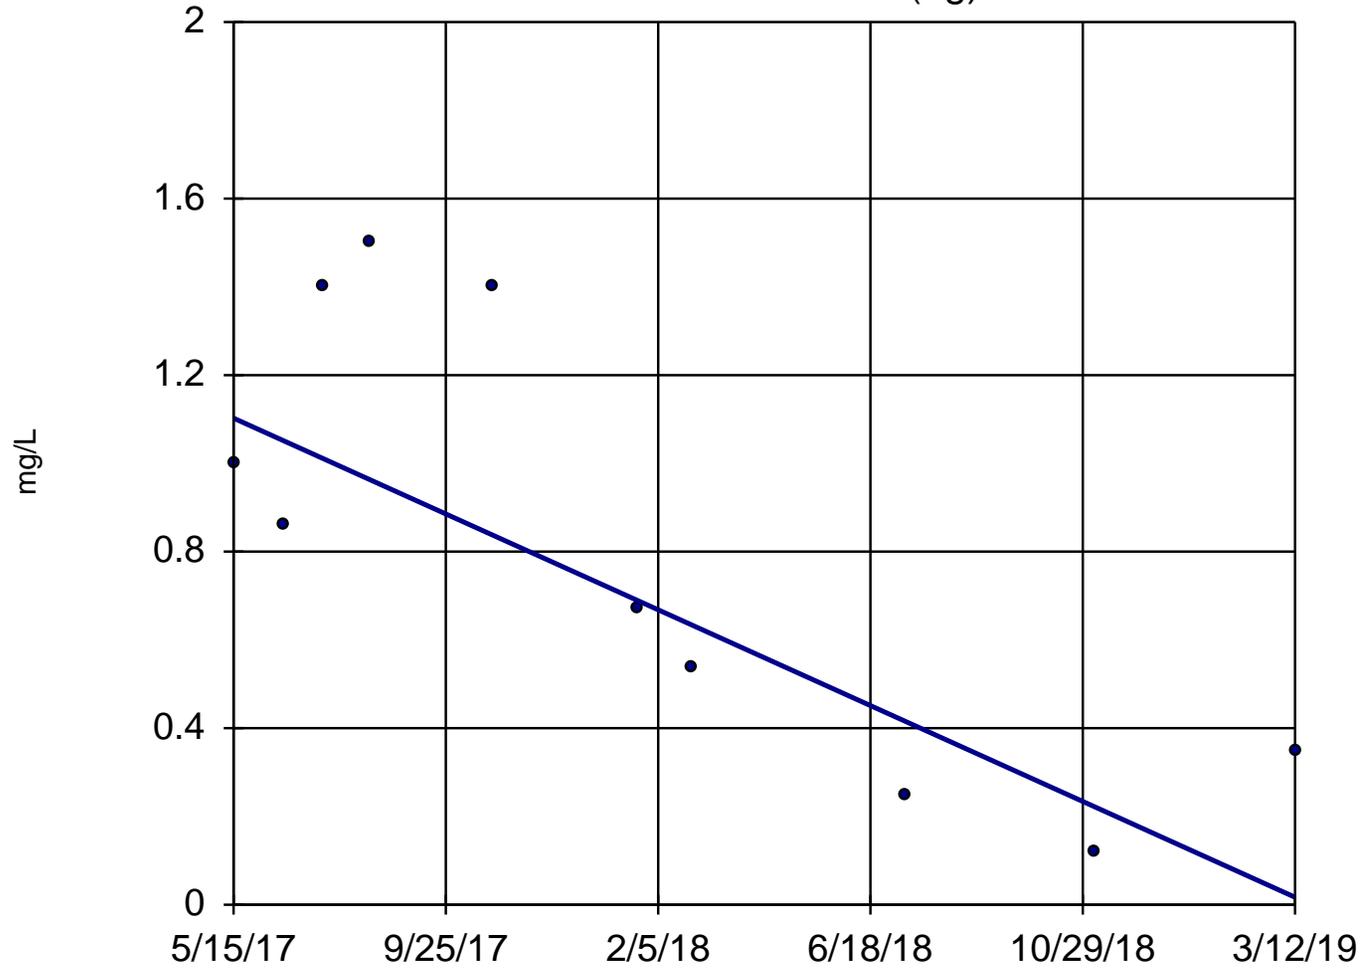

n = 10

Slope = -0.5948
units per year.

Mann-Kendall
statistic = -26
critical = -30


Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Sulfate Analysis Run 7/26/2019 1:32 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator

DGWC-68A

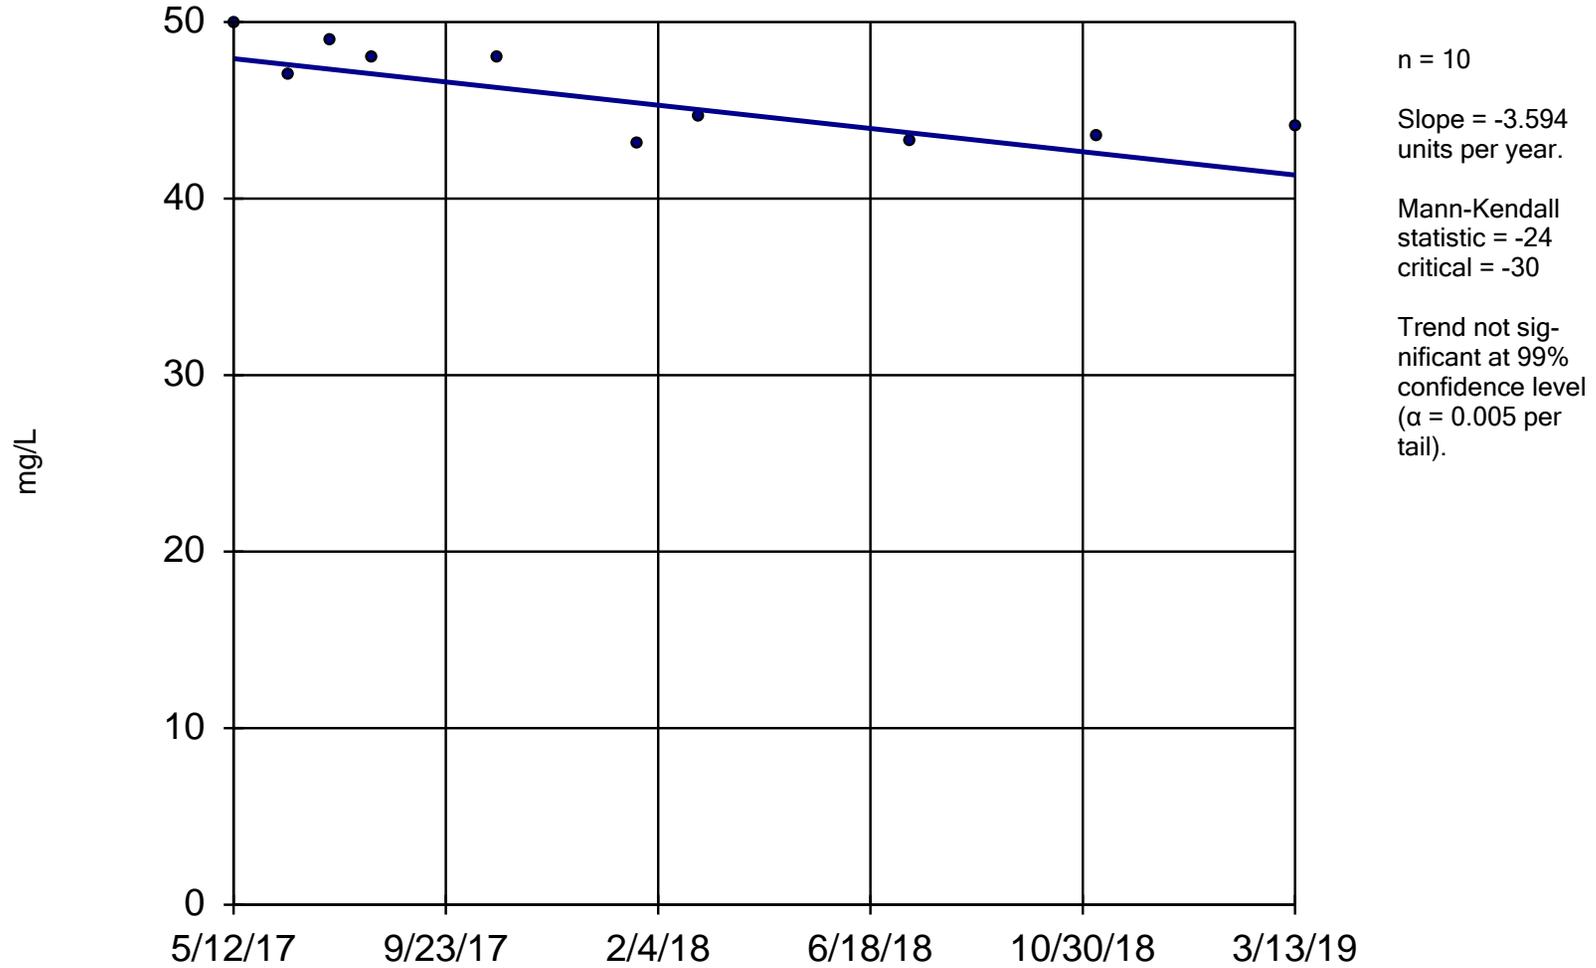


Constituent: Sulfate Analysis Run 7/26/2019 1:32 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator

DGWC-38

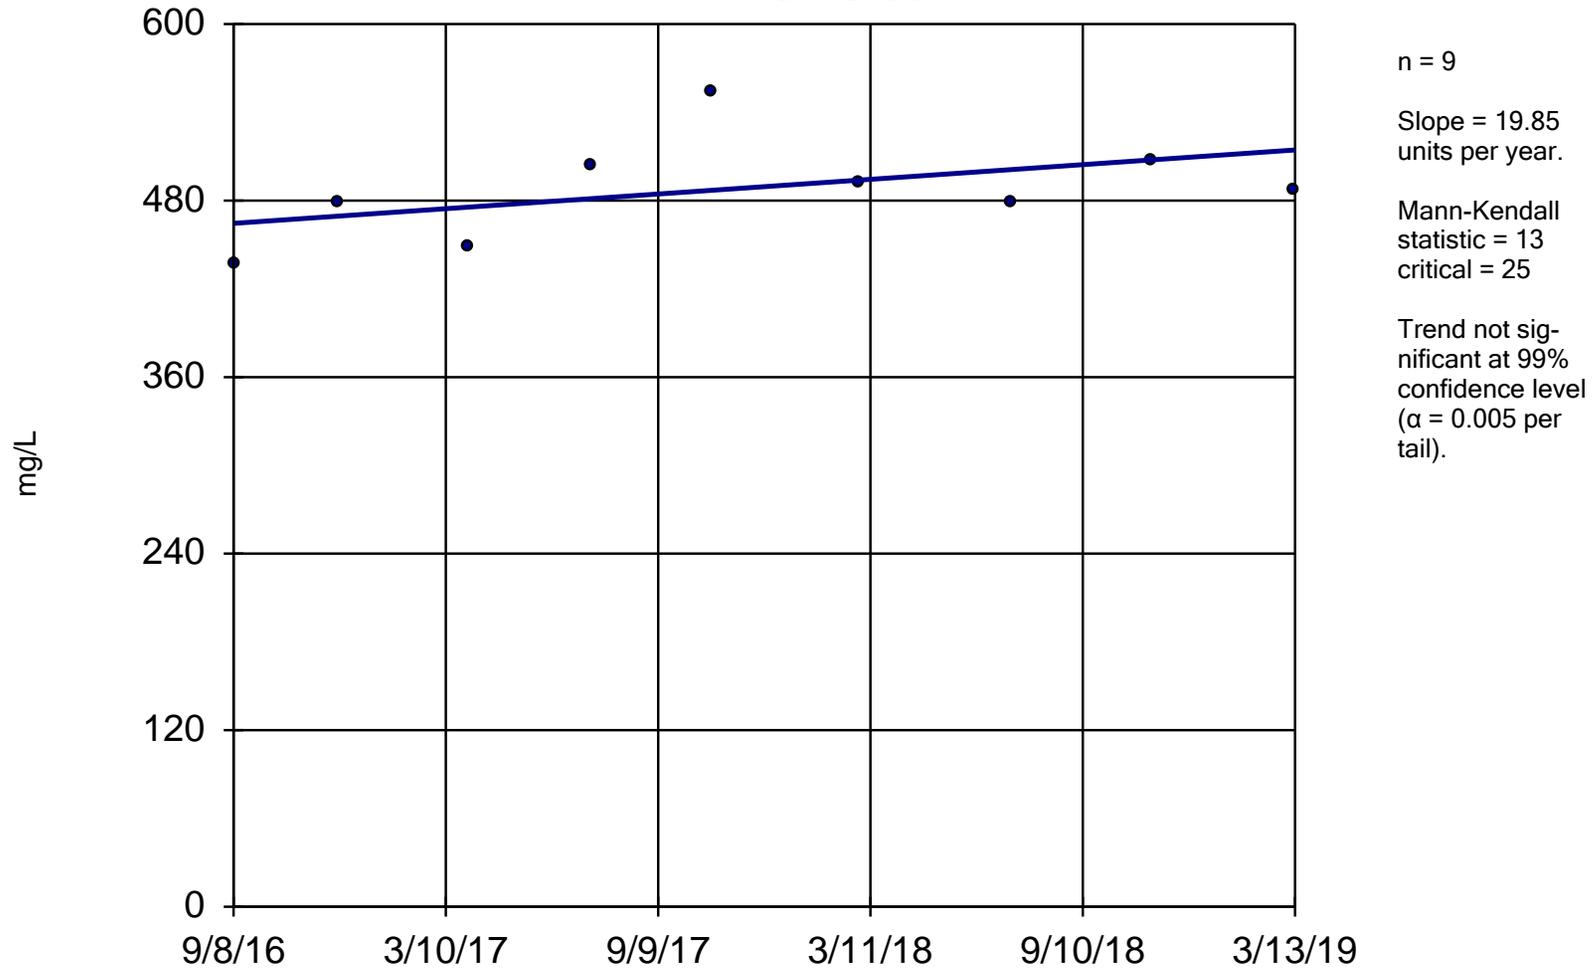


Constituent: TDS Analysis Run 7/26/2019 1:32 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator


DGWC-39

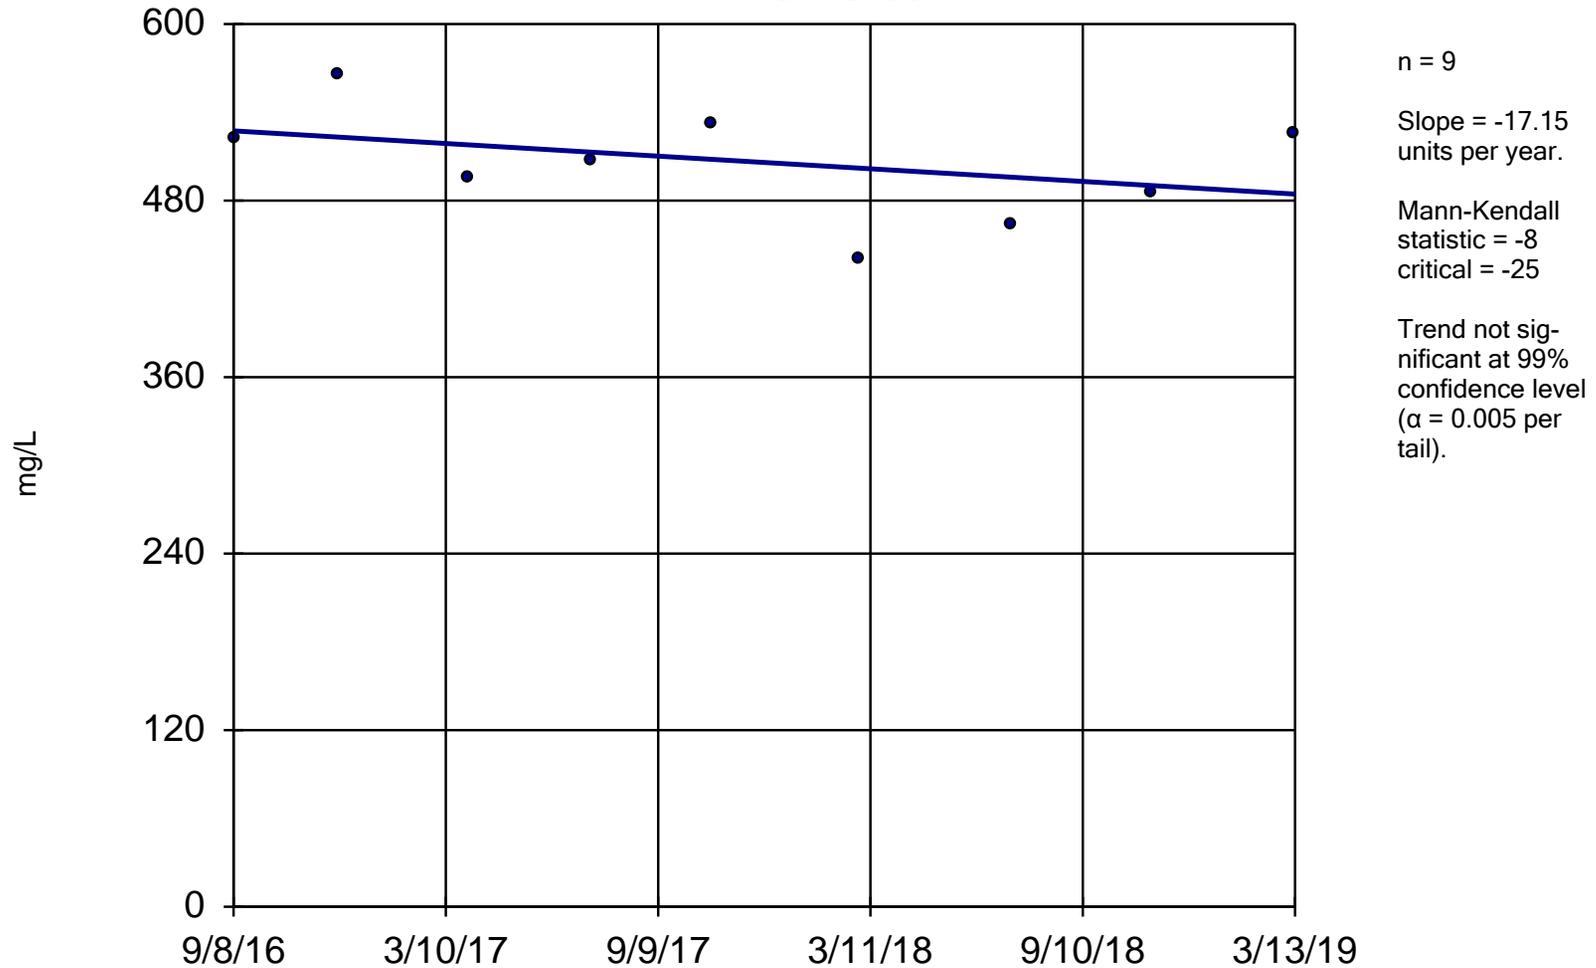

Constituent: TDS Analysis Run 7/26/2019 1:32 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated


Sen's Slope Estimator DGWA-53 (bg)

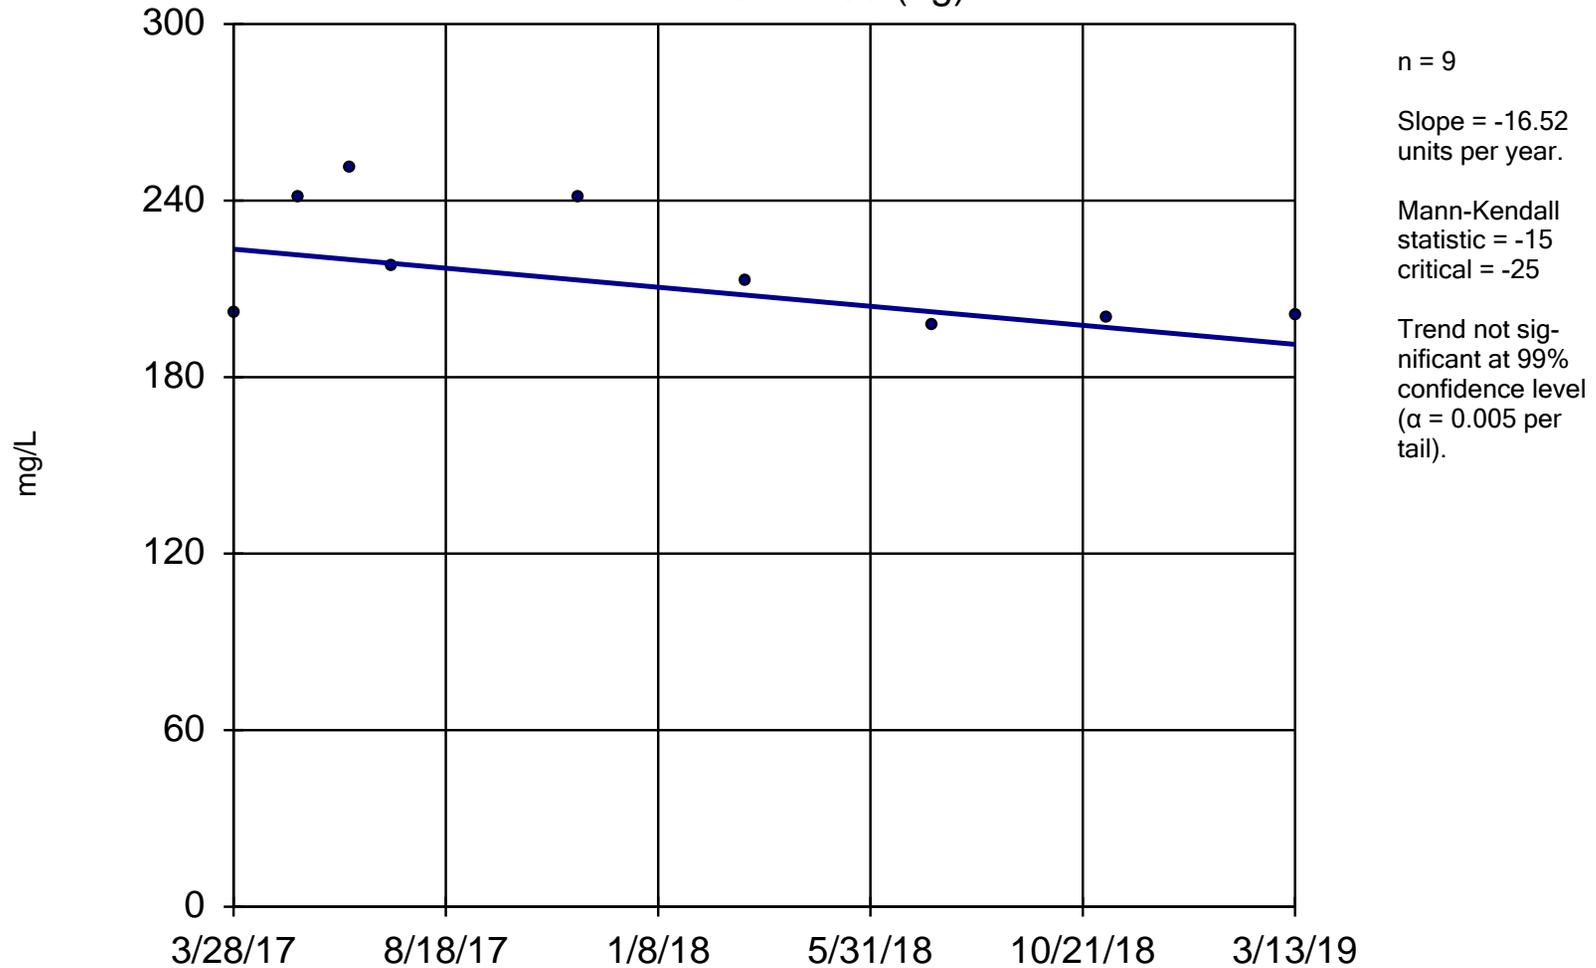

Constituent: TDS Analysis Run 7/26/2019 1:32 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Sen's Slope Estimator DGWA-71 (bg)

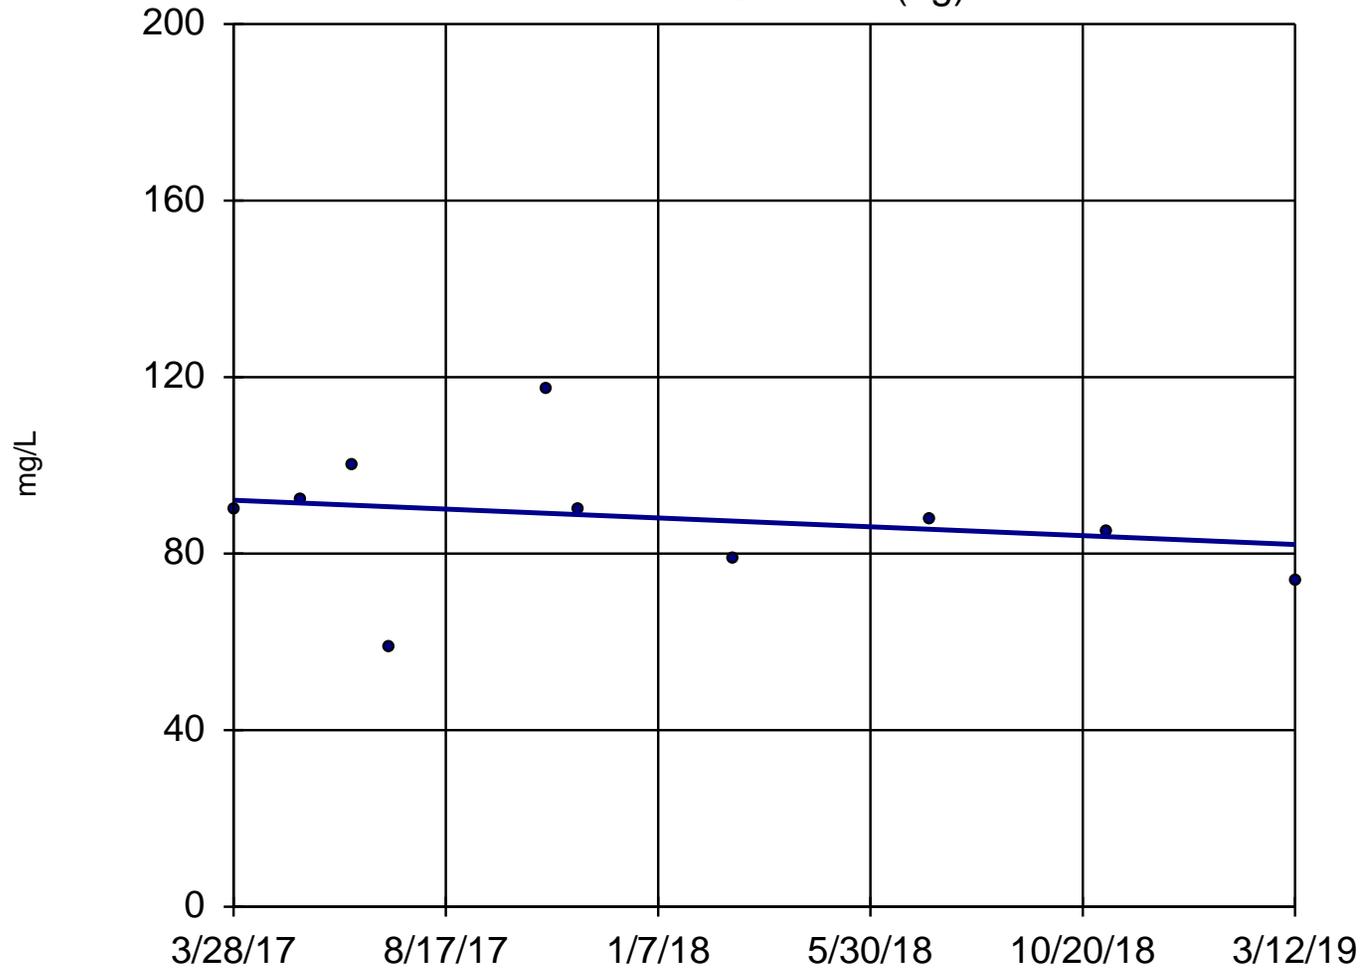

n = 10

Slope = -5.126
units per year.


Mann-Kendall
statistic = -16
critical = -30

Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: TDS Analysis Run 7/26/2019 1:32 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated


Sen's Slope Estimator DGWA-70A (bg)

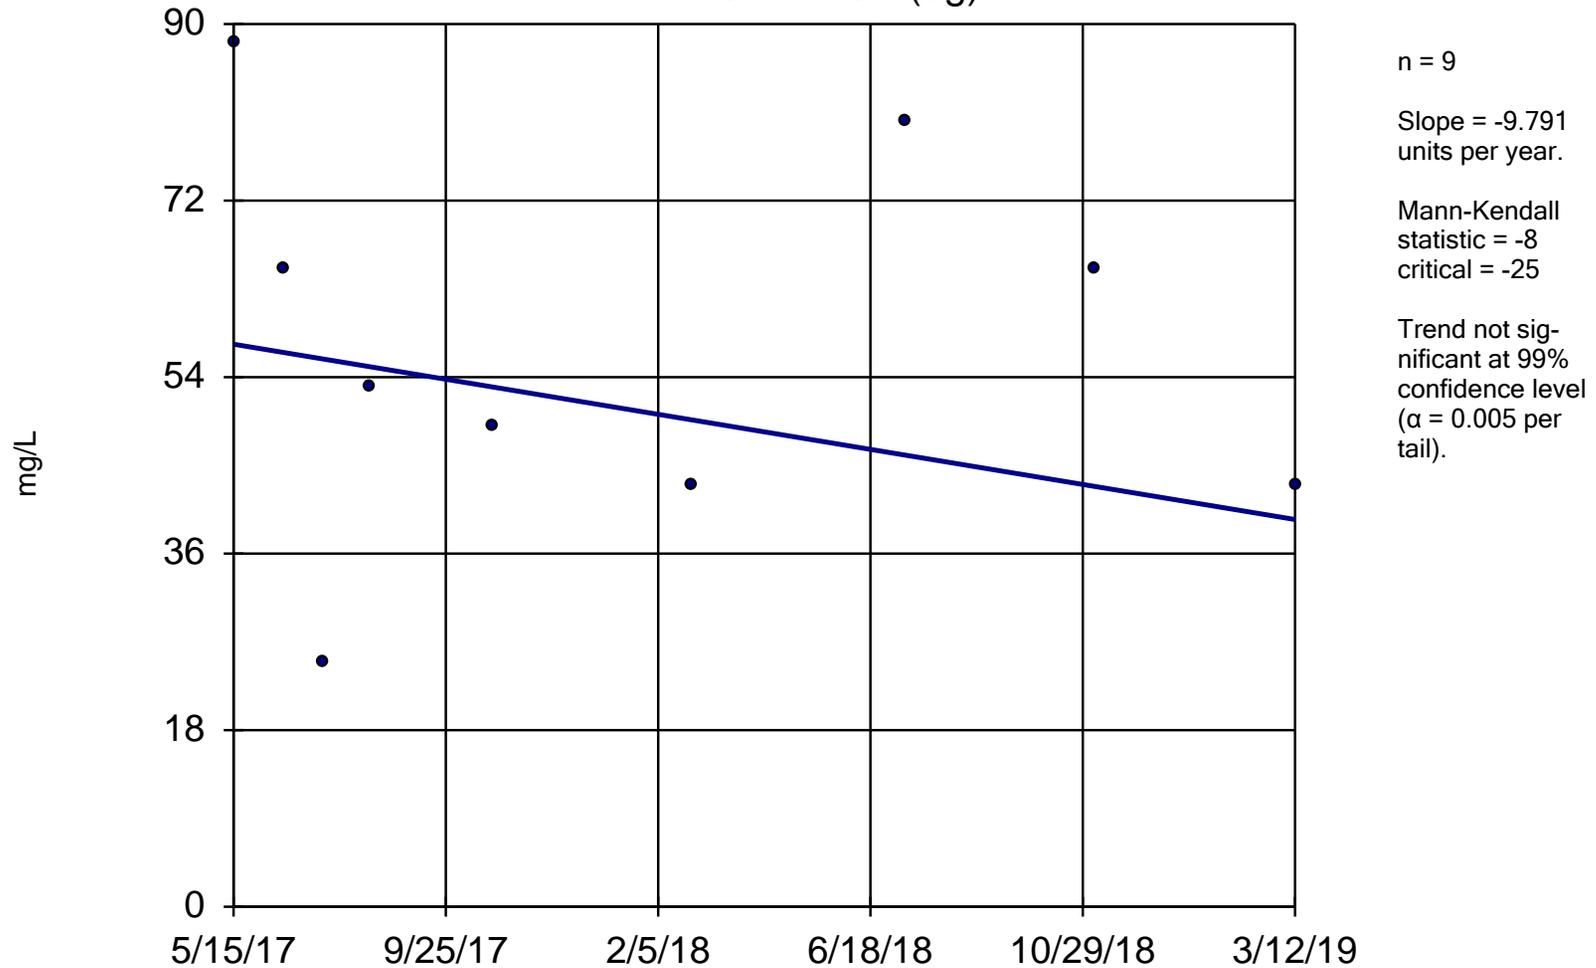

Constituent: TDS Analysis Run 7/26/2019 1:32 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated


Time Series

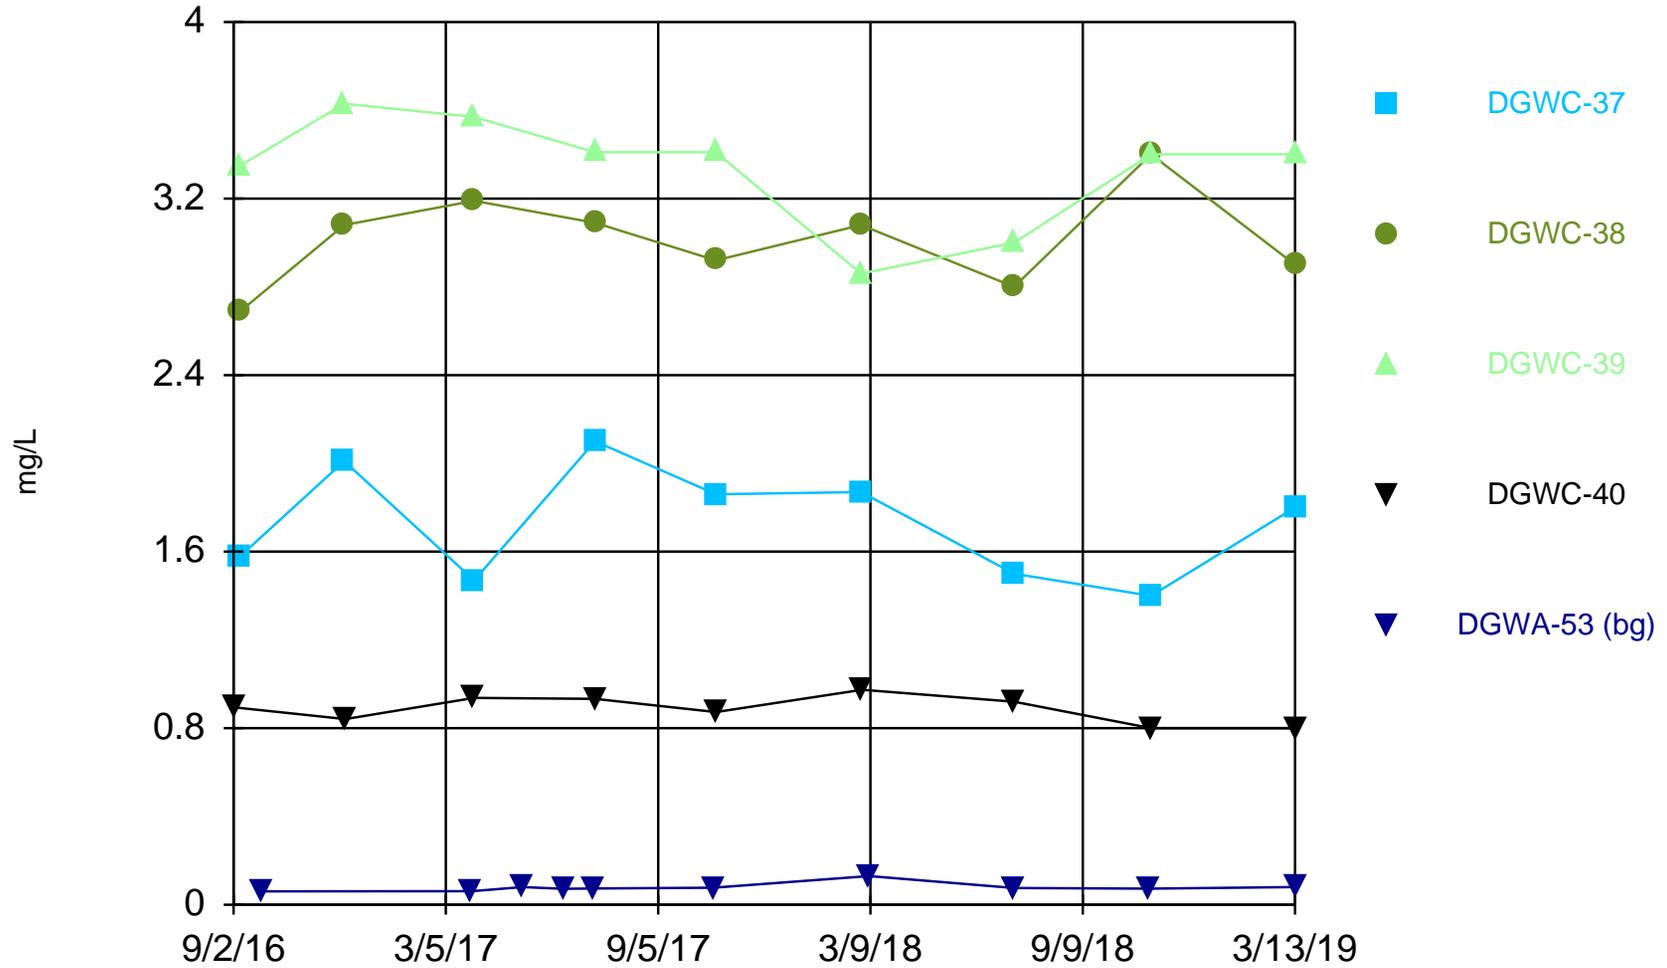

Constituent: Boron Analysis Run 7/6/2019 3:05 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated


Time Series

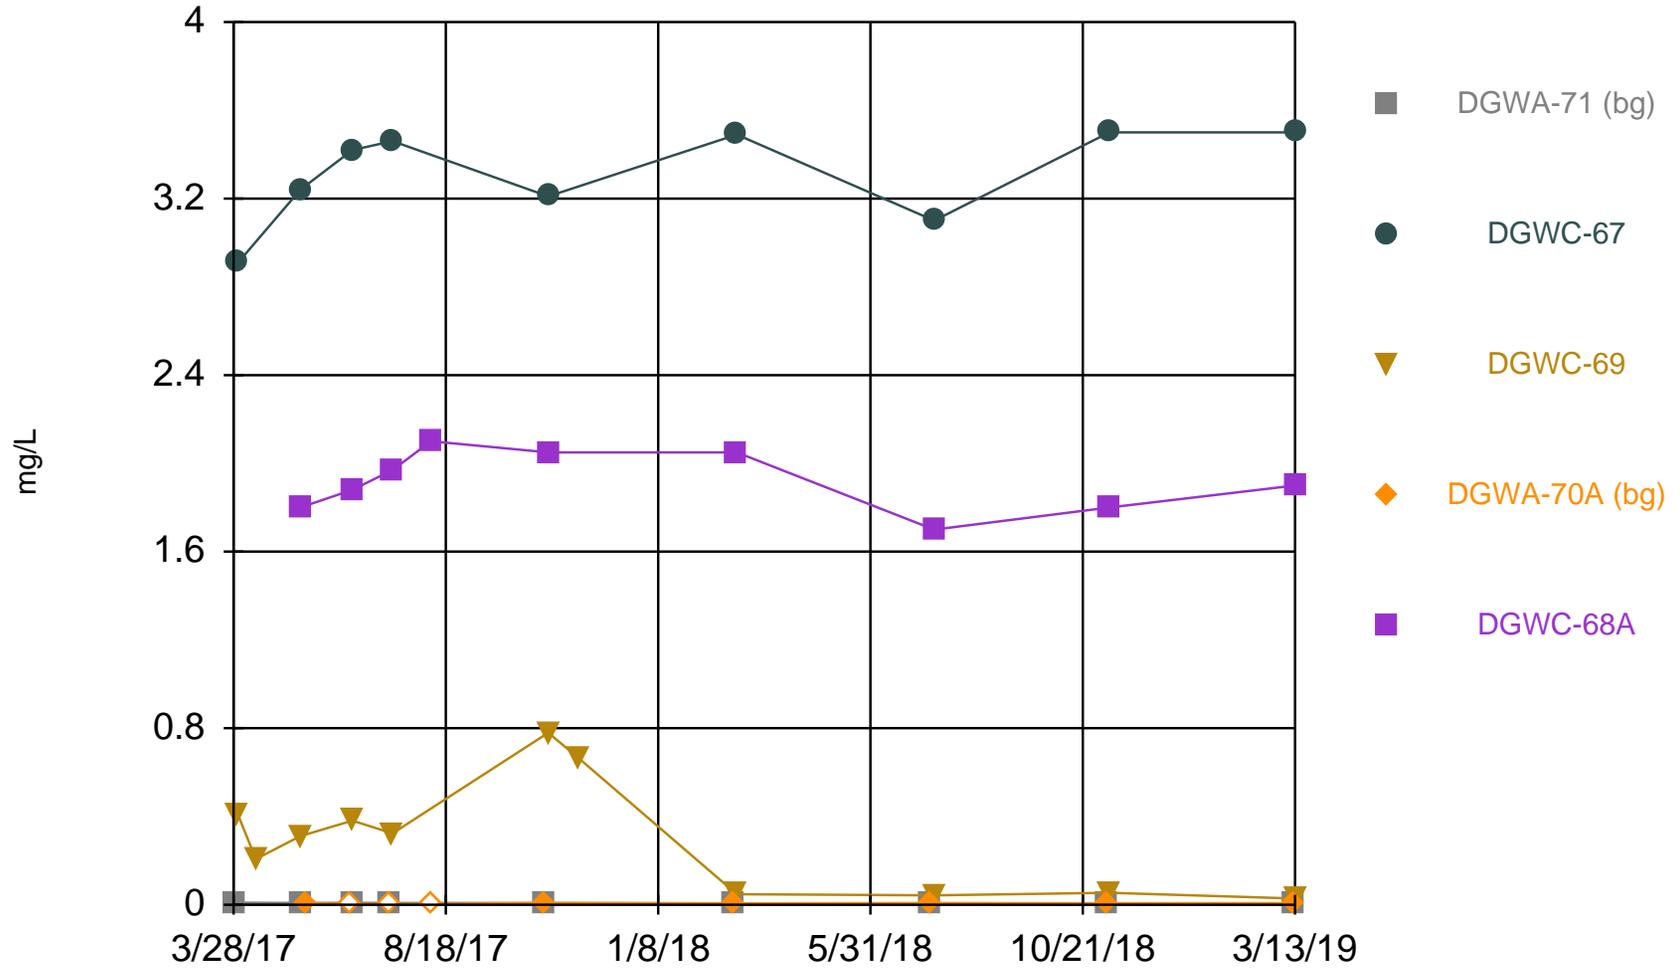

Constituent: Boron Analysis Run 7/6/2019 3:05 PM View: APPIII_AP1


McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Time Series

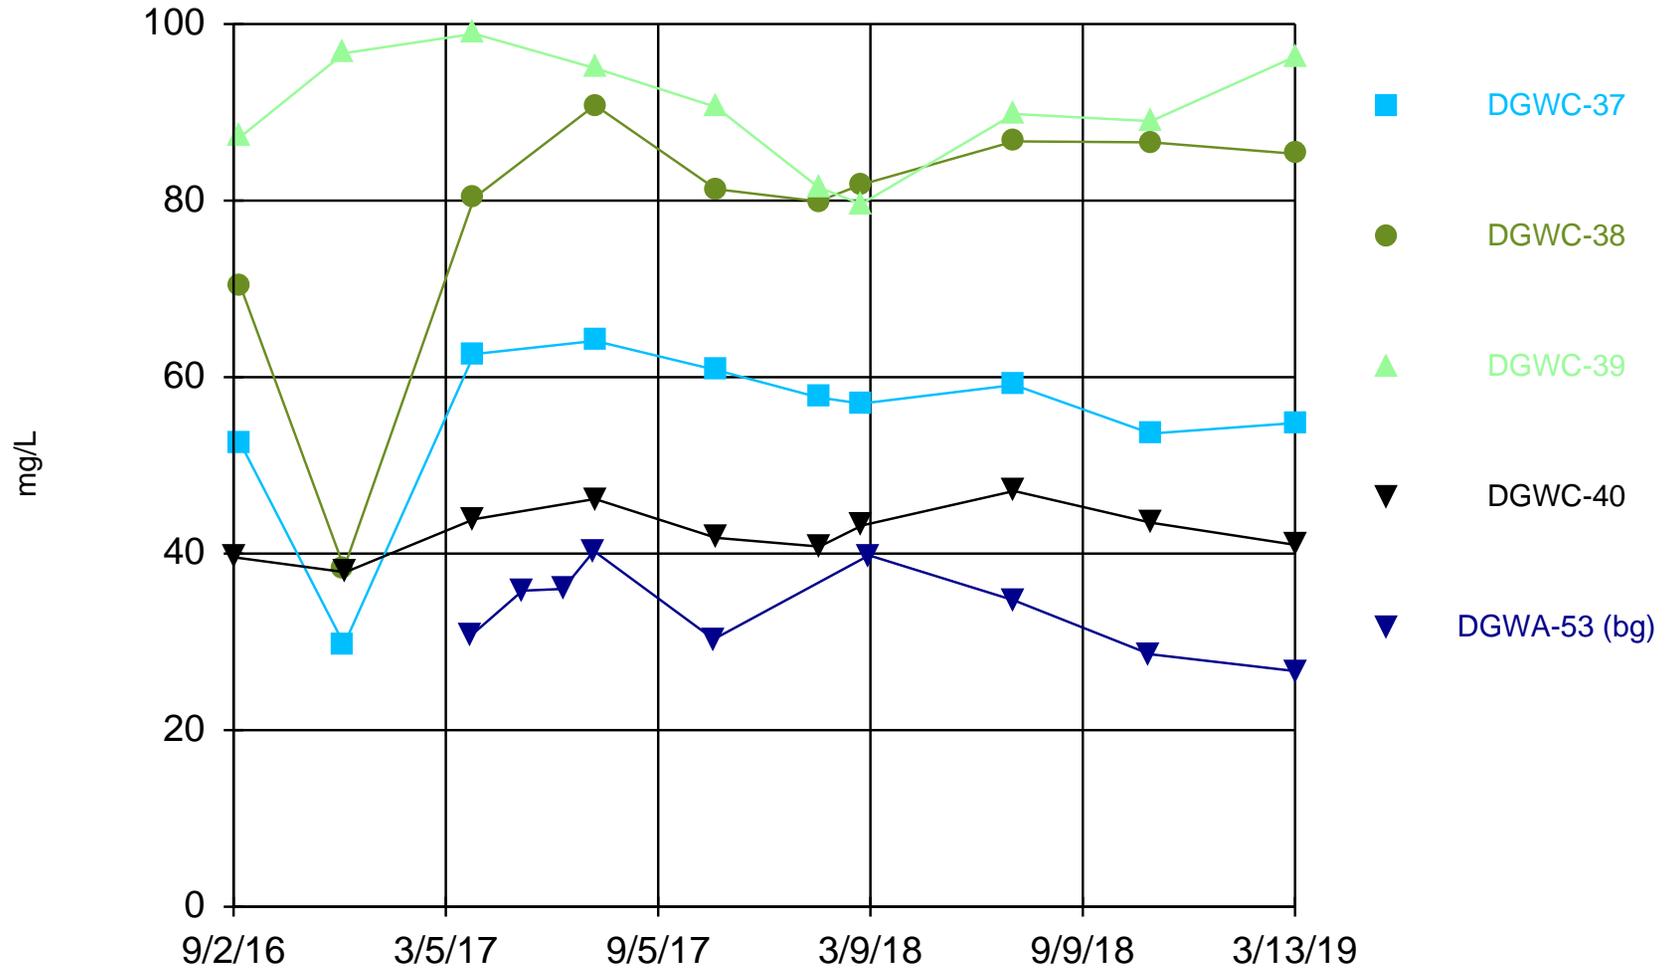

Constituent: Calcium Analysis Run 7/6/2019 3:05 PM View: APPIII_AP1
McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated


Time Series

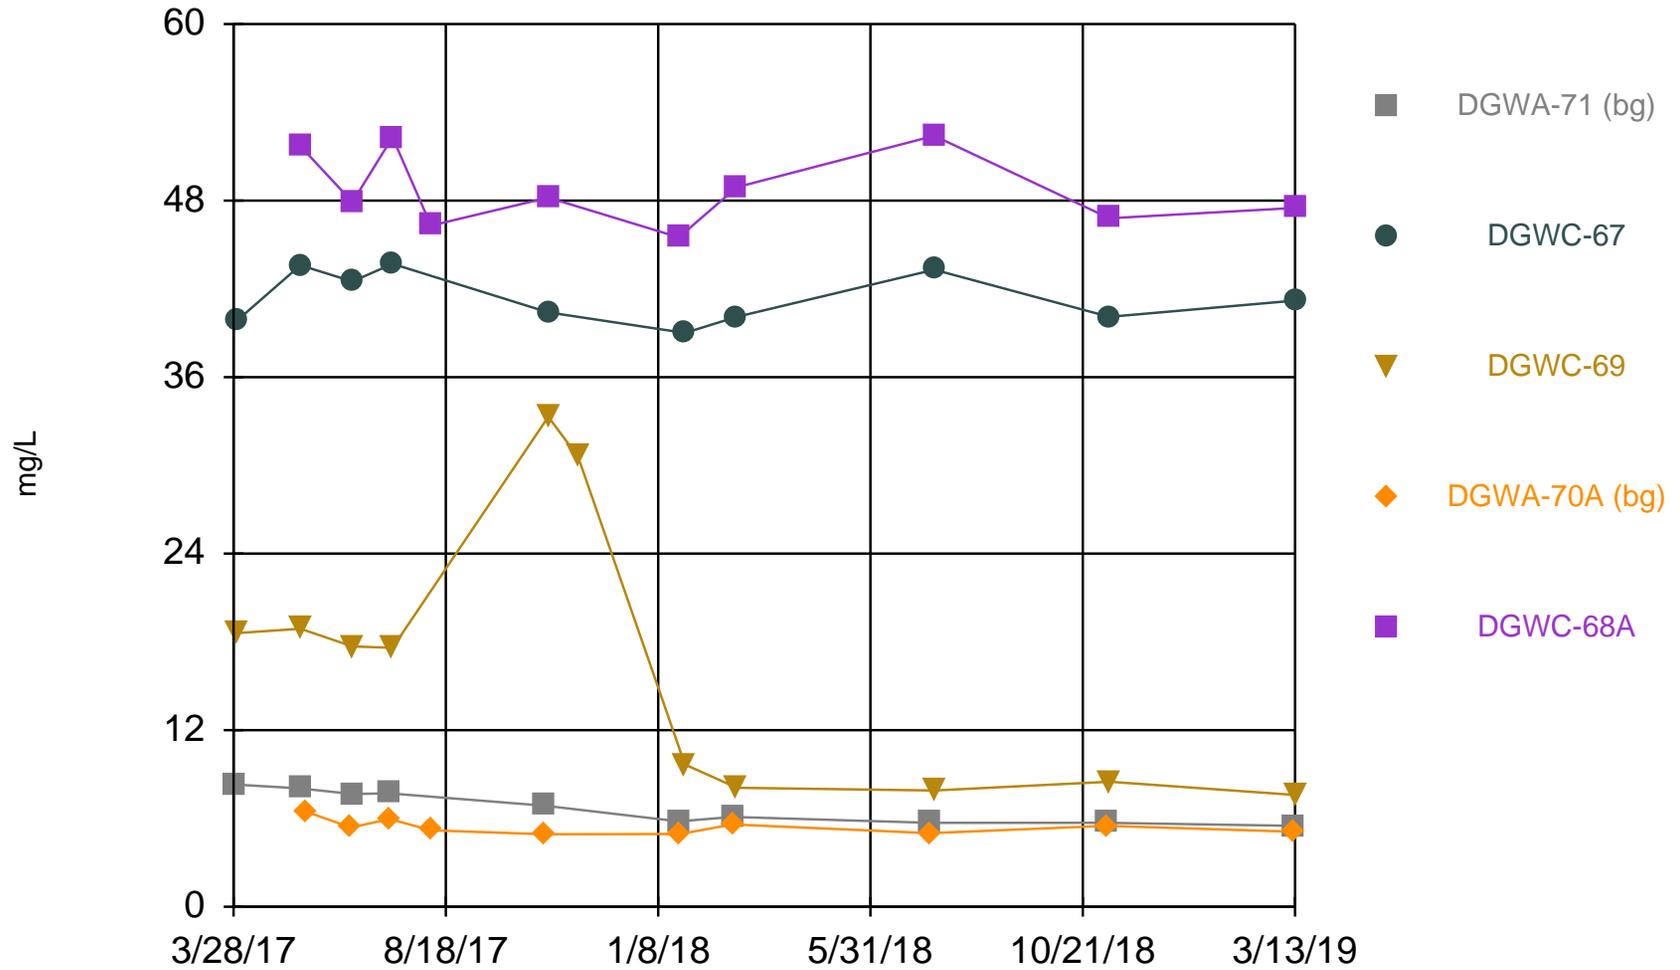

Constituent: Calcium Analysis Run 7/6/2019 3:05 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated


Time Series

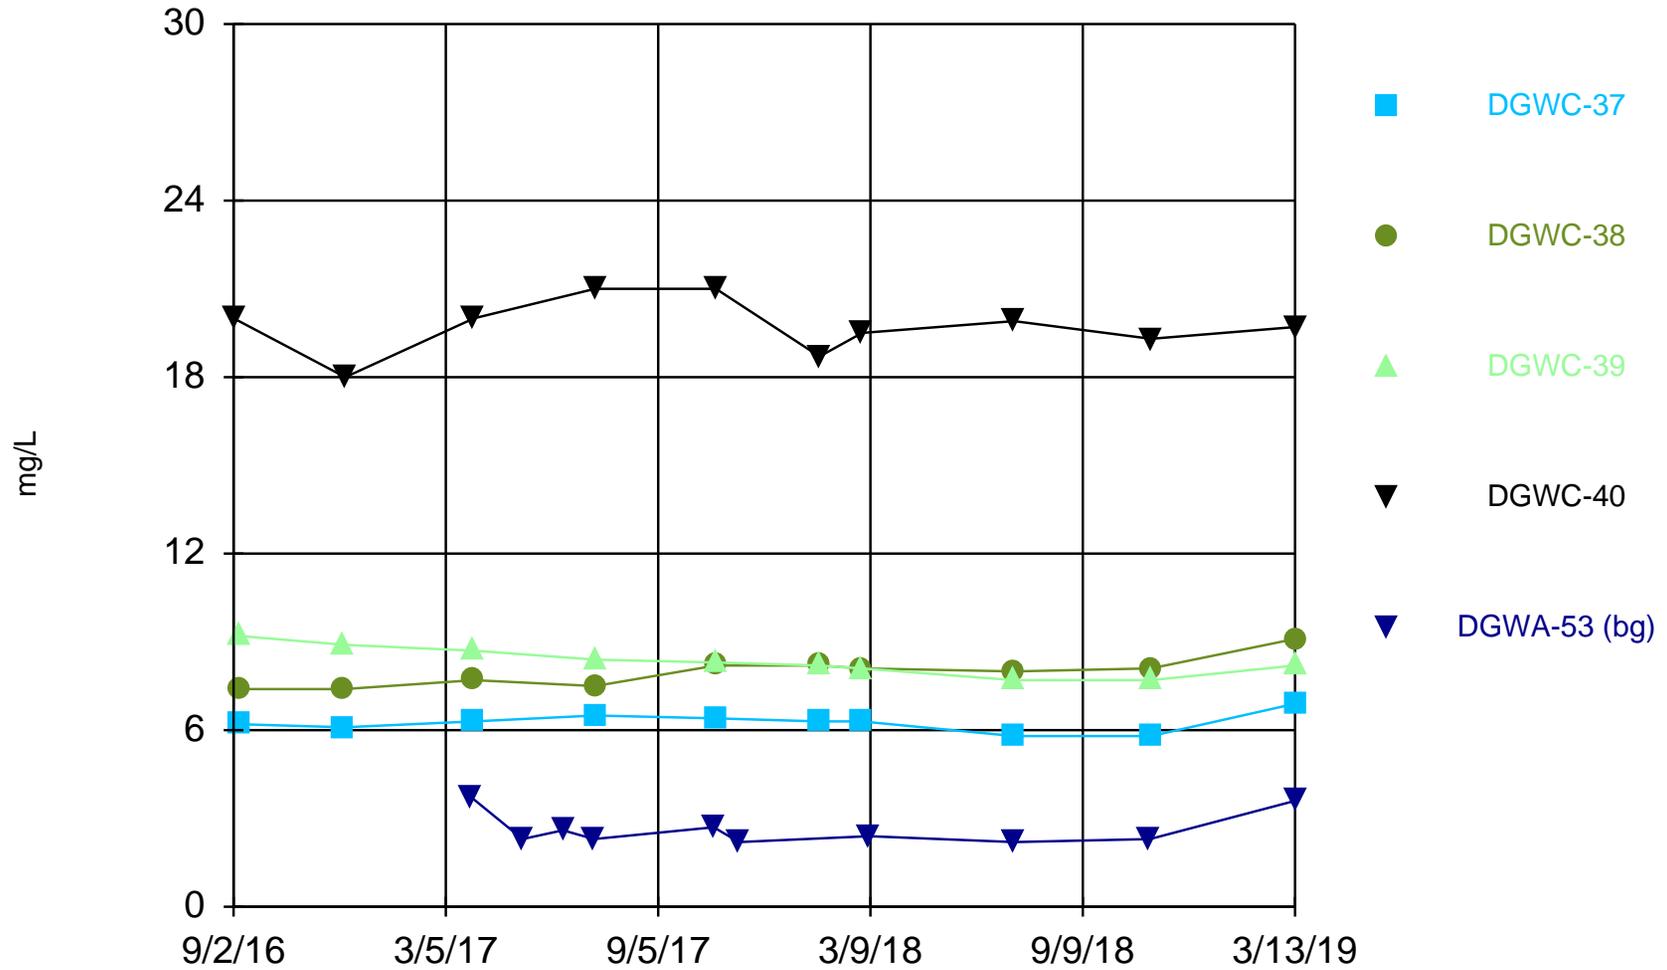

Constituent: Chloride Analysis Run 7/6/2019 3:05 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated


Time Series

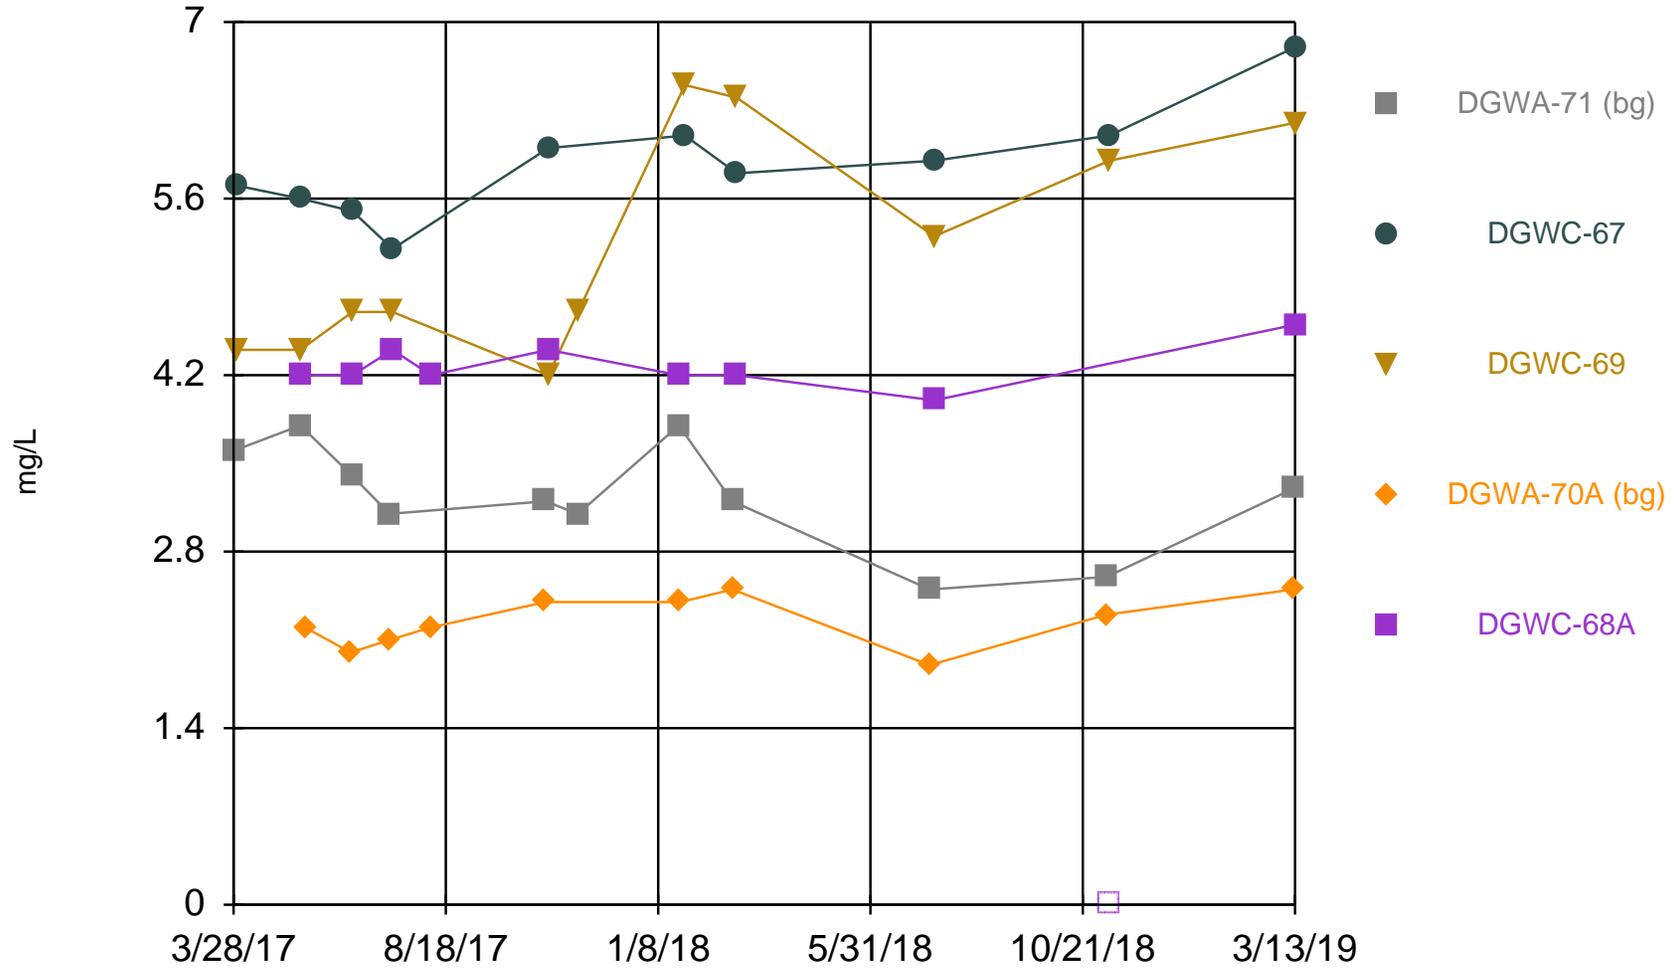

Constituent: Chloride Analysis Run 7/6/2019 3:05 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated


Time Series

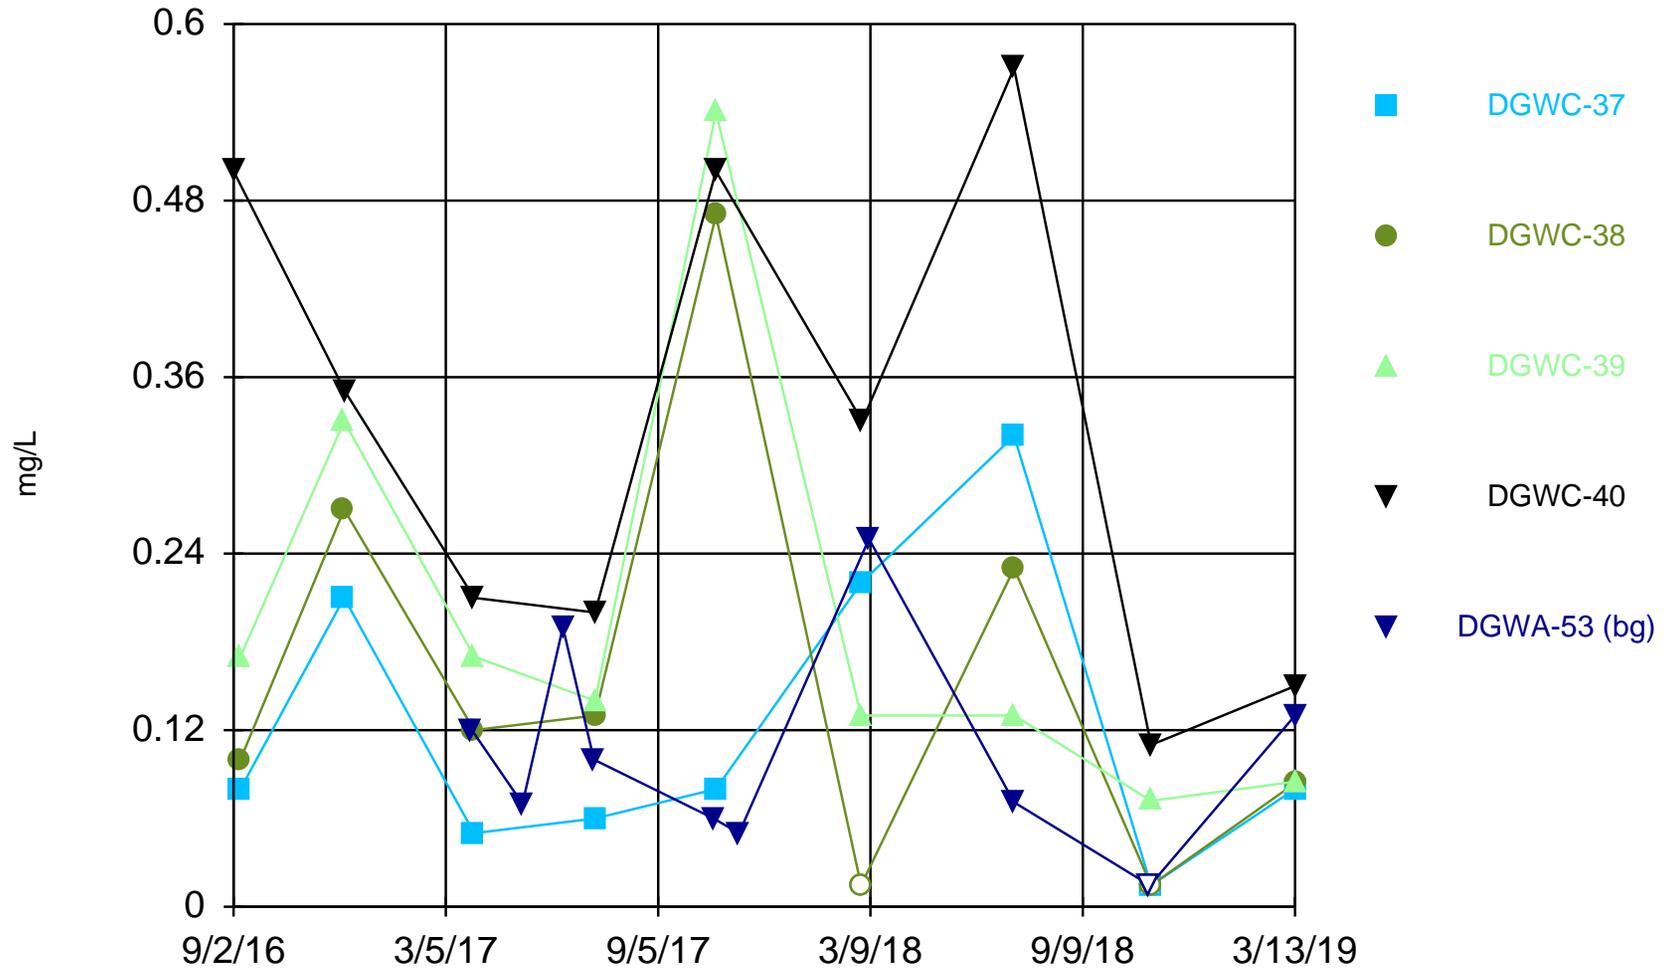

Constituent: Fluoride Analysis Run 7/6/2019 3:05 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated


Time Series

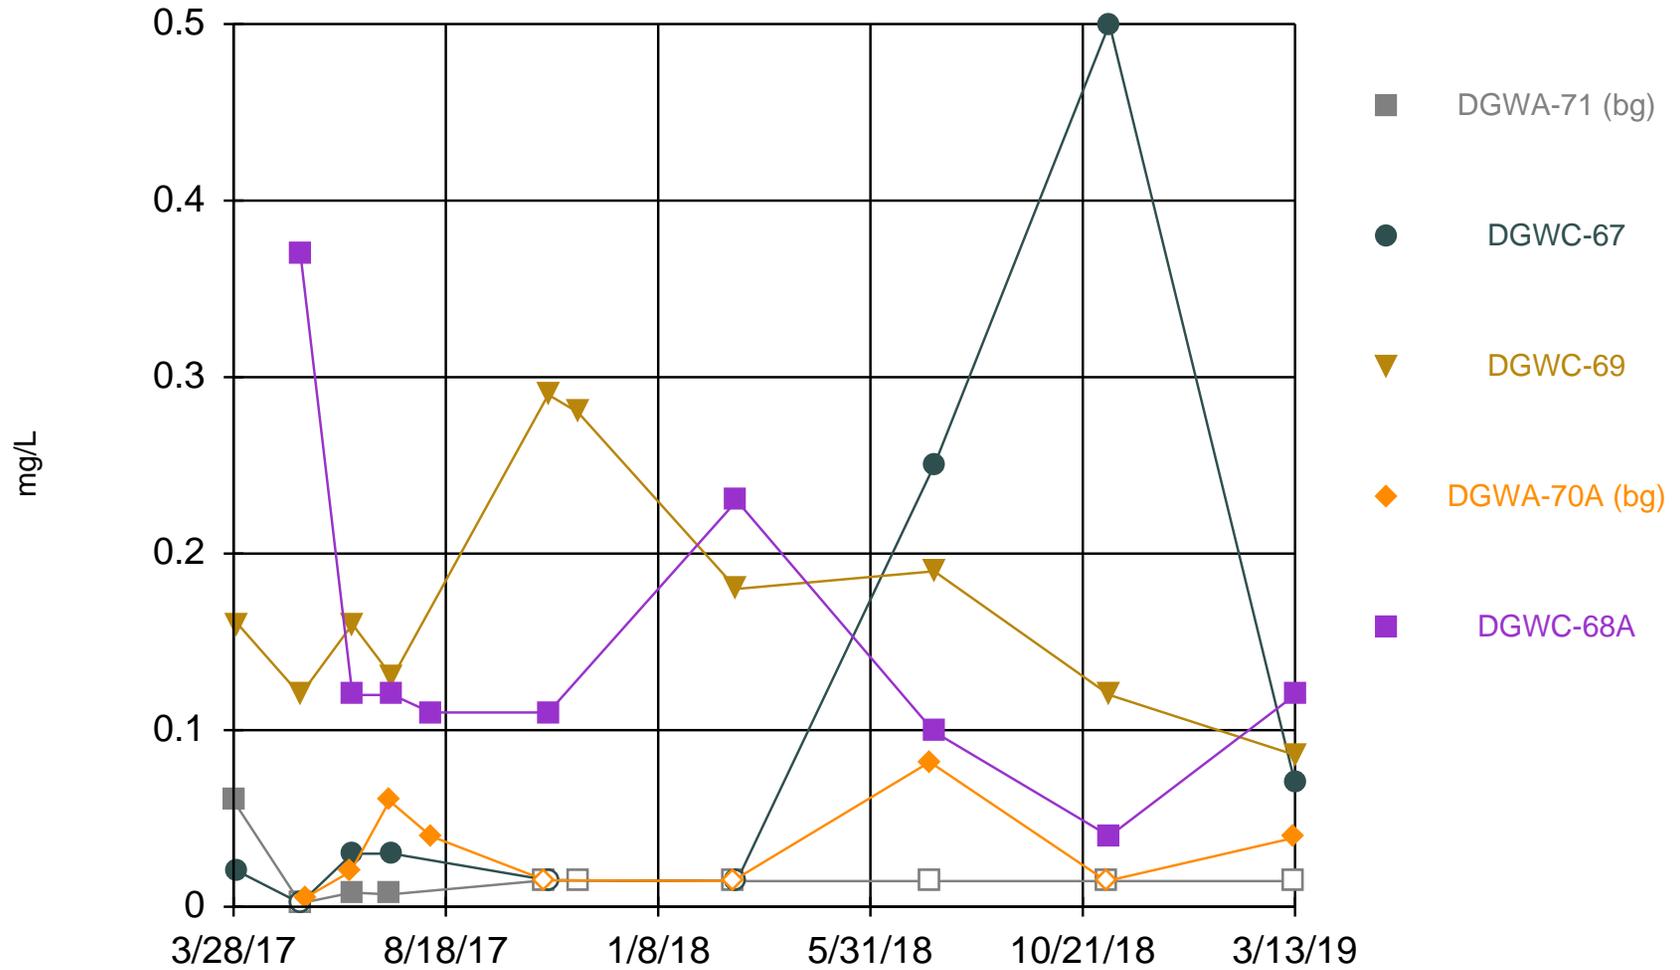

Constituent: Fluoride Analysis Run 7/6/2019 3:05 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated


Time Series

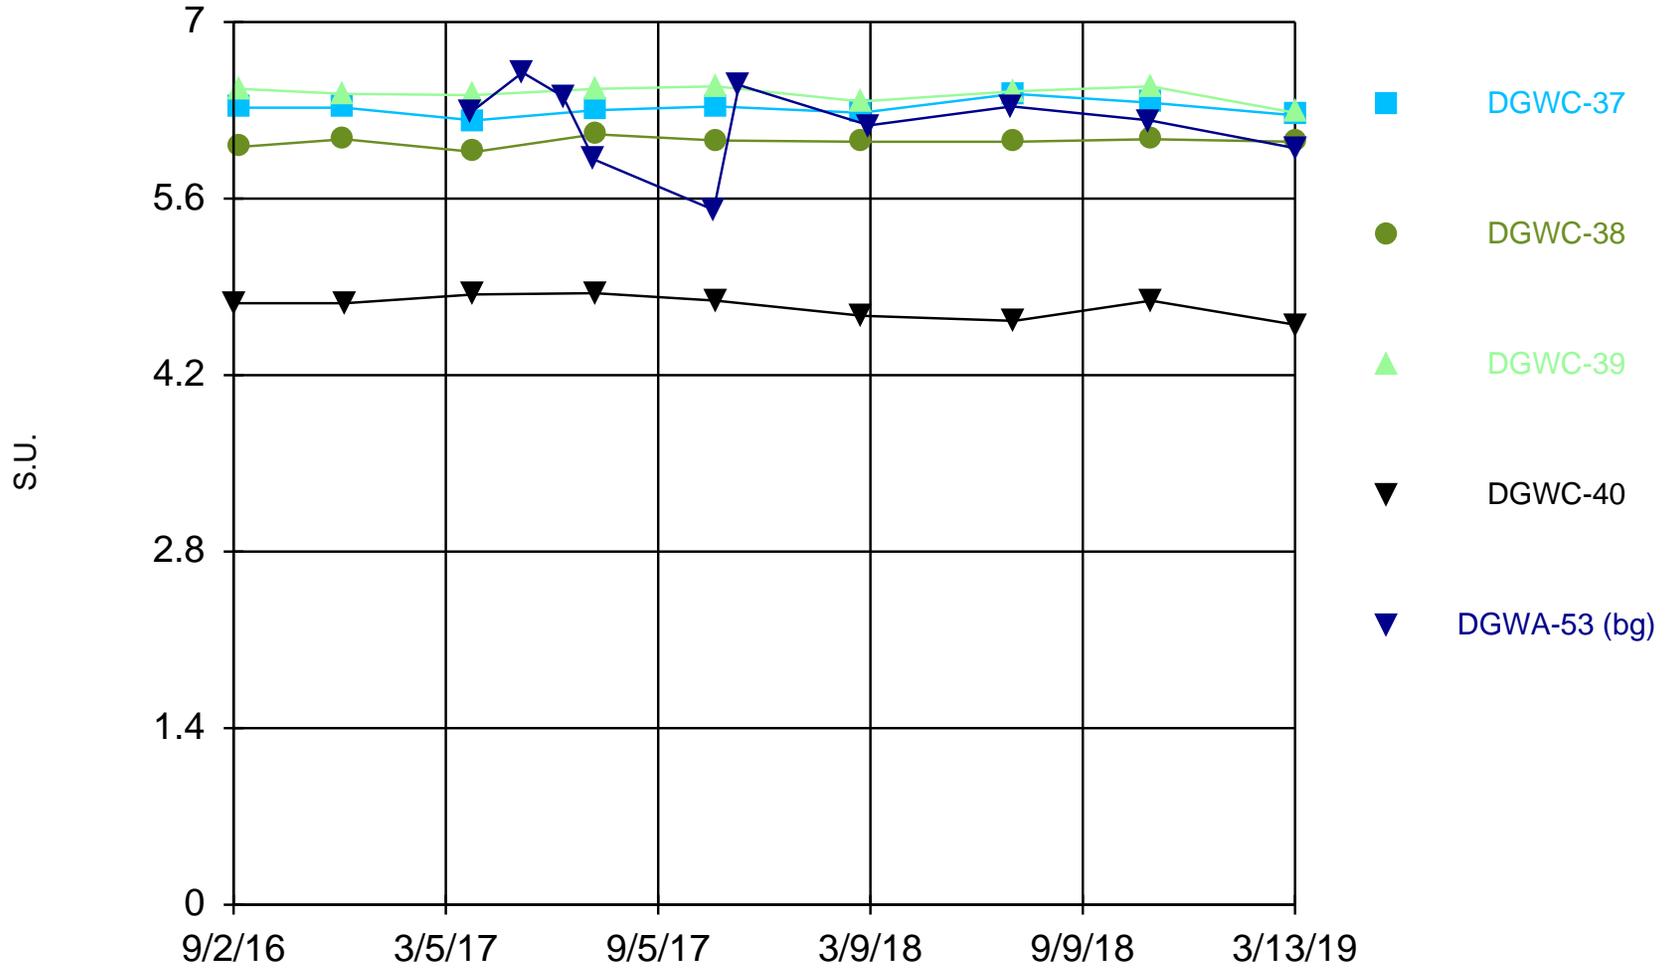

Constituent: pH [field] Analysis Run 7/6/2019 3:05 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated


Time Series

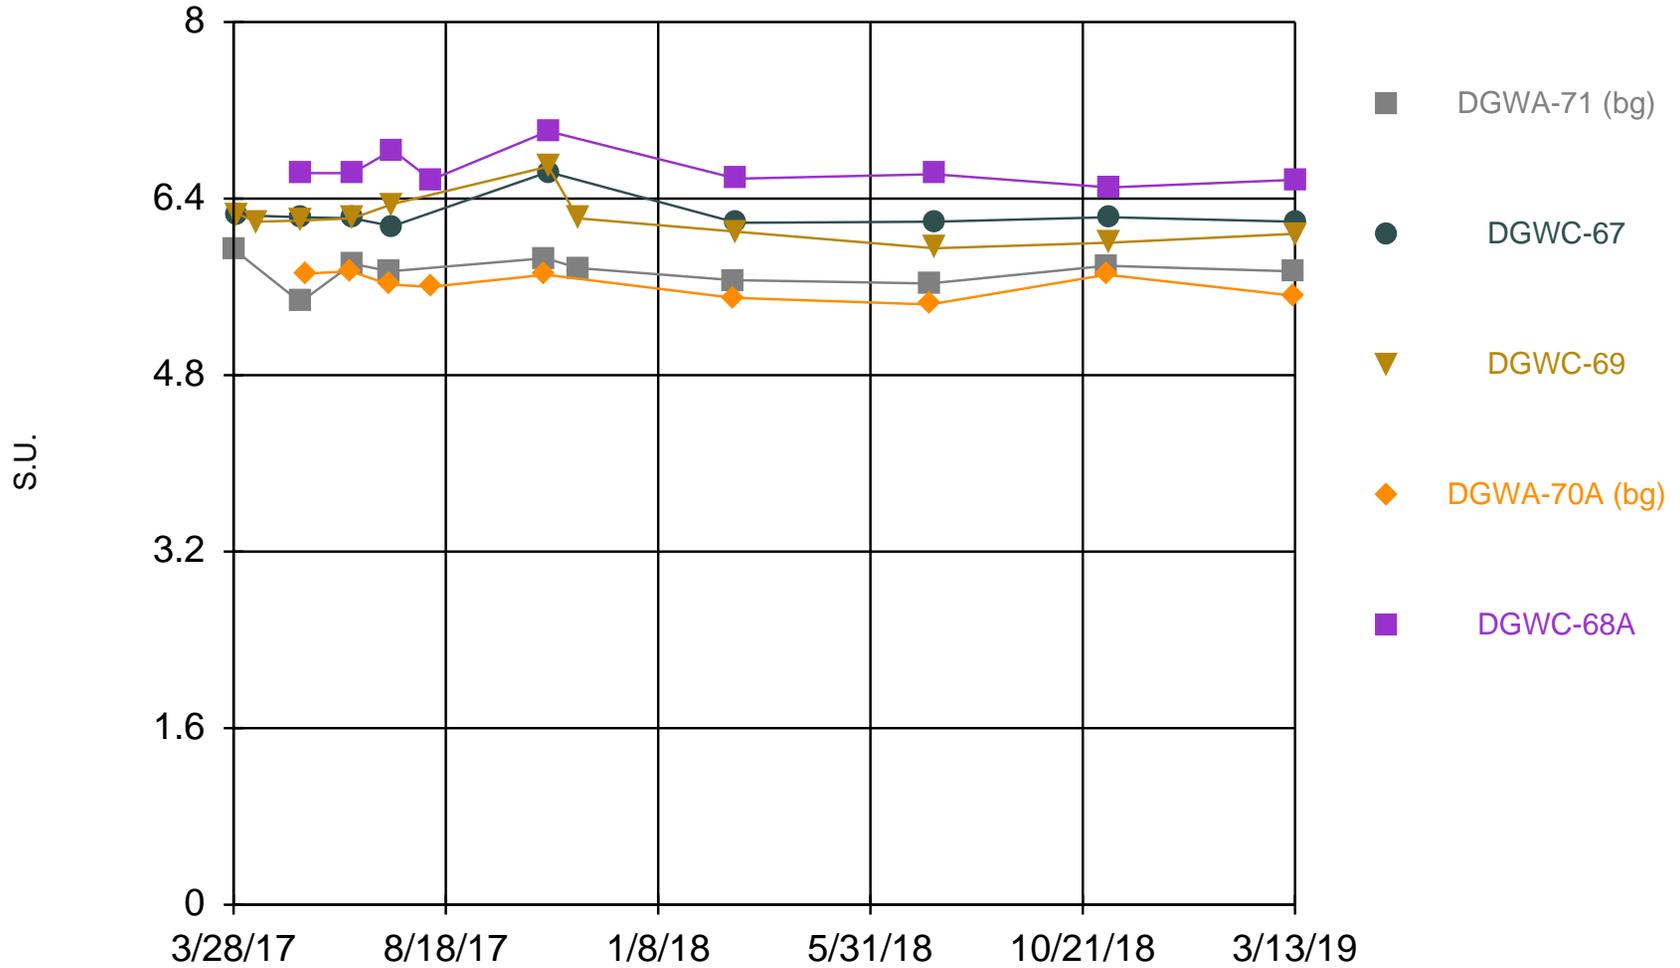

Constituent: pH [field] Analysis Run 7/6/2019 3:05 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated


Time Series

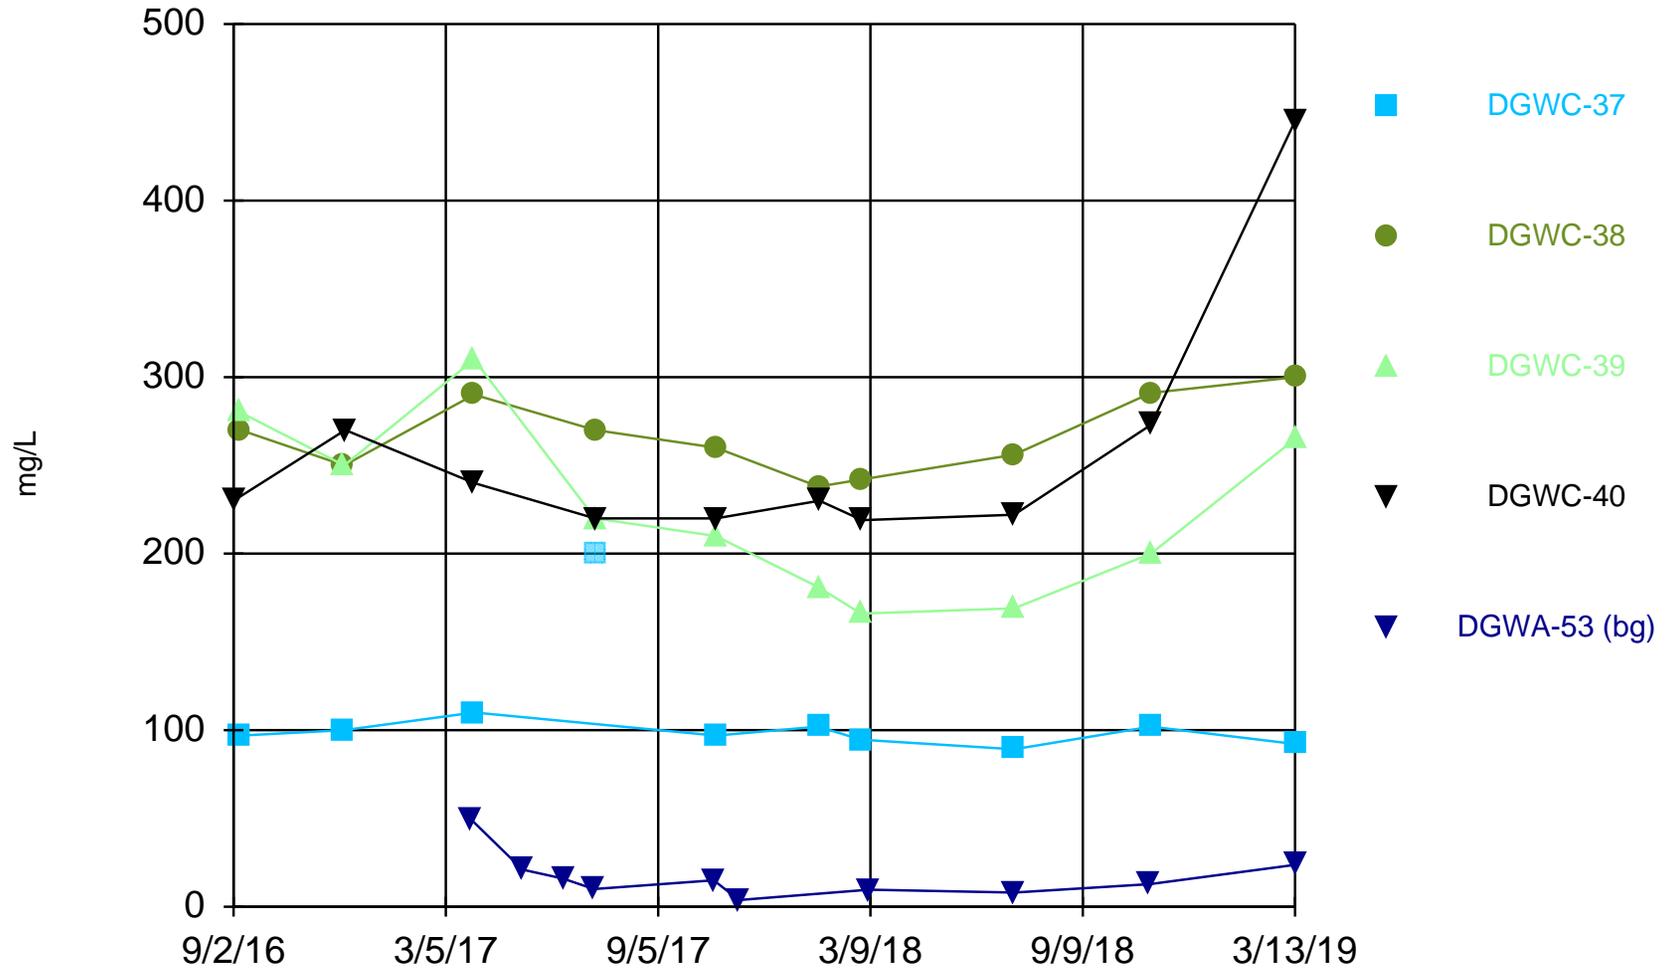

Constituent: Sulfate Analysis Run 7/6/2019 3:05 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated


Time Series

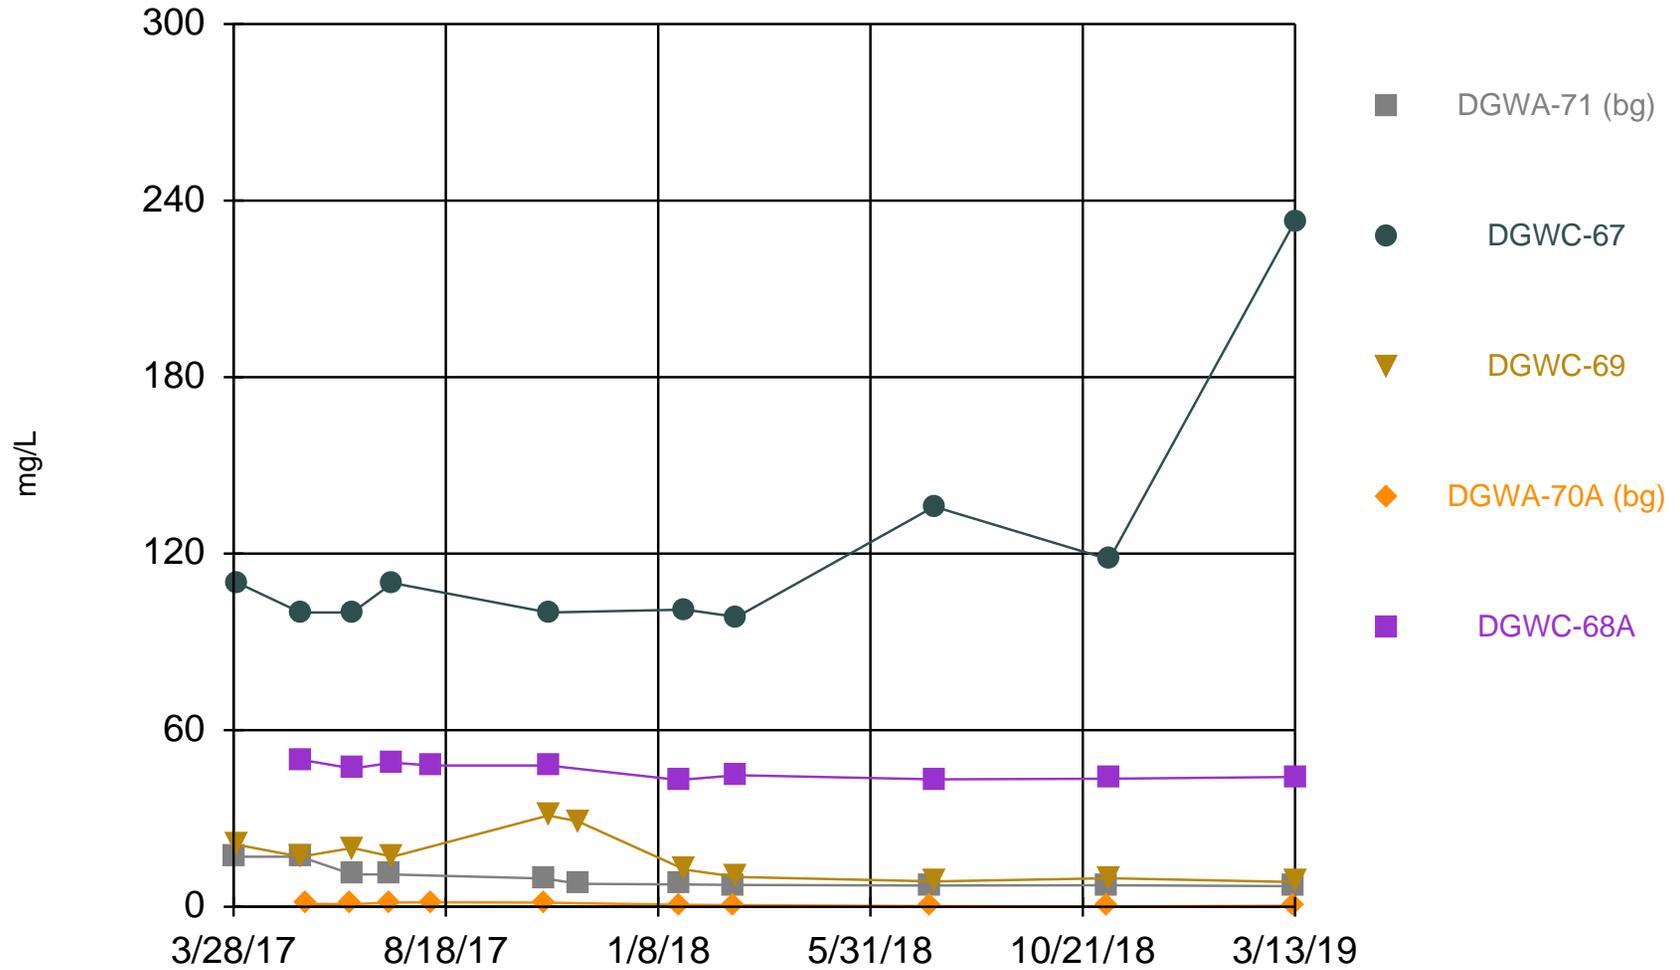

Constituent: Sulfate Analysis Run 7/6/2019 3:05 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated


Time Series

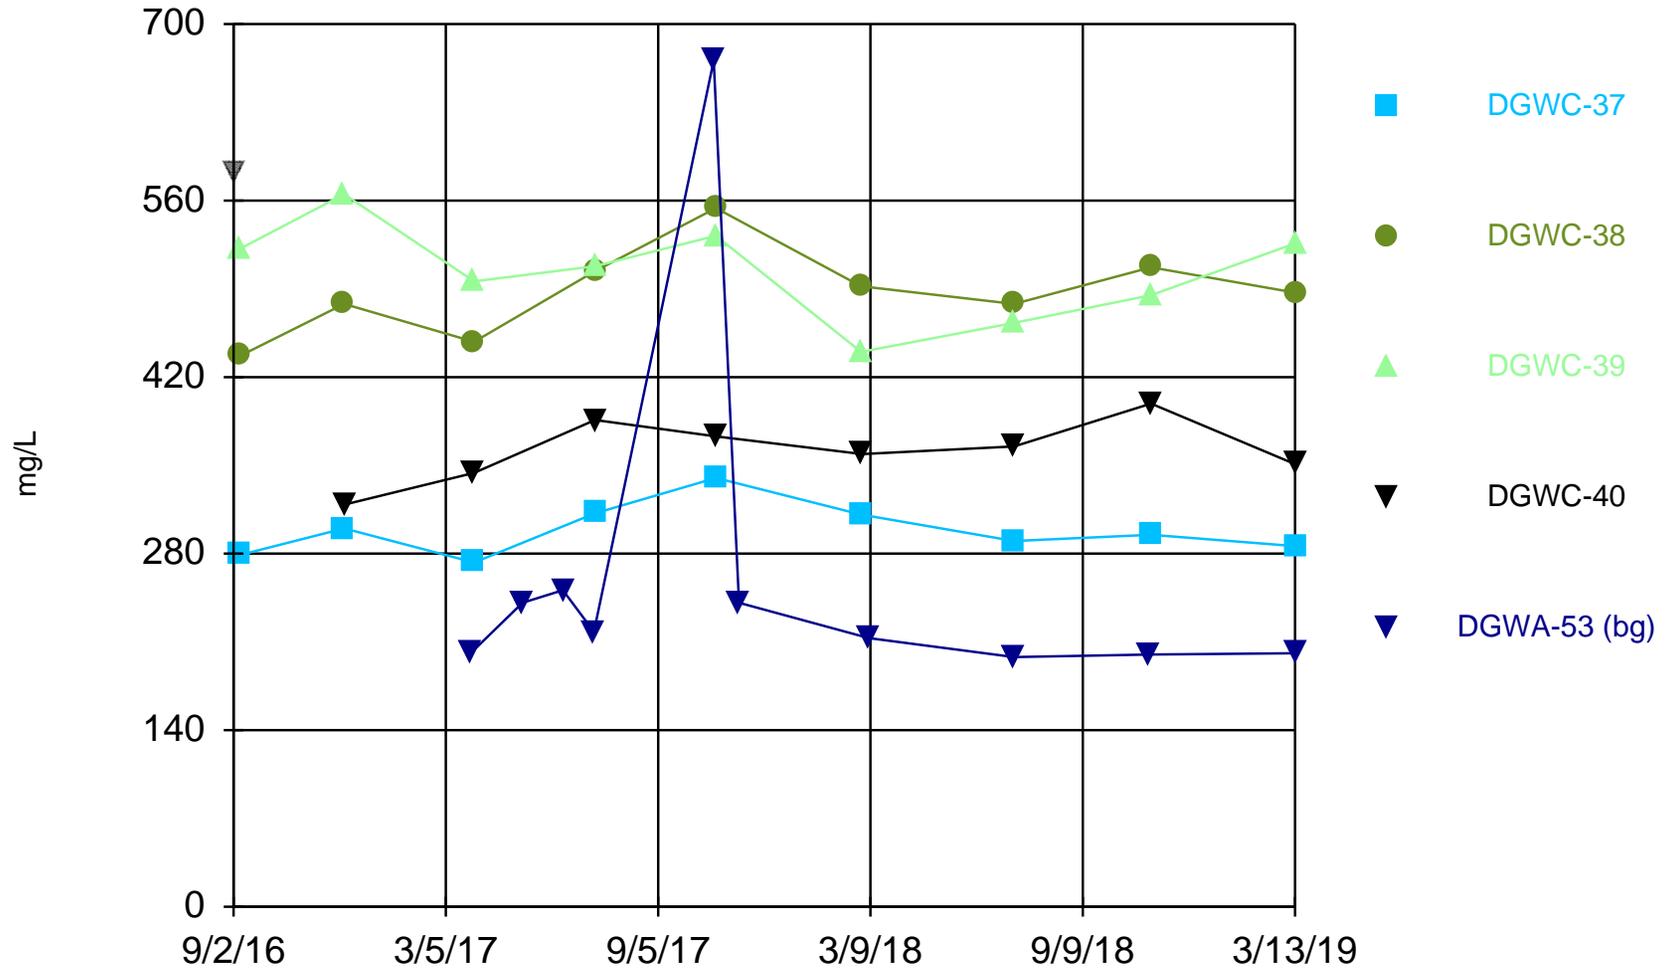

Constituent: TDS Analysis Run 7/6/2019 3:05 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated

Time Series

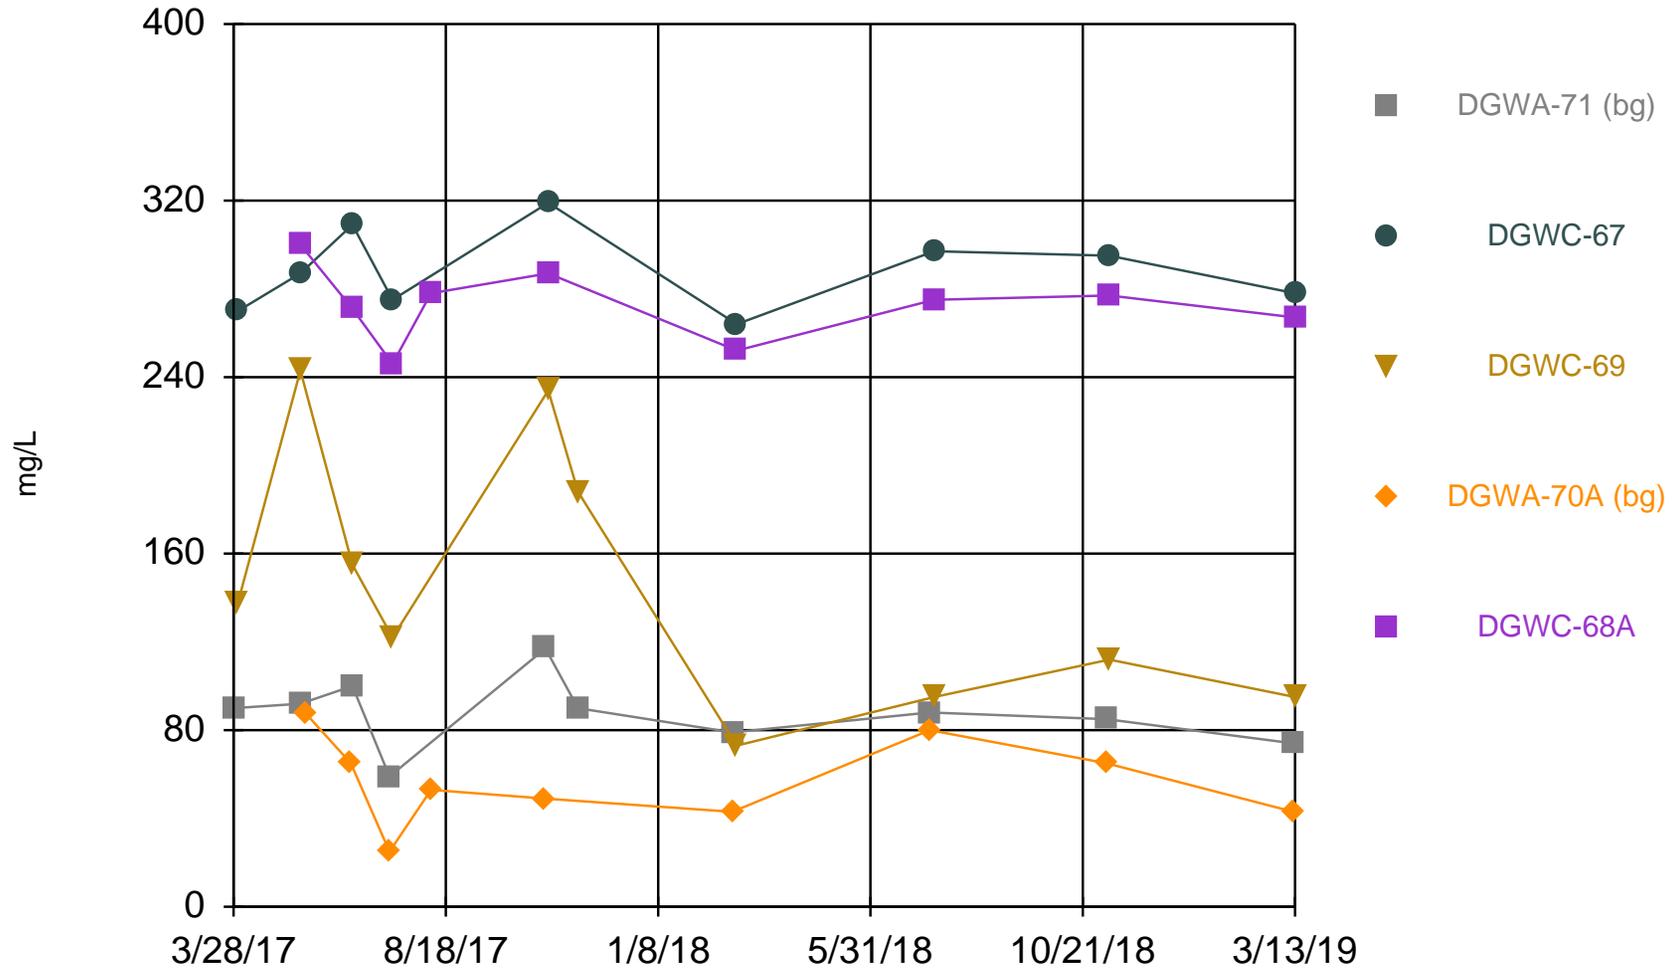

Constituent: TDS Analysis Run 7/6/2019 3:05 PM View: APPIII_AP1

McDonough Client: Golder Associates Data: McDonough Ash Pond - updated 752019_nonvalidated



golder.com