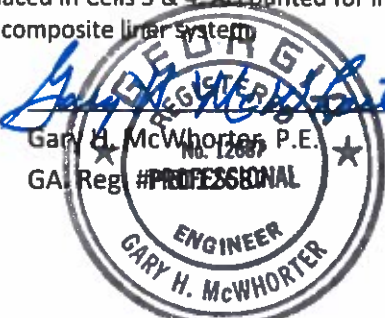


|                  |   |                             |
|------------------|---|-----------------------------|
| 257.84<br>(b)(2) | <b>2019 REPORT OF ANNUAL INSPECTION OF CCR LANDFILL</b>   |                             |
|                  | CCR LANDFILL NAME: Plant Bowen Private Industrial Solid Waste (Coal Combustion By-product) Disposal Facility (Active Cells 1 & 2, 3 & 4, 9 & 10). Permit # 008-018D(LI).  |                             |
|                  | OWNER OF CCR LANDFILL: Georgia Power Company  |                             |
|                  | INSPECTION DATE: 11/21/2019   |                             |
|                  | INSPECTING ENGINEER: Gary H. McWhorter, P.E. GA Reg. #PE012687  |                             |
| (i)              | ANY CHANGES IN GEOMETRY OF THE STRUCTURE SINCE THE PREVIOUS ANNUAL INSPECTION?  | NO <sup>(1)</sup>           |
|                  | (IF YES, DESCRIBE):   |                             |
|                  |   |                             |
|                  |   |                             |
|                  |   |                             |
|                  |   |                             |
|                  |   |                             |
|                  |   |                             |
| (ii)             | APPROXIMATE VOLUME OF CCR CONTAINED IN THE UNIT AT THE TIME OF INSPECTION?  | 1,460,031 cy <sup>(2)</sup> |
| (iii)            | ANY APPEARANCE OF AN ACTUAL OR POTENTIAL STRUCTURAL WEAKNESS OF THE CCR UNIT, IN ADDITION TO ANY EXISTING CONDITIONS THAT ARE DISRUPTING OR HAVE THE POTENTIAL TO DISRUPT THE OPERATION AND SAFETY OF THE CCR UNIT? | NO                          |
|                  | (IF YES, DESCRIBE):   |                             |
|                  |   |                             |
|                  |   |                             |
|                  |   |                             |
|                  |   |                             |
|                  |   |                             |
|                  |   |                             |
| (iv)             | ANY OTHER CHANGE(S) WHICH MAY HAVE AFFECTED THE STABILITY OR OPERATION OF THE CCR UNIT SINCE THE PREVIOUS ANNUAL INSPECTION?  | NO                          |
|                  | (IF YES, DESCRIBE):   |                             |
|                  |   |                             |
|                  |   |                             |
|                  |   |                             |
|                  |   |                             |
|                  |   |                             |
|                  |   |                             |

- (1) The geometry of the structure (permitted footprint and final grades) has not changed since the last inspection, with the exception of the additional placement or marketing of CCR.
- (2) From survey dated 12/11/2019: Cell 1 – 252,241 cy; Cell 2 – 0 cy; Cell 3&4 – 1,207,790 cy (operated as one cell); Cell 9 – 0 cy (74,543 cy of CCR in Cell 9 has been removed and placed in Cells 3 & 4. Accounted for in survey.); Cell 10 – 0 cy (Cells 9 & 10 are currently being retrofitted with a composite liner system)


  
 Gary H. McWhorter, P.E.  
 GA Reg. #PE012687  
 ENGINEER  
 GARY H. McWHORTER

1/15/20