

**PLANT McDONOUGH-ATKINSON  
CCR SURFACE IMPOUNDMENT  
(CCR UNIT AP-2 AND AP-3/4)  
COBB COUNTY, GEORGIA  
PART A SECTION 6  
GROUNDWATER MONITORING PLAN**

---

**FOR**



**Georgia  
Power**

**February 2025**



WSP USA Inc.  
5170 Peachtree Road, Building 100, Suite 300, Atlanta, GA 30341  
(770) 496-1893

# Table of Contents

**1.0 INTRODUCTION .....2**

**2.0 GEOLOGIC AND HYDROGEOLOGIC CONDITIONS .....3**

2.1 Site Geology .....3

2.2 Site Hydrogeology .....4

2.3 Uppermost Groundwater Aquifer .....5

2.4 Groundwater Gradient and Flow Velocity .....5

**3.0 SELECTION OF WELL LOCATIONS .....6**

**4.0 MONITORING WELL DRILLING, CONSTRUCTION, ABANDONMENT & REPORTING.....7**

4.1 Drilling .....7

4.2 Design and Construction.....7

4.2.1 Well Casings and Screens .....7

4.2.2 Well Intake Design .....8

4.2.3 Filter Pack and Annular Seal .....8

4.2.4 Protective Casing and Well Completion .....9

4.2.5 Well Development.....9

4.2.6 Surveying .....10

4.3 Well Abandonment.....10

4.4 Documentation .....10

**5.0 GROUNDWATER MONITORING PARAMETERS AND FREQUENCY .....11**

**6.0 SAMPLE COLLECTION .....12**

**7.0 SURFACE WATER MONITORING PLAN.....12**

**8.0 CHAIN-OF-CUSTODY .....13**

**9.0 FIELD AND LABORATORY QUALITY ASSURANCE/QUALITY CONTROL .....14**

**10.0 REPORTING RESULTS .....14**

**11.0 STATISTICAL ANALYSES .....15**

**12.0 REFERENCES .....16**

## Table of Contents (continued)

### Tables

TABLE 1:	SUMMARY OF MONITORING WELL, ASSESSMENT WELL AND PIEZOMETER CONSTRUCTION DATA
TABLE 2:	GROUNDWATER VELOCITY CALCULATIONS – JANUARY 2024
TABLE 3:	GROUNDWATER MONITORING PARAMETERS AND FREQUENCY
TABLE 4:	ANALYTICAL METHODS
TABLE 5:	SURFACE WATER MONITORING PARAMETERS AND FREQUENCY

### Figures

FIGURE 1:	ASH POND 2 (AP-2) & ASH PONDS 3/4 (AP-3/4) SITE PLAN & DETECTION MONITORING WELL LOCATION MAP
FIGURE 2A:	SITE POTENTIOMETRIC MAP – JANUARY 29, 2024
FIGURE 2B:	(INSET) SITE POTENTIOMETRIC MAP – JANUARY 29, 2024
FIGURE 3:	SURFACE WATER SAMPLING LOCATION MAP
FIGURE 4:	STATISTICAL ANALYSIS PLAN OVERVIEW
FIGURE 5:	DECISION LOGIC FOR COMPUTING INTERWELL PREDICTION LIMITS

### Appendices

APPENDIX A:	MONITORING SYSTEM DETAILS
	MONITORING WELL AND PIEZOMETER CONSTRUCTION LOGS
	DRILLER BONDS
	CERTIFIED WELL SURVEY REPORT
APPENDIX B:	GROUNDWATER MONITORING WELL DETAILS
APPENDIX C:	GROUNDWATER SAMPLING PROCEDURES
APPENDIX D:	SURFACE WATER SAMPLING PROCEDURES

## Certification

This *Groundwater Monitoring Plan* for Georgia Power Company's (Georgia Power) Ash Pond 2 (AP-2), and Combined Unit AP-3/4 (previously Ash Pond 3 [AP-3] and Ash Pond 4 [AP-4]) located at Plant McDonough-Atkinson (Plant McDonough) has been prepared by a qualified groundwater scientist with WSP USA Inc. (WSP) to meet the requirements contained in Chapter 391-3-4-.10 of Georgia Environmental Protection Division Rules of Georgia, Solid Waste Management, Coal Combustion Residuals (i.e., State Rule). References to the appropriate 391-3-4 Rules are incorporated throughout this document.

I certify that I am a qualified groundwater scientist as defined in 391-3-4-.01 who is a professional engineer or geologist registered to practice in Georgia who has received a baccalaureate or post-graduate degree in the natural sciences or engineering and has sufficient training and experience in groundwater hydrology and related fields that enable me to make sound professional judgments regarding groundwater monitoring, contaminant fate and transport, and corrective action. I further certify that this Groundwater Monitoring Plan was prepared by myself or by a subordinate working under my direction. The design of the groundwater monitoring system was developed in compliance with Georgia Environmental Protection Division (EPD) Rules of Solid Waste Management, Chapter 391-3-4-.10(6)

**WSP USA Inc.**



Dawn L. Prell, CPG  
*Senior Hydrogeologist*



Gregory L. Hebel, PhD, PE  
Georgia Registered Professional Engineer No. 034749



## 1.0 INTRODUCTION

Groundwater monitoring is required by the Georgia Environmental Protection Division (EPD) to detect and quantify potential changes in groundwater chemistry. This *Groundwater Monitoring Plan* (plan) describes the groundwater monitoring program for CCR impoundments at Plant McDonough-Atkinson (Plant McDonough, the Site). This plan meets the requirements of EPD rules and uses EPD's Manual for Groundwater Monitoring dated September 1991 as a guide. Monitoring well and piezometer locations are presented on Figure 1 for Ash Pond Unit 2 (AP-2) and combined Ash Pond Units 3 and 4 (AP-3/4) at Plant McDonough. Ash Pond 1 (AP-1) is located west of AP-2 and AP-3/4 and is referenced herein as it relates to site conditions. Information included specific to AP-1 should not be considered for permitting.

Monitoring will occur in accordance with 391-3-4-.10 of the Georgia Solid Waste Management Rules. If the monitoring requirements specified in this plan conflict with EPD rules (391-3-4), the EPD rules will take precedence. Plant McDonough AP-2 and AP-3/4 entered into assessment monitoring on November 15, 2019. An assessment of corrective measures (ACM) was initiated on July 9, 2020, within 90 days of identifying statistically significant levels above groundwater protection standards (SSLs). A 60-day extension until December 4, 2020 for completion of the ACM was documented on October 7, 2020. Based on the results of the ACM, a final long-term corrective action plan will be developed and implemented pursuant to 40 CFR 257.97-98 and 391-3-4-.10(6).

In accordance with the United States Environmental Protection Agency (US EPA) Coal Combustion Rule (§ 257.90), a detection monitoring well network for AP-2 and AP-3/4 has been installed and certified by a qualified professional engineer. This certification has been placed in the facility's operating record. The existing monitoring wells were installed following the guidelines presented herein. Additionally, this plan documents the methods for future monitoring well installation and/or replacement, and procedures for well abandonment. As required by 391-3-4-.10(6)(g), a minor modification will be submitted to the EPD prior to the unscheduled installation or abandonment of monitoring wells. Well installation and/or abandonment must be directed by a qualified groundwater scientist.

### Current Site Conditions and Pond Closure

The following sections describe the current site conditions as well as geologic and hydrogeologic information for Ash Pond 2 and 3/4 at Plant McDonough. AP-3 and AP-4 were historically operated together and are being closed as a Combined Unit AP-3/4, as required by 391-3-4-.10(7)(a).

At AP-2, closure by removal of ash was completed in September 2016. Closure procedures included excavating all visible ash, over excavating into the subgrade soils, and placement of topsoil and seeding for vegetative cover. In 2019, additional ash removal was undertaken, and a closure certification report was submitted to GA EPD on March 30, 2020, and receipt acknowledged on October 14, 2020. AP-3 and adjacent AP-4 have been consolidated and are being closed in place as combined unit AP-3/4 in accordance with § 257.102(d). CCR in the eastern portion of AP-4 has been relocated to the western portion of AP-4 as well as dry stacked on AP-3. CCR has been graded within the footprint of the impoundment to create a subgrade for the final cover system, and final cover completion is underway. During closure, AP-3 and AP-4 are being dewatered as required to facilitate consolidation and closure in place. This process is expected to result in groundwater flow returning to its original, pre-construction flow direction to the south.

The *Closure Plan* (WSP 2023) was prepared in accordance with § 257, Subpart D and meets the requirements of § 257.102(b). Following closure, maintenance will be provided on the final cover system for the required post-

closure care period so that the integrity and effectiveness of the final cover system are maintained. Relevant performance criteria, including dewatering, are part of the scope evaluated in the Closure Design and advanced engineering methods (AEM) and addressed in the Closure Plan and Post-Closure Care Plan (WSP 2023 and 2024a).

The *Hydrogeological Assessment Report* (HAR; WSP 2024b) details the three-dimensional post-closure numerical groundwater modeling for the Site. The steady state groundwater modelling predicts that the closure plans, with implementation of the designed enhanced under-slope collection system AEM, will result in water levels declining to elevations below the bottom of the unit. In addition, the proposed AEMs for CCR Unit AP-3/4 include the continued use of the temporary AEM wells for enhanced water removal for a temporary period after closure to accelerate the rates at which the post-closure groundwater table elevation is reached.

The selected AEM for AP-1 includes a subsurface vertical barrier wall that surrounds AP-1 in its entirety. Groundwater flow in the vicinity of AP-2 and AP-3/4 is not expected to be significantly influenced by the presence of the barrier wall following construction. Groundwater flow is predicted to flow south towards the Chattahoochee River throughout the closure and post-closure period.

## 2.0 GEOLOGIC AND HYDROGEOLOGIC CONDITIONS

Geologic conditions for this site are described in detail in the *Hydrogeological Assessment Report* (HAR) prepared by WSP USA Inc. (WSP 2024b). Key elements of the HAR are summarized below. Monitoring wells and piezometers installed at the Site are summarized on Table 1.

### 2.1 Site Geology

The Piedmont/Blue Ridge geologic province contains some of the oldest rock formations in the southeastern United States. These late Precambrian to late Paleozoic rocks have undergone repeated cycles of igneous intrusions and extrusions, metamorphism, folding, faulting, shearing, and silicification. The latest regional metamorphism and associated deformation has been attributed to the collision of the North America plate with the Eurasian plate approximately 200 to 230 Ma. More recent deformation and emplacement of mafic dikes is associated with the rifting of the North American craton during the Mesozoic and Cenozoic Eras. The Site lies in a regional zone of deformation, referred to as the Brevard Zone, which extends from Alabama to Virginia. The Brevard Fault Zone is inactive with no displacement since the Holocene. Several regionally extensive faults have been mapped near and within the Site associated with the inactive Brevard Fault Zone. Rock outcrops near the Site consist of biotite gneiss, porphyritic gneiss, mica schist, and quartzite.

Based on review of site data, residual soils, primarily clayey/sandy silt, sandy silt with clay, and silty sand, occur as a variably thick blanket overlying bedrock across most of the Site. Saprolitic or residual soils and/or saprolitic rock range in thickness across the Site but are generally encountered at or near ground surface. Saprolitic rock is also considered to be transitionally weathered rock (TWR) or partially weathered rock (PWR). PWR is defined by Standard Penetration Test (SPT) blow counts that exceed 50 blows per six inches. Material overlying the top of bedrock surface, including residual soils, saprolite, and TWR or PWR, is collectively referred to as overburden.

Bedrock beneath the overburden north of the faulted intrusive contact is primarily characterized by Ordovician-age felsic sphene-epidote-biotite-quartz-feldspar gneiss (Long Island Creek Gneiss - Oli) with well-developed foliation and an augen texture reflecting historical movement/deformation near fault and shear zones of the inactive Brevard fault zone. Bedrock beneath the overburden south of the faulted intrusive contact is primarily

characterized by interlayered Ordovician age phyllonite, button schist with well-developed shear foliation, fine-grained mylonite with poorly developed foliation, and very fine-grained mylonitic biotite gneiss with well-developed shear foliation (Phyllonite, Button Schist, Mylonite, and Mylonitic Biotite Gneiss - OZbs). The contact has had substantial movement as indicated by porphyroclastic-feldspars with sigmoidal-tails. An updated geologic map of the Site area was published in the HAR (WSP 2024b). The update shows the Site is located outside of the area of most intense shearing that is associated with the Brevard Zone. The zone with the greatest number of fractures is to the south of the Site and beyond the Chattahoochee River, which is considered to be a hydraulic divide in the vicinity of the Site as evidenced during drilling of deeper bedrock monitoring wells.

## 2.2 Site Hydrogeology

A regional, unconfined aquifer system is present at the Site, consisting of residual soils, saprolite, TWR/PWR (i.e., overburden), and upper bedrock. Based on drilling at the Site, borings completed deeper in the bedrock aquifer (i.e., greater than 30 feet into the bedrock unit) exhibit minimal and likely isolated fractures, and minimal connectivity between the overburden and deeper bedrock hydrogeologic unit. The overburden is variably comprised of porous and permeable alluvial, residual, and colluvial soils and saprolite, grading downward into a variably weathered, less permeable zone that overlies a less weathered and more permeable transitional weathering zone (Heath 1984). This unconfined, surficial aquifer system (referred to as uppermost aquifer) is recharged primarily through precipitation and subsequent infiltration, and flow is generally controlled by topography and surface water drainage and occurs mainly through intergranular pore spaces. Porosity generally ranges from about 20 to 30%. Hydraulic conductivity in the Site uppermost aquifer comprised of the overburden and upper bedrock has an estimated average of 0.69 feet/day ( $2.4 \times 10^{-4}$  centimeters per second). Groundwater is stored in pore spaces in the overburden and then percolates downward to the weathered zone between soil and bedrock and into interconnected bedrock discontinuities. The saturated soils in the overburden function as the principal storage reservoir for groundwater in the bedrock.

Groundwater in the bedrock occurs in a fracture network that is largely dependent on rock type, degree of differential weathering, topography, and area of catchment. Groundwater flow in the underlying bedrock occurs primarily along discontinuities such as compositional layering, zones with variable mineralogy that are more susceptible to weathering, foliation, joints, and fractures. Fracture porosity is minimum compared to the overburden, and thus, groundwater flow is determined by how well the fractures are interconnected. Further, fractures within the deeper bedrock at the Site are not well connected and the predominant groundwater flow at the Site occurs in the overburden and upper bedrock. Based on site-specific examples and supporting data, as presented in the HAR (WSP 2024b), fractures within the bedrock are limited and decrease in number and groundwater production with depth. Borings B-103D, B-122D and B-123D were installed to vertically delineate constituents in areas where bedrock was approximately 70 feet below ground surface (bgs) and therefore, were installed to capture groundwater flow from bedrock fractures. Groundwater monitoring wells were screened across available fractures and did not produce sufficient water for proper development or sampling. Site geophysical logs and groundwater monitoring data at B-123D confirm that the deeper fractures produce less than 0.025 milliliters per minute using a heat pulse flow meter. This flow rate does not constitute “groundwater in an aquifer” but rather “limited” groundwater movement within the deeper bedrock unit.

Several references to published work within the HAR were reviewed and confirm that these observations made at the Site are consistent with Piedmont geology.

At the Site, the overburden upper bedrock aquifer constitutes an unconfined system. Available groundwater level data indicate a high of 837 feet referenced to North American Vertical Datum (NAVD) near the northern area and about 742 feet NAVD near the Chattahoochee River. Groundwater flows toward the on-site streams and the Chattahoochee River. Figure 2A presents the potentiometric surface contours depicting groundwater flow across the Site based on water levels from January 29, 2024.

## 2.3 Uppermost Groundwater Aquifer

The uppermost aquifer occurs within the overburden and upper bedrock, the upper 30 feet of fractured bedrock, at the Site. Although the degree of connection between the overburden and upper bedrock and underlying deeper bedrock (i.e., greater than 30 feet) aquifer systems is not well known, the deeper bedrock is generally massive with few joints available to receive groundwater from the overlying overburden and upper bedrock. Consequently, groundwater flow within the uppermost aquifer occurs within the residual soil, saprolite, and TWR/PWR (overburden) and upper bedrock.

Groundwater in the uppermost aquifer appears to be supporting base flow of creeks on site (many groundwater contours cross topographic contours of similar elevation at headwaters of creek). Generally, across the Site vertical gradients are assumed to be downward in topographically higher areas and upwards near topographic lows. Recharge to the uppermost aquifer is primarily through precipitation. Groundwater discharge appears to occur within tributary creeks on site, the ponds, and ultimately into the Chattahoochee River. The potentiometric surface for the uppermost aquifer indicates groundwater flow across AP-2 and AP-3/4 is generally southeast to south.

## 2.4 Groundwater Gradient and Flow Velocity

Hydraulic gradient is calculated as the difference in groundwater elevation (in feet) divided by the distance between two piezometers or wells (in feet). Groundwater elevation data recorded in January 2024 from two piezometer and/or well pairings; DGWA-53/DGWC-13, and B-26/DGWC-48, located along the groundwater flow path and perpendicular to the potentiometric contours were used to calculate hydraulic gradients for AP-2 and AP-3/4.

Average groundwater flow velocities at the Site were calculated using hydraulic gradient data, hydraulic conductivity data generated from slug testing results, and an estimated effective porosity of the screened portion of the uppermost aquifer. The Site hydraulic conductivity was re-evaluated in October 2024 in the monitoring network wells to incorporate additional hydraulic conductivity data recorded from additional monitoring wells. The field hydraulic conductivity data was re-analyzed as part of the update of the groundwater flow model. As a result of the additional data made available for the Site, the updated hydraulic conductivity values are somewhat lower than previously used to calculate site groundwater flow velocities. Based on slug test data, the geometric mean of the hydraulic conductivity for the overburden is  $3.3 \times 10^{-4}$  centimeters/second (cm/sec) (0.94 feet/day) and  $1.5 \times 10^{-4}$  cm/sec (0.44 feet/day) in the upper bedrock. Using the overburden and upper bedrock hydraulic conductivity values, an estimated average hydraulic conductivity for the Site uppermost aquifer (overburden and upper bedrock) was calculated as  $2.4 \times 10^{-4}$  (cm/sec) (0.69 feet/day). This value is within the range of values expected for silty sand and weathered/fractured metamorphic rocks (Freeze and Cherry, 1979). An effective porosity of 0.20 was used based on the default values for effective porosity recommended by US EPA for a silty sand-type soil (US EPA 1996). The hydraulic gradient calculated between well pairs DGWA-53/DGWC-13 and B-26/DGWC-48 for January 2024 were 0.028 and 0.026 feet per feet, respectively (see Table 2).

The horizontal flow velocities were calculated using the commonly used derivative of Darcy's Law:

$$V = \frac{K * i}{n_e} \quad \text{Where:}$$

$$V = \text{Groundwater flow velocity} \left( \frac{\text{feet}}{\text{day}} \right)$$

$$K = \text{Average hydraulic conductivity of the aquifer} \left( \frac{\text{feet}}{\text{day}} \right)$$

$$i = \text{Horizontal hydraulic gradient} \left( \frac{\text{feet}}{\text{feet}} \right)$$

$$n_e = \text{Effective porosity}$$

Using this equation, groundwater flow velocities were calculated for AP-2 and AP-3/4 using January 2024 groundwater elevation data as shown on Table 2.

Calculated (horizontal) flow velocities range from approximately 33 feet per year (ft/yr) to 35 ft/yr during the January 2024 event. These estimated flow velocities, though lower than past results, are generally consistent with other published velocities for regolith-upper bedrock aquifers of the Piedmont (Heath 1984). In the vicinity of each of the dewatering wells, small, localized flow changes are observed.

### 3.0 SELECTION OF WELL LOCATIONS

Groundwater monitoring wells are installed to monitor the uppermost aquifer beneath the Site. Georgia Power follows the recommendations as stated in Chapter 2 of the Manual for Groundwater Monitoring (GA EPD 1991) to establish well spacings based on site-specific conditions. Locations are selected based on final ash pond closure footprint and site geologic and hydrogeologic considerations. Locations are chosen to serve as upgradient, lateral, or downgradient based on groundwater flow direction determined by potentiometric evaluation. As flow conditions change after pumping ceases, well designations will continue to be evaluated during each semi-annual event.

Monitoring wells will generally be located outside of areas with frequent auto traffic; however, wells may be installed in heavily trafficked areas when necessary to meet the groundwater monitoring objectives of the EPD rules.

The Site has a comprehensive well network, including detection and assessment monitoring wells located around AP-2 and AP-3/4 targeted to monitor groundwater flowing in the uppermost aquifer across AP-2 and AP-3/4. Groundwater flow in the underlying bedrock occurs primarily along discontinuities. Subsurface discontinuities can sometimes be expressed on the land surface as linear topographic features referred to as lineaments. Several detection and assessment wells were located as either straddling or adjacent to these lineament features to capture the potential flow from the overburden toward the potential bedrock discontinuities and monitor for impacts from AP-2 and AP-3/4. Table 1 presents a tabulated list of individual monitoring wells, assessment wells and piezometers; with well construction details such as location coordinates, top-of-casing elevation, well depths and screened intervals. A map depicting monitoring well locations for monitoring is included as Figure 1. Any modification that involves the addition of or a change to the detection monitoring network will be made by a minor modification to the permit pursuant to 391-3-4-.02(3)(b)(6).

Additional detection monitoring wells (DGWC-126, DGWC-127, DGWC-128) are planned for installation at three locations around AP-2, AP-3/4 to provide additional coverage in areas at the downgradient edge of the CCR unit (Figure 1). Existing piezometers B-16 and B-18 will be converted to detection monitoring wells (DGWC-16 and DGWC-18) along the southern side of AP-3/4 (Figure 1). The current groundwater elevations at the B-16 and

B-18 locations are at the top to slightly below the top of the wells screens and are anticipated to decrease with ongoing dewatering activities, such that these converted wells may not produce sufficient water for analysis. Existing monitoring well DGWC-9 has been dry for two consecutive sampling events and is planned for replacement with a deeper well at a nearby location.

## **4.0 MONITORING WELL DRILLING, CONSTRUCTION, ABANDONMENT & REPORTING**

The existing AP-2 and AP-3/4 monitoring wells were installed following the Region 4 U.S. Environmental Protection Agency (US EPA) Science and Ecosystem Support Division (SESD) *Operating Procedure for Design and Installation of Monitoring Wells* (SESDGUID-101-R2 and updates) as a general guide for best practices. Well boring and construction logs for the existing monitoring well network are included in Appendix A. The following sections describe the applicable methods for well drilling, construction, abandonment, and reporting for modifications to the well network at the Site. Any additional well installation at the Site will be directed by a qualified groundwater scientist.

### **4.1 Drilling**

A variety of well drilling methods are available for installing groundwater wells. Drilling methodology may include, but not be limited to hollow stem augers, direct push, air rotary, mud rotary, or rotosonic techniques. The drilling method shall minimize the disturbance of subsurface materials and shall not cause impact to the groundwater. Borings will be advanced using an appropriate drilling technology capable of drilling and installing a well in site-specific geology. Monitoring wells will be installed using the most current version of the Region 4 U.S. Environmental Protection Agency (US EPA) Science and Ecosystem Support Division (SESD) Operating Procedure SESDGUID-101-R2 and updates as a general guide for best practices. Drilling equipment shall be decontaminated before use and between borehole locations using the procedures described in the latest version of the Region 4 U.S. EPA Laboratory Services and Applied Science Division (LSASD) *Operating Procedure for Field Equipment Cleaning and Decontamination* as a guide.

Sampling and/or coring may be used to help determine the stratigraphy and geology. Samples will be logged under the oversight of a qualified groundwater scientist. Screen depths will be chosen based on the depth of the uppermost aquifer.

Drilling and well installation activities will be completed under the direction of a qualified groundwater scientist. All drilling for any subsurface hydrologic investigation, installation or abandonment of groundwater monitoring wells will be performed by a driller that has at the time of installation, a performance bond on file with the Water Well Standards Advisory Council. Copies of the bonds for the existing wells are included in Appendix A.

### **4.2 Design and Construction**

Well construction materials will be sufficiently durable to resist chemical and physical degradation and will not interfere with the quality of groundwater samples.

#### **4.2.1 Well Casings and Screens**

American Society for Testing and Materials (ASTM), National Sanitation Foundation (NSF) rated, Schedule 40, 2-inch polyvinyl chloride (PVC) pipe with flush threaded connections will be used for the well riser and screens. Compounds that can cause PVC to deteriorate (e.g., organic compounds) are not expected at this facility. If



conditions warrant, other appropriate materials may be used for construction with prior written approval from the EPD.

#### **4.2.2 Well Intake Design**

The design and construction of the intake of the groundwater wells shall: (1) allow sufficient groundwater flow to the well for sampling; (2) minimize the passage of formation materials (turbidity) into the well; and (3) ensure sufficient structural integrity to prevent the collapse of the intake structure.

Each groundwater monitoring well will include a well screen designed to limit the amount of formation material passing into the well when it is purged and sampled. Screens with 0.010-inch slots have proven effective for the earth materials at the Site and will be used unless geologic conditions discovered at the time of installation dictate a different size. Screen length shall not exceed 10 feet without justification as to why a longer screen is necessary (e.g., significant variation in groundwater level). If the above techniques prove ineffective for developing a well with sufficient yield or acceptable turbidity, further steps will be taken to assure that the well screen is appropriately sized for the formation material. This may include performing sieve analysis of the formation material and determining well screen slot size based on the grain size distribution, if warranted.

Pre-packed dual-wall well screens may be used for well construction. Pre-packed well screens combine a centralized inner well screen, a developed filter sand pack, and an outer conductor screen in one integrated unit composed of inert materials. Pre-packed well screens will be installed following general industry standards and using the latest version of the Region 4 U.S. EPA SEDS *Operating Procedure for Design and Installation of Monitoring Wells* (SESDGUID-101-R2 and updates) as a general guide.

#### **4.2.3 Filter Pack and Annular Seal**

The materials used to construct the filter pack will be clean quartz sand of a size that is appropriate for the screened formation. Fabric filters will not be used as filter pack material. Sufficient filter material will be placed in the borehole and measurements taken to ensure that no bridging occurs. Upon placement of the filter pack, the well may be pumped to assure settlement of the pack. If pumping is performed, the top of filter pack depth will be measured, and additional sand added if necessary. The filter pack will extend at least two feet above the top of the well screen.

The materials used to seal the annular space in the boring above the well pack must prevent hydraulic communication between strata and prevent migration from overlying areas into the well screen interval. A minimum of two feet of bentonite (chips, pellets, or slurry) will be placed immediately above the filter pack. The bentonite seal will extend up to the base of any overlying confining zone or the top of the water-bearing zone to prevent cementitious grout from entering the water-bearing or screened zone. If dry bentonite is used, the bentonite must be hydrated with potable water prior to grouting the remaining annulus.

The annulus above the bentonite seal will be grouted with a cement and bentonite mixture (approximately 94 pounds cement / 3 to 5 pounds bentonite / 6.5 gallons of potable water) placed via tremie pipe from the top of the bentonite seal. During grouting, care will be taken to assure that the bentonite seal is not disturbed by locating the base of the tremie pipe approximately two feet above the bentonite seal and injecting grout at low pressure/velocity.

#### 4.2.4 Protective Casing and Well Completion

After allowing the grout to settle, the well will be finished by installing a flush-mount or above ground protective casing, as appropriate; and building a surface completion. The use of flush-mount wells will generally be limited to paved surfaces unless site operations warrant otherwise. The surface completion will extend from the top of the cement grout to ground surface, where it will become a concrete apron extending outward with a radius of at least 3 feet from the edge of the well casing and sloped to drain water away from the well. The apron for a flush-mount well will be tied into the surrounding pavement.

Each well will be fitted with a cap that contains a hole or opening to allow the well headspace to equalize with atmospheric pressure. For wells with above ground protection, the space between the well riser and the protective casing may be filled with coarse sand or pea-gravel to within approximately 6 inches of the top of the well riser. A small weep hole will be drilled at the base of the metal protective casing for the drainage of moisture from the casing. Above ground protective covers will be locked.

Protective bollards may be installed around each above-grade groundwater monitoring well. Well construction in high traffic areas will generally be limited unless site conditions warrant otherwise.

The groundwater monitoring well detail attached in Appendix B, Groundwater Monitoring Well Detail, illustrates the general design and construction details for a monitoring well.

#### 4.2.5 Well Development

Well development will be conducted under direction of a qualified groundwater scientist. After well construction is completed, wells will be developed by alternately purging and surging until relatively clear discharge water with little turbidity is observed. The goal will be to achieve a turbidity of less than 5 nephelometric turbidity units (NTUs); however, formation-specific conditions may not allow this target to be accomplished, and development may be discontinued at a measured turbidity of less than 10 NTUs. Additionally, the stabilization criteria contained in Appendix C, Groundwater Sampling Procedures, should be met. A variety of techniques may be used to develop site groundwater monitoring wells. The method used must create reversals or surges in flow to eliminate bridging of particles around the well screen. These reversals or surges can be created by using surge blocks, bailers, or pumps. The wells will be developed using a pump capable of inducing the stress necessary to achieve the development goals. Development equipment will be decontaminated prior to first use and between wells.

In low yielding wells, potable water may be added to the well to facilitate surging of the well screen interval and removal of fine-grained sediment. If water is added, the volume will be documented and at minimum, an equal volume purged from the well.

Many geologic formations contain clay and silt particles that are small enough to work their way through well filter packs over time. Therefore, the turbidity of the groundwater from the monitoring wells may gradually increase over time after initial well development. As a result, the monitoring wells may have to be redeveloped periodically to remove the silt and clay that has worked its way into the filter pack. Each monitoring well should be redeveloped when sample turbidity values have significantly increased since initial development or since prior redevelopment. The redevelopment should be performed as described above. Well development data will be included in the well installation report.



### 4.2.6 Surveying

The monitoring wells and piezometers were surveyed by Metro Engineering & Surveying Co., Inc., with a horizontal accuracy of 0.5 foot and a vertical accuracy of 0.01 foot referenced to Georgia State Plane Coordinate System (Georgia State Plane, West Zone, NAD83) and vertical datum to the North American Vertical Datum 1988 (NAVD88). The certified surveyor's report is included in Appendix A.

## 4.3 Well Abandonment

Monitoring wells will be abandoned using industry-accepted practices and using the Manual for Groundwater Monitoring (1991) and Georgia Water Well Standards Act of 1985 [Official Code of Georgia Annotated (O.C.G.A.) 12-5-120, 1985] as guides. Neat Portland cement or bentonite will be used as appropriate to complete abandonment and seal the well borehole.

Per Georgia Rule 391-3-4-.10(6)(g), monitoring wells require abandonment and replacement after two consecutive dry sampling events, unless an alternate schedule is approved by EPD. Well abandonment will be directed by a qualified groundwater scientist. A minor modification shall be submitted in accordance with Rule 391-3-4-.02(3)(b)6 prior to the installation or decommissioning of monitoring wells.

## 4.4 Documentation

The following information documenting the construction and development of each well is provided on the boring logs for the existing monitoring system (Appendix A). Within 60 days of the construction and development or abandonment of each groundwater monitoring well, a well installation/abandonment report will be submitted to the EPD by a qualified groundwater scientist. For installed wells, the following information will be provided:

- Well Identification
- Name of drilling contractor and type of drill rig
- Documentation that the driller, at the time the monitoring wells were installed, had a bond on file with the Water Well Standards Advisory Council
- Narrative of drilling technique applied, well construction details, and well development procedures, including dates, drilling fluids used (if applicable), well casing and screen materials, screen slot size, and joint type
- Filter pack material/size and volume (placement narrative)
- Seal emplacement method and type/volume of sealant
- Borehole diameter and well casing diameter
- Type of protective well cap and sump dimensions for each well
- Surface seal and volumes/mix of annular seal material
- Screen length and slot size
- Screen materials and design (i.e., interval in feet below ground surface and elevation)
- Well location data given to within an accuracy of 0.5 feet based on survey data recorded from a known datum

- Well elevation data at concrete pad nail given to within an accuracy of 0.01 feet based on survey data recorded from a known datum
- Documentation of ground surface elevation at well location ( $\pm 0.01$  ft.). Based on survey data recorded from a known datum
- Documentation of top of casing elevation ( $\pm 0.01$  ft.). Based on survey data recorded from a known datum
- Well depth ( $\pm 0.1$  ft.)
- Dates of drilling and initial well emplacement
- Drilling method and drilling fluid, if used
- Schematic of well with dimensions
- Lithologic logs
- Well casing materials
- Well development date
- Well turbidity following development
- Documentation that water quality field parameters meet well development criteria
- Narrative of well development method - specific well development procedure
- Documentation stating that a Georgia-registered professional surveyor has certified that the horizontal accuracy for the installed monitoring wells is 0.5 foot, and vertical accuracy for elevations to 0.01 foot using a known datum.

In accordance with the Georgia Water Well Standards Act (O.C.G.A. § 12-5-120), at least once every five years, the owner of the property on which a monitoring well is constructed shall have the monitoring well(s) inspected by a professional engineer or professional geologist, who shall direct appropriate remedial corrective work to be performed if the well does not conform to standards. Well inspection records and records of remedial corrective work are subject to review by EPD. Additionally, as part of the post closure care plan, the cost estimate based upon current year cost for the well inspections will be provided for as part of the cost calculations for the groundwater monitoring period. Additionally, as part of the closure and post-closure plan, the cost estimate based upon current year cost for the well inspections must be provided for as part of the cost calculations for the groundwater monitoring period.

## 5.0 GROUNDWATER MONITORING PARAMETERS AND FREQUENCY

The following describes groundwater sampling requirements with respect to parameters for analysis, sampling frequency, sample preservation and shipment, and analytical methods. Groundwater samples used to provide compliance monitoring data will not be filtered prior to collection.

Table 3 presents the groundwater monitoring parameters and sampling frequency. A minimum of eight independent samples from each groundwater well will be collected and analyzed for 40 CFR 257, Subpart D, Appendix III and Appendix IV test parameters to establish a background statistical dataset. Subsequently, in

accordance with 391-3-4-.10(6), the monitoring frequency for the Appendix III parameters will be at least semi-annual during the active life of the facility and the post-closure care period. If required, Georgia Power will conduct assessment monitoring in accordance with the Georgia Rules for Solid Waste Management Chapter 391-3-4-.10(6) to also include 40 CFR 257, Subpart D, Appendix IV test parameters. Assessment monitoring was initiated on November 15, 2019, per GA Chapter 391-3-4-.10(6) Rules for Solid Waste Management.

When referenced throughout this plan, Appendix III and Appendix IV parameters refer to the parameters contained in Appendix III and Appendix IV of 40 CFR 257, Subpart D, 80 Fed. Reg. 21468 (April 17, 2015).

As shown in Table 4, the groundwater samples will be analyzed using methods specified in US EPA Manual SW-846, EPA 600/4-79-020, Standard Methods for the Examination of Water and Wastewater (SM18-20), US EPA Methods for the Chemical Analysis of Water and Wastes (MCAWW), ASTM, or other suitable analytical methods approved by EPD. The method used will be able to reach a suitable practical quantification limit to detect natural background conditions at the facility. The groundwater samples will be analyzed by licensed and accredited laboratories through the National Environmental Laboratory Program (NELAP). Field instruments used to measure pH must be accurate and reproducible to within 0.1 Standard Units (S.U.).

## 6.0 SAMPLE COLLECTION

During each sampling event, samples will be collected and handled in accordance with the procedures specified in Appendix C, Groundwater Sampling Procedures and Appendix D, Surface Water Sampling Procedures. Sampling procedures were developed using standard industry practice and US EPA Region 4 Field Branches Quality System and Technical Procedures as a guide. Low-flow sampling methodology will be utilized for groundwater sample collection. Alternative industry accepted sampling techniques may be used when appropriate with prior EPD approval. The applied groundwater purging, and sampling methodologies will be discussed in the semi-annual monitoring reports submitted to EPD.

For groundwater sampling, positive gas displacement Teflon or stainless-steel bladder pumps will be used for purging. If dedicated bladder pumps are not used, portable bladder pumps or peristaltic pumps (with dedicated or disposable tubing) may be used. When non-dedicated equipment is used, it will be decontaminated prior to use and between wells. Non-dedicated equipment will be decontaminated in accordance with the US EPA LSASDPROC-205-R4 (US EPA 2020).

Per Georgia Rule 391-3-4-.10(6)(g), monitoring wells require replacement after two consecutive dry sampling events. Well installation must be directed by a qualified groundwater scientist. A minor modification shall be submitted in accordance with Rule 391-3-4-.02(3)(b) prior to the installation or decommissioning of monitoring wells.

## 7.0 SURFACE WATER MONITORING PLAN

Following final closure certification of AP-2 and AP-3/4, surface water is directed through a series of settling ponds located northwest (Pond 1), east (Pond 2) and south (Pond 3) of AP-3/4. Sample locations SWC-1, SWC-2 and SWC-3 will be added to the monitoring program following final construction certification. During each semi-annual sampling event, if flowing water is present, surface water samples will be collected from each location (see Figure 3). This surface water monitoring is for the Solid Waste Management Program and is not associated with any existing industrial stormwater, and/or construction stormwater discharge permitting regulated by the National Pollutant Discharge Elimination System (NPDES) requirements of Section 402 of the Clean Water Act. In the

event that no flowing water is present at the sampling locations at the time of sampling, it will be noted in the field sampling documents associated with that event and no sample will be collected for that event.

During each sampling event, samples will be collected and handled in accordance with the procedures specified in Appendix D. Surface water samples will be collected and handled in accordance with standard industry practice and US EPA Region 4 LSASD *Surface Water Sampling Procedures* LSASDPROC-201-R6 as a guide (US EPA 2023a). When possible, the sample should be collected directly into the appropriate sample container provided by the analytical laboratory. If the sample location cannot be physically reached, an intermediate collection device may be used (e.g., a “swing sampler” with a 12-foot handle and a single use container) as presented in the current US EPA field guidance document. When non-dedicated equipment is used, it will be decontaminated prior to first use and between surface water sampling locations.

Surface water samples will be analyzed for field parameters, pH, temperature, specific conductance, dissolved oxygen, oxidation reduction potential (ORP), and turbidity and Appendix IV constituents as listed in Table 5 and using the methods listed in Table 4.

Monitoring results from surface water sampling will be incorporated into semi-annual groundwater monitoring reports. Constituent concentrations from the current monitoring event, as well as each of the historical monitoring events will be provided on a data summary table to assess potential impacts of the facility to adjacent surface waters.

## 8.0 CHAIN-OF-CUSTODY

Samples will be handled under chain-of-custody (COC) procedures beginning in the field. The COC record will contain the following information:

- Sample identification numbers
- Signature of collector
- Date and time of collection
- Sample type
- Sample point identification
- Number of sample containers
- Signature of person(s) involved in the chain of possession
- Dates and times of possession by each individual
- Notated date(s) and time(s) of sample transfer between individuals

The samples will remain in the custody of assigned personnel, an assigned agent, or the laboratory. If the samples are transferred to other employees for delivery or transport, the sampler or possessor must relinquish possession, and the samples must be received by the new owner.

If the samples are being shipped, a hard copy COC will be signed and enclosed within the shipping container.

Samplers must use COC forms provided by the analytical laboratory or use a COC form similarly formatted and containing the information listed above.

## 9.0 FIELD AND LABORATORY QUALITY ASSURANCE/QUALITY CONTROL

Field quality control samples will be prepared the same as compliance samples with regard to sample volume, containers, and preservation. The following quality control samples will be collected during each sampling event:

**Field Equipment Rinsate Blanks** - Where sampling equipment is not new (pre-cleaned) or dedicated, an equipment rinsate blank will be collected at a rate of one blank per 20 samples collected using such non-dedicated equipment. Rinsate blanks will be collected following decontamination of, and prior to collection of a field sample with the non-dedicated equipment.

**Field Duplicates** - Field duplicates are collected by filling additional containers at the same location, and the field duplicate is assigned a unique sample identification number. One blind field duplicate will be collected for every 20 samples.

**Field Blanks** - Field blanks are collected in the field using the same water source that is used for decontamination. The water is poured directly into the supplied sample containers in the field and submitted to the laboratory for analysis of target constituents. One field blank will be collected for every 20 samples.

Calibration of field instruments will occur daily and follow the recommended (specific) instrument calibration procedures provided by the manufacturer and/or equipment manual specific to each instrument. Daily calibration will be documented on field forms and these field forms will be included in groundwater monitoring reports. Instruments will be recalibrated as necessary (e.g., when calibration checks indicate significant variability), and any recalibration steps will be documented on field calibration forms. Calibration of the instruments will also be checked if any readings during sampling activities are suspect. Replacement probes and meters will be obtained as a corrective action in the event that recalibration does not improve instrument function. Calibration field forms will be provided as part of each groundwater report's quality control documentation.

The groundwater samples will be analyzed by licensed and accredited laboratories through NELAP.

## 10.0 REPORTING RESULTS

A semi-annual groundwater report that documents the results of sampling and analysis will be submitted to EPD within 90 days of receipt and analysis of the groundwater analytical data from the laboratory. At a minimum, semi-annual reports will include:

- 1) A narrative describing sampling activities and findings including a summary of the number of samples collected, the dates the samples were collected and whether the samples were required by the detection or assessment monitoring programs.
- 2) A record of field sampling conditions including, well signage, well access, sampling and purging equipment condition, and site conditions that may affect sampling will be recorded on a Well Inspection Form. These forms will be included as an appendix to the semi-annual groundwater monitoring reports.
- 3) A brief overview of purging/sampling methodologies
- 4) Discussion of results
- 5) Recommendations for the future monitoring consistent with the Rules

- 6) Potentiometric surface contour map for the aquifer(s) being monitored, signed, and sealed by a Georgia-registered PG or PE
- 7) Table of as-built information for groundwater monitoring wells including top of casing elevations, ground elevations, screened elevations, current groundwater elevations and depth to water measurements
- 8) Groundwater flow rate and direction calculations
- 9) Identification of any groundwater wells that were installed or decommissioned during the preceding year, along with a narrative description of why these actions were taken
- 10) A narrative discussion of any transition between monitoring programs (e.g., the date and circumstances for transitioning from detection monitoring to assessment monitoring in addition to identifying the constituent(s) detected at a statistically significant increase over background levels)
- 11) Table of current analytical results for each well, highlighting statistically significant increases and concentrations above maximum contaminant level (MCL)
- 12) Tabular summary of surface water monitoring results including the current monitoring event as well as each of the historical monitoring events. This will be added after the final closure certification is submitted.
- 13) If applicable, semi-annual assessment monitoring results
- 14) Any alternate source demonstration completed during the previous monitoring period, if applicable
- 15) Laboratory reports
- 16) COC documentation
- 17) Field sampling logs including field instrument calibration, indicator parameters and parameter stabilization data
- 18) Documentation of non-functioning wells or dry surface water sampling locations
- 19) Statistical analyses, including trend analyses (if applicable)
- 20) Plume delineation (if applicable)
- 21) Updated potable water well survey (annually, if applicable)
- 22) Certification by a qualified groundwater scientist.

## 11.0 STATISTICAL ANALYSES

Groundwater quality data from each sampling event will be statistically evaluated to determine if there has been a statistically significant change in groundwater chemistry. Historical background data will be used to determine statistical limits. These statistical analyses methods are consistent with the *Statistical Analysis of Groundwater Data at RCRA Facilities Unified Guidance* (Unified Guidance) (US EPA 2009).

According to EPD rules (391-3-4-.10(6)(a), which incorporate the statistical analysis requirements of 40 CFR 257.93 by reference), the Site must specify in the operating record the statistical methods to be used in evaluating

groundwater monitoring data for each constituent. The statistical test chosen shall be conducted separately for each constituent in each well. As authorized by the rule, statistical tests that may be used include:

- 1) A prediction interval procedure in which an interval for each constituent is established from the distribution of the background data, and the level of each constituent in each compliance well is compared to the upper prediction limit (§257.93(f)(3)).
- 2) A control chart approach that gives control limits for each constituent (§257.93(f)(4)).
- 3) Another statistical test method (such as prediction limits or control charts) that meets the performance standards of §257.93(g). A justification for an alternative method will be placed in the operating record and the Director notified of the use of an alternative test. The justification will demonstrate that the alternative method meets the performance standards of §257.93(g) (§257.93(f)(5)).

Interwell statistical methods will be used to compare Appendix III groundwater monitoring data to background conditions. Confidence intervals will be constructed for each downgradient well and used to compare Appendix IV groundwater monitoring data to groundwater protection standards.

A site-specific statistical analysis plan that provides details regarding the statistical methods to be used has been placed in the Site's operating record pursuant to 391-3-4-.10(6) (EPD 2014). Figure 4 includes a flowchart that depicts the process that will be followed to develop the site-specific plan. Figure 5 presents the logic that will be used to calculate site-specific statistical limits and test compliance results against those limits.

## 12.0 REFERENCES

Freeze, R.A. and Cherry, J.A., 1979. *Groundwater*, Prentice-Hall, Inc. Englewood Cliffs, New Jersey. 624pp.

GA EPD, 1991. Georgia Environmental Protection Division, Georgia Department of Natural Resources, Manual for Groundwater Monitoring, July 1991.

GA EPD, 1985. Georgia Water Well Standards Act. Official Code of Georgia Annotated (O.C.G.A.) 12-5-120, 1985.

GA EPD, 2014. Georgia (GA) Department of Natural Resources Environmental Protection Division, Rules of Solid Waste Management, Chapter 391-3-4-.10(6), Georgia Environmental Protection Division, March 14, 2014.

Golder, 2020. Plant McDonough-Atkinson CCR Surface Impoundments CCR Unit Ash Pond 2 and 3/4 (AP-2 and 3/4), Amended Closure Plan – Revision 01, Golder Associates Inc., November 2020.

Heath, R.C., 1984. *Ground-Water Regions of the United States*, United States Geological Survey, Geological Survey Water-Supply Paper 2242, 1984.

US EPA, 1996. U.S. Environmental Protection Agency, *Soil Guidance Manual*.

US EPA, 2009. U.S. Environmental Protection Agency, *Statistical Analysis of Groundwater Monitoring Data at RCRA Facilities, Unified Guidance*, (EPA 530-R-09-007), March 2009.

US EPA, 2015. U.S. Environmental Protection Agency, 40 CFR 257, Subpart D, 80 Fed. Reg. 21468, April 17, 2015.



US EPA, 2018. Region 4 U.S. Environmental Protection Agency Science and Ecosystem Support Division, *Operating Procedure for Design and Installation of Monitoring Wells*, (SESDGUID-101-R2) January 16, 2018.

US EPA, 2018. Region 4 U.S. Environmental Protection Agency, Field Branches Quality System and Technical Procedures, November 11, 2018.

US EPA, 2020. Region 4 U.S. Environmental Protection Agency, Laboratory Services and Applied Science Division, *Field Equipment Cleaning and Decontamination*, (LSASDPROC-205-R4), June 22, 2020.

US EPA, 2023a. Region 4 U.S. Environmental Protection Agency, Laboratory Services and Applied Science Division, *Surface Water Sampling*, (LSASDPROC-201-R6), April 22, 2023.

US EPA, 2023b. Region 4 U.S. Environmental Protection Agency, Laboratory Services and Applied Science Division, *Groundwater Sampling*, (LSASDPROC-301-R6), April 22, 2023.

US EPA. U.S. Environmental Protection Agency, Hazardous Waste Test Methods SW-846, [www.epa.gov/hw-sw846](http://www.epa.gov/hw-sw846).

Standard Methods for the Examination of Water and Wastewater, [www.standardmethods.org](http://www.standardmethods.org).

US EPA. U.S. Environmental Protection Agency, Methods for the Chemical Analysis of Water and Wastes (MCAWW).

WSP, 2023. Plant McDonough-Atkinson CCR Surface Impoundments CCR Unit AP-2 and 3/4, Closure Plan, WSP USA Inc., May 2023.

WSP, 2024a. Plant McDonough-Atkinson CCR Surface Impoundment (CCR Unit AP-2 and 3/4) Cobb County, Georgia, Part A Section 8 - Post-Closure Care Plan, WSP USA Inc., December 2024.

WSP, 2024b. Plant McDonough-Atkinson CCR Surface Impoundment (CCR Unit AP-2 and 3/4) Smyrna, Georgia, Part B Section 1 - *Hydrogeological Assessment Report*, WSP USA Inc., December 2024.



## Tables

**TABLE 1**  
**SUMMARY OF MONITORING WELL, ASSESSMENT WELL AND PIEZOMETER CONSTRUCTION DATA**  
Georgia Power Company - Plant McDonough-Atkinson  
CCR Unit AP-2 and AP-3/4  
Cobb County, Georgia

Well-ID	Hydraulic Location	Screened Lithology	NAD 83 Northing <sup>[1]</sup>	NAD 83 Easting <sup>[1]</sup>	Top of Casing Elevation (feet NAVD 88)	Ground Surface Elevation (feet NAVD 88)	Total Well Depth (feet bgs)	Top of Screen Elevation (feet NAVD 88)	Bottom of Screen Elevation (feet NAVD 88)	Screen Length (feet)	Date of Installation	Hydraulic Conductivity Geometric Mean (cm/sec) <sup>[13]</sup>
<b>ASH POND 1 (AP-1) DETECTION MONITORING WELL NETWORK</b>												
DGWA-53	Upgradient	Upper Bedrock	1393472.8	2201668.8	844.26	841.37	28.9	823.8	813.8	10	9/24/2016	--
DGWA-70A	Upgradient	Saprolite/PWR	1390481.4	2200591.6	808.52	805.67	59.3	756.8	746.8	10	5/10/2017	2.0E-04
DGWA-71	Upgradient	Saprolite/PWR	1393963.3	2201714.8	863.84	861.22	43.8	827.8	817.8	10	2/28/2017	3.9E-04
DGWC-37	Downgradient	Saprolite/PWR	1390482.2	2200919.8	766.21	763.64	39.7	734.3	724.3	10	11/28/2012	--
DGWC-38	Downgradient	Residual Soils	1390362.7	2201148.6	757.43	754.67	25.0	740.0	730.0	10	11/29/2012	--
DGWC-39	Downgradient	Residual Soils/Saprolite	1390303.6	2201540.1	759.89	756.93	21.2	746.1	736.1	10	11/6/2012	--
DGWC-40	Downgradient	Saprolite	1390625.7	2201825.9	779.06	776.12	34.9	751.6	741.6	10	11/5/2012	3.1E-03
DGWC-67	Downgradient	Saprolite/PWR	1390953.8	2200830.7	766.70	766.80	56.3	720.5	710.5	10	3/14/2017	2.5E-04
DGWC-68A	Downgradient	Saprolite	1391301.2	2200734.9	765.33	765.06	29.8	745.7	735.7	10	4/20/2017	--
DGWC-69	Downgradient	Saprolite/PWR	1391585.0	2200657.1	763.75	763.99	24.3	749.7	739.7	10	3/16/2017	1.4E-04
DGWC-121	Downgradient	PWR/Upper Bedrock	1390739.7	2200849.4	764.16	764.52	50.0	724.8	714.8	10	3/22/2022	4.7E-05
<b>ASH POND 1 (AP-1) ASSESSMENT MONITORING WELL NETWORK</b>												
B-62	Downgradient	Upper Bedrock	1389828.1	2201811.2	760.08	760.40	39.9	730.7	720.7	10	10/4/2016	--
B-100	Downgradient	Saprolite	1390254.8	2202242.1	777.95	775.32	44.8	740.5	730.5	10	7/8/2020	--
B-105D	Downgradient	Upper Bedrock	1390634.5	2201831.9	779.01	776.03	70.0	716.0	706.0	10	10/19/2020	1.2E-04
B-112D	Downgradient	Upper Bedrock	1391564.2	2200664.1	765.58	765.98	55.0	721.3	711.3	10	3/22/2021	1.2E-03

**TABLE 1**  
**SUMMARY OF MONITORING WELL, ASSESSMENT WELL AND PIEZOMETER CONSTRUCTION DATA**  
Georgia Power Company - Plant McDonough-Atkinson  
CCR Unit AP-2 and AP-3/4  
Cobb County, Georgia

Well-ID	Hydraulic Location	Screened Lithology	NAD 83 Northing <sup>[1]</sup>	NAD 83 Easting <sup>[1]</sup>	Top of Casing Elevation (feet NAVD 88)	Ground Surface Elevation (feet NAVD 88)	Total Well Depth (feet bgs)	Top of Screen Elevation (feet NAVD 88)	Bottom of Screen Elevation (feet NAVD 88)	Screen Length (feet)	Date of Installation	Hydraulic Conductivity Geometric Mean (cm/sec) <sup>[13]</sup>
<b>ASH POND 2 and ASH PONDS 3/4 (AP-2 and AP-3/4) DETECTION MONITORING WELL NETWORK</b>												
DGWA-53	Upgradient	Upper Bedrock	1393472.8	2201668.8	844.26	841.37	28.9	823.8	813.8	10	9/24/2016	6.1E-06
DGWA-70A	Upgradient	Saprolite/PWR	1390481.4	2200591.6	808.52	805.67	59.3	756.8	746.8	10	5/10/2017	2.0E-04
DGWA-71	Upgradient	Saprolite/PWR	1393963.3	2201714.8	863.84	861.22	43.8	827.8	817.8	10	2/28/2017	--
DGWC-2	Downgradient	PWR/Upper Bedrock	1393958.0	2202119.5	850.88	848.17	49.0	809.5	799.5	10	10/2/2012	--
DGWC-4	Downgradient	Saprolite	1394171.5	2202662.4	814.85	812.06	45.0	777.4	767.4	10	10/3/2012	--
DGWC-5	Downgradient	Saprolite/PWR/Upper Bedrock	1394306.3	2202965.1	791.75	788.64	30.0	768.9	758.9	10	10/4/2012	1.1E-03
DGWC-8	Downgradient	Saprolite/PWR	1394322.2	2203882.1	826.38	824.02	49.1	785.3	775.3	10	10/10/2012	--
DGWC-9 <sup>[9]</sup>	Downgradient	Saprolite/PWR	1394055.9	2204170.0	824.35	821.86	30.0	802.3	792.3	10	10/10/2012	5.0E-04
DGWC-9A <sup>[9]</sup>	Downgradient	PWR/Upper Bedrock	TBD	TBD	TBD	TBD	45.0	787.0	767.0	10.0	TBD	--
DGWC-10	Downgradient	Saprolite	1393818.3	2204201.1	823.55	820.82	45.4	785.8	775.8	10	10/11/2012	7.2E-04
DGWC-11	Downgradient	Saprolite/PWR	1393547.1	2204166.2	800.57	797.99	49.1	759.2	749.2	10	10/15/2012	--
DGWC-12	Downgradient	Residual Soils/Saprolite	1393149.4	2204128.3	773.86	771.10	25.1	756.4	746.4	10	10/15/2012	--
DGWC-13	Downgradient	Saprolite/PWR	1392881.1	2204084.6	794.10	791.20	43.8	757.8	747.8	10	11/29/2012	7.3E-04
DGWC-14	Downgradient	PWR/Upper Bedrock	1392574.2	2204013.3	792.40	789.69	34.3	765.8	755.8	10	12/18/2012	1.3E-03
DGWC-15	Downgradient	PWR	1392544.1	2203679.0	824.50	821.43	67.1	764.7	754.7	10	11/29/2012	--
DGWC-16 <sup>[10]</sup>	Downgradient	Saprolite	1392595.1	2203315.4	826.47	823.54	43.7	790.1	780.1	10	12/19/2012	--
DGWC-17	Downgradient	Saprolite	1392645.6	2203051.0	837.05	834.14	44.5	799.9	789.9	10	1/9/2013	--
DGWC-18 <sup>[10]</sup>	Downgradient	Residual Soils/Saprolite	1392521.0	2202875.5	826.56	823.89	32.6	801.5	791.5	10	1/10/2013	--
DGWC-19	Downgradient	Saprolite	1392342.6	2202601.0	825.46	822.87	39.8	793.5	783.5	10	3/12/2013	7.9E-04
DGWC-20	Downgradient	Saprolite	1392164.5	2202315.6	822.14	819.66	39.7	790.6	780.6	10	3/5/2013	--
DGWC-21	Downgradient	PWR/Upper Bedrock	1392067.5	2202063.5	816.28	813.47	69.0	754.9	744.9	10	10/31/2012	6.3E-04
DGWC-22	Downgradient	Upper Bedrock	1392126.3	2201791.9	816.59	813.69	60.0	764.0	754.0	10	10/25/2012	1.2E-03
DGWC-23	Downgradient	Upper Bedrock	1392239.7	2201582.0	818.37	815.63	60.1	765.8	755.8	10	10/25/2012	5.4E-05

**TABLE 1**  
**SUMMARY OF MONITORING WELL, ASSESSMENT WELL AND PIEZOMETER CONSTRUCTION DATA**  
Georgia Power Company - Plant McDonough-Atkinson  
CCR Unit AP-2 and AP-3/4  
Cobb County, Georgia

Well-ID	Hydraulic Location	Screened Lithology	NAD 83 Northing <sup>[1]</sup>	NAD 83 Easting <sup>[1]</sup>	Top of Casing Elevation (feet NAVD 88)	Ground Surface Elevation (feet NAVD 88)	Total Well Depth (feet bgs)	Top of Screen Elevation (feet NAVD 88)	Bottom of Screen Elevation (feet NAVD 88)	Screen Length (feet)	Date of Installation	Hydraulic Conductivity Geometric Mean (cm/sec) <sup>[13]</sup>
<b>ASH POND 2 and ASH PONDS 3/4 (AP-2 and AP-3/4) DETECTION MONITORING WELL NETWORK</b>												
DGWC-42	Downgradient	Saprolite	1391327.8	2201870.2	804.68	801.98	50.4	762.1	752.1	10	11/12/2012	--
DGWC-47	Downgradient	PWR/Upper Bedrock	1391553.8	2202610.5	797.45	794.35	28.8	776.0	766.0	10	6/23/2016	6.4E-05
DGWC-48	Downgradient	Saprolite/PWR/Upper Bedrock	1391314.6	2202290.2	788.33	785.21	30.0	765.6	755.6	10	6/22/2016	8.6E-05
DGWC-126 <sup>[11]</sup>	Downgradient	Saprolite	TBD	TBD	TBD	TBD	44.5	783.0	773.0	10	TBD	--
DGWC-127 <sup>[11]</sup>	Downgradient	Saprolite	TBD	TBD	TBD	TBD	52.0	773.0	763.0	10	TBD	--
DGWC-128 <sup>[11]</sup>	Downgradient	Saprolite	TBD	TBD	TBD	TBD	35.0	776.0	766.0	10	TBD	--
<b>ASH POND 2 and ASH PONDS 3/4 (AP-2 and AP-3/4) ASSESSMENT MONITORING WELL NETWORK</b>												
B-56	Downgradient	Saprolite	1393957.9	2204187.8	823.59	820.95	45.0	786.4	776.4	10	10/3/2016	2.2E-04
B-62	Downgradient	Upper Bedrock	1389828.1	2201811.2	760.08	760.40	39.9	730.7	720.7	10	10/4/2016	5.5E-04
B-63	Downgradient	Saprolite/PWR	1390999.1	2202978.1	777.10	777.37	46.0	741.9	731.9	10	10/6/2016	2.0E-04
B-66	Downgradient	Saprolite	1393858.2	2204277.5	815.90	813.33	55.3	768.3	758.3	10	11/16/2016	3.2E-05
B-77	Downgradient	Residual Soils	1390948.7	2202942.0	776.86	777.12	42.0	745.1	735.1	10	9/17/2019	--
B-82	Downgradient	Saprolite	1393750.0	2204258.1	810.07	807.55	45.0	773.1	763.1	10	9/21/2019	8.0E-05
B-83	Downgradient	Residual Soils/Saprolite	1390735.5	2202695.6	776.98	777.17	48.6	738.6	728.6	10	9/30/2019	--
B-88	Downgradient	Saprolite/PWR	1394401.1	2203738.3	820.07	816.80	72.0	754.8	744.8	10	11/15/2019	1.1E-03
B-92	Downgradient	Residual Soils/Saprolite	1394392.7	2203026.7	785.08	785.30	25.0	770.7	760.7	10	12/11/2019	9.2E-04
B-93	Downgradient	Residual Soils/Saprolite	1394348.7	2202946.7	789.07	789.19	29.2	770.3	760.3	10	12/12/2019	1.8E-04
B-97	Downgradient	Upper Bedrock	1394430.0	2203008.3	786.29	786.50	31.7	765.2	755.2	10	2/11/2020	--
B-98 <sup>[12]</sup>	Downgradient	Saprolite/Upper Bedrock	1394392.5	2202934.0	789.67	789.81	19.4	780.8	770.8	10	2/10/2020	--
B-100	Downgradient	Saprolite	1390254.8	2202242.1	777.95	775.32	44.8	740.5	730.5	10	7/8/2020	1.5E-03
B-101D	Downgradient	PWR/Upper Bedrock	1394063.6	2204168.2	824.29	821.24	75.0	756.3	746.3	10	11/12/2020	2.1E-05
B-102D	Downgradient	Upper Bedrock	1393828.4	2204200.4	823.42	820.64	85.0	746.2	736.2	10	11/10/2020	1.0E-04
B-104D	Downgradient	Upper Bedrock	1391318.3	2202298.5	787.90	785.31	60.0	735.3	725.3	10	10/20/2020	2.8E-05

**TABLE 1**  
**SUMMARY OF MONITORING WELL, ASSESSMENT WELL AND PIEZOMETER CONSTRUCTION DATA**  
Georgia Power Company - Plant McDonough-Atkinson  
CCR Unit AP-2 and AP-3/4  
Cobb County, Georgia

Well-ID	Hydraulic Location	Screened Lithology	NAD 83 Northing <sup>[1]</sup>	NAD 83 Easting <sup>[1]</sup>	Top of Casing Elevation (feet NAVD 88)	Ground Surface Elevation (feet NAVD 88)	Total Well Depth (feet bgs)	Top of Screen Elevation (feet NAVD 88)	Bottom of Screen Elevation (feet NAVD 88)	Screen Length (feet)	Date of Installation	Hydraulic Conductivity Geometric Mean (cm/sec) <sup>[13]</sup>
<b>ASH POND 2 and ASH PONDS 3/4 (AP-2 and AP-3/4) ASSESSMENT MONITORING WELL NETWORK</b>												
B-106D	Downgradient	Upper Bedrock	1394327.1	2203869.2	826.21	823.39	80.0	754.0	744.0	10	11/13/2020	1.4E-04
B-107D	Downgradient	Upper Bedrock	1392334.5	2202596.4	823.38	820.44	85.8	745.3	735.3	10	10/28/2020	3.2E-04
B-108D	Downgradient	Upper Bedrock	1392156.1	2202312.5	821.13	818.33	80.0	749.3	739.3	10	10/27/2020	1.2E-04
B-111D	Downgradient	Upper Bedrock	1394303.6	2202956.4	791.84	788.99	85.0	714.8	704.8	10	11/3/2020	1.5E-04
B-120D	Downgradient	Upper Bedrock	1394047.2	2202436.4	836.42	834.03	69.3	775.0	765.0	10	3/6/2021	8.2E-03
B-122D	Downgradient	Lower Bedrock	1390992.8	2202975.4	777.03	777.32	79.8	707.5	697.5	10	3/24/2022	4.3E-05
B-125D	Downgradient	Lower Bedrock	1394111.6	2202580.7	821.70	819.15	145.4	684.1	674.1	10	3/31/2023	6.6E-07
<b>PIEZOMETERS</b>												
B-3	Downgradient	Saprolite/Upper Bedrock	1394045.1	2202411.5	837.78	834.86	37.0	808.2	798.2	10	10/3/2012	--
B-6	Downgradient	Saprolite/PWR	1394419.5	2203266.5	789.47	786.45	35.4	761.5	751.5	10	10/9/2012	--
B-7	Downgradient	Residual Soils	1394374.6	2203596.1	809.16	806.04	25.2	791.2	781.2	10	10/9/2012	--
B-24	Downgradient	Upper Bedrock	1392479.9	2201450.0	822.11	819.19	79.1	750.9	740.9	10	10/24/2012	--
B-25	Downgradient	Upper Bedrock	1392813.3	2201502.7	836.54	833.41	54.8	789.0	779.0	10	10/24/2012	3.7E-04
B-26	Downgradient	Upper Bedrock	1393105.6	2201550.4	853.60	850.61	49.3	811.7	801.7	10	10/23/2012	7.1E-06
B-28	Downgradient	PWR/Upper Bedrock	1391967.4	2201679.2	816.08	813.28	69.4	754.3	744.3	10	10/31/2012	--
B-29	Downgradient	Saprolite/PWR	1391890.0	2201422.0	816.43	813.47	54.4	769.4	759.4	10	1/11/2013	--
B-31	Downgradient	Upper Bedrock	1392034.3	2200928.5	797.47	794.84	45.1	760.1	750.1	10	1/22/2013	Abandoned
B-41	Downgradient	Saprolite	1390920.8	2201751.9	795.20	792.40	60.0	743.0	733.0	10	11/14/2012	6.2E-04
B-50	Downgradient	Saprolite	1391657.1	2201841.0	809.67	809.20	35.2	784.4	774.4	10	6/24/2016	8.5E-04
B-51	Downgradient	Saprolite/PWR	1390501.2	2200906.5	765.92	763.29	65.0	708.3	698.3	10	6/27/2016	6.7E-04
B-52	Downgradient	PWR	1392308.3	2201314.8	822.89	820.18	50.0	781.3	771.3	10	9/28/2016	1.2E-04
B-54	Downgradient	Saprolite/PWR/Upper Bedrock	1394423.5	2203140.7	785.46	782.54	34.2	758.7	748.7	10	9/26/2016	--
B-55	Downgradient	Saprolite	1394142.6	2204147.9	825.12	822.86	52.0	781.9	771.9	10	9/22/2016	--

**TABLE 1**  
**SUMMARY OF MONITORING WELL, ASSESSMENT WELL AND PIEZOMETER CONSTRUCTION DATA**  
Georgia Power Company - Plant McDonough-Atkinson  
CCR Unit AP-2 and AP-3/4  
Cobb County, Georgia

Well-ID	Hydraulic Location	Screened Lithology	NAD 83 Northing <sup>[1]</sup>	NAD 83 Easting <sup>[1]</sup>	Top of Casing Elevation (feet NAVD 88)	Ground Surface Elevation (feet NAVD 88)	Total Well Depth (feet bgs)	Top of Screen Elevation (feet NAVD 88)	Bottom of Screen Elevation (feet NAVD 88)	Screen Length (feet)	Date of Installation	Hydraulic Conductivity Geometric Mean (cm/sec) <sup>[13]</sup>
<b>PIEZOMETERS</b>												
B-57	Downgradient	Upper Bedrock	1391396.3	2202736.9	789.04	786.03	50.5	746.0	736.0	10	9/24/2016	1.1E-04
B-58	Downgradient	Saprolite	1391125.7	2202426.5	788.17	785.20	45.0	750.7	740.7	10	9/23/2016	--
B-59	Downgradient	Saprolite/PWR/Upper Bedrock	1394349.1	2203001.1	788.00	785.41	30.3	765.2	755.2	10	9/23/2016	--
B-60	Downgradient	Saprolite/PWR	1391100.7	2202881.6	782.13	779.25	49.8	740.0	730.0	10	9/29/2016	1.2E-03
B-61	Downgradient	Saprolite/PWR	1390957.8	2202505.8	782.09	778.95	51.9	737.5	727.5	10	9/29/2016	--
B-64	Downgradient	Saprolite	1394381.9	2203031.3	785.83	785.98	30.4	766.0	756.0	10	11/2/2016	--
B-65	Downgradient	Saprolite/PWR/Upper Bedrock	1394381.2	2204050.8	821.95	822.30	45.4	787.9	777.9	10	11/15/2016	--
B-68	Downgradient	Saprolite/PWR	1391298.2	2200714.2	758.68	759.05	18.0	751.1	741.1	10	3/16/2017	--
B-72	Downgradient	Saprolite	1391241.4	2200725.9	758.46	758.45	21.9	747.0	737.0	10	4/19/2017	--
B-73	Downgradient	Saprolite	1391351.8	2200699.4	759.21	759.16	15.8	753.8	743.8	10	4/19/2017	--
B-74	Downgradient	Saprolite	1391279.9	2200666.1	759.06	759.18	16.2	748.4	743.4	5	4/25/2017	--
B-76	Downgradient	Saprolite	1390717.4	2202756.9	760.53	760.87	38.5	732.4	722.4	10	9/18/2019	--
B-78	Downgradient	Saprolite/Upper Bedrock	1394328.2	2202958.2	790.75	787.79	30.0	767.8	758.3	10	9/22/2019	8.3E-04
B-79	Downgradient	Saprolite/PWR	1394458.6	2203223.0	788.66	785.84	34.9	760.9	751.4	10	9/21/2019	2.8E-04
B-80	Downgradient	Saprolite/PWR	1394372.6	2203533.9	804.47	801.73	30.0	781.9	772.4	10	9/20/2019	1.8E-04
B-81	Downgradient	Saprolite/PWR	1394364.9	2203741.1	820.56	817.64	50.0	778.5	768.5	10	9/22/2019	5.1E-05
B-84 <sup>[6]</sup>	Downgradient	Saprolite	1390411.9	2202241.9	776.34	776.52	49.1	737.4	727.4	10	10/1/2019	6.7E-05
B-85	Downgradient	Saprolite/PWR/Upper Bedrock	1394433.4	2203134.5	782.54	782.71	34.5	758.5	748.5	10	11/18/2019	2.5E-04
B-86	Downgradient	Saprolite/Upper Bedrock	1394480.0	2203206.6	784.29	784.52	34.1	760.4	750.4	10	11/18/2019	4.4E-04
B-87	Downgradient	Saprolite/PWR	1394401.9	2203531.3	803.37	800.32	42.0	768.6	758.6	10	11/17/2019	--
B-89	Downgradient	Upper Bedrock	1394398.4	2204049.4	822.36	822.53	49.5	783.0	773.0	10	11/19/2019	7.1E-04
B-90	Downgradient	Residual Soils/Saprolite	1394501.0	2203212.6	784.00	784.16	33.4	760.8	750.8	10	12/10/2019	--
B-91	Downgradient	Residual Soils/Saprolite	1394447.1	2203123.9	782.98	783.10	35.0	758.5	748.5	10	12/11/2019	4.9E-04



**TABLE 1**  
**SUMMARY OF MONITORING WELL, ASSESSMENT WELL AND PIEZOMETER CONSTRUCTION DATA**  
Georgia Power Company - Plant McDonough-Atkinson  
CCR Unit AP-2 and AP-3/4  
Cobb County, Georgia

Well-ID	Hydraulic Location	Screened Lithology	NAD 83 Northing <sup>[1]</sup>	NAD 83 Easting <sup>[1]</sup>	Top of Casing Elevation (feet NAVD 88)	Ground Surface Elevation (feet NAVD 88)	Total Well Depth (feet bgs)	Top of Screen Elevation (feet NAVD 88)	Bottom of Screen Elevation (feet NAVD 88)	Screen Length (feet)	Date of Installation	Hydraulic Conductivity Geometric Mean (cm/sec) <sup>[13]</sup>
<b>PIEZOMETERS</b>												
B-94	Downgradient	Saprolite/PWR	1394402.0	2203513.7	801.74	799.12	45.2	764.5	754.5	10	1/23/2020	--
B-95	Downgradient	Saprolite	1394518.6	2203167.7	784.00	784.18	33.3	761.2	751.2	10	2/11/2020	--
B-96	Downgradient	Saprolite/PWR	1394478.7	2203099.3	784.92	785.19	33.1	762.1	752.1	10	2/10/2020	--
B-99	Downgradient	Fill	1394524.2	2203084.5	782.39	782.57	12.3	775.3	770.3	5	7/7/2020	--
B-103D	Downgradient	Lower Bedrock	1391543.5	2202614.4	795.96	793.77	70.0	733.8	723.8	10	10/15/2020	1.9E-06
B-109D	Downgradient	Upper Bedrock	1393957.5	2202127.0	850.73	847.78	100.0	758.4	748.4	10	10/31/2020	2.1E-05
B-110D	Downgradient	Upper Bedrock	1391294.4	2200736.0	764.61	764.55	65.0	711.6	701.6	10	11/17/2020	7.8E-06
B-113D	Downgradient	Lower Bedrock	1391264.6	2200719.2	758.22	758.87	84.7	684.5	674.5	10	3/30/2021	--
B-115D	Downgradient	Lower Bedrock	1391265.3	2202580.7	789.17	786.43	79.5	717.2	707.2	10	3/20/2021	5.4E-05
B-116D	Upgradient	Upper Bedrock	1390483.7	2200611.0	807.82	805.31	89.5	726.1	716.1	10	3/8/2021	2.9E-04
B-117D	Upgradient	Upper Bedrock	1393963.8	2201727.3	863.82	861.23	75.0	796.5	786.5	10	3/17/2021	6.4E-05
B-118	Upgradient	Upper Bedrock	1391219.3	2200449.7	807.70	804.99	75.2	740.1	730.1	10	3/9/2021	8.0E-04
B-119D	Upgradient	Lower Bedrock	1391236.4	2200446.6	807.15	804.53	105.0	709.8	699.8	10	3/16/2021	2.7E-05
B-123D	Downgradient	Lower Bedrock	1391234.4	2202608.4	781.80	778.85	160.0	668.9	618.9	50	4/4/2022	4.3E-06

**Notes:**

- Coordinate System: NAD 1983 State Plane Georgia West (U.S. feet)
- bgs - Below Ground Surface; NAD 83 - North American Datum of 1983; NAVD 88 - North American Vertical Datum of 1988; PWR - Partially Weathered Rock
- The 2020 Certified Well Survey has been incorporated into this construction summary. A copy of the Certified Well Survey Report is included in the GWMP.
- Ground surface elevations shown are the elevation of the survey nail.
- Data presented for CCR Unit AP-1 are included for reference only. This data should not be considered for permitting of CCR Units AP-2 and AP-3/4.
- Piezometer B-84 abandoned on 4/28/2022
- Piezometers B-31 and B-74 were decommissioned and abandoned on 10/14/2023.
- TBD - To be determined upon actual installation
- Proposed well DGWC-9A is a replacement well for DGWC-9. The screen elevation shown is estimated. Well DGWC-9 will be decommissioned and abandon upon completion of DGWC-9A.
- Piezometers B-16 and B-18 were converted to detection monitoring wells (DGWC-16 and DGWC-18) for AP-2, AP-3/4 in December 2024.
- DGWC-126, DGWC-127, DGWC-128 are proposed detection monitoring wells and will be installed in January 2025. The screen elevations shown are estimated.
- No soil data were collected in well B-98. Screened Lithology based on adjacent boring B-97.
- The geometric mean of hydraulic conductivity data available for each well is presented in cm/sec. For individual test data refer to Table GW-3 of the Hydrogeologic Assessment Report (WSP, 2025). "--" Test data not available.

**TABLE 2**  
**GROUNDWATER VELOCITY CALCULATIONS - JANUARY 2024**

Georgia Power Company - Plant McDonough-Atkinson  
CCR Unit AP-2 and AP-3/4  
Cobb County, Georgia

Flow Paths	Groundwater Elevation (feet)	$\Delta h$ (feet) <sup>1</sup>	$\Delta l$ (feet) <sup>2</sup>	Hydraulic Gradient ( $\Delta h/\Delta l$ ) <sup>3</sup>	Estimated Hydraulic Conductivity for Uppermost Aquifer (feet per day) <sup>5</sup>	Assumed Effective Porosity ( $n_e$ ) <sup>6</sup>	Average Linear Groundwater Velocity	
							(feet per day) <sup>4</sup>	(feet per year) <sup>4</sup>
ASH POND 1 (AP-1)								
B-29/DGWC-68A	787.07	31.63	900	0.035	0.69	0.2	0.12	44
	755.44							
B-28/DGWC-37	784.98	32.19	1700	0.019	0.69	0.2	0.07	24
	752.79							
B-50/DGWC-39	786.08	33.31	1400	0.024	0.69	0.2	0.08	30
	752.77							
ASH POND 2 AND ASH PONDS 3/4 (AP-2 and AP- 3/4)								
DGWA-53/DGWC-13	829.91	70.35	2550	0.028	0.69	0.2	0.10	35
	759.56							
B-26/DGWC-48	825.75	52.92	2000	0.026	0.69	0.2	0.09	33
	772.83							

**Notes:**

1.  $\Delta h$  = Change in groundwater elevation
2.  $\Delta l$  = Distance along flow path
3.  $I = \Delta h / \Delta l$
4. Velocity =  $(I * K)/n_e$
5. Hydraulic conductivity based on historic aquifer performance tests (updated October 2024)
6. Assumed effective porosities for overburden was based on the default values recommended by USEPA for a silty sand-type soil (1996). Assumed effective porosity for bedrock was derived from Daniel and Dahlen (2002) and Dowd and Marshall (1995).



**TABLE 3**  
**GROUNDWATER MONITORING PARAMETERS AND FREQUENCY**  
Georgia Power Company - Plant McDonough-Atkinson  
CCR Unit AP-2 and AP-3/4  
Cobb County, Georgia

MONITORING PARAMETERS		GROUNDWATER MONITORING	
		BACKGROUND	SEMI-ANNUAL EVENTS
Field Parameters	Temperature	X	X
	pH	X	X
	Turbidity	X	X
	Specific Conductance	X	X
	Oxidation Reduction Potential	X	X
	Dissolved Oxygen	X	X
Appendix III (Detection Monitoring)	Boron	X	X
	Calcium	X	X
	Chloride	X	X
	Fluoride	X	X
	pH (field)	X	X
	Sulfate	X	X
	Total Dissolved Solids	X	X
Appendix IV (Assesment Monitoring)	Antimony	X	X
	Arsenic	X	X
	Barium	X	X
	Beryllium	X	X
	Cadmium	X	X
	Chromium	X	X
	Cobalt	X	X
	Fluoride	X	X
	Lead	X	X
	Lithium	X	X
	Mercury	X	X
	Molybdenum	X	X
	Selenium	X	X
	Thallium	X	X
	Radium 226+228	X	X

**Notes:**

1. The water samples will be tested for total metals following the SW-846 EPA Methods or the most current approved EPA Methods.
2. Assessment sampling frequency and parameter list determined in accordance with Georgia Chapter 391-3-4-.10(6)

**TABLE 4**  
**ANALYTICAL METHODS**  
Georgia Power Company - Plant McDonough-Atkinson  
CCR Unit AP-2 and AP-3/4  
Cobb County, Georgia

PARAMETERS	EPA METHOD NUMBER
<b>APPENDIX III</b>	
Boron	EPA 6010D/6020B
Calcium	EPA 6010D/6020B
Chloride	EPA 300.0/300.1/9250/9251/9253/9056A
Fluoride	EPA 300.0/300.1/9214/9056A
pH	150.1 field
Sulfate	EPA 9035/9036/9038/300.0/300.1/9056A
Total Dissolved Solids (TDS)	EPA 160.1/Standard Method 2540C
<b>APPENDIX IV</b>	
Antimony	EPA 7040/7041/6010D/6020B
Arsenic	EPA 7060A/7061A/6010D/6020B
Barium	EPA 7080A/7081/6010D/6020B
Beryllium	EPA 7090/7091/6010D/6020B
Cadmium	EPA 7130/7131A/6020B
Chromium	EPA 7190/7191/6010D/6020B
Cobalt	EPA 7200/7201/6010D/6020B
Fluoride	EPA 300.0/300.1/9214/9056A
Lead	EPA 7420/7421/6010D/6020B
Lithium	EPA 6010D/6020B
Mercury	EPA 7470A
Molybdenum	EPA 6010D/6020B
Selenium	EPA 7740/7741A/6010D/6020B
Thallium	EPA 7840/7841/6010D/6020B
Radium 226 and 228 combined	EPA 903.0/9320/9315

**Notes:**

The water Samples will be tested for total metals by following the SW-846, EPA Methods or the most current approved EPA methods.

**TABLE 5**  
**SURFACE WATER MONITORING PARAMETERS AND FREQUENCY**  
Georgia Power Company - Plant McDonough-Atkinson  
CCR Unit AP-2 and AP-3/4  
Cobb County, Georgia

ANALYTE	SURFACE WATER SAMPLING LOCATIONS		
	SWC-1	SWC-2	SWC-3
<b>FIELD MONITORING PARAMETERS</b>			
pH	X	X	X
Oxidation Reduction Potential	X	X	X
Specific Conductance	X	X	X
Dissolved Oxygen	X	X	X
Temperature	X	X	X
Turbidity	X	X	X
<b>APPENDIX IV</b>			
Antimony, Total	X	X	X
Arsenic, Total	X	X	X
Barium, Total	X	X	X
Beryllium, Total	X	X	X
Cadmium, Total	X	X	X
Chromium, Total	X	X	X
Cobalt, Total	X	X	X
Fluoride, Total	X	X	X
Lead, Total	X	X	X
Lithium, Total	X	X	X
Mercury, Total	X	X	X
Molybdenum, Total	X	X	X
Radium (226 + 228)	X	X	X
Selenium, Total	X	X	X
Thallium, Total	X	X	X

**Notes:**

1. Surface water sampling will commence following certification of closure construction.
2. Surface water is collected Semi-Annually concurrent with the groundwater sampling event.
3. Any location that is dry at the time of the sampling event will be identified as such.

## Figures









LEGEND


- PROPOSED DETECTION MONITORING WELL
- PROPOSED DETECTION MONITORING WELL REPLACEMENT
- AP-1 MONITORING WELL
- AP-2,3/4 MONITORING WELL
- UPGRADIENT WELL
- ASSESSMENT MONITORING WELL
- PIEZOMETER
- DEWATERING WELL
- APPROXIMATE GROUNDWATER FLOW DIRECTION
- GROUNDWATER SURFACE CONTOUR (FT-NAVD88)
- SURFACE WATER STREAM
- PERMIT BOUNDARY
- PROPERTY BOUNDARY
- EXISTING TOPOGRAPHY 10-FOOT CONTOUR
- EXISTING TOPOGRAPHY 2-FOOT CONTOUR

NOTES

- ALL LOCATIONS AND BOUNDARIES ARE APPROXIMATE.
- GROUNDWATER ELEVATION MEASUREMENTS OBTAINED JANUARY 29, 2024 BY WSP.
- GROUNDWATER ELEVATIONS DISPLAYED IN FEET REFERENCED TO NORTH AMERICAN VERTICAL DATUM (FT NAVD88).

REFERENCE

- AERIAL IMAGERY DATE FOR AP-1, AP-2, AND AP-3/4 PROVIDED BY GEORGIA POWER, JANUARY 25, 2024; AND SURROUNDING AREAS SOURCED BY PLEXEARTH, DATED SEPTEMBER 28, 2023.
- COORDINATE SYSTEM: NAD 1983 STATE PLANE GEORGIA WEST (U.S. FEET).
- MONITORING WELL/PIEZOMETER LOCATIONS AND ELEVATIONS SURVEYED BY METRO ENGINEERING AND SURVEYING COMPANY IN AUGUST 2020 WITH ADDITIONAL SURVEY PROVIDED IN JANUARY 2021, APRIL 2021, MAY 2022, AND MAY 2023.



CLIENT  
GEORGIA POWER COMPANY  
PLANT MCDONOUGH-ATKINSON

PROJECT  
GROUNDWATER MONITORING PLAN  
PLANT MCDONOUGH-ATKINSON CCR UNIT AP-2 AND AP-3/4

TITLE  
**SITE POTENTIOMETRIC MAP – JANUARY 29, 2024**

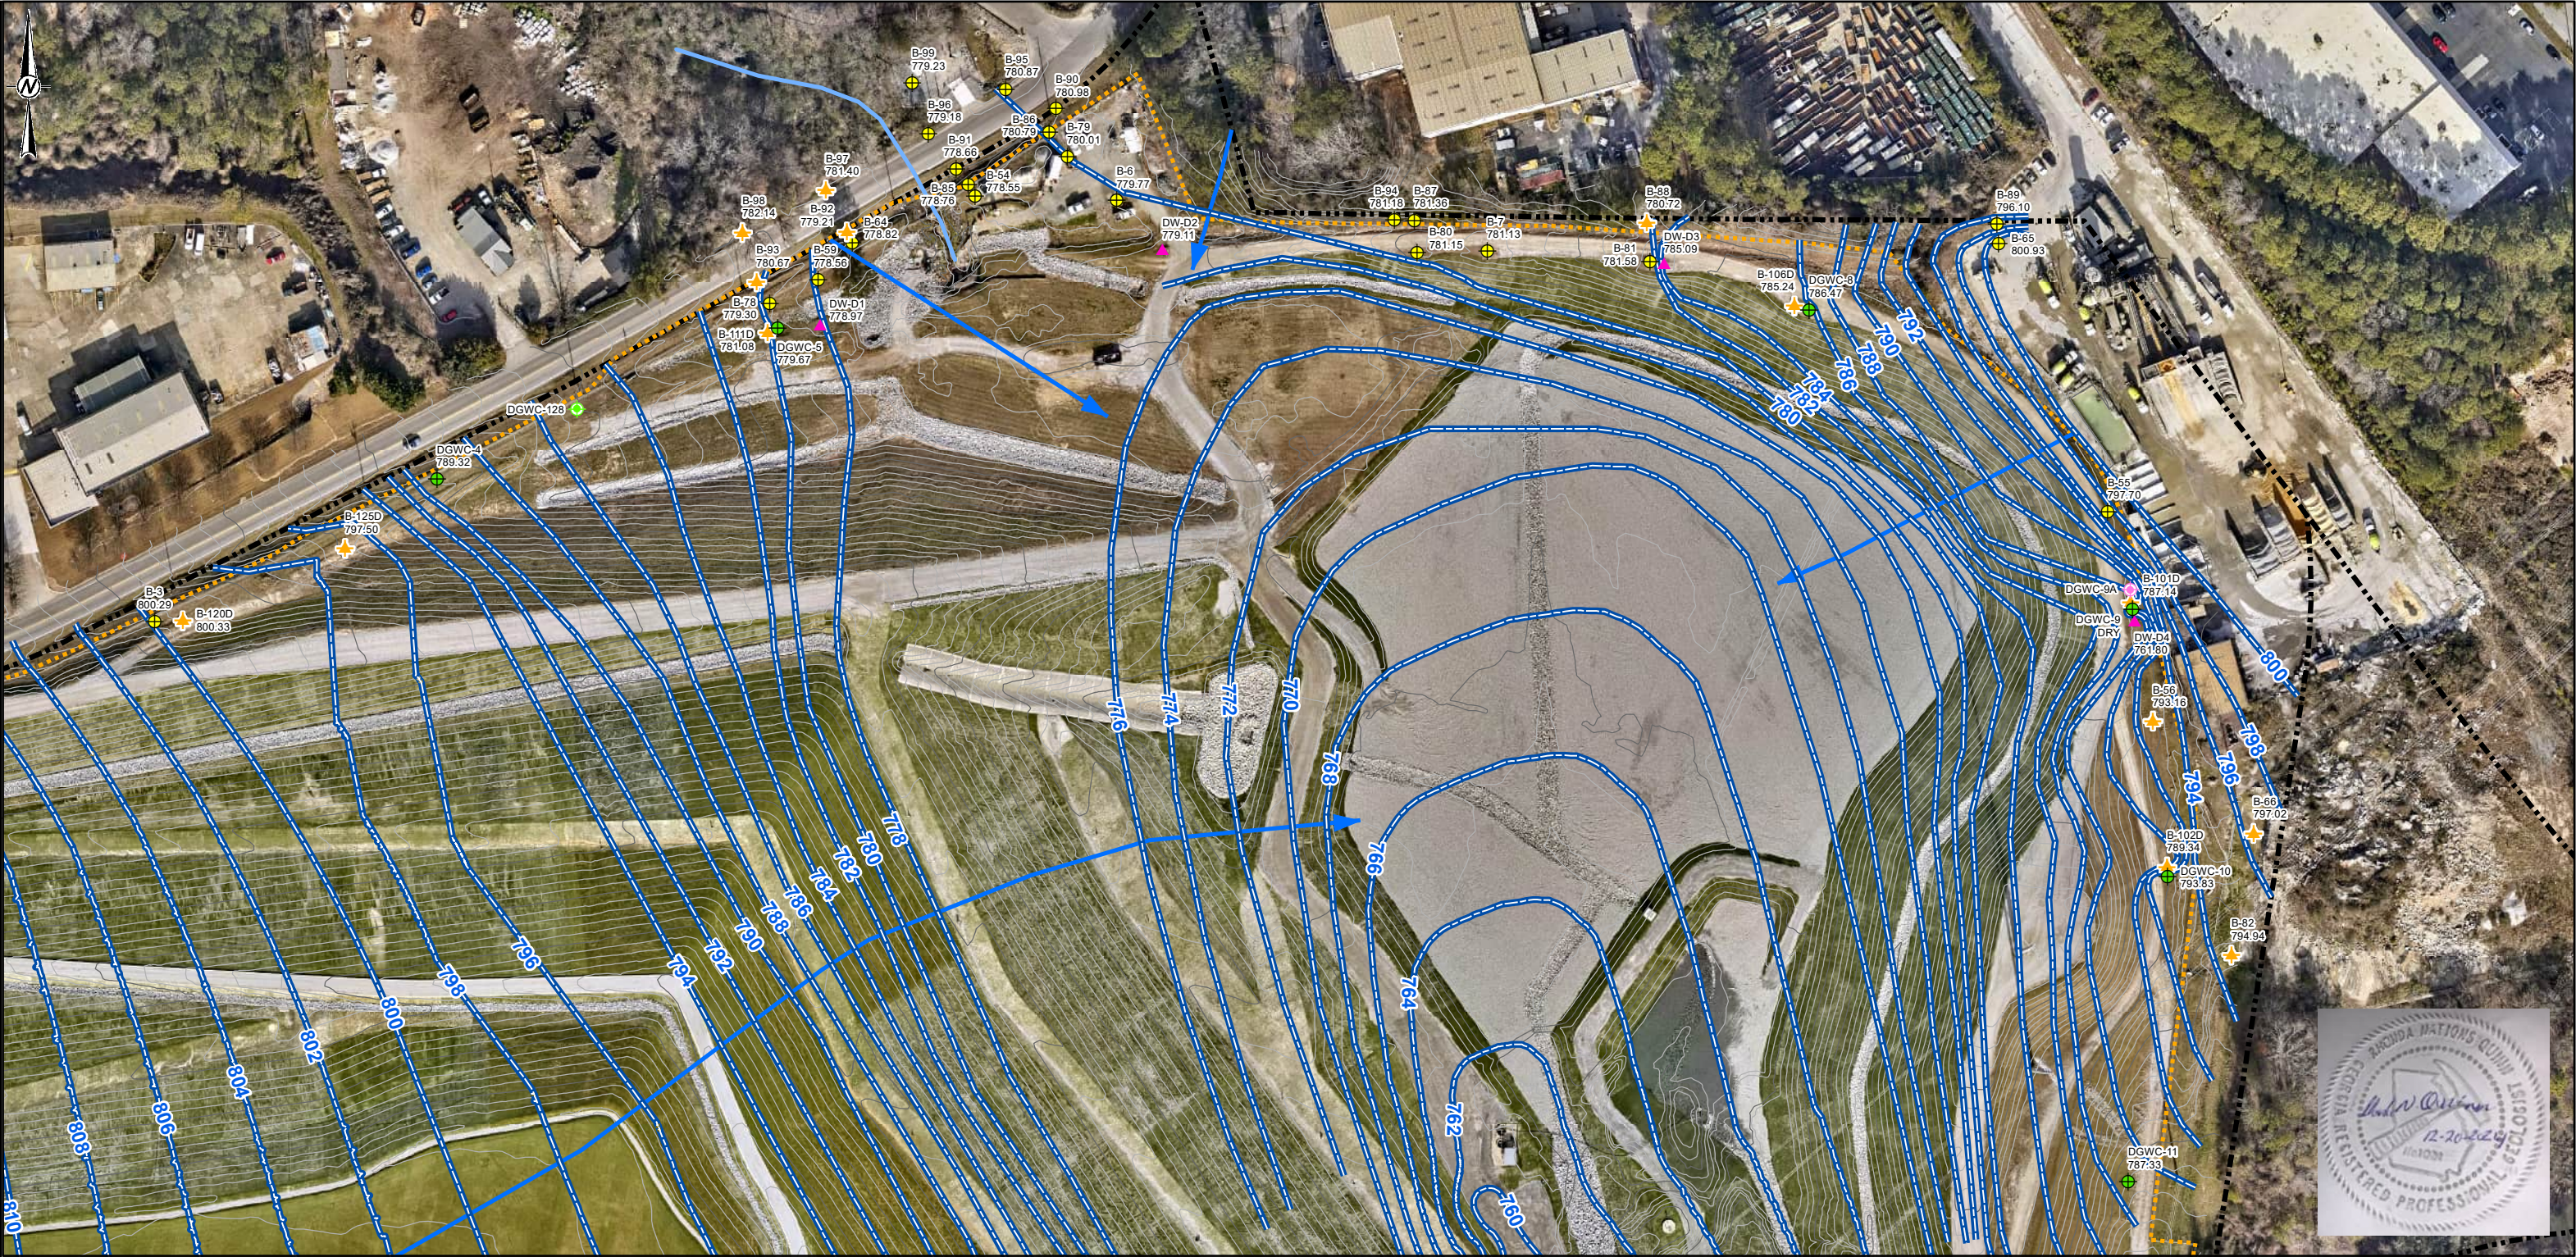
CONSULTANT	YYYY-MM-DD	2024-12-18
PREPARED	YCS	
DESIGN	SEB	
CHECKED	DLP	
REVIEWED/APPROVED	RNQ	

PROJECT No. US0037149.3190 (GL1777449) Rev. 0

FIGURE 2A







LEGEND

- AP-1 MONITORING WELL
- AP-2,3/4 MONITORING WELL
- UPGRADIENT WELL
- ASSESSMENT MONITORING WELL
- PIEZOMETER
- DEWATERING WELL
- PROPOSED DETECTION MONITORING WELL
- PROPOSED DETECTION MONITORING WELL REPLACEMENT
- GROUNDWATER SURFACE CONTOUR (FT-NAVD88)
- APPROXIMATE GROUNDWATER FLOW DIRECTION
- SURFACE WATER STREAM
- PERMIT BOUNDARY
- PROPERTY BOUNDARY
- EXISTING TOPOGRAPHY 10-FOOT CONTOUR
- EXISTING TOPOGRAPHY 2-FOOT CONTOUR

NOTES

- ALL LOCATIONS AND BOUNDARIES ARE APPROXIMATE.
- GROUNDWATER ELEVATION MEASUREMENTS OBTAINED JANUARY 29, 2024 BY WSP.
- GROUNDWATER ELEVATIONS DISPLAYED IN FEET REFERENCED TO NORTH AMERICAN VERTICAL DATUM (FT NAVD88).

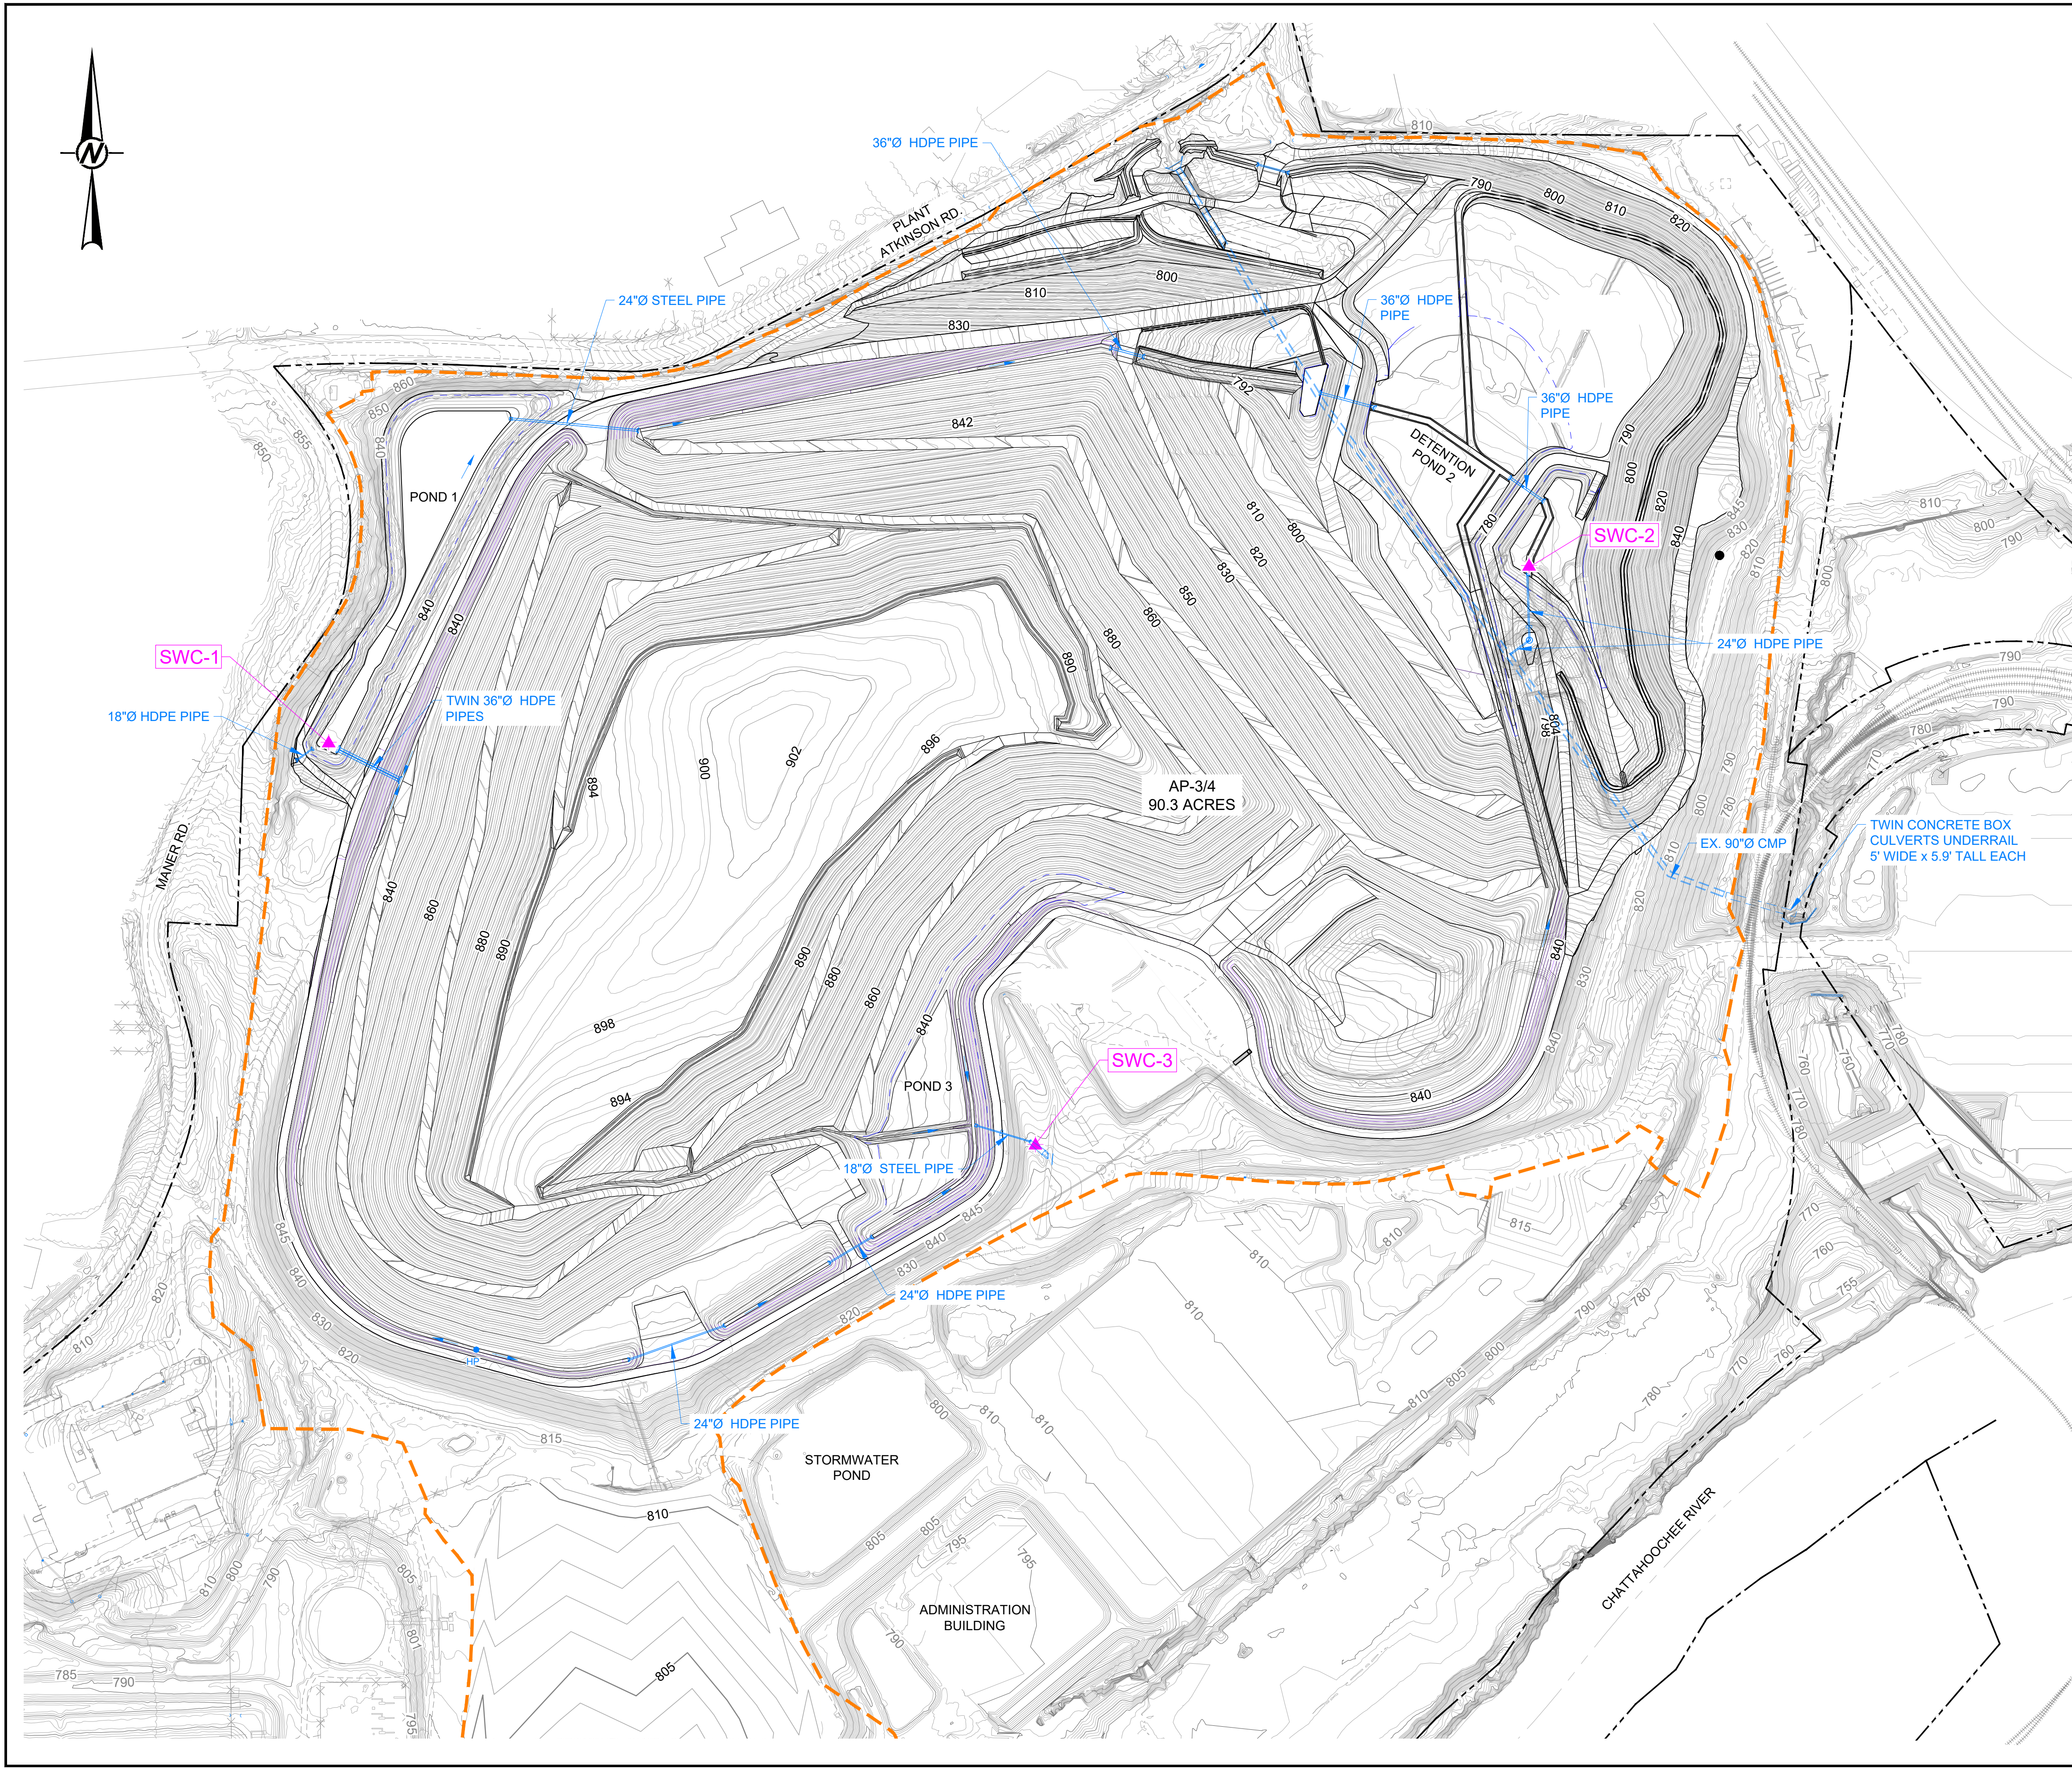
REFERENCE

- AERIAL IMAGERY DATE FOR AP-1, AP-2, AND AP-3/4 PROVIDED BY GEORGIA POWER, JANUARY 25, 2024; AND SURROUNDING AREAS SOURCED BY PLEXEARTH, DATED SEPTEMBER 28, 2023.
- COORDINATE SYSTEM: NAD 1983 STATE PLANE GEORGIA WEST (U.S. FEET).
- MONITORING WELL/PIEZOMETER LOCATIONS AND ELEVATIONS SURVEYED BY METRO ENGINEERING AND SURVEYING COMPANY IN AUGUST 2020 WITH ADDITIONAL SURVEY PROVIDED IN JANUARY 2021, MAY 2021, AND MAY 2022 AND 2023.



CLIENT GEORGIA POWER COMPANY PLANT MCDONOUGH-ATKINSON PROJECT GROUNDWATER MONITORING PLAN PLANT MCDONOUGH-ATKINSON CCR UNIT AP-2 AND AP-3/4				
TITLE (INSET) SITE POTENTIOMETRIC MAP JANUARY 29, 2024				
CONSULTANT			YYYY-MM-DD	2024-12-18
			PREPARED	YCS
			DESIGN	SEB
			CHECKED	DLP
			REVIEW/APPROVED	RNQ
PROJECT NO. CONTROL US0037149.3190 (GL1777449)			REV. 0	FIGURE 2B





LEGEND

- 780 --- EXISTING CONTOURS (SEE REFERENCE 2)
- - - - - PROPERTY BOUNDARY LIMITS
- 810 --- FINAL CONTOURS
- PROPOSED PERMIT BOUNDARY AP-2, AP-3/4
- ▲ SURFACE WATER SAMPLE LOCATION

REFERENCES


- APPROXIMATE PROPERTY BOUNDARY PROVIDED BY SOUTHERN COMPANY SERVICES (2017).
- THE EXISTING TOPOGRAPHY AND CONTOUR ELEVATIONS FOR THE ASH PONDS 1 THROUGH 4 AREAS WERE PROVIDED BY GEORGIA POWER. THE DATE OF THE SURVEY PROVIDED AND SHOWN ON THIS PLAN, ON AP- 1 THROUGH 4, IS AUGUST 31, 2022.

THE EXISTING TOPOGRAPHY AND CONTOUR ELEVATIONS FOR THE SURROUNDING AREAS OF ASH PONDS 1 THROUGH 4 WERE PROVIDED BY GEORGIA LAND DEPARTMENT AND METRO ENGINEERING AND SURVEYING CO, INC. THE DATE OF THE SURVEY PROVIDED AND SHOWN ON THIS PLAN, AT THE SURROUNDING AREAS, IS 03-18-2018. REFER TO THE SURVEY DRAWING TITLED "TOPOGRAPHIC MAP PREPARED FOR GEORGIA POWER COMPANY PLANT MCDONOUGH - GEORGIA STATE PLANE WEST SURVEY FEET FOR SURROUNDING AREAS OF ASH PONDS 1 THROUGH 4.

NOTES

- EXISTING TOPOGRAPHIC CONTOUR INTERVAL = 1 FOOT.

ISSUED FOR PERMIT  
NOT FOR CONSTRUCTION



CLIENT  
GEORGIA POWER COMPANY  
PLANT MCDONOUGH-ATKINSON



PROJECT

GROUNDWATER MONITORING PLAN  
PLANT MCDONOUGH-ATKINSON CCR UNIT AP-2 AND AP-3/4

TITLE  
SURFACE WATER SAMPLING LOCATION MAP

CONSULTANT



YYYY-MMM	2024-02-05
DESIGNED	DLP
PREPARED	CRP
CHECKED	DLP
REVIEWED / APPROVED	RPK

PROJECT NO  
US0037149.3190

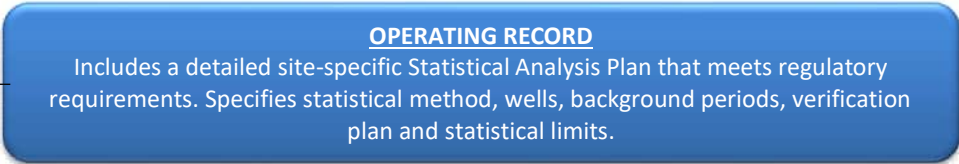
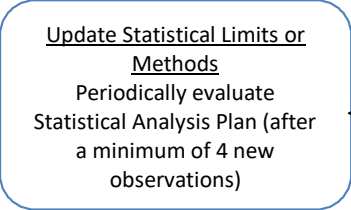

REF:  
1777449

REV.  
0

FIGURE  
3

IF THIS MEASUREMENT DOES NOT MATCH WHAT IS SHOWN, THE SHEET SIZE HAS BEEN MODIFIED FROM "ANSI D 11" x 17" TO "CUSTOM" 11" x 17".





CLIENT  
GEORGIA POWER COMPANY  
PLANT MCDONOUGH-ATKINSON

CONSULTANT

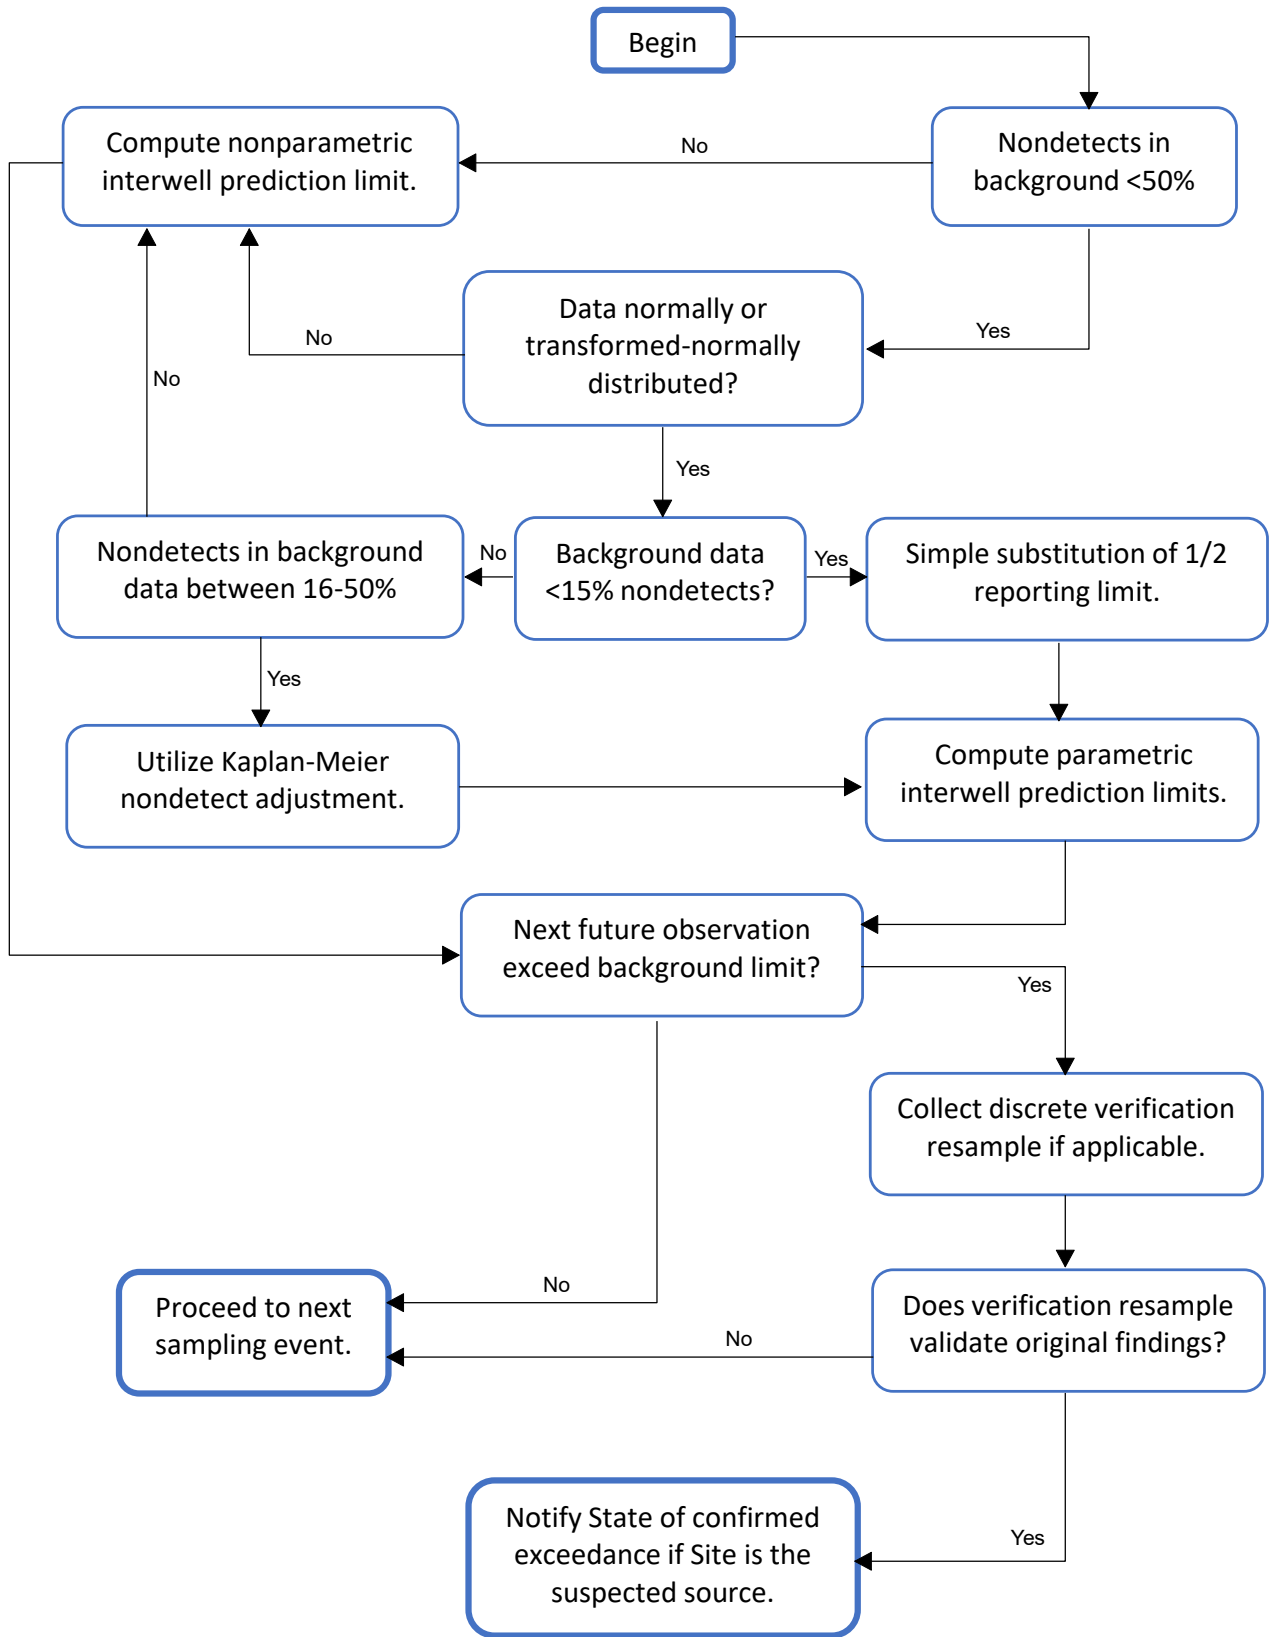


YYYY-MM-DD	2024-11-18
DESIGNED	DLP
PREPARED	DJC
REVIEWED	DLP
APPROVED	RNQ

PROJECT  
GROUNDWATER MONITORING PLAN  
PLANT MCDONOUGH-ATKINSON CCR UNIT AP-2  
AND AP-3/4

TITLE  
**STATISTICAL ANALYSIS PLAN OVERVIEW**

PROJECT NO.	CONTROL	REV.	FIGURE
US0037149.3190 (GL1777449)	GL166449622B001.mxd	0	4



CLIENT  
GEORGIA POWER COMPANY  
PLANT MCDONOUGH-ATKINSON

CONSULTANT



YYYY-MM-DD 2024-11-18

DESIGNED DLP

PREPARED DJC

REVIEWED DLP

APPROVED RNQ

PROJECT  
GROUNDWATER MONITORING PLAN  
PLANT MCDONOUGH-ATKINSON CCR UNIT AP-2  
AND AP-3/4

TITLE

**DECISION LOGIC FOR COMPUTING INTERWELL  
PREDICTION LIMITS**

PROJECT NO. US0037149.3190 (GL1777449) CONTROL GL166849622B002.mxd

REV. FIGURE  
0 5

**APPENDIX A**

# MONITORING SYSTEM DETAILS

## MONITORING WELL AND PIEZOMETER CONSTRUCTION LOGS

# RECORD OF BOREHOLE DGWA-53/B-53

SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 28.90 ft  
LOCATION: in the middle of the pond of the construction area of AP3

DRILL RIG: CME 55  
DATE STARTED: 9/24/16  
DATE COMPLETED: 9/24/16

NORTHING: 1,393,472.80  
EASTING: 2,201,668.80  
GS ELEVATION: 841.37  
TOC ELEVATION: 844.26 ft

DEPTH W.L.: 10.08  
ELEVATION W.L.: 831.22  
DATE W.L.: 10/6/2016  
TIME W.L.: 1233

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
0	840	0.00 - 3.50 SM, silt SAND, fine to medium grained, non-plastic, tan, non-cohesive, dry to moist, compact	SM			1	DO	2-4-6	10	1.50	CETCO puregold grout (70:30) — / aluminum casing	<b>WELL CASING</b> Interval: 0'-17.6' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 17.6'-27.6' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010 End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 12'-28.9' Type: FilterSil  <b>FILTER PACK SEAL</b> Interval: 8'-12' Type: PEL-PLUG 3/8" Bentonite pellets  <b>ANNULUS SEAL</b> Interval: 0'-8' Type: CETCO puregold grout (70:30)  <b>WELL COMPLETION</b> Pad: Protective Casing: 4"x4"x5' aluminum  <b>DRILLING METHODS</b> Soil Drill: Hollow-stem auger Rock Drill: HQ Core Barrell
5	835	3.50 - 12.20 SM, silt SAND, fine to medium grained, non-plastic, tan, non-cohesive, dry to moist, compact to dense (saprolite). Auger Refusal at 12.2	SM		837.9 3.50	2	DO	4-6-6	12	1.50	CETCO puregold grout (70:30)	
10	830					3	DO	5-13-35	48	1.50	PEL-PLUG 3/8" Bentonite pellets	
15	825	12.20 - 29.50 Bedrock; GNEISS; competent, thinly foliated.	BR		829.2 12.20						FilterSil —	
20	820										0.010" slotted — screen	
25	815											
30	810	Boring completed at 28.90 ft			812.5 28.9							
35	805											
40	800											
45												

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Nortey Yeboah  
CHECKED BY: Timothy Richards, PG  
DATE: 12/22/17



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

# RECORD OF BOREHOLE DGWA-70A/B-70A








SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 60.00 ft  
LOCATION: ~400' west of the SW corner of AP-1

DRILL RIG: CME 550  
DATE STARTED: 5/10/17  
DATE COMPLETED: 5/10/17

NORTHING: 1,390,481.40  
EASTING: 2,200,591.60  
GS ELEVATION: 805.67  
TOC ELEVATION: 808.52 ft

DEPTH W.L.: 42.9  
ELEVATION W.L.: 762.9  
DATE W.L.: 5/10/2017  
TIME W.L.: 10:45

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
0	805	0.00 - 5.00 CL-CH, low to high plasticity CLAY with trace fine sand; red orange; cohesive, moist	CL-CH									<b>WELL CASING</b> Interval: 0' - 59.3' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 48.9' - 58.9' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: 58.9' - 59.3'  <b>FILTER PACK</b> Interval: 46.9' - 59.3' Type: FilterSil Gravel Pack  <b>FILTER PACK SEAL</b> Interval: 43.4' - 46.9' Type: Pel-Plug 3/8" Bentonite Pellets  <b>ANNULUS SEAL</b> Interval: 0' - 43.4' Type: Pure Gold Grout Mixture  <b>WELL COMPLETION</b> Pad: 4' x 4' concrete Protective Casing: 4" x 4" x 5' Aluminum  <b>DRILLING METHODS</b> Soil Drill: 8.25 Hollow-Stem Auger Rock Drill: N/A
5	800	5.00 - 13.50 ML, SILT, trace fine sand, low plasticity; yellowish brown, contains mica; cohesive, moist, w<PL, soft.	ML		800.7 5.00							
10	795											
15	790	13.50 - 28.50 ML, SILT, trace fine to coarse sand, non to low plasticity; yellowish brown to orange brown, iron staining weathered, relict structure (gneissic); cohesive, moist, w<PL, soft.	ML		792.2 13.50	S1	DO	6-7-7	14	0.83 1.50		
20	785		ML			S2	DO	5-9-13	22	1.50 1.50		
25	780					S3	DO	5-9-10	19	1.50 1.50		
30	775	28.50 - 38.50 ML, SILT, trace sand, low plasticity; medium to dark gray, highly micaceous; cohesive, moist to wet (increase with depth), w<PL, soft.	ML		777.2 28.50	S4	DO	5-8-11	19	1.50 1.50		
35	770					S5	DO	5-11-15	26	1.50 1.50		
40	765	38.50 - 53.50 ML, SILT, trace sand, low plasticity; medium to dark gray, saprolite, highly micaceous; cohesive, moist to wet (increase with depth), w<PL, soft.	ML		767.2 38.50	S6	DO	4-8-10	18	1.50 1.50		
45		Log continued on next page				S7	DO	20-50/4	50/4	0.75 1.50		

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 1/16/18



# RECORD OF BOREHOLE DGWA-70A/B-70A

SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 60.00 ft  
LOCATION: ~400' west of the SW corner of AP-1

DRILL RIG: CME 550  
DATE STARTED: 5/10/17  
DATE COMPLETED: 5/10/17

NORTHING: 1,390,481.40  
EASTING: 2,200,591.60  
GS ELEVATION: 805.67  
TOC ELEVATION: 808.52 ft

DEPTH W.L.: 42.9  
ELEVATION W.L.: 762.9  
DATE W.L.: 5/10/2017  
TIME W.L.: 10:45

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
45	760	38.50 - 53.50 ML, SILT, trace sand, low plasticity; medium to dark gray, saprolite, highly micaceous; cohesive, moist to wet (increase with depth), w<PL, soft. (Continued)	ML								FilterSil Gravel Pack	<b>WELL CASING</b> Interval: 0' - 59.3' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 48.9' - 58.9' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: 58.9' - 59.3'  <b>FILTER PACK</b> Interval: 46.9' - 59.3' Type: FilterSil Gravel Pack  <b>FILTER PACK SEAL</b> Interval: 43.4' - 46.9' Type: Pel-Plug 3/8" Bentonite Pellets  <b>ANNULUS SEAL</b> Interval: 0' - 43.4' Type: Pure Gold Grout Mixture  <b>WELL COMPLETION</b> Pad: 4' x 4' concrete Protective Casing: 4" x 4" x 5' Aluminum  <b>DRILLING METHODS</b> Soil Drill: 8.25 Hollow-Stem Auger Rock Drill: N/A
50	755					S8	DO	50/4	50/4	0.00 1.50		
55	750	53.50 - 60.00 SM, Silty SAND, fine grained, low plasticity; dark gray, contains mica; non-cohesive, moist, w<PL, dense.				S9	DO	50/3	50/3	0.25 1.50		
60	745	Boring completed at 60.00 ft	PWR		745.7	S10	DO	50/2	50/2	0.17 1.50	0.010" Slotted Schedule 40 PVC	
65	740											
70	735											
75	730											
80	725											
85	720											
90												

BOREHOLE RECORD MCDONOUGH MASTER LIST BACKUP SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 1/16/18





# RECORD OF BOREHOLE DGWA-71/B-71

SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 43.80 ft  
LOCATION: NW corner of site, inside cell tower gate.

DRILL RIG: CME 550  
DATE STARTED: 2/28/17  
DATE COMPLETED: 2/28/17

NORTHING: 1,393,963.30  
EASTING: 2,201,714.80  
GS ELEVATION: 861.22  
TOC ELEVATION: 863.84 ft

DEPTH W.L.: 27.1  
ELEVATION W.L.: 834.1  
DATE W.L.: 2/28/17  
TIME W.L.: 1245

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES				MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC	
0	860	0.00 - 10.50 Hydrovac									<b>WELL CASING</b> Interval: 0'-33.4' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screen  <b>WELL SCREEN</b> Interval: 33.4'-43.4' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 32.6'-43.8' Type: FilterSil  <b>FILTER PACK SEAL</b> Interval: 30.6'-32.6' Type: PEL-PLUG 3/8" Bentonite pellets  <b>ANNULUS SEAL</b> Interval: 1'-30.6' Type: CETCO puregold grout (70:30)  <b>WELL COMPLETION</b> Pad: 4'x4' Concrete Protective Casing: 4" x 4" x 5' Aluminum  <b>DRILLING METHODS</b> Soil Drill: Hollow-stem auger Rock Drill: N/A
5	855										
10	850	10.50 - 20.00 Sand with some silt, sands fine, white/black/grey weathered granite/granite gneiss, non plastic, moist, compact.			850.7 10.50						
15	845		SP-SM			S1	SPT	4-8-10	18	1.50 1.50	
20	840	20.00 - 30.00 Silty Sand, sands fine, white/black/grey weathered granite/granite gneiss, non plastic, moist, dense.			841.2 20.00	S2	SPT	2-5-7	12	1.50 1.50	CETCO puregold - grout (70:30)
25	835		SM			S3	SPT	4-7-11	18	1.50 1.50	
30	830	30.00 - 35.00 Sand with trace to some silt, sands fine to medium, white/black/grey, non plastic, moist, very dense.			831.2 30.00	S4	SPT	8-21-50/4	71/10	1.33 1.33	
35	825	35.00 - 43.80 Sand with trace silt and gravel (rock fragments), sands fine to medium, white/black/grey, non plastic, wet, very dense, and some iron staining in samples.			826.2 35.00	S5	SPT	43-50/2	50/2	0.67 0.67	
40	820		PWR			S6	SPT	50/3	50/3	0.25 0.25	PEL-PLUG 3/8" Bentonite pellets  0.010" Slotted Schedule 40 PVC  FilterSil -
45		Boring completed at 43.80 ft			817.4	S7	SPT	50/3	50/3	0.25 0.25	

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 1/16/18





# BORING LOG

**BORING B-37**

Page 1 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DATE STARTED 11/28/2012 COMPLETED 11/28/2012 GROUND ELEVATION 763.7 ft COORDINATES N 1390482.2 E 2200919.8

CONTRACTOR SCS Field Services METHOD 4.25" Hollow Stem Auger w/pilot bit EQUIPMENT CME 550

DRILLED BY S. Denty LOGGED BY G. Dyer CHECKED BY BORING DEPTH 41 ft.

GROUND WATER DEPTH: DURING COMP. DELAYED

NOTES Well installed. Refer to well data sheet.

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \VALTRCFP01\APARKER\DESKTOP\GPCMW LOGS SURVEY UPDATED.GPJ

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
0		- Vacuum excavation fro 0 ft to 9.0 ft						
5								
10		<b>Silt (ML)</b> - tan to mottled tan, brown and red, damp, soft, SILT with clay (about 5% clay); micaceous; trace schistose texture (highly weathered)	754.7	SS -1	9.5	1-1-3 (4)		residual soil.
15		- yellow tan, medium stiff, SAA		SS -2	14.5	2-2-3 (5)		residual soil.
20		- tan, yellow and green banding, soft, SAA; softer; less clay		SS -3	19.5	1-1-2 (3)		residual soil.
25				SS	24.5	2-2-4		

(Continued Next Page)



# BORING LOG

**SOUTHERN COMPANY SERVICES, INC.**  
**EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING**

**PROJECT** Plant McDonough Hydrogeological Investigation

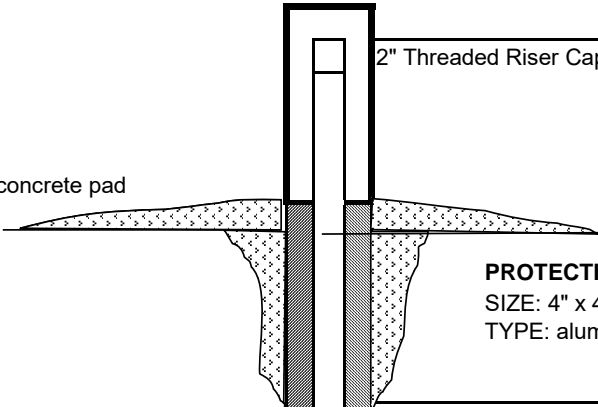
**LOCATION** Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		<b>Silt (ML)(con't)</b> - green-gray, moist, medium stiff, SILT; micaceous; lacks structure		-4		(6)		
30		- mottled tan, green, and white-gray, very damp, stiff, sandy SILT		SS -5	29.5	4-5-7 (12)		upper saprolite.
35		- brown, very hard, SILT with gravel; saprolite; highly weathered schist fragments		SS -6	34.5	50 (0)		lower saprolite.
40		- brown, very moist, very hard, sandy SILT, weathered schist fragments		SS -7	39.5	22-32-23 (55)		lower saprolite.
			722.7					
		Bottom of borehole at 41.0 feet.						
45								
50								

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRCFP01\LA\PARKER\B\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME	
Hydrogeologic Investigation		DRILLER: S. Denty			
LOCATION: Ash Pond		RIG TYPE: CME550		DGWC-37/B-37	
LOGGER: Greg Dyer		DRILLING METHODS: HS Auger			
DATE CONSTRUCTED: 11/28/2012		N: 1390482.2 E:2200919.8			
			DEPTH FEET	ELEVATION FT, MSL	
			TOP OF RISER	-2.5	766.21
2" Threaded Riser Cap					
4 ft x 4 ft concrete pad			GROUND SURFACE	0.0	763.64
					
<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum			BOTTOM OF GROUT		
<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 20 bags cement 10 lbs bentonite					
<b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded			TOP OF SEAL	24.6	739.0
<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 1.5 buckets PLACEMENT: Poured			TOP OF FILTER PACK	27.0	736.6
<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 6.75 Bags PLACEMENT: Poured w/water			BOTTOM OF RISER / TOP OF SCREEN	29.3	734.3
<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch			BOTTOM OF SCREEN	39.3	724.3
Flush-threaded end cap			BOTTOM OF CASING	39.7	723.9
HOLE DIA: 7 inch					



# BORING LOG

**BORING B-38**

Page 1 of 1

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DATE STARTED 11/28/2012 COMPLETED 11/28/2012 GROUND ELEVATION 754.7 ft COORDINATES N 1390362.7 E 2201148.6

CONTRACTOR SCS Field Services METHOD 4.25" Hollow Stem Auger w/pilot bit EQUIPMENT CME 550

DRILLED BY S. Denty LOGGED BY G. Dyer CHECKED BY BORING DEPTH 24.7 ft.

GROUND WATER DEPTH: DURING 13 ft. COMP. DELAYED

NOTES Well installed. Refer to well data sheet.

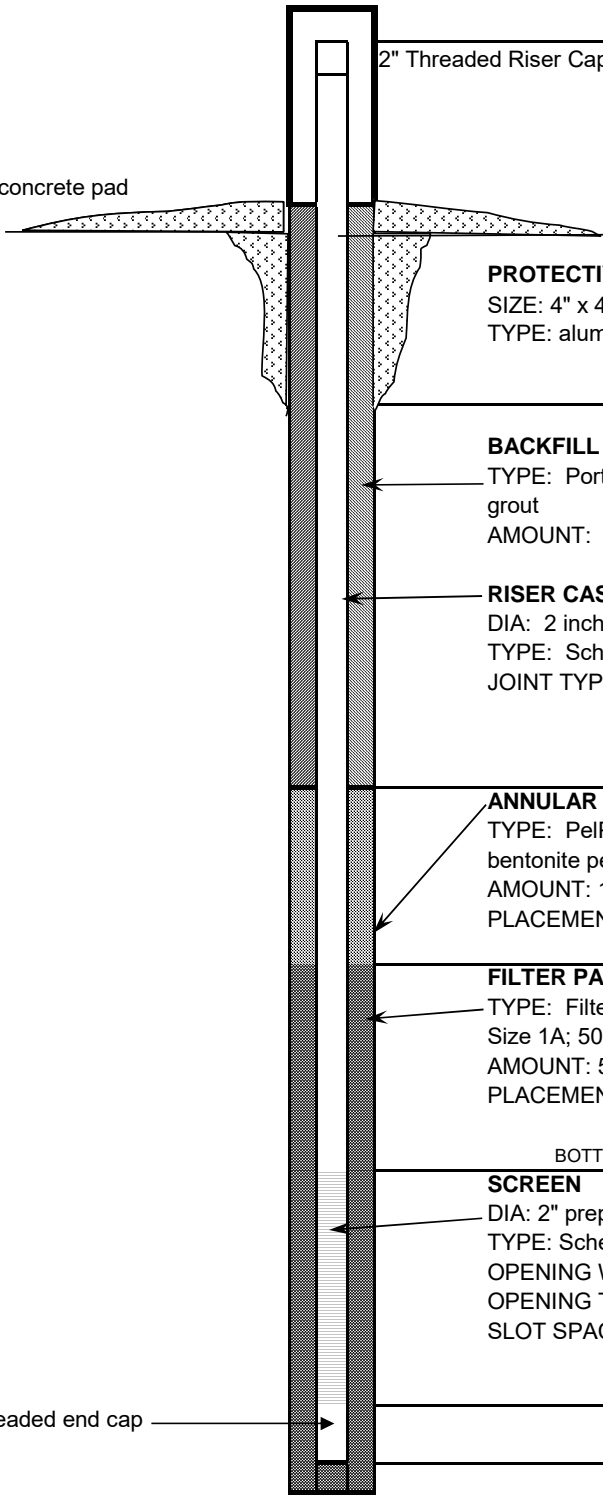
DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
0		- Vacuum excavation from 0 ft to 9.0 ft						
5								
10		<b>Silt (ML)</b> - olive-gray to tan, moist, medium stiff, SILT; micaceous; trace schist gravel; <5% clay	745.7	SS -1	9.5	2-3-4 (7)		residual soil.
15		- more tan, wet, very soft, SAA		SS -2	14.5	WH-WH-1 (1)		
20		- tan-brown-gray, very moist, stiff, SILT; micaceous; more prevalent schistose gravel		SS -3	19.5	2-4-5 (9)		residual soil.
25		- SAA with very fine-grained sand	730.0					

Bottom of borehole at 24.7 feet.

GEOTECH ENGINEERING LOGS - ESEE DATABASE: GDT - 8/26/20 20:44 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME				
Hydrogeologic Investigation		DRILLER: S. Denty						
LOCATION: Ash Pond		RIG TYPE: CME550		DGWC-38/B-38				
LOGGER: Greg Dyer		DRILLING METHODS: HS Auger						
DATE CONSTRUCTED: 11/29/2012		N: 1390362.7 E:2201148.6						
				DEPTH FEET	ELEVATION FT, MSL			
				TOP OF RISER	-2.7	757.43		
				2" Threaded Riser Cap				
				4 ft x 4 ft concrete pad		GROUND SURFACE	0.0	754.67
				<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum		BOTTOM OF GROUT		
				<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 4 bags cement 6 lbs bentonite				
				<b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded		TOP OF SEAL	10.4	744.3
				<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 1.25 bucket PLACEMENT: Poured		TOP OF FILTER PACK	13.4	741.3
				<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 5.25 Bags PLACEMENT: Poured w/water		BOTTOM OF RISER / TOP OF SCREEN	14.7	740.0
				<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch		BOTTOM OF SCREEN	24.7	730.0
				Flush-threaded end cap		BOTTOM OF CASING	25.0	729.7
				HOLE DIA: 7 inch				



# BORING LOG

**BORING B-39**

Page 1 of 2

**SOUTHERN COMPANY SERVICES, INC.**  
**EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING**

**PROJECT** Plant McDonough Hydrogeological Investigation

**LOCATION** Cobb County, GA

**DATE STARTED** 10/6/2012 **COMPLETED** 10/6/2012 **GROUND ELEVATION** 757 ft **COORDINATES** N 1390303.6 E 2201540.1

**CONTRACTOR** SCS Field Services **METHOD** 4.25" Hollow Stem Auger w/pilot bit **EQUIPMENT** CME 550

**DRILLED BY** S. Denty **LOGGED BY** G. Dyer **CHECKED BY**  **BORING DEPTH** 26 ft.

**GROUND WATER DEPTH: DURING** 20 ft. **COMP.**  **DELAYED**

**NOTES** Well installed. Refer to well data sheet.

GEOTECH ENGINEERING LOGS - ESEE DATABASE: GDT - 8/26/20 20:44 - \VALTRCFP01\APARKER\DESKTOP\GPCMW LOGS SURVEY UPDATED.GPJ

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
0		- Vacuum excavation from 0 ft to 9.5 ft						
5								
10		<b>Elastic Silt (MH)</b> - tan, wet, medium stiff, medium plasticity, clayey SILT with fine sand	747.5	UD -1	9.5			water table in hydrovac hole at about 2 ft bgs.
15		<b>Silt (ML)</b> - tan-brown, wet, medium stiff, sandy SILT; contains schist gravel at base	741.8	SS -1	14.5	1-2-6 (8)		residual soil.
20		<b>Silt (ML)</b> - mottled tan, orange and brown, wet, medium stiff, clayey SILT; micaceous		SS -2	19.5	2-2-5 (7)		residual soil/upper saprolite transition.
25		<b>Lean Clay (CL)</b>	732.5	SS	24.5	3-2-4		

(Continued Next Page)





# BORING LOG

BORING B-39

Page 2 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		- mottled tan, brown and black, damp, medium stiff, low plasticity, silty CLAY; relict structures observed; highly weathered <b>Lean Clay (CL)</b> (con't)	731.0	-3		(6)		upper saprolite.
30								
35								
40								
45								
50								

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

Bottom of borehole at 26.0 feet.

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME	
Hydrogeologic Investigation		DRILLER: S. Denty			
LOCATION: Ash Pond		RIG TYPE: CME550		DGWC-39/B-39	
LOGGER: Greg Dyer		DRILLING METHODS: HS Auger			
DATE CONSTRUCTED: 11/6/2012		N: 1390303.6 E:2201540.1			
				DEPTH	ELEVATION
				FEET	FT, MSL
TOP OF RISER				-2.9	759.89
2" Threaded Riser Cap					
4 ft x 4 ft concrete pad					
GROUND SURFACE				0.0	756.93
<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum					
BOTTOM OF GROUT					
<b>BACKFILL MATERIAL</b> TYPE: Bentonite Plug grout AMOUNT: 4 buckets 200 lbs bentonite					
<b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded					
TOP OF SEAL				4.9	752.0
<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 3.5 buckets PLACEMENT: Poured					
TOP OF FILTER PACK				8.0	748.9
<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 11 Bags PLACEMENT: Poured w/water					
BOTTOM OF RISER / TOP OF SCREEN				10.8	746.1
<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch					
BOTTOM OF SCREEN				20.8	736.1
Flush-threaded end cap					
BOTTOM OF CASING				21.2	735.7
HOLE DIA: 7 inch					



# BORING LOG

**BORING B-40**

Page 1 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DATE STARTED 11/5/2012 COMPLETED 11/5/2012 GROUND ELEVATION 776.2 ft COORDINATES N 1390625.7 E 2201825.9

CONTRACTOR SCS Field Services METHOD 4.25" Hollow Stem Auger w/pilot bit EQUIPMENT CME 550

DRILLED BY S. Denty LOGGED BY G. Dyer CHECKED BY BORING DEPTH 36 ft.

GROUND WATER DEPTH: DURING COMP. DELAYED

NOTES Well installed. Refer to well data sheet.

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
0		- Vacuum excavation from 0 ft to 9.5 ft						
5								
10		<b>Silt (ML)</b> - brown-tan, stiff, clayey, sandy SILT; damp to moist; contains micaceous fragments; manganese staining and nodules	766.7	SS -1	9.5	2-4-5 (9)		residual soil.
15		- tan to tan-brown, damp, stiff, sandy SILT; contains highly weathered schist; manganese staining		SS -2	14.5	4-5-6 (11)		upper saprolite.
20		- mottled tan, brown, and black, very moist, clayey SILT with sand; highly weathered schist fragments; 10% micaceous sand		SS -3	19.5	4-3-4 (7)		upper saprolite; increased water content.
25				SS	24.5	7-11-12		


GEOTECH ENGINEERING LOGS - ESEE DATABASE: GDT - 8/26/20 20:44 - \VALTRCFP01\APARKER\DESKTOP\GPCMW LOGS SURVEY UPDATED.GPJ

(Continued Next Page)



## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME			
Hydrogeologic Investigation		DRILLER: S. Denty					
LOCATION: Ash Pond		RIG TYPE: CME550		DGWC-40/B-40			
LOGGER: Greg Dyer		DRILLING METHODS: HS Auger					
DATE CONSTRUCTED: 11/5/2012		N: 1390625.7 E:2201825.9					
				DEPTH FEET	ELEVATION FT, MSL		
				TOP OF RISER	-2.9	779.06	
				2" Threaded Riser Cap			
				GROUND SURFACE		0.0	776.12
				<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum			
				BOTTOM OF GROUT			
				<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 6 bags cement 6 lbs bentonite			
				<b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded			
				TOP OF SEAL		19.0	757.1
				<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 1 bucket PLACEMENT: Poured			
				TOP OF FILTER PACK		21.4	754.7
				<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 0.5 Bag filter pac 6.5 bag hole PLACEMENT: Poured w/water			
				BOTTOM OF RISER / TOP OF SCREEN		24.5	751.6
				<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch			
				BOTTOM OF SCREEN		34.5	741.6
				Flush-threaded end cap			
BOTTOM OF CASING		34.9	741.2				
HOLE DIA: 7 inch							

# RECORD OF BOREHOLE DGWC-67/B-67

SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 56.00 ft  
LOCATION: West Toe of AP-1

DRILL RIG: Geoprobe  
DATE STARTED: 3/8/17  
DATE COMPLETED: 3/14/17

NORTHING: 1,390,953.80  
EASTING: 2,200,830.70  
GS ELEVATION: 766.80  
TOC ELEVATION: 766.70 ft

DEPTH W.L.: 9.1  
ELEVATION W.L.: 757.9  
DATE W.L.: 3/14/17  
TIME W.L.: 0850

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES				MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS		
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE			REC	
					DEPTH (ft)								
0		0.00 - 10.00 Silt and Clay with some sand and pebbles, brown, highly weathered mica schist, low plastic, cohesive, dry.	ML							Flush Mounted Casing	<b>WELL CASING</b> Interval: 0'-46.3' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 46.3'-56.3' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 44.0'-56.7' Type: FilterSil  <b>FILTER PACK SEAL</b> Interval: 44.0'-41.8' Type: PEL-PLUG 3/8" Bentonite pellets  <b>ANNULUS SEAL</b> Interval: 0'-41.8' Type: CETCO puregold grout (70:30)  <b>WELL COMPLETION</b> Pad: 4'x4' Concrete Protective Casing: 8" Round Flush Mount  <b>DRILLING METHODS</b> Soil Drill: Hollow-stem auger Rock Drill: N/A		
765													
5							S1	GRAB					0.50
	760												
10		10.00 - 15.00 Sandy Silt, sands fine, brown, highly weathered, micaceous, low plastic, cohesive, dry.	ML		756.8	S2	GRAB			0.50	CETCO puregold – grout (70:30)		
755						10.00							
							S3	SPT	6-7-12	19		1.50 1.50	
15		15.00 - 20.00 Sandy Silt, sands fine, brown, highly weathered, micaceous, low plastic, cohesive, moist.	ML		751.8								
750						15.00							
							S4	SPT	9-25-25	50	1.50 1.50		
20		20.00 - 25.00 Sandy silt, sand f-m, brown to tan, highly weathered, micaceous, low-medium plasticity, cohesive, moist, sample spoon wet.	ML		746.8								
745						20.00							
							S5	SPT	6-10-14	24	1.16 1.50		
25		25.00 - 30.00 Saprolite, Sandy silt, sands fine to coarse, brown to tan, highly weathered, micaceous, low plastic, cohesive, moist, sample spoon wet.	ML		741.8								
740						25.00							
							S6	SPT	13-20-22	42	1.16 1.50		
30		30.00 - 35.00 Saprolite, Sandy silt, sands fine to coarse, trace pebbles, reddish brown to tan, highly weathered, micaceous, low plastic, cohesive, moist, sample spoon wet.	ML		736.8								
735						30.00							
							S7	SPT	7-10-13	23	1.00 1.50		
35		35.00 - 40.00 Saprolite, Sandy silt, sands fine to coarse, trace pebbles, reddish brown to tan, highly weathered, micaceous, low plastic, cohesive, moist, sample spoon wet.	ML		731.8								
730						35.00							
							S8	SPT	7-16-23	39	1.33 1.50		
40		40.00 - 45.00 Saprolite, Sandy silt, sands fine to medium, reddish brown to tan, highly weathered, micaceous, low plastic, cohesive, moist, sample spoon wet.	ML		726.8								
725						40.00							
							S9	SPT	12-15-18	33	1.16 1.50		
45		Log continued on next page			721.8						PEL-PLUG 3/8" – Bentonite pellets		

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Ben Hodges  
CHECKED BY: Timothy Richards, PG  
DATE: 1/16/18



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

# RECORD OF BOREHOLE DGWC-67/B-67


SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 56.00 ft  
LOCATION: West Toe of AP-1

DRILL RIG: Geoprobe  
DATE STARTED: 3/8/17  
DATE COMPLETED: 3/14/17

NORTHING: 1,390,953.80  
EASTING: 2,200,830.70  
GS ELEVATION: 766.80  
TOC ELEVATION: 766.70 ft

DEPTH W.L.: 9.1  
ELEVATION W.L.: 757.9  
DATE W.L.: 3/14/17  
TIME W.L.: 0850

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
45	720	45.00 - 50.00 Saprolite, silt and sand, sands fine to coarse, grey to brown, highly weathered, micaceous, low plastic, cohesive, moist, sample spoon wet.	ML		45.00							<b>WELL CASING</b> Interval: 0'-46.3' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 46.3'-56.3' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 44.0'-56.7' Type: FilterSil  <b>FILTER PACK SEAL</b> Interval: 44.0'-41.8' Type: PEL-PLUG 3/8" Bentonite pellets  <b>ANNULUS SEAL</b> Interval: 0'-41.8' Type: CETCO puregold grout (70:30)  <b>WELL COMPLETION</b> Pad: 4'x4' Concrete Protective Casing: 8" Round Flush Mount  <b>DRILLING METHODS</b> Soil Drill: Hollow-stem auger Rock Drill: N/A
					716.8	S10	SPT	50/4	50/4	0.33		
					50.00					0.33		
50	715	50.00 - 55.00 Saprolite, silt and sand, sands fine to coarse, trace pebbles, grey to dark brown, highly weathered, micaceous, non plastic, noncohesive, moist, sample spoon wet.	PWR		50.00							
					711.8	S11	SPT	50/2	50/2	0.16	.010" Slotted Schedule 40 - PVC	
					55.00					0.16		
55	710	55.00 - 56.00 Auger Refusal Boring completed at 56.00 ft	PWR		55.00 710.8							
60	705											
65	700											
70	695											
75	690											
80	685											
85	680											
90												

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Ben Hodges  
CHECKED BY: Timothy Richards, PG  
DATE: 1/16/18



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20



# RECORD OF BOREHOLE DGWC-68A/B-68A

SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 30.00 ft  
LOCATION: ~15' East of B-68

DRILL RIG: Geoprobe 7822DT  
DATE STARTED: 4/19/17  
DATE COMPLETED: 4/20/17

NORTHING: 1,391,301.20  
EASTING: 2,200,734.90  
GS ELEVATION: 765.06  
TOC ELEVATION: 765.33 ft

DEPTH W.L.: 18.8  
ELEVATION W.L.: 746.6  
DATE W.L.: 4/20/2017  
TIME W.L.: 08:48

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
0	765	0.00 - 8.50 SM, Silty SAND, fine to coarse, moderate plasticity; red-orange to orange-brown, fill; non-cohesive, moist, w~PL, loose.	SM								8" Diameter Round Flush Mount	<b>WELL CASING</b> Interval: 0' - 29.8' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 19.4' - 29.4' Material: Schedule 40 PVC pre-pack Diameter: 2" Slot Size: 0.010" End Cap: 29.4' - 29.8'  <b>FILTER PACK</b> Interval: 17.0' - 29.8' Type: FilterSil gravel pack  <b>FILTER PACK SEAL</b> Interval: 15.0' - 17.0' Type: Pel-Plug 3/8" Bentonite Pellets  <b>ANNULUS SEAL</b> Interval: 0' - 15.0' Type: Pure Gold Grout Mixture  <b>WELL COMPLETION</b> Pad: 4' x 4' concrete Protective Casing: 8" Diameter Round Flush Mount  <b>DRILLING METHODS</b> Soil Drill: 4.25-inch ID HSA Rock Drill: N/A
5	760											
10	755	8.50 - 13.50 CL, CLAY, with trace sand, moderate plasticity; red-orange brown, fill; cohesive, moist, w<PL, soft to firm.	CL		756.6 8.50	S1	DO	13-18-9	27	$\frac{1.50}{1.50}$	Pure Gold Grout Mixture	
15	750	13.50 - 28.50 ML, SILT, low plasticity; brown to silver, relict structure; cohesive, moist to wet, w<PL, very soft.			751.6 13.50	S2	DO	WOH-WOH-3	3	$\frac{1.50}{1.50}$	Pel-Plug 3/8" Bentonite Pellets	
20	745		ML			S3	DO	4-6-16	22	$\frac{1.33}{1.50}$		
25	740					S4	DO	WOH-16-24	40	$\frac{1.50}{1.50}$	Pre-pack 0.010" Slotted - Schedule 40 PVC	
30	735	28.50 - 30.00 SM, Silty SAND, fine to coarse, non-plastic to low plasticity; gray to white to silver, weathered saprolite, gneiss; cohesive, wet, w<PL, firm.  Boring completed at 30.00 ft	SM		736.6 28.50 735.1	S5	DO	13-50/5	50/5	$\frac{0.75}{0.92}$	FilterSil gravel pack	
35	730											
40	725											
45												

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 1/16/18



# RECORD OF BOREHOLE DGWC-69/B-69

SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 44.30 ft  
LOCATION: West Toe of AP-1

DRILL RIG: Geoprobe  
DATE STARTED: 3/15/17  
DATE COMPLETED: 3/16/17

NORTHING: 1,391,585.00  
EASTING: 2,200,657.10  
GS ELEVATION: 763.99  
TOC ELEVATION: 763.75 ft

DEPTH W.L.: 6.0  
ELEVATION W.L.: 758  
DATE W.L.: 3/17/17  
TIME W.L.: 0840

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
0		0.00 - 10.00 Hydrovac									Flush Mount Casing	<b>WELL CASING</b> Interval: 0'-14.3' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screen  <b>WELL SCREEN</b> Interval: 14.3'-24.3' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 12.0'-24.7' Type: FilterSil  <b>FILTER PACK SEAL</b> Interval: 10.0'-12.0' Type: PEL-PLUG 3/8" Bentonite pellets  <b>ANNULUS SEAL</b> Interval: 0'-10.0' Type: CETCO puregold grout (70:30)  <b>WELL COMPLETION</b> Pad: 4'x4' Concrete Protective Casing: 8" Round Flush  <b>DRILLING METHODS</b> Soil Drill: Hollow-stem auger Rock Drill: HQ Core Barrell
760											CETCO puregold grout (70:30)	
755												
10		10.00 - 24.90 Silty Sand, fine to coarse, banded grey and brown, highly weathered, noncohesive, moist, very dense, sample spoon wet			754 10.00						PEL-PLUG 3/8" Bentonite pellets	
750						S1	SPT	26-36-48	84	1.58 1.50		
15			SM								FilterSil	
745						S2	SPT	3-23-17	40	1.00 1.50		
20											.010" Slotted Schedule 40 - PVC	
740						S3	SPT	50/6	50/6	0.50 0.50		
25		24.90 - 44.30 Slightly weathered to fresh, moderate to strongly foliated, light to dark gray, fine to coarse grained, medium strong to strong, Sheared Gneiss (Long Island Creek).			739.1 24.90						FilterSil	
735												
30												
730			BR								PEL-PLUG 3/8" Bentonite pellets	
35												
725												
40												
720												
45		Boring completed at 44.30 ft			719.7							

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: Sean Denty

GA INSPECTOR: Ben Hodges  
CHECKED BY: Timothy Richards, PG  
DATE: 1/16/18



# RECORD OF BOREHOLE DGWC-121















SHEET 1 of 2

PROJECT: SCS Plant McDonough  
PROJECT NUMBER: GL166849621  
DRILLED DEPTH: 50.00 ft  
LOCATION: Smyrna, GA

DRILL RIG: Terra Sonic 150T  
Truck-Mounted Sonic  
DATE STARTED: 3/22/22  
DATE COMPLETED: 3/22/22

NORTHING: 1,390,739.7  
EASTING: 2,200,849.4  
GS ELEVATION: 764.52  
TOC ELEVATION: 764.16 ft

DEPTH W.L.: 9.4'  
ELEVATION W.L.: 755.12  
DATE W.L.: 3/22/22  
TIME W.L.: 19:25

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	PHOTO	REC		
0		0.00 - 8.00 Fill material							Aquaguard Grout	<b>WELL CASING</b> Interval: 0'-39.7' Material: Schedule 40 PVC Diameter: 2" Joint Type: Threaded  <b>WELL SCREEN</b> Interval: 39.7'-49.7' Material: 0.010" Slotted Diameter: 2" Slot Size: 0.010" End Cap: 3"  <b>FILTER PACK</b> Interval: 37.5'-49.7' Type: Filter Sil - Filtration sand and gravel, industrial quartz Quantity: 3.5 x 50 lb bag  <b>FILTER PACK SEAL</b> Interval: 34'-37.5' Type: Pel Plug Bentonite Pellets Quantity: 1 x 50 lb bucket  <b>ANNULUS SEAL</b> Interval: 0'-34' Type: Aquaguard bentonite grout Quantity: 2 bags Aquaguard + 40 gal water  <b>WELL COMPLETION</b> Pad: 4' x 4' Protective Casing: Aluminum  <b>DRILLING METHODS</b> Soil Drill: Sonic Rock Drill: Sonic Sample Type: Sonic
5	760				756.5	1		6.50 10.00		
		8.00 - 10.00 MH, CLAYEY SILT; very micaceous, little fine to coarse sand, brown/red brown, saprolitic, dry	MH		8.00 754.5					
10	755				10.00					
		10.00 - 20.00 ML, fine sandy SILT; very micaceous, little clay, brown to dark brown, saprolitic, crenulated, dry	ML			2		9.75 10.00		
15	750									
		20.00 - 29.50 SW-ML, fine SAND and SILT; very micaceous, little clay, dark brown to brown, iron staining, saprolitic, moist	SW-ML		744.5 20.00	3		9.75 10.00		
20	745									
		29.50 - 30.00 TWR, Transitionally Weathered Rock; muscovite schist	TWR		30.00					
25	740									
		30.00 - 40.00 TWR; fine to coarse gravel with fine sandy silt, little clay, friable, very micaceous, brown to dark brown, orange iron staining in soils, moist	TWR			4		9.75 10.00		
30	735									
		40.00 - 48.50 TWR; same as above	TWR		724.5 40.00	5		7.50 10.00		
35	730									
		48.50 - 50.00 muscovite SCHIST, fine to coarse grained, medium strong,			716.0 48.50 714.5					
40	725									
45	720									
50	715									

Log continued on next page

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Corey Franklin

GA INSPECTOR: Connor Mikilitus  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/10/22

**wsp** GOLDER

BOREHOLE RECORD PLANT MCDONOUGH\_DGWC-121, B-122D, B-123D.GPJ, PIEDMONT.GDT, 5/13/22

# RECORD OF BOREHOLE DGWC-121

SHEET 2 of 2

PROJECT: SCS Plant McDonough  
PROJECT NUMBER: GL166849621  
DRILLED DEPTH: 50.00 ft  
LOCATION: Smyrna, GA

DRILL RIG: Terra Sonic 150T  
Truck-Mounted Sonic  
DATE STARTED: 3/22/22  
DATE COMPLETED: 3/22/22

NORTHING: 1,390,739.7  
EASTING: 2,200,849.4  
GS ELEVATION: 764.52  
TOC ELEVATION: 764.16 ft

DEPTH W.L.: 9.4'  
ELEVATION  
W.L.: 755.12  
DATE W.L.: 3/22/22  
TIME W.L.: 19:25

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	PHOTO	REC		
50		slightly to moderately weathered, slightly to moderately fractured, some iron staining Boring completed at 50.00 ft								<b>WELL CASING</b> Interval: 0'-39.7' Material: Schedule 40 PVC Diameter: 2" Joint Type: Threaded  <b>WELL SCREEN</b> Interval: 39.7'-49.7' Material: 0.010" Slotted Diameter: 2" Slot Size: 0.010" End Cap: 3"  <b>FILTER PACK</b> Interval: 37.5'-49.7' Type: Filter Sil - Filtration sand and gravel, industrial quartz Quantity: 3.5 x 50 lb bag  <b>FILTER PACK SEAL</b> Interval: 34'-37.5' Type: Pel Plug Bentonite Pellets Quantity: 1 x 50 lb bucket  <b>ANNULUS SEAL</b> Interval: 0'-34' Type: Aquaguard bentonite grout Quantity: 2 bags Aquaguard + 40 gal water  <b>WELL COMPLETION</b> Pad: 4' x 4' Protective Casing: Aluminum  <b>DRILLING METHODS</b> Soil Drill: Sonic Rock Drill: Sonic Sample Type: Sonic
55	710									
60	705									
65	700									
70	695									
75	690									
80	685									
85	680									
90	675									
95	670									
100	665									

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Corey Franklin

GA INSPECTOR: Connor Mikilitus  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/10/22



BOREHOLE RECORD PLANT MCDONOUGH\_DGWC-121, B-122D, B-123D.GPJ PIEDMONT.GDT 5/13/22

# RECORD OF BOREHOLE B-62

SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 39.90 ft  
LOCATION: South of the Main road.

DRILL RIG: CME 55  
DATE STARTED: 10/4/16  
DATE COMPLETED: 10/4/16

NORTHING: 1,389,828.10  
EASTING: 2,201,811.20  
GS ELEVATION: 760.40  
TOC ELEVATION: 760.08 ft

DEPTH W.L.: 21.57  
ELEVATION W.L.: 738.83  
DATE W.L.: 10/6/2016  
TIME W.L.: 1000

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE			SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS	
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE			REC
					DEPTH (ft)							
0	760	0.00 - 13.50 Top 10' were Hydrovac for utilities.									CETCO puregold grout (70:30) — / aluminum casing	<b>WELL CASING</b> Interval: 0'-30' Material: Schedule 40 PVC Diameter: 2 Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 29.7'-39.7' Material: Schedule 40 PVC Diameter: 2 Slot Size: 0.010 End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 25.5'-40.1' Type: FilterSil  <b>FILTER PACK SEAL</b> Interval: 19.6'-25.5' Type: PEL-PLUG 3/8" Bentonite pellets  <b>ANNULUS SEAL</b> Interval: 0'-19.6' Type: CETCO puregold grout (70:30)  <b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 8" Round Ground Flush  <b>DRILLING METHODS</b> Soil Drill: Hollow-stem auger Rock Drill: HQ Core Barrell
5	755											
10	750											
15	745	13.50 - 18.50 SM, silty SAND, fine, low to moderate plasticity; red-brown; cohesive, wet, w~PL, very soft to soft.	SM		746.9 13.50	1	DO	3-1-3	4	1.00 1.50	CETCO puregold grout (70:30)	
20	740	18.50 - 23.50 CL, CLAY, trace silt and fine sand, moderate plasticity; red-brown; cohesive, moist to wet, w~PL, soft to firm.	CL		741.9 18.50	2	DO	1-1-1	2	1.50 1.50		
25	735	23.50 - 24.60 SP, poorly-graded SAND, fine to coarse, non plastic; gray to black; non-cohesive, wet, w<PL, very dense, PWR. Auger Refusal at 24.2  24.60 - 39.90 Bedrock; SCHIST fresh to slightly weathered, foliated, dark green to black, fine to medium grained.	SP		736.9 23.50 735.8 24.60	3	DO	50/4	50/4	0.16 0.33	PEL-PLUG 3/8" — Bentonite pellets	
30	730		BR								FilterSil —	
35	725											
40	720	Boring completed at 39.90 ft					720.5					
45												

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 12/22/17



# RECORD OF BOREHOLE B-100

SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 44.80 ft  
LOCATION: Smyrna, GA

DRILL RIG: CME 550X  
DATE STARTED: 7/8/20  
DATE COMPLETED: 7/8/20

NORTHING: 1,390,254.80  
EASTING: 2,202,242.10  
GS ELEVATION: 775.32  
TOC ELEVATION: 777.95 ft

DEPTH W.L.: 34.78  
ELEVATION W.L.: 743.17  
DATE W.L.: 7/8/20  
TIME W.L.: 15:50

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP SURVEY UPDATED (5).GPJ PIEDMONT.GDT 9/2/20

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES				MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS			
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE			REC		
					DEPTH (ft)									
0	775	0.00 - 11.00 SILT-SILTY GRAVEL; mix of topsoil, residuum, fill, rip-rap boulders, soil; clayey silt, red-brown, micaceous, moist, moderately weathered, non-cohesive, moist, (backfilled cuttings)	ML-GM			R1	AUGER				Bentonite Grout	<b>WELL CASING</b> Interval: 0'-44'8" Material: Schedule 40 PVC Diameter: 2" Joint Type: Screw fit with rubber seam  <b>WELL SCREEN</b> Interval: 34'8"-44'8" Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 32'2"-44'8" Type: Filtersil std61  <b>FILTER PACK SEAL</b> Interval: 30'-32'2" Type: 3/8" Coated Pel-Plug  <b>ANNULUS SEAL</b> Interval: 2'-30' Type: Aquagaurd Bentonite Grout  <b>WELL COMPLETION</b> Pad: 4'x4'x4" Protective Casing: Aluminum  <b>DRILLING METHODS</b> Soil Drill: Auger Rock Drill:		
5	770													0.00 11.00
10	765								764.3 11.00					
15	760	13.50 - 15.00 SILT; with sand, gravel and trace clay, red-brown, highly weathered, non-cohesive, dry to moist, loose to compact	ML		761.8 13.50 760.3 15.00	R2	SS	3-3-2		1.45 1.50				
20	755	18.50 - 20.00 SILTY SAND; heavy organic matter (wood), red-brown with black organic matter, moderately weathered, non-cohesive, dry, loose	SM		756.8 18.50 755.3 20.00	R3	SS	3-3-2		0.60 1.50				
25	750	23.50 - 25.00 CLAYEY SAND; some organic matter, brown, slightly weathered, cohesive, w<PL, soft	SC		751.8 23.50 750.3 25.00	R4	SS	2-1-2		1.60 1.50				
30	745	28.50 - 30.00 CLAYEY SAND WITH SILT; trace organic matter, brown with some red, micaceous, moderately weathered, cohesive, w>PL, firm to soft, moist to wet	SC-SM		746.8 28.50 745.3 30.00	R5	SS	1-2-1		1.50 1.50	Bentonite Pellets			
35	740	33.50 - 35.00 CLAYEY SAND; some silt, red with some brown, highly weathered trace mica, cohesive, w>PL, wet, soft to very soft, trace gravel	SC		741.8 33.50 740.3 35.00	R6	SS	WH-WH-2		1.40 1.50	Sand Filter Pack			
40		38.50 - 40.00 CLAYEY SAND; some gravel of gneiss (bottom 0.5'), black-brown with red, highly	SC		736.8 38.50 735.3	R7	SS	2-6-22		1.30 1.50	3" PVC 0.010			
		Log continued on next page												

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: SCS CFS  
DRILLER: S. Deuty

GA INSPECTOR: Chris Tidwell  
CHECKED BY: Brian Steele, PG  
DATE: 8/24/2020



# RECORD OF BOREHOLE B-100



SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 44.80 ft  
LOCATION: Smyrna, GA

DRILL RIG: CME 550X  
DATE STARTED: 7/8/20  
DATE COMPLETED: 7/8/20

NORTHING: 1,390,254.80  
EASTING: 2,202,242.10  
GS ELEVATION: 775.32  
TOC ELEVATION: 777.95 ft

DEPTH W.L.: 34.78  
ELEVATION W.L.: 743.17  
DATE W.L.: 7/8/20  
TIME W.L.: 15:50

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
40	735	weathered, non-cohesive, wet, loose to compact			40.00						Slot U-Pack Screen 	<b>WELL CASING</b> Interval: 0'-44'8" Material: Schedule 40 PVC Diameter: 2" Joint Type: Screw fit with rubber seam  <b>WELL SCREEN</b> Interval: 34'8"-44'8" Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 32'2"-44'8" Type: Filtersil std61  <b>FILTER PACK SEAL</b> Interval: 30'-32'2" Type: 3/8" Coated Pel-Plug  <b>ANNULUS SEAL</b> Interval: 2'-30' Type: Aquagard Bentonite Grout  <b>WELL COMPLETION</b> Pad: 4'x4'x4" Protective Casing: Aluminum  <b>DRILLING METHODS</b> Soil Drill: Auger Rock Drill:
		42.50 - 45.00 CLAYEY SAND; some gravel, red with black and brown, highly weathered, cohesive, w~PL, firm to soft, micaceous schist gravel	SC		732.8 42.50	R8	SS	4-5-12		0.00 1.50		
45	730	Boring completed at 44.80 ft			730.3 45.00							
50	725											
55	720											
60	715											
65	710											
70	705											
75	700											
80												

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: SCS CFS  
DRILLER: S. Deuty

GA INSPECTOR: Chris Tidwell  
CHECKED BY: Brian Steele, PG  
DATE: 8/24/2020



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 9/2/20



# RECORD OF BOREHOLE B-105D



SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 70.00 ft  
LOCATION: East of DGWC-40

DRILL RIG: Geoprobe 8140LC  
DATE STARTED: 10/18/20  
DATE COMPLETED: 10/19/20

NORTHING: 1390634.5  
EASTING: 2201831.9  
GS ELEVATION: 776.03 ft  
TOC ELEVATION: 779.01 ft

DEPTH W.L.: 22.50  
ELEVATION W.L.: 756.5  
DATE W.L.: 10/19/2020  
TIME W.L.: 0950

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS	
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	REC			
					DEPTH (ft)						
0		0.00 - 10.00 Air knife; FILL	FILL						Stick-up – 	<b>B-105D</b> Borehole Diameter: 4" <b>WELL CASING</b> Interval: 0'-70' Material: Schedule 40 PVC Diameter: 2" Joint Type: Screw fit with rubber seam <b>WELL SCREEN</b> Interval: 60'-70' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC <b>FILTER PACK</b> Interval: 57.5'-60.0' Type: FilterSil Quantity: 4-50 lbs bags <b>FILTER PACK SEAL</b> Interval: 53.75'-57.5' Type: 3/8" Uncoated Pel-Plug Quantity: 1-5 gallon bucket <b>ANNULUS SEAL</b> Interval: 0'-53.75' Type: AquaGuard Bentonite Grout Quantity: Approximately 80 gallons  <b>NOTES</b>	
5											
10		10.00 - 15.00 (ML), SILT; red to orange brown, some clay, low plasticity, dry to moist, w<PL, soft to firm, FILL			CL-ML	10.00					
15		15.00 - 27.00 (ML), SILT; olive brown to silvery brown, low plasticity, moist, firm, w<PL, contains muscovite		15.00	1	ROTO SONIC	9.25 10.00				
20			ML		2	ROTO SONIC	6.00 7.50				
25											
30		27.00 - 27.50 (CL), CLAY; white, medium plasticity, firm, moist, w<PL, possible WT	CL	27.50							
35		27.50 - 32.50 (ML), SILT; gray/brown, fine grain, low to medium plasticity, moist, w~PL, soft to firm	ML		3	ROTO SONIC	8.50 10.00				
40		32.50 - 33.80 (SM), SILTY SAND; non-plastic to low plasticity, dry to moist, fine to coarse, w<PL, loose, sand is mica (biotite/muscovite)	SM	32.50							
45		33.80 - 37.50 (ML), SILT; gray/brown, fine grain, low to moderate plasticity, moist, w~PL, soft to firm	ML	33.80							
50		37.50 - 40.00 (ML), SILT; whitish gray, trace fine sand, low plasticity, moist to dry, w~PL, firm/compact, high feldspar	ML	37.50	4	ROTO SONIC	2.50 2.50				
55		40.00 - 45.00 (SM), SILTY SAND; brown to black, non-plastic to low plasticity, moist, w<PL, fine to coarse, compact to loose. Sand particles size is mica, not quartz.	SM	40.00	5	ROTO SONIC	5.00 5.00				
60		45.00 - 50.00 (SM), SILTY SAND; rock flour, trace gravels, tan brown, non-plastic, dry, fine to coarse, w<PL, loose, sand is micaceous, transitions to TWR from 48.8'-50.0'	SM	45.00	6	ROTO SONIC	5.00 5.00				
65		Log continued on next page							AquaGuard Bentonite – Grout		

BOREHOLE RECORD MCDONOUGH MASTER LIST (2).GPJ PIEDMONT.GDT 2/3/21

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Fred Dorse

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/3/21





# RECORD OF BOREHOLE B-105D


SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 70.00 ft  
LOCATION: East of DGWC-40

DRILL RIG: Geoprobe 8140LC  
DATE STARTED: 10/18/20  
DATE COMPLETED: 10/19/20

NORTHING: 1390634.5  
EASTING: 2201831.9  
GS ELEVATION: 776.03 ft  
TOC ELEVATION: 779.01 ft

DEPTH W.L.: 22.50  
ELEVATION W.L.: 756.5  
DATE W.L.: 10/19/2020  
TIME W.L.: 0950

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	REC		
50		50.00 - 55.00 (SM), SILTY SAND; brown to black, low to medium plasticity, moist to dry, w<PL, loose/soft, materials is from gneiss (relief structure), TWR	SM		50.00	7	ROTO SONIC	5.00 5.00		<b>B-105D</b> Borehole Diameter: 4" <b>WELL CASING</b> Interval: 0'-70' Material: Schedule 40 PVC Diameter: 2" Joint Type: Screw fit with rubber seam <b>WELL SCREEN</b> Interval: 60'-70' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC <b>FILTER PACK</b> Interval: 57.5'-60.0' Type: FilterSil Quantity: 4-50 lbs bags <b>FILTER PACK SEAL</b> Interval: 53.75'-57.5' Type: 3/8" Uncoated Pel-Plug Quantity: 1-5 gallon bucket <b>ANNULUS SEAL</b> Interval: 0'-53.75' Type: AquaGuard Bentonite Grout Quantity: Approximately 80 gallons  <b>NOTES</b>
55		55.00 - 70.00 (GNEISS), BEDROCK; light to dark gray, fine to medium grain, well foliated, poorly jointed, fresh to slightly weathered, strong to medium strong	BR		55.00	8	ROTO SONIC	2.75 3.50		
60						9	ROTO SONIC	4.80 6.50		
65						10	ROTO SONIC	4.25 5.00		
70		Boring completed at 70.00 ft								
75										
80										
85										
90										
95										
100										

BOREHOLE RECORD MCDONOUGH MASTER LIST (2).GPJ | PIEDMONT.GDT 2/3/21

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Fred Dorse

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/3/21



# RECORD OF BOREHOLE B-112D











SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 166849621  
DRILLED DEPTH: 55.00 ft  
LOCATION: Offset of DGWC-69

DRILL RIG: TSi 150CC  
DATE STARTED: 3/21/21  
DATE COMPLETED: 3/22/21

NORTHING: 1,391,564.2  
EASTING: 2,200,664.1  
GS ELEVATION: 765.98  
TOC ELEVATION: 765.58 ft

DEPTH W.L.: 6.87  
ELEVATION W.L.: 758.71  
DATE W.L.: 4/12/2021  
TIME W.L.: 12:18

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			PIEZOMETER DIAGRAM and NOTES	PIEZOMETER CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	PHOTO	REC		
0	765	0.00 - 7.00 CL, Silty CLAY, low plasticity; red brown; soft, dry to moist, W<PL	CL						8" Flush Mount	<b>WELL CASING</b> Interval: 0-44.7' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 44.7-54.7' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: 54.7-55'  <b>FILTER PACK</b> Interval: 42.5-55' Type: #1 Filter Sand Quantity: 4-50 lbs bags  <b>FILTER PACK SEAL</b> Interval: 38.5-42.5' Type: 3/8" Uncoated Pel-Plug Quantity: 1 - 5 gallon bucket  <b>ANNULUS SEAL</b> Interval: 0-38.5' Type: AquaGuard Bentonite Grout Quantity: Approximately 80 gallons  <b>WELL COMPLETION</b> Pad: 4'x4'x4" Concrete Protective Casing: 8" Flush Mount  <b>DRILLING METHODS</b> Soil Drill: Rotosonic (6 inch casing by 4 inch core barrel) Rock Drill: Rotosonic Sample Type: Rotosonic
5	760	7.00 - 11.50 SP, SAND with trace silt and gravels, non-plasticity fine to coarse; blue-gray; soft to firm, moist, W<PL	SP		759.0 7.00		Hand Auger	0.00 10.00		
10	755	11.50 - 12.50 ML, Clayey SILT, low plasticity; brown to gray-brown; soft, moist, W<PL	ML		11.50 753.5					
15	750	12.50 - 16.00 SM, SILTY SAND, non to low plasticity; tan to brown to beige; loose to compact, dry, W<PL	SM		12.50 750.0	1		9.00 10.00	AquaGuard Grout	
20	745	16.00 - 20.00 TWR, Transitionally Weathered Rock; No recovery; Wash out; Driller noted the material was hard enough to drill with water (coring), but soft enough to wash away.	TWR		16.00 746.0					
25	740	20.00 - 30.00 Slightly to moderately weathered, well foliated, well jointed, light gray to gray, fine-medium grained, medium strong, quartz-feldspar-biotite GNEISS; locally contains vein quartz and augenized potassium feldspar (K-spar)	BR		20.00 736.0	2		3.80 10.00		
30	735	30.00 - 40.00 Fresh to slightly weathered, well foliated, poorly jointed, light gray to gray, fine-medium grained, weak to medium strong, quartz-feldspar-biotite GNEISS; locally contains epidote	BR		30.00 726.0	3		7.80 10.00	Bentonite Seal	
40		Log continued on next page								

BOREHOLE RECORD 166849621.GPJ PIEDMONT.GDT 5/24/21

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Tommy Ardito

INSPECTOR: Michael Boatman, PG  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/24/21



# RECORD OF BOREHOLE B-112D

SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 166849621  
DRILLED DEPTH: 55.00 ft  
LOCATION: Offset of DGWC-69

DRILL RIG: TS1 150CC  
DATE STARTED: 3/21/21  
DATE COMPLETED: 3/22/21

NORTHING: 1,391,564.2  
EASTING: 2,200,664.1  
GS ELEVATION: 765.98  
TOC ELEVATION: 765.58 ft

DEPTH W.L.: 6.87  
ELEVATION W.L.: 758.71  
DATE W.L.: 4/12/2021  
TIME W.L.: 12:18

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			PIEZOMETER DIAGRAM and NOTES	PIEZOMETER CONSTRUCTION DETAILS	
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	PHOTO	REC			
					DEPTH (ft)						
40	725	40.00 - 50.00 Fresh to moderately weathered, well foliated, poorly jointed, light gray to gray, fine-medium grained, weak to medium strong, quartz-feldspar-biotite GNEISS; locally contains vein quartz and water staining	BR		40.00	4		5.00 10.00	#1 Sand filter pack		<b>WELL CASING</b> Interval: 0-44.7' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 44.7-54.7' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: 54.7-55'  <b>FILTER PACK</b> Interval: 42.5-55' Type: #1 Filter Sand Quantity: 4-50 lbs bags  <b>FILTER PACK SEAL</b> Interval: 38.5-42.5' Type: 3/8" Uncoated Pel-Plug Quantity: 1 - 5 gallon bucket  <b>ANNULUS SEAL</b> Interval: 0-38.5' Type: AquaGuard Bentonite Grout Quantity: Approximately 80 gallons  <b>WELL COMPLETION</b> Pad: 4'x4'x4" Concrete Protective Casing: 8" Flush Mount  <b>DRILLING METHODS</b> Soil Drill: Rotosonic (6 inch casing by 4 inch core barrel) Rock Drill: Rotosonic Sample Type: Rotosonic
45	720										
50	715	50.00 - 55.00 Slightly to moderately weathered, well foliated, poorly jointed, light gray to gray, fine-medium grained, medium strong to strong, potassium feldspar, plagioclase, quartz-biotite GNEISS; locally contains epidote, pegmatitic vein quartz, and augened k-spar	BR		716.0 50.00	5		5.00 5.00	0.010" Slotted Schedule 40 PVC		
55	710	Boring completed at 55.00 ft			711.0				Sump		
60	705										
65	700										
70	695										
75	690										
80											

**WELL CASING**  
Interval: 0-44.7'  
Material: Schedule 40 PVC  
Diameter: 2"  
Joint Type: Flush/Screw

**WELL SCREEN**  
Interval: 44.7-54.7'  
Material: Schedule 40 PVC  
Diameter: 2"  
Slot Size: 0.010"  
End Cap: 54.7-55'

**FILTER PACK**  
Interval: 42.5-55'  
Type: #1 Filter Sand  
Quantity: 4-50 lbs bags

**FILTER PACK SEAL**  
Interval: 38.5-42.5'  
Type: 3/8" Uncoated Pel-Plug  
Quantity: 1 - 5 gallon bucket

**ANNULUS SEAL**  
Interval: 0-38.5'  
Type: AquaGuard Bentonite Grout  
Quantity: Approximately 80 gallons

**WELL COMPLETION**  
Pad: 4'x4'x4" Concrete  
Protective Casing: 8" Flush Mount

**DRILLING METHODS**  
Soil Drill: Rotosonic (6 inch casing by 4 inch core barrel)  
Rock Drill: Rotosonic  
Sample Type: Rotosonic

BOREHOLE RECORD 166849621.GPJ PIEDMONT.GDT 5/24/21

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Tommy Ardito

INSPECTOR: Michael Boatman, PG  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/24/21





# BORING LOG

**BORING B-02**

Page 1 of 3

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DATE STARTED 10/2/2012 COMPLETED 10/2/2012 GROUND ELEVATION 848.3 ft COORDINATES N 1393958 E 2202119.5

CONTRACTOR SCS Field Services METHOD 4.25" Hollow Stem Auger w/pilot bit; HQ Rock Core EQUIPMENT CME 550

DRILLED BY S. Denty LOGGED BY R. Tinsley CHECKED BY BORING DEPTH 54.4 ft.

GROUND WATER DEPTH: DURING 42 ft. COMP. DELAYED 27.8 ft. after 24 hrs.

NOTES Well installed. Refer to well data sheet.

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
5		<b>Silt (ML)</b> - Gravel surface with some vegetation.  - brown, medium stiff, SILT with mica and quartz fragments.  - CL-ML: dark red, stiff, SILT/CLAY; micaceous		SS -1	4.5	4-6-9 (15)		2.5YR.
10		- reddish brown, dry, medium stiff, SILT with mica and relict bedding.		SS -2	9.5	4-4-4 (8)		saprolite (gneiss).
15		- medium stiff, SAA with mica, quartz and feldspar; distinct banding		SS -3	14.5	2-3-3 (6)		saprolite.
20		- light yellowish brown, medium stiff, fine to coarse grain, SILT with mica, quartz, and feldspar		SS -4	19.5	1-3-2 (5)		saprolite; distinct color change from red to tan with micas.
25				SS	24.5	2-3-5		

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:43 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

(Continued Next Page)



# BORING LOG

**BORING B-02**

Page 2 of 3

**SOUTHERN COMPANY SERVICES, INC.**  
**EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING**

**PROJECT** Plant McDonough Hydrogeological Investigation

**LOCATION** Cobb County, GA

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:43 - \\VALTRCFP01\APARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		<b>Silt (ML)(con't)</b> - damp, medium stiff, SAA		-5		(8)		upper saprolite.
30		- gray and white, dry, very hard, SILT; gneiss saprolite		SS -6	29.5	6-15-25 (40)		lower saprolite.
35		- olive brown, very hard, SAA, more evidence of water (iron) staining; some black specks (manganese?)		SS -7	34.5	9-27-40 (67)		2.5Y.
40		- pale brown, dry, very hard, pulverized SILT with gneiss fragments		SS -8	39.5	50 (0)		10YR.
45		<b>Gneiss</b> - dark gray, hard, slightly weathered, augen gneiss with iron staining along partings. - extremely weathered and broken gneiss	804.2	RC -1	44.1			H2O on augers when pulled.
50		- gray, hard, slightly weathered, staining along vertical fractures		RC -2	49.4			
		- dark gray, weathered augen gneiss and mica schist with chlorite. Quartz layers at 50 ft, 52.8 ft and 54.1 ft.; Deformed and folded about 3 inches.						
		- Schist: hard, slightly weathered, with chlorite						

(Continued Next Page)



# BORING LOG

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING


PROJECT Plant McDonough Hydrogeological Investigation  
LOCATION Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
55		Bottom of borehole at 54.4 feet.	793.9					
60								
65								
70								
75								
80								

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:43 - \\VALTRCFP01\IAPARKER\$\DESKTOP\GPCMW LOGS - SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME					
Hydrogeologic Investigation		DRILLER: S. Denty							
LOCATION: Ash Pond		RIG TYPE: CME550		DGWA-2/B-2 DGWC-2					
LOGGER: Rhonda Tinsley		DRILLING METHODS: HS Auger/HQ Rock Core							
DATE CONSTRUCTED: 10/2/2012		N: 1393958 E:2202119.5							
				DEPTH FEET	ELEVATION FT, MSL				
				TOP OF RISER	-2.6	850.88			
				GROUND SURFACE	0.0	848.17			
				BOTTOM OF GROUT					
				BACKFILL MATERIAL TYPE: Portland cement/bentonite grout AMOUNT: 10 bags cement 4 lbs bentonite					
				RISER CASING DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded					
				TOP OF SEAL	31.0	817.2			
				ANNULAR SEAL TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 1.75 buckets PLACEMENT: Poured					
				TOP OF FILTER PACK	35.1	813.1			
				FILTER PACK TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 2.5 Bags PLACEMENT: Poured					
				BOTTOM OF RISER / TOP OF SCREEN	38.7	809.5			
				SCREEN DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch					
				BOTTOM OF SCREEN	48.7	799.5			
				BOTTOM OF CASING	49.0	799.2			
				HOLE DIA: 7 inch (auger) 3.8 inch (HQ core)					



# BORING LOG

**BORING B-04**

Page 1 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DATE STARTED 10/3/2012 COMPLETED 10/3/2012 GROUND ELEVATION 812.1 ft COORDINATES N 1394171.5 E 2202662.4

CONTRACTOR SCS Field Services METHOD 4.25" Hollow Stem Auger w/pilot bit EQUIPMENT CME 550

DRILLED BY S. Denty LOGGED BY R. Tinsley CHECKED BY BORING DEPTH 46 ft.

GROUND WATER DEPTH: DURING 23 ft. COMP. DELAYED 12.2 ft. after 24 hrs.

NOTES Well installed. Refer to well data sheet.

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
5		<b>Silt (ML)</b> - Thin topsoil with vegetation. - brown, SILT						
10		- yellowish brown, stiff, SILT saprolite, relic bedding prominent.		SS -1	4.5	3-3-6 (9)		10YR; upper saprolite.
15		- olive gray, medium stiff, SILT saprolite with fine to coarse-grained fragments.		SS -2	9.5	2-3-3 (6)		5YR; lower saprolite.
20		- damp, medium stiff, SAA		SS -3	14.5	2-2-4 (6)		
25		- wet, hard, SAA		SS -4	19.5	6-12-23 (35)		
				SS	24.5	6-11-12		WT @ 23'.

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:43 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

(Continued Next Page)





# BORING LOG

BORING B-04

Page 2 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		<b>Silt (ML)(con't)</b> - very stiff, SAA		-5		(23)		
30		- hard, SAA		SS -6	29.5	10-18-23 (41)		
35		- very stiff, SAA		SS -7	34.5	6-11-13 (24)		
40		- stiff, SAA		SS -8	39.5	5-6-5 (11)		
45		- hard, SAA	766.1	SS -9	44.5	25-45 (45)		
		Bottom of borehole at 46.0 feet.						
50								

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:43 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME					
Hydrogeologic Investigation		DRILLER: S. Denty							
LOCATION: Ash Pond		RIG TYPE: CME550		DGWC-4/B-4					
LOGGER: Rhonda Tinsley		DRILLING METHODS: HS Auger							
DATE CONSTRUCTED: 10/3/2012		N: 1394171.5 E:2202662.4							
				DEPTH FEET	ELEVATION FT, MSL				
<p>TOP OF RISER</p> <p>2" Threaded Riser Cap</p> <p>4 ft x 4 ft concrete pad</p> <p>GROUND SURFACE</p> <p><b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum</p> <p>BOTTOM OF GROUT</p> <p><b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 6 bags cement 9 lbs bentonite</p> <p><b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded</p> <p>TOP OF SEAL</p> <p><b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 2.25 buckets PLACEMENT: Poured</p> <p>TOP OF FILTER PACK</p> <p><b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 6.5 Bags PLACEMENT: Poured w/water</p> <p>BOTTOM OF RISER / TOP OF SCREEN</p> <p><b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch</p> <p>BOTTOM OF SCREEN</p> <p>Flush-threaded end cap</p> <p>BOTTOM OF CASING</p> <p>HOLE DIA: 7 inch</p>				-2.8	814.85				
								0.0	812.06



# BORING LOG

**BORING B-05**

Page 1 of 2

**SOUTHERN COMPANY SERVICES, INC.**  
**EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING**

**PROJECT** Plant McDonough Hydrogeological Investigation

**LOCATION** Cobb County, GA

**DATE STARTED** 10/3/2012 **COMPLETED** 10/4/2012 **GROUND ELEVATION** 788.7 ft **COORDINATES** N 1394306.3 E 2202965.1

**CONTRACTOR** SCS Field Services **METHOD** 4.25" Hollow Stem Auger w/pilot bit; HQ Rock Core **EQUIPMENT** CME 550

**DRILLED BY** S. Denty **LOGGED BY** R. Tinsley **CHECKED BY** **BORING DEPTH** 30 ft.

**GROUND WATER DEPTH: DURING** 16 ft. **COMP.** **DELAYED** 0 ft. after 100 hrs.

**NOTES** Well installed. Refer to well data sheet.

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:43 - \\VALTRCFP01\1APARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
5		<b>Silt (ML)</b> - reddish brown, SILT	784.2	SS -1	4.5	WH-WH-WH (0)		
10		<b>Silty Sand (SM)</b> - olive gray, damp, very loose, silty SAND to sandy SILT	779.2	SS -2	9.5	WH-WH-WH (0)		upper saprolite.
15		<b>Silt (ML)</b> - yellowish to light brown, damp, very soft, SILT with mica (gneiss)		SS -3	14.5	2-2-4 (6)		lower saprolite.
20		- greenish gray, wet, medium stiff, sandy SILT saprolite with relic structure (gneiss).		SS -4	19.5	1-2-3 (5)		lower saprolite.
25		- medium stiff, SAA		SS	24.5	50		
		- very hard, SAA; slightly less weathered.						

(Continued Next Page)



# BORING LOG

BORING B-05

Page 2 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

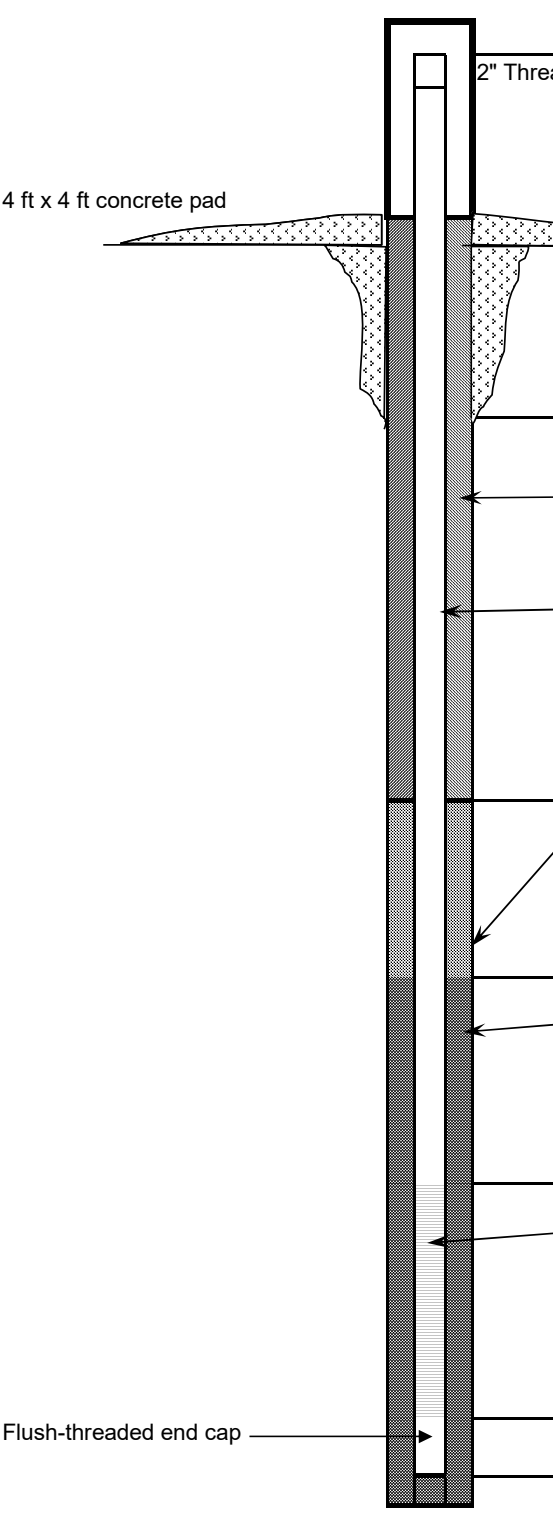
PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
30		<b>Gneiss</b> - black (biotite) and white, hard, slightly weathered, AUGEN GNEISS with water staining along foliations (approx. 45 degrees).	763.3	-5 RC -1	24.9	(0)		lower saprolite.
		Bottom of borehole at 30.0 feet.						
35								
40								
45								
50								

# WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME		
Hydrogeologic Investigation		DRILLER: S. Denty				
LOCATION: Ash Pond		RIG TYPE: CME550		DGWC-5/B-5		
LOGGER: Rhonda Tinsley		DRILLING METHODS: HS Auger/HQ Rock Core				
DATE CONSTRUCTED: 10/4/2012		N: 1394306.3 E:2202965.1				
				DEPTH FEET	ELEVATION FT, MSL	
				TOP OF RISER	-3.0	791.75
				2" Threaded Riser Cap		
4 ft x 4 ft concrete pad				GROUND SURFACE	0.0	788.64
<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum				BOTTOM OF GROUT		
<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 5 bags cement 7 lbs bentonite						
<b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded						
				TOP OF SEAL	12.0	776.6
<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 2 buckets PLACEMENT: Tremie				TOP OF FILTER PACK	16.0	772.6
<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 1.5 Bags PLACEMENT: Tremie						
				BOTTOM OF RISER / TOP OF SCREEN	19.7	768.9
<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch						
				BOTTOM OF SCREEN	29.7	758.9
Flush-threaded end cap				BOTTOM OF CASING	30.0	758.6
HOLE DIA: 7 inch (auger) 3.8 inch (HQ core)						



# BORING LOG

**BORING B-08**

Page 1 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DATE STARTED 10/10/2012 COMPLETED 10/10/2012 GROUND ELEVATION 824.1 ft COORDINATES N 1394322.2 E 2203882.1

CONTRACTOR SCS Field Services METHOD 4.25" Hollow Stem Auger w/pilot bit EQUIPMENT CME 550

DRILLED BY S. Denty LOGGED BY G. Dyer CHECKED BY BORING DEPTH 49.1 ft.

GROUND WATER DEPTH: DURING COMP. DELAYED 17.04 ft. after 18 hrs.

NOTES Well installed. Refer to well data sheet.

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
5		<b>Silt (ML)</b>  - tan-brown, dry, very soft, clayey SILT; micaceous; contains little quartz sand, no relic structures; 85% silt, 10% clay, 5% sand		SS -1	4.5	WH-WH-WH (0)		residual soil.
10		- tan to reddish brown, dry, medium stiff, clayey SILT; contains mica flakes and trace quartz sand; higher iron content and soil bonding; no relic structures		SS -2	9.5	3-3-5 (8)		residual soil.
15		- red-brown, damp, soft, clayey SILT; micaceous; contains trace of schist-derived gravel; higher clay percent, more plastic		SS -3	14.5	WH-1-2 (3)		residual soil.
20		- olive brown with black streaks and white layer, damp, very stiff, sandy SILT with clay; very micaceous; highly weathered original structure; contains sand and gravel derived from gneiss and a white bleached quartz lense		SS -4	19.5	20-16-10 (26)		transition to upper saprolite and higher moisture content.
25				SS	24.5	5-7-6		

GEOTECH ENGINEERING LOGS - ESEE DATABASE: GDT - 8/26/20 20:44 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

(Continued Next Page)



# BORING LOG

**BORING B-08**

Page 2 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		<b>Silt (ML)(con't)</b> - stiff, SAA; more coarse-grained sediment; coarse material is angular; less competent than above; some highly weathered relict structure		-5		(13)		starting to get H2O return to surface.
30		- very hard, SAA; more competent; rock fragments less weathered		SS -6	29.5	9-10-50 (60)		transition to lower saprolite.
35		- brown-black, damp, hard, gravelly SILT; contains highly to partially weathered relict gneiss fragments; micaceous; contains manganese streaks		SS -7	34.5	5-15-18 (33)		less weathered rock; again becoming partially weathered.
40		- brown black, damp, very hard, sandy SILT with gravel; contains black manganese, red iron and weathered quartz zones; less gneissic gravel than above; micaceous		SS -8	39.5	11-12-50 (62)		fewer rock fragments.
45		<b>Silty Gravel (GM)</b> - brown, tan and black, damp, very dense, silty GRAVEL; predominately weathered to partially weathered gneiss fragments	779.6	SS -9	44.5	17-50 (50)		transitioning to partially weathered rock.
			775.0					
50		Bottom of borehole at 49.1 feet.						

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRC\FP01\1\APARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME	
Hydrogeologic Investigation		DRILLER: S. Denty			
LOCATION: Ash Pond		RIG TYPE: CME550		DGWC-8/B-8	
LOGGER: Greg Dyer		DRILLING METHODS: HS Auger			
DATE CONSTRUCTED: 10/10/2012		N: 1394322.2 E:2203882.1			
				DEPTH FEET	ELEVATION FT, MSL
TOP OF RISER				-2.3	826.38
2" Threaded Riser Cap					
4 ft x 4 ft concrete pad					
GROUND SURFACE				0.0	824.02
<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum  BOTTOM OF GROUT					
<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 6.25 bags cement 9 lbs bentonite  <b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded  TOP OF SEAL				34.8	789.2
<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 1 bucket PLACEMENT: Tremie w/water  TOP OF FILTER PACK				36.8	787.2
<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 7 Bags PLACEMENT: Poured w/water  BOTTOM OF RISER / TOP OF SCREEN				38.7	785.3
<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch  BOTTOM OF SCREEN				48.7	775.3
Flush-threaded end cap					
BOTTOM OF CASING				49.1	774.9
HOLE DIA: 7 inch					





# BORING LOG

**BORING B-09**

Page 1 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DATE STARTED 10/10/2012 COMPLETED 10/10/2012 GROUND ELEVATION 821.8 ft COORDINATES N 1394055.9 E 2204170

CONTRACTOR SCS Field Services METHOD 4.25" Hollow Stem Auger w/pilot bit EQUIPMENT CME 550

DRILLED BY S. Denty LOGGED BY G. Dyer CHECKED BY BORING DEPTH 30.1 ft.

GROUND WATER DEPTH: DURING COMP. DELAYED 7.2 ft. after 15 hrs.

NOTES Well installed. Refer to well data sheet.

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		<b>Silt (ML)</b>						no residual soil; low area previously excavated..
5		- red-brown, dry, stiff, fine SILT; relic schistose structures; soil is bonded and moderately competent but rubs to fine silt or clay		SS -1	4.5	4-6-9 (15)		upper saprolite.
10		- brown-tan, dry, very stiff, gravelly SILT; relic schistose or gneissic structure; rock fragments are more competent; rubs to fine silt with clay; contains manganese nodules and iron staining		SS -2	9.5	4-9-9 (18)		transition to lower saprolite.
15		- very stiff, SAA		SS -3	14.5	6-10-12 (22)		lower saprolite.
20		- very hard, SAA		SS -4	19.5	16-34-32 (66)		lower saprolite.
25		<b>Silty Gravel (GM)</b>	797.3	SS	24.5	51-15-25		

(Continued Next Page)

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ



# BORING LOG

BORING B-09

Page 2 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

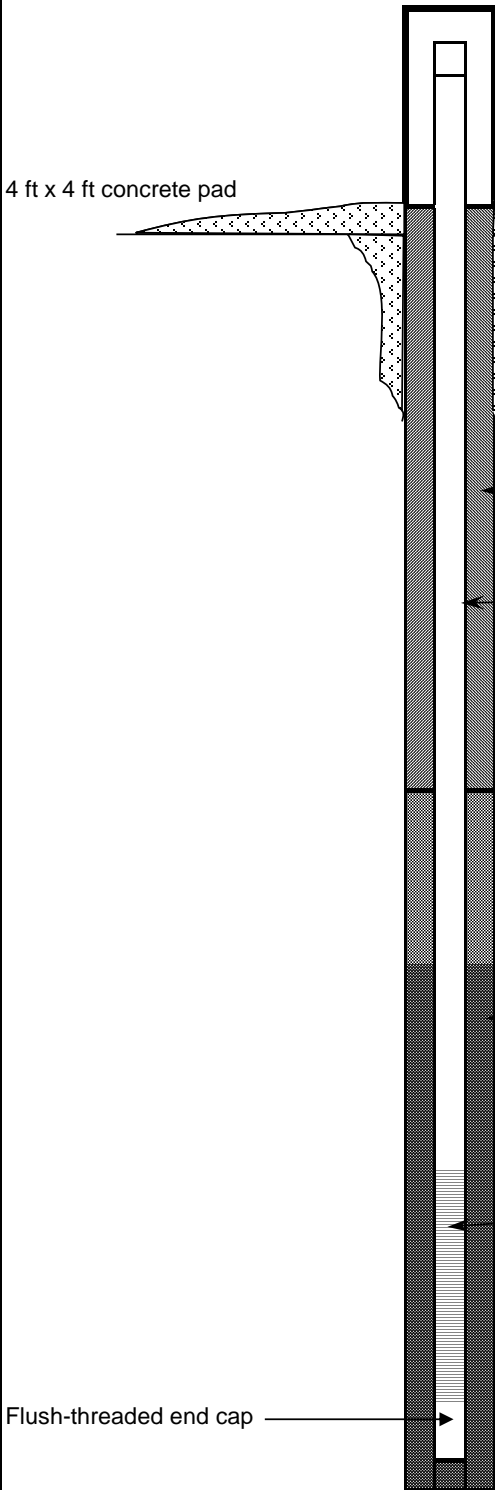
DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
30		<b>Silty Gravel (GM)</b> (con't) - brown-black, damp, hard, silty GRAVEL; contains few rock fragments; crumbles to gravelly silt to silty gravel; manganese staining	791.7	-5		(40)		H2O return when pulling augers.
		- very hard, partially weathered rock; schist fragments; crumbles to gravel with minor silt; micaceous		SS -6	29.5	50 (0)		
		Bottom of borehole at 30.1 feet.						
35								
40								
45								
50								

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME	
Hydrogeologic Investigation		DRILLER: S. Denty			
LOCATION: Ash Pond		RIG TYPE: CME550		DGWC-9/ B-9	
LOGGER: Greg Dyer		DRILLING METHODS: HS Auger			
DATE CONSTRUCTED: 10/10/2012		N: 1394055.9 E:2204170.0			
				DEPTH	ELEVATION
				FEET	FT, MSL
TOP OF RISER				-3.1	824.35
2" Threaded Riser Cap					
GROUND SURFACE				0.0	821.86
PROTECTIVE CASING SIZE: 4" x 4" TYPE: aluminum					
BOTTOM OF GROUT					
BACKFILL MATERIAL TYPE: Portland cement/bentonite grout AMOUNT: 5 bags cement 7 lbs bentonite					
RISER CASING DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded					
TOP OF SEAL				15.0	806.9
ANNULAR SEAL TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 1 bucket PLACEMENT: Poured					
TOP OF FILTER PACK				17.5	804.4
FILTER PACK TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 7 Bags PLACEMENT: Poured w/water					
BOTTOM OF RISER / TOP OF SCREEN				19.6	802.3
SCREEN DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch					
BOTTOM OF SCREEN				29.6	792.3
BOTTOM OF CASING				30.0	791.9



4 ft x 4 ft concrete pad

PROTECTIVE CASING  
SIZE: 4" x 4"  
TYPE: aluminum

BACKFILL MATERIAL  
TYPE: Portland cement/bentonite grout  
AMOUNT: 5 bags cement  
7 lbs bentonite

RISER CASING  
DIA: 2 inch  
TYPE: Schedule 40 PVC  
JOINT TYPE: Flush Threaded

ANNULAR SEAL  
TYPE: PelPlug TR-30 3/8"  
bentonite pellets; 5-gallon buckets  
AMOUNT: 1 bucket  
PLACEMENT: Poured

FILTER PACK  
TYPE: Filtersil #61  
Size 1A; 50 lbs/bag  
AMOUNT: 7 Bags  
PLACEMENT: Poured w/water

SCREEN  
DIA: 2" prepack (3.45" OD)  
TYPE: Schedule 40 PVC  
OPENING WIDTH: 0.01 inch  
OPENING TYPE: Slotted  
SLOT SPACING: 0.1 inch

Flush-threaded end cap

HOLE DIA: 7 inch



# BORING LOG

**BORING B-10**

Page 1 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DATE STARTED 10/11/2012 COMPLETED 10/11/2012 GROUND ELEVATION 820.9 ft COORDINATES N 1393818.3 E 2204201.1

CONTRACTOR SCS Field Services METHOD 4.25" Hollow Stem Auger w/pilot bit EQUIPMENT CME 550

DRILLED BY S. Denty LOGGED BY G. Dyer CHECKED BY BORING DEPTH 46 ft.

GROUND WATER DEPTH: DURING COMP. DELAYED

NOTES Well installed. Refer to well data sheet.

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
5		<b>Silt (ML)</b>  - red to red-brown, soft, fine SILT with clay; sparse mica flakes; few angular to sub-angular quartz grains; soil is moderately well bonded		SS -1	4.5	2-2-2 (4)		residual soil.
10		- tan-brown with black streaks, dry, medium stiff, fine SILT with fine to medium-grained sand and gravel; contains few quartz gravels and highly weathered mica; rubs to silt and fine to medium-grained sand; manganese staining		SS -2	9.5	2-4-4 (8)		residual soil.
15		- stiff, SAA; less sand and gravel; better cemented/bonded		SS -3	14.5	3-4-5 (9)		
20		- medium stiff, SAA; softer		SS -4	19.5	1-2-4 (6)		
25				SS	24.5	2-3-4		

GEOTECH ENGINEERING LOGS - ESEE DATABASE: GDT - 8/26/20 20:44 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

(Continued Next Page)



# BORING LOG

**BORING B-10**  
Page 2 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		<b>Silt (ML)(con't)</b> - very damp, medium stiff, SAA		-5		(7)		
30		- stiff, SAA; contains highly weathered schist fragments		SS -6	29.5	4-5-5 (10)		upper saprolite.
35		- brown, very damp, very stiff, gravelly SILT with clay; contains highly weathered schist fragments; samples crumble and rub to clayey silt.		SS -7	34.5	7-8-9 (17)		upper saprolite.
40		- hard, SAA; more rock fragments; less weathered		SS -8	39.5	6-12-16 (28)		lower saprolite.
45		- wet, hard, gravelly SILT; prevalent relict structures	774.9	SS -9	44.5			lower saprolite.
		Bottom of borehole at 46.0 feet.						
50								

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\ALTRCFP01\LPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough	DRILLING CO.: SCS Field Services	WELL NAME
Hydrogeologic Investigation	DRILLER: S. Denty	
LOCATION: Ash Pond	RIG TYPE: CME550	DGWC-10/B-10
LOGGER: Greg Dyer	DRILLING METHODS: HS Auger	
DATE CONSTRUCTED: 10/11/2012	N: 1393818.3 E:2204201.1	

	DEPTH FEET	ELEVATION FT, MSL
TOP OF RISER	-2.6	823.55
2" Threaded Riser Cap		
4 ft x 4 ft concrete pad		
GROUND SURFACE	0.0	820.82
<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum		
BOTTOM OF GROUT		
<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 6 bags cement 9 lbs bentonite		
<b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded		
TOP OF SEAL	29.8	791.0
<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 1 bucket PLACEMENT: Poured		
TOP OF FILTER PACK	32.1	788.7
<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 6.75 Bags PLACEMENT: Poured w/water		
BOTTOM OF RISER / TOP OF SCREEN	35.0	785.8
<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch		
BOTTOM OF SCREEN	45.0	775.8
Flush-threaded end cap		
BOTTOM OF CASING	45.4	775.4
HOLE DIA: 7 inch		



# BORING LOG

**BORING B-11**

Page 1 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DATE STARTED 10/15/2012 COMPLETED 10/15/2012 GROUND ELEVATION 798.1 ft COORDINATES N 1393547.1 E 2204166.2

CONTRACTOR SCS Field Services METHOD 4.25" Hollow Stem Auger w/pilot bit EQUIPMENT CME 550

DRILLED BY S. Denty LOGGED BY C. Sellers CHECKED BY \_\_\_\_\_ BORING DEPTH 51 ft.

GROUND WATER DEPTH: DURING 25 ft. COMP. \_\_\_\_\_ DELAYED \_\_\_\_\_

NOTES Well installed. Refer to well data sheet.

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
5		Silt (ML)  - brownish red, medium stiff, fine SILT with clay; micaceous; slightly bonded		SS -1	4.5	2-3-4 (7)		
10		- brownish red, very stiff, fine SILT with clay; very micaceous; 10% clay		SS -2	9.5	12-12-15 (27)		
15		- damp, stiff, SAA; 20% clay; contains small schist gravel		SS -3	14.5	5-6-6 (12)		
20		- tan, damp, stiff, SAA		SS -4	19.5	4-5-7 (12)		
25				SS	24.5	5-8-11		

(Continued Next Page)



# BORING LOG

**BORING B-11**  
Page 2 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		<b>Silt (ML)(con't)</b> - light tan, wet, very stiff, SAA; contains fine sand and small schist fragments		-5		(19)		
30		- stiff, SAA		SS -6	29.5	5-6-8 (14)		
35		- very stiff, SAA		SS -7	34.5	6-8-14 (22)		
40		- hard, SAA		SS -8	39.5	12-20-25 (45)		
45		- gray, very hard, SAA; contains schist gravel throughout		SS -9	44.5	26-50 (50)		
50		- dark gray, very hard, SAA		SS -10	49.5	50 (0)		
			747.1					
		Bottom of borehole at 51.0 feet.						

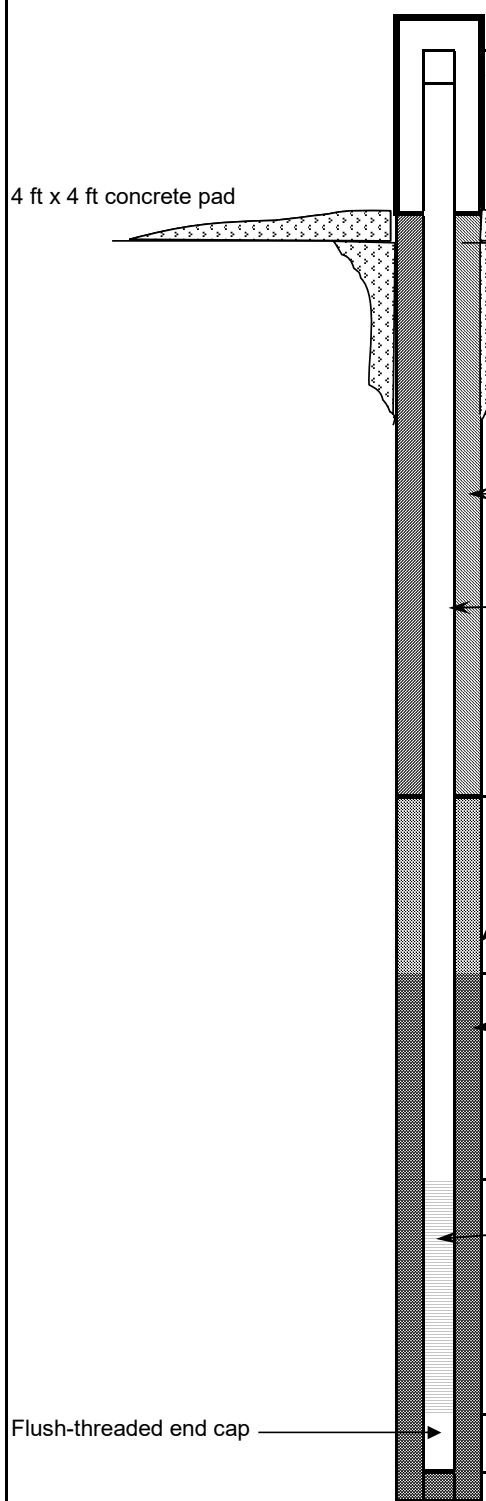
GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRCFP01\1\APARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ



## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME	
Hydrogeologic Investigation		DRILLER: S. Denty			
LOCATION: Ash Pond		RIG TYPE: CME550		DGWC-11/B-11	
LOGGER: C. Sellers/K. Byrd		DRILLING METHODS: HS Auger			
DATE CONSTRUCTED: 10/15/2012		N: 1393547.1 E:2204166.2			
				DEPTH FEET	ELEVATION FT, MSL
TOP OF RISER				-2.5	800.57
2" Threaded Riser Cap					
GROUND SURFACE				0.0	797.99
PROTECTIVE CASING SIZE: 4" x 4" TYPE: aluminum					
BOTTOM OF GROUT					
BACKFILL MATERIAL TYPE: Portland cement/bentonite grout AMOUNT: 7 bags cement 10.5 lbs bentonite					
RISER CASING DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded					
TOP OF SEAL				33.9	764.1
ANNULAR SEAL TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 1 bucket PLACEMENT: Tremie					
TOP OF FILTER PACK				36.2	761.8
FILTER PACK TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 7 Bags PLACEMENT: Tremie					
BOTTOM OF RISER / TOP OF SCREEN				38.8	759.2
SCREEN DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch					
BOTTOM OF SCREEN				48.8	749.2
BOTTOM OF CASING				49.1	748.9



4 ft x 4 ft concrete pad

PROTECTIVE CASING  
SIZE: 4" x 4"  
TYPE: aluminum

BACKFILL MATERIAL  
TYPE: Portland cement/bentonite  
grout  
AMOUNT: 7 bags cement  
10.5 lbs bentonite

RISER CASING  
DIA: 2 inch  
TYPE: Schedule 40 PVC  
JOINT TYPE: Flush Threaded

ANNULAR SEAL  
TYPE: PelPlug TR-30 3/8"  
bentonite pellets; 5-gallon buckets  
AMOUNT: 1 bucket  
PLACEMENT: Tremie

FILTER PACK  
TYPE: Filtersil #61  
Size 1A; 50 lbs/bag  
AMOUNT: 7 Bags  
PLACEMENT: Tremie

SCREEN  
DIA: 2" prepack (3.45" OD)  
TYPE: Schedule 40 PVC  
OPENING WIDTH: 0.01 inch  
OPENING TYPE: Slotted  
SLOT SPACING: 0.1 inch

Flush-threaded end cap

HOLE DIA: 7 inch



# BORING LOG

**BORING B-12**

Page 1 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DATE STARTED 10/15/2012 COMPLETED 10/15/2012 GROUND ELEVATION 771.2 ft COORDINATES N 1393149.4 E 2204128.3

CONTRACTOR SCS Field Services METHOD 4.25" Hollow Stem Auger w/pilot bit EQUIPMENT CME 550

DRILLED BY S. Denty LOGGED BY K. Byrd CHECKED BY BORING DEPTH 26 ft.

GROUND WATER DEPTH: DURING 9 ft. COMP. DELAYED

NOTES Well installed. Refer to well data sheet.

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
5		<b>Silt (ML)</b>  - brown/tan, damp, soft, SILT with some clay; micaceous		SS -1	4.5	1-2-2 (4)		
				UD -1	7.0			
10		<b>Lean Clay (CL)</b> - red/orange/light brown, wet, very soft, CLAY; contains sparse mica and fine sand grains	761.7	SS -2	9.5	WH-WH-WH (0)		
15		<b>Silt (ML)</b> - yellowish orange, wet, medium stiff, sandy SILT; very fine-grained	756.7	SS -3	14.5	WH-WH-7 (7)		
20		- light to olive gray, wet, very stiff, SILT; micaceous; contains heavily weathered schist fragments		SS -4	19.5	6-11-8 (19)		
25			746.2	SS	24.5	2-2-3		

(Continued Next Page)



# BORING LOG

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation  
LOCATION Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		- yellowish orange, damp, medium stiff, clayey SILT; micaceous		-5		(5)		

Bottom of borehole at 26.0 feet.

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRCFP01\IAPARKER\$\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

# WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME	
Hydrogeologic Investigation		DRILLER: S. Denty			
LOCATION: Ash Pond		RIG TYPE: CME550		DGWC-12/B-12	
LOGGER: Kinsey Byrd		DRILLING METHODS: HS Auger			
DATE CONSTRUCTED: 10/15/2012		N: 1393149.4 E:2204128.3			
				DEPTH FEET	ELEVATION FT, MSL
TOP OF RISER				-2.7	773.86
2" Threaded Riser Cap					
GROUND SURFACE				0.0	771.10
<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum					
BOTTOM OF GROUT					
<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 4 bags cement 6 lbs bentonite					
<b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded					
TOP OF SEAL				10.2	760.9
<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 1 bucket PLACEMENT: Tremie					
TOP OF FILTER PACK				12.6	758.5
<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 2.5 Bags; 50 lbs/bag PLACEMENT: Tremie					
BOTTOM OF RISER / TOP OF SCREEN				14.7	756.4
<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch					
BOTTOM OF SCREEN				24.7	746.4
Flush-threaded end cap					
BOTTOM OF CASING				25.1	746.0
HOLE DIA: 7 inch					



# BORING LOG

**BORING B-13**

Page 1 of 2

**SOUTHERN COMPANY SERVICES, INC.**  
**EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING**

**PROJECT** Plant McDonough Hydrogeological Investigation

**LOCATION** Cobb County, GA

**DATE STARTED** 11/27/2012 **COMPLETED** 11/27/2012 **GROUND ELEVATION** 791.3 ft **COORDINATES** N 1392881.1 E 2204084.6

**CONTRACTOR** SCS Field Services **METHOD** 4.25" Hollow Stem Auger w/pilot bit **EQUIPMENT** CME 550

**DRILLED BY** S. Denty **LOGGED BY** G. Dyer **CHECKED BY**  **BORING DEPTH** 46 ft.

**GROUND WATER DEPTH: DURING**  **COMP.**  **DELAYED** 26.73 ft. after 36 hrs.

**NOTES** Well installed. Refer to well data sheet.

GEOTECH ENGINEERING LOGS - ESEE DATABASE: GDT - 8/26/20 20:44 - \VALTRCFP01\APARKER\DESKTOP\GPCMW LOGS SURVEY UPDATED.GPJ

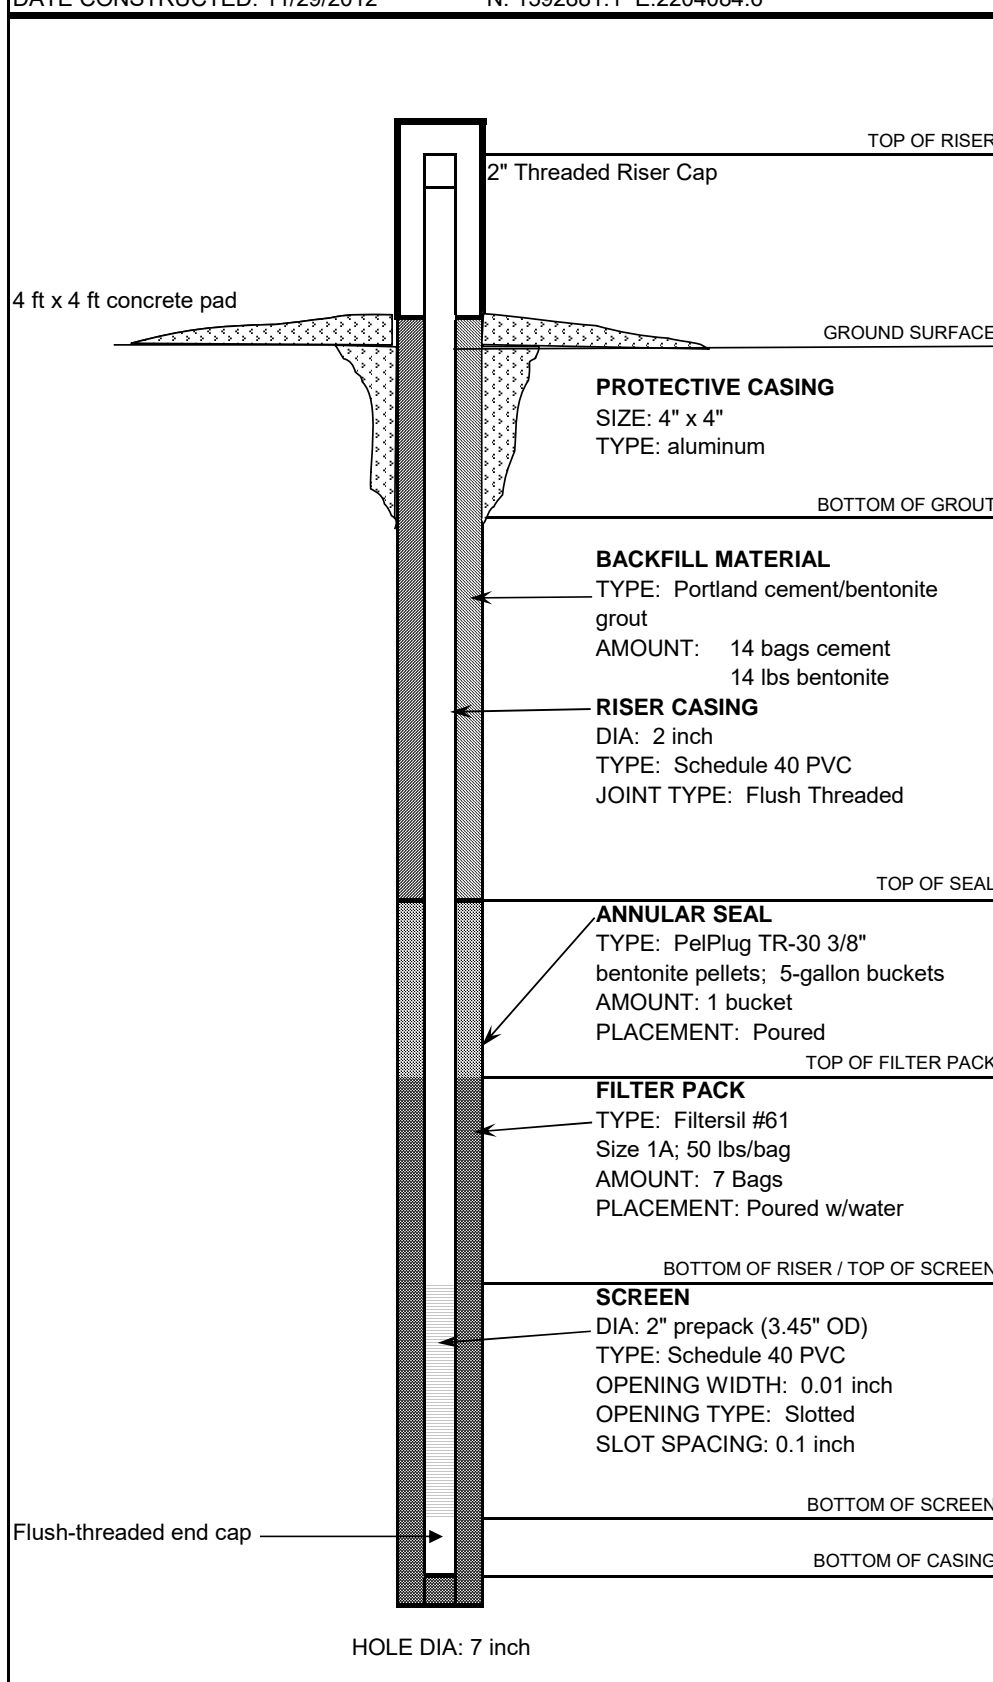
DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
0		- Vacuum excavation from 0 ft to 9.0 ft						
5								
10			781.8	SS -1	9.5	21-50 (50)		
15		- mottled tan, brown and red with black manganese staining, dry, very hard, clayey SILT; saprolite		SS -2	14.5	18-30-50 (80)		
20		- damp, hard, SAA		SS -3	19.5	6-14-26 (40)		
25				SS	24.5	12-22-31		

(Continued Next Page)

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\ALTRCFP01\LAPARKER\$\DESKTOP\GPC\IMW LOGS SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME		
Hydrogeologic Investigation		DRILLER: S. Denty				
LOCATION: Ash Pond		RIG TYPE: CME550		DGWC-13/B-13		
LOGGER: Greg Dyer		DRILLING METHODS: HS Auger				
DATE CONSTRUCTED: 11/29/2012		N: 1392881.1 E:2204084.6				
				DEPTH FEET	ELEVATION FT, MSL	
				TOP OF RISER	-2.8	794.10
				2" Threaded Riser Cap		
4 ft x 4 ft concrete pad						
GROUND SURFACE				0.0	791.20	
<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum						
BOTTOM OF GROUT						
<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 14 bags cement 14 lbs bentonite						
<b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded						
TOP OF SEAL				29.0	762.2	
<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 1 bucket PLACEMENT: Poured						
TOP OF FILTER PACK				31.2	760.0	
<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 7 Bags PLACEMENT: Poured w/water						
BOTTOM OF RISER / TOP OF SCREEN				33.4	757.8	
<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch						
BOTTOM OF SCREEN				43.4	747.8	
Flush-threaded end cap						
BOTTOM OF CASING				43.8	747.4	
HOLE DIA: 7 inch						



# BORING LOG

**BORING B-14**

Page 1 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DATE STARTED 12/18/2012 COMPLETED 12/18/2012 GROUND ELEVATION 789.8 ft COORDINATES N 1392574.2 E 2204013.3

CONTRACTOR SCS Field Services METHOD 4.25" Hollow Stem Auger w/pilot bit; HQ Rock Core EQUIPMENT CME 550

DRILLED BY T. Milam LOGGED BY G. Dyer CHECKED BY BORING DEPTH 34.3 ft.

GROUND WATER DEPTH: DURING COMP. DELAYED

NOTES Well installed. Refer to well data sheet.

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
0		- Vacuum excavation from 0 ft to 9.0 ft						
5								
10		<b>Silt (ML)</b> - tan with green and red-orange mottling, damp, soft, SILT; trace of schistose bedding; trace schist fragments; slightly micaceous and quartzose	780.8	SS -1	9.5	1-2-2 (4)		residual soil.  upper saprolite.
15		- brown and tan-red, dry, hard, SILT; consolidated and slightly hard; relict schistose bedding; trace schist fragments		SS -2	14.5	9-15-21 (36)		lower saprolite.
20		<b>Silty Gravel (GM)</b> - brown, tan and silver, dry, very hard, SAPROCK; predominately schist fragments; moderately weathered	770.3	SS -3	19.5	16-50 (50)		saprock/pwr.
25		- SAA; softer zone from 23' to 24'						
		<b>Schist</b>	765.5	SS	24.5	50		

(Continued Next Page)





# BORING LOG

BORING B-14

Page 2 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
..... ..... ..... 30 ..... ..... ..... .....		- green, silver, black and white, BUTTON MICA SCHIST; heavily fractured; iron-staining; quartz banding; sheared foliations <b>Schist(con't)</b> - gray, silver and black, SCHIST; fractured; iron staining; feldspar augens; shear foliation less common  - green, silver, black and white, BUTTON MICA SCHIST; heavily fractured; prevalent iron-staining; feldspar augens; sheared  - gray, MYLONITE; micaceous; slightly to moderately fractured; pyrite observed	758.9   755.5	4		(0)		prevalent iron-staining and manganese oxides.  black dike or mylonite cross-cuts schist @ 45 degrees at 27.5'.
35 ..... ..... ..... 40 ..... ..... ..... 45 ..... ..... ..... 50 ..... ..... ..... .....		Bottom of borehole at 34.3 feet.						

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME	
Hydrogeologic Investigation		DRILLER: T. Milam			
LOCATION: Ash Pond		RIG TYPE: CME550		DGWC-14/B-14	
LOGGER: Greg Dyer		DRILLING METHODS: HS Auger/HQ Rock Core			
DATE CONSTRUCTED: 12/18/2012		N: 1392574.2 E:2204013.3			
			DEPTH FEET	ELEVATION FT, MSL	
			TOP OF RISER	-2.6	792.40
			2" Threaded Riser Cap		
4 ft x 4 ft concrete pad			GROUND SURFACE	0.0	789.69
			<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum		
			BOTTOM OF GROUT		
			<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 24 bags cement 30 lbs bentonite		
			<b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded		
			TOP OF SEAL	12.5	777.2
			<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 1/4" bentonite pellets; 5-gallon buckets AMOUNT: 0.75 bucket PLACEMENT: Poured/tremie pipe		
			TOP OF FILTER PACK	15.5	774.2
			<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 2 Bags PLACEMENT: poured w/water		
			BOTTOM OF RISER / TOP OF SCREEN	23.9	765.8
			<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch		
			BOTTOM OF SCREEN	33.9	755.8
Flush-threaded end cap			BOTTOM OF CASING	34.3	755.4



# BORING LOG

**BORING B-15**

Page 1 of 3

**SOUTHERN COMPANY SERVICES, INC.**  
**EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING**

**PROJECT** Plant McDonough Hydrogeological Investigation

**LOCATION** Cobb County, GA

**DATE STARTED** 11/29/2012 **COMPLETED** 11/29/2012 **GROUND ELEVATION** 821.5 ft **COORDINATES** N 1392544.1 E 2203679

**CONTRACTOR** SCS Field Services **METHOD** 4.25" Hollow Stem Auger w/pilot bit **EQUIPMENT** CME 550

**DRILLED BY** S. Denty **LOGGED BY** G. Dyer **CHECKED BY**  **BORING DEPTH** 67.2 ft.

**GROUND WATER DEPTH: DURING**  **COMP.**  **DELAYED**

**NOTES** Well installed. Refer to well data sheet.

GEOTECH ENGINEERING LOGS - ESEE DATABASE: GDT - 8/26/20 20:44 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
0		- Vacuum excavation from 0 ft to 9.0 ft						
5								
10		<b>Silt (ML)</b> - tan-red, dry, soft, SILT; about 3% clay; few schistose rock fragments; slightly micaceous	812.5	SS -1	9.5	2-1-2 (3)		residual soil.
15		- light tan, dry, medium stiff, SILT; homogeneous silt (no clay or sand); slightly micaceous; trae gneiss fragments near base of sample		SS -2	14.5	2-3-4 (7)		residual soil.
20		- gray to brown, dry, very hard, crumbles to sandy SILT; saprolite; fragmented soil largely consistent of moderately to highly weathered rock		SS -3	19.5	19-35-38 (73)		
25				SS	24.5	14-24-27		

(Continued Next Page)



# BORING LOG

**BORING B-15**

Page 2 of 3

**SOUTHERN COMPANY SERVICES, INC.**  
**EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING**

**PROJECT** Plant McDonough Hydrogeological Investigation

**LOCATION** Cobb County, GA

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \VALTRCFP01\1APARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
29.5		<b>Silt (ML)(con't)</b> - green to dark tan, dry, very hard, crumbles to SILT with fine sand; relict schitose structure; lacks competent schist fragments; micaceous; trace quartz sand (about 5%)		SS -4		(51)		lower saprolite.
30		- tan to gray with black manganese, dry, hard, crumbles to sandy SILT; relict schistosity; more prevalent quartz (about 10%); slightly micaceous		SS -5	29.5	14-25-22 (47)		lower saprolite.
35		- olive green, tan and silver, dry, hard, crumbles to SILT with schist derived gravel; large mica flakes; trace fine quartz sand		SS -6	34.5	12-20-16 (36)		lower saprolite.
40		- olive green, tan and silver, moist, very hard, crumbles to SILT with clay; very micaceous; relict schitose structure; moderately weathered schist fragments		SS -7	39.5	14-36-50 (86)		lower saprolite.
45		<b>Silty Gravel (GM)</b> - olive green, tan and black, moist, very hard, crumbles to silty GRAVEL; less weathered schist fragments	777.0	SS -8	44.5	50 (0)		transition from saprolite to saprock.
50		<b>Silt (ML)</b> - olive to dark green and silver, damp, hard, crumbles to SILT with gravel and clay; relict schist structure and fragments	772.0	SS -9	49.5	14-21-26 (47)		lower saprolite.

(Continued Next Page)



# BORING LOG

BORING B-15

Page 3 of 3

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

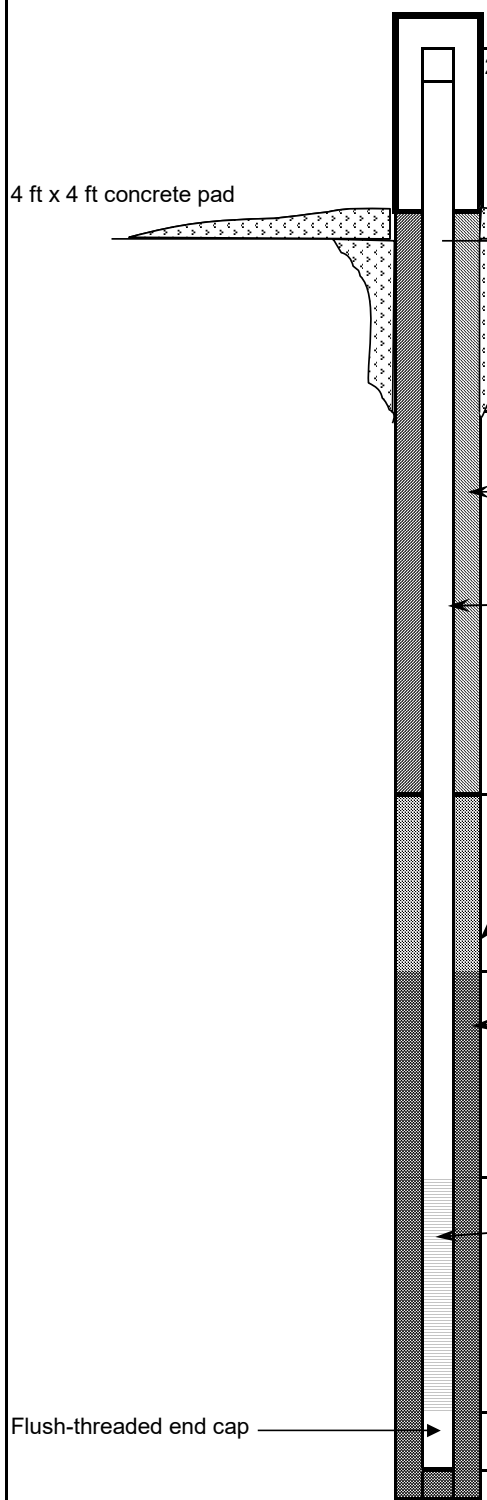
LOCATION Cobb County, GA

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
55		<b>Silty Gravel (GM)</b> - dark green and black, damp, very hard, weathered schist GRAVEL	767.0	SS -10	54.5	50 (0)		more competent saprock.
60		- very hard, SAA; damp to dry		SS -11	59.5	50 (0)		
65		- very hard, SAA		SS -12	64.5	50 (0)		
			754.3					
		Bottom of borehole at 67.2 feet.						
70								
75								
80								

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS - SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME		
Hydrogeologic Investigation		DRILLER: S. Denty				
LOCATION: Ash Pond		RIG TYPE: CME550		DGWC-15/B-15		
LOGGER: Greg Dyer		DRILLING METHODS: HS Auger				
DATE CONSTRUCTED: 11/29/2012		N: 1392544.1 E:2203679.0				
				DEPTH FEET	ELEVATION FT, MSL	
				TOP OF RISER	-3.0	824.50
				2" Threaded Riser Cap		
4 ft x 4 ft concrete pad				GROUND SURFACE	0.0	821.43
<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum				BOTTOM OF GROUT		
<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 13 bags cement 17.5 lbs bentonite						
<b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded				TOP OF SEAL	52.4	769.0
<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 1 bucket PLACEMENT: Poured				TOP OF FILTER PACK	54.5	766.9
<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 7 Bags PLACEMENT: Poured w/water				BOTTOM OF RISER / TOP OF SCREEN	56.7	764.7
<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch				BOTTOM OF SCREEN	66.7	754.7
Flush-threaded end cap				BOTTOM OF CASING	67.1	754.3
HOLE DIA: 7 inch						



# BORING LOG

**BORING B-16**

Page 1 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DATE STARTED 12/19/2012 COMPLETED 12/19/2012 GROUND ELEVATION 823.6 ft COORDINATES N 1392595.1 E 2203315.4

CONTRACTOR SCS Field Services METHOD 4.25" Hollow Stem Auger w/pilot bit EQUIPMENT CME 550

DRILLED BY T. Milam LOGGED BY G. Dyer CHECKED BY BORING DEPTH 46 ft.

GROUND WATER DEPTH: DURING COMP. DELAYED

NOTES Well installed. Refer to well data sheet.

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
0		- Vacuum excavation from 0 ft to 9 ft						
5								
10		<b>Silt (ML)</b> - tan and brown, dry, stiff, SILT; slightly micaceous; trace manganese oxides	814.6	SS -1	9.5	3-4-5 (9)		residual soil.
15		- tan, brown and orange, dry, medium stiff, sandy SILT; sand is fine to very fine-grained; slightly micaceous; trace schistosity		SS -2	14.5	3-3-5 (8)		residual soil.
20		- light tan to brown, dry, medium stiff, SILT with clay (about 10%); clay is slightly plastic; slightly micaceous; trace schistose gravel; trace manganese oxide		SS -3	19.5	3-3-3 (6)		residual soil.
25				SS	24.5	2-3-3		

(Continued Next Page)



# BORING LOG

BORING B-16

Page 2 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		<b>Silt (ML)(con't)</b> - medium stiff, SAA; silt more elastic		4		(6)		
30		- mottled tan, brown and black, moist, stiff, SILT; saprolite like relict structures; micaceous; weathered schistose foliations; trace gravel; trace manganese oxides		SS -5	29.5	7-5-6 (11)		upper saprolite.
35		- wet, stiff, SAA		SS -6	34.5	6-5-5 (10)		
40		- wet, stiff, SAA; more schist gravel and slightly less weathered		SS -7	39.5	5-6-5 (11)		
45		- wet, very stiff, SAA; slightly less weathered trend	777.6	SS -8	44.5	5-9-8 (17)		
		Bottom of borehole at 46.0 feet.						
50								

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \VALTRCFP01\APARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ



## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME	
Hydrogeologic Investigation		DRILLER: T. Milam			
LOCATION: Ash Pond		RIG TYPE: CME550		DGWC-16/ B-16	
LOGGER: Greg Dyer		DRILLING METHODS: HS Auger			
DATE CONSTRUCTED: 12/19/2012		N: 1392595.1 E:2203315.4			
				DEPTH FEET	ELEVATION FT, MSL
TOP OF RISER				-2.9	826.47
2" Threaded Riser Cap					
GROUND SURFACE				0.0	823.54
<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum					
BOTTOM OF GROUT					
<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 5.5 bags cement 8 lbs bentonite					
<b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded					
TOP OF SEAL				26.5	797.0
<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 0.75 bucket PLACEMENT: Poured					
TOP OF FILTER PACK				29.2	794.3
<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 4.5 Bag PLACEMENT: Poured w/water					
BOTTOM OF RISER / TOP OF SCREEN				33.4	790.1
<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch					
BOTTOM OF SCREEN				43.4	780.1
BOTTOM OF CASING				43.7	779.8
HOLE DIA: 7 inch					



# BORING LOG

**BORING B-17**

Page 1 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DATE STARTED 1/9/2012 COMPLETED 1/9/2012 GROUND ELEVATION 834.2 ft COORDINATES N 1392645.6 E 2203051

CONTRACTOR SCS Field Services METHOD 4.25" Hollow Stem Auger w/pilot bit EQUIPMENT CME 550

DRILLED BY S. Denty LOGGED BY G. Dyer CHECKED BY \_\_\_\_\_ BORING DEPTH 46 ft.

GROUND WATER DEPTH: DURING \_\_\_\_\_ COMP. \_\_\_\_\_ DELAYED \_\_\_\_\_

NOTES Well installed. Refer to well data sheet.

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
5		- Vacuum excavation from 0 ft to 15.0 ft						
10								
15			819.2	SS -1	15.0	2-2-3 (5)		residual soil.
20		<b>Silt (ML)</b> - brown to brown tan, damp, medium stiff, SILT with fine sand and clay; micaceous; contains black manganese oxides; trace quartz sand		SS -2	19.5	4-6-9 (15)		upper saprolite.
25		- brown, damp, stiff, SILT with clay; highly weathered relict structure; micaceous; trace manganese oxides		SS	24.5	3-5-6		

(Continued Next Page)



# BORING LOG

BORING B-17

Page 2 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation


LOCATION Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		<b>Silt (ML)(con't)</b> - tan and green, damp, stiff, highly weathered relic structure; micaceous		-3		(11)		upper saprolite.
30		- green to mottled green, black, yellow and tan, wet, stiff, SILT with fine sand; trace unweathered quartz gravel within weathered relic structure; heavy manganese oxide staining; micaceous		SS -4	29.5	2-3-6 (9)		upper saprolite.
35		- wet, stiff, SAA; more cemented; trace pyrite in/around weathered zones		SS -5	34.5	4-6-9 (15)		
40		- dark green and tan, very moist, very hard, SILT with gravel; micaceous; quartz sand; relict structures intact; trace manganese oxides; highly to slightly weathered schist fragments		SS -6	39.5	19-50 (50)		lower saprolite.
45		- green-gray, very moist, hard, SILT with clay; micaceous; trace quartz sand; relict structures but highly weathered; black manganese oxides	788.2	SS -7	44.5	16-19-20 (39)		lower saprolite.
		Bottom of borehole at 46.0 feet.						
50								

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\ALTRCFP01\1\APARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME			
Hydrogeologic Investigation		DRILLER: S. Denty					
LOCATION: Ash Pond		RIG TYPE: CME550		DGWC-17/B-17			
LOGGER: Greg Dyer		DRILLING METHODS: HS Auger					
DATE CONSTRUCTED: 1/9/2013		N: 1392645.6 E:2203051.0					
				DEPTH FEET	ELEVATION FT, MSL		
				TOP OF RISER	-2.8	837.05	
				2" Threaded Riser Cap			
				GROUND SURFACE		0.0	834.14
				<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum			
				BOTTOM OF GROUT			
				<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 20 bags cement 30.5 lbs bentonite			
				<b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded			
				TOP OF SEAL		30.0	804.1
				<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 1/4" bentonite pellets; 5-gallon buckets AMOUNT: 1 bucket PLACEMENT: Poured			
				TOP OF FILTER PACK		32.0	802.1
				<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 0.5 Bag filter pac 6.25 bag hole PLACEMENT: Poured w/water			
				BOTTOM OF RISER / TOP OF SCREEN		34.2	799.9
				<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch			
				BOTTOM OF SCREEN		44.2	789.9
				Flush-threaded end cap			
BOTTOM OF CASING		44.5	789.6				
HOLE DIA: 7 inch							



# BORING LOG

**BORING B-18**

Page 1 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DATE STARTED 1/9/2012 COMPLETED 1/9/2012 GROUND ELEVATION 823.9 ft COORDINATES N 1392521 E 2202875.5

CONTRACTOR SCS Field Services METHOD 4.25" Hollow Stem Auger w/pilot bit EQUIPMENT CME 550

DRILLED BY S. Denty LOGGED BY G. Dyer CHECKED BY \_\_\_\_\_ BORING DEPTH 31 ft.

GROUND WATER DEPTH: DURING \_\_\_\_\_ COMP. \_\_\_\_\_ DELAYED 11 ft. after 24 hrs.

NOTES Well installed. Refer to well data sheet.

GEOTECH ENGINEERING LOGS - ESEE DATABASE: GDT - 8/26/20 20:44 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
0		- Vacuum excavation from 0 ft to 18.0 ft						
5								
10								
15								
20		<b>Silt (ML)</b>  - tan-orange, wet, medium stiff, SILT with clay; trace quartz gravel; mica flakes; trace relict structures but highly weathered	805.9	SS -1	19.5	2-3-5 (8)		residual soil-upper saprolite transition.
25				SS	24.5	3-5-6		

(Continued Next Page)



# BORING LOG

**BORING B-18**  
Page 2 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		<b>Silt (ML)(con't)</b> - mottled tan, green, gray and black, very moist, stiff, SILT; highly weathered relict structures; prevalent manganese oxides; trace gravel and clay		-2		(11)		residual soil-upper saprolite transition.
30		- more tan-gray, soft, SAA	SS -3	29.5	1-2-2 (4)			
			792.9					

Bottom of borehole at 31.0 feet.

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME			
Hydrogeologic Investigation		DRILLER: S. Denty					
LOCATION: Ash Pond		RIG TYPE: CME550		DGWC-18/ B-18			
LOGGER: Greg Dyer		DRILLING METHODS: HS Auger					
DATE CONSTRUCTED: 1/9-10/2013		N: 1392521 E:2202875.5					
				DEPTH FEET	ELEVATION FT, MSL		
<p>4 ft x 4 ft concrete pad</p> <p>2" Threaded Riser Cap</p> <p>GROUND SURFACE</p> <p><b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum</p> <p><b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 28 bags cement 42 lbs bentonite</p> <p><b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded</p> <p><b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 1/4" bentonite pellets; 5-gallon buckets AMOUNT: 1 bucket PLACEMENT: Poured</p> <p><b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 0.5 Bag filter pac 5.5 bags hole PLACEMENT: Poured w/water</p> <p><b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch</p> <p>Flush-threaded end cap</p> <p>HOLE DIA: 7 inch</p>				TOP OF RISER	-2.7	826.56	
				GROUND SURFACE	0.0	823.89	
				BOTTOM OF GROUT			
				TOP OF SEAL		18.0	805.9
				TOP OF FILTER PACK		19.2	804.7
				BOTTOM OF RISER / TOP OF SCREEN		22.4	801.5
				BOTTOM OF SCREEN		32.4	791.5
				BOTTOM OF CASING		32.6	791.3



# BORING LOG

**BORING B-19**

Page 1 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DATE STARTED 3/12/2013 COMPLETED 3/12/2013 GROUND ELEVATION 822.9 ft COORDINATES N 1392342.6 E 2202601

CONTRACTOR SCS Field Services METHOD 4.25" Hollow Stem Auger w/pilot bit EQUIPMENT CME 550

DRILLED BY S. Denty LOGGED BY B. Gallagher CHECKED BY BORING DEPTH 41 ft.

GROUND WATER DEPTH: DURING COMP. 28 ft. DELAYED

NOTES Well installed. Refer to well data sheet.

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
5		Fill (ML) - SILT						
10		Silt (ML)  - olive, tan, moist, medium stiff, SILT with fine sand and clay; micaceous; with iron oxide staining	816.9	SS -1	10.0	5-4-4 (8)		Vaccum excavation from 0 ft to 10 ft. Soil identified based on observation during vacuum excavation.
15		- wet, medium stiff		SS -2	14.5	2-3-3 (6)		residual soil.
20		- moist, very stiff, more iron oxide staining below 19 ft		SS -3	19.5	2-4-6 (10)		
25				SS	24.5	3-3-4		

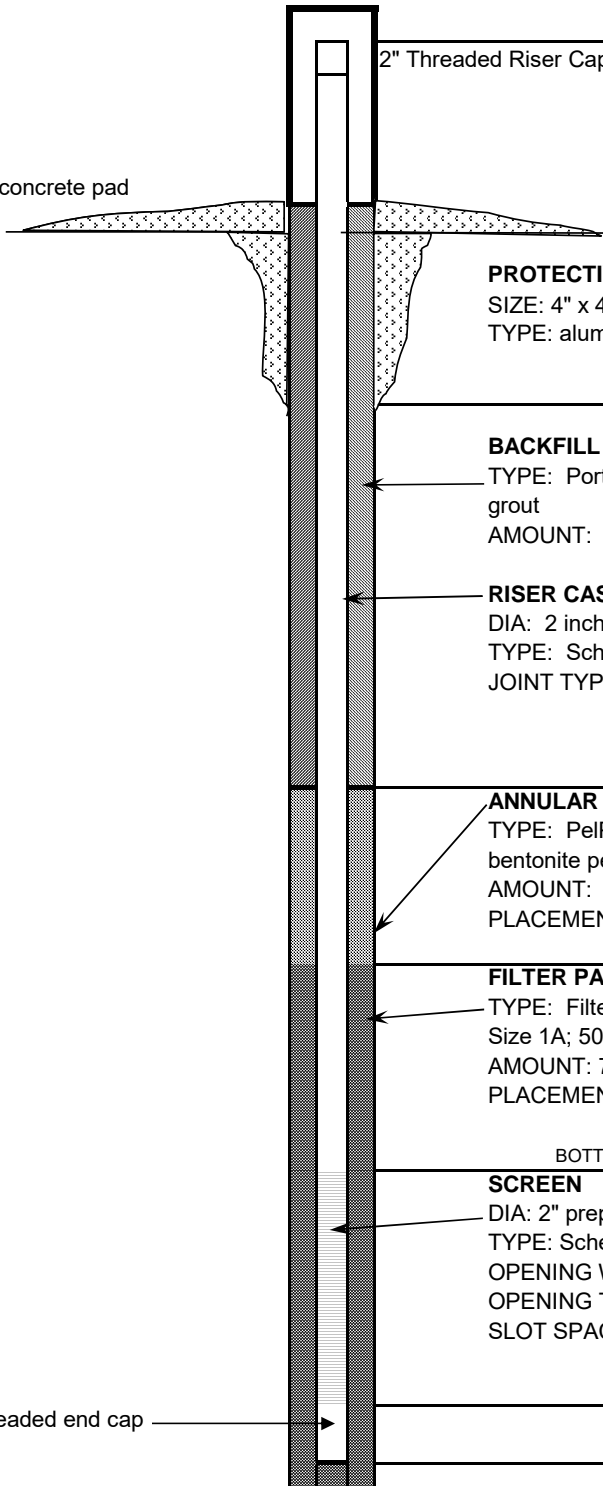
(Continued Next Page)



GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\ALTRCF01\LAPARKER\$\DESKTOP\GPC\MW LOGS SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME				
Hydrogeologic Investigation		DRILLER: S. Denty						
LOCATION: Ash Pond 3		RIG TYPE: CME550		DGWC-19/B-19				
LOGGER: B. Gallagher		DRILLING METHODS: HS Auger						
DATE CONSTRUCTED: 3/12/2013		N: 1392342.6 E:2202601.0						
				DEPTH FEET	ELEVATION FT, MSL			
				TOP OF RISER	-2.6	825.46		
				2" Threaded Riser Cap				
				4 ft x 4 ft concrete pad		GROUND SURFACE	0.0	822.87
				<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum		BOTTOM OF GROUT		
				<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 16 bags cement 23 lbs bentonite				
				<b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded		TOP OF SEAL	24.7	798.2
				<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 1/4" bentonite pellets; 5-gallon buckets AMOUNT: 1 bucket PLACEMENT: Poured		TOP OF FILTER PACK	27.2	795.7
				<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 7 Bags PLACEMENT: Tremie		BOTTOM OF RISER / TOP OF SCREEN	29.4	793.5
				<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch		BOTTOM OF SCREEN	39.4	783.5
				Flush-threaded end cap		BOTTOM OF CASING	39.8	783.1
				HOLE DIA: 7 inch				



# BORING LOG

**BORING B-20**

Page 1 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DATE STARTED 3/4/2012 COMPLETED 3/4/2012 GROUND ELEVATION 819.8 ft COORDINATES N 1392164.5 E 2202315.6

CONTRACTOR SCS Field Services METHOD 4.25" Hollow Stem Auger w/pilot bit EQUIPMENT CME 550

DRILLED BY S. Denty LOGGED BY R. Tinsley CHECKED BY BORING DEPTH 41 ft.

GROUND WATER DEPTH: DURING 2 ft. COMP. DELAYED

NOTES Well installed. Refer to well data sheet.

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
0								
5								
10								
10			809.8	SS -1	10.0	2-2-5 (7)		
15				SS -2	14.5	4-4-5 (9)		
20				SS -3	19.5	4-7-9 (16)		
25				SS	24.5	4-6-8		

(Continued Next Page)



# BORING LOG

BORING B-20

Page 2 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		<b>Silt (ML)(con't)</b> - olive green, stiff, SAA		-4		(14)		
30		- stiff, SAA		SS -5	29.5	6-9-10 (19)		
35		- stiff, SAA with heavy staining		SS -6	34.5	3-4-5 (9)		
40		- SAA	778.8	SS -7	39.5	5-7-7 (14)		
		Bottom of borehole at 41.0 feet.						
45								
50								

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRCFP01\LPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME	
Hydrogeologic Investigation		DRILLER: S. Denty			
LOCATION: Ash Pond		RIG TYPE: CME550		DGWC-20/B-20	
LOGGER: Rhonda Tinsley		DRILLING METHODS: HS Auger			
DATE CONSTRUCTED: 3/5/2013		N: 1392164.5 E:2202315.6			
				DEPTH FEET	ELEVATION FT, MSL
TOP OF RISER				-2.3	822.14
2" Threaded Riser Cap					
4 ft x 4 ft concrete pad					
GROUND SURFACE				0.0	819.66
<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum					
BOTTOM OF GROUT					
<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 9 bags cement 12 lbs bentonite					
<b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded					
TOP OF SEAL				24.7	795.0
<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 1 bucket PLACEMENT: Poured					
TOP OF FILTER PACK				26.7	793.0
<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 6.5 Bags PLACEMENT: Tremie					
BOTTOM OF RISER / TOP OF SCREEN				29.1	790.6
<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch					
BOTTOM OF SCREEN				39.1	780.6
Flush-threaded end cap					
BOTTOM OF CASING				39.7	780.0
HOLE DIA: 7 inch					



# BORING LOG

**BORING B-21**

Page 1 of 3

**SOUTHERN COMPANY SERVICES, INC.**  
**EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING**

**PROJECT** Plant McDonough Hydrogeological Investigation

**LOCATION** Cobb County, GA

**DATE STARTED** 10/31/2012 **COMPLETED** 10/31/2012 **GROUND ELEVATION** 813.5 ft **COORDINATES** N 1392067.5 E 2202063.5

**CONTRACTOR** SCS Field Services **METHOD** 4.25" Hollow Stem Auger w/pilot bit; HQ Rock Core **EQUIPMENT** CME 550

**DRILLED BY** S. Denty **LOGGED BY** D. Brooks **CHECKED BY**  **BORING DEPTH** 69.1 ft.

**GROUND WATER DEPTH: DURING**  **COMP.**  **DELAYED**

**NOTES** Well installed. Refer to well data sheet.

GEOTECH ENGINEERING LOGS - ESEE DATABASE: GDT - 8/26/20 20:44 - \\ALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS SURVEY UPDATED.GPJ

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
0		- Vacuum excavation form 0 ft to 9.5 ft						
5								
10		<b>Clayey Silty Sand (SC-SM)</b> - orange and tan, moist, loose, silty, clayey SAND; micaceous; fine to very fine-grained	804.0	SS -1	9.5	3-3-4 (7)		
15		<b>Silty Sand (SM)</b> - tan, orange and black, damp, loose, silty SAND; micaceous; very fine-grained	799.0	SS -2	14.5	4-3-6 (9)		
20		- tan, orange and black, damp, medium dense, silty SAND; micaceous; fine-grained		SS -3	19.5	6-10-20 (30)		upper saprolite.
25				SS	24.5	10-16-18		

(Continued Next Page)



# BORING LOG

**BORING B-21**  
Page 2 of 3

**SOUTHERN COMPANY SERVICES, INC.**  
**EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING**

**PROJECT** Plant McDonough Hydrogeological Investigation

**LOCATION** Cobb County, GA

GEOTECH ENGINEERING LOGS - ESEE DATABASE: GDT - 8/26/20 20:44 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		<b>Silty Sand (SM)</b> (con't) - hard, SAA		4		(34)		
30		- tan and orange, damp, very stiff, silty SAND with gravel; relic structure present; fine to medium-grained		SS -5	29.5	7-10-12 (22)		saprolite.
35		- olive, orange and black, hard, SAA		SS -6	34.5	18-22-20 (42)		lower saprolite.
40		- olive and black, very hard, SAA		SS -7	39.5	18-25-45 (70)		
45		- olive and tan, damp, hard, silty SAND; relict structure; fine-grained		SS -8	44.5	9-16-21 (37)		saprolite.
50		- hard, SAA		SS -9	49.5	16-21-19 (40)		

(Continued Next Page)

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\ALTRCFP01\LAPARKER\$\DESKTOP\GPCIMW LOGS SURVEY UPDATED.GPJ



## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME	
Hydrogeologic Investigation		DRILLER: S. Denty			
LOCATION: Ash Pond		RIG TYPE: CME550		DGWC-21/B-21	
LOGGER: Dustin Brooks		DRILLING METHODS: HS Auger/HQ Rock Core			
DATE CONSTRUCTED: 10/31/2012		N: 1392067.5 E:2202063.5			
				DEPTH FEET	ELEVATION FT, MSL
TOP OF RISER				-2.8	816.28
2" Threaded Riser Cap					
GROUND SURFACE				0.0	813.47
<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum					
BOTTOM OF GROUT					
<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 15 bags cement 20 lbs bentonite					
<b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded					
TOP OF SEAL				51.2	762.3
<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 0.5 bucket PLACEMENT: Tremie					
TOP OF FILTER PACK				56.4	757.1
<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 0.5 Bag filter pac 0.5 bag hole PLACEMENT: Poured w/water					
BOTTOM OF RISER / TOP OF SCREEN				58.6	754.9
<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch					
BOTTOM OF SCREEN				68.6	744.9
BOTTOM OF CASING				69.0	744.5
HOLE DIA: 7 inch (auger) 3.8 inch (HQ core)					



# BORING LOG

**BORING B-22**

Page 1 of 3

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA


DATE STARTED 10/25/2012 COMPLETED 10/25/2012 GROUND ELEVATION 813.7 ft COORDINATES N 1392126.3 E 2201791.9

CONTRACTOR SCS Field Services METHOD 4.25" Hollow Stem Auger w/pilot bit; HQ Rock Core EQUIPMENT CME 550

DRILLED BY S. Denty LOGGED BY C. Sellers CHECKED BY BORING DEPTH 59.5 ft.

GROUND WATER DEPTH: DURING 20 ft. COMP. DELAYED

NOTES Well installed. Refer to well data sheet.

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
0		- Vacuum excavation from 0 ft to 9.5 ft						
5								
10		<b>Silt (ML)</b> - brown, very stiff, SILT; micaceous	804.2	SS -1	9.5	6-9-9 (18)		upper saprolite.
15		- tan, very moist, medium stiff, SILT; contains very fine sand and mica		SS -2	14.5	3-3-5 (8)		
20		 - wet, very stiff, SAA		SS -3	19.5	10-11-15 (26)		
25				SS	24.5	3-4-4		

GEOTECH ENGINEERING LOGS - ESEE DATABASE: GDT - 8/26/20 20:44 - \VALTRCFP01\APARKER\DESKTOP\GPCMW LOGS - SURVEY UPDATED.GPJ

(Continued Next Page)



# BORING LOG

**BORING B-22**

Page 2 of 3

**SOUTHERN COMPANY SERVICES, INC.**  
**EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING**

**PROJECT** Plant McDonough Hydrogeological Investigation

**LOCATION** Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		<b>Silt (ML)(con't)</b> - brown, medium stiff, SILT; contains fine sand and mica		4		(8)		
30		- dark brown to dark gray, wet, hard, weathered schist		SS -5	29.5	10-16-19 (35)		lower sparolite.
35		- very hard, SAA		SS -6	34.5	50 (0)		
40		- brown to orange, wet, very hard		SS -7	39.5	10-15-50 (65)		
45		- black, weathered schist	769.2	SS -8	44.5	50 (0)		
		<b>Schist</b> - very weathered SCHIST with mud in fractures		RC -1	44.8			
50		- very fractured BIOTITE GNEISS with schist-like features; red staining	764.2	RC -2	49.5			
		<b>Gneiss</b>						

GEOTECH ENGINEERING LOGS - ESEE DATABASE: GDT - 8/26/20 20:44 - \VALTRCFP01\1APARKER\DESKTOP\GPCMW LOGS - SURVEY UPDATED.GPJ

(Continued Next Page)



# BORING LOG

BORING B-22

Page 3 of 3

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
55		<b>Gneiss</b> (con't) - GNEISS (mylonite); fractures throughout; stained	754.2	RC-3	54.5			
60	Bottom of borehole at 59.5 feet.							
65								
70								
75								
80								

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\ALTRCFP01\IAPARKER\$\DESKTOP\GPCMW LOGS - SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME	
Hydrogeologic Investigation		DRILLER: S. Denty			
LOCATION: Ash Pond		RIG TYPE: CME550		DGWC-22/B-22	
LOGGER: Cale Sellers		DRILLING METHODS: HS Auger/HQ Rock Core			
DATE CONSTRUCTED: 10/25/2012		N: 1392126.3 E:2201791.9			
				DEPTH FEET	ELEVATION FT, MSL
TOP OF RISER				-2.9	816.59
2" Threaded Riser Cap					
GROUND SURFACE				0.0	813.69
<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum					
BOTTOM OF GROUT					
<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 9 bags cement 12.5 lbs bentonite					
<b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded					
TOP OF SEAL				44.6	769.1
<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 0.25 bucket PLACEMENT: Poured					
TOP OF FILTER PACK				47.7	766.0
<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 1 Bag PLACEMENT: Poured w/water					
BOTTOM OF RISER / TOP OF SCREEN				49.7	764.0
<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch					
BOTTOM OF SCREEN				59.7	754.0
Flush-threaded end cap					
BOTTOM OF CASING				60.0	753.7
HOLE DIA: 7 inch (auger) 3.8 inch (HQ core)					



# BORING LOG

**BORING B-23**

Page 1 of 3

**SOUTHERN COMPANY SERVICES, INC.**  
**EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING**

**PROJECT** Plant McDonough Hydrogeological Investigation

**LOCATION** Cobb County, GA

**DATE STARTED** 10/24/2012 **COMPLETED** 10/25/2012 **GROUND ELEVATION** 815.7 ft **COORDINATES** N 1392239.7 E 2201582

**CONTRACTOR** SCS Field Services **METHOD** 4.25" Hollow Stem Auger w/pilot bit; HQ Rock Core **EQUIPMENT** CME 550

**DRILLED BY** S. Denty **LOGGED BY** C. Sellers **CHECKED BY**  **BORING DEPTH** 59.4 ft.

**GROUND WATER DEPTH: DURING**  **COMP.**  **DELAYED**

**NOTES** Well installed. Refer to well data sheet.

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRCFP01\1APARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
0		- Vacuum excavation from 0 ft to 9.5 ft						
5								
10		<b>Silt (ML)</b> - dark brown, wet, medium stiff, clayey SILT with gravel (schist)	806.2	SS -1	9.5	3-3-3 (6)		
15		- dark gray, very soft, clayey SILT; contains wood		SS -2	14.5	WH-1-1 (2)		
20		- light purple.gray, stiff, SILT; very fine-grained		SS -3	19.5	1-3-7 (10)		
25		<b>Silty Sand (SM)</b>	791.2	SS	24.5	10-14-16		

(Continued Next Page)



# BORING LOG

**BORING B-23**

Page 2 of 3

**SOUTHERN COMPANY SERVICES, INC.**  
**EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING**

**PROJECT** Plant McDonough Hydrogeological Investigation

**LOCATION** Cobb County, GA

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		<b>Silty Sand (SM)</b> (con't) - light tan, damp, medium dense, silty SAND; fine to very fine-grained; micaceous		-4		(30)		
30		- dark gray to brown, loose, angular gravel at top of sample; saprolite at bottom		SS -5	29.5	7-5-2 (7)		
35		- dark gray to brown, very dense, saprolite		SS -6	34.5	13-17-50 (67)		
40		- light tan to white, very dense, saprolite (silty); micaceous		SS -7	39.5	50 (0)		
45		- no sample obtained		SS -8	44.5			
			768.6	RC -1	47.1			
50		<b>Gneiss</b>  - weathered GNEISS; vertical fractures and red staining throughout		RC -2	49.4			

(Continued Next Page)



# BORING LOG

BORING B-23

Page 3 of 3

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
55		<b>Gneiss</b> (con't)  - light gray, GNEISS; some fractures	756.3	RC-3	54.4			
60	Bottom of borehole at 59.4 feet.							
</								



## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME		
Hydrogeologic Investigation		DRILLER: S. Denty				
LOCATION: Ash Pond		RIG TYPE: CME550		DGWC-23/B-23		
LOGGER: Cale Sellers		DRILLING METHODS: HS Auger/HQ Rock Core				
DATE CONSTRUCTED: 10/25/2012		N: 1392239.7 E:2201582.0				
				DEPTH FEET	ELEVATION FT, MSL	
				TOP OF RISER	-2.7	818.37
				2" Threaded Riser Cap		
4 ft x 4 ft concrete pad				GROUND SURFACE	0.0	815.63
<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum				BOTTOM OF GROUT		
<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 8 bags cement 11 lbs bentonite						
<b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded				TOP OF SEAL	42.9	772.7
<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 0.25 bucket PLACEMENT: Tremie				TOP OF FILTER PACK	46.8	768.8
<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 1 Bag PLACEMENT: Tremie				BOTTOM OF RISER / TOP OF SCREEN	49.8	765.8
<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch				BOTTOM OF SCREEN	59.8	755.8
Flush-threaded end cap				BOTTOM OF CASING	60.1	755.5
HOLE DIA: 7 inch (auger) 3.8 inch (HQ core)						



# BORING LOG

**BORING B-42**

Page 1 of 2

**SOUTHERN COMPANY SERVICES, INC.**  
**EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING**

**PROJECT** Plant McDonough Hydrogeological Investigation

**LOCATION** Cobb County, GA

**DATE STARTED** 11/12/2012 **COMPLETED** 11/12/2012 **GROUND ELEVATION** 802 ft **COORDINATES** N 1391327.8 E 2201870.2

**CONTRACTOR** SCS Field Services **METHOD** 4.25" Hollow Stem Auger w/pilot bit **EQUIPMENT** CME 550

**DRILLED BY** S. Denty **LOGGED BY** C. Sellers **CHECKED BY**  **BORING DEPTH** 51 ft.

**GROUND WATER DEPTH: DURING** 30 ft. **COMP.**  **DELAYED**

**NOTES** Well installed. Refer to well data sheet.

GEOTECH ENGINEERING LOGS - ESEE DATABASE: GDT - 8/26/20 20:44 - \\VALTRCFP01\1\APARKER\DESKTOP\GPCMW LOGS SURVEY UPDATED.GPJ

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
0		- Vacuum excavation from 0 ft to 9.5 ft						
5								
10			792.5	SS -1	9.5	1-2-4 (6)		
15		<b>Lean Clay (CL)</b> - orange/tan, medium stiff, silty CLAY; micaceous; fine to very-fine grained						
			787.5	SS -2	14.5	3-4-6 (10)		
20		<b>Silt (ML)</b> - tan/orange/some white, stiff, SILT with very fine sand; very micaceous; saprolite						
				SS -3	19.5	4-4-5 (9)		
25		- SAA		SS	24.5	1-3-4		

(Continued Next Page)



# BORING LOG

**BORING B-42**

Page 2 of 2

**SOUTHERN COMPANY SERVICES, INC.**  
**EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING**

**PROJECT** Plant McDonough Hydrogeological Investigation

**LOCATION** Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		<b>Silt (ML)(con't)</b> - light tan, medium stiff, clayey SILT; very fine-grained; some mica (less than above)		-4		(7)		
30	▽	- tan with black banding, wet, soft, SILT with very fine-grained sand		SS -5	29.5	1-2-2 (4)		
35		- wet, hard, SILT with fine sand and some gravel; angular; saprolite		SS -6	34.5	7-22-26 (48)		
40		- tan, wet, very stiff, SILT with fine sand and angular gravel		SS -7	39.5	8-9-12 (21)		
45		- wet, very stiff, SAA		SS -8	44.5	5-9-14 (23)		
50		<b>Silty Sand (SM)</b> - tan, damp, silty SAND	752.5	SS -9	49.5			
			751.0					
		Bottom of borehole at 51.0 feet.						

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \VALTRCFP01\APARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME	
Hydrogeologic Investigation		DRILLER: S. Denty			
LOCATION: Ash Pond		RIG TYPE: CME550		DGWC-42/B-42	
LOGGER: Cale Sellers		DRILLING METHODS: HS Auger			
DATE CONSTRUCTED: 11/12/2012		N: 1391327.8 E:2201870.2			
			DEPTH FEET	ELEVATION FT, MSL	
			TOP OF RISER	-2.7	804.68
			2" Threaded Riser Cap		
4 ft x 4 ft concrete pad			GROUND SURFACE	0.0	801.98
			<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum		
			BOTTOM OF GROUT		
			<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 8 bags cement 11 lbs bentonite		
			<b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded		
			TOP OF SEAL	35.2	766.8
			<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 1/4" bentonite pellets; 5-gallon buckets AMOUNT: 1 bucket PLACEMENT: Poured		
			TOP OF FILTER PACK	37.2	764.8
			<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 5 Bags PLACEMENT: Poured w/water		
			BOTTOM OF RISER / TOP OF SCREEN	39.9	762.1
			<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch		
			BOTTOM OF SCREEN	49.9	752.1
Flush-threaded end cap			BOTTOM OF CASING	50.4	751.6
HOLE DIA: 7 inch					

# RECORD OF BOREHOLE DGWC-47/B-47

SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 28.80 ft  
LOCATION: Smyrna, GA

DRILL RIG: 100C Track Mounted Rig  
DATE STARTED: 6/23/16  
DATE COMPLETED: 6/23/16

NORTHING: 1,391,553.80  
EASTING: 2,202,610.50  
GS ELEVATION: 794.35  
TOC ELEVATION: 797.45 ft

DEPTH W.L.: 15.98  
ELEVATION W.L.: 778.32  
DATE W.L.: 6/23/2016  
TIME W.L.: 15:56

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	REC		
0		0.00 - 4.00 SILT; red brown, trace subrounded to subangular fine gravel, gray to white, dry (fill)	ML						Portland Type I/ _ Aluminum Casing	<b>WELL CASING</b> Interval: 0'-28.8' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush threaded with O-ring  <b>WELL SCREEN</b> Interval: 18.4'-28.4' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 16.35'-28.8' Type: Filtersil std61  <b>FILTER PACK SEAL</b> Interval: 11.3'-16.4' Type: 3/8" Bentonite Pellets  <b>ANNULUS SEAL</b> Interval: 0'-11.3' Type: Portland Type I/Type II/Gel Mix  <b>WELL COMPLETION</b> Pad: 4"x4"x4" Protective Casing: Aluminum  <b>DRILLING METHODS</b> Soil Drill: Sonic Rock Drill: Sonic
790		4.00 - 9.00 SILT; orange brown, some medium sand with black laminations, micaceous, stiff, dry to moist (saprolite)	ML		790.4 4.00				Portland Type I/ Type II/ Bentonite Gel mix	
785		9.00 - 10.00 SILT; gray, some white and black laminations, dry, stiff	ML		785.4 784.4					
10		10.00 - 13.00 SILT and GRAVEL; fine to coarse gravel and cobbles/moderately weathered rock (biotite schist), light brown silt and black with orange staining gravel, foliated, friable	GW-GM		10.00 781.4					
15		13.00 - 20.00 GNEISS and weathered SCHIST; gray and white, foliated biotite gneiss, some orange staining, trace pyrite and garnets (saprock)	PWR		13.00 774.4				3/8" Bentonite - Pellets	
20		20.00 - 28.80 Biotite GNEISS (competent rock); some orange staining at fractures; trace pyrite and garnets	BR		20.00 765.6				Filtersil std #61  0.010" slot screen	
775										Sump -
770										
765		Boring completed at 28.80 ft								
760										
755										
750										

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Bill Lindsey

GA INSPECTOR: K. Jurinko, PG  
CHECKED BY: Rachel P. Kirkman, PG  
DATE: 12/22/17



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

# RECORD OF BOREHOLE DGWC-48/B-48

SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 30.00 ft  
LOCATION: Smyrna, GA

DRILL RIG: 100C Track Mounted Rig  
DATE STARTED: 6/21/16  
DATE COMPLETED: 6/22/16

NORTHING: 1,391,314.60  
EASTING: 2,202,290.20  
GS ELEVATION: 785.21  
TOC ELEVATION: 788.33 ft

DEPTH W.L.: 11.35  
ELEVATION W.L.: 773.85  
DATE W.L.: 6/23/2016  
TIME W.L.: 9:55

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	REC		
0	785	0.00 - 3.00 SILT; orange brown, micaceous, dry, very stiff (fill)	ML		782.2 3.00				Portland Type I/ _ Aluminum Casing	<b>WELL CASING</b> Interval: 0'-30' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush threaded with O-ring  <b>WELL SCREEN</b> Interval: 19.6'-29.6' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 17.6'-30' Type: Filtersil std61  <b>FILTER PACK SEAL</b> Interval: 12.1'-17.6' Type: 3/8" Bentonite Pellets  <b>ANNULUS SEAL</b> Interval: 0'-12.1' Type: Portland Type I/Type II/Gel Mix  <b>WELL COMPLETION</b> Pad: 4"x4"x4" Protective Casing: Aluminum  <b>DRILLING METHODS</b> Soil Drill: Sonic Rock Drill: Sonic
5	780	3.00 - 11.00 SILT; oragnish brown to tan, laminations, trace to some medium to coarse sand, trace fine to coarse gravel, gray, subangular, moist (saprolite)	ML						Portland Type I/ Type _ II/ Bentonite Gel mix	
10	775	11.00 - 24.00 SILT; gray to blackish brown, some fine to coarse sand, laminations, stiff to very stiff, dry	ML		774.2 11.00					
15	770		ML						3/8" Bentonite - Pellets	
20	765									
25	760	24.00 - 30.00 biotite GNEISS; gray and white, orange staining, partially weathered bedrock, some clay, gray, micaceous	BR		761.2 24.00				Filtersil std #61  0.010" slot screen	
30	755	Boring completed at 30.00 ft			755.2				Sump -	
35	750									
40	745									
45										

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Bill Lindsey

GA INSPECTOR: K. Jurinko, PG  
CHECKED BY: Rachel P. Kirkman, PG  
DATE: 12/22/17



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

# RECORD OF BOREHOLE B-56

SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 45.00 ft  
LOCATION: SW of the cement plant

DRILL RIG: CME 55  
DATE STARTED: 10/3/16  
DATE COMPLETED: 10/3/16

NORTHING: 1,393,957.90  
EASTING: 2,204,187.80  
GS ELEVATION: 820.95  
TOC ELEVATION: 823.59 ft

DEPTH W.L.: 16.39  
ELEVATION W.L.: 804.61  
DATE W.L.: 10/6/2016  
TIME W.L.: 900

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES				MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS			
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	BLOWS per 6 in  140 lb hammer 30 inch drop	N-VALUE			REC		
					DEPTH (ft)									
0	820	0.00 - 13.50 ML, SILT, trace fine sand, non to low plasticity; brownish red, micaceous, fill; cohesive, dry to moist, w<PL, firm.	ML								CETCO puregold grout (70:30) – / aluminum casing		<b>WELL CASING</b> Interval: 0'-34.6' Material: Schedule 40 PVC Diameter: 2 Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 34.6'-44.6' Material: Schedule 40 PVC Diameter: 2 Slot Size: 0.010 End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 31.8' - 45' Type: FilterSil  <b>FILTER PACK SEAL</b> Interval: 26.7'-31.8' Type: PEL-PLUG 3/8" Bentonite pellets  <b>ANNULUS SEAL</b> Interval: 0'-26.7' Type: CETCO puregold grout (70:30)  <b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 4"x4"x5' aluminum  <b>DRILLING METHODS</b> Soil Drill: Hollow-stem auger Rock Drill: N/A	
						1	DO	2-5-5	10	1.08 1.50				
5	815													
						2	DO	2-4-4	8	0.75 1.50				
10	810													
										CETCO puregold – grout (70:30)				
		13.50 - 23.50 ML, SILT, trace fine to coarse sand, non to low plasticity; red to brown to black to silver, micaceous, schist/schistose gneiss saprolite; cohesive, mosit to wet, soft to stiff.	ML		807.5 13.50	3	DO	3-5-11	16	1.50 1.50				
15	805													
						4	DO	3-5-9	16	1.50 1.50				
20	800													
		23.50 - 45.00 ML, SILT, trace fine to coarse sand, non to low plasticity; brown to silvery brown, deeply weathered, micaceous, schist saprolite; cohesive, wet, w<PL, soft to firm. (locally contains pegmatite veins)	ML		797.5 23.50	5	DO	7-8-14	22	1.33 1.50				
25	795													
													PEL-PLUG 3/8" – Bentonite pellets	
30	790													
35	785													
40	780													

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 12/22/17



# RECORD OF BOREHOLE B-63

SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 46.00 ft  
LOCATION: Due south of B-61. Flush mounted in the roadway.

DRILL RIG: CME 55  
DATE STARTED: 10/6/16  
DATE COMPLETED: 10/6/16

NORTHING: 1,390,999.10  
EASTING: 2,202,978.10  
GS ELEVATION: 777.37  
TOC ELEVATION: 777.10 ft

DEPTH W.L.: 34.2  
ELEVATION W.L.: 743.1  
DATE W.L.: 10/6/2016  
TIME W.L.: 1745

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE			SAMPLES				MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS		
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop			N-VALUE	REC
					DEPTH (ft)							
0		0.00 - 13.50 Top 12' were Hydrovac for utilities.									CETCO puregold grout (70:30) – / aluminum casing	<div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div>&lt;/</div></div>

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 12/22/17



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20



# RECORD OF BOREHOLE B-63


SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 46.00 ft  
LOCATION: Due south of B-61. Flush mounted in the roadway.

DRILL RIG: CME 55  
DATE STARTED: 10/6/16  
DATE COMPLETED: 10/6/16

NORTHING: 1,390,999.10  
EASTING: 2,202,978.10  
GS ELEVATION: 777.37  
TOC ELEVATION: 777.10 ft

DEPTH W.L.: 34.2  
ELEVATION W.L.: 743.1  
DATE W.L.: 10/6/2016  
TIME W.L.: 1745

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
45			SM		731.4							<div>  <p><b>WELL CASING</b> Interval: 0' - 35.5' Material: Schedule 40 PVC Diameter: 2 Joint Type: Flush/Screw</p> <p><b>WELL SCREEN</b> Interval: 35.5'-45.5' Material: Schedule 40 PVC Diameter: 2 Slot Size: 0.010 End Cap: Schedule 40 PVC</p> <p><b>FILTER PACK</b> Interval: 33'- 45.9' Type: FilterSil</p> <p><b>FILTER PACK SEAL</b> Interval: 27.6'-33' Type: PEL-PLUG 3/8" Bentonite pellets</p> <p><b>ANNULUS SEAL</b> Interval: 0' - 27.6' Type: CETCO puregold grout (70:30)</p> <p><b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 8" Round Flush Mount</p> <p><b>DRILLING METHODS</b> Soil Drill: Hollow-stem auger Rock Drill: N/A</p> </div>
		Boring completed at 46.00 ft										
730												
50												
725												
55												
720												
60												
715												
65												
710												
70												
705												
75												
700												
80												
695												
85												
690												
90												

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 12/22/17



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20



# **DRILLING LOG** **GEOLOGICAL SERVICES**

Hole No. **B-66**  
Sheet 1 of 2

SITE <b>Plant McDonough</b>		HOLE DEPTH <b>55.5'</b>	SURFELEV <b>813.30</b>
LOCATION <b>North of AP-4, near property line concrete pile</b>		COORDINATES <b>33.831427</b>	<b>-84.470638</b>
ANGLE _____	BEARING _____	CONTRACTOR <b>SCS</b>	DRILL NO. _____
DRILLING METHOD <b>HSA</b>		NO. SAMPLES _____	NO. U.D. SAMPLES <b>0</b>
CASING SIZE <b>2"</b>	LENGTH <b>10'</b>	CORE SIZE _____	TOTAL % REC. _____
WATER TABLE DEPTH <b>14.8' BLS</b>		ELEV. <b>798.50' NAVD88</b>	TIME AFTER COMP. _____
TYPE GROUT _____		QUANTITY _____	MIX <b>.</b>
DRILLER <b>Milam</b>		RECORDER <b>Abraham</b>	APPROVED _____
		DRILLING START DATE <b>11/16/2016</b>	
		DRILLING COMP. DATE <b>11/16/2016</b>	

Depth	Elev.	Material Description, Classification and Remarks	Sample No.	Standard Penetration Test			Comments	% Rec	RQD
				From To	Blows	N			
0	813.30								
1	812.30								
2	811.30								
3	810.30								
4	809.30								
5	808.30	<b>HYDRO-EXCAVATION</b> Hydrovac from land surface to 10-feet below land. No samples							
6	807.30								
7	806.30								
8	805.30								
9	804.30								
10	803.30								
11	802.30								
12	801.30								
13	800.30								
14	799.30	<b>CLAYEY SILT</b> Light Brown to reddish brown clayey silt; 10R/5/6; damp; FeO along fracture traces & relict foliations; organics absent.	S-1	13.5-15	2-1-1	2		85	
15	798.30								
16	797.30								
17	796.30								
18	795.30								
19	794.30	<b>CLAYEY SILT</b> Light Brown to reddish brown clayey silt; 10R/5/6; damp; FeO along fracture traces & relict foliations;	S-2	18.5-20	2-1-5	6		90	
20	793.30								
21	792.30								
22	791.30	<b>CLAYEY SILT</b> Brownish gray with reddish streaks clayey silt grading to brownsh gray saprolite; 10YR/6/3; moist; FeO bands with minor MnO streaks along fracutre traces; distinct MnO layer at 25-ft parallel to foliation; fractures increase at 25-ft.	S-3	3-4-9	3-4-9	14		90	
23	790.30								
24	789.30								

**DRILLING LOG  
GEOLOGICAL SERVICES**

Hole No. **B-66**

Sheet 2 of 2

SITE		Plant McDonough		TOTAL DEPTH		55.5'		SURF.ELEV.		813.30	
Depth	Elev.	Material Description, Classification and Remarks	Sample No.	Standard Penetration Test			Comments	% Rec	RQD		
				From To	Blows	N					
25	788.30	<b>SILTY SAND</b>  Medium to dark gray silty sand with minor clay; 2.5Y/5/2; few brownish-black weathered minerals; micaceous texture; MnO bands along fracture & foliations; saprolite between 28 and 30 feet.	S-4	4-5-10	15	80					
26	787.30										
27	786.30										
28	785.30										
29	784.30										
30	783.30										
31	782.30	<b>SILTY SAND SAPROLITE</b>  Light to dark gray SILTY SAND; 5Y/5/3; moist to wet saprolite; gravel-size rock frags; weathered feldspars & quartz; increasing biotite & MnO at 35-feet.	S-5	7-9-16	25	90					
32	781.30										
33	780.30										
34	779.30										
35	778.30										
36	777.30										
37	776.30	Grayish brown - brownish-black SILTY SAND with minor clay; 5Y/3/2; fewer rock fragments than above; moist to wet.	S-6	6-8-10	18	90					
38	775.30										
39	774.30										
40	773.30										
41	772.30										
42	771.30										
43	770.30	<b>SILTY SAPROLITE</b> Yellowish brown silt with minor clay saprolite; 2.5Y/6/3; lighter than above; abundant MnO streaks; wet but not saturated.	S-7	5-6-9	16	90					
44	769.30										
45	768.30										
46	767.30										
47	766.30										
48	765.30										
49	764.30	<b>SILTY SAND SAPROLITE</b> Yellowish to blackish brown SILTY SAND saprolite; 2.5Y/6/3; minor rock fragments; saturated	S-8	6-7-17	24	90					
50	763.30										
51	762.30										
52	761.30										
53	760.30										
54	759.30										
55	758.30	Yellowish brown silty sand saprolite; minor clay; 2.5Y/6/3; abundant MnO streaks parallel to relict foliations; saturated.	S-9	7-8-18	26	90					
56	757.30										
END OF BORING: REGOLITH WELL											

## Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS, Inc.		WELL NAME		
NE of AP-4 at Argos, nr concrete pile, ~250' NE of DGWC-10		DRILLER: Wideman				
LOCATION:33.831427 / -84.470638		RIG TYPE: CME 550				
LOGGER: Abraham		DRILLING METHODS: HSA		B-66		
DATE CONSTRUCTED: 3/7/2016		Survey Coordinates: N: 1393858.2 E: 2204277.5				
<p>Locking Hinged Top</p> <p>1/4-inch Vent</p> <p>1/4-inch Weep Hole</p> <p>4-ft x 4-ft x 4" concrete pad</p> <p>2" Threaded Riser Cap</p> <p>PROTECTIVE CASING</p> <p>BACKFILL MATERIAL TYPE: Grout-bentonite mix AMOUNT: 4 x 50 lbs</p> <p>RISER CASING DIA: 2-inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded</p> <p>ANNULAR SEAL TYPE: 1/4-inch coated bentonite pellets 5-gal buckets AMOUNT: 0.5 bucket PLACEMENT: Tremie</p> <p>FILTER PACK TYPE: DSI Sand - 1A (20/40) Drillers Services, Inc. AMOUNT: 5 bags PLACEMENT: Tremie; wash with water</p> <p>SCREEN DIA: 2-inch TYPE: Schedule 40 PVC Prepack OPENING WIDTH: 0.01-inch OPENING TYPE: Slotted SLOT SPACING: 0.25-inch SLOT LENGTH: 1.5-inch</p> <p>HOLE DIA: 9"</p>				DEPTH FEET	ELEVATION FT, MSL	
				TOP OF RISER	-1.89	815.90
				GROUND SURFACE	0.00	813.33
				BOTTOM OF PROTECTIVE CASING		
				TOP OF SEAL	37.6	775.7
				TOP OF FILTER PACK	41.7	771.6
				BOTTOM OF RISER / TOP OF SCREEN	45.0	768.3
				BOTTOM OF SCREEN	55.0	758.3
				BOTTOM OF WELL	55.3	758.0

# RECORD OF BOREHOLE B-77

SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 42.00 ft  
LOCATION: South by river, SW of B-63

DRILL RIG: Rotosonic 1159  
DATE STARTED: 9/17/19  
DATE COMPLETED: 9/17/19

NORTHING: 1,390,948.70  
EASTING: 2,202,942.00  
GS ELEVATION: 777.12 ft  
TOC ELEVATION: 776.86 ft

DEPTH W.L.: 28.50  
ELEVATION W.L.: 748.6  
DATE W.L.: 1/13/2020  
TIME W.L.: 14:39

BOREHOLE RECORD MCDONOUGH MASTER LIST BACKUP SURVEY UPDATED (5).GPJ PIEDMONT.GDT 9/2/20

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	REC		
0	775	0.00 - 8.00 Hydrovac, no soil recovery due to Hydrovac							AquaGuard Bentonite — Grout	<b>WELL CASING</b> Interval: 0'-32' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 32'-42' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 30'-42' Type: Filter Media  <b>FILTER PACK SEAL</b> Interval: 22'-30' Type: PEL-PLUG 3/8"  <b>ANNULUS SEAL</b> Interval: 0'-22' Type: AquaGuard Bentonite Grout  <b>WELL COMPLETION</b> Pad: 4'x4' Concrete Protective Casing: 4" Stainless Steel  <b>DRILLING METHODS</b> Soil Drill: Sonic Rock Drill: Sonic
5	770	8.00 - 10.00 Fill			769.1	S1	ROTO SONIC	0.17 0.17		
10	765	10.00 - 20.00 Sandy SILT, trace clay, some gravel, reddish brown, low plasticity, w<PL, moist, firm, cohesive	MLS		767.1	S2	ROTO SONIC	0.67 0.83		
15	760				757.1	S3	ROTO SONIC	0.38 0.83		
20	755	20.00 - 30.00 Sandy SILT, micaceous, trace clay, some gravel, reddish brown, low plasticity, w<PL, moist, firm, cohesive	MLS		747.1	S4	ROTO SONIC	0.52 0.83		
25	750								PEL-PLUG 3/8" — Bentonite Pellets	
30	745	30.00 - 40.00 Silty CLAY, some sand, transitioning from reddish-brown to brownish gray, w~PL, moderate plasticity, moist to wet, soft to firm, cohesive,	CL-ML		737.1	S5	ROTO SONIC	0.17 0.17	#2 FilterSil —	
35	740									
40	735	40.00 - 42.00 Silty CLAY, some sand, transitioning from reddish-brown to brownish gray, w~PL, moderate plasticity, soft to firm, moist to wet, transition to PWR, cohesive Boring completed at 42.00 ft	CL-ML		735.1				0.010" Slotted Schedule 40 PVC	
45										

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Jose

GA INSPECTOR: D. Thomas  
CHECKED BY: Timothy Richards, PG  
DATE: 2/11/20



# RECORD OF BOREHOLE B-82

SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 45.00 ft  
LOCATION: East of CCR Unit south of concrete plant

DRILL RIG: Rotosonic 1159  
DATE STARTED: 9/21/19  
DATE COMPLETED: 9/21/19

NORTHING: 1,393,750.00  
EASTING: 2,204,258.10  
GS ELEVATION: 807.55  
TOC ELEVATION: 810.07 ft

DEPTH W.L.: 8.90  
ELEVATION W.L.: 798.6  
DATE W.L.: 1/13/2020  
TIME W.L.: 15:59

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 9/22/20

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	REC		
0		0.00 - 8.70 Hydrovac	NA			0		0.00 0.73	Concrete Surface / Completion	<b>WELL CASING</b> Interval: 0.0 - 34.5' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 34.5 - 44.5' Material: Schedule 40 PVC Schedule 40 PVC Diameter: 2" ID 4" OD Slot Size: 0.010 End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 32.5 - 45.0' Type: 20/40 FilterSil  <b>FILTER PACK SEAL</b> Interval: 26.5 - 32.5' Type: Pel-Plug 3/8" Bentonite Pellets  <b>ANNULUS SEAL</b> Interval: 0.4 - 26.5' Type: High Solids Bentonite (AquaGuard)  <b>WELL COMPLETION</b> Pad: 4' x 4' x 4" Protective Casing: 4" Stainless Steel  <b>DRILLING METHODS</b> Soil Drill: Sonic Rock Drill: Sonic  ~200 gallons of water used while drilling
805										
5										
800			ML		798.9		ROTO SONIC		High Solids Bentonite -- (AquaGuard)	
		8.70 - 10.70 (ML) sandy SILT, non-plastic fines, fine sand; dark yellowish brown (10YR 4/2); non-cohesive, dry, loose			8.70	1		0.94 0.94		
10					796.9					
		10.70 - 31.70 (SM) sandy SILT, fine to medium angular sand, non-plastic to low plasticity fines, some soft (crumble under finger pressure) fine angular gravel; dark yellowish brown (10YR 4/2) to pale yellowish brown (10YR 6/2), very micaceous, SAPROLITE; non-cohesive, dry, loose. Moist and compact starting at 20 feet bgs.	ML		10.70				Pel-Plug 3/8" Bentonite -- Pellets	
795										
15										
790			ML			2	ROTO SONIC	0.83 0.83	20/40 FilterSil -- Sandpack	
20										
785										
		31.70 - 35.50 (SP and ML) SAND and SILT, fine sub-angular sand, non-plastic to low plasticity fines; dark yellowish brown (10YR 4/2), highly micaceous, SAPROLITE; non-cohesive, wet, compact	SP & ML		775.9		ROTO SONIC	0.83 0.83	2"ID, 4"OD 0.010 Slot SCH 40 PVC -- U-Pack Screen	
775					31.70					
		35.50 - 38.50 (CL) sandy SILTY CLAY, low to moderate plasticity fines, fine sand; moderate yellowish brown (10YR 4/2) to light brown (5YR 5/6), some relic foliations, highly micaceous, SAPROLITE; cohesive, w>PL, soft.			772.1					
35			CL		35.50				PVC Cap --	
770										
		38.50 - 40.00 (SC) CLAYEY SAND, fine angular sand, low to moderate plasticity fines; light brown (5YR 5/6) to moderate yellowish brown (10YR 5/4), iron oxide staining, very micaceous, some relic foliations, SAPROLITE; non-cohesive, wet, compact			769.1					
40			ML & SP		767.6		ROTO SONIC	0.42 0.42		
		40.00 - 45.00 (ML and SP) SILT and SAND, non-plastic to low plasticity fines, fine sand; dark yellowish brown (10YR 4/2) with frequent relic foliations, very micaceous, SAPROLITE; non-cohesive, wet to moist, compact			767.6	4				
765										
45		Boring completed at 45.00 ft			762.6					

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Jose

GA INSPECTOR: Jeff Ingram  
CHECKED BY: Timothy Richards, PG  
DATE: 2/12/20



# RECORD OF BOREHOLE B-83

SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 50.00 ft  
LOCATION: South by river, NW of B-76

DRILL RIG: CME550X  
DATE STARTED: 9/30/19  
DATE COMPLETED: 9/30/09

NORTHING: 1,390,735.50  
EASTING: 2,202,695.60  
GS ELEVATION: 777.17  
TOC ELEVATION: 776.98 ft

DEPTH W.L.: 28.75  
ELEVATION W.L.: 748.35  
DATE W.L.: 1/13/2020  
TIME W.L.: 14:52

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
					DEPTH (ft)							
0		0.00 - 15.00 Hydrovac to 15' for utilities									AquaGuard Bentonite – Grout	<b>WELL CASING</b> Interval: 0'-38.6' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 38.6'-48.6' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 36.6'-50' Type: Filter Media  <b>FILTER PACK SEAL</b> Interval: 30.7'-36.6' Type: PEL-PLUG 3/8"  <b>ANNULUS SEAL</b> Interval: 0'-30.7' Type: AquaGuard Bentonite Grout  <b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 8" Round Ground Flush  <b>DRILLING METHODS</b> Soil Drill: 4.25-inch ID Hollow-Stem Auger Rock Drill: N/A
775												
5												
770												
10												
765												
15		15.00 - 19.00 ML, Gravelly SILT with some sand, brown-black, cohesive, W<PL, dry, soft	ML		762.2 15.00							
760												
20		19.00 - 20.00 ML, SILT, micaceous, brown, W<PL, moist, very soft	ML		758.2 19.00	S1	SS	6-4-4	8	1.25 1.50		
755		20.00 - 33.50 ML, SILT, brown, moist, W-PL, firm to stiff			757.2 20.00							
25			ML			S2	SS	2-1-3	4	1.50 1.50		
750												
30						S3	SS	1-1-2	3	1.50 1.50		
745												
35		33.50 - 38.50 CL, silty CLAY, micaceous, dark brown-tan, cohesive, moist, W>PL, very soft to soft	CL		743.7 33.50	S4	SS	1-1-2	3	1.50 1.50	PEL-PLUG 3/8" – Bentonite Pellets	
740												
40		38.50 - 43.50 CL, silty CLAY, brown with black and red, W>PL, very soft to soft	CL		738.7 38.50	S5	SS	3-3-4	7	1.50 1.50	#2 FilterSil –	
735												
45		43.50 - 49.00 CL, silty CLAY, brown with orange, moist to wet, W<PL, very soft to firm Log continued on next page	CL-ML		733.7 43.50	S6	SS	WOH-4-8	12	1.50 1.50	0.010" Slotted	

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: K. Minkara  
CHECKED BY: Timothy Richards, PG  
DATE: 2/11/20



# RECORD OF BOREHOLE B-83




SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 50.00 ft  
LOCATION: South by river, NW of B-76

DRILL RIG: CME550X  
DATE STARTED: 9/30/19  
DATE COMPLETED: 9/30/09

NORTHING: 1,390,735.50  
EASTING: 2,202,695.60  
GS ELEVATION: 777.17  
TOC ELEVATION: 776.98 ft

DEPTH W.L.: 28.75  
ELEVATION W.L.: 748.35  
DATE W.L.: 1/13/2020  
TIME W.L.: 14:52

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
45		43.50 - 49.00 CL, silty CLAY, brown with orange, moist to wet, W<PL, very soft to firm (Continued)	CL-ML								Schedule 40 PVC 	<b>WELL CASING</b> Interval: 0'-38.6' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 38.6'-48.6' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 36.6'-50' Type: Filter Media  <b>FILTER PACK SEAL</b> Interval: 30.7'-36.6' Type: PEL-PLUG 3/8"  <b>ANNULUS SEAL</b> Interval: 0'-30.7' Type: AquaGuard Bentonite Grout  <b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 8" Round Ground Flush  <b>DRILLING METHODS</b> Soil Drill: 4.25-inch ID Hollow-Stem Auger Rock Drill: N/A
50		49.00 - 50.00 SM, silty SAND, PWR, black-brown mica schist  Boring completed at 50.00 ft	SM		728.2 49.00 727.2	S7	SS	8-15-18	33	1.50 1.50		
730												
725												
720												
715												
710												
705												
700												
695												
690												
685												
680												
675												
670												
665												
660												
655												
650												
645												
640												
635												
630												
625												
620												
615												
610												
605												
600												
595												
590												
585												
580												
575												
570												
565												
560												
555												
550												
545												
540												
535												
530												
525												
520												
515												
510												
505												
500												
495												
490												
485												
480												
475												
470												
465												
460												
455												
450												
445												
440												
435												
430												
425												
420												
415												
410												
405												
400												
395												
390												
385												
380												
375												
370												
365												
360												
355												
350												
345												
340												
335												
330												
325												
320												
315												
310												
305												
300												
295												
290												
285												
280												
275												
270												
265												
260												
255												
250												
245												
240												
235												
230												
225												
220												
215												
210												
205												
200												
195												
190												
185												
180												
175												
170												
165												
160												
155												
150												
145												
140												
135												
130												
125												
120												
115												
110												
105												
100												
95												
90												

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: K. Minkara  
CHECKED BY: Timothy Richards, PG  
DATE: 2/11/20





# RECORD OF BOREHOLE B-88




SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 72.40 ft  
LOCATION: North end of site along fence

DRILL RIG: CME 550  
DATE STARTED: 11/15/19  
DATE COMPLETED: 11/15/19

NORTHING: 1,394,401.10  
EASTING: 2,203,738.30  
GS ELEVATION: 816.80  
TOC ELEVATION: 820.07 ft

DEPTH W.L.: 31.47  
ELEVATION W.L.: 785.53  
DATE W.L.: 1/13/2020  
TIME W.L.: 15:11

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES				MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS	
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE			REC
					DEPTH (ft)							
0		0.00 - 10.00 Hydrovac to 10.00' to for utilities									<div>AquaGuard Bentonite – Grout</div> 	<div><b>WELL CASING</b> Interval: 0'-72' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screen</div> <div><b>WELL SCREEN</b> Interval: 62'-72' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: Schedule 40 PVC</div> <div><b>FILTER PACK</b> Interval: 60'-72' Type: Filter Media</div> <div><b>FILTER PACK SEAL</b> Interval: 55'-60' Type: PEL-PLUG 3/8"</div> <div><b>ANNULUS SEAL</b> Interval: 0'-55' Type: AquaGuard Bentonite Grout</div> <div><b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 8" Round Ground Flush</div> <div><b>DRILLING METHODS</b> Soil Drill: 4.25-inch ID Hollow Stem Auger Rock Drill: N/A</div>
815												
5												
810												
10		10.00 - 15.00 SM, silty SAND with trace gravel, white and orange, saprolite, non-cohesive, dry, loose	SM		806.8 10.00							
805						1	SS	6-5-2	7	1.50 1.50		
15		15.00 - 19.00 SM, silty SAND with trace gravel, white and orange, saprolite, non-cohesive, dry, loose	SM		801.8 15.00							
800												
20		19.00 - 20.00 CL-ML, silt CLAY with some sand, brown, W<PL, firm	CL-ML		797.8 19.00 796.8 20.00	2	SS	7-5-2	7	1.50 1.50		
795		20.00 - 25.00 SM, silty SAND with some clay, fine to medium sand, orange and tan, low to no plasticity, W<PL, firm, cohesive	SM									
25		25.00 - 30.00 SM, silty SAND with some clay, fine to medium sand, orange and tan with white, saprolite, low to no plasticity, W<PL, firm, cohesive	SM		791.8 25.00	3	SS	2-5-3	8	1.50 1.50		
790												
30		30.00 - 34.00 SM, silty SAND with some clay, fine to medium sand, orange to tan with brown, saprolite, low to no plasticity, W<PL, firm, cohesive	SM		786.8 30.00	4	SS	2-2-5	7	1.50 1.50		
785												
35		34.00 - 35.00 SM, silty SAND with some clay, fine sand, white, gneissic saprolite, non-cohesive, dense, dry	SM		782.8 34.00 781.8 35.00	5	SS	5-13-20	33	1.50 1.50		
780		35.00 - 40.00 SM, silty SAND, white and grey, fine to medium sand, saprolite, dry, dense	SM									
40		40.00 - 44.40 ML, clayey SILT with trace sand and gravel, grey and brown some orange, saprolite, W<PL, very dense	ML		776.8 40.00	6	SS	13-25-26	51	1.00 1.50		
775												
45		Log continued on next page	SP		772.4 44.40	7	SS	13-50/4	<50	0.90 0.90		

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: W.Ballow  
CHECKED BY: Timothy Richards, PG  
DATE: 2/11/20



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

SHEET 2 of 2

DEPTH W.L.: 31.47  
ELEVATION W.L.: 785.53  
DATE W.L.: 1/13/2020  
TIME W.L.: 15:11

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20



# RECORD OF BOREHOLE B-93

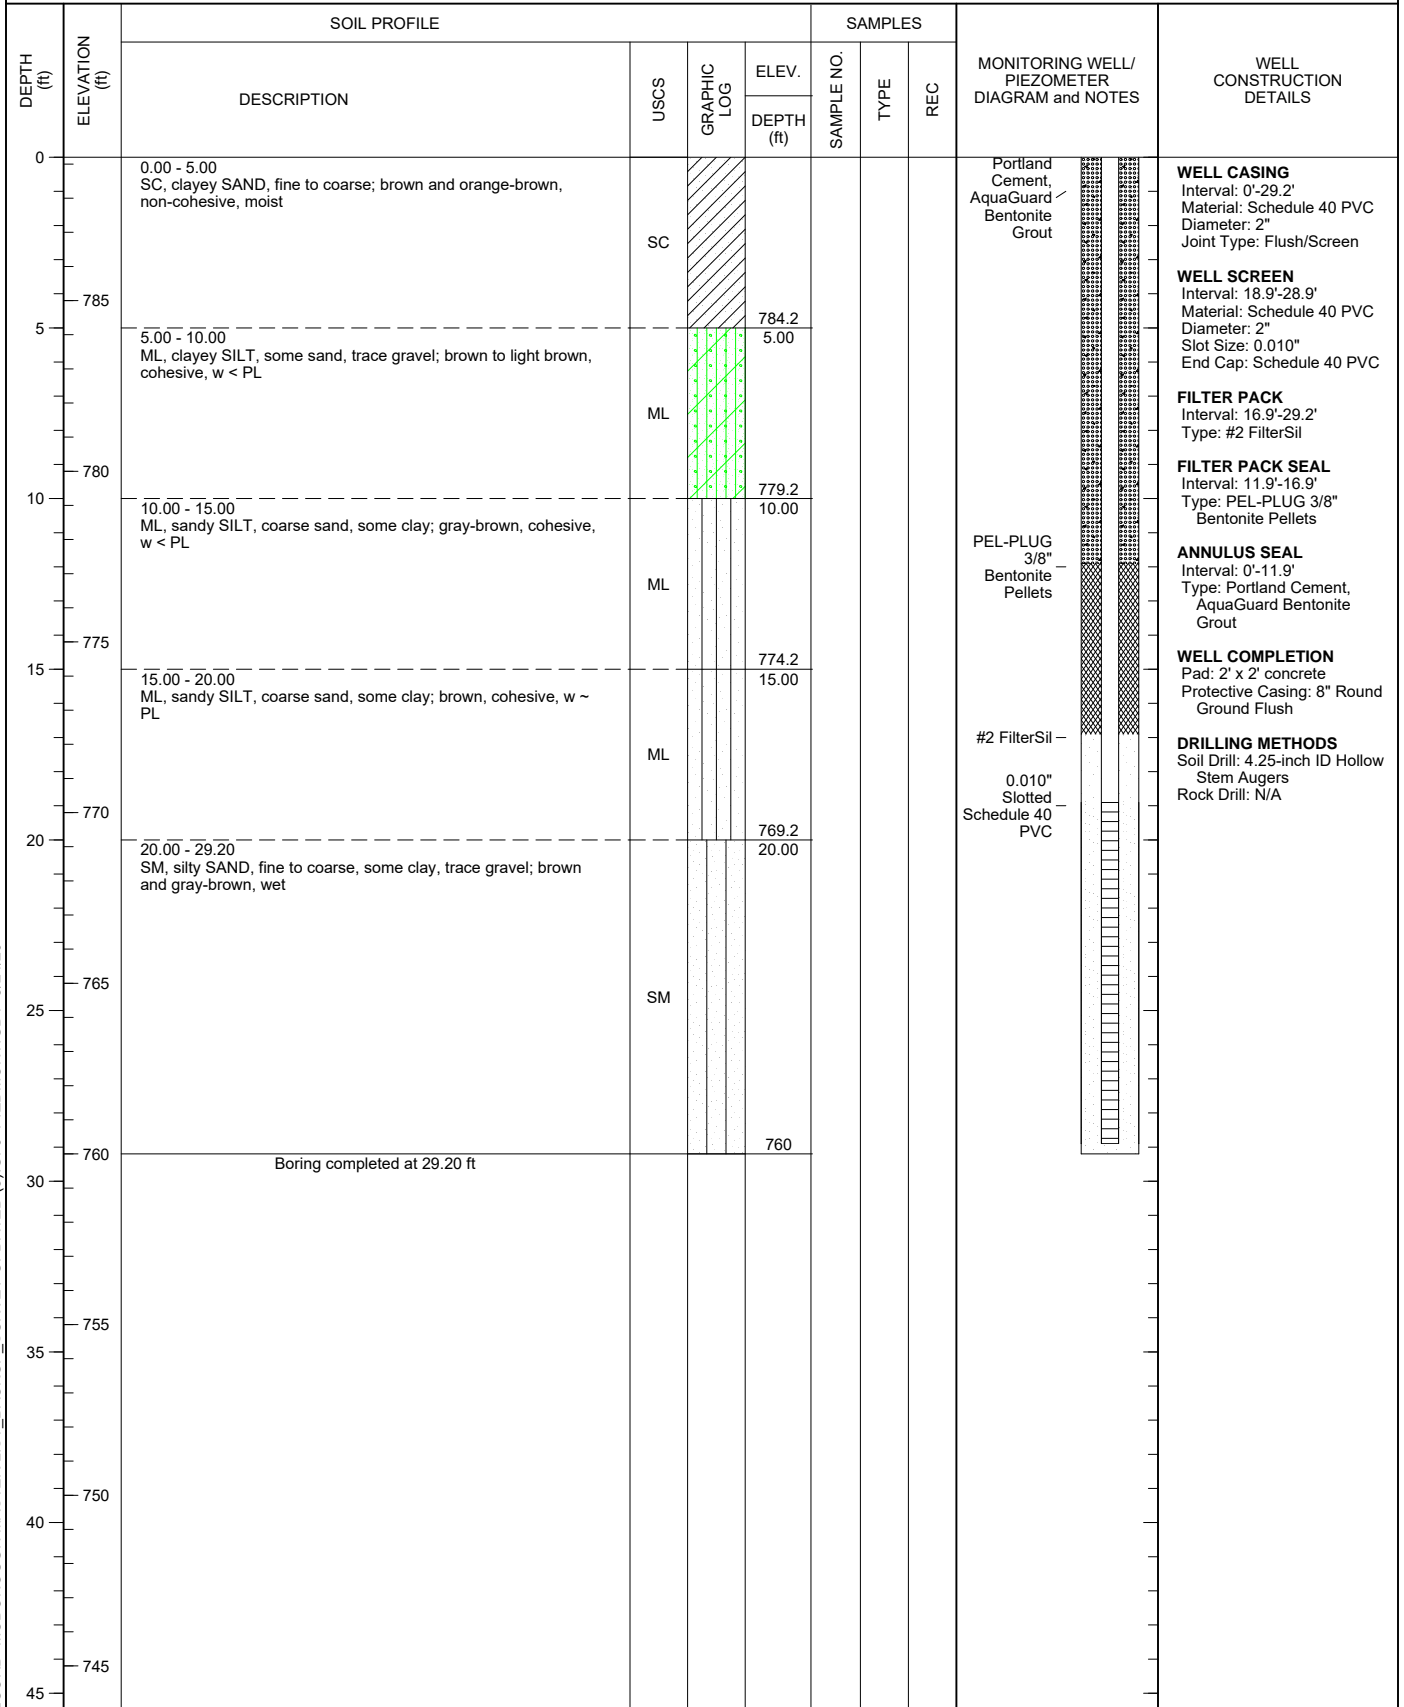
SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 29.20 ft  
LOCATION: West of site on site along Plant Atkinson Road

DRILL RIG: CME 550  
DATE STARTED: 12/12/19  
DATE COMPLETED: 12/12/19

NORTHING: 1,394,348.70  
EASTING: 2,202,946.70  
GS ELEVATION: 789.19  
TOC ELEVATION: 789.07 ft

DEPTH W.L.: 4.86  
ELEVATION W.L.: 784.34  
DATE W.L.: 1/14/2020  
TIME W.L.: 12:38



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: W.Ballow  
CHECKED BY: Timothy Richards, PG  
DATE: 2/11/20



# RECORD OF BOREHOLE B-97


SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 31.00 ft  
LOCATION: East of B-98

DRILL RIG: CME 550  
DATE STARTED: 2/11/20  
DATE COMPLETED: 2/11/20

NORTHING: 1,394,430.00  
EASTING: 2,203,008.30  
GS ELEVATION: 786.50  
TOC ELEVATION: 786.29 ft

DEPTH W.L.: 3.24 ft bTOC  
ELEVATION W.L.: 783.05  
DATE W.L.: 2/27/2020  
TIME W.L.: 10:54

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
0	785	0.00 - 10.00 Hydro Vac'd for utilities clearance										<b>WELL CASING</b> Interval: 0 ft-bgs - 31.7 ft-bgs Material: PVC Diameter: 2" Joint Type: Flush  <b>WELL SCREEN</b> Interval: 21.3 ft-bgs - 31.3 ft-bgs Material: Schedule 40 PVC Diameter: 3" Slot Size: 0.010" End Cap: 4"  <b>FILTER PACK</b> Interval: 13.5 ft-bgs - 21.3 ft-bgs Type: FilterSil Sand  <b>FILTER PACK SEAL</b> Interval: 7.5 ft-bgs - 13.5 ft-bgs Type: PEL-PLUG 3/8" Bentonite Pellets  <b>ANNULUS SEAL</b> Interval: 0 ft-bgs - 7.5 ft-bgs Type: Portland Cement, AquaGuard Bentonite Grout  <b>WELL COMPLETION</b> Pad: 2'x2' Concrete Pad Protective Casing: 8" Round Flush Mount  <b>DRILLING METHODS</b> Soil Drill: 4.25-inch ID Hollow Stem Augers Rock Drill: HQ Core Barrel
5	780				776.5							
10	775				10.00							
15	770	13.50 - 16.00 gravelly SILTY SAND, no plasticity, medium grained sand, coarse gravel; tan to dark brown; non-cohesive, moist, compact	SM		773.0 13.50	S-01	OD	15-17-15	32	0.92 1.50		
20	765	16.00 - 31.70 Fresh, foliated, dark grey and white, fine to coarse grained, strong, GNEISS			770.5 16.00							
25	760										3" PVC 0.010 Slot U-Pack - Screen	
30	755	29.00: Slightly weathered, porous, medium strong										
35	750	Boring completed at 31.70 ft			754.8 31.70							
40	745											
45												

BOREHOLE RECORD MCDONOUGH MASTER LIST BACKUP SURVEY UPDATED (5).GPJ PIEDMONT.GDT 9/2/20

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Heather Brissey  
CHECKED BY: Timothy Richards, PG  
DATE: 4/28/20



# RECORD OF BOREHOLE B-98


SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 19.40 ft  
LOCATION: West of B-97

DRILL RIG: Geoprobe 7822DT  
DATE STARTED: 2/10/20  
DATE COMPLETED: 2/10/20

NORTHING: 1,394,392.50  
EASTING: 2,202,934.00  
GS ELEVATION: 789.81  
TOC ELEVATION: 789.67 ft

DEPTH W.L.: 5.33 ft bTOC  
ELEVATION W.L.: 784.34  
DATE W.L.: 2/27/2020  
TIME W.L.: 10:36

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	REC		
0		0.00 - 10.00 Hydro Vac'd for utilities clearance								<b>WELL CASING</b> Interval: 0 ft-bgs - 19.4 ft-bgs Material: PVC Diameter: 2" Joint Type: Flush  <b>WELL SCREEN</b> Interval: 9 ft-bgs- 19 ft-bgs Material: Schedule 40 PVC Diameter: 3" Slot Size: 0.010" End Cap: 4"  <b>FILTER PACK</b> Interval: 7 ft-bgs - 9 ft-bgs Type: FilterSil Sand  <b>FILTER PACK SEAL</b> Interval: 4 ft-bgs - 7 ft-bgs Type: PEL-PLUG 3/8" Bentonite Pellets  <b>ANNULUS SEAL</b> Interval: 0 ft-bgs - 4 ft-bgs Type: Portland Cement, AquaGuard Bentonite Grout  <b>WELL COMPLETION</b> Pad: 2'x2' Concrete Pad Protective Casing: 8" Round Flush Mount  <b>DRILLING METHODS</b> Soil Drill: 4.25-inch ID Hollow Stem Augers Rock Drill: N/A
5	785									
10	780	10.00 - 19.40 Augered through with Geoprobe. No Soil data collected			779.8 10.00					
15	775									
20	770	Boring completed at 19.40 ft			770.4					
25	765									
30	760									
35	755									
40	750									
45	745									

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Cascade  
DRILLER: Eladio Gonzalaz

GA INSPECTOR: Heather Brissey  
CHECKED BY: Timothy Richards, PG  
DATE: 4/28/20



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

# RECORD OF BOREHOLE B-101D

SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 75.00 ft  
LOCATION: Next to DGWC-9

DRILL RIG: Geoprobe 8140LC  
DATE STARTED: 11/11/20  
DATE COMPLETED: 11/12/20

NORTHING: 1394063.6  
EASTING: 2204168.2  
GS ELEVATION: 821.24 ft  
TOC ELEVATION: 824.29 ft

DEPTH W.L.: 34.0  
ELEVATION W.L.: 790.3  
DATE W.L.: 11/12/20  
TIME W.L.: 0954

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	REC		
0		0.00 - 10.00 Air knife; FILL	FILL						Stick-up --	<b>B-101D</b> Borehole Diameter: 4" <b>WELL CASING</b> Interval: 0-75' Material: Schedule 40 PVC Diameter: 2" Joint Type: Screw fit with rubber seam <b>WELL SCREEN</b> Interval: 64.9'-74.9' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC <b>FILTER PACK</b> Interval: 62.5'-75.0' Type: FilterSil Quantity: 4-50 lbs bags <b>FILTER PACK SEAL</b> Interval: 59.0'-62.5' Type: 3/8" Uncoated Pel-Plug Quantity: 1-5 gallon bucket <b>ANNULUS SEAL</b> Interval: 0'-59.0' Type: AquaGuard Bentonite Grout Quantity: Approximately 80 gallons  <b>NOTES</b>
5										
10		10.00 - 15.00 (SM), SILTY SAND; tannish brown to reddish brown, low plasticity, w<pl, dry, loose to soft	SM		10.00					
15		15.00 - 16.00 (TWR), TRANSITIONALLY WEATHERED ROCK; dark gray, deeply weathered, fine to medium, poorly jointed	TWR		15.00	1	ROTO SONIC	8.00 10.00		
		16.00 - 20.00 (CL), CLAY; some sand, reddish brown, fine to coarse, low plasticity, w<PL, soft, moist to wet	CL		16.00					
20		20.00 - 23.00 (ML), SILT; trace to some gravels, reddish brown, low plasticity, w<PL, very soft, wet	ML		20.00	2	ROTO SONIC	4.00 5.00		
		23.00 - 25.00 (SM), SILTY SAND; trace gravels, tannish brown to gray, non-plastic, w<PL, loose, dry, TWR	TWR		23.00					
25		25.00 - 35.00 NO RECOVERY; material washed out of core barrel after switching to rock coring methods based on the TWR at the 23-25' interval.	NR		25.00	3	ROTO SONIC	0.00 10.00		
30										
35		35.00 - 40.00 NO RECOVERY; The core barrel was able to be advanced to depth, but casing was not able to advance to depth. Material was lost while extracting core barrel.	NR		35.00	4	ROTO SONIC	0.00 5.00	AquaGuard Bentonite Grout	
40		40.00 - 50.00 NO RECOVERY; The core barrel was able to be advanced to depth, but casing was not able to advance to depth. Material was lost while extracting core barrel.	NR		40.00	5	ROTO SONIC	0.00 10.00		
45										
50		Log continued on next page								

BOREHOLE RECORD MCDONOUGH MASTER LIST (2).GPJ PIEDMONT.GDT 2/3/21

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Fred Dorse

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/3/21



# RECORD OF BOREHOLE B-101D











SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 75.00 ft  
LOCATION: Next to DGWC-9

DRILL RIG: Geoprobe 8140LC  
DATE STARTED: 11/11/20  
DATE COMPLETED: 11/12/20

NORTHING: 1394063.6  
EASTING: 2204168.2  
GS ELEVATION: 821.24 ft  
TOC ELEVATION: 824.29 ft

DEPTH W.L.: 34.0  
ELEVATION W.L.: 790.3  
DATE W.L.: 11/12/20  
TIME W.L.: 0954

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS	
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	REC			
					DEPTH (ft)						
50		50.00 - 51.00 (ML), SANDY SILT; grayish brown, low to medium plasticity, w~PL, soft to firm, moist	ML		50.00	6	ROTO SONIC	9.50 10.00		<b>B-101D</b> Borehole Diameter: 4" <b>WELL CASING</b> Interval: 0-75' Material: Schedule 40 PVC Diameter: 2" Joint Type: Screw fit with rubber seam <b>WELL SCREEN</b> Interval: 64.9'-74.9' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC <b>FILTER PACK</b> Interval: 62.5'-75.0' Type: FilterSil Quantity: 4-50 lbs bags <b>FILTER PACK SEAL</b> Interval: 59.0'-62.5' Type: 3/8" Uncoated Pel-Plug Quantity: 1-5 gallon bucket <b>ANNULUS SEAL</b> Interval: 0'-59.0' Type: AquaGuard Bentonite Grout Quantity: Approximately 80 gallons  <b>NOTES</b>	
		51.00 - 52.00 (ML), SILT; trace gravels, schist fragments, grayish tan, non-plastic, non-cohesive, w<PL, loose, dry	ML		51.00						
		52.00 - 52.30 (TWR), TRANSITIONALLY WEATHERED ROCK; deeply weathered, R2, well foliated, fine to medium grain, iron staining.	TWR		52.30						
55		52.30 - 60.00 (ML), SANDY SILT; with gravel, grayish brown, low to medium plasticity, w~PL, soft to firm, moist	ML								
60		60.00 - 70.00 (SCHIST), BEDROCK; well foliated, highly crenulated, poorly jointed, iron staining	BR		60.00	7	ROTO SONIC	2.50 10.00			
65											
70		70.00 - 72.00 (ML), SANDY SILT; grayish brown, low to medium plasticity, w~PL, soft to firm, moist	ML		70.00	8	ROTO SONIC	3.55 5.00			
		72.00 - 75.00 (SCHIST), BEDROCK; well foliated, highly crenulated, poorly jointed, iron staining	BR		72.00						
75		Boring completed at 75.00 ft									
80											
85											
90											
95											
100											

BOREHOLE RECORD McDONOUGH MASTER LIST (2).GPJ PIEDMONT.GDT 2/3/21

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Fred Dorse

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/3/21





# RECORD OF BOREHOLE B-102D

SHEET 1 of 2












PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 85.00 ft  
LOCATION: Next to DGWC-10

DRILL RIG: Geoprobe 8140LC  
DATE STARTED: 11/9/20  
DATE COMPLETED: 11/10/20

NORTHING: 1393828.4  
EASTING: 2204200.4  
GS ELEVATION: 820.64 ft  
TOC ELEVATION: 823.42 ft

DEPTH W.L.: 34.0  
ELEVATION W.L.: 789.4  
DATE W.L.: 11/10/2020  
TIME W.L.: 1444

BOREHOLE RECORD MCDONOUGH MASTER LIST (2) (3) (1) (2) GPJ PIEDMONT.GDT 7/19/21

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS		
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	REC				
					DEPTH (ft)							
0		0.00 - 10.00 Air knife; FILL	FILL						Stick-up –   	<b>B-102D</b> Borehole Diameter: 4" <b>WELL CASING</b> Interval: 0'-85' Material: Schedule 40 PVC Diameter: 2" Joint Type: Screw fit with rubber seam <b>WELL SCREEN</b> Interval: 74.4'-84.4' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC <b>FILTER PACK</b> Interval: 72.0'-75.4' Type: FilterSil Quantity: 4-50 lbs bags <b>FILTER PACK SEAL</b> Interval: 67'-72' Type: 3/8" Uncoated Pel-Plug Quantity: 1-5 gallon bucket <b>ANNULUS SEAL</b> Interval: 0'-67' Type: AquaGuard Bentonite Grout Quantity: Approximately 120 gallons  <b>NOTES</b>		
5												
10		10.00 - 15.50 (CL), CLAY; red brown, trace to some sand, fine grain, w~PL, low plasticity, soft, moist			CL		10.00	1			ROTO SONIC	6.50 10.00
15		15.50 - 17.50 (ML), SILT; red brown, trace gravels, non-plastic to low plasticity, w<PL, soft, moist			ML		15.50					
		17.50 - 20.00 (ML), SILT; tanish-orange brown to silver, nonplastic to low plasticity, soft to loose	ML		17.50							
20		20.00 - 26.00 (SM), SILTY SAND; bronze, some coarse sand, nonplastic, dry to moist	SM		20.00	2	ROTO SONIC	10.00 10.00				
25		26.00 - 30.00 (SM), SILTY SAND; gray, some coarse sand, nonplastic, non-cohesive, compact, dry to moist	SM		26.00							
30		30.00 - 40.00 (SM), SILTY SAND; gray and orange-brown, non-plastic to low plasticity, firm to compact, dry to moist, soft to firm, contains muscovite	SM		30.00	3	ROTO SONIC	9.00 10.00	AquaGuard Bentonite – Grout			
35												
40		40.00 - 44.00 (SM), SILTY SAND; gray and orange-brown, non-plastic to low plasticity, firm to compact, dry to moist, soft to firm	SM		40.00							
45		44.00 - 46.00 (ML), SILT; gray, non-plastic to lows plasticity, soft, moist,	ML		44.00	4	ROTO SONIC	7.00 10.00				
		46.00 - 50.00 (SM), SILTY SAND; reddish brown, non-plastic to low plasticity, very soft, wet	SM		46.00							
50		Log continued on next page										

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Fred Dorse

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/3/21



# RECORD OF BOREHOLE B-102D


SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 85.00 ft  
LOCATION: Next to DGWC-10

DRILL RIG: Geoprobe 8140LC  
DATE STARTED: 11/9/20  
DATE COMPLETED: 11/10/20

NORTHING: 1393828.4  
EASTING: 2204200.4  
GS ELEVATION: 820.64 ft  
TOC ELEVATION: 823.42 ft

DEPTH W.L.: 34.0  
ELEVATION W.L.: 789.4  
DATE W.L.: 11/10/2020  
TIME W.L.: 1444

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	REC		
50		50.00 - 51.00 (SM), SILTY SAND; reddish brown, non-plastic to low plasticity, very soft, wet	SM		50.00	5	ROTO SONIC	5.00 5.00	 <p>3/8" Uncoated Pel-Plug</p> <p>Sand Filter Pack</p> <p>U-Pack Screen</p>	<b>B-102D</b> Borehole Diameter: 4" <b>WELL CASING</b> Interval: 0'-85' Material: Schedule 40 PVC Diameter: 2" Joint Type: Screw fit with rubber seam <b>WELL SCREEN</b> Interval: 74.4'-84.4' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC <b>FILTER PACK</b> Interval: 72.0'-75.4' Type: FilterSil Quantity: 4-50 lbs bags <b>FILTER PACK SEAL</b> Interval: 67'-72' Type: 3/8" Uncoated Pel-Plug Quantity: 1-5 gallon bucket <b>ANNULUS SEAL</b> Interval: 0'-67' Type: AquaGuard Bentonite Grout Quantity: Approximately 120 gallons  <b>NOTES</b>
		51.00 - 55.00 (SM), SILTY SAND; gray, w<PL, fine to compact, dry to moist, contains muscovite	SM		51.00					
55		55.00 - 60.00 (SM), SILTY SAND; gray to yellow orange, w<PL, fine to stiff, dry to moist, saprolitic	SM		55.00	6	ROTO SONIC	5.00 5.00		
60		60.00 - 65.00 (ML), SILT; gray to light brown, w<PL, dense, dry	ML		60.00	7	ROTO SONIC	4.00 5.00		
65		65.00 - 70.00 (TWR), TRANSITIONALLY WEATHERED ROCK; silty sand, gray, low plasticity, w<PL, stiff to hard, dry, saprolitic	TWR		65.00	8	ROTO SONIC	5.00 5.00		
70		70.00 - 75.00 (SCHIST), BEDROCK, dark gray to black, fine to medium grain, moderately foliated, poorly jointed, high crenulated, weak to strong rock, slightly to moderately weathered, feldspar, muscovite, schist	BR		70.00	9	ROTO SONIC	5.00 5.00		
75		75.00 - 85.00 (SCHIST), BEDROCK; dark gray to black, moderately foliated, poorly jointed, high crenulated, weak to strong rock, slightly to moderately weathered, feldspar, muscovite, schist	BR		75.00	10	ROTO SONIC	7.00 10.00		
85		Boring completed at 85.00 ft								
90										
95										
100										

BOREHOLE RECORD MCDONOUGH MASTER LIST (2) (3) (1) (2) GPJ PIEDMONT.GDT 7/19/21

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Fred Dorse

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/3/21



# RECORD OF BOREHOLE B-104D

SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 60.00 ft  
LOCATION: East of DGWC-48

DRILL RIG: Geoprobe 8140LC  
DATE STARTED: 10/20/20  
DATE COMPLETED: 10/20/20

NORTHING: 1391318.3  
EASTING: 2202298.5  
GS ELEVATION: 785.31 ft  
TOC ELEVATION: 787.90 ft

DEPTH W.L.: 12.0  
ELEVATION W.L.: 775.9  
DATE W.L.: 10/20/2020  
TIME W.L.: 1818

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	REC		
0		0.00 - 10.00 Air knife; FILL	FILL						Stick-up --	<b>B-104D</b> Borehole Diameter: 4" <b>WELL CASING</b> Interval: 0'-60' Material: Schedule 40 PVC Diameter: 2" Joint Type: Screw fit with rubber seam <b>WELL SCREEN</b> Interval: 50'-60' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC <b>FILTER PACK</b> Interval: 47.15'-60.0' Type: FilterSil Quantity: 4-50 lbs bags <b>FILTER PACK SEAL</b> Interval: 44'-47.15' Type: 3/8" Uncoated Pel-Plug Quantity: 1-5 gallon bucket <b>ANNULUS SEAL</b> Interval: 0'-44' Type: AquaGuard Bentonite Grout Quantity: Approximately 40 gallons  <b>NOTES</b>
10		10.00 - 12.00 (CL), CLAY; red brown; moist, soft, low plasticity, w<PL, FILL	CL		10.00					
12		12.00 - 22.00 (ML), SILT; dark brown to gray; non-plastic to low plasticity, dry to moist, w<PL, soft to firm	ML		12.00	1	ROTO SONIC	8.00 8.00		
20						2	ROTO SONIC	4.00 4.00		
22		22.00 - 30.00 (ML), SILT; dark brown; w~PL, moist to wet, soft to firm, contains gravels of biotite gneiss (trace)	ML		22.00	3	ROTO SONIC	8.00 8.00	AquaGuard Bentonite -- Grout	
30		30.00 - 35.00 (TWR), TRANSITIONALLY WEATHERED ROCK; rust brown to gray; deeply weathered biotite gneiss, poorly foliated, poorly jointed, iron staining	TWR		30.00	4	ROTO SONIC	6.55 10.00		
35		35.00 - 55.50 (GNEISS), BEDROCK; biotite, quartz, feldspar, light to dark gray, strong to medium strong, fresh to slightly weathered, locally contains iron staining and garnets	BR		35.00	5	ROTO SONIC	2.10 5.00	3/8" Uncoated -- Pel-Plug	
45						6	ROTO SONIC	4.35 7.50		
50		Log continued on next page							Sand Filter --	

BOREHOLE RECORD MCDONOUGH MASTER LIST (2).GPJ PIEDMONT.GDT 2/3/21

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Fred Dorse

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/3/21



# RECORD OF BOREHOLE B-104D




SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 60.00 ft  
LOCATION: East of DGWC-48

DRILL RIG: Geoprobe 8140LC  
DATE STARTED: 10/20/20  
DATE COMPLETED: 10/20/20

NORTHING: 1391318.3  
EASTING: 2202298.5  
GS ELEVATION: 785.31 ft  
TOC ELEVATION: 787.90 ft

DEPTH W.L.: 12.0  
ELEVATION W.L.: 775.9  
DATE W.L.: 10/20/2020  
TIME W.L.: 1818

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	REC		
					DEPTH (ft)					
50		35.00 - 55.50 (GNEISS), BEDROCK; biotite, quartz, feldspar, light to dark gray, strong to medium strong, fresh to slightly weathered, locally contains iron staining and garnets <i>(Continued)</i>	BR			6		4.35 7.50	<div>Pack</div> <div>U-Pack Screen</div> 	<b>B-104D</b> Borehole Diameter: 4" <b>WELL CASING</b> Interval: 0'-60' Material: Schedule 40 PVC Diameter: 2" Joint Type: Screw fit with rubber seam <b>WELL SCREEN</b> Interval: 50'-60' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC <b>FILTER PACK</b> Interval: 47.15'-60.0' Type: FilterSil Quantity: 4-50 lbs bags <b>FILTER PACK SEAL</b> Interval: 44'-47.15' Type: 3/8" Uncoated Pel-Plug Quantity: 1-5 gallon bucket <b>ANNULUS SEAL</b> Interval: 0'-44' Type: AquaGuard Bentonite Grout Quantity: Approximately 40 gallons  <b>NOTES</b>
55		55.50 - 60.00 (SCHIST), BEDROCK; quartz, muscovite, gray to silver, medium grain, medium strong, fresh to moderately weathered	BR		55.50	7	ROTO SONIC	6.15 7.50		
60		Boring completed at 60.00 ft								
65										
70										
75										
80										
85										
90										
95										
100										

BOREHOLE RECORD MCDONOUGH MASTER LIST (2).GPJ PIEDMONT.GDT 2/3/21

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Fred Dorse

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/3/21



# RECORD OF BOREHOLE B-106D

SHEET 1 of 2









PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 80.00 ft  
LOCATION: North of DGWC-8

DRILL RIG: Geoprobe 8140LC  
DATE STARTED: 11/12/20  
DATE COMPLETED: 11/13/20

NORTHING: 1394327.1  
EASTING: 2203869.2  
GS ELEVATION: 823.39 ft  
TOC ELEVATION: 826.21 ft

DEPTH W.L.: 37.0  
ELEVATION W.L.: 789.2  
DATE W.L.: 11/13/2020  
TIME W.L.: 1652

BOREHOLE RECORD MCDONOUGH MASTER LIST (2) GPJ PIEDMONT.GDT 2/3/21

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM AND NOTES	WELL CONSTRUCTION DETAILS		
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	REC				
					DEPTH (ft)							
0		0.00 - 10.00 Air knife; FILL	FILL						Stick-up – 	<b>B-106D</b> Borehole Diameter: 4" <b>WELL CASING</b> Interval: 0'-80' Material: Schedule 40 PVC Diameter: 2" Joint Type: Screw fit with rubber seam <b>WELL SCREEN</b> Interval: 69.4'-79.4' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC <b>FILTER PACK</b> Interval: 66.61'-80' Type: FilterSil Quantity: 4-50 lbs bags <b>FILTER PACK SEAL</b> Interval: 62.85'-66.61' Type: 3/8" Uncoated Pel-Plug Quantity: 1-5 gallon bucket <b>ANNULUS SEAL</b> Interval: 0'-62.85' Type: AquaGuard Bentonite Grout Quantity:  <b>NOTES</b>		
5												
10		10.00 - 16.75 (ML), SILT; some fine to medium sand, some gravel, moist, firm, w<PL, low to medium plasticity			ML		10.00	1			ROTO SONIC	8.20 10.00
15		16.75 - 18.10 (ML), SILT; some coarse sand, moist, stiff, w<PL			ML		16.75					
20		18.10 - 20.00 (CL), CLAY; red to red-brown, some coarse sand, dry to moist, w<PL, soft, some muscovite, Fill	CL		18.10							
25		20.00 - 28.00 (ML), SILT; brown, some fines, very fine to coarse sand, wet, soft to very soft, w<PL, medium plasticity,	ML		20.00	2	ROTO SONIC	10.00 10.00				
30		28.00 - 30.00 (SP), SAND; uniformly graded, some silt, non-cohesive, loose, moist, non-plastic	SP		28.00				AquaGuard Bentonite – Grout			
35		30.00 - 32.00 (SM), SILTY SAND; brown, trace gravel, dry to moist, cohesive, firm to stiff, w<PL, low plasticity, some crenulations, saprolitic	SM		30.00	3	ROTO SONIC	5.00 5.00				
40		32.00 - 35.00 (SM), SILTY SAND; dry to moist, cohesive, firm to stiff, w~PL, low to medium plasticity	SM		32.00							
45		35.00 - 40.00 (ML), SANDY SILT; brown, fine to coarse sand, micas, firm to stiff, w>PL, dry to wet	ML		35.00	4	ROTO SONIC	5.00 5.00				
50		40.00 - 45.00 (SM), SILTY SAND; brown, fine to coarse sand, some gravel, schist, quartz vein fragments, micas, firm to stiff, w<PL, moist, medium plasticity	SM		40.00	5	ROTO SONIC	5.00 5.00				
55		45.00 - 47.00 (SM), SILTY SAND; brown, fine to coarse sand, some gravel, schist, quartz vein fragments, micas, stiff to very stiff, w>PL, moist, medium plasticity, saprolitic	SM		45.00	6	ROTO SONIC	2.00				
60		47.00 - 60.00 NO RECOVERY; material too loose and continues to fall out of core barrel	NR		47.00	7		0.00 13.00				
65		Log continued on next page										

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Fred Dorse

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/3/21



# RECORD OF BOREHOLE B-106D





SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 80.00 ft  
LOCATION: North of DGWC-8

DRILL RIG: Geoprobe 8140LC  
DATE STARTED: 11/12/20  
DATE COMPLETED: 11/13/20

NORTHING: 1394327.1  
EASTING: 2203869.2  
GS ELEVATION: 823.39 ft  
TOC ELEVATION: 826.21 ft

DEPTH W.L.: 37.0  
ELEVATION W.L.: 789.2  
DATE W.L.: 11/13/2020  
TIME W.L.: 1652

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	REC		
50		47.00 - 60.00 NO RECOVERY; material too loose and continues to fall out of core barrel <i>(Continued)</i>	NR			7	ROTO SONIC	0.00 13.00		<b>B-106D</b> Borehole Diameter: 4" <b>WELL CASING</b> Interval: 0'-80' Material: Schedule 40 PVC Diameter: 2" Joint Type: Screw fit with rubber seam <b>WELL SCREEN</b> Interval: 69.4'-79.4' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC <b>FILTER PACK</b> Interval: 66.61'-80' Type: FilterSil Quantity: 4-50 lbs bags <b>FILTER PACK SEAL</b> Interval: 62.85'-66.61' Type: 3/8" Uncoated Pel-Plug Quantity: 1-5 gallon bucket <b>ANNULUS SEAL</b> Interval: 0'-62.85' Type: AquaGuard Bentonite Grout Quantity: <b>NOTES</b>
55										
60		60.00 - 65.00 (SCHIST), BEDROCK; silvery blue, well foliated, poorly jointed, moderate to deeply weathered, weak to medium strong rock, iron staining	BR		60.00	8	ROTO SONIC	1.60 5.00		
65										
70		65.00 - 75.00 (BIOTITE GNEISS), BEDROCK; light gray to dark gray, zones of muscovite schistosity, very fine grain, moderate to poor foliation, poorly jointed, fresh to moderately weathered, medium strong, iron staining, feldspar, quartz, muscovite	BR		65.00	9	ROTO SONIC	5.20 10.00	Sand Filter Pack	
75										
80		75.00 - 80.00 (BIOTITE GNEISS), BEDROCK; light gray to dark gray, zones of muscovite schistosity, very fine grain, moderate to poor foliation, poorly jointed, fresh to moderately weathered, medium strong, iron staining, feldspar, quartz	BR		75.00	10	ROTO SONIC	3.40 5.00	U-Pack Screen	
85		Boring completed at 80.00 ft								
90										
95										
100										

BOREHOLE RECORD MCDONOUGH MASTER LIST (2).GPJ PIEDMONT.GDT 2/3/21

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Fred Dorse

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/3/21



# RECORD OF BOREHOLE B-107D












SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 85.75 ft  
LOCATION: Southwest of DGWC-19

DRILL RIG: Geoprobe 8140LC  
DATE STARTED: 10/28/20  
DATE COMPLETED: 10/28/20

NORTHING: 1392334.5  
EASTING: 2202596.4  
GS ELEVATION: 820.44 ft  
TOC ELEVATION: 823.38 ft

DEPTH W.L.: 21.8  
ELEVATION W.L.: 801.6  
DATE W.L.: 10/28/2020  
TIME W.L.: 1440

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS						
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	REC								
					DEPTH (ft)											
0		0.00 - 10.00 Air knife; FILL	FILL						Stick-up – 			<b>B-107D</b> Borehole Diameter: 4" <b>WELL CASING</b> Interval: 0'-85.1' Material: Schedule 40 PVC Diameter: 2" Joint Type: Screw fit with rubber seam <b>WELL SCREEN</b> Interval: 75.1'-85.1' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC <b>FILTER PACK</b> Interval: 72.25'-85.5' Type: FilterSil Quantity: 4.5-50 lbs bags <b>FILTER PACK SEAL</b> Interval: 68.8'-72.25' Type: 3/8" Uncoated Pel-Plug Quantity: 1-5 gallon <b>ANNULUS SEAL</b> Interval: 0'-68.8' Type: AquaGuard Bentonite Grout Quantity: Approximately 80 gallons  <b>NOTES</b>				
5																
10		10.00 - 20.00 (CL-ML), SILT and CLAY; red brown to brown, trace sand, low to medium plasticity, soft to firm, moist, contains muscovite	CL-ML		10.00	1	ROTO SONIC	7.00 10.00								
15																
20		20.00 - 38.00 (SM), SILTY SAND; brown to tannish brown, trace sand, w<PL, low plasticity, loose to compact, large grains of muscovite	SM		20.00	2	ROTO SONIC	4.30 10.00					AquaGuard Bentonite – Grout			
25																
30																
35						3	ROTO SONIC	10.00 10.00								
40		38.00 - 40.00 (SM), SILTY SAND; black and silverish gray, fine to medium, non-plastic, w<PL, loose sand, moist,	SM		38.00											
45		40.00 - 50.00 (SM-ML), SILTY SAND to SILT; brown to silverish brown, moist to wet, w<PL, soft to stiff	SM		40.00	4	ROTO SONIC	9.00 10.00								
50																
Log continued on next page																

BOREHOLE RECORD MCDONOUGH MASTER LIST (2) GPJ PIEDMONT.GDT 2/3/21

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Fred Dorse

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/3/21





# RECORD OF BOREHOLE B-107D


SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 85.75 ft  
LOCATION: Southwest of DGWC-19

DRILL RIG: Geoprobe 8140LC  
DATE STARTED: 10/28/20  
DATE COMPLETED: 10/28/20

NORTHING: 1392334.5  
EASTING: 2202596.4  
GS ELEVATION: 820.44 ft  
TOC ELEVATION: 823.38 ft

DEPTH W.L.: 21.8  
ELEVATION W.L.: 801.6  
DATE W.L.: 10/28/2020  
TIME W.L.: 1440

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	REC		
50		50.00 - 60.00 (SM-ML), SILTY SAND to SILT; brown to silverish brown, moist to wet, w<PL, soft to stiff	SM		50.00	5	ROTO SONIC	6.00 10.00		<b>B-107D</b> Borehole Diameter: 4" <b>WELL CASING</b> Interval: 0'-85.1' Material: Schedule 40 PVC Diameter: 2" Joint Type: Screw fit with rubber seam <b>WELL SCREEN</b> Interval: 75.1'-85.1' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC <b>FILTER PACK</b> Interval: 72.25'-85.5' Type: FilterSil Quantity: 4.5-50 lbs bags <b>FILTER PACK SEAL</b> Interval: 68.8'-72.25' Type: 3/8" Uncoated Pel-Plug Quantity: 1-5 gallon <b>ANNULUS SEAL</b> Interval: 0'-68.8' Type: AquaGuard Bentonite Grout Quantity: Approximately 80 gallons  <b>NOTES</b>
55										
60		60.00 - 67.00 NO RECOVERY; material was washed away by coring methods. Material from 63' to 67' is inferred as TWR.	NR		60.00	6	ROTO SONIC	0.00 7.00		
65										
70		67.00 - 75.00 (GNEISS), BEDROCK; dark gray to black, well foliated, poorly jointed, slightly to deeply weathered, weak to medium strong, feldspar, quartz, muscovite,	BR		67.00	7	ROTO SONIC	6.70 8.00		
75										
80		75.00 - 85.75 (GNEISS), BEDROCK; dark gray to black, well foliated, poorly jointed, slightly to deeply weathered, weak to medium strong, feldspar, quartz, muscovite,	BR		75.00	8	ROTO SONIC	6.80 10.75		
85										
		Boring completed at 85.75 ft			85.75					
90										
95										
100										

BOREHOLE RECORD MCDONOUGH MASTER LIST (2).GPJ PIEDMONT.GDT 2/3/21

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Fred Dorse

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/3/21



# RECORD OF BOREHOLE B-108D








SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 80.00 ft  
LOCATION: Next to DGWC-20

DRILL RIG: Geoprobe 8140LC  
DATE STARTED: 10/26/20  
DATE COMPLETED: 10/27/20

NORTHING: 1392156.1  
EASTING: 2202312.5  
GS ELEVATION: 818.33 ft  
TOC ELEVATION: 821.13 ft

DEPTH W.L.: 17.7  
ELEVATION W.L.: 803.43  
DATE W.L.: 10/27/2020  
TIME W.L.: 0915

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM AND NOTES	WELL CONSTRUCTION DETAILS	
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	REC			
					DEPTH (ft)						
0		0.00 - 10.00 Air knife; FILL	FILL						Stick-up – 	<b>B-108D</b> Borehole Diameter: 4" <b>WELL CASING</b> Interval: 0'-80.0' Material: Schedule 40 PVC Diameter: 2" Joint Type: Screw fit with rubber seam <b>WELL SCREEN</b> Interval: 69'-79' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC <b>FILTER PACK</b> Interval: 65.85'-79' Type: FilterSil Quantity: 4-50 lbs bags <b>FILTER PACK SEAL</b> Interval: 62.5'-65.85' Type: 3/8" Uncoated Pel-Plug Quantity: 1- 5 gallon bucket <b>ANNULUS SEAL</b> Interval: 0'-62.5' Type: AquaGuard Bentonite Grout Quantity: Approximately 80 gallons  <b>NOTES</b>	
5											
10		10.00 - 12.00 (CL), CLAY;w<PL, low plasticity, moist to wet, Fill			CL		10.00				
15		12.00 - 20.00 (ML), SILT; tannish brown with black spots, trace fine sand, w<PL, non-plastic to low plasticity, compact to firm, moist	ML		12.00	1	ROTO SONIC	<u>10.00</u> 10.00	AquaGuard Bentonite – Grout		
20		20.00 - 30.00 (ML), SILT; tannish brown with black/silver spots, trace to some fine sand, w<PL, low plasticity, dry to moist, firm, saprolite, deeply weather biotite gneiss			20.00			<u>9.50</u> 10.00			
25			ML			2	ROTO SONIC	<u>8.00</u> 10.00			
30		30.00 - 40.00 (ML-SM), SILT and SILTY SAND; silverish brown, trace clay, w<PL, nonplastic to low plasticity, moist, firm to stiff, contains muscovite, saprolite	30.00		<u>6.75</u> 10.00						
35			SM			3	ROTO SONIC	<u>8.00</u> 10.00			
40		40.00 - 50.00 (ML-SM), SILT and SILTY SAND; silverish brown, trace clay, w<PL, nonplastic to low plasticity, moist, soft to firm, contains muscovite, saprolite	40.00		<u>6.75</u> 10.00						
45			SM			4	ROTO SONIC	<u>6.75</u> 10.00			
50											
Log continued on next page											

BOREHOLE RECORD MCDONOUGH MASTER LIST (2).GPJ PIEDMONT.GDT 2/3/21

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Fred Dorse

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/3/21



# RECORD OF BOREHOLE B-108D

SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 80.00 ft  
LOCATION: Next to DGWC-20

DRILL RIG: Geoprobe 8140LC  
DATE STARTED: 10/26/20  
DATE COMPLETED: 10/27/20

NORTHING: 1392156.1  
EASTING: 2202312.5  
GS ELEVATION: 818.33 ft  
TOC ELEVATION: 821.13 ft

DEPTH W.L.: 17.7  
ELEVATION W.L.: 803.43  
DATE W.L.: 10/27/2020  
TIME W.L.: 0915

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	REC		
50		50.00 - 51.00 (SP), SAND; black to dark gray, w<PL, non-plastic, firm, loose, wet	SP		50.00					
		51.00 - 57.50 (ML), SILT; gray to brown, w<PL, low plasticity, firm to stiff, moist, saprolite	ML		51.00	5	ROTO SONIC	7.50 7.50		
55										
60		57.50 - 65.00 (GNEISS), BEDROCK; dark brown to gray, well foliated, poorly jointed, deeply weathered, weak rock, iron staining	BR		57.50	6	ROTO SONIC	1.25 7.50		
65										
70		65.00 - 75.00 (GNEISS), BEDROCK; dark brown to gray, well foliated, poorly jointed, fresh to slightly weathered, medium strong rock, iron staining	BR		65.00	7	ROTO SONIC	6.55 10.00		
75										
80		75.00 - 80.00 (GNEISS), BEDROCK; dark brown to gray, well foliated, poorly jointed, fresh to slightly weathered, medium strong rock, iron staining	BR		75.00	8	ROTO SONIC	4.80 5.00		
85		Boring completed at 80.00 ft								
90										
95										
100										

**B-108D**  
Borehole Diameter: 4"  
**WELL CASING**  
Interval: 0'-80.0'  
Material: Schedule 40 PVC  
Diameter: 2"  
Joint Type: Screw fit with rubber seam  
**WELL SCREEN**  
Interval: 69'-79'  
Material: Schedule 40 PVC  
Diameter: 2"  
Slot Size: .010"  
End Cap: Schedule 40 PVC  
**FILTER PACK**  
Interval: 65.85'-79'  
Type: FilterSil  
Quantity: 4-50 lbs bags  
**FILTER PACK SEAL**  
Interval: 62.5'-65.85'  
Type: 3/8" Uncoated Pel-Plug  
Quantity: 1- 5 gallon bucket  
**ANNULUS SEAL**  
Interval: 0'-62.5'  
Type: AquaGuard Bentonite Grout  
Quantity: Approximately 80 gallons

## NOTES

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Fred Dorse

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/3/21



BOREHOLE RECORD MCDONOUGH MASTER LIST (2).GPJ PIEDMONT.GDT 2/3/21

# RECORD OF BOREHOLE B-111D

SHEET 1 of 2






PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 85.00 ft  
LOCATION: West of DGWC-5

DRILL RIG: Geoprobe 8140LC  
DATE STARTED: 11/1/20  
DATE COMPLETED: 11/3/20

NORTHING: 1394303.6  
EASTING: 2202956.4  
GS ELEVATION: 788.99 ft  
TOC ELEVATION: 791.84 ft

DEPTH W.L.: 8.9  
ELEVATION W.L.: 755.30  
DATE W.L.: 11/3/2020  
TIME W.L.: 0815

BOREHOLE RECORD MCDONOUGH MASTER LIST (2) (3) (1) GPJ PIEDMONT GDT 2/10/21

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM AND NOTES	WELL CONSTRUCTION DETAILS		
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	REC				
					DEPTH (ft)							
0		0.00 - 10.00 Air Knife; Fill	FILL						Stick-up – 	<b>B-111D</b> Borehole Diameter: 6" <b>WELL CASING</b> Interval: 0'-85' Material: Schedule 40 PVC Diameter: 2" Joint Type: Screw fit with rubber seam <b>WELL SCREEN</b> Interval: 74.15'-84.15' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC <b>FILTER PACK</b> Interval: 72.1'-84.15' Type: FilterSil Quantity: 3-50 lbs bags <b>FILTER PACK SEAL</b> Interval: 68.7'-72.1' Type: 3/8" Uncoated Pel-Plug Quantity: 1-5 gallon bucket <b>ANNULUS SEAL</b> Interval: 0'-68.7' Type: AquaGuard Bentonite Grout Quantity: Approximately 80 gallons  <b>NOTES</b>		
5												
10		10.00 - 15.00 (ML), SILT; tan to brown, trace fine to coarse sand, moist to wet, soft, low plasticity, w<Pl, saprolite			ML		10.00	1			ROTO SONIC	
15		15.00 - 20.00 (ML), SILT; gray and green to brown, low plasticity, w<PL, moist, soft to firm	ML		15.00	10.00 10.00						
20		20.00 - 26.00 (ML), SILT; gray and green to brown, low plasticity, w<PL, moist, soft to firm, more saprolitic	ML		20.00	8.00 8.00						
25		26.00 - 27.00 (TWR), TRANSITIONALLY WEATHERED ROCK; silt, gray and green to brown, low plasticity, w<PL, moist, soft to firm, saprolitic, locally contains gravels of augen biotite gneiss	TWR		26.00	2	ROTO SONIC		AquaGuard Bentonite – Grout			
30		27.00 - 34.00 (GNEISS), BEDROCK; quartz, feldspar, biotite, white to dark gray, moderately weathered, medium strong, iron staining, locally contains augened feldspars	BR		27.00			3		1.00 2.00		
35		34.00 - 51.50 (GNEISS), BEDROCK; biotite, quartz, feldspar, white to light gray, well foliated, poorly jointed, fresh to slightly weathered, medium strong, iron staining, locally contains K-spar augens			4			2.20 4.00				
40			BR		34.00	5	ROTO SONIC	1.70 6.00				
45						6	ROTO SONIC	10.00 10.00				
50		Log continued on next page										

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Fred Dorse

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/3/21



# RECORD OF BOREHOLE B-111D

SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 85.00 ft  
LOCATION: West of DGWC-5

DRILL RIG: Geoprobe 8140LC  
DATE STARTED: 11/1/20  
DATE COMPLETED: 11/3/20

NORTHING: 1394303.6  
EASTING: 2202956.4  
GS ELEVATION: 788.99 ft  
TOC ELEVATION: 791.84 ft

DEPTH W.L.: 8.9  
ELEVATION W.L.: 755.30  
DATE W.L.: 11/3/2020  
TIME W.L.: 0815

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	REC		
50			BR							
51.50 - 58.00		(GNEISS), BEDROCK; feldspar, quartz, biotite, white to light gray, well foliated, poorly jointed, fresh to slightly weathered, medium strong, locally contains epidote	BR		51.50	7	ROTO SONIC	7.00 10.00		
58.00 - 85.00		(GNEISS), BEDROCK; biotite, feldspar, quartz, white to light gray, well foliated, poorly jointed, fresh to slightly weathered, medium to strong,	BR		58.00	8	ROTO SONIC	5.00 5.00		
						9	ROTO SONIC	5.00 5.00		
						10	ROTO SONIC	5.00 5.00		
						11	ROTO SONIC	10.00 10.00		
Boring completed at 85.00 ft										



**B-111D**  
Borehole Diameter: 6"  
**WELL CASING**  
Interval: 0'-85'  
Material: Schedule 40 PVC  
Diameter: 2"  
Joint Type: Screw fit with rubber seam  
**WELL SCREEN**  
Interval: 74.15'-84.15'  
Material: Schedule 40 PVC  
Diameter: 2"  
Slot Size: .010"  
End Cap: Schedule 40 PVC  
**FILTER PACK**  
Interval: 72.1'-84.15'  
Type: FilterSil  
Quantity: 3-50 lbs bags  
**FILTER PACK SEAL**  
Interval: 68.7'-72.1'  
Type: 3/8" Uncoated Pel-Plug  
Quantity: 1-5 gallon bucket  
**ANNULUS SEAL**  
Interval: 0'-68.7'  
Type: AquaGuard Bentonite Grout  
Quantity: Approximately 80 gallons

## NOTES

BOREHOLE RECORD MCDONOUGH MASTER LIST (2) (3) (1).GPJ PIEDMONT.GDT 2/10/21

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Fred Dorse

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/3/21



# RECORD OF BOREHOLE B-120D

SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 166849621  
DRILLED DEPTH: 70.00 ft  
LOCATION: Offset of B-3

DRILL RIG: TS1 150CC  
DATE STARTED: 3/5/21  
DATE COMPLETED: 3/6/21

NORTHING: 1,394,047.2  
EASTING: 2,202,436.4  
GS ELEVATION: 834.03  
TOC ELEVATION: 836.42 ft

DEPTH W.L.: 33.76  
ELEVATION W.L.: 802.66  
DATE W.L.: 4/9/2021  
TIME W.L.: 12:26

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			PIEZOMETER DIAGRAM AND NOTES	PIEZOMETER CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	NO.	PHOTO	REC		
0		0.00 - 10.00 FILL- Backfilled with cuttings from air knife clearance								
830										
5							Air Knife	0.00 10.00		
825										
10		10.00 - 20.00 ML, Clayey SILT with trace medium to coarse sand, non to low plasticity; tan to brown; loose, dry to moist, W<PL			824 10.00					
820			ML			1		6.80 10.00		
15										
815										
20		20.00 - 27.00 SM, SILTY SAND with some gravels, non plasticity; light gray to gray; loose, dry to moist, W<PL			814 20.00					
810			SM							
25						2		10.00 10.00		
805		27.00 - 30.00 ML, Clayey SILT with trace medium to coarse sand, non to low plasticity; tan to brown; loose, dry to moist, W<PL			807 27.00					
30		30.00 - 36.00 SM, SILTY SAND with trace fine to coarse gravels, non plasticity; tan to brown; compact to dense, dry to moist, W<PL			804 30.00					
800			SM							
35						3		8.00 10.00	AquaGuard - Grout	
795		36.00 - 40.00 TWR, Transitional Weathered Rock; breaks down to a SM, SILTY SAND with trace fine to coarse gravels, non plasticity; olive to tan to brown; compact to dense, dry to moist, W<PL	TWR		798 36.00					
40					794					
Log continued on next page										

**WELL CASING**  
Interval: 0-59'  
Material: Schedule 40 PVC  
Diameter: 2"  
Joint Type: Flush/Screw

**WELL SCREEN**  
Interval: 59-69'  
Material: Schedule 40 PVC  
Diameter: 2"  
Slot Size: 0.010"  
End Cap: 69.0-69.3'

**FILTER PACK**  
Interval: 56.0-69.3'  
Type: #1 Filter Sand  
Quantity: 5.5 - 50 lbs bags

**FILTER PACK SEAL**  
Interval: 53-56'  
Type: 3/8" Uncoated  
Pel-Plug  
Quantity: 1 - 5 gallon bucket

**ANNULUS SEAL**  
Interval: 0-53'  
Type: AquaGuard Bentonite  
Grout  
Quantity: Approximately 80  
gallons

**WELL COMPLETION**  
Pad: 4'x4'x4" Concrete  
Protective Casing: 4"x4"  
Aluminium

**DRILLING METHODS**  
Soil Drill: Rotasonic (6 inch  
casing by 4 inch core  
barrel)  
Rock Drill: Rotasonic  
Sample Type: Rotasonic

BOREHOLE RECORD 166849621.GPJ PIEDMONT.GDT 5/24/21

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Tommy Ardito

INSPECTOR: Michael Boatman, PG  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/24/21





# RECORD OF BOREHOLE B-120D



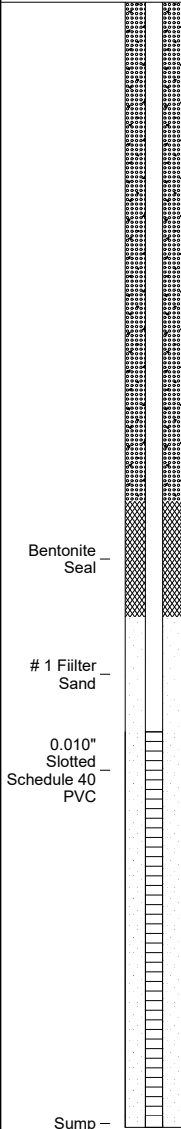
SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 166849621  
DRILLED DEPTH: 70.00 ft  
LOCATION: Offset of B-3

DRILL RIG: TSi 150CC  
DATE STARTED: 3/5/21  
DATE COMPLETED: 3/6/21

NORTHING: 1,394,047.2  
EASTING: 2,202,436.4  
GS ELEVATION: 834.03  
TOC ELEVATION: 836.42 ft

DEPTH W.L.: 33.76  
ELEVATION W.L.: 802.66  
DATE W.L.: 4/9/2021  
TIME W.L.: 12:26

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			PIEZOMETER DIAGRAM and NOTES	PIEZOMETER CONSTRUCTION DETAILS	
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	PHOTO	REC			
					DEPTH (ft)						
40		40.00 - 70.00 Fresh to slightly weatherd, well foliated, poorly jointed, white to dark gray, fine to coarse grained, biotite-feldspar-quartz GNEISS; locally the felspars are augened	BR		40.00	4		7.80 10.00		<b>WELL CASING</b> Interval: 0-59' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 59-69' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: 69.0-69.3'  <b>FILTER PACK</b> Interval: 56.0-69.3' Type: #1 Filter Sand Quantity: 5.5 - 50 lbs bags  <b>FILTER PACK SEAL</b> Interval: 53-56' Type: 3/8" Uncoated Pel-Plug Quantity: 1 - 5 gallon bucket  <b>ANNULUS SEAL</b> Interval: 0-53' Type: AquaGuard Bentonite Grout Quantity: Approximately 80 gallons  <b>WELL COMPLETION</b> Pad: 4'x4'x4" Concrete Protective Casing: 4"x4" Aluminium  <b>DRILLING METHODS</b> Soil Drill: Rotosonic (6 inch casing by 4 inch core barrel) Rock Drill: Rotosonic Sample Type: Rotosonic	
45	790										
50	785										
55	780					5		6.20 10.00			
60	775										
65	770					6		8.50 10.00			
70	765	Boring completed at 70.00 ft			764						
75	760										
80	755										

BOREHOLE RECORD 166849621.GPJ PIEDMONT.GDT 5/24/21

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Tommy Ardito

INSPECTOR: Michael Boatman, PG  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/24/21





# RECORD OF BOREHOLE B-122D

SHEET 1 of 2

PROJECT: SCS Plant McDonough  
PROJECT NUMBER: GL166849621  
DRILLED DEPTH: 85.00 ft  
LOCATION: Smyrna, GA

DRILL RIG: Terra Sonic 150T  
Truck-Mounted Sonic  
DATE STARTED: 3/24/22  
DATE COMPLETED: 3/24/22

NORTHING: 1,390,992.8  
EASTING: 2,202,975.4  
GS ELEVATION: 777.32  
TOC ELEVATION: 777.03 ft

DEPTH W.L.: 30.25  
ELEVATION W.L.: 747.07  
DATE W.L.: 3/25/22  
TIME W.L.: 8:15

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	PHOTO	REC		
0		0.00 - 10.00 FILL, CL, SILTY CLAY, moist, micaceous, trace of organics; air knifed for utility clearance							Aquaguard - Grout	<b>WELL CASING</b> Interval: 0'-69.8' Material: Schedule 40 PVC Diameter: 2" Joint Type: Threaded  <b>WELL SCREEN</b> Interval: 69.8'-79.8' Material: 0.010" Slotted Diameter: 2" Slot Size: 0.010" End Cap: 3"  <b>FILTER PACK</b> Interval: 67.8'-85' Type: Filter Sil - Filtration sand and gravel, industrial quartz Quantity: 5 x 50 lb bag  <b>FILTER PACK SEAL</b> Interval: 64.2'-67.8' Type: Pel Plug Bentonite Pellets Quantity: 1 x 50 lb bucket  <b>ANNULUS SEAL</b> Interval: 0'-64.2' Type: Aquaguard bentonite grout Quantity: 3 batches of 2 bags Aquaguard + 40 gal water  <b>WELL COMPLETION</b> Pad: 4' x 4' Protective Casing: Aluminum  <b>DRILLING METHODS</b> Soil Drill: Sonic Rock Drill: Sonic Sample Type: Sonic
775						1		NA		
5								10.00		
770					767.3					
10		10.00 - 20.00 CL, SILTY CLAY, moist, high plasticity, little fine to coarse gravel, orange to brown, schist fragments	CH		10.00	2		8.50		
765								10.00		
15										
760					757.3					
20		20.00 - 30.00 SP-SM, SAND and SILT, dark brown, iron staining, low plasticity, weathered boulder encountered, muscovite, biotite schist boulder			20.00	3		6.50		
755								10.00		
25			SP-SM							
750					747.3					
30		30.00 - 40.00 SP-SM, SAND, moist, dark gray, fine grained, trace of organics, rounded shape			30.00	4		9.75		
745								10.00		
35			SP-SM							
740					737.3					
40		40.00 - 41.00 SP-SM, SILTY SAND, dark brown, little iron staining, fine, rounded shape	SP-SM		736.3					
735		41.00 - 50.00 muscovite biotite SCHIST, strong, fresh to slightly weathered, slightly fractured, fine to coarse grains, little iron staining			41.00	5		9.75		
45								10.00		
730										
50					727.3					

Log continued on next page

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Corey Franklin

GA INSPECTOR: Connor Mikilitus  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/10/22

**wsp** GOLDER

BOREHOLE RECORD PLANT MCDONOUGH\_DGWC-121, B-122D, B-123D.GPJ, PIEDMONT.GDT 5/13/22

# RECORD OF BOREHOLE B-122D

SHEET 2 of 2

PROJECT: SCS Plant McDonough  
PROJECT NUMBER: GL166849621  
DRILLED DEPTH: 85.00 ft  
LOCATION: Smyrna, GA

DRILL RIG: Terra Sonic 150T  
Truck-Mounted Sonic  
DATE STARTED: 3/24/22  
DATE COMPLETED: 3/24/22

NORTHING: 1,390,992.8  
EASTING: 2,202,975.4  
GS ELEVATION: 777.32  
TOC ELEVATION: 777.03 ft

DEPTH W.L.: 30.25  
ELEVATION W.L.: 747.07  
DATE W.L.: 3/25/22  
TIME W.L.: 8:15

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	PHOTO	REC		
50		50.00 - 60.00 Muscovite biotite SCHIST, strong, fresh, unfractured, fine to coarse grains			50.00					<p><b>WELL CASING</b> Interval: 0'-69.8' Material: Schedule 40 PVC Diameter: 2" Joint Type: Threaded</p> <p><b>WELL SCREEN</b> Interval: 69.8'-79.8' Material: 0.010" Slotted Diameter: 2" Slot Size: 0.010" End Cap: 3"</p> <p><b>FILTER PACK</b> Interval: 67.8'-85' Type: Filter Sil - Filtration sand and gravel, industrial quartz Quantity: 5 x 50 lb bag</p> <p><b>FILTER PACK SEAL</b> Interval: 64.2'-67.8' Type: Pel Plug Bentonite Pellets Quantity: 1 x 50 lb bucket</p> <p><b>ANNULUS SEAL</b> Interval: 0'-64.2' Type: Aquaguard bentonite grout Quantity: 3 batches of 2 bags Aquaguard + 40 gal water</p> <p><b>WELL COMPLETION</b> Pad: 4' x 4' Protective Casing: Aluminum</p> <p><b>DRILLING METHODS</b> Soil Drill: Sonic Rock Drill: Sonic Sample Type: Sonic</p>
725						6		6.50 10.00		
55										
720										
60		60.00 - 65.00 Same as above			717.3 60.00					
715										
65		65.00 - 70.00 muscovite biotite SCHIST, strong, fresh to slightly weathered, slightly fractured, fine to coarse grained, traces of iron staining			712.3 65.00	7		9.50 10.00		
710										
70		70.00 - 73.00 Same as above, some iron staining, slightly to moderately fractured			707.3 70.00					
705										
75		73.00 - 80.00 muscovite biotite SCHIST, strong fresh, unfractured, fine to coarse grained			704.3 73.00	8		9.20 10.00		
700										
80		80.00 - 85.00 muscovite biotite SCHIST, strong fresh to slightly weathered, slightly fractured, fine to coarse grained, trace to little iron staining			697.3 80.00	9		5.00 5.00		
695										
85		Boring completed at 85.00 ft			692.3					
690										
90										
685										
95										
680										
100										

BOREHOLE RECORD PLANT MCDONOUGH\_DGWC-121, B-122D, B-123D.GPJ PIEDMONT.GDT 5/13/22

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Corey Franklin

GA INSPECTOR: Connor Mikilitus  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/10/22



# RECORD OF BOREHOLE B-125D

SHEET 1 of 5

PROJECT: SCS Plant McDonough  
PROJECT NUMBER: GL166849622  
DRILLED DEPTH: 220.00 ft  
LOCATION: Smyrna, GA

DRILL RIG: Track Rig PS150  
DATE STARTED: 3/14/23  
DATE COMPLETED: 3/31/23

NORTHING: 1,394,111.60  
EASTING: 2,202,580.70  
GS ELEVATION: 819.15 ft  
TOC ELEVATION: 821.70 ft

DEPTH W.L.: 15.7 ft  
ELEVATION W.L.:  
DATE W.L.: 3/31/23  
TIME W.L.:

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL DIAGRAM and NOTES		WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	PHOTO	REC			
					DEPTH (ft)						
0		0.00 - 10.00 FILL, SC, CLAYEY SAND, some silt, red, trace mica, highly weathered, NC, moist, trending drier downhole, loose to compact; air knifed for utility clearance	SC			1		4.00 10.00	Aquaguard Grout		<b>WELL CASING</b> Interval: 0'-135.1' Material: Schedule 40 PVC Diameter: 2" Joint Type: Threaded
815											
5											<b>FILTER PACK</b> Interval: 132.6'-146.5' Type: No. 2 Filter Sand Quantity: 4x15-cu ft bag
810											<b>FILTER PACK SEAL</b> Interval: 128'-132.6' Type: Pel Plug Bentonite Pellets 3/8" Quantity: 1 x 5 gal bucket
10		10.00 - 20.00 RESIDUUM, SP, fine SAND with trace clay, tan, trace mica, moderately weathered, NC, moist, loose	SP		809.15 10.00	2		4.00 10.00			<b>ANNULUS SEAL</b> Interval: 0'-128' Type: Aquaguard bentonite grout Quantity: 8 bags
805											
15											<b>DRILLING METHODS</b> Soil Drill: Sonic Rock Drill: Sonic Sample Type: Sonic
800					799.15 20.00	3					
20		20.00 - 22.50 SW, fine to coarse SAND with gravels of schist, saprolitic schist structure observed, tan, highly weathered, NC, dry, very loose	SW								
						796.65 22.50					
795		22.50 - 25.00 TWR, GP, angular GRAVEL with fine to coarse sand; schistic gravels, highly weathered, NC, dry, very loose	GP		794.15 25.00			9.50 10.00			
25		25.00 - 30.00 BEDROCK, highly weathered GNEISS, very rough surface, multiple fractures									
790					789.15 30.00	4					
30		30.00 - 34.00 No Recovery									
785		34.00 - 68.00 moderately weathered GNEISS, very rough surface, multiple fractures			785.15 34.00			6.00 10.00			
35											
780											
40											
775						5					
45											
770								9.50 10.00			
50											
Log continued on next page											

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Brendan Griffin

GA INSPECTOR: Chris Tidwell  
CHECKED BY: Rhonda Quinn  
DATE: 5/11/2023



# RECORD OF BOREHOLE B-125D

SHEET 2 of 5

PROJECT: SCS Plant McDonough  
PROJECT NUMBER: GL166849622  
DRILLED DEPTH: 220.00 ft  
LOCATION: Smyrna, GA

DRILL RIG: Track Rig PS150  
DATE STARTED: 3/14/23  
DATE COMPLETED: 3/31/23

NORTHING: 1,394,111.60  
EASTING: 2,202,580.70  
GS ELEVATION: 819.15 ft  
TOC ELEVATION: 821.70 ft

DEPTH W.L.: 15.7 ft  
ELEVATION W.L.:  
DATE W.L.: 3/31/23  
TIME W.L.:

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS		
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	PHOTO	REC				
					DEPTH (ft)							
50		34.00 - 68.00 moderately weathered GNEISS, very rough surface, multiple fractures <i>(Continued)</i>									<b>WELL CASING</b> Interval: 0'-135.1' Material: Schedule 40 PVC Diameter: 2" Joint Type: Threaded	
	765					6		8.00 10.00			<b>WELL SCREEN</b> Interval: 135.1'-145.1' Material: 0.010" Slotted Diameter: 2" Slot Size: 0.010" End Cap: 3"	
55												
	760										<b>FILTER PACK</b> Interval: 132.6'-146.5' Type: No. 2 Filter Sand Quantity: 4x15-cu ft bag	
60											<b>FILTER PACK SEAL</b> Interval: 128'-132.6' Type: Pel Plug Bentonite Pellets 3/8" Quantity: 1 x 5 gal bucket	
	755					7		6.00 10.00			<b>ANNULUS SEAL</b> Interval: 0'-128' Type: Aquaguard bentonite grout Quantity: 8 bags	
65												
	750	68.00 - 70.00 highly weathered GNEISS, very rough surface, multiple fractures, iron staining			751.15 68.00						<b>WELL COMPLETION</b> Pad: 4'x4' Protective Casing: Aluminum	
70		70.00 - 150.00 moderately to slightly weathered GNEISS; rough irregular surface, multiple fractures, intermittent quartz lenses, iron staining at 77.5', 130'-140'			749.15 70.00						<b>DRILLING METHODS</b> Soil Drill: Sonic Rock Drill: Sonic Sample Type: Sonic	
	745					8		5.00 10.00				
75												
	740											
80												
	735					9		7.00 10.00				
85												
	730											
90												
	725					10		5.00 10.00				
95												
	720											
100		Log continued on next page										

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Brendan Griffin

GA INSPECTOR: Chris Tidwell  
CHECKED BY: Rhonda Quinn  
DATE: 5/11/2023



# RECORD OF BOREHOLE B-125D

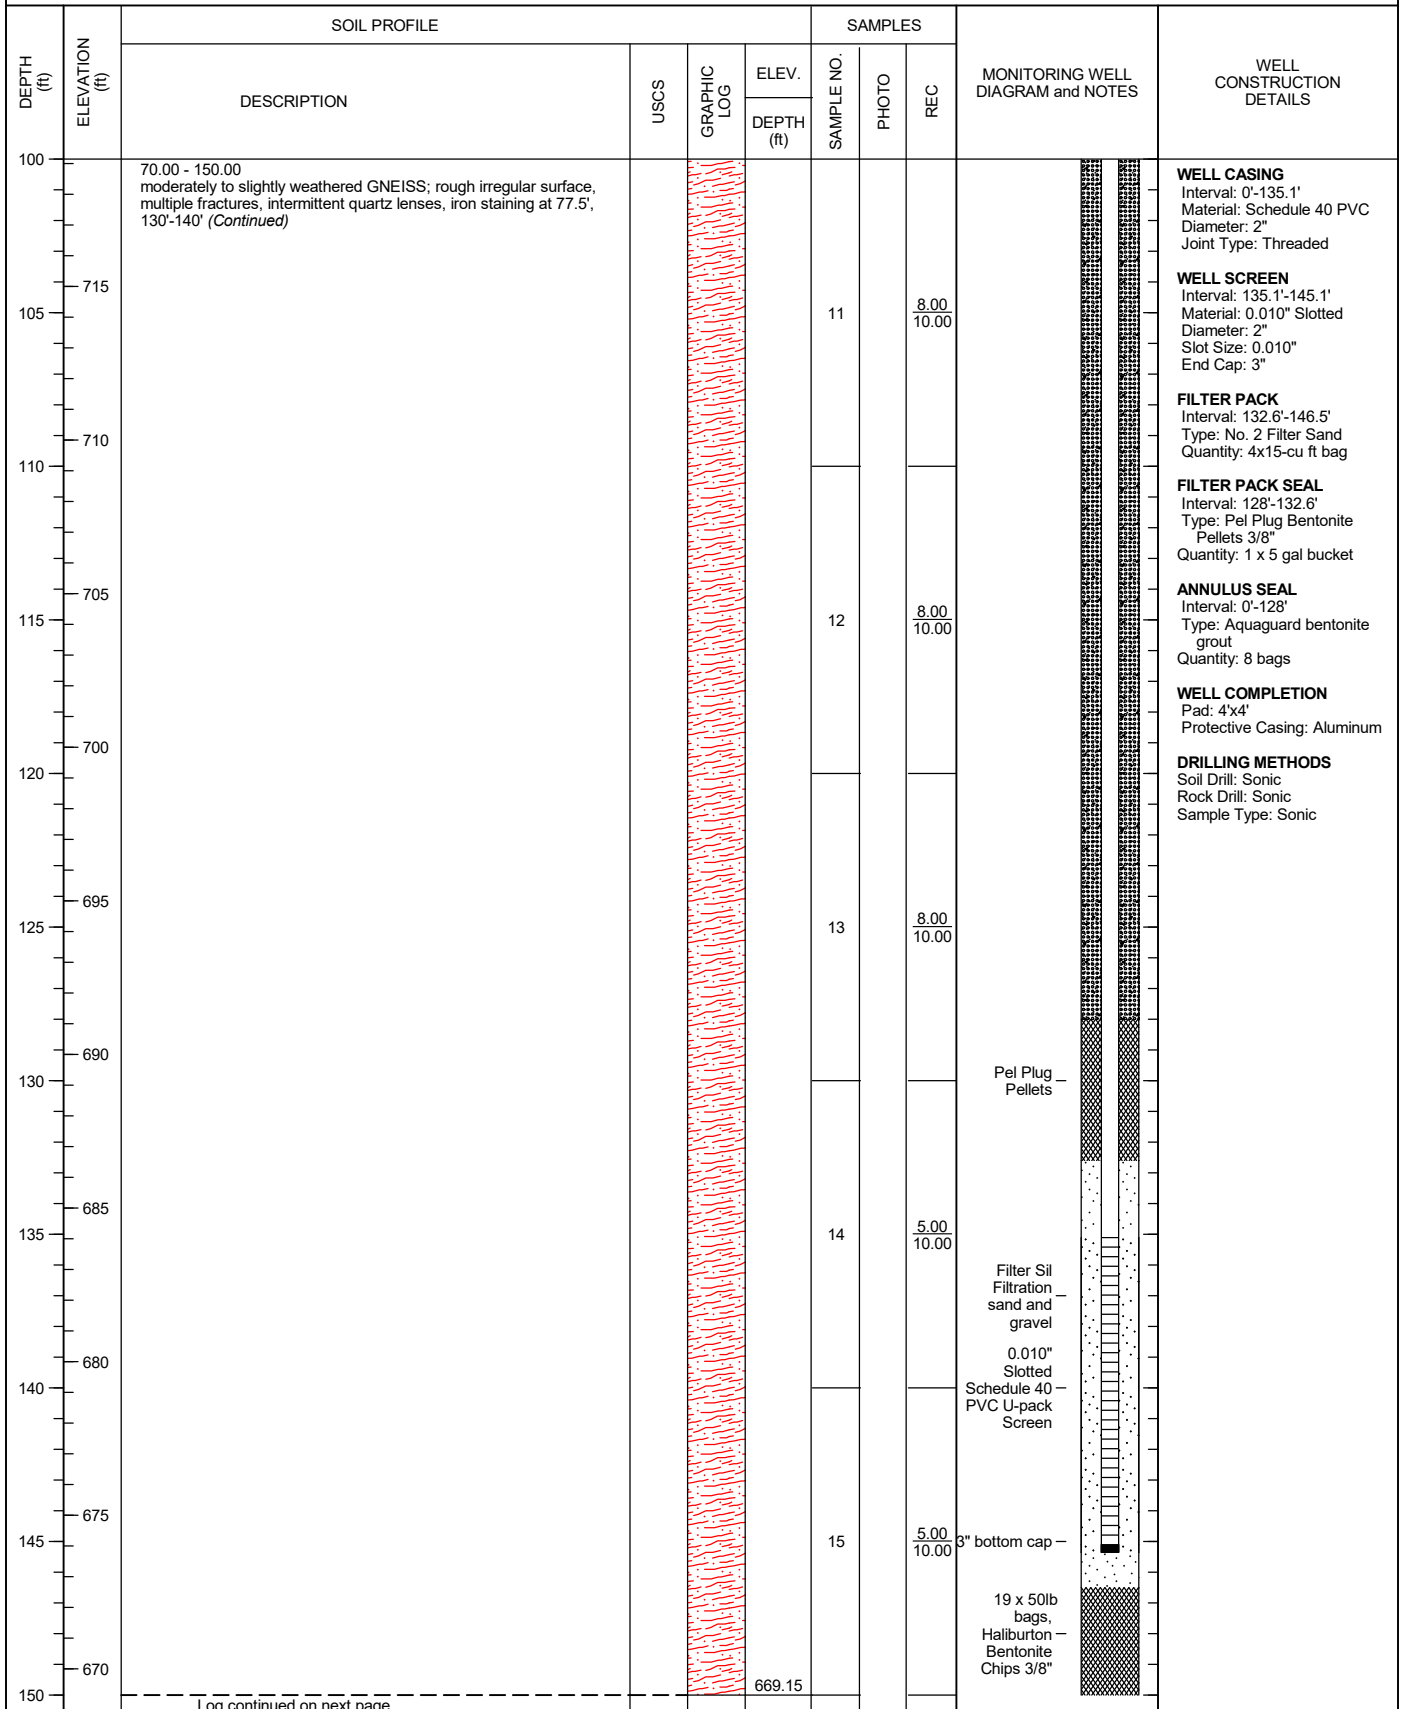
SHEET 3 of 5

PROJECT: SCS Plant McDonough  
PROJECT NUMBER: GL166849622  
DRILLED DEPTH: 220.00 ft  
LOCATION: Smyrna, GA

DRILL RIG: Track Rig PS150  
DATE STARTED: 3/14/23  
DATE COMPLETED: 3/31/23

NORTHING: 1,394,111.60  
EASTING: 2,202,580.70  
GS ELEVATION: 819.15 ft  
TOC ELEVATION: 821.70 ft

DEPTH W.L.: 15.7 ft  
ELEVATION W.L.:  
DATE W.L.: 3/31/23  
TIME W.L.:



Log continued on next page

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Brendan Griffin

GA INSPECTOR: Chris Tidwell  
CHECKED BY: Rhonda Quinn  
DATE: 5/11/2023



# RECORD OF BOREHOLE B-125D



SHEET 4 of 5

PROJECT: SCS Plant McDonough  
PROJECT NUMBER: GL166849622  
DRILLED DEPTH: 220.00 ft  
LOCATION: Smyrna. GA

DRILL RIG: Track Rig PS150  
DATE STARTED: 3/14/23  
DATE COMPLETED: 3/31/23

NORTHING: 1,394,111.60  
EASTING: 2,202,580.70  
GS ELEVATION: 819.15 ft  
TOC ELEVATION: 821.70 ft

DEPTH W.L.: 15.7 ft  
ELEVATION W.L.:  
DATE W.L.: 3/31/23  
TIME W.L.:

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	PHOTO	REC		
150		150.00 - 220.00 moderately to highly weathered GNEISS; rough irregular surface, multiple fractures, quartz and biotite mica, iron staining at 157'-160'			150.00					<b>WELL CASING</b> Interval: 0'-135.1' Material: Schedule 40 PVC Diameter: 2" Joint Type: Threaded  <b>WELL SCREEN</b> Interval: 135.1'-145.1' Material: 0.010" Slotted Diameter: 2" Slot Size: 0.010" End Cap: 3"  <b>FILTER PACK</b> Interval: 132.6'-146.5' Type: No. 2 Filter Sand Quantity: 4x15-cu ft bag  <b>FILTER PACK SEAL</b> Interval: 128'-132.6' Type: Pel Plug Bentonite Pellets 3/8" Quantity: 1 x 5 gal bucket  <b>ANNULUS SEAL</b> Interval: 0'-128' Type: Aquaguard bentonite grout Quantity: 8 bags  <b>WELL COMPLETION</b> Pad: 4'x4' Protective Casing: Aluminum  <b>DRILLING METHODS</b> Soil Drill: Sonic Rock Drill: Sonic Sample Type: Sonic
665						16		10.00 10.00		
155										
660										
160										
655						17		7.50 10.00		
165										
650										
170										
645						18		10.00 10.00		
175										
640										
180										
635						19		8.00 10.00		
185										
630										
190										
625						20		10.00 10.00		
195										
620										
200										

Log continued on next page

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Brendan Griffin

GA INSPECTOR: Chris Tidwell  
CHECKED BY: Rhonda Quinn  
DATE: 5/11/2023





# RECORD OF BOREHOLE B-125D



SHEET 5 of 5

PROJECT: SCS Plant McDonough  
PROJECT NUMBER: GL166849622  
DRILLED DEPTH: 220.00 ft  
LOCATION: Smyrna, GA

DRILL RIG: Track Rig PS150  
DATE STARTED: 3/14/23  
DATE COMPLETED: 3/31/23

NORTHING: 1,394,111.60  
EASTING: 2,202,580.70  
GS ELEVATION: 819.15 ft  
TOC ELEVATION: 821.70 ft

DEPTH W.L.: 15.7 ft  
ELEVATION W.L.:  
DATE W.L.: 3/31/23  
TIME W.L.:

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE			SAMPLES			MONITORING WELL DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS	
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	PHOTO			REC
					DEPTH (ft)					
200		150.00 - 220.00 moderately to highly weathered GNEISS; rough irregular surface, multiple fractures, quartz and biotite mica, iron staining at 157'-160' (Continued)								
	615					21		10.00 10.00		<b>WELL CASING</b> Interval: 0'-135.1' Material: Schedule 40 PVC Diameter: 2" Joint Type: Threaded
205										<b>WELL SCREEN</b> Interval: 135.1'-145.1' Material: 0.010" Slotted Diameter: 2" Slot Size: 0.010" End Cap: 3"
	610									<b>FILTER PACK</b> Interval: 132.6'-146.5' Type: No. 2 Filter Sand Quantity: 4x15-cu ft bag
210										<b>FILTER PACK SEAL</b> Interval: 128'-132.6' Type: Pel Plug Bentonite Pellets 3/8" Quantity: 1 x 5 gal bucket
	605									<b>ANNULUS SEAL</b> Interval: 0'-128' Type: Aquaguard bentonite grout Quantity: 8 bags
215						22		7.00 10.00		<b>WELL COMPLETION</b> Pad: 4'x4' Protective Casing: Aluminum
	600									<b>DRILLING METHODS</b> Soil Drill: Sonic Rock Drill: Sonic Sample Type: Sonic
220		Boring completed at 220.00 ft			599.15					
	595									
225										
	590									
230										
	585									
235										
	580									
240										
	575									
245										
	570									
250										

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Brendan Griffin

GA INSPECTOR: Chris Tidwell  
CHECKED BY: Rhonda Quinn  
DATE: 5/11/2023







# BORING LOG

**BORING B-03**

Page 1 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DATE STARTED 10/2/2012 COMPLETED 10/3/2012 GROUND ELEVATION 835 ft COORDINATES N 1394045.1 E 2202411.5

CONTRACTOR SCS Field Services METHOD 4.25" Hollow Stem Auger w/pilot bit; HQ Rock Core EQUIPMENT CME 550

DRILLED BY S. Denty LOGGED BY R. Tinsley CHECKED BY BORING DEPTH 42 ft.

GROUND WATER DEPTH: DURING 23 ft. COMP. DELAYED 22.5 ft. after 24 hrs.

NOTES Well installed. Refer to well data sheet.

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
5		Silt (ML) - Grass - brownish yellow, dry, SILT		SS -1	4.5	3-2-3 (5)		upper saprolite.
10		- brownish yellow, dry, medium stiff, SILT saprolite with relic bedding.		SS -2	9.5	2-3-3 (6)		10YR; powdery; Upper Saprolite.
15		- SAA		SS -3	14.5	2-3-4 (7)		upper saprolite.
20		- mottled deep red and gray, damp, stiff, SILT; with coarse grains of angular quartz; gneiss saprolite.		SS -4	19.5	1-6-5 (11)		upper saprolite.
25		Silt (ML)	810.5	SS	24.5	6-6-8		

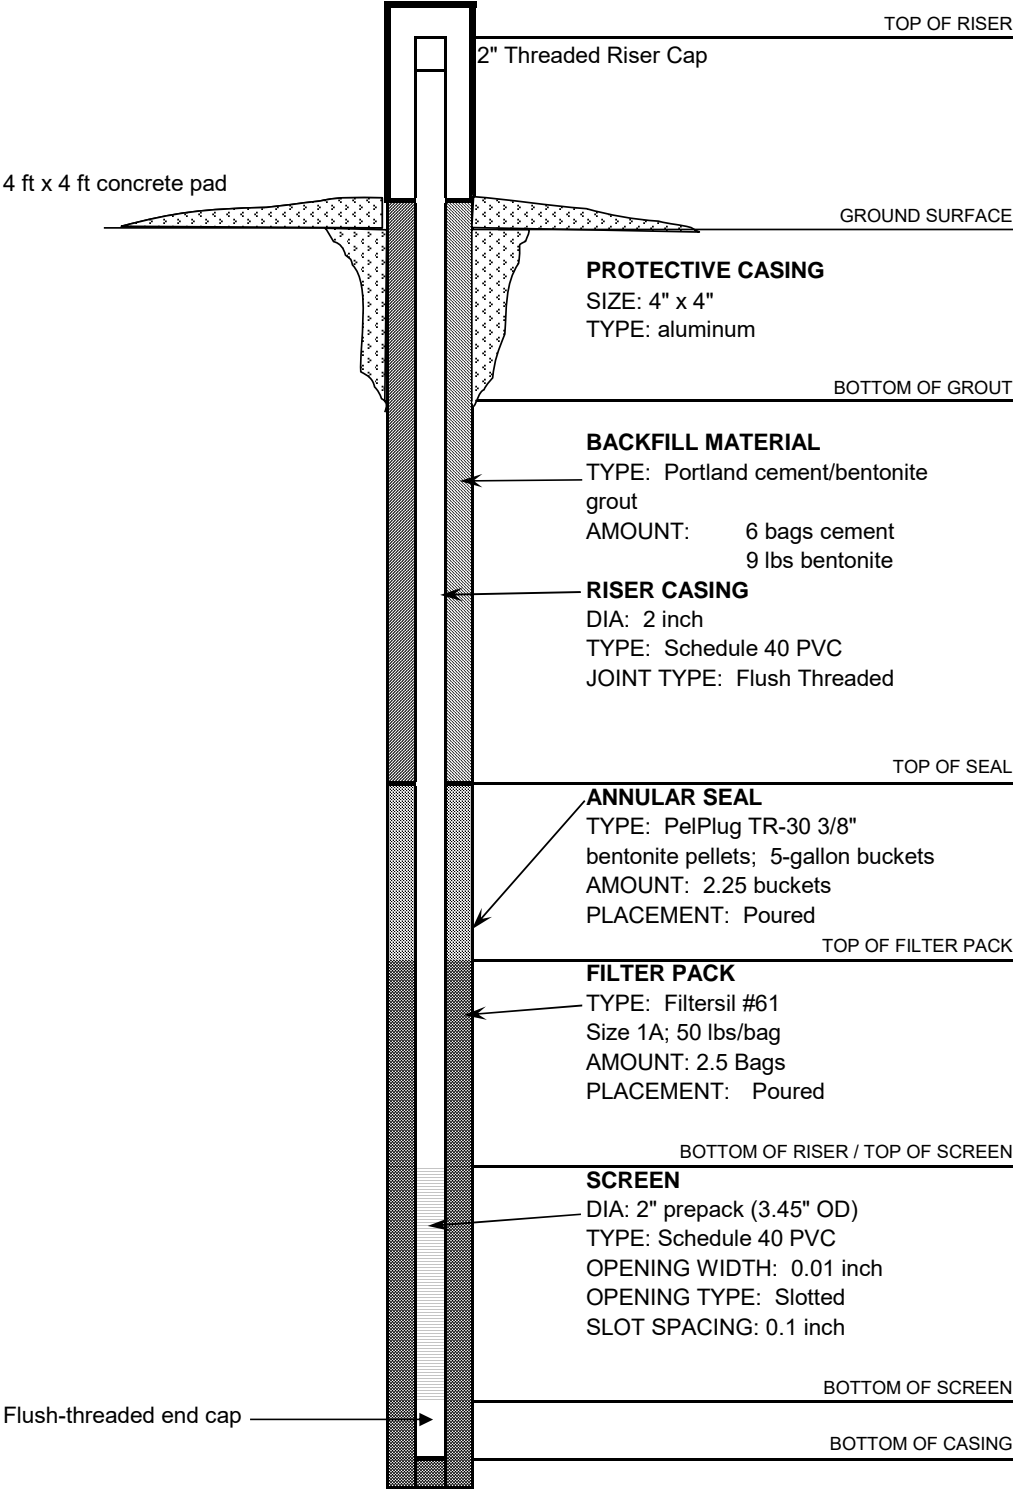
GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:43 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

(Continued Next Page)

GEOTECH ENGINEERING LOGS - ESEE DATABASE GDT - 8/26/20 20:43 - \\ALTRCFP01\LPARKER\$\DESKTOP\GPCIMW LOGS SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME  B-3		
Hydrogeologic Investigation		DRILLER: S. Denty				
LOCATION: Ash Pond		RIG TYPE: CME550				
LOGGER: Rhonda Tinsley		DRILLING METHODS: HS Auger/HQ Rock Core				
DATE CONSTRUCTED: 10/3/2012		N: 1394045.1 E:2202411.5				
				DEPTH FEET	ELEVATION FT, MSL	
				TOP OF RISER	-2.78	837.78
				2" Threaded Riser Cap		
				GROUND SURFACE	0.0	834.86
				PROTECTIVE CASING SIZE: 4" x 4" TYPE: aluminum		
				BOTTOM OF GROUT		
				BACKFILL MATERIAL TYPE: Portland cement/bentonite grout AMOUNT: 6 bags cement 9 lbs bentonite		
				RISER CASING DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded		
				TOP OF SEAL	20.0	814.9
				ANNULAR SEAL TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 2.25 buckets PLACEMENT: Poured		
				TOP OF FILTER PACK	24.2	810.7
				FILTER PACK TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 2.5 Bags PLACEMENT: Poured		
				BOTTOM OF RISER / TOP OF SCREEN	26.7	808.2
SCREEN DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch						
BOTTOM OF SCREEN	36.7	798.2				
Flush-threaded end cap						
BOTTOM OF CASING	37.0	797.9				
HOLE DIA: 7 inch (auger) 3.8 inch (HQ core)						



# BORING LOG

**BORING B-06**

Page 1 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DATE STARTED 10/9/2012 COMPLETED 10/9/2012 GROUND ELEVATION 786.5 ft COORDINATES N 1394419.5 E 2203266.5

CONTRACTOR SCS Field Services METHOD 4.25" Hollow Stem Auger w/pilot bit EQUIPMENT CME 550

DRILLED BY S. Denty LOGGED BY G. Dyer CHECKED BY BORING DEPTH 35.8 ft.

GROUND WATER DEPTH: DURING COMP. DELAYED 7 ft. after 3 hrs.

NOTES Well installed. Refer to well data sheet.

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		<b>Clayey Sand (SC)</b> - red-brown, damp, very loose, silty, clayey SAND; approximately 50% fine-grained sand, 20% clay, 20% silt, 10% organics. Organic rich horizon.	783.0					
5		<b>Silt (ML)</b> - red-tan, damp, clayey SILT with fine-grained sand  - gray to brownish yellow, stiff, clayey SILT to silty CLAY; 60% silt, 30% clay; 10% sand/gravel; contains small (1 to 2 mm) quartz feldspar gravel		SS -1	4.5	4-4-8 (12)		A horizon of residual soil.
10		- tan-brown w/orange and gray, very moist, very soft, clayey SILT, micaceous; 70% silt, 25% clay, 5% fine- grained sand		SS -2	9.5	1-1-1 (2)		B horizon of residual soil.
15		- tan-brown, very moist, very soft, clayey SILT to silty CLAY; 55% clay, 40% silt, approximately 5% fine- grained sand		SS -3	14.5	1-1-1 (2)		B horizon of residual soil.
20		- olive gray to tan--brown, dry, stiff, clayey SILT, weathered with some relic structure; 60% silt, 35% clay, 5% fine-grained sand		SS -4	19.5	3-5-6 (11)		Top of upper saprolite zone.
25				SS	24.5	12-32-46		

(Continued Next Page)



# BORING LOG

BORING B-06

Page 2 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		<b>Silt (ML)(con't)</b> - tan-brown, very hard, clayey SILT with sand and gravel; contains highly weathered schist fragments; micaceous; 50% silt, 30% clay, 20% sand/gravel		-5		(78)		mid-lower saprolite.
30		- tan-brown, damp, very hard, sandy, gravelly, clayey SILT; 50% clayey silt, 50% sandy gravel; gravels are 1 mm to 10 mm in size, angular and gneissic in origin; highly weathered; contains some white leached quartz		SS -6	29.5	50 (0)		lower saprolite.
35		- brown, damp, very hard, clayey SILT; 40% clay, 60% silt; micaceous, contains relic structures		SS -7	34.5	27-50 (50)		lower saprolite.
			750.7					
		Bottom of borehole at 35.8 feet.						
40								
45								
50								

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME	
Hydrogeologic Investigation		DRILLER: S. Denty			
LOCATION: Ash Pond		RIG TYPE: CME550		B-6	
LOGGER: Greg Dyer		DRILLING METHODS: HS Auger			
DATE CONSTRUCTED: 10/9/2012		N: 1394419.5 E: 2203266.5			
				DEPTH FEET	ELEVATION FT, MSL
TOP OF RISER				-3.0	789.47
2" Threaded Riser Cap					
GROUND SURFACE				0.0	786.45
<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum BOTTOM OF GROUT					
<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 5 bags cement 7.5 lbs bentonite <b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded TOP OF SEAL				16.8	769.7
<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 2 buckets PLACEMENT: Tremie TOP OF FILTER PACK				21.7	764.8
<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 6 Bags PLACEMENT: Tremie BOTTOM OF RISER / TOP OF SCREEN				25.0	761.5
<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch BOTTOM OF SCREEN				35.0	751.5
Flush-threaded end cap					
BOTTOM OF CASING				35.4	751.1
HOLE DIA: 7 inch					





# BORING LOG

**BORING B-07**

Page 1 of 2

**SOUTHERN COMPANY SERVICES, INC.**  
**EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING**

**PROJECT** Plant McDonough Hydrogeological Investigation

**LOCATION** Cobb County, GA

**DATE STARTED** 10/9/2012 **COMPLETED** 10/9/2012 **GROUND ELEVATION** 806.1 ft **COORDINATES** N 1394374.6 E 2203596.1






**CONTRACTOR** SCS Field Services **METHOD** 4.25" Hollow Stem Auger w/pilot bit **EQUIPMENT** CME 550

**DRILLED BY** S. Denty **LOGGED BY** G. Dyer **CHECKED BY** **BORING DEPTH** 26 ft.

**GROUND WATER DEPTH: DURING** 18.5 ft. **COMP.** **DELAYED** 3.8 ft. after 18 hrs.

**NOTES** Well installed. Refer to well data sheet.

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRCFP01\1APARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
5		<b>Silt (ML)</b> - brown to red-brown, damp, very soft, clayey SILT with trace sand; organic rich  - red to red-tan, damp, soft, clayey SILT  	801.6	SS -1	4.5	3-3-3 (6)		O Horizon.
10		<b>Fat Clay (CH)</b> - tan, brown and orange, damp, medium stiff, silty CLAY; micaceous; relic foliations; 60% clay, 40% silt  	796.6	SS -2	9.5	1-1-2 (3)		A-B Horizon / residual soils.  becomes very moist at 8.5'.  residual soil.
15		<b>Silt (ML)</b> - red-tan, very moist, soft, clayey SILT with trace fine sand; slightly micaceous; contains manganese  		SS -3	14.5	1-1-3 (4)		residual soil.
20		- brown-red, very moist, soft, clayey SILT to silty CLAY with trace gravel; micaceous; prevalent manganese staining  		SS -4	19.5	1-1-5 (6)		saturated from 18.5 to 19.5'.  residual soil.
25		- olive gray (greenish), wet, medium stiff, clayey SILT; micaceous; contains relic schist fragments  		SS	24.5	7-7-8		
		- olive gray to tan-brown, wet, stiff, clayey, gravelly SILT; contains manganese and moderately						

(Continued Next Page)



# BORING LOG

**BORING B-07**  
Page 2 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation  
LOCATION Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		weathered gneissic fragments; relic structures preserved insome instances <b>Silt (ML)(con't)</b>	780.1	-5		(15)		upper saprolite.
30		Bottom of borehole at 26.0 feet.						
35								
40								
45								
50								

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME	
Hydrogeologic Investigation		DRILLER: S. Denty			
LOCATION: Ash Pond		RIG TYPE: CME550		B-7	
LOGGER: Greg Dyer		DRILLING METHODS: HS Auger			
DATE CONSTRUCTED: 10/9/2012		N: 1394374.6 E:2203596.1			
				DEPTH FEET	ELEVATION FT, MSL
TOP OF RISER				-3.1	809.16
2" Threaded Riser Cap					
4 ft x 4 ft concrete pad					
GROUND SURFACE				0.0	806.04
PROTECTIVE CASING SIZE: 4" x 4" TYPE: aluminum					
BOTTOM OF GROUT					
BACKFILL MATERIAL TYPE: Portland cement/bentonite grout AMOUNT: 3 bags cement 1.75 lbs bentonite					
RISER CASING DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded					
TOP OF SEAL				7.6	798.4
ANNULAR SEAL TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 1.75 buckets PLACEMENT: Poured					
TOP OF FILTER PACK				12.7	793.3
FILTER PACK TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 7 Bags PLACEMENT: Poured					
BOTTOM OF RISER / TOP OF SCREEN				14.8	791.2
SCREEN DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch					
BOTTOM OF SCREEN				24.8	781.2
Flush-threaded end cap					
BOTTOM OF CASING				25.2	780.8
HOLE DIA: 7 inch					



# BORING LOG

**BORING B-24**

Page 1 of 3

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DATE STARTED 10/24/2012 COMPLETED 10/24/2012 GROUND ELEVATION 819.3 ft COORDINATES N 1392479.9 E 2201450

CONTRACTOR SCS Field Services METHOD 4.25" Hollow Stem Auger w/pilot bit; HQ Rock Core EQUIPMENT CME 550

DRILLED BY S. Denty LOGGED BY C. Sellers CHECKED BY BORING DEPTH 79.1 ft.

GROUND WATER DEPTH: DURING COMP. DELAYED

NOTES Well installed. Refer to well data sheet.

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
5		- Vacuum excavation from 0 ft to 9.5 ft						
10			809.8	SS -1	9.5	WH-1-1 (2)		
15		- light gray, very soft, SILT with very fine to fine-grained sand		SS -2	14.5	3-4-6 (10)		
20		- stiff, SAA; very micaceous		SS -3	19.5	5-4-4 (8)		
25		- light tan to brown, medium stiff, SILT; very fine to fine-grained; micaceous; 2" quartz		SS	24.5	19-37-50		

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

(Continued Next Page)



# BORING LOG

BORING B-24

Page 2 of 3

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		<b>Silt (ML)(con't)</b> - wet, very hard, SILT; saprolite (weathered gneiss); banding		4		(87)		
30				SS -5	29.5	50 (0)		
35		- SAA		SS -6	34.5	50 (0)		
40				SS -7	39.5	50 (0)		
45				SS -8	44.5	50 (0)		
50		- SAA; contains gneiss fragments		SS -9	49.5	50 (0)		

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

(Continued Next Page)



# BORING LOG

BORING B-24

Page 3 of 3

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
55		<b>Silt (ML)(con't)</b> - SAA		SS -10	54.5	50 (0)		
			760.2	RC -1	59.1			
60		<b>Gneiss</b> - light gray to orange, highly weathered, GNEISS; highly fractured, vertical and horizontal						
				RC -2	64.1			
65		- light gray with red staining, SAA						
				RC -3	69.1			
70		- SAA						
				RC -4	74.1			
75								
			740.2					
80		Bottom of borehole at 79.1 feet.						

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRCFP01\1\APARKER\DESKTOP\GPCMW LOGS SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME		
Hydrogeologic Investigation		DRILLER: S. Denty				
LOCATION: Ash Pond		RIG TYPE: CME550				
LOGGER: Cale Sellers		DRILLING METHODS: HS Auger/HQ Rock Core				
DATE CONSTRUCTED: 10/24/2012		N: 1392479.9 E:2201450.0		B-24		
				DEPTH FEET	ELEVATION FT, MSL	
<p>4 ft x 4 ft concrete pad</p> <p>2" Threaded Riser Cap</p> <p>GROUND SURFACE</p> <p><b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum</p> <p><b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 21 bags cement 30 lbs bentonite</p> <p><b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded</p> <p><b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 0.25 bucket PLACEMENT: Poured</p> <p><b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 2.5 Bags PLACEMENT: Poured w/water</p> <p><b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch</p> <p>Flush-threaded end cap</p> <p>HOLE DIA: 7 inch (auger) 3.8 inch (HQ core)</p>				TOP OF RISER	-2.8	822.11





# BORING LOG

**BORING B-25**

Page 1 of 3

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DATE STARTED 10/23/2012 COMPLETED 10/24/2012 GROUND ELEVATION 833.5 ft COORDINATES N 1392813.3 E 2201502.7

CONTRACTOR SCS Field Services METHOD 4.25" Hollow Stem Auger w/pilot bit; HQ Rock Core EQUIPMENT CME 550

DRILLED BY S. Denty LOGGED BY B. Gallagher CHECKED BY BORING DEPTH 54.8 ft.

GROUND WATER DEPTH: DURING COMP. DELAYED

NOTES Well installed. Refer to well data sheet.

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
0		- Vacuum excavation from 0 ft to 9.5 ft						
5								
10		Silt (ML)	824.0	SS -1	9.5	1-2-2 (4)		no recovery.
15		- tan, dry, very hard, saprolite; micaceous, sandy with 1 inch lense of white feldspar at 14.8 ft.		SS -2	14.5	22-50 (50)		
20		- black and white, very hard, SAA; weathered gneiss saprolite		SS -3	19.5	18-36-50 (86)		
25				SS	24.5	25		

GEOTECH ENGINEERING LOGS - ESEE DATABASE: GDT - 8/26/20 20:44 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS - SURVEY UPDATED.GPJ

(Continued Next Page)



# BORING LOG

**BORING B-25**

Page 2 of 3

**SOUTHERN COMPANY SERVICES, INC.**  
**EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING**

**PROJECT** Plant McDonough Hydrogeological Investigation

**LOCATION** Cobb County, GA

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		<b>Silt (ML)(con't)</b> - black and white, dry, weathered gneiss		4		(0)		
			806.5	RC -1	27.0			
30		<b>Gneiss</b>  - black and white, medium hard to hard, slightly weathered - two 1/2" augens and weathered joints at 28.5 ft		RC -2	29.8			
35		- soft, weathered and broken from 29.1 to 30.2 ft - joint filled with secondary minerals from 30.2 to 30.7 ft - slightly weathered joints at 31.0, 31.3, and 31.6 ft  - 1/4" augen with four slightly weathered joints across foliation from 32.3 to 33.0 ft  - 3 inch weathered soft zone @ 34.5 ft		RC -3	34.8			
40		- 2" quartzite at 42 ft; very little staining; vertical fractures from 40ft to 42ft		RC -4	39.8			
45		- SAA		RC -5	44.8			
50		- weathered; staining in and around fractures		RC -6	49.8			

(Continued Next Page)



# BORING LOG

**BORING B-25**  
Page 3 of 3

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation  
LOCATION Cobb County, GA

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
55	/		778.7					
		Bottom of borehole at 54.8 feet.						
60								
65								
70								
75								
80								

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRCFP01\IAPARKER\$\DESKTOP\GPCMW LOGS - SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME	
Hydrogeologic Investigation		DRILLER: S. Denty			
LOCATION: Ash Pond		RIG TYPE: CME550		B-25	
LOGGER: B. Gallagher		DRILLING METHODS: HS Auger/HQ Rock Core			
DATE CONSTRUCTED: 10/24/2012		N: 1392813.3 E:2201502.7			
				DEPTH FEET	ELEVATION FT, MSL
TOP OF RISER				-3.0	836.54
2" Threaded Riser Cap					
GROUND SURFACE				0.0	833.41
<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum					
BOTTOM OF GROUT					
<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 10 bags cement 14 lbs bentonite					
<b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded					
TOP OF SEAL				40.1	793.3
<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 0.25 bucket PLACEMENT: Tremie					
TOP OF FILTER PACK				42.4	791.0
<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 1 Bag; 50 lbs/bag PLACEMENT: Tremie					
BOTTOM OF RISER / TOP OF SCREEN				44.4	789.0
<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch					
BOTTOM OF SCREEN				54.4	779.0
BOTTOM OF CASING				54.8	778.6
HOLE DIA: 7 inch (auger) 3.8 inch (HQ core)					



# BORING LOG

**BORING B-26**

Page 1 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DATE STARTED 10/16/2012 COMPLETED 10/23/2012 GROUND ELEVATION 850.6 ft COORDINATES N 1393105.6 E 2201550.4

CONTRACTOR SCS Field Services METHOD 4.25" Hollow Stem Auger w/pilot bit; HQ Rock Core EQUIPMENT CME 550

DRILLED BY S. Denty LOGGED BY Sellers/Byrd/Gallager CHECKED BY BORING DEPTH 49.3 ft.

GROUND WATER DEPTH: DURING COMP. DELAYED

NOTES Well installed. Refer to well data sheet.

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
5		- Vacuum excavation from 0 ft to 9.5 ft						
10		<b>Silt (ML)</b> - tan with white, pink and dark brown layering, stiff, sandy SILT; heavily weathered; micaceous; fine-grained	841.1	SS -1	9.5	4-4-6 (10)		
15		- stiff, SAA; heavily weathered gneiss		SS -2	14.5	3-5-9 (14)		
20		- dry, very hard, SAA; more compact with better foliation than previous samples; less sand		SS -3	19.5	17-24-27 (51)		
25				SS	24.5	50		

GEOTECH ENGINEERING LOGS - ESEE DATABASE: GDT - 8/26/20 20:44 - \VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS SURVEY UPDATED.GPJ

(Continued Next Page)



# BORING LOG

**BORING B-26**

Page 2 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		<b>Silt (ML)(con't)</b> - dry, very hard, SAA; powdered rock	824.6	RC -4	26.0	(0)		
30		<b>Gneiss</b> - black and white, fine grain, medium hard to hard, slightly to moderately weathered, banded, GNEISS - from 27.0' to 27.3' - soft, weathered, leached of biotite, stained below; 1.4" thick augen - 1/2" thick augen with remnant, healed fractures across foliation at 28'; slight staining on joint across foliation from 28.6' to 28.7' - stain on joints, one joint on foliation and one joint across foliation at 29.3' to 29.7'		RC -2	28.9			
35		- 3 stained and leached, weathered joints from 31.4' to 32.2'; augen - 3 stained joints across foliation from 32.7' to 33.0', including a soil coated joint at 33' - slightly stained joints on foliation at 33.1', 33.6', and 34.1' to 34.7'		RC -3	33.9			
40		- stained, leached, weathered zone with many 1/4" quartz phenocrysts from 35.8' to 36.6'		RC -4	39.0			
45		- soft weathered zone with staining from 39.0' to 39.7' - heavily stained, soft joints across foliation at 41.3' - 1/2" augen at 42.0' - weathered broken zone from 43.6' to 44.1' - below 44.1' heavily stained with many quartz phenocrysts - stained joint across foliation at 45.5'	801.3	RC -5	44.1			
50		Bottom of borehole at 49.3 feet.						

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRCFP01\1\APARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services	WELL NAME
Hydrogeologic Investigation		DRILLER: S. Denty	
LOCATION: Ash Pond		RIG TYPE: CME550	B-26
LOGGER: Ben Gallagher		DRILLING METHODS: HS Auger/HQ Rock Core	
DATE CONSTRUCTED: 10/23/2012		N: 1393105.6 E: 2201550.4	
		DEPTH FEET	ELEVATION FT, MSL
		TOP OF RISER	-3.0 853.60
		2" Threaded Riser Cap	
4 ft x 4 ft concrete pad		GROUND SURFACE	0.0 850.61
		<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum	
		BOTTOM OF GROUT	
		<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 7 bags cement 10 lbs bentonite	
		<b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded	
		TOP OF SEAL	30.5 820.1
		<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 0.25 bucket PLACEMENT: Tremie	
		TOP OF FILTER PACK	34.8 815.8
		<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 0.5 Bag filter pac 0.5 bag hole PLACEMENT: Tremie	
		BOTTOM OF RISER / TOP OF SCREEN	38.9 811.7
		<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch	
		BOTTOM OF SCREEN	48.9 801.7
Flush-threaded end cap		BOTTOM OF CASING	49.3 801.3
HOLE DIA: 7 inch (auger) 3.8 inch (HQ core)			





# BORING LOG

**BORING B-28**

Page 1 of 4

**SOUTHERN COMPANY SERVICES, INC.**  
**EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING**

**PROJECT** Plant McDonough Hydrogeological Investigation

**LOCATION** Cobb County, GA

**DATE STARTED** 10/30/2012 **COMPLETED** 10/30/2012 **GROUND ELEVATION** 813.3 ft **COORDINATES** N 1391967.4 E 2201679.2

**CONTRACTOR** SCS Field Services **METHOD** 4.25" Hollow Stem Auger w/pilot bit; HQ Rock Core **EQUIPMENT** CME 550

**DRILLED BY** S. Denty **LOGGED BY** D. Brooks **CHECKED BY**  **BORING DEPTH** 94.3 ft.

**GROUND WATER DEPTH: DURING**  **COMP.**  **DELAYED**

**NOTES** Well installed. Refer to well data sheet.

GEOTECH ENGINEERING LOGS - ESEE DATABASE: GDT - 8/26/20 20:44 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS - SURVEY UPDATED.GPJ

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
0		- Vacuum excavation from 0 ft to 9.5 ft						
5								
10		<b>Gneiss</b> - no recovery; encountered boulder	803.8	SS -1	9.5			
		<b>Silty Sand (SM)</b>	802.3					
15		- green and black, saprolite; relict structure present		SS -2	14.5			
20		- brown and tan, damp, silty SAND; micaceous; fine-grained		SS -3	19.5			
25				SS	24.5	4-5-7		

(Continued Next Page)



# BORING LOG

**BORING B-28**

Page 2 of 4

**SOUTHERN COMPANY SERVICES, INC.**  
**EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING**

**PROJECT** Plant McDonough Hydrogeological Investigation

**LOCATION** Cobb County, GA

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRCFP01\1\APARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		<b>Silty Sand (SM)</b> (con't) - SC-SM: tan, orange, and black, damp, medium dense, silty, clayey SAND; fine to very fine-grained		-4		(12)		
30		- medium dense, SAA; micaceous; clay content increases		SS -5	29.5	7-7-7 (14)		
35			778.8	SS -6	34.5	5-16-23 (39)		
40		<b>Silt (ML)</b> - green and black, damp, hard, sandy SILT; relict structure present		SS -7	39.5	5-5-6 (11)		
45		- tan, orange, and black, stiff, sandy SILT; micaceous; some relict structure		SS -8	44.5	7-16-20 (36)		
		- hard, SAA		SS -9	49.5	20-20 (20)		
50		- very hard, SAA						

(Continued Next Page)



# BORING LOG

**BORING B-28**

Page 3 of 4

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
55		<b>Silt (ML)(con't)</b> - very hard, minimal recovery; partially weathered rock		SS -10	54.5	50 (0)		
60		<b>Gneiss</b> - black and gray, mylonite GNEISS (schistic zone); weathering noted along small joints and along foliations (saprock), otherwise fresh; no staining seen	754.1	RC -1	59.2			
65		- black and gray, hard, mylonite GNEISS; fresh		RC -2	64.3			
70		- SAA		RC -3	69.3			
75		- SAA		RC -4	74.3			
80		- SAA with small iron-stained joint at 83'		RC -5	79.3			

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRCFP01\1APARKER\DESKTOP\GPCMW LOGS SURVEY UPDATED.GPJ

(Continued Next Page)



# BORING LOG

**BORING B-28**  
Page 4 of 4

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
85		Gneiss( <i>con't</i> )		RC -6	84.3			
90		- black and gray, hard, GNEISS; fresh		RC -7	89.3			
			719.0					
95		Bottom of borehole at 94.3 feet.						
100								
105								
110								

GEOTECH ENGINEERING LOGS - ESEE DATABASE: GDT - 8/26/20 20:44 - \\VALTRCFP01\APARKER\DESKTOP\GPCMW LOGS SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services	WELL NAME
Hydrogeologic Investigation		DRILLER: S. Denty	
LOCATION: Ash Pond		RIG TYPE: CME550	B-28
LOGGER: Dustin Brooks		DRILLING METHODS: HS Auger/HQ Rock Core	
DATE CONSTRUCTED: 10/31/2012		N: 1391967.4 E: 2201679.2	
		DEPTH FEET	ELEVATION FT, MSL
		TOP OF RISER	-2.8 816.08
2" Threaded Riser Cap			
4 ft x 4 ft concrete pad			
		GROUND SURFACE	0.0 813.28
<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum BOTTOM OF GROUT			
<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 14 bags cement 19 lbs bentonite <b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded TOP OF SEAL		53.0	760.3
<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 0.5 bucket PLACEMENT: Tremie TOP OF FILTER PACK		55.6	757.7
<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 0.5 Bag filter pac 0.5 bag hole PLACEMENT: Tremie BOTTOM OF RISER / TOP OF SCREEN		59.0	754.3
<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch BOTTOM OF SCREEN		69.0	744.3
Flush-threaded end cap BOTTOM OF CASING		69.4	743.9
HOLE DIA: 7 inch (auger) 3.8 inch (HQ core)			



# BORING LOG

**BORING B-29**

Page 1 of 3

**SOUTHERN COMPANY SERVICES, INC.**  
**EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING**

**PROJECT** Plant McDonough Hydrogeological Investigation

**LOCATION** Cobb County, GA

**DATE STARTED** 1/10/2012 **COMPLETED** 1/11/2012 **GROUND ELEVATION** 813.5 ft **COORDINATES** N 1391890 E 2201422

**CONTRACTOR** SCS Field Services **METHOD** 4.25" Hollow Stem Auger w/pilot bit **EQUIPMENT** CME 550

**DRILLED BY** S. Denty **LOGGED BY** G. Dyer **CHECKED BY**  **BORING DEPTH** 55.7 ft.

**GROUND WATER DEPTH: DURING**  **COMP.**  **DELAYED**

**NOTES** Well installed. Refer to well data sheet.

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
0		- Vacuum excavation from 0 ft to 10 ft						
5								
10			803.5					
		<b>Silt (ML)</b>						
		- tan-red, damp, medium stiff, clayey SILT, no structures or staining		SS -1	12.0	2-2-4 (6)		residual soil.
15		- tan, brown, and orange-red, damp, stiff, SILT with clay; vertical manganese oxide bands; highly weathered relict structure; slightly micaceous		SS -2	14.5	2-5-6 (11)		residual soil - upper saprolite.
20		- red, green and gray, very hard, sandy SILT; highly weathered schist fragments; relict structure intact; moderately to well cemented; trace partially weathered rock fragments		SS -3	19.5	9-28-29 (57)		lower saprolite.
25				SS	24.5	2-11-14		

(Continued Next Page)



# BORING LOG

**BORING B-29**

Page 2 of 3

**SOUTHERN COMPANY SERVICES, INC.**  
**EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING**

**PROJECT** Plant McDonough Hydrogeological Investigation

**LOCATION** Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		<b>Silt (ML)(con't)</b> - green-gray and tan, dry, very stiff, sandy SILT; moderately to well cemented; structure intact; lacks rock fragments; micaceous; trace quartz sand		4		(25)		lower saprolite.
30		- green-gray, moist, very hard, GRAVEL and SILT; moderately weathered schist fragments		SS -5	29.5	28-50 (50)		lower saprolite/transitioning to saprock.
35		- very damp, very hard, SAA		SS -6	34.5	24-50 (50)		spoon moist to wet.
40		- dry, very hard, SAA		SS -7	39.5	50 (0)		saprock transition.
45								
50		- green-gray, wet, very hard, fine SILT with gravel; noticeably softer than previous runs; isolated schist fragments near base; little to no structure		SS -8	49.5	11-29-50 (79)		noticeable sound of water flowing.

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \VALTRCFP01\1APARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

(Continued Next Page)





# BORING LOG

BORING B-29

Page 3 of 3

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
55		- very hard, SAPROCK; schist fragments <b>Silt (ML)</b> (con't)	757.8	SS-9	54.5	50 (0)		
60								
65								
70								
75								
80								

Bottom of borehole at 55.7 feet.

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME	
Hydrogeologic Investigation		DRILLER: S. Denty			
LOCATION: Ash Pond		RIG TYPE: CME550		B-29	
LOGGER: Greg Dyer		DRILLING METHODS: HS Auger			
DATE CONSTRUCTED: 1/11/2013		N: 1391890.0 E: 2201422.0			
				DEPTH FEET	ELEVATION FT, MSL
TOP OF RISER				-2.9	816.43
2" Threaded Riser Cap					
4 ft x 4 ft concrete pad					
GROUND SURFACE				0.0	813.47
<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum					
BOTTOM OF GROUT					
<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 10 bags cement 13.5 lbs bentonite					
<b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded					
TOP OF SEAL				40.0	773.5
<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 1/4" bentonite pellets; 5-gallon buckets AMOUNT: 1 bucket PLACEMENT: Poured					
TOP OF FILTER PACK				42.0	771.5
<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 5.5 Bags PLACEMENT: Poured w/water					
BOTTOM OF RISER / TOP OF SCREEN				44.1	769.4
<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch					
BOTTOM OF SCREEN				54.1	759.4
Flush-threaded end cap					
BOTTOM OF CASING				54.4	759.1
HOLE DIA: 7 inch					



# BORING LOG

**BORING B-31**

Page 1 of 2

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DATE STARTED 1/22/2013 COMPLETED 1/22/2013 GROUND ELEVATION 794.9 ft COORDINATES N 1392034.3 E 2200928.5

CONTRACTOR SCS Field Services METHOD 4.25" Hollow Stem Auger w/pilot bit; HQ Rock Core EQUIPMENT CME 550

DRILLED BY S. Denty LOGGED BY B. Gallagher CHECKED BY BORING DEPTH 45.1 ft.

GROUND WATER DEPTH: DURING COMP. DELAYED

NOTES Drilled near North Abutment of Ash Pond 1 dike Well installed. Refer to well data sheet.

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
5		Silt (ML)						
10				SS -1	10.0	8-7-6 (13)		Vacuum excavation from 0 ft to 10 ft.
15		- white and tan, moist, foliated; saprolite		SS -2	14.5	7-8-17 (25)		
20				SS -3	19.5	7-17-12 (29)		
25		- tan, damp, stained below 20.5 ft		SS	24.5	3-6-12		

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

(Continued Next Page)

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\ALTRCFP01\LAPARKER\$\DESKTOP\GPCIMW LOGS SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME		
Hydrogeologic Investigation		DRILLER: S. Denty				
LOCATION: Ash Pond 1		RIG TYPE: CME550				
LOGGER: B. Gallagher		DRILLING METHODS: HS Auger/HQ Rock Core				
DATE CONSTRUCTED: 1/22/2013		N: 1392034.3 E:2200928.5		B-31		
				DEPTH FEET	ELEVATION FT, MSL	
				TOP OF RISER	-2.6	797.47
2" Threaded Riser Cap						
4 ft x 4 ft concrete pad						
				GROUND SURFACE	0.0	794.84
<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum						
				BOTTOM OF GROUT		
<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 5 bags cement 8 lbs bentonite						
<b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded						
				TOP OF SEAL	25.7	769.1
<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 1/4" bentonite pellets; 5-gallon buckets AMOUNT: 1/4 bucket PLACEMENT: Poured						
				TOP OF FILTER PACK	29.1	765.7
<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 1/2 Bags PLACEMENT: Tremie						
				BOTTOM OF RISER / TOP OF SCREEN	34.7	760.1
<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch						
				BOTTOM OF SCREEN	44.7	750.1
				BOTTOM OF CASING	45.1	749.7
HOLE DIA: 7 inch (auger) 3.8 inch (HQ core)						

**ABANDONMENT NOTES:**

Abandoned on 10/4/2023  
Tremmie grouted 25lbs  
Aquagrard/7 gallons water  
Overdrilled to 10 feet bgs.; 10-  
feet PVC removed.  
Final Grout: 38 lbs  
Quickrete/10 lbs  
AquaGuard/6.5 gallons water.

Flush-threaded end cap

**ABANDONMENT NOTES:**

Abandoned on 10/4/2023  
 Tremmie grouted 25lbs  
 Aquagard/7 gallons water  
 Overdrilled to 10 feet bgs.; 10-  
 feet PVC removed.  
 Final Grout: 38 lbs  
 Quickrete/10 lbs  
 AquaGuard/6.5 gallons water.



# BORING LOG

**BORING B-41**

Page 1 of 3

**SOUTHERN COMPANY SERVICES, INC.**  
**EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING**

**PROJECT** Plant McDonough Hydrogeological Investigation

**LOCATION** Cobb County, GA

**DATE STARTED** 11/13/2012 **COMPLETED** 11/14/2012 **GROUND ELEVATION** 792.4 ft **COORDINATES** N 1390920.8 E 2201751.9

**CONTRACTOR** SCS Field Services **METHOD** 4.25" Hollow Stem Auger w/pilot bit **EQUIPMENT** CME 550

**DRILLED BY** S. Denty **LOGGED BY** C. Sellers **CHECKED BY**  **BORING DEPTH** 61 ft.

**GROUND WATER DEPTH: DURING** 35 ft. **COMP.**  **DELAYED**

**NOTES** Well installed. Refer to well data sheet.

GEOTECH ENGINEERING LOGS - ESEE DATABASE: GDT - 8/26/20 20:44 - \VALTRCFP01\APARKER\DESKTOP\GPCMW LOGS - SURVEY UPDATED.GPJ

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
0		- Vacuum excavation from 0 ft to 9.5 ft						
5								
10			782.9	SS -1	9.5	WH-WH-1 (1)		
15		<b>Lean Clay (CL)</b> - light tan/orange, very soft, silty CLAY (fill for parking lot)						
			777.9	SS -2	14.5	3-2-4 (6)		
20				SS -3	19.5	4-4-5 (9)		
25				SS	24.5			

(Continued Next Page)



# BORING LOG

**BORING B-41**

Page 2 of 3

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

LOCATION Cobb County, GA

DEPTH (ft.)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
		<b>Silt (ML)(con't)</b> - light tan, SILT; micaceous		4				
30		- stiff, SAA; with very fine-grained sand		SS -5	29.5	2-4-9 (13)		
35		▽ - wet, medium stiff, SAA		SS -6	34.5	2-2-3 (5)		
40		- brown, wet, stiff, SILT with fine to very fine sand		SS -7	39.5	2-3-6 (9)		
45		- stiff, SAA		SS -8	44.5	2-5-7 (12)		
50		- light tan, damp, hard, sandy SILT (saprolite); fine to very fine-grained sand		SS -9	49.5	11-18-23 (41)		

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \VALTRCFP01\APARKER\DESKTOP\GPCMW LOGS\_SURVEY UPDATED.GPJ

(Continued Next Page)





# BORING LOG

**BORING B-41**  
Page 3 of 3

SOUTHERN COMPANY SERVICES, INC.  
EARTH SCIENCE AND ENVIRONMENTAL ENGINEERING

PROJECT Plant McDonough Hydrogeological Investigation

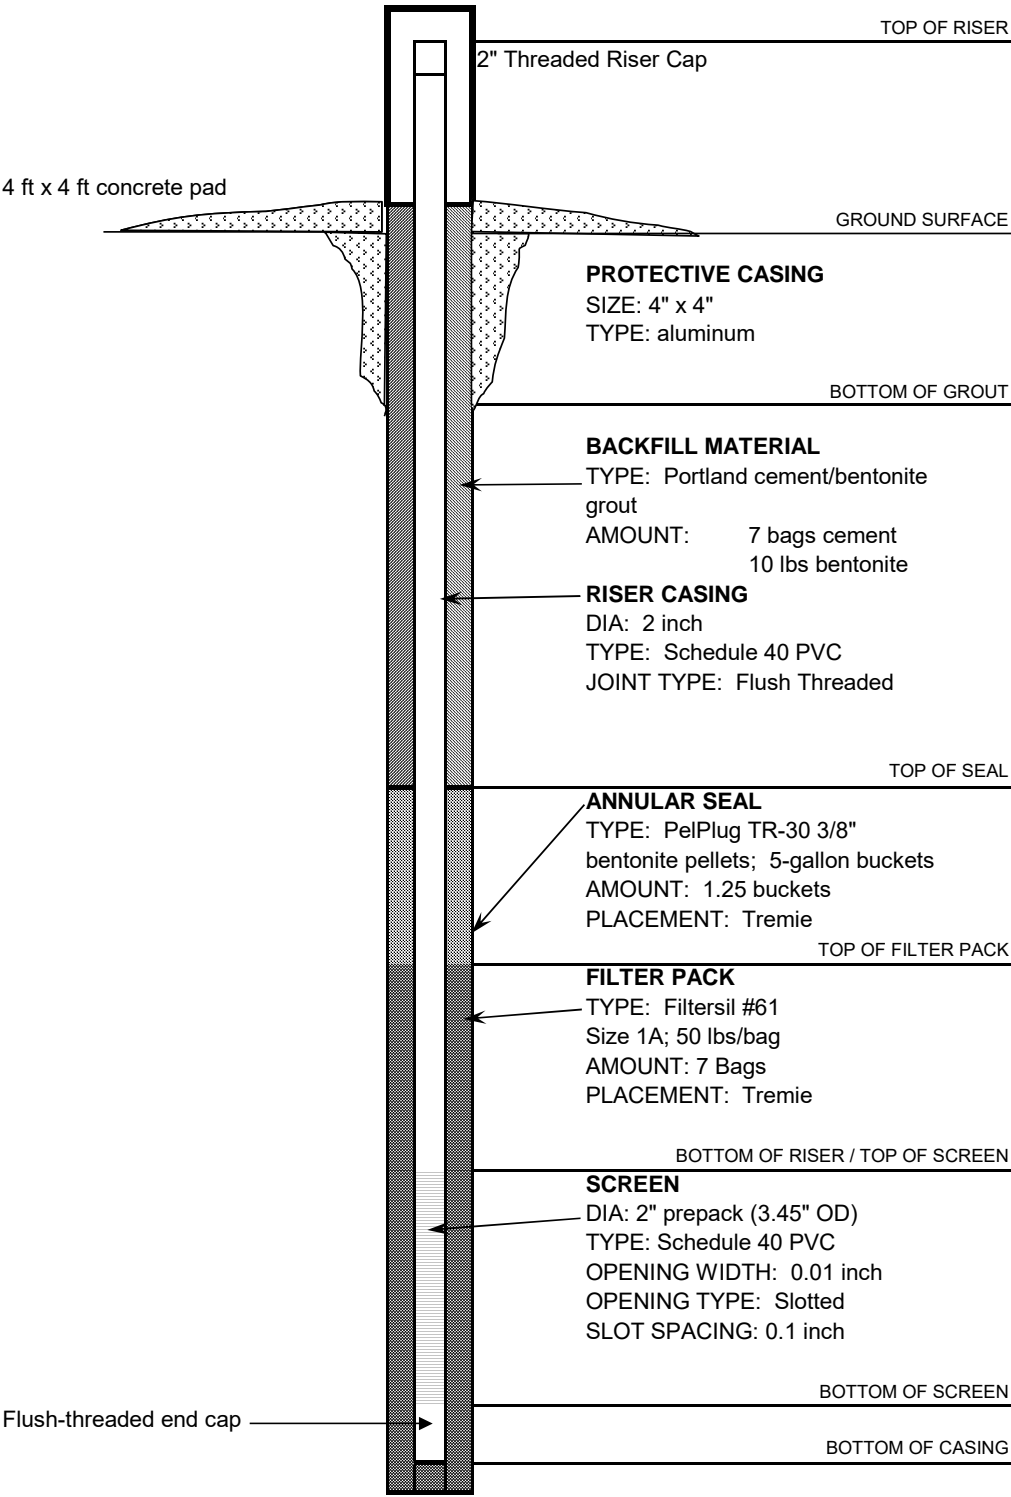
LOCATION Cobb County, GA

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	ELEVATION	SAMPLE TYPE NUMBER	SAMPLE DEPTH (ft.)	BLOW COUNTS (N VALUE)	RECOVERY % (RQD)	COMMENTS
55		<b>Silt (ML)(con't)</b> - light tan, damp, hard, SILT; contains fine to very fine-grained sand and angular quartz gravel		SS -10	54.5	10-17-26 (43)		
60		- light tan, damp, saprolite; contains fine to medium-grained sand	731.4	SS -11	59.5	11-24-50 (74)		
		Bottom of borehole at 61.0 feet.						
65								
70								
75								
80								

GEOTECH ENGINEERING LOGS - ESEE DATABASE.GDT - 8/26/20 20:44 - \\VALTRCFP01\IAPARKER\DESKTOP\GPCMW LOGS - SURVEY UPDATED.GPJ

## WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS Field Services		WELL NAME  B-41		
Hydrogeologic Investigation		DRILLER: S. Denty				
LOCATION: Ash Pond		RIG TYPE: CME550				
LOGGER: Cale Sellers		DRILLING METHODS: HS Auger				
DATE CONSTRUCTED: 11/14/2012		N: 1390920.8 E:2201751.9				
				DEPTH FEET	ELEVATION FT, MSL	
				TOP OF RISER	-2.8	795.20
				2" Threaded Riser Cap		
				4 ft x 4 ft concrete pad		
				GROUND SURFACE	0.0	792.40
				<b>PROTECTIVE CASING</b> SIZE: 4" x 4" TYPE: aluminum		
				BOTTOM OF GROUT		
				<b>BACKFILL MATERIAL</b> TYPE: Portland cement/bentonite grout AMOUNT: 7 bags cement 10 lbs bentonite		
				<b>RISER CASING</b> DIA: 2 inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded		
				TOP OF SEAL	45.2	747.2
				<b>ANNULAR SEAL</b> TYPE: PelPlug TR-30 3/8" bentonite pellets; 5-gallon buckets AMOUNT: 1.25 buckets PLACEMENT: Tremie		
				TOP OF FILTER PACK	47.3	745.1
				<b>FILTER PACK</b> TYPE: Filtersil #61 Size 1A; 50 lbs/bag AMOUNT: 7 Bags PLACEMENT: Tremie		
				BOTTOM OF RISER / TOP OF SCREEN	49.4	743.0
<b>SCREEN</b> DIA: 2" prepack (3.45" OD) TYPE: Schedule 40 PVC OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.1 inch						
BOTTOM OF SCREEN	59.4	733.0				
Flush-threaded end cap						
BOTTOM OF CASING	60.0	732.4				
HOLE DIA: 7 inch						

# RECORD OF BOREHOLE B-50





SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 36.00 ft  
LOCATION: Smyrna, GA

DRILL RIG: 100C Track Mounted Rig  
DATE STARTED: 6/24/16  
DATE COMPLETED: 6/24/16

NORTHING: 1,391,657.10  
EASTING: 2,201,841.00  
GS ELEVATION: 809.20  
TOC ELEVATION: 809.67 ft

DEPTH W.L.: 20.8  
ELEVATION W.L.: 788.4  
DATE W.L.: 6/24/2016  
TIME W.L.: 10:50

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS			
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	REC					
					DEPTH (ft)								
0		0.00 - 12.00 SILT; grayish brown, dry, soft (fill)	ML						Portland Type I – Protective Casing		<b>WELL CASING</b> Interval: 0'-35.2' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush threaded with O-ring  <b>WELL SCREEN</b> Interval: 24.8'-34.8' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 21.8'-36' Type: Filtersil std61  <b>FILTER PACK SEAL</b> Interval: 15.9'-21.8' Type: 3/8" Bentonite Pellets  <b>ANNULUS SEAL</b> Interval: 3'-15.9' Type: Portland Type I/Type II/Bentonite Gel Mix  <b>WELL COMPLETION</b> Pad: 4'x4'x4" Protective Casing: Aluminum  <b>DRILLING METHODS</b> Soil Drill: Sonic Rock Drill: Sonic		
805													
5													
800										Portland Type I/ Type II – Bentonite Gel mix			
10													
795		12.00 - 29.50 SILT; organish gray, some fine to coarse sand, micaceous, moist to wet, soft to firm (saprolite)	ML		797.2								
15						12.00							
790												3/8" Bentonite – Pellets	
20													
785										Filtersil std #61			
25													
780													
30		29.50 - 36.00 SILTY SAND; brownish gray, fine sand, wet, very soft	SM		779.7						0.010" slot screen		
775						29.50							
35												Sump –	
		Boring completed at 36.00 ft			773.2								
770													
40													
765													
45													

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Bill Lindsey

GA INSPECTOR: K. Jurinko, PG  
CHECKED BY: Rachel P. Kirkman, PG  
DATE: 12/22/17



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

# RECORD OF BOREHOLE B-51

SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 66.00 ft  
LOCATION: Smyrna, GA

DRILL RIG: 100C Track Mounted Rig  
DATE STARTED: 6/27/16  
DATE COMPLETED: 6/27/16

NORTHING: 1,390,501.20  
EASTING: 2,200,906.50  
GS ELEVATION: 763.29  
TOC ELEVATION: 765.92 ft

DEPTH W.L.: 8.85  
ELEVATION W.L.: 754.45  
DATE W.L.: 6/28/2016  
TIME W.L.: 13:22

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	REC		
0		0.00 - 3.00 SILT; brown, some fine to coarse sand, dry, soft, micaceous (topsoil)	ML		760.3				Portland Type I/ _ Aluminum Casing	<b>WELL CASING</b> Interval: 0'-65' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush threaded with O-ring  <b>WELL SCREEN</b> Interval: 55'-65' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 53'-65.4' Type: Filtersil std61  <b>FILTER PACK SEAL</b> Interval: 47.5'-53' Type: 3/8" Bentonite Pellets  <b>ANNULUS SEAL</b> Interval: 3'-47.5' Type: Portland Type I/Type II/Gel Mix  <b>WELL COMPLETION</b> Pad: 4'x4'x4" Protective Casing: Aluminum  <b>DRILLING METHODS</b> Soil Drill: Sonic Rock Drill: Sonic
760		3.00 - 15.00 SILT; red to reddish brown, some fine to coarse gravel, black, subrounded, some clayey silt, orangish white and black, dry, soft, micaceous (saprolite)	ML		3.00					
5										
755										
10										
750										
15		15.00 - 58.00 SILT and SAND; orangish brown, brown, and grey, fine to medium sand, some laminations and black mottling, micaceous, some biotite schist gravel, fine to coarse, dry to wet, very soft to very stiff			748.3				Portland Type I/ Type _ II/ Bentonite Gel mix	
745					15.00					
20										
740										
25										
735										
30			SP-SM							
730										
35										
725										
40										
720										
45										

Log continued on next page

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Scotty Vermillion

GA INSPECTOR: K. Jurinko, PG  
CHECKED BY: Rachel P. Kirkman, PG  
DATE: 12/22/17



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

# RECORD OF BOREHOLE B-51


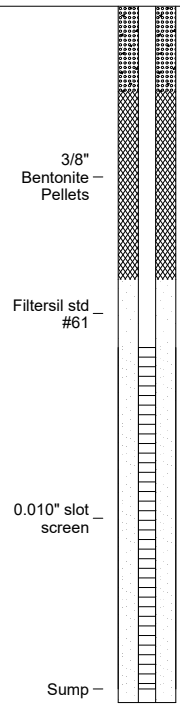
SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 66.00 ft  
LOCATION: Smyrna, GA

DRILL RIG: 100C Track Mounted Rig  
DATE STARTED: 6/27/16  
DATE COMPLETED: 6/27/16

NORTHING: 1,390,501.20  
EASTING: 2,200,906.50  
GS ELEVATION: 763.29  
TOC ELEVATION: 765.92 ft

DEPTH W.L.: 8.85  
ELEVATION W.L.: 754.45  
DATE W.L.: 6/28/2016  
TIME W.L.: 13:22

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	REC		
45		15.00 - 58.00 SILT and SAND; orangish brown, brown, and grey, fine to medium sand, some laminations and black mottling, micaceous, some biotite schist gravel, fine to coarse, dry to wet, very soft to very stiff (Continued)	SP-SM							<b>WELL CASING</b> Interval: 0'-65' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush threaded with O-ring  <b>WELL SCREEN</b> Interval: 55'-65' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 53'-65.4' Type: Filtersil std#61  <b>FILTER PACK SEAL</b> Interval: 47.5'-53' Type: 3/8" Bentonite Pellets  <b>ANNULUS SEAL</b> Interval: 3'-47.5' Type: Portland Type I/Type II/Gel Mix  <b>WELL COMPLETION</b> Pad: 4"x4"x4" Protective Casing: Aluminum  <b>DRILLING METHODS</b> Soil Drill: Sonic Rock Drill: Sonic
715										
50										
710										
55										
705		58.00 - 66.00 biotite SCHIST; some clayey silt and sand to gravel, coarse-grained, gray, orange staining, micaceous, dry to wet, very stiff (saprock)	PWR		705.3 58.00					
60										
700										
65										
		Boring completed at 66.00 ft			697.3					
695										
70										
690										
75										
685										
80										
680										
85										
675										
90										

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Scotty Vermillion

GA INSPECTOR: K. Jurinko, PG  
CHECKED BY: Rachel P. Kirkman, PG  
DATE: 12/22/17



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

# RECORD OF BOREHOLE B-52

SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 50.00 ft  
LOCATION: Northside of the Lab Parking lot

DRILL RIG: CME 55  
DATE STARTED: 9/27/16  
DATE COMPLETED: 9/28/16

NORTHING: 1,392,308.30  
EASTING: 2,201,314.80  
GS ELEVATION: 820.18  
TOC ELEVATION: 822.89 ft

DEPTH W.L.: 25.72  
ELEVATION W.L.: 794.58  
DATE W.L.: 10/6/2016  
TIME W.L.: 1330

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES				MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS	
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	BLOWS per 6 in  140 lb hammer 30 inch drop	N-VALUE			REC
					DEPTH (ft)							
0	820	0.00 - 10.00 Top 10' were Hydrovac for utilities.									CETCO puregold grout (70:30) – / aluminum casing	<b>WELL CASING</b> Interval: 0'-38.9' Material: Schedule 40 PVC Diameter: 2 Joint Type: FLUSH/SCREW  <b>WELL SCREEN</b> Interval: 38.9'-48.9' Material: Schedule 40 PVC Diameter: 2 Slot Size: 0.010 End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 35.7-50' Type: FilterSil  <b>FILTER PACK SEAL</b> Interval: 31.0-35.7' Type: PEL-PLUG 3/8" Bentonite pellets  <b>ANNULUS SEAL</b> Interval: 0-31' Type: CETCO puregold grout (70:30)  <b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 4"x4"x5' aluminum  <b>DRILLING METHODS</b> Soil Drill: Hollow-stem auger Rock Drill: N/A
5	815											
10	810	10.00 - 15.00 SM, silty SAND, fine to medium grained, non to low plasticity, tan, non-cohesive, dry, W<PL, loose	SM		810.2 10.00							
15	805	15.00 - 33.50 ML, SILT with some SAND, fine to coarse, non to moderate plasticity, orange-brown to white to silver, slightly weathered, highly micaceous, cohesive, dry to wet (increasing with detpth), W<PL, firm to stiff, PWR.			805.2 15.00	1	DO	8-8-4	12	1.50 1.50		
20	800					2	DO	7-9-8	17	1.50 1.50	CETCO puregold – grout (70:30)	
25	795		ML			3	DO	7-13-11	24	1.50 1.50		
30	790					4	DO	18-50/3	68/9	0.75 1.50		
35	785	33.50 - 50.00 SM, silty SAND, fine to coarse, non to moderate plasticity, trace rock fragments, yellow-orange, non-cohesive, dry to moist, W<PL, compact to very dense, PWR			786.7 33.50	5	DO	17-20-50/4	70/10	1.50 1.50	PEL-PLUG 3/8" – Bentonite pellets	
40	780		SM			6	DO	50/5	50/5	0.41 0.41		
45						7	DO	50/2	50/2	0.16 0.16	FilterSil –	
Log continued on next page												

Log continued on next page

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: Shawn Milam

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 12/22/17



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

# RECORD OF BOREHOLE B-52

SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 50.00 ft  
LOCATION: Northside of the Lab Parking lot

DRILL RIG: CME 55  
DATE STARTED: 9/27/16  
DATE COMPLETED: 9/28/16

NORTHING: 1,392,308.30  
EASTING: 2,201,314.80  
GS ELEVATION: 820.18  
TOC ELEVATION: 822.89 ft

DEPTH W.L.: 25.72  
ELEVATION W.L.: 794.58  
DATE W.L.: 10/6/2016  
TIME W.L.: 1330

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
45	775	33.50 - 50.00 SM, silty SAND, fine to coarse, non to moderate plasticity, trace rock fragments, yellow-orange, non-cohesive, dry to moist, W<PL, compact to very dense, PWR (Continued)	SM								0.010 Slotted Screen	<b>WELL CASING</b> Interval: 0'-38.9' Material: Schedule 40 PVC Diameter: 2 Joint Type: FLUSH/SCREW  <b>WELL SCREEN</b> Interval: 38.9'-48.9' Material: Schedule 40 PVC Diameter: 2 Slot Size: 0.010 End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 35.7-50' Type: FilterSil  <b>FILTER PACK SEAL</b> Interval: 31.0-35.7 Type: PEL-PLUG 3/8" Bentonite pellets  <b>ANNULUS SEAL</b> Interval: 0-31' Type: CETCO puregold grout (70:30)  <b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 4"x4"x5' aluminum  <b>DRILLING METHODS</b> Soil Drill: Hollow-stem auger Rock Drill: N/A
50	770	Boring completed at 50.00 ft			770.2	8	DO	50/3	50/3	0.25 0.25		
55	765											
60	760											
65	755											
70	750											
75	745											
80	740											
85	735											
90												

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: Shawn Milam

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 12/22/17





# RECORD OF BOREHOLE B-54

SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 34.20 ft  
LOCATION: Eastside of the stream north of AP4

DRILL RIG: CME 55  
DATE STARTED: 9/26/16  
DATE COMPLETED: 9/26/16

NORTHING: 1,394,423.50  
EASTING: 2,203,140.70  
GS ELEVATION: 782.54  
TOC ELEVATION: 785.46 ft

DEPTH W.L.: 4.56  
ELEVATION W.L.: 778.04  
DATE W.L.: 10/6/2016  
TIME W.L.: 839

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES				MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS	
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE			REC
					DEPTH (ft)							
0		0.00 - 13.50 Top 10' were Hydrovac for utilities.									<div>Portland Type I/Type II/Gel Mix / – aluminum casing</div> <div>Portland Type I/Type – II/Gel Mix</div> <div>PEL-PLUG 3/8" – Bentonite pellets</div> <div>FilterSil –</div> <div>0.010 Slotted Screen</div>	<div><b>WELL CASING</b> Interval: 0'-23.8' Material: Schedule 40 PVC Diameter: 2 Joint Type: Flush/Screw</div> <div><b>WELL SCREEN</b> Interval: 23.8'-33.8' Material: Schedule 40 PVC Diameter: 2 Slot Size: 0.010 End Cap: Schedule 40 PVC</div> <div><b>FILTER PACK</b> Interval: 21.9'-34.2' Type: FilterSil</div> <div><b>FILTER PACK SEAL</b> Interval: 17.8'-21.9' Type: PEL-PLUG 3/8" Bentonite pellets</div> <div><b>ANNULUS SEAL</b> Interval: 0-17.8' Type: Portland Type I/Type II/Gel Mix</div> <div><b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 4"x4"x5' aluminum</div> <div><b>DRILLING METHODS</b> Soil Drill: Hollow-stem auger Rock Drill: HQ Core Barrell</div>
780												
5												
775												
10												
770												
15		13.50 - 28.50 SM, silty SAND, fine to coarse, non to low plasticity; white to gray, weathered, well foliated gneiss saprolite; cohesive, moist, w<PL, stiff.			769.0 13.50	1	DO	6-7-6	13	0.83 1.50		
765												
20			SM			2	DO	5-9-8	17	1.33 1.50		
760												
25						3	DO	4-5-11	15	0.00 1.50		
755												
30		28.50 - 29.00 GPS, poorly-graded sandy GRAVEL, fine to coarse, non plastic, some silt; white to tan to pink, K-spar and Quartz; non-cohesive, wet, w<PL, dense., PWR. Auger Refusal at 29.0 29.00 - 34.20 Bedrock; AUGEN GNEISS; fresh to slightly weathered, well foliated, gray, fine grained, medium strong to strong, (locally contains pegamitite zones). Boring completed at 34.20 ft	GP-GM		754.0 753.5 29.00	4	DO	21-50/1	71/7	0.50 0.58		
750			BR									
35												
745												
40												
740												
45												

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Terracon  
DRILLER: Shep Becker

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 12/22/17



# RECORD OF BOREHOLE B-55

SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 52.00 ft  
LOCATION: West of the cement plant

DRILL RIG: CME 55  
DATE STARTED: 9/21/16  
DATE COMPLETED: 9/22/16

NORTHING: 1,394,142.60  
EASTING: 2,204,147.90  
GS ELEVATION: 822.86  
TOC ELEVATION: 825.12 ft

DEPTH W.L.: 12.05'  
ELEVATION W.L.: 810.85  
DATE W.L.: 10/6/2016  
TIME W.L.: 850

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
0		0.00 - 3.50 SM, silty SAND, non to low plasticity; red-brown; cohesive, moist, w<PL, soft.	SM			1	DO	4-8-11	19	0.75 1.50	Portland Type I/Type II/Gel Mix / -- aluminum casing	<b>WELL CASING</b> Interval: 0'-41' Material: Schedule 40 PVC Diameter: 2 Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 41' - 51' Material: Schedule 40 PVC Diameter: 2 Slot Size: 0.010 End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 39'-52' Type: FilterSil  <b>FILTER PACK SEAL</b> Interval: 32'-39' Type: PEL-PLUG 3/8" Bentonite pellets  <b>ANNULUS SEAL</b> Interval: 0'-32' Type: Portland Type I/Type II/Gel Mix  <b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 4"x4"x5' aluminum  <b>DRILLING METHODS</b> Soil Drill: Hollow-stem auger Rock Drill: N/A
820					819.4							
5		3.50 - 13.50 ML, SILT, trace to some sand and clay, non to low plasticity; light brown to red-brown to silverish gray; cohesive, dry to moist, w<PL, soft to firm.	ML		3.50	2	DO	7-7-9	16	1.00 1.50		
815						3	DO	7-11-12	23	1.33 1.50		
10						4	DO	5-8-11	19	1.50 1.50	Portland Type I/Type -- II/Gel Mix	
810					809.4							
15		13.50 - 23.50 ML, SILT, trace fine to coarse sand, non plastic; light brown, deeply weathered, foliated, schist saprolite, cohesive, dry to moist, w<PL, soft to firm.	ML		13.50	5	DO	8-17-24	41	1.50 1.50		
805						6	DO	9-10-11	21	1.50 1.50		
20											PEL-PLUG 3/8" -- Bentonite pellets	
800					799.4							
25		23.50 - 52.00 ML, SILT, some sand, non plastic; light brown to tan to silverish gray, schist saprolite; cohesive, moist to wet (increases with depth), w<PL, soft to firm.	ML		23.50	7	DO	5-12-12	24	1.50 1.50		
795						8	DO	8-12-15	27	1.50 1.50		
30											FilterSil --	
790						9	DO	9-14-17	31	1.50 1.50		
785						10	DO	10-12-16	28	1.50 1.50		
40						11	DO	7-12-23	35	1.50 1.50		
780												
45												

Log continued on next page

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Terracon  
DRILLER: Shep Becker

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 12/22/17



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

# RECORD OF BOREHOLE B-55

SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 52.00 ft  
LOCATION: West of the cement plant

DRILL RIG: CME 55  
DATE STARTED: 9/21/16  
DATE COMPLETED: 9/22/16

NORTHING: 1,394,142.60  
EASTING: 2,204,147.90  
GS ELEVATION: 822.86 TOC  
ELEVATION: 825.12 ft

DEPTH W.L.: 12.05'  
ELEVATION W.L.: 810.85  
DATE W.L.: 10/6/2016  
TIME W.L.: 850

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
45		23.50 - 52.00 ML, SILT, some sand, non plastic; light brown to tan to silverish gray, schist saprolite; cohesive, moist to wet (increases with depth), w<PL, soft to firm. (Continued)	ML								0.010 Slotted _ Screen	<b>WELL CASING</b> Interval: 0' - 41' Material: Schedule 40 PVC Diameter: 2 Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 41' - 51' Material: Schedule 40 PVC Diameter: 2 Slot Size: 0.010 End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 39'-52' Type: FilterSil  <b>FILTER PACK SEAL</b> Interval: 32'-39' Type: PEL-PLUG 3/8" Bentonite pellets  <b>ANNULUS SEAL</b> Interval: 0'-32' Type: Portland Type I/Type II/Gel Mix  <b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 4"x4"x5' aluminum  <b>DRILLING METHODS</b> Soil Drill: Hollow-stem auger Rock Drill: N/A
775												
50												
770		Boring completed at 52.00 ft			770.9							
55												
765												
60												
760												
65												
755												
70												
750												
75												
745												
80												
740												
85												
735												
90												

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Terracon  
DRILLER: Shep Becker

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 12/22/17



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

# RECORD OF BOREHOLE B-57

SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 50.50 ft  
LOCATION: North of the 4-wide construction trailer

DRILL RIG: CME 55  
DATE STARTED: 9/24/16  
DATE COMPLETED: 9/24/16

NORTHING: 1,391,396.30  
EASTING: 2,202,736.90  
GS ELEVATION: 786.03  
TOC ELEVATION: 789.04 ft

DEPTH W.L.: 21.49  
ELEVATION W.L.: 764.51  
DATE W.L.: 10/6/2016  
TIME W.L.: 920

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
0	785	0.00 - 10.00 Boring was hydrovac'd to 10' bgs (material appears to be SM-ML)	SM-ML		776 10.00						Portland Type I/Type II/Gel Mix / -- aluminum casing	<b>WELL CASING</b> Interval: 0'-40' Material: Schedule 40 PVC Diameter: 2 Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 40'-50' Material: Schedule 40 PVC Diameter: 2 Slot Size: 0.010 End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 34.6'-50.5' Type: FilterSil  <b>FILTER PACK SEAL</b> Interval: 29'-34.6' Type: PEL-PLUG 3/8" Bentonite pellets  <b>ANNULUS SEAL</b> Interval: 0'-29' Type: Portland Type I/Type II/Gel Mix  <b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 4"x4"x5' aluminum  <b>DRILLING METHODS</b> Soil Drill: Hollow-stem auger Rock Drill: HQ Core Barrell
5	780											
10	775	10.00 - 30.00 ML- Sandy Clayey SILT, fine to coarse sand, some fine gravel; reddish-brown to brown, dense, dry; micaceous, PWR										
15	770		ML		756 30.00	1	DO	4-10-14	24	1.00 1.50	Portland Type I/Type II/Gel Mix	
20	765											
25	760					2	DO	11-24-50/5	74/11	1.00 1.50		
30	755	30.00 - 34.50 CL- Silty CLAY, SOME fine to medium SAND, trace gravel: brown; loose, W<PL; micaceous, PWR. Auger Refusal at 34.5										
35	750	34.50 - 50.50 Bedrock; SCHIST; strong to very strong, light to dark gray with white and black laminae, sub-parallel; slightly weathered top with red oxidation on fractured surfaces to fresh and unfractured at the bottom.	BR		751.5 34.50	3	DO	4-8-14	22	1.33 1.50	PEL-PLUG 3/8" Bentonite pellets	
40	745					4	DO	4-4-8	12	1.33 1.50		
45						5	DO	50/3	50/3	0.00 0.25	FilterSil --  0.010 Slotted Screen	

Log continued on next page

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Terracon  
DRILLER: Shep Becker

GA INSPECTOR: Aubrey Ellis  
CHECKED BY: Timothy Richards, PG  
DATE: 12/22/17



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

# RECORD OF BOREHOLE B-57



SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 50.50 ft  
LOCATION: North of the 4-wide construction trailer

DRILL RIG: CME 55  
DATE STARTED: 9/24/16  
DATE COMPLETED: 9/24/16

NORTHING: 1,391,396.30  
EASTING: 2,202,736.90  
GS ELEVATION: 786.03  
TOC ELEVATION: 789.04 ft

DEPTH W.L.: 21.49  
ELEVATION W.L.: 764.51  
DATE W.L.: 10/6/2016  
TIME W.L.: 920

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	BLOWS per 6 in  140 lb hammer 30 inch drop	N-VALUE	REC		
					DEPTH (ft)							
45	740	34.50 - 50.50 Bedrock; SCHIST; strong to very strong, light to dark gray with white and black laminations, sub-parallel; sightly weathered top with red oxidation on fractured surfaces to fresh and unfractured at the bottom. <i>(Continued)</i>	BR									<b>WELL CASING</b> Interval: 0'-40' Material: Schedule 40 PVC Diameter: 2 Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 40'-50' Material: Schedule 40 PVC Diameter: 2 Slot Size: 0.010 End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 34.6'-50.5' Type: FliterSil  <b>FILTER PACK SEAL</b> Interval: 29'-34.6' Type: PEL-PLUG 3/8" Bentonite pellets  <b>ANNULUS SEAL</b> Interval: 0'-29' Type: Portland Type I/Type II/Gel Mix  <b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 4"x4"x5' aluminum  <b>DRILLING METHODS</b> Soil Drill: Hollow-stem auger Rock Drill: HQ Core Barrell
50	735	Boring completed at 50.50 ft			735.5							
55	730											
60	725											
65	720											
70	715											
75	710											
80	705											
85	700											
90												

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Terracon  
DRILLER: Shep Becker

GA INSPECTOR: Aubrey Ellis  
CHECKED BY: Timothy Richards, PG  
DATE: 12/22/17



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

# RECORD OF BOREHOLE B-58

SHEET 1 of 2








PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 45.00 ft  
LOCATION: SW corner of the new overflow parking lot of the NEW admin building

DRILL RIG: CME 55  
DATE STARTED: 9/22/16  
DATE COMPLETED: 9/23/16

NORTHING: 1,391,125.70  
EASTING: 2,202,426.50  
GS ELEVATION: 785.20  
TOC ELEVATION: 788.17 ft

DEPTH W.L.: 22.30  
ELEVATION W.L.: 762.9  
DATE W.L.: 10/6/2016  
TIME W.L.: 940

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES				MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS	
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE			REC
					DEPTH (ft)							
0	785	0.00 - 13.50 Top 10' were Hydrovac for utilities.									CETCO puregold grout (70:30) – / aluminum casing	<b>WELL CASING</b> Interval: 0'- 34.5' Material: Schedule 40 PVC Diameter: 2 Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 34.5'-44.5' Material: Schedule 40 PVC Diameter: 2 Slot Size: 0.010 End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 31.7'-45.' Type: FilterSil  <b>FILTER PACK SEAL</b> Interval: 24.1'-31.7' Type: PEL-PLUG 3/8" Bentonite pellets  <b>ANNULUS SEAL</b> Interval: 0'-24.1' Type: CETCO puregold grout (70:30)  <b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 4"x4"x5' aluminum  <b>DRILLING METHODS</b> Soil Drill: Hollow-stem auger Rock Drill: N/A
15	770	13.50 - 18.50 SC-SM, silty SAND/ clayly SAND, fine to coarse, low plasticity; red to red orang, fill; cohesive, moist, w<PL, soft to firm.	SC-SM		771.7 13.50	1	DO	5-6-7	13	1.50 1.50		
20	765	18.50 - 23.50 ML, SILT, trace sand, low to moderate plasticity; red orange, micaceous, fill; cohesive, moist, w<PL, soft to firm.	ML		766.7 18.50	2	DO	2-1-2	3	1.50 1.50	CETCO puregold – grout (70:30)	
25	760	23.50 - 28.50 ML, SILT, some fine sand, low plasticity; tan to white; cohesive, wet, w<PL (over saturated), soft.	ML		761.7 23.50	3	DO	2-3-3	6	1.50 1.50		
30	755	28.50 - 33.50 ML, SILT, non plastic; brown to silver, slight to deeply weathered, schistose gneiss saprolite; cohesive, wet, w<PL, firm to stiff.	ML		756.7 28.50	4	DO	4-7-9	16	1.50 1.50	PEL-PLUG 3/8" – Bentonite pellets	
35	750	33.50 - 45.00 ML, SILT, trace to some sand, low to moderate plasticity; brown to dark brown, micaceous, schistose gneiss/shcist saprolite; cohesive, moist to wet, w<PL, soft to stiff.	ML		751.7 33.50	5	DO	1-4-7	11	1.50 1.50	FilterSil –	
40	745		ML			6	DO	3-6-11	17	1.50 1.50	0.010 Slotted Screen –	
45					740.2	7	DO	3-7-12	19	1.50 1.50		
		Boring continued on next page										

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 12/22/17



# RECORD OF BOREHOLE B-58

SHEET 2 of 2

PROJECT: Plant McDonough  
 PROJECT NUMBER: 1668496.18  
 DRILLED DEPTH: 45.00 ft  
 LOCATION: SW corner of the new overflow parking lot of the NEW admin building

DRILL RIG: CME 55  
 DATE STARTED: 9/22/16  
 DATE COMPLETED: 9/23/16

NORTHING: 1,391,125.70  
 EASTING: 2,202,426.50  
 GS ELEVATION: 785.20  
 TOC ELEVATION: 788.17 ft

DEPTH W.L.: 22.30  
 ELEVATION W.L.: 762.9  
 DATE W.L.: 10/6/2016  
 TIME W.L.: 940

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
45	740											<b>WELL CASING</b> Interval: 0'-34.5' Material: Schedule 40 PVC Diameter: 2 Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 34.5'-44.5' Material: Schedule 40 PVC Diameter: 2 Slot Size: 0.010 End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 31.7'-45.' Type: FilterSil  <b>FILTER PACK SEAL</b> Interval: 24.1'-31.7' Type: PEL-PLUG 3/8" Bentonite pellets  <b>ANNULUS SEAL</b> Interval: 0'-24.1' Type: CETCO puregold grout (70:30)  <b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 4"x4"x5' aluminum  <b>DRILLING METHODS</b> Soil Drill: Hollow-stem auger Rock Drill: N/A
50	735											
55	730											
60	725											
65	720											
70	715											
75	710											
80	705											
85	700											
90												

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

LOG SCALE: 1 in = 5.5 ft  
 DRILLING COMPANY: Southern Company Services  
 DRILLER: S. Milam

GA INSPECTOR: Michael Boatman, PG  
 CHECKED BY: Timothy Richards, PG  
 DATE: 12/22/17



# RECORD OF BOREHOLE B-59







SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 30.25 ft  
LOCATION: westside of the stream north of AP4

DRILL RIG: CME 55  
DATE STARTED: 9/23/16  
DATE COMPLETED: 9/23/16

NORTHING: 1,394,349.10  
EASTING: 2,203,001.10  
GS ELEVATION: 785.41  
TOC ELEVATION: 788.00 ft

DEPTH W.L.: 5.56  
ELEVATION W.L.: 779.94  
DATE W.L.: 10/6/2016  
TIME W.L.: 828

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
					DEPTH (ft)							
0	785	0.00 - 3.50 SC, clayly SAND, fine to coarse, non plastic; red, micaceous, fill; cohesive, dry, w<PL, stiff.	SC			1	DO	3-5-7	12	1.16 1.50	CETCO puregold grout (70:30) – / aluminum casing	<b>WELL CASING</b> Interval: 0'-20.2' Material: Schedule 40 PVC Diameter: 2 Joint Type: Flush/Screw
					781.9							
		3.50 - 9.00 CH, CLAY, moderate to high plasticity; aark brown to red brown, fill; cohesive, moist, w>PL, soft.	CH		3.50	2	DO	2-1-1	2	0.75 1.50		<b>WELL SCREEN</b> Interval: 20.2'-30.2' Material: Schedule 40 PVC Diameter: 2 Slot Size: 0.010 End Cap: Schedule 40 PVC
5	780											
		9.00 - 14.00 SM, SAND and SILT, fine, trace organics, non to low plasticity; gray; cohesive, wet, w<PL, very soft.	SM		776.4	3	DO	WOH-1-1	2	1.50 1.50	CETCO puregold – grout (70:30)	<b>FILTER PACK</b> Interval: 17'-30.2' Type: FilterSil
10	775				9.00							
		14.00 - 19.00 SP-SW, moderate- graded SAND, fine to coarse, non plastic; tan to white; non-cohesive, wet, w<PL, loose.	SP-SW		771.4	4	DO	4-5-7	12	1.50 1.50	PEL-PLUG 3/8" – Bentonite pellets	<b>FILTER PACK SEAL</b> Interval: 12'-17" Type: PEL-PLUG 3/8" Bentonite pellets
15	770				14.00							
		19.00 - 24.50 SM, silty SAND, low plasticity; gray to black, deeply weathered, gneissic saprolite; cohesive, moist to wet, w<PL, firm to very stiff, PWR. Auger Refusal at 24.3	SM		766.4	5	DO	5-4-5	9	1.00 1.50	FilterSil –	<b>ANNULUS SEAL</b> Interval: 0'-12' Type: CETCO puregold grout (70:30)
20	765				19.00							
		24.50 - 30.25 Bedrock; AUGEN GNEISS; slightly weathered, foliated, gray to dark gray, fine to medium grained, medium strong.	BR		760.9	6	DO	50/4	50/4	0.66 0.33	0.010 Slotted Screen	<b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 4"x4"x5' aluminum
25	760				24.50							
		Boring completed at 30.25 ft			755.2							<b>DRILLING METHODS</b> Soil Drill: Hollow-stem auger Rock Drill: HQ Core Barrell
30	755											
35	750											
40	745											
45												

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 12/22/17





# RECORD OF BOREHOLE B-60

SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 49.80 ft  
LOCATION: Almost due south of B-58 ~ 300 to 400 feet

DRILL RIG: CME 55  
DATE STARTED: 9/29/16  
DATE COMPLETED: 9/29/16

NORTHING: 1,391,100.70  
EASTING: 2,202,881.60  
GS ELEVATION: 779.25  
TOC ELEVATION: 782.13 ft

DEPTH W.L.: 33.35  
ELEVATION W.L.: 745.85  
DATE W.L.: 10/6/2016  
TIME W.L.: 955

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS	
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC			
					DEPTH (ft)								
0		0.00 - 13.50 Top 10' were Hydrovac for utilities.										CETCO puregold grout (70:30) – / aluminum casing	<b>WELL CASING</b> Interval: 0'-39.3' Material: Schedule 40 PVC Diameter: 2 Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 39.3' - 49.3' Material: Schedule 40 PVC Diameter: 2 Slot Size: 0.010 End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 36.9'-50' Type: FilterSil  <b>FILTER PACK SEAL</b> Interval: 30.2'-36.9' Type: PEL-PLUG 3/8" Bentonite pellets  <b>ANNULUS SEAL</b> Interval: 0'-30.2' Type: CETCO puregold grout (70:30)  <b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 4"x4"x5' aluminum  <b>DRILLING METHODS</b> Soil Drill: Hollow-stem auger Rock Drill: N/A
775													
5													
770													
10													
15		13.50 - 23.50 SC-SM, clayey SAND - silty SAND; brown to red brown; non-cohesive, moist, loose.			765.8 13.50	1	DO	4-3-4	7	0.66 1.50		CETCO puregold – grout (70:30)	
20			SC-SM			2	DO	3-2-3	5	1.33 1.50			
25		23.50 - 28.50 CL, silty CLAY, low plasticity; contains mica; moist, W<PL.			755.8 23.50	3	DO	1-3-5	8	1.50 1.50			
30		28.50 - 33.50 SC-SM, clayey SAND - silty SAND, fine grained, low to non-plastic; brown to gray; non-cohesive, moist, compact.			750.8 28.50	4	DO	2-8-10	18	1.50 1.50			
35		33.50 - 48.50 SM, silty SAND; brown to red brown, saprolite; non-cohesive, moist to wet (increases with depth), dense, PWR.			745.8 33.50	5	○	50/4	50/4	0.33 0.33		PEL-PLUG 3/8" – Bentonite pellets	
40			SM			6	○	50/4	50/4	0.33 0.33			
45						7	○	50/4	50/4	0.25 0.33		FilterSil –	
		Log continued on next page											

Log continued on next page

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Nortey Yeboah  
CHECKED BY: Timothy Richards, PG  
DATE: 12/22/17



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

# RECORD OF BOREHOLE B-60

SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 49.80 ft  
LOCATION: Almost due south of B-58 ~ 300 to 400 feet

DRILL RIG: CME 55  
DATE STARTED: 9/29/16  
DATE COMPLETED: 9/29/16

NORTHING: 1,391,100.70  
EASTING: 2,202,881.60  
GS ELEVATION: 779.25  
TOC ELEVATION: 782.13 ft

DEPTH W.L.: 33.35  
ELEVATION W.L.: 745.85  
DATE W.L.: 10/6/2016  
TIME W.L.: 955

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
45		33.50 - 48.50 SM, silty SAND; brown to red brown, saprolite; non-cohesive, moist to wet (increases with depth), dense, PWR. (Continued)	SM								0.010 Slotted Screen	<b>WELL CASING</b> Interval: 0'-39.3' Material: Schedule 40 PVC Diameter: 2 Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 39.3' - 49.3' Material: Schedule 40 PVC Diameter: 2 Slot Size: 0.010 End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 36.9'-50' Type: FilterSil  <b>FILTER PACK SEAL</b> Interval: 30.2'-36.9' Type: PEL-PLUG 3/8" Bentonite pellets  <b>ANNULUS SEAL</b> Interval: 0'-30.2' Type: CETCO puregold grout (70:30)  <b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 4"x4"x5' aluminum  <b>DRILLING METHODS</b> Soil Drill: Hollow-stem auger Rock Drill: N/A
730		48.50 - 49.80 SM, silty SAND; gray to brown, saprolite, contains mica; non-cohesive, moist to wet (increases with depth), dense, PWR Boring completed at 49.80 ft	SM		730.8 48.50 729.5	8	DO	50/3	50/3	0.16 0.25		
50												
725												
55												
720												
60												
715												
65												
710												
70												
705												
75												
700												
80												
695												
85												
690												
90												

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Nortey Yeboah  
CHECKED BY: Timothy Richards, PG  
DATE: 12/22/17



# RECORD OF BOREHOLE B-61





SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 52.40 ft  
LOCATION: SSW of B-57. on the NE corner of the switch yard

DRILL RIG: CME 55  
DATE STARTED: 9/28/16  
DATE COMPLETED: 9/29/16

NORTHING: 1,390,957.80  
EASTING: 2,202,505.80  
GS ELEVATION: 778.95  
TOC ELEVATION: 782.09 ft

DEPTH W.L.: 22.25  
ELEVATION W.L.: 756.75  
DATE W.L.: 10/6/2016  
TIME W.L.: 950

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES				MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS	
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE			REC
					DEPTH (ft)							
0		0.00 - 13.50 Top 10' were Hydrovac for utilities.									<div>CETCO puregold grout (70:30) – / aluminum casing</div> <div>CETCO puregold grout (70:30)</div> <div>PEL-PLUG 3/8" – Bentonite pellets</div> <div>FilterSil –</div>	<div><b>WELL CASING</b> Interval: 0'-41.5' Material: Schedule 40 PVC Diameter: 2 Joint Type: Flush/Screw</div> <div><b>WELL SCREEN</b> Interval: 41.5'-51.5' Material: Schedule 40 PVC Diameter: 2 Slot Size: 0.010 End Cap: Schedule 40 PVC</div> <div><b>FILTER PACK</b> Interval: 39.5'-51.9' Type: FilterSil</div> <div><b>FILTER PACK SEAL</b> Interval: 35'-39.5' Type: PEL-PLUG 3/8" Bentonite pellets</div> <div><b>ANNULUS SEAL</b> Interval: 0'-35' Type: CETCO puregold grout (70:30)</div> <div><b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 4"x4"x5' aluminum</div> <div><b>DRILLING METHODS</b> Soil Drill: Hollow-stem auger Rock Drill: N/A</div>
775												
5												
770												
10												
765		13.50 - 18.50 CL-CH, CLAY, trace sand and silt, fine to coarse, moderate plasticity; dark red brown, fill; cohesive, moist, w<PL, soft.	CL-CH		765.5 13.50	1	DO	3-4-6	10	1.50 1.50		
15												
760		18.50 - 23.50 SM, silty SAND, fine, non to low plasticity, trace organics (tree root); dark gray to black; cohesive, dry to moist, w<PL, firm	SM		760.5 18.50	2	DO	5-8-13	21	1.50 1.50		
20												
755		23.50 - 38.50 ML, SILT, trace fine to coarse sand, non to low plasticity; red-brown to gray to black; cohesive, dry to moist, w<PL, firm.			755.5 23.50	3	DO	6-8-13	21	1.16 1.50		
25												
750												
30												
745												
35												
740		38.50 - 52.40 SM, silty SAND, fine to coarse, non to low plasticity; dark brown to gray to black, deeply weathered, schistose gneiss / schist saprolite; non-cohesive to cohesive, moist, w<PL, compact to dense / firm to stiff, PWR.	SM		740.5 38.50	6	DO	7-10-23	33	1.33 1.50		
40												
735												
45												

# RECORD OF BOREHOLE B-61

SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 52.40 ft  
LOCATION: SSW of B-57. on the NE corner of the switch yard

DRILL RIG: CME 55  
DATE STARTED: 9/28/16  
DATE COMPLETED: 9/29/16

NORTHING: 1,390,957.80  
EASTING: 2,202,505.80  
GS ELEVATION: 778.95  
TOC ELEVATION: 782.09 ft

DEPTH W.L.: 22.25  
ELEVATION W.L.: 756.75  
DATE W.L.: 10/6/2016  
TIME W.L.: 950

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
45		38.50 - 52.40 SM, silty SAND, fine to coarse, non to low plasticity; dark brown to gray to black, deeply weathered, schistose gneiss / schist saprolite; non-cohesive to cohesive, moist, w<PL, compact to dense / firm to stiff, PWR. (Continued)	SM								0.010 Slotted _ Screen	<b>WELL CASING</b> Interval: 0'-41.5' Material: Schedule 40 PVC Diameter: 2 Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 41.5'-51.5' Material: Schedule 40 PVC Diameter: 2 Slot Size: 0.010 End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 39.5'-51.9' Type: FilterSil  <b>FILTER PACK SEAL</b> Interval: 35'-39.5' Type: PEL-PLUG 3/8" Bentonite pellets  <b>ANNULUS SEAL</b> Interval: 0'-35' Type: CETCO puregold grout (70:30)  <b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 4"x4"x5' aluminum  <b>DRILLING METHODS</b> Soil Drill: Hollow-stem auger Rock Drill: N/A
730						8	DO	14-9-14	23	1.50 1.50		
50												
		Boring completed at 52.40 ft			726.6							
725												
55												
720												
60												
715												
65												
710												
70												
705												
75												
700												
80												
695												
85												
690												
90												

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 12/22/17



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20



# **DRILLING LOG** **GEOLOGICAL SERVICES**

Hole No. **B-64**  
Sheet 1 of 2

SITE <b>Plant McDonough</b>		HOLE DEPTH <b>31'</b>	SURFELEV <b>786.10</b>
LOCATION <b>North of AP-4, near property line at Atkinson Rd</b>		COORDINATES <b>33.832856</b>	<b>-84.474746</b>
ANGLE _____	BEARING _____	CONTRACTOR <b>SCS</b>	DRILL NO. _____
DRILLING METHOD <b>HSA</b>		NO. SAMPLES _____	NO. U.D. SAMPLES <b>0</b>
CASING SIZE <b>2"</b>	LENGTH <b>10'</b>	CORE SIZE _____	TOTAL % REC. _____
WATER TABLE DEPTH <b>4.9' BLS</b>	ELEV. <b>781.20' NAVD88</b>	TIME AFTER COMP. <b>24 hr</b>	DATE TAKEN <b>11/3/2016</b>
TYPE GROUT <b>Bentonite</b>	QUANTITY _____	MIX <b>.</b>	DRILLING START DATE <b>11/2/2016</b>
DRILLER <b>Milam</b>	RECORDER <b>Abraham</b>	APPROVED _____	DRILLING COMP. DATE <b>11/2/2016</b>

Depth	Elev.	Material Description, Classification and Remarks	Sample No.	Standard Penetration Test			Comments	% Rec	RQD
				From To	Blows	N			
0	786.10								
1	785.10								
2	784.10								
3	783.10								
4	782.10								
5	781.10	<b>HYDRO-EXCAVATION</b> Hydrovac from land surface to 20-feet below land. No samples							
6	780.10								
7	779.10								
8	778.10								
9	777.10								
10	776.10								
11	775.10								
12	774.10								
13	773.10								
14	772.10								
15	771.10								
16	770.10								
17	769.10								
18	768.10								
19	767.10								
20	766.10								
21	765.10								
22	764.10	<b>SANDY SILT SAPROLITE</b> Light gray sandy silt saprolite; minor quartz & feldspar grains, micaceous; oxidation along relict foliations; Fe stains; 2.5Y/6/1; SM.	S-1	23.5 - 25	1-1-2			85	
23	763.10								
24	762.10								



# WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS, Inc.		WELL NAME	
North of AP-4, at Atkinson Rd		DRILLER: Milam			
LOCATION: 33.832856 / -84.474746		RIG TYPE: CME550			
LOGGER: Abraham		DRILLING METHODS: HSA		B-64	
DATE CONSTRUCTED: 11/2/2016		Survey Coordinates: N: 1394381.9 E: 2203031.3			
				DEPTH	ELEVATION
				FEET	FT, MSL
				TOC	785.83
4 ft x 4 ft x 4" concrete pad				GROUND SURFACE	0.0
					785.98

**DRILLING LOG**  
**GEOLOGICAL SERVICES**

Hole No. **B-65**  
Sheet 1 of 2

SITE **Plant McDonough** HOLE DEPTH **50'** SURFELEV **822.30**  
LOCATION **North of AP-4, near property line, NW end of parking lot** COORDINATES **33.832862** **-84.471389**  
ANGLE \_\_\_\_\_ BEARING \_\_\_\_\_ CONTRACTOR **SCS** DRILL NO. \_\_\_\_\_  
DRILLING METHOD **HSA** NO. SAMPLES \_\_\_\_\_ NO. U.D. SAMPLES **0**  
CASING SIZE **2"** LENGTH **10'** CORE SIZE \_\_\_\_\_ TOTAL % REC. \_\_\_\_\_  
WATER TABLE DEPTH **10.5' BLS** ELEV. **811.80 NAVD88** TIME AFTER COMP. **24 HR** DATE TAKEN **11/16/2016**  
TYPE GROUT \_\_\_\_\_ QUANTITY \_\_\_\_\_ MIX **.** DRILLING START DATE **11/15/2016**  
DRILLER **Milam** RECORDER **Abraham** APPROVED \_\_\_\_\_ DRILLING COMP. DATE **11/15/2016**

Depth	Elev.	Material Description, Classification and Remarks	Sample No.	Standard Penetration Test			Comments	% Rec	RQD
				From To	Blows	N			
0	822.30								
1	821.30	<b>HYDRO-EXCAVATION</b> Hydrovac from land surface to 10-feet below land. No samples							
2	820.30								
3	819.30								
4	818.30								
5	817.30								
6	816.30								
7	815.30								
8	814.30								
9	813.30								
10	812.30								
11	811.30	<b>SILTY SAND SAPROLITE</b> Light brown silty sand with minor clay; weathered schist fragments; minor oxidation bands; minor quartz fragments 10YR/3/2; SM; At 15-ft, large rock fragments brownish black color; damp.							
12	810.30								
13	809.30								
14	808.30		S-1	13.5-15	13-50/3			90	
15	807.30								
16	806.30	<b>SILTY SAND SAPROLITE</b> Blackish brown silty sand saprolite; large micas with a greenish tinge; highly oxidized with FeO parallel to foliations; 10YR/3/2; SM; damp to moist.							
17	805.30								
18	804.30								
19	803.30		S-2	18.5-20	24-30-31	61		90	
20	802.30								
21	801.30	<b>CLAYEY SILT</b> Dark gray to reddish brown silty sand saprolite; micas abundant; softer than interval above; few gravel-size rock fragments; FeO bands with minor MnO streaks; 2.5Y/3/2; SM; moist to saturated.							
22	800.30								
23	799.30		S-3	23.5 - 25	2-16-50/2			90	
24	798.30								



**DRILLING LOG**  
**GEOLOGICAL SERVICES**

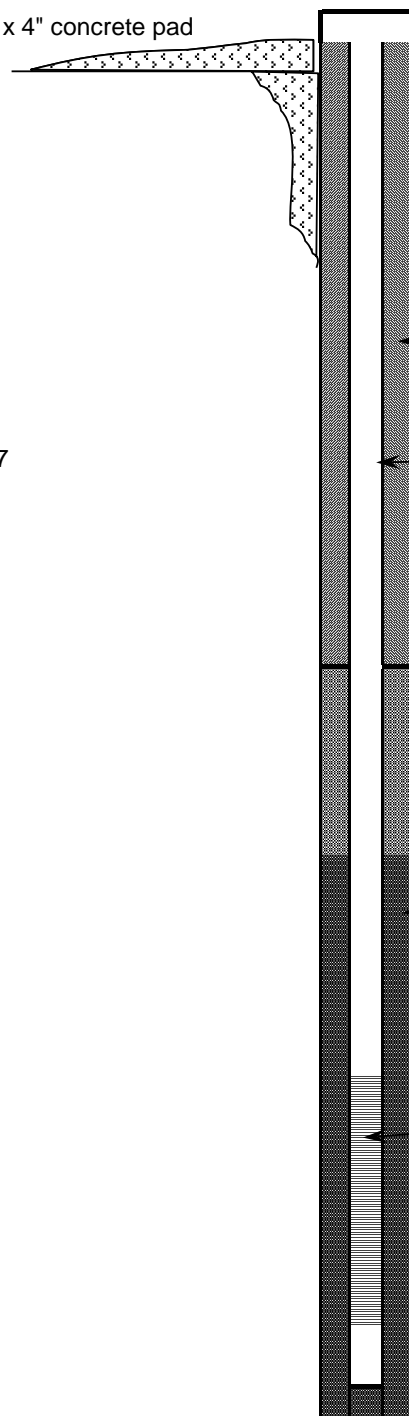
Hole No. **B-65**

Sheet 2 of 2

SITE		Plant McDonough		TOTAL DEPTH		50'		SURF.ELEV.		822.30	
Depth	Elev.	Material Description, Classification and Remarks	Sample No.	Standard Penetration Test			Comments	% Rec	RQD		
				From To	Blows	N					
25	797.30	SILTY SAND SAPROLITE  Dark gray to reddish brown silty sand with minor clay; few structures; 2.5Y/3/2; SM; saturated.	S-4	28.5-30	50/2			90			
26	796.30										
27	795.30										
28	794.30										
29	793.30										
30	792.30	SILTY SAND SAPROLITE  Dark gray to reddish brown silty sand with minor gravel; damp to saturated; 2.5Y/3/2	S-5	33.5 - 35	50/2			90			
31	791.30										
32	790.30										
33	789.30										
34	788.30										
35	787.30	SILTY SAND SAPROLITE  Dark gray to reddish brown silty sand with minor clay; saprolite; saturated; 2.5YR/3/2	S-6	38.5 - 40	6-9-32			90			
36	786.30										
37	785.30										
38	784.30										
39	783.30										
40	782.30	Top of Rock - 42-ft	S-7	40 - 42	50/2			90			
41	781.30										
42	780.30										
43	779.30										
44	778.30										
45	777.30	MUSCOVITE-BIOTITE SCHIST; minor chlorite; 2 horizontal fractures, non-water bearing, 44' 1 sub-vertical fracture, water-bearing, 46' - 50'		42 - 49.9				95			
46	776.30										
47	775.30										
48	774.30										
49	773.30										
50	772.30	BACKFILLED & SET REGOLITH WELL									
51	771.30										
52	770.30										
53	769.30										
54	768.30										
55	767.30										
56	766.30										
		END OF BORING - 49.9-FT									

# WELL CONSTRUCTION LOG

Southern Company Generation

PROJECT: Plant McDonough		DRILLING CO.: SCS, Inc.		WELL NAME	
NE of AP-4 at Argos, near N corner parking lot		DRILLER: Milam			
LOCATION: 33.832862 / -84.471389		RIG TYPE: CME550		B-65	
LOGGER: Abraham		DRILLING METHODS: HSA			
DATE CONSTRUCTED: 11/15/2016		Survey Coordinates: N: 1394381.2 E: 2204050.8			
 <p>6 ft x 6 ft x 4" concrete pad</p> <p>GROUND SURFACE</p> <p><b>PROTECTIVE CASING</b> Flushmounted</p> <p>BOTTOM OF GROUT</p> <p><b>BACKFILL MATERIAL</b> TYPE: Bentonite Grout mix AMOUNT: 3 x 50lbs (1.5 bag bentonite; 1.5 bag grout)</p> <p><b>RISER CASING</b> DIA: 2-inch TYPE: Schedule 40 PVC JOINT TYPE: Flush Threaded</p> <p>TOP OF SEAL</p> <p><b>ANNULAR SEAL</b> TYPE: 1/4" coated bentonite pellets 5-gal buckets AMOUNT: 0.5 bucket PLACEMENT: Tremie</p> <p>TOP OF FILTER PACK</p> <p><b>FILTER PACK</b> TYPE: DSI Sand - 1A (20/40) Drillers Services, Inc. AMOUNT: 5 Bags PLACEMENT: Tremie; wash with water</p> <p>BOTTOM OF RISER / TOP OF SCREEN</p> <p><b>SCREEN</b> DIA: 2" TYPE: Schedule 40 PVC Prepack OPENING WIDTH: 0.01 inch OPENING TYPE: Slotted SLOT SPACING: 0.25 inch SLOT LENGTH: 1.5 inch</p> <p>BOTTOM OF SCREEN</p> <p>BOTTOM OF WELL</p> <p>HOLE DIA: 9 inch</p> <p>TYPE: 1/4" coated bentonite pellets between 45.4' and 49.9'</p>				DEPTH FEET TOC	ELEVATION FT, MSL
					821.95
					822.30
					819.3
					795.5
					790.5
	787.9				
	777.9				
	776.9				
	772.4				

# RECORD OF BOREHOLE B-68 / DGWC-68

SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 40.40 ft  
LOCATION: West Toe of AP-1

DRILL RIG: Geoprobe  
DATE STARTED: 3/16/17  
DATE COMPLETED: 3/16/17

NORTHING: 1,391,298.20  
EASTING: 2,200,714.20  
GS ELEVATION: 759.05  
TOC ELEVATION: 758.68 ft

DEPTH W.L.: 3.5  
ELEVATION W.L.: 755.06  
DATE W.L.: 3/16/17  
TIME W.L.: 1700

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES				MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS		
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE			REC	
					DEPTH (ft)								
0		0.00 - 10.00 Hydrovac										Flush Mounted Casing CETCO puregold grout (70:30)	<b>WELL CASING</b> Interval: 0'-8' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screen
755													<b>WELL SCREEN</b> Interval: 8.0'-18.0' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC
5												PEL-PLUG 3/8" Bentonite pellets	<b>FILTER PACK</b> Interval: 6.1'-18.4' Type: FilterSil
750													<b>FILTER PACK SEAL</b> Interval: 4.1'-6.1' Type: PEL-PLUG 3/8" Bentonite pellets
10		10.00 - 15.00 Sandy Silt, fine to medium sand, dark brown, highly weathered, micaceous, cohesive, moist, firm, sample spoon wet	ML		749 10.00							FilterSil	<b>ANNULUS SEAL</b> Interval: 0'-4.1' Type: CETCO puregold grout (70:30)
745						S1	SPT	5-6-5	11	1.08 1.50		.010" Slotted Schedule 40 PVC	<b>WELL COMPLETION</b> Pad: 4'x4' Concrete Protective Casing: 8" Round Flush Mount
15		15.00 - 18.80 Silty Sand, fine to coarse, trace gravel, greenish grey, weathered, thinly bedded, noncohesive, very dense, (weathered gneiss)	PWR		744 15.00								<b>DRILLING METHODS</b> Soil Drill: Hollow-stem auger Rock Drill: HQ Core Barrell
740			PWR		740.2	S2	SPT	50/3	50/3	0.25 0.25		FilterSil	
20		19.20 - 22.80 Slightly weathered to fresh, weakly foliated, light gray to white, fine to very fine grained, medium strong to strong, MYLONITE (White Mylonite).	BR		19.20								
735					736.2 22.80 734.9 24.10								
25		22.80 - 24.10 Slight to moderately weathered, weakly foliated, dary gray to black , fine to very fine grained, medium strong, MYLONITE (Black Mylonite).	BR										
730		24.10 - 28.90 Slightly weathered to fresh, weakly foliated, interlayered with vein quartz (~1"), light grey to white, fine to very fine grained, medium strong to strong, MYLONITE (White Mylonite).	BR		730.1 28.90							PEL-PLUG 3/8" Bentonite pellets	
30		28.90 - 38.00 Slightly weathered to fresh, moderate to strongly foliated, interlayered with Black Mylonite (~1") and pegmatites (~1 to 2"), light to dark gray, fine to coarse grained, medium strong to strong, Sheared Gneiss (Long Island Creek).	BR										
725					721 38.00 719.8 39.20 718.6								
40		38.00 - 39.20 Slight to moderately weathered, weakly foliated, dary gray to black , fine to very fine grained, medium strong, MYLONITE (Black Mylonite).	BR										
720		39.20 - 40.40 Slightly weathered to fresh, moderate to strongly foliated, light to dark gray, fine to coarse grained, medium strong to strong, Sheared Gneiss (Long Island Creek).	BR										
715		Boring completed at 40.40 ft											
45													

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: Sean Denty

GA INSPECTOR: Ben Hodges  
CHECKED BY: Timothy Richards, PG  
DATE: 1/16/18



# RECORD OF BOREHOLE B-72

SHEET 1 of 1

PROJECT: SCS-Plant McDonough  
PROJECT NUMBER: 1779172  
DRILLED DEPTH: 21.90 ft  
LOCATION: ~50' SSE of B-68

DRILL RIG: Geoprobe 7822DT  
DATE STARTED: 4/19/17  
DATE COMPLETED: 4/19/17

NORTHING: 1,391,241.4  
EASTING: 220,0725.9  
GS ELEVATION: 758.45  
TOC ELEVATION: 758.46 ft

DEPTH W.L.: 2.90  
DATE W.L.: 5/2/2017  
TIME W.L.: 09:00

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
0		0.00 - 5.00 ML, SILT, with trace fine sand and gravels (rock fragments), low plasticity; brown; cohesive, moist, w<PL, soft.	ML								<p>8" Diameter Round Flush Mount</p> <p>Pure Gold Grout Mixture</p> <p>Pel-Plug 3/8" Bentonite Pellets</p> <p>FilterSil gravel pack</p> <p>Pre-pack 0.010" Slotted Schedule PVC</p>	<b>WELL CASING</b> Interval: 0' - 21.9' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>SURFACE CASING</b> Interval: Material: Diameter:  <b>WELL SCREEN</b> Interval: 11.5' - 21.5' Material: Schedule 40 PVC Pre-Pack Diameter: 2" Slot Size: 0.010" End Cap: 21.5' - 21.9'  <b>FILTER PACK</b> Interval: 9.8' - 21.9' Type: FilterSil gravel pack  <b>FILTER PACK SEAL</b> Interval: 7.7' - 9.8' Type: Pel-Plug 3/8" Bentonite Pellets  <b>ANNULUS SEAL</b> Interval: 0' - 7.7' Type: Pure Gold Grout Mixture  <b>WELL COMPLETION</b> Pad: 4' x 4' concrete Protective Casing: 8" Diameter Round Flush Mount  <b>DRILLING METHODS</b> Soil Drill: 4.25-inch ID HSA Rock Drill: N/A  <b>NOTES</b>
5		5.00 - 13.50 SP-SM, Poorly-graded SAND with Silt, fine, low plasticity; red-orange brown, relict structure, highly micaceous; cohesive, wet, w<PL, very soft.	SP-SM		753.5 5.00							
10												
15		13.50 - 18.50 SM, Silty SAND with trace fine gravels, non-plastic to low plasticity; dark brown to dark gray, highly micaceous; non-cohesive, dry to moist, w<PL, compact.	SM		745.0 13.50	S1	OD	25-50/3	50/3	0.75 1.50		
20		18.50 - 21.50 ML, SILT, with trace sand and large gravels, low plasticity; brown to dark gray black, saprolitic, highly micaceous, gneiss; cohesive, wet, w<PL, soft to firm.	ML		740.0 18.50	S2	OD	17-34-8	42	1.50 1.50		
21.90		Boring completed at 21.90 ft			737.0 21.50							

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Michael Boatman PG  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/17/17



BOREHOLE RECORD 1779172.GPJ PIEDMONT.GDT 5/18/17

# RECORD OF BOREHOLE B-73

SHEET 1 of 1

PROJECT: SCS-Plant McDonough  
PROJECT NUMBER: 1779172  
DRILLED DEPTH: 15.80 ft  
LOCATION: ~50' NNW of B-68

DRILL RIG: Geoprobe 7822DT  
DATE STARTED: 4/19/17  
DATE COMPLETED: 4/19/17

NORTHING: 1,391,351.8  
EASTING: 2,200,699.4  
GS ELEVATION: 759.16  
TOC ELEVATION: 759.21 ft

DEPTH W.L.: 4.11  
DATE W.L.: 4/26/2017  
TIME W.L.: 12:00

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE			SAMPLES				MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS			
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	TYPE	BLOWS per 6 in  140 lb hammer 30 inch drop	N-VALUE			REC		
					DEPTH (ft)								
0		0.00 - 8.50 SP-SM, Poorly-graded SAND with Silt, non-plastic; red-orange brown; non-chesive, dry to moist, w<PL, loose.	SP-SM							8" Diameter Round Flush Mount Pure Gold Grout Mixture Pel-Plug 3/8" Bentonite Pellets	<b>WELL CASING</b> Interval: 0' - 15.8' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>SURFACE CASING</b> Interval: Material: Diameter:  <b>WELL SCREEN</b> Interval: 5.4' - 15.4' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: 15.4' - 15.8'  <b>FILTER PACK</b> Interval: 3.2' - 15.8' Type: FilterSil  <b>FILTER PACK SEAL</b> Interval: 0.5' - 3.2' Type: Pel-Plug 3/8" Bentonite Pellets  <b>ANNULUS SEAL</b> Interval: 0 - 0.5' Type: Pure Gold Grout Mixture  <b>WELL COMPLETION</b> Pad: 4' x 4' concrete Protective Casing: 8" Diameter Round Flush Mount  <b>DRILLING METHODS</b> Soil Drill: 4.25-inch ID HSA Rock Drill: N/A  <b>NOTES</b>		
755													
5													
750		8.50 - 9.50 CL, CLAY, with some silt, low plasticity; red brown; cohesive, moist, w<PL, soft.	CL		750.7 8.50 749.7 9.50	S1	DO	1-8-15	23	1.50 1.50	Pre-pack 0.010" Slotted Schedule PVC  <		

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Michael Boatman PG  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/17/17



BOREHOLE RECORD 1779172.GPJ PIEDMONT.GDT 5/18/17

# RECORD OF BOREHOLE B-74




SHEET 1 of 1

PROJECT: SCS-Plant McDonough  
PROJECT NUMBER: 1779172  
DRILLED DEPTH: 16.50 ft  
LOCATION: ~50' West of B-68

DRILL RIG: Geoprobe 7822DT  
DATE STARTED: 4/24/17  
DATE COMPLETED: 4/25/17

NORTHING: 1,391,279.9  
EASTING: 2,200,666.1  
GS ELEVATION: 759.18  
TOC ELEVATION: 759.06 ft

DEPTH W.L.: 3.3'  
DATE W.L.: 4/25/2017  
TIME W.L.: 09:37

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES				MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC	
0		0.00 - 4.00 CL, CLAY, with some silt, low plasticity; red brown, fill; cohesive, moist, w<PL, soft.	CL								<b>WELL CASING</b> Interval: 0' - 16.2' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>SURFACE CASING</b> Interval: Material: Diameter:  <b>WELL SCREEN</b> Interval: 10.8' - 15.8' Material: Pre-pack Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: 15.8' - 16.2'  <b>FILTER PACK</b> Interval: 9.0' - 16.5' Type: FilterSil gravel pack  <b>FILTER PACK SEAL</b> Interval: 4.8' - 9.0' Type: Pel-Plug 3/8" Bentonite Pellets  <b>ANNULUS SEAL</b> Interval: 0' - 4.8' Type: Pure Gold Grout Mixture  <b>WELL COMPLETION</b> Pad: 4' x 4' concrete Protective Casing: 8" Diameter Round Flush Mount  <b>DRILLING METHODS</b> Soil Drill: 4.25-inch ID HSA Rock Drill: N/A  <b>NOTES</b> N/A  <b>ABANDONMENT NOTES:</b>  Abandoned on 10/4/2023 Tremmie grouted 17lbs Aquagrard/4 gallons water Overdrilled to 10 feet bgs.; 10-foot PVC removed. Final Grout: 38 lbs Quickrete/10 lbs AquaGuard/6.5 gallons water.
755		4.00 - 13.50 SP-SM, Poorly-graded SAND with Silt and trace gravel, fine to coarse, non-plastic; white to tan, deeply weathered, granitic; non-cohesive, moist, w<PL, loose/soft.	SP-SM		755.2 4.00						
750						S1	DO	3-18-20	38	0.75 1.50	
745		13.50 - 16.50 SM, Silty SAND, non-plastic; white to light gray; non-cohesive, dry to moist, w<PL, dense.	SM		745.7 13.50						
742.7		Boring completed at 16.50 ft				S2	DO	50/3	50/3	0.25 1.50	
740											
735											
730											
725											
720											
715											
710											
705											
700											
695											
690											
685											
680											
675											
670											
665											
660											
655											
650											
645											
640											
635											
630											
625											
620											
615											
610											
605											
600											
595											
590											
585											
580											
575											
570											
565											
560											
555											
550											
545											
540											
535											
530											
525											
520											
515											
510											
505											
500											
495											
490											
485											
480											
475											
470											
465											
460											
455											
450											
445											
440											
435											
430											
425											
420											
415											
410											
405											
400											

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Michael Boatman PG  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/17/17



BOREHOLE RECORD 1779172.GPJ PIEDMONT.GDT 5/18/17

# RECORD OF BOREHOLE B-76

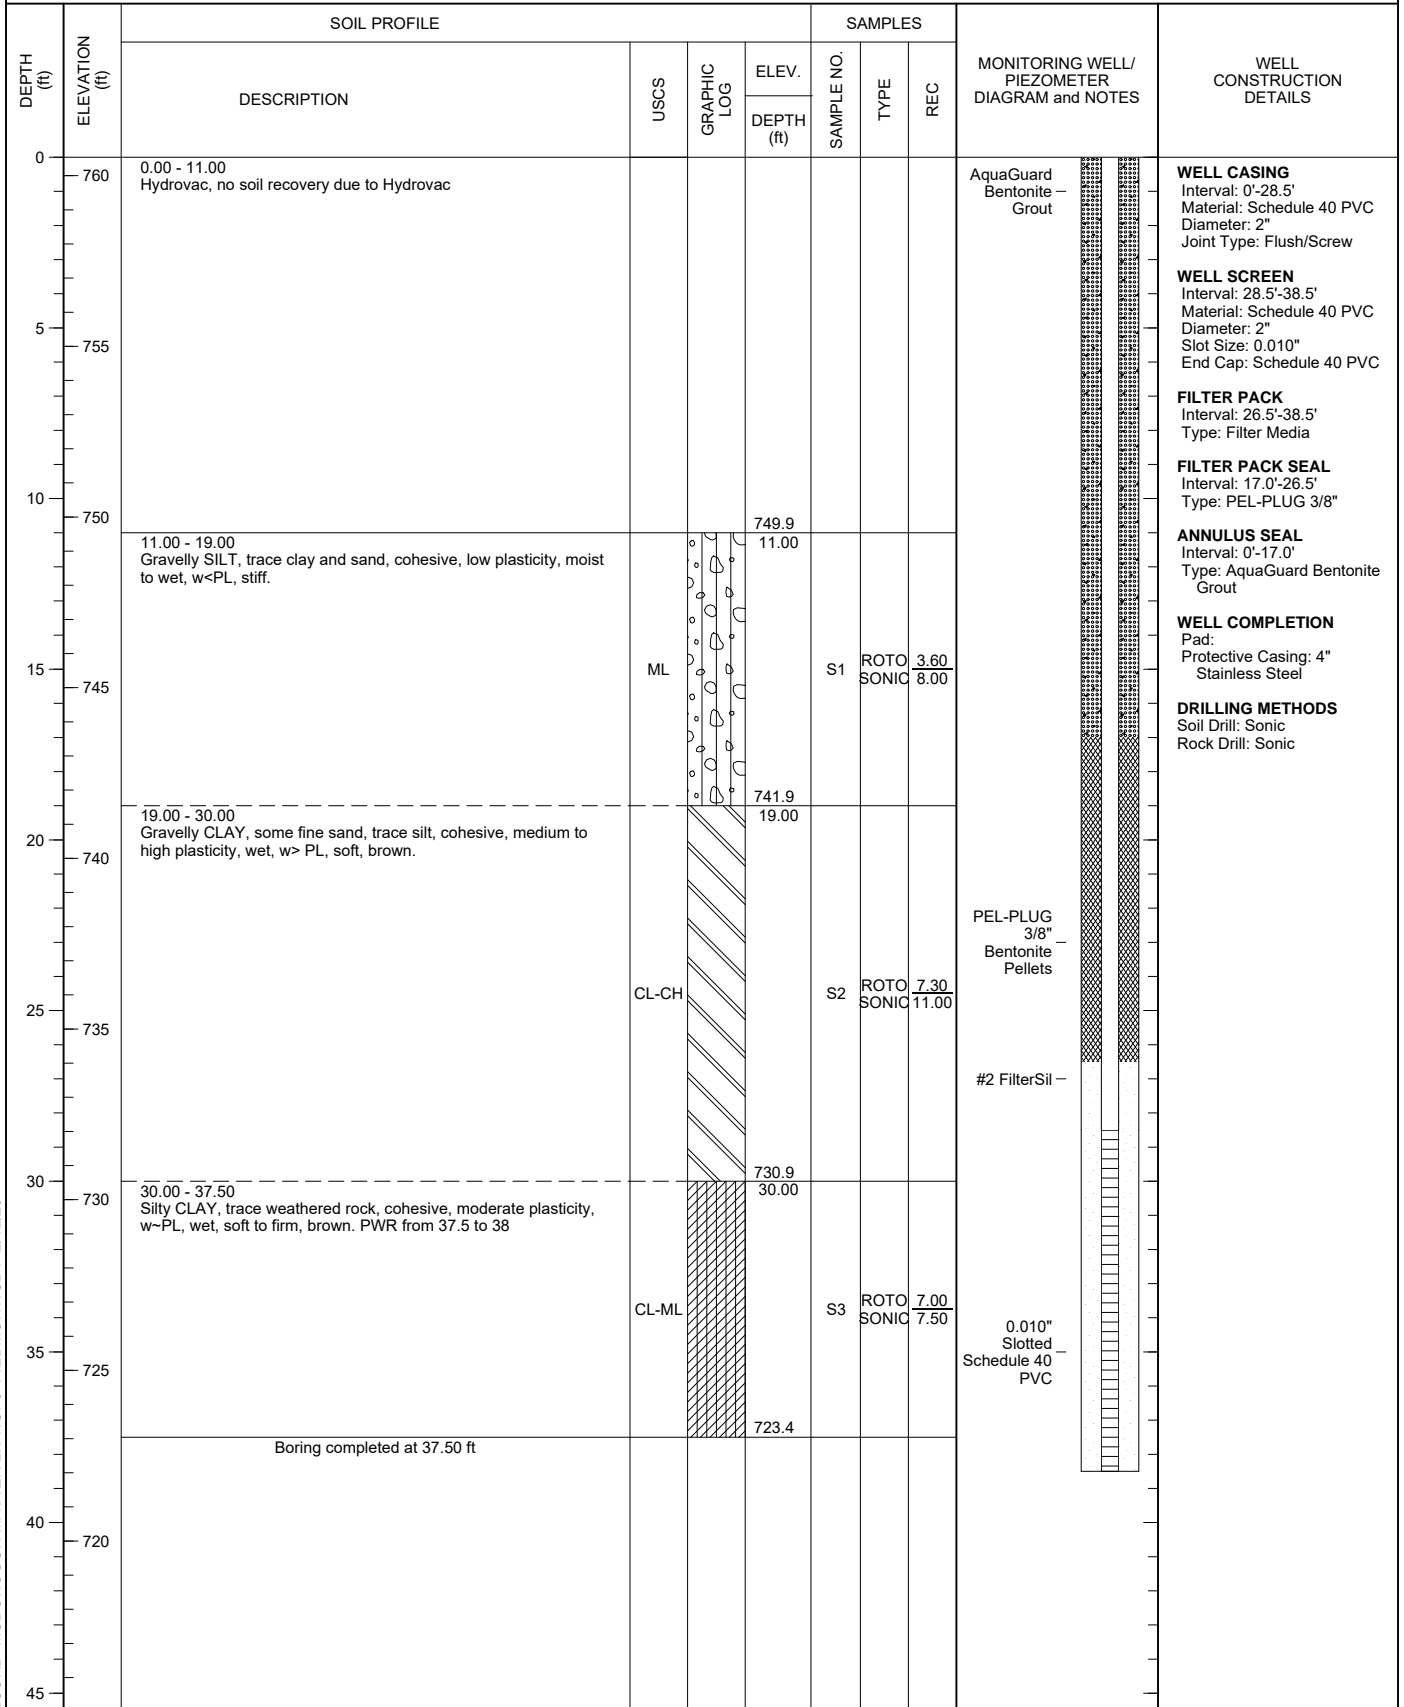
SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496-01  
DRILLED DEPTH: 37.50 ft  
LOCATION: South by river, SE of B-83

DRILL RIG: Rotosonic 1159  
DATE STARTED: 9/16/19  
DATE COMPLETED: 9/16/19

NORTHING: 1,390,717.4  
EASTING: 2,202,756.9  
GS ELEVATION: 760.87 ft  
TOC ELEVATION: 760.53 ft

DEPTH W.L.: 38.5  
DATE W.L.: 9/17/2019  
TIME W.L.: 1300  
GW ELEVATION:



BOREHOLE RECORD MCDONOUGH MASTER LIST.GPJ PIEDMONT.GDT 2/12/20

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Jose

GA INSPECTOR: D. Thomas  
CHECKED BY: Brian Steele, PG  
DATE: 2/10/20



# RECORD OF BOREHOLE B-78

SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 30.00 ft  
LOCATION: South of road on north side of plant property

DRILL RIG: Rotosonic 1159  
DATE STARTED: 9/22/19  
DATE COMPLETED: 9/22/19

NORTHING: 1,394,328.20  
EASTING: 2,202,958.20  
GS ELEVATION: 787.79  
TOC ELEVATION: 790.75 ft

DEPTH W.L.: 9.05  
ELEVATION W.L.: 778.95  
DATE W.L.: 1/13/2020  
TIME W.L.: 13:44

BOREHOLE RECORD MCDONOUGH MASTER LIST BACKUP SURVEY UPDATED (5).GPJ PIEDMONT.GDT 9/22/20

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	REC		
0		0.00 - 8.70 Hydrovac				0		0.00 0.73	Concrete Surface Completion	<b>WELL CASING</b> Interval: 0.0 - 29.0' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 20.0-29.5' Material: Schedule 40 PVC Schedule 40 PVC Diameter: 2" ID 4" OD Slot Size: 0.010 End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 17.5 - 30.0 Type: 20/40 FilterSil  <b>FILTER PACK SEAL</b> Interval: 9.0 - 17.5' Type: Pel-Plug 3/8" Bentonite Pellets  <b>ANNULUS SEAL</b> Interval: 0.4 - 9.0' Type: Baroid 3/8" Bentonite Chips (Holeplug)  <b>WELL COMPLETION</b> Pad: 4' x 4' x 4" Protective Casing: 4" Stainless Steel  <b>DRILLING METHODS</b> Soil Drill: Sonic Rock Drill: Sonic  ~250 gallons of water used while drilling
785									Baroid 3/8" Bentonite Chips (Holeplug)	
5										
780					779.1					
10		8.70 - 11.20 (MLS) sandy SILT, low plasticity fines, fine to medium sub-angular sand, trace organics (roots); light brown (5YR 5/6) to Pale Brown (5YR 2/2), residual soil with frequent micaceous minerals present; cohesive, w-PL, soft	MLS		8.70	1	ROTO SONIC	0.94 0.94		
775		11.20 - 17.00 (MLS) sandy SILT, non to low plasticity fines, fine sub-angular sand, trace soft (crumbles with pressure from fingers) gravels with relic foliations; pale yellowish brown (10YR 6/2) with light gray (N7) and dark yellowish brown (10YR 4/2) foliations, highl	MLS		776.6				Pel-Plug 3/8" Bentonite Pellets	
15					770.8					
770		17.00 - 25.10 (SM) SILTY SAND, fine sub-angular to sub-rounded sand, non-plastic fines, trace fine angular soft (crumbles with pressure from fingers) with relic foliations; pale yellowish brown (10YR 6/2) with very pale orange (10YR 8/2) and dark yellowish brown (10YR	SM		17.00	2	ROTO SONIC	0.18 0.42	20/40 FilterSil Sandpack	
20										
765										
25		25.10 - 30.00 BEDROCK, GNEISS, slightly to moderately weathered (W2 - W3), medium dark gray (N4), with light bluish gray (5B 5/1) and light gray (N7) foliations, fine to medium grained, medium strong rock (R3)	GNEISS		762.7	3	ROTO SONIC	0.31 0.42	2"ID, 4"OD 0.010 Slot SCH 40 PVC U-Pack Screen	
760					757.8					
30		Boring completed at 30.00 ft							PVC Cap	
755										
35										
750										
40										
745										
45										

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Jose

GA INSPECTOR: Jeff Ingram  
CHECKED BY: Timothy Richards, PG  
DATE: 2/12/20





# RECORD OF BOREHOLE B-79

SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 35.00 ft  
LOCATION: South of road on north side of plant property

DRILL RIG: Rotasonic 1159  
DATE STARTED: 9/20/19  
DATE COMPLETED: 9/21/19

NORTHING: 1,394,458.60  
EASTING: 2,203,223.00  
GS ELEVATION: 785.84  
TOC ELEVATION: 788.66 ft

DEPTH W.L.: 5.92  
ELEVATION W.L.: 779.98  
DATE W.L.: 1/13/2020  
TIME W.L.: 14:26

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 9/2/20

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	REC		
0	785	0.00 - 9.20 Hydrovac	NA			0		0.00 0.77	Concrete Surface / Completion	<b>WELL CASING</b> Interval: 0.0 - 34.9' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 24.93-34.43' Material: Schedule 40 PVC Schedule 40 PVC Diameter: 2" ID 4" OD Slot Size: 0.010 End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 22.0 - 35.0' Type: 20/40 FilterSil  <b>FILTER PACK SEAL</b> Interval: 14.0 - 22.0' Type: Pel-Plug 3/8" Bentonite Pellets  <b>ANNULUS SEAL</b> Interval: 0.4 - 14.0' Type: Baroid 3/8" Bentonite Chips (Holeplug)  <b>WELL COMPLETION</b> Pad: Protective Casing: 4" Stainless Steel  <b>DRILLING METHODS</b> Soil Drill: Sonic Rock Drill: Sonic  ~175 gallons of water used while drilling
5	780				776.6					
10	775	9.20 - 13.70 (ML) sandy SILT, non to low plasticity fines, fine sand; layered light brown (5YR 5/6) with dark yellowish brown (10YR 4/2) and pale yellowish brown (10YR 6/2) layers, some relic curved laminated layers (relic foliations); non-cohesive, wet, loose	ML		9.20				Baroid 3/8" Bentonite Chips (Holeplug)	
15	770	13.70 - 30.00 (SM) silty SAND, fine sub-angular sand, non-plastic fines, some soft (crumbles with pressure from fingers) fine to coarse sub-angular gravels; pale yellowish brown (10YR 6/2) with some light brown (5YR 5/6) iron oxide staining, PWR with frequent micaceous mineral; non-cohesive, wet, loose	SM		772.1	1	ROTO SONIC	0.77 10.80		
20	765					2	ROTO SONIC	0.42 0.90	Pel-Plug 3/8" Bentonite Pellets	
25	760					3	ROTO SONIC	0.42 0.42		
30	755	30.00 - 35.00 (SM) SILTY SAND, fine sub-angular sand, non-plastic fines, trace soft (crumbles with pressure from fingers) fine gravels with some relic foliations; pale yellowish brown (10YR 6/2) to dark yellowish brown (10YR 4/2) layers, PWB; non-cohesive, moist, compact			755.8	4	ROTO SONIC	0.38 0.42	2"ID, 4"OD 0.010 Slot SCH 40 PVC U-Pack Screen	
35	750	Boring completed at 35.00 ft			750.8					
40	745								PVC Cap - Backfill	
45										

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Jose

GA INSPECTOR: Jeff Ingram  
CHECKED BY: Timothy Richards, PG  
DATE: 2/12/20



# RECORD OF BOREHOLE B-80

SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 30.00 ft  
LOCATION: North to northeast of CCR Unit

DRILL RIG: Rotosonic 1159  
DATE STARTED: 9/20/19  
DATE COMPLETED: 9/20/19

NORTHING: 1,394,372.60  
EASTING: 2,203,533.90  
GS ELEVATION: 801.73  
TOC ELEVATION: 804.47 ft

DEPTH W.L.: 16.48  
ELEVATION W.L.: 785.32  
DATE W.L.: 1/13/2020  
TIME W.L.: 14:46

BOREHOLE RECORD MCDONOUGH MASTER LIST BACKUP SURVEY UPDATED (5).GPJ PIEDMONT.GDT 9/2/20

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	REC		
0		0.00 - 8.70 Hydrovac	NA			0		0.00 0.73	Concrete Surface Completion	<b>WELL CASING</b> Interval: 0.0 - 19.8' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 19.8-29.3' Material: Schedule 40 PVC Schedule 40 PVC Diameter: 2" ID 4" OD Slot Size: 0.010 End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 17.5 - 30.0' Type: 20/40 FilterSil  <b>FILTER PACK SEAL</b> Interval: 9.0 - 17.5' Type: Pel-Plug 3/8" Bentonite Pellets  <b>ANNULUS SEAL</b> Interval: 0.4 - 9.0' Type: High Solids Bentonite (AquaGuard)  <b>WELL COMPLETION</b> Pad: 4' x 4' x 4" Protective Casing: 4" Stainless Steel  <b>DRILLING METHODS</b> Soil Drill: Sonic Rock Drill: Sonic  ~150 gallons of water used while drilling
800									High Solids Bentonite (AquaGuard)	
5										
795					793.0					
		8.70 - 10.00 (ML) sandy SILT, non-plastic to low plasticity fines, fine to medium sub-rounded sand, trace organics (roots); moderate brown (5YR 4/4) to pale yellowish brown (10YR 6/2); non-cohesive, dry, loose	ML		8.70	1	ROTO SONIC	0.11 0.11		
10		10.00 - 13.20 (ML and SP) SILT and SAND, non-plastic to low plasticity fines, fine sub-angular sand; light brown (5YR 5/6) with some moderate reddish brown (10R 4/6) layers, some laminated layers (relic foliations), SAPROLITE; non-cohesive, moist, loose	ML & SP		791.7 10.00	2	ROTO SONIC	0.81 0.83	Pel-Plug 3/8" Bentonite Pellets	
790					788.5					
		13.20 - 25.90 (SM) SILTY SAND, non-plastic to low plasticity fines, fine sub-angular sand; light brown (5YR 5/6) and pale yellowish brown (10YR 6/2) with trace very pale orange (10YR 8/1) grains, SAPROLITE; non-cohesive, wet, loose	SM SM		13.20					
15									20/40 FilterSil Sandpack	
785										
		20.00: SAA, with frequent weathered micaceous minerals				3	ROTO SONIC	0.83 0.83		
20										
780										
					775.8					
25		25.90 - 30.00 (SM-SP) SAND, fine to medium sub-rounded sand, some non-plastic fines, trace angular fine to coarse soft (crumbles with pressure from fingers) gravels; very pale orange (10YR 8/2) with pale yellowish brown (10YR 6/2) mottling, PWR; non-cohesive, moist to wet, compact	SP-SM		25.90				2"ID, 4"OD 0.010 Slot SCH 40 PVC U-Pack Screen	
775										
		Boring completed at 30.00 ft			771.7				PVC Cap	
30										
770										
35										
765										
40										
760										
45										

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Jose

GA INSPECTOR: Jeff Ingram  
CHECKED BY: Timothy Richards, PG  
DATE: 2/12/20



# RECORD OF BOREHOLE B-81

SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 50.00 ft  
LOCATION: North to northeast of CCR Unit

DRILL RIG: Rotasonic 1159  
DATE STARTED: 9/20/19  
DATE COMPLETED: 9/22/19

NORTHING: 1,394,364.90  
EASTING: 2,203,741.10  
GS ELEVATION: 817.64  
TOC ELEVATION: 820.56 ft

DEPTH W.L.: 31.39  
ELEVATION W.L.: 786.31  
DATE W.L.: 1/13/2020  
TIME W.L.: 15:06

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS		
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	REC				
					DEPTH (ft)							
0		0.00 - 9.00 Hydrovac	NA			0		0.00 0.75	Concrete Surface Completion	<b>WELL CASING</b> Interval: 0.0 - 39.17' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 39.17 - 49.17' Material: 39.17 - 49.17' Diameter: 2" ID 4 " OD Slot Size: 0.010 End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 37.0 - 50.0' Type: 20/40 FilterSil  <b>FILTER PACK SEAL</b> Interval: 17.0 - 37.0' Type: Pel-Plug 3/8" Bentonite Pellets  <b>ANNULUS SEAL</b> Interval: 0.4 - 17.0' Type: High Solids Bentonite (Aquagard)  <b>WELL COMPLETION</b> Pad: 4' x 4' x 4" Protective Casing: 4" Stainless Steel  <b>DRILLING METHODS</b> Soil Drill: Sonic Rock Drill: Sonic  ~150 gallons of water used while drilling		
815												
5												
810												
		9.00 - 13.10 (SM) SILTY SAND, fine to medium sub-rounded sand, non-plastic fines, trace organics (roots); light brown (5YR 5/6) and moderate reddish brown (10R 4/6), SAPROLITE; non-cohesive, dry, compact	SM		808.6 9.00	1	ROTO SONIC	0.91 0.92	High Solids Bentonite (Aquagard)			
10												
		13.10 - 17.90 (SM) SILTY SAND, fine sub-rounded sand, non-plastic fines; very pale orange (10YR 8/2) to grayish orange (10YR 7/6), PWR with frequent micaceous mineralization; non-cohesive, dry, loose	SM		804.5 13.10				Cave in prior to installing Aquagard due to sampling requirements			
805												
15												
		17.90 - 19.00 (ML and SP) SILT and SAND, non-plastic fine, fine to medium sub-rounded sand; light brown (5YR 5/6), PWR; non-cohesive, dry, compact.	ML & SP		799.7 17.90 798.6 19.00		ROTO SONIC					
800												
20		19.00 - 23.50 (SP-SM) SAND, fine to medium sub-rounded sand, some non-plastic fines; grayish orange (10YR 7/4) with light brown (5YR 5/6) and dark yellowish brown (10YR 2/2) grains, PWR; non-cohesive, dry, compact 20.00: SAA with some pale reddish brown (10R 5/6) coloration	SP-SM  SP-SM			2		0.83 0.83				
795												
		23.50 - 33.60 (ML) sandy SILT, non-plastic to low plasticity fines, fine sub-angular sand; pale yellowish brown (10YR 6/2) to light brown (5YR 5/6), PWR; non-cohesive, moist, loose	ML		794.1 23.50				Pel-Plug 3/8" Bentonite Pellets			
25												
790												
30		30.00: SAA wit some greenish gray (5G 6/1) layers, trace fine soft angular gravels (crumble with finger pressure).			ML			3			0.83 0.83	
785												
		33.60 - 40.00 (SM and SP) SILT and SAND, non-plastic to low plasticity fines, fine sub-rounded sand, trace sub-angular soft (crumbles with finger pressure) gravels; yellowish gray (5YR 8/1) to pale pink (5RP 8/2) to greenish gray (5G 6/1), very micaceous, PWR; non-cohesive, moist, loose	ML & SP		784.0 33.60				Backfill -			
35												
780									20/40 FilterSil Sandpack			
40		40.00 - 41.30 (ML and SP) SILT and SAND, non-plastic to low plasticity fines, fine to medium sub-rounded sand; grayish orange (10YR 7/6) to light olive gray (5Y 5/2), highly weathered with some relic foliation layers, PWR; non-cohesive, moist, compact	ML & SP		777.6 40.00 776.3 41.30	4	ROTO SONIC	0.83 0.83				
775												
		41.30 - 45.40 (SP and ML) SAND and SILT, fine sand, non-plastic fines; yellowish gray (5Y 8/1), very micaceous, PWR; non-cohesive, moist, loose	SP & ML						2"ID, 4"OD 0.010 Slot			
45												
Log continued on next page												

BOREHOLE RECORD MCDONOUGH MASTER LIST BACKUP SURVEY UPDATED (5).GPJ PIEDMONT.GDT 9/22/20

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Jose

GA INSPECTOR: Jeff Ingram  
CHECKED BY: Timothy Richards, PG  
DATE: 2/12/20





# RECORD OF BOREHOLE B-84

SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 50.00 ft  
LOCATION: NE of security gate, along road

DRILL RIG: CME550X  
DATE STARTED: 10/1/19  
DATE COMPLETED: 10/1/19

NORTHING: 1,390,411.90  
EASTING: 2,202,241.90  
GS ELEVATION: 776.52  
TOC ELEVATION: 776.34 ft

DEPTH W.L.: 30.12  
ELEVATION W.L.: 746.48  
DATE W.L.: 1/14/2020  
TIME W.L.: 12:32

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES				MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS	
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC			
					DEPTH (ft)							
0		0.00 - 14.50 Hydrovac to 14.5' to for utilities										
775												
5												
770												
10												
765												
15		14.50 - 20.00 ML-CL, silty CLAY with some gravel, brown-black, micaceous, W-PL, moist, very soft	CL-ML		762.0 14.50							
760												
20		20.00 - 25.00 ML, sandy SILT with some gravel, brown-black, dry, W<PL, very soft	ML		756.5 20.00	S1	SS	3-1-2	3	0.75 1.50		
755												
25		25.00 - 30.00 CL, silty CLAY with some gravel, brown-black, micaceous, W-PL, moist, very soft to soft	CL		751.5 25.00							
750												
30		30.00 - 35.00 CL, silty CLAY with some sand, brown-black with tan, W-PL, moist	CL		746.5 30.00	S3	SS	1-2-3	5	1.50 1.50		
745												
35		35.00 - 39.00 CL, silty CLAY, brown-black, W-PL, wet to moist	CL		741.5 35.00	S4	SS	2-2-3	5	1.50 1.50		
740												
40		39.00 - 40.00 SM, silty SAND with gravel, black-grey, moist, compact 40.00 - 44.00 CL, silty CLAY, brown-black, W-PL, moist, very soft to soft	SM CL		737.5 39.00 736.5 40.00	S5	SS	15-18-11	29	1.50 1.50		
735												
45		44.00 - 45.00 ML, gravelly SILT with some sand, Log continued on next page	ML		732.5 44.00 731.5	S6	SS	7-7-8	17	1.50 1.50		

WELL  
ABANDONED  
ON 4/28/2022

BOREHOLE RECORD MCDONOUGH MASTER LIST BACKUP SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: K. Minkara  
CHECKED BY: Timothy Richards, PG  
DATE: 2/11/20



# RECORD OF BOREHOLE B-84

SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 50.00 ft  
LOCATION: NE of security gate, along road

DRILL RIG: CME550X  
DATE STARTED: 10/1/19  
DATE COMPLETED: 10/1/19

NORTHING: 1,390,411.90  
EASTING: 2,202,241.90  
GS ELEVATION: 776.52  
TOC ELEVATION: 776.34 ft

DEPTH W.L.: 30.12  
ELEVATION W.L.: 746.48  
DATE W.L.: 1/14/2020  
TIME W.L.: 12:32

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
45		brown-black, micaceous, PWR, moist 45.00 - 50.00	ML		45.00						Schedule 40 PVC	<b>WELL CASING</b> Interval: 0'-39.1' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 39.1'-49.1' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 36.0'-49.5' Type: Filter Media  <b>FILTER PACK SEAL</b> Interval: 30.6'-36.0' Type: PEL-PLUG 3/8"  <b>ANNULUS SEAL</b> Interval: 0'-30.6' Type: AquaGuard Bentonite Grout  <b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 8" Round Ground Flush  <b>DRILLING METHODS</b> Soil Drill: 4.25-inch ID Hollow Stem Auger Rock Drill: N/A
730		ML, sandy SILT with gravel, brown-black, PWR, W<PL, wet to moist, PWR, very dense				S7	SS	25-33-24	57	1.50 1.50		
50		Boring completed at 50.00 ft			726.5							
725												
55												
720												
60												
715												
65												
710												
70												
705												
75												
700												
80												
695												
85												
690												
90												

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: K. Minkara  
CHECKED BY: Timothy Richards, PG  
DATE: 2/11/20



# RECORD OF BOREHOLE B-85

SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 34.50 ft  
LOCATION: North of site, adjacent to B-54

DRILL RIG: CME 550  
DATE STARTED: 11/17/19  
DATE COMPLETED: 11/18/19

NORTHING: 1,394,433.40  
EASTING: 2,203,134.50 GS  
ELEVATION: 782.71 TOC  
ELEVATION: 782.54 ft

DEPTH W.L.: 2.27  
ELEVATION W.L.: 780.43  
DATE W.L.: 1/13/2020  
TIME W.L.: 14:16

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
0		0.00 - 10.00 Hydrovac to 10.0' to for utilities									AquaGuard Bentonite – Grout	<b>WELL CASING</b> Interval: 0'-34.2' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screen  <b>WELL SCREEN</b> Interval: 24.2'-34.2' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 21.6'-34.5' Type: Filter Media  <b>FILTER PACK SEAL</b> Interval: 16.6'-21.6' Type: PEL-PLUG 3/8"  <b>ANNULUS SEAL</b> Interval: 0'-16.6' Type: AquaGuard Bentonite Grout  <b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 8" Round Ground Flush  <b>DRILLING METHODS</b> Soil Drill: 4.25-inch ID Hollow Stem Auger Rock Drill: HQ Core Barrell
780												
5											PEL-PLUG 3/8" – Bentonite Pellets	
775												
10		10.00 - 15.00 SM, silty SAND with trace clay, white to grey, fine to coarse sand, well foliated, saprolite, low to no plasticity, W<PL, moist, cohesive	SM		772.7 10.00						#2 FilterSil –	
770						1	SPT	4-8-9	17	1.00 1.50		
15		15.00 - 20.00 SM, silty SAND with some clay and trace gravel, orange to brown and white to grey, fine to coarse sand, saprolite, no plasticity, W<PL, moist, cohesive, firm	SM		767.7 15.00						0.010" Slotted Schedule 40 PVC	
765						2	SPT	2-6-8	14	0.50 1.50		
20		20.00 - 25.00 SW, SAND with some silt, white to grey and brown, fine to coarse sand, saprolite, non-cohesive, moist, compact	SP-SM		762.7 20.00							
760						3	SPT	6-15-12	27	1.00 1.50		
25		25.00 - 29.50 PWR, AUGEN GNEISS, gravelly sand, grey to white, some orange staining, fine to coarse, moist, very dense	PWR		757.7 25.00							
755						4	SPT	27-50/1	>50	0.50 0.50		
30		29.50 - 34.50 BEDROCK, AUGEN GNEISS, fresh to slightly weathered, white to light pink, feldspar porphyroclasts up to 1 cm in diameter, well foliated, strong to medium strong	GNEISS		753.2 29.50							
750						5	CORE			4.80 5.00		
35		Boring completed at 34.50 ft			748.2							
745												
40												
740												
45												

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: W.Ballow  
CHECKED BY: Timothy Richards, PG  
DATE: 2/11/20



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20



# RECORD OF BOREHOLE B-86

SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 34.10 ft  
LOCATION: North of site along fence adjacent to B-79

DRILL RIG: CME 550  
DATE STARTED: 11/18/19  
DATE COMPLETED: 11/18/20

NORTHING: 1,394,480.00  
EASTING: 2,203,206.60  
GS ELEVATION: 784.52  
TOC ELEVATION: 784.29 ft

DEPTH W.L.: 0.91  
ELEVATION W.L.: 783.69  
DATE W.L.: 1/13/2020  
TIME W.L.: 14:54

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES				MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS	
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE			REC
					DEPTH (ft)							
0		0.00 - 7.00 Hydrovac to 7.00' to for utilities									AquaGuard Bentonite – Grout	<b>WELL CASING</b> Interval: 0'-34.1' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screen
5	780				777.5							
		7.00 - 18.50 No Recovery			7.00							<b>WELL SCREEN</b> Interval: 24.1'-34.1' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: Schedule 40 PVC
10	775											<b>FILTER PACK</b> Interval: 22.1'-34.1' Type: Filter Media
												<b>FILTER PACK SEAL</b> Interval: 17'-22.1' Type: PEL-PLUG 3/8"
15	770											<b>ANNULUS SEAL</b> Interval: 0.0'-17' Type: AquaGuard Bentonite Grout
												<b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 8" Round Ground Flush
20	765	18.50 - 23.50 SM, silty SAND, white to black and brown, fine to medium sand, saprolite, non-cohesive, wet, compact	SM		766.0 18.50	1	SS	5-10-14	24	1.00 1.50	PEL-PLUG 3/8" – Bentonite Pellets	<b>DRILLING METHODS</b> Soil Drill: 4.25-inch ID Hollow Stem Auger Rock Drill: HQ Core Barrell
					761.0						#2 FilterSil –	
25	760	23.50 - 28.00 SW-SM, SAND with some silt and trace gravel, brown and white to black, saprolite, non-cohesive, wet, compact	SM		23.50	2	SS	4-9-17	26	1.00 1.50		
					756.5							
30	755	28.00 - 34.10 Bedrock, AUGEN GNEISS, white to black, fresh to slightly weathered, strong	GNEISS		28.00	3	CORE			4.00 5.00	0.010" Slotted Schedule 40 PVC	
					750.4							
35	750	Boring completed at 34.10 ft										
40	745											
45	740											

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: W.Ballow  
CHECKED BY: Timothy Richards, PG  
DATE: 2/11/20





SHEET 1 of 1

DEPTH W.L.: 15.56  
ELEVATION W.L.: 784.84  
DATE W.L.: 1/13/2020  
TIME W.L.: 14:54

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

## SHEET 1 of 2

DEPTH W.L.: 21.78  
ELEVATION W.L.: 800.82  
DATE W.L.: 1/13/2020  
TIME W.L.: 16:36

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

# RECORD OF BOREHOLE B-89



SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 49.50 ft  
LOCATION: North of site in cement plant lot, next to retaining wall

DRILL RIG: CME 550  
DATE STARTED: 11/19/19  
DATE COMPLETED: 11/19/19

NORTHING: 1,394,398.40  
EASTING: 2,204,049.40  
GS ELEVATION: 822.53  
TOC ELEVATION: 822.36 ft

DEPTH W.L.: 21.78  
ELEVATION W.L.: 800.82  
DATE W.L.: 1/13/2020  
TIME W.L.: 16:36

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE			SAMPLES				MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS		
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop			N-VALUE	REC
					DEPTH (ft)							
45		44.00 - 49.50 Bedrock, SCHIST, light grey to dark grey, fresh to slightly weathered, strong to very strong <i>(Continued)</i>									<div>Schedule 40 PVC</div> 	<b>WELL CASING</b> Interval: 0'-49.5' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screen  <b>WELL SCREEN</b> Interval: 39.5'-49.5' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 33.5'-49.5' Type: Filter Media  <b>FILTER PACK SEAL</b> Interval: 28.5'-33.5' Type: PEL-PLUG 3/8"  <b>ANNULUS SEAL</b> Interval: 0'-28.5' Type: AquaGuard Bentonite Grout  <b>WELL COMPLETION</b> Pad: 2' x 2' concrete Protective Casing: 8" Round Ground Flush  <b>DRILLING METHODS</b> Soil Drill: 4.25-inch ID Hollow Stem Auger Rock Drill: HQ Core Barrell
775					773.0							
50		Boring completed at 49.50 ft										
770												
55												
765												
60												
760												
65												
755												
70												
750												
75												
745												
80												
740												
85												
735												
90												

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: W.Ballow  
CHECKED BY: Timothy Richards, PG  
DATE: 2/11/20



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

SHEET 1 of 1

DEPTH W.L.: 0.88  
ELEVATION W.L.: 783.32  
DATE W.L.: 1/14/2020  
TIME W.L.: 12:32

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

# RECORD OF BOREHOLE B-91

SHEET 1 of 1

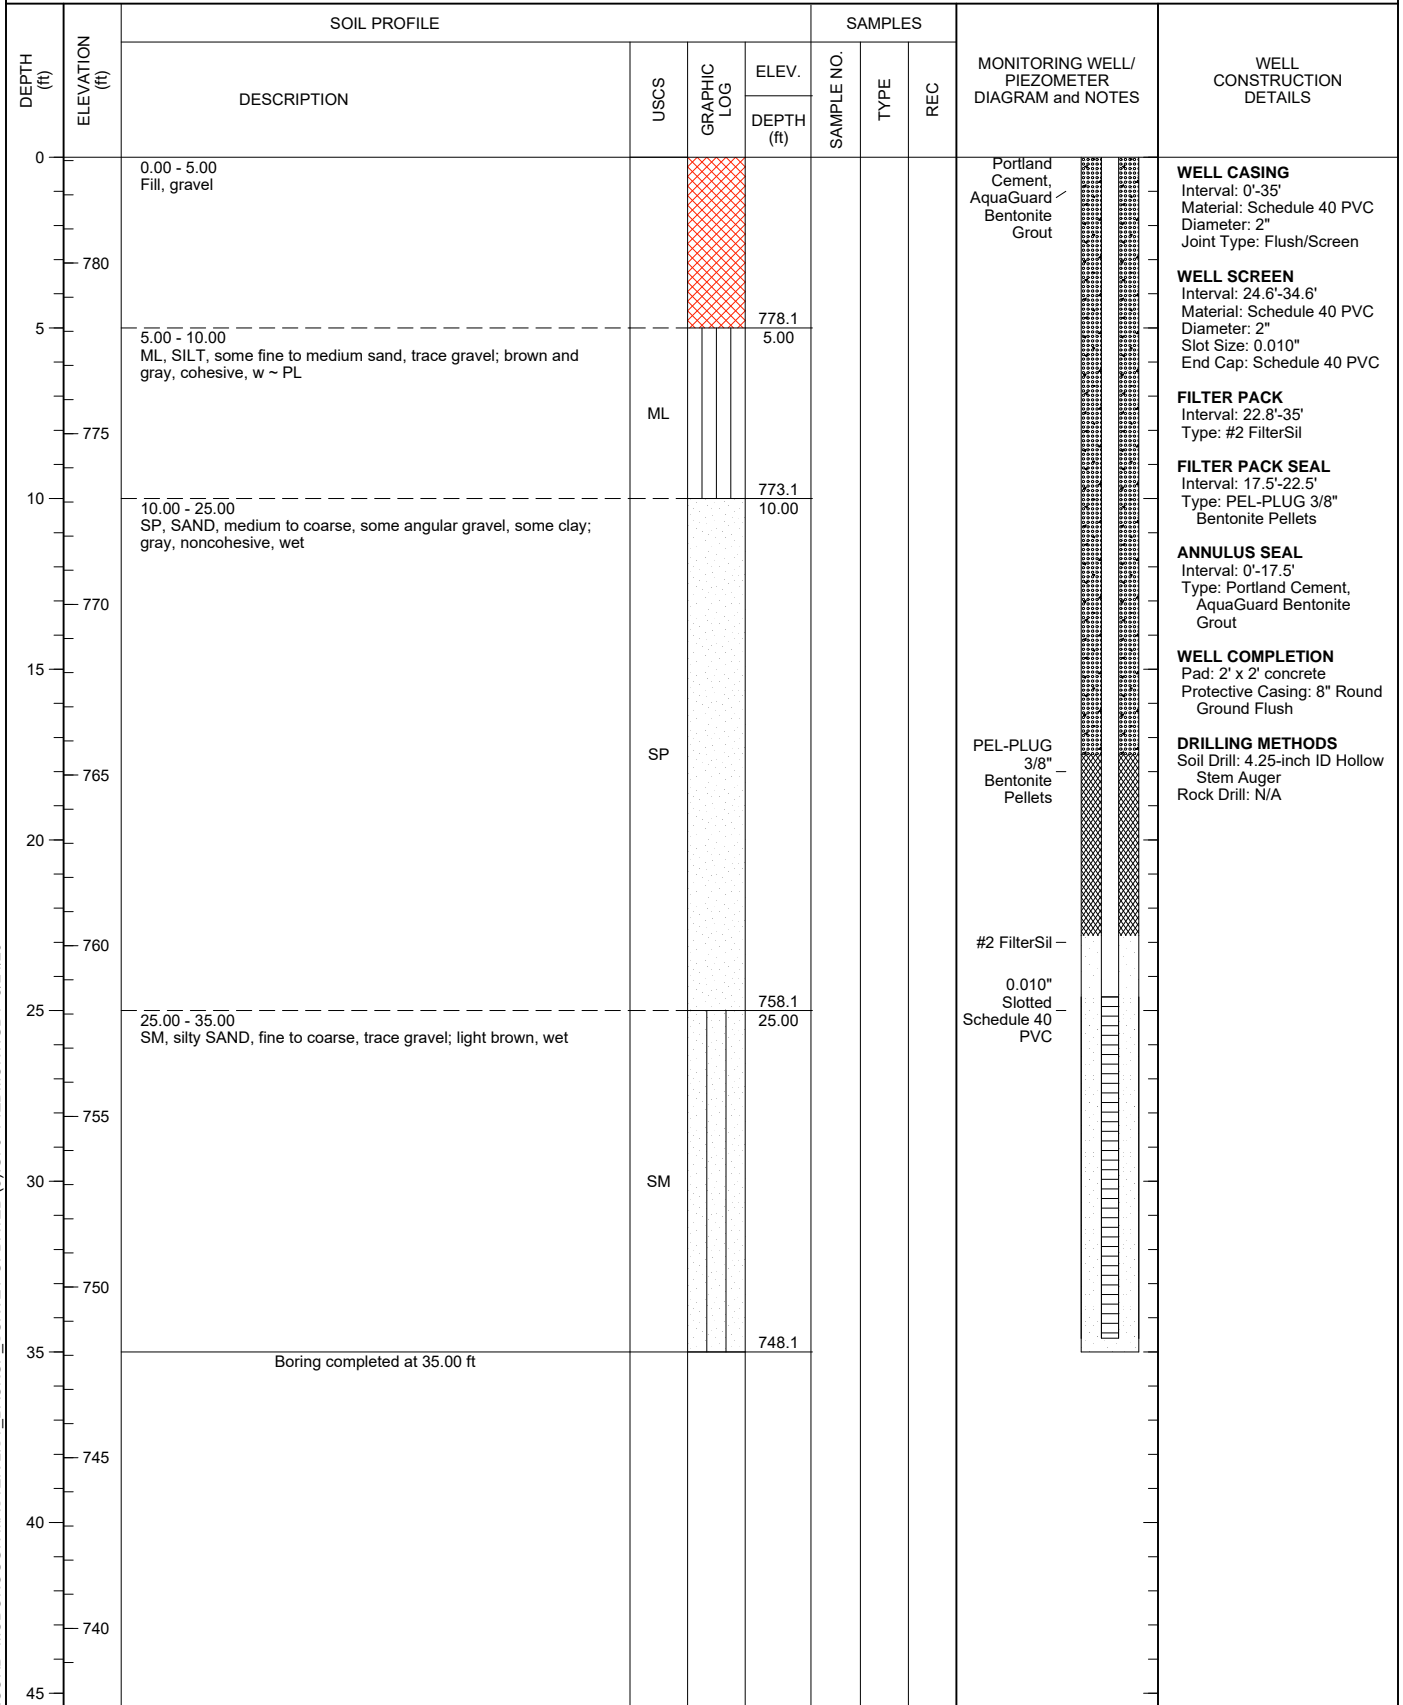
PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 35.00 ft  
LOCATION: North of site along Plant Atkinson Road

DRILL RIG: CME 550  
DATE STARTED: 12/11/19  
DATE COMPLETED: 12/11/19

NORTHING: 1,394,447.10  
EASTING: 2,203,123.90  
GS ELEVATION: 783.10  
TOC ELEVATION: 782.98 ft

DEPTH W.L.: 2.90  
ELEVATION W.L.: 780.2  
DATE W.L.: 1/14/2020  
TIME W.L.: 12:34

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20



LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: W.Ballow  
CHECKED BY: Timothy Richards, PG  
DATE: 2/11/20



# RECORD OF BOREHOLE B-94

SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 45.24 ft  
LOCATION: Northeast side, on property line

DRILL RIG: CME 550  
DATE STARTED: 1/21/20  
DATE COMPLETED: 1/23/20

NORTHING: 1,394,402.00  
EASTING: 2,203,513.70  
GS ELEVATION: 799.12  
TOC ELEVATION: 801.74 ft

DEPTH W.L.: 13.81 ft bTOC  
ELEVATION W.L.: 770.49  
DATE W.L.: 1/28/2020  
TIME W.L.: 16:44

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM AND NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
0		0.00 - 9.00 CL, silty CLAY, medium plasticity, some sand; reddish brown, cohesive, w > PL, soft	CL			S-01	GRAB			0.00 0.75		<b>WELL CASING</b> Interval: 0 ft-bgs - 45 ft-bgs Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush  <b>WELL SCREEN</b> Interval: 34.6 ft-bgs - 44.6 ft-bgs Material: Schedule 40 PVC Diameter: 3" Slot Size: 0.010" End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 32.5 ft-bgs - 44.6 ft-bgs Type: FilterSII Sand  <b>FILTER PACK SEAL</b> Interval: 28 ft-bgs - 32.5 ft-bgs Type: PEL-PLUG 3/8" Bentonite Pellets  <b>ANNULUS SEAL</b> Interval: 0 ft-bgs - 28 ft-bgs Type: Portland Cement, AquaGuard Bentonite Grout  <b>WELL COMPLETION</b> Pad: 4' x 4' Concrete Pad Protective Casing: Aluminum Riser  <b>DRILLING METHODS</b> Soil Drill: 4.25-inch ID Hollow Stem Augers Rock Drill: N/A
795												
5												
790		9.00 - 13.50 ML, SILT, non-plastic, trace sand; orange-brown, micaceous, non-cohesive, moist, firm to stiff	ML		790.1 9.00	S-02	DO	2-2-4	6	1.50 1.50		
10												
785		13.50 - 45.24 SM, silty SAND, fine; mottled tan-brown and white, micaceous, saprolitic, non-cohesive, dry to moist, very dense	SM		785.6 13.50	S-03	DO	18-24-33	57	1.50 1.50		
15												
780		18.50: Compact				S-04	DO	6-10-20	30	1.50 1.50		
20												
775						S-05	DO	4-5-16	21	1.42 1.50		
25												
770		28.50: Trace quartz gravel from pegmatitic vein, dense				S-06	DO	21-24-22	46	1.08 1.50		
30		30.00: Trace quartz gravel, very dense				S-07	DO	10-50	50/4	0.83 0.83		
						S-08	DO	50	50/3	0.25 0.25		
						S-09	DO	50	50/5	0.42 0.42		
765						S-10	DO	50	50/4	0.33 0.33		
35						S-11	DO	50	50/3	0.58 0.25		
760		37.50: 1.0" pegmatitic vein consisting of potassium feldspar and plagioclase feldspar				S-12	DO	50	50/4	0.83 0.83		
40						S-13	DO	19-50	50/2	0.17 0.17		
		Log continued on next page										

BOREHOLE RECORD MCDONOUGH MASTER LIST BACKUP SURVEY UPDATED (5).GPJ PIEDMONT.GDT 9/2/20

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Heather Brissey & Michael Boatman PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/11/20



# RECORD OF BOREHOLE B-94



SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 45.24 ft  
LOCATION: Northeast side, on property line

DRILL RIG: CME 550  
DATE STARTED: 1/21/20  
DATE COMPLETED: 1/23/20

NORTHING: 1,394,402.00  
EASTING: 2,203,513.70  
GS ELEVATION: 799.12  
TOC ELEVATION: 801.74 ft

DEPTH W.L.: 13.81 ft bTOC  
ELEVATION W.L.: 770.49  
DATE W.L.: 1/28/2020  
TIME W.L.: 16:44

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
40		13.50 - 45.24 SM, silty SAND, fine; mottled tan-brown and white, micaceous, saprolitic, non-cohesive, dry to moist, very dense (Continued) 42.00: Trace gravel	SM		753.9	S-14	DO	50	50/2	0.17 0.17		<b>WELL CASING</b> Interval: 0 ft-bgs - 45 ft-bgs Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush  <b>WELL SCREEN</b> Interval: 34.6 ft-bgs - 44.6 ft-bgs Material: Schedule 40 PVC Diameter: 3" Slot Size: 0.010" End Cap: Schedule 40 PVC  <b>FILTER PACK</b> Interval: 32.5 ft-bgs - 44.6 ft-bgs Type: FilterSII Sand  <b>FILTER PACK SEAL</b> Interval: 28 ft-bgs - 32.5 ft-bgs Type: PEL-PLUG 3/8" Bentonite Pellets  <b>ANNULUS SEAL</b> Interval: 0 ft-bgs - 28 ft-bgs Type: Portland Cement, AquaGuard Bentonite Grout  <b>WELL COMPLETION</b> Pad: 4' x 4' Concrete Pad Protective Casing: Aluminum Riser  <b>DRILLING METHODS</b> Soil Drill: 4.25-inch ID Hollow Stem Augers Rock Drill: N/A
						S-15	DO	8-26-50	76/10	0.83 0.83		
						S-16	DO	50	50/4	0.33 0.33		
755		Boring completed at 45.24 ft										
45												
750												
50												
750												
55												
745												
60												
740												
65												
735												
70												
730												
75												
725												
720												
80												

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Heather Brissey & Michael Boatman PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/11/20



BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 9/2/20

# RECORD OF BOREHOLE B-95


SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 33.30 ft  
LOCATION: East of B-96

DRILL RIG: CME 550  
DATE STARTED: 2/11/20  
DATE COMPLETED: 2/11/20

NORTHING: 1,394,518.60  
EASTING: 2,203,167.70  
GS ELEVATION: 784.18  
TOC ELEVATION: 784.00 ft

DEPTH W.L.: 1.7 ft bTOC  
ELEVATION W.L.: 782.3  
DATE W.L.: 2/26/2020  
TIME W.L.: 13:49

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC		
0		0.00 - 10.00 Hydro Vac'd for utilities clearance									 <p>Bentonite Grout</p> <p>Bentonite Pellets</p> <p>Sand Filter Pack</p> <p>3" PVC 0.010 Slot U-Pack Screen</p>	<p><b>WELL CASING</b> Interval: 0 ft-bgs - 33.3 ft-bgs Material: PVC Diameter: 2" Joint Type: Flush</p> <p><b>WELL SCREEN</b> Interval: 23 ft-bgs - 33 ft-bgs Material: Schedule 40 PVC Diameter: 3" Slot Size: 0.010" End Cap: 4"</p> <p><b>FILTER PACK</b> Interval: 20.8 ft-bgs - 33.3 ft-bgs Type: FilterSil Sand</p> <p><b>FILTER PACK SEAL</b> Interval: 17.5 ft-bgs - 20.5 ft-bgs Type: PEL-PLUG 3/8" Bentonite Pellets</p> <p><b>ANNULUS SEAL</b> Interval: 0 ft-bgs - 17.5 ft-bgs Type: Portland Cement, AquaGuard Bentonite Grout</p> <p><b>WELL COMPLETION</b> Pad: 2'x2' Concrete Pad Protective Casing: 8" Round Flush Mount</p> <p><b>DRILLING METHODS</b> Soil Drill: 4.25-inch ID Hollow Stem Augers Rock Drill: N/A</p>
780												
5												
775					774.2							
10					10.00							
770		13.50 - 33.30 SANDY SILT, low plasticity, fine grained sand; brown; non-cohesive, wet, loose			770.7	S-01	DO	3-3-4	7	N/A 1.50		
15												
765		18.50: SANDY SILT, low plasticity, fine grained sand; tan, orange, bronze, laminated, saprolite (gneiss parent rock), micaceous; non-cohesive, moist, very dense				S-02	DO	14-27-27	54	N/A 1.50		
20												
760		23.50: Trace fine gravel	ML			S-03	DO	8-50	50/5	N/A 0.92		
25												
755		28.50: Compact				S-04	DO	3-2-8	10	N/A 1.50		
30												
750		Boring completed at 33.30 ft			750.9							
35												
745												
40												
740												
45												

BOREHOLE RECORD MCDONOUGH MASTER LIST\_BACKUP\_SURVEY UPDATED (5).GPJ PIEDMONT.GDT 9/2/20

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Heather Brissey  
CHECKED BY: Timothy Richards, PG  
DATE: 4/28/20





# RECORD OF BOREHOLE B-96

SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 33.10 ft  
LOCATION: North side of AP4

DRILL RIG: CME 550  
DATE STARTED: 2/10/20  
DATE COMPLETED: 2/10/20

NORTHING: 1,394,478.70  
EASTING: 2,203,099.30  
GS ELEVATION: 785.19  
TOC ELEVATION: 784.92 ft

DEPTH W.L.: 4.31 ft bTOC  
ELEVATION W.L.: 780.61  
DATE W.L.: 2/26/2020  
TIME W.L.: 15:14

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES					MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS	
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	BLOWS per 6 in 140 lb hammer 30 inch drop	N-VALUE	REC			
					DEPTH (ft)								
0	785	0.00 - 10.00 Hydro Vac'd for utilities clearance											<p><b>WELL CASING</b> Interval: 0 ft-bgs - 33.1 ft-bgs Material: PVC Diameter: 2" Joint Type: Flush</p> <p><b>WELL SCREEN</b> Interval: 23.1 ft-bgs - 33.1 ft-bgs Material: Schedule 40 PVC Diameter: 3" Slot Size: 0.010" End Cap: 4"</p> <p><b>FILTER PACK</b> Interval: 20 ft-bgs - 33.1 ft-bgs Type: FilterSil Sand</p> <p><b>FILTER PACK SEAL</b> Interval: 15.8 ft-bgs - 20 ft-bgs Type: PEL-PLUG 3/8" Bentonite Pellets</p> <p><b>ANNULUS SEAL</b> Interval: 0 ft-bgs - 15.8 ft-bgs Type: Portland Cement, AquaGuard Bentonite Grout</p> <p><b>WELL COMPLETION</b> Pad: 2'x2' Concrete Pad Protective Casing: 8" Round Flush Mount</p> <p><b>DRILLING METHODS</b> Soil Drill: 4.25-inch ID Hollow Stem Augers Rock Drill: N/A</p>
5	780												
10	775				775.2 10.00								
15	770	13.50 - 33.10 SILTY SAND, low to no plasticity; light grey, saprolitic (gneiss parent rock); non-cohesive, dry to moist, very dense			771.7 13.50	S-01	DO	50	50/5	0.17 0.50			
20	765					S-02	DO	4-50	50/3	0.50 1.00			
25	760	23.50: grey to tan	SM			S-03	DO	17-50	50/5	1.00 1.00			
30	755	28.50: Iron staining				S-04	DO	5-26-50	76/11	1.30 1.50			
35	750	Boring completed at 33.10 ft			752.1								
40	745												
45													

BOREHOLE RECORD MCDONOUGH MASTER LIST BACKUP SURVEY UPDATED (5).GPJ PIEDMONT.GDT 9/2/20

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: Southern Company Services  
DRILLER: S. Milam

GA INSPECTOR: Michael Boatman PG  
CHECKED BY: Timothy Richards, PG  
DATE: 4/28/20



# RECORD OF BOREHOLE B-99

SHEET 1 of 1

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 12.30 ft  
LOCATION: Smyrna, GA

DRILL RIG: CME 550X  
DATE STARTED: 7/7/20  
DATE COMPLETED: 7/7/20

NORTHING: 1,394,524.20  
EASTING: 2,203,084.50  
GS ELEVATION: 782.57  
TOC ELEVATION: 782.39 ft

DEPTH W.L.: 5.93  
ELEVATION W.L.: 776.46  
DATE W.L.: 7/7/20  
TIME W.L.: 16:10

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	REC		
					DEPTH (ft)					
0		0.00 - 5.00 GRAVEL WITH SILT; non-native, brown to brown-tan with some red, silty, poorly graded gravel with some concrete fill, some organics, slightly weathered, non-cohesive, moist to wet, loose to compact (fill)	GW-GM			R1		12.30	<div>Bentonite — Grout Bentonite — Pellets Sand Filter — Pack 3" PVC 0.010 Slot — U-Pack Screen</div>	<div><b>WELL CASING</b> Interval: 0'-12'3" Material: Schedule 40 PVC Diameter: 2" Joint Type: Screw fit with rubber seam</div> <div><b>WELL SCREEN</b> Interval: 7'3"-12'3" Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: Schedule 40 PVC</div> <div><b>FILTER PACK</b> Interval: 5'-12'3" Type: Filtersil std61</div> <div><b>FILTER PACK SEAL</b> Interval: 3'-5' Type: 3/8" Coated Pel-Plug</div> <div><b>ANNULUS SEAL</b> Interval: 0'-3' Type: Aquagaurd Bentonite Grout</div> <div><b>WELL COMPLETION</b> Pad: 4'x4'x4" Protective Casing: Aluminum</div> <div><b>DRILLING METHODS</b> Soil Drill: Auger Rock Drill:</div>
5		5.00 - 9.00 GRAVEL WITH SILT; non-native, brown to brown tan with red, silty, poorly graded gravel with some concrete fill, some organics, slightly weathered, non-cohesive, wet, loose to compact (fill)			GW-GM					
10		9.00 - 12.30 SILTY GRAVEL; brown, tan and red, non-cohesive, wet, loose to compact (mix of fill and saprolite)	GM		773.6 9.00					
770		Boring completed at 12.30 ft			770.3					
15										
765										
20										
760										
25										
755										
30										
750										
35										
745										
40										
740										
45										

BOREHOLE RECORD MCDONOUGH MASTER LIST BACKUP SURVEY UPDATED (5).GPJ PIEDMONT.GDT 8/24/20

LOG SCALE: 1 in = 5.5 ft  
DRILLING COMPANY: SCS CFS  
DRILLER: S. Deuty

GA INSPECTOR: Chris Tidwell  
CHECKED BY: Brian Steele, PG  
DATE: 8/24/2020



# RECORD OF BOREHOLE B-103D

SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 70.00 ft  
LOCATION: East of DGWC-47

DRILL RIG: Geoprobe 8140LC  
DATE STARTED: 10/14/20  
DATE COMPLETED: 10/15/20

NORTHING: 1391543.5  
EASTING: 2202614.4  
GS ELEVATION: 793.77 ft  
TOC ELEVATION: 795.96 ft

DEPTH W.L.: 12.0  
ELEVATION W.L.: 783.9  
DATE W.L.: 10/15/2020  
TIME W.L.: 0740

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	REC		
0		0.00 - 5.00 (SM), SILTY SAND; red brown; low plasticity, moist, w<PL, loose, contains muscovite, FILL	SM			1	ROTO SONIC	<u>2.50</u> 5.00	Stick-up --	<b>B-103D</b> Borehole Diameter: 4" <b>WELL CASING</b> Interval: 0'-70' Material: Schedule 40 PVC Diameter: 2" Joint Type: Screw fit with rubber seam <b>WELL SCREEN</b> Interval: 60'-70' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC <b>FILTER PACK</b> Interval: 57.9'-70.0' Type: FilterSil Quantity: 3.5-50 lbs bags <b>FILTER PACK SEAL</b> Interval: 53.5'-57.9' Type: 3/8" Uncoated Pel-Plug Quantity: 1-5 gallon bucket <b>ANNULUS SEAL</b> Interval: 0'-53.5' Type: AquaGuard Bentonite Grout Quantity: Approximately 40 gallons  <b>NOTES</b>
5		5.00 - 15.00 (ML), SILT; tan to gray-brown; low plasticity, moist, fine, w<PL, loose	ML		5.00	2	ROTO SONIC	<u>6.50</u> 10.00		
10										
15		15.00 - 18.00 (SM), SILTY SAND; dark brown, gravel; moist, non to low plasticity, w<PL	SM		15.00	3	ROTO SONIC	<u>5.50</u> 5.00		
20		18.00 - 20.00 (SCHIST), BEDROCK; feldspar, biotite, muscovite, moderate to well foliated, fresh, rock	BR		18.00					
25		20.00 - 23.00 (SCHIST), BEDROCK; well foliated, poorly jointed, feldspar, quartz, muscovite	BR		20.00					
30									AquaGuard Bentonite -- Grout	
35		23.00 - 40.00 (GNEISS), BEDROCK; light to dark gray; partially foliated, poorly jointed, biotite, feldspar, quartz, locally contains garnet	BR		23.00	4	ROTO SONIC	<u>10.00</u> 12.00		
40										
45						5	ROTO SONIC	<u>5.60</u> 8.00		
50		40.00 - 70.00 (GNEISS), BEDROCK; light gray-green to dark gray; well foliated, poorly jointed, muscovite, biotite, feldspar, quartz	BR		40.00	6	ROTO SONIC	<u>9.00</u> 10.00		
		Log continued on next page								

BOREHOLE RECORD MCDONOUGH MASTER LIST (2) GPJ PIEDMONT.GDT 2/3/21

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Fred Dorse

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/3/21



# RECORD OF BOREHOLE B-103D


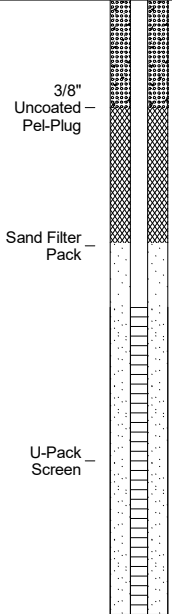
SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 70.00 ft  
LOCATION: East of DGWC-47

DRILL RIG: Geoprobe 8140LC  
DATE STARTED: 10/14/20  
DATE COMPLETED: 10/15/20

NORTHING: 1391543.5  
EASTING: 2202614.4  
GS ELEVATION: 793.77 ft  
TOC ELEVATION: 795.96 ft

DEPTH W.L.: 12.0  
ELEVATION W.L.: 783.9  
DATE W.L.: 10/15/2020  
TIME W.L.: 0740

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	REC		
50		40.00 - 70.00 (GNEISS), BEDROCK; light gray-green to dark gray; well foliated, poorly jointed, muscovite, biotite, feldspar, quartz (Continued)	BR							<b>B-103D</b> Borehole Diameter: 4" <b>WELL CASING</b> Interval: 0'-70' Material: Schedule 40 PVC Diameter: 2" Joint Type: Screw fit with rubber seam <b>WELL SCREEN</b> Interval: 60'-70' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC <b>FILTER PACK</b> Interval: 57.9'-70.0' Type: FilterSil Quantity: 3.5-50 lbs bags <b>FILTER PACK SEAL</b> Interval: 53.5'-57.9' Type: 3/8" Uncoated Pel-Plug Quantity: 1-5 gallon bucket <b>ANNULUS SEAL</b> Interval: 0'-53.5' Type: AquaGuard Bentonite Grout Quantity: Approximately 40 gallons <b>NOTES</b>
55						7	ROTO SONIC	7.50 10.00		
60						8	ROTO SONIC	9.65 10.00		
65										
70		Boring completed at 70.00 ft								
75										
80										
85										
90										
95										
100										

BOREHOLE RECORD MCDONOUGH MASTER LIST (2).GPJ PIEDMONT.GDT 2/3/21

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Fred Dorse

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/3/21



# RECORD OF BOREHOLE B-109D

SHEET 1 of 2










PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 100.00 ft  
LOCATION: Next to DGWC-2

DRILL RIG: Geoprobe 8140LS  
DATE STARTED: 10/30/20  
DATE COMPLETED: 10/31/20

NORTHING: 1393957.5  
EASTING: 2202127  
GS ELEVATION: 847.78 ft  
TOC ELEVATION: 850.73 ft

DEPTH W.L.: 23.50  
ELEVATION W.L.: 827.2  
DATE W.L.: 10/31/2020  
TIME W.L.: 1157

BOREHOLE RECORD MCDONOUGH MASTER LIST (2) (3) (1) (2) GPJ PIEDMONT.GDT 7/19/21

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM AND NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	REC		
0		0.00 - 10.00 Air knife; FILL	FILL						Stick-up --	<b>B-109D</b> Borehole Diameter: 4" <b>WELL CASING</b> Interval: 0'-100' Material: Schedule 40 PVC Diameter: 2" Joint Type: Screw fit with rubber seam <b>WELL SCREEN</b> Interval: 89.4'-99.4' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC <b>FILTER PACK</b> Interval: 86.5'-99.4' Type: FilterSil Quantity: 4-50 lbs bags <b>FILTER PACK SEAL</b> Interval: 83.9'-86.5' Type: 3/8" Uncoated Pel-Plug Quantity: 1-5 gallon bucket <b>ANNULUS SEAL</b> Interval: 0'-83.9' Type: AquaGuard Bentonite Grout Quantity: Approximately 80 gallons  <b>NOTES</b>
5										
10		10.00 - 13.50 (ML). SILT; brown, soft,	ML		10.00					AquaGuard Bentonite Grout
15		13.50 - 20.00 (CL). CLAY; red to red brown, trace sand, medium plasticity, w<PL, firm, moist to dry,	CL		13.50	1	ROTO SONIC	10.00 10.00		
20		20.00 - 30.00 (SM). SILTY SAND; gray to reddish gray, fine to medium, loose to soft, dry to moist, w<PL, low plasticity, quartz, biotite, feldspar	SM		20.00	2	ROTO SONIC	3.70 10.00		
25										
30		30.00 - 36.00 (SM). SILTY SAND; gray to reddish gray, some clay, fine to medium, loose to soft, dry to moist, w<PL, low plasticity, quartz, biotite, feldspar	SM		30.00	3	ROTO SONIC	6.00 6.00		
35										
40		36.00 - 40.00 (CL). CLAY; black to dark gray, low plasticity, w<PL, very soft to hard, dry to moist, saprolite, biotite gneiss, saprolite,	CL		36.00	4	ROTO SONIC	4.00 4.00		
45		40.00 - 45.00 (TWR). TRANSITIONALLY WEATHERED ROCK; black to dark gray, silt with some fine sand, trace gravels, low plasticity, w<PL, soft, moist to wet, biotite gneiss fragments	TWR		40.00	5	ROTO SONIC	2.20 5.00		
50		45.00 - 46.00 (GRANITE). BEDROCK; biotite, feldspar, quartz, white to light gray, fine grain, quartz veins, weakly foliated, poorly jointed, fresh to slightly weathered, medium strong	BR		45.00	6	ROTO SONIC	4.20 10.00		
		46.00 - 55.00 (GNEISS). BEDROCK; feldspar, quartz, biotite, black to dark gray, well foliated, poorly jointed fresh to slightly weathered, medium strong to weak, iron staining	BR		46.00					

Log continued on next page

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Fred Dorse

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/3/21



# RECORD OF BOREHOLE B-109D

SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 100.00 ft  
LOCATION: Next to DGWC-2

DRILL RIG: Geoprobe 8140LS  
DATE STARTED: 10/30/20  
DATE COMPLETED: 10/31/20

NORTHING: 1393957.5  
EASTING: 2202127  
GS ELEVATION: 847.78 ft  
TOC ELEVATION: 850.73 ft

DEPTH W.L.: 23.50  
ELEVATION W.L.: 827.2  
DATE W.L.: 10/31/2020  
TIME W.L.: 1157

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	TYPE	REC		
50		46.00 - 55.00 (GNEISS), BEDROCK; feldspar, quartz, biotite, black to dark gray, well foliated, poorly jointed fresh to slightly weathered, medium strong to weak, iron staining ( <i>Continued</i> )	BR			6	ROTO SONIC	4.20 10.00		<b>B-109D</b> Borehole Diameter: 4" <b>WELL CASING</b> Interval: 0'-100' Material: Schedule 40 PVC Diameter: 2" Joint Type: Screw fit with rubber seam <b>WELL SCREEN</b> Interval: 69.4'-99.4' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC <b>FILTER PACK</b> Interval: 86.5'-99.4' Type: FilterSil Quantity: 4-50 lbs bags <b>FILTER PACK SEAL</b> Interval: 83.9'-86.5' Type: 3/8" Uncoated Pel-Plug Quantity: 1-5 gallon bucket <b>ANNULUS SEAL</b> Interval: 0'-83.9' Type: AquaGuard Bentonite Grout Quantity: Approximately 80 gallons  <b>NOTES</b>
55		55.00 - 65.00 (GNEISS), BEDROCK; feldspar, quartz, biotite, black to dark gray, well foliated, poorly jointed, fresh to slightly weathered, medium strong to weak, iron staining. Pegmatitic zone 57.75' - 58.75' bgs (biotite, quartz, feldspar).	BR		55.00	7	ROTO SONIC	8.25 10.00		
60										
65		65.00 - 80.00 (GNEISS), BEDROCK; quartz, feldspar, biotite, black to dark gray, well foliated, poorly jointed fresh to slightly weathered, medium strong to weak, iron staining.	BR		65.00	8	ROTO SONIC	10.00 10.00		
70										
75						9	ROTO SONIC	5.00 5.00		
80		80.00 - 85.00 (GNEISS), BEDROCK; feldspar, quartz, biotite, black to dark gray, well foliated, poorly jointed, fresh, fine to medium grain, medium strong, iron staining, locally contains chlorite	BR		80.00	10	ROTO SONIC	4.25 5.00	3/8" Uncoated Pel-Plug	Sand Filter Pack   U-Pack Screen
85		85.00 - 100.00 (GNEISS), BEDROCK; feldspar, quartz, biotite, green when dry and dark gray to black when wet, well foliated, poorly jointed fresh, fine to medium grain, medium strong, iron staining, locally contains chlorite and epidote	BR		85.00	11	ROTO SONIC	5.00 5.00		
90						12	ROTO SONIC	8.40 10.00		
95										
100		Boring completed at 100.00 ft								

BOREHOLE RECORD MCDONOUGH MASTER LIST (2) (3) (1) (2) GPJ PIEDMONT.GDT 7/19/21

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Fred Dorse

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/3/21



# RECORD OF BOREHOLE B-110D







SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 65.00 ft  
LOCATION: Next to DGWC-68A

DRILL RIG: Geoprobe 8140LC  
DATE STARTED: 11/14/20  
DATE COMPLETED: 11/17/20

NORTHING: 1391294.4  
EASTING: 2200736  
GS ELEVATION: 764.55 ft  
TOC ELEVATION: 764.61 ft

DEPTH W.L.: 9.35  
ELEVATION W.L.: 755.3  
DATE W.L.: 11/17/2020  
TIME W.L.: 1110

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	REC		
					DEPTH (ft)					
0		0.00 - 5.00 Hand Auger 0'-10'; core loss from 0'-5',	NR						Flush mount –	<b>B-110D</b> Borehole Diameter: 4" <b>WELL CASING</b> Interval: 0'-65' Material: Schedule 40 PVC Diameter: 2" Joint Type: Screw fit with rubber seam <b>WELL SCREEN</b> Interval: 53'-63' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC <b>FILTER PACK</b> Interval: 50.5'-63' Type: FilterSil Quantity: 3.5-50 lbs bags <b>FILTER PACK SEAL</b> Interval: 46'-50.5' Type: 3/8" Uncoated Pel-Plug Quantity: 1-5 gallon bucket <b>ANNULUS SEAL</b> Interval: 0'-46' Type: AquaGuard Bentonite Grout Quantity: Approximately 85 gallons  <b>NOTES</b>
5		5.00 - 8.50 (CL), CLAY; reddish brown to yellowish orange, trace to some fine to medium sand, moist, low plasticity, w<PL, soft to firm, Fill	CL		5.00	1	ROTO SONIC	7.00 12.00		
10		8.50 - 12.00 (ML), SILT; brown to dark brown, trace fine sand, moist, non-plastic, w<PL, soft	ML		8.50					
15		12.00 - 20.00 (ML), SILT; brown to dark brown, some fine sand, moist, non-plastic, w<PL, soft	ML		12.00	2	ROTO SONIC	3.00 8.00		
20		20.00 - 25.00 (ML), SILT; brown to dark brown, some fine sand, moist, non-plastic, w<PL, firm to stiff	ML		20.00	3	ROTO SONIC	3.00 5.00	AquaGuard Bentonite – Grout	
25		25.00 - 35.00 NO RECOVERY; material too loose and soft to stay in core barrel	NR		25.00					
30			NR			4	ROTO SONIC	0.00 10.00		
35		35.00 - 45.00 (GNEISS), BEDROCK; biotite, feldspar, quartz, light gray to white, well foliated, poorly jointed, fine-to medium-grained, fresh to slightly weathered, strong rock, locally contains vein quartz and garnets	BR		35.00	5	ROTO SONIC	6.40 10.00		
45		45.00 - 55.00 (GNEISS), BEDROCK; biotite, feldspar, quartz, light gray to white, well foliated, poorly jointed, veing quartz, fine to medium-grained, fresh to slightly weathered, strong rock, zones of fine-grained biotite	BR		45.00	6	ROTO SONIC	8.70 10.00	3/8" Uncoated – Pel-Plug	
50		Log continued on next page								

BOREHOLE RECORD MCDONOUGH MASTER LIST (2).GPJ PIEDMONT.GDT 2/3/21

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Fred Dorse

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/3/21





# RECORD OF BOREHOLE B-110D





SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 1668496.18  
DRILLED DEPTH: 65.00 ft  
LOCATION: Next to DGWC-68A

DRILL RIG: Geoprobe 8140LC  
DATE STARTED: 11/14/20  
DATE COMPLETED: 11/17/20

NORTHING: 1391294.4  
EASTING: 2200736  
GS ELEVATION: 764.55 ft  
TOC ELEVATION: 764.61 ft

DEPTH W.L.: 9.35  
ELEVATION W.L.: 755.3  
DATE W.L.: 11/17/2020  
TIME W.L.: 1110

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL/ PIEZOMETER DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	TYPE	REC		
					DEPTH (ft)					
50		45.00 - 55.00 (GNEISS), BEDROCK; biotite, feldspar, quartz, light gray to white, well foliated, poorly jointed, veing quartz, fine to medium-grained, fresh to slightly weathered, strong rock, zones of fine-grained biotite <i>(Continued)</i>	BR			6	ROTO SONIC	8.70 10.00		<b>B-110D</b> Borehole Diameter: 4" <b>WELL CASING</b> Interval: 0'-65' Material: Schedule 40 PVC Diameter: 2" Joint Type: Screw fit with rubber seam <b>WELL SCREEN</b> Interval: 53'-63' Material: Schedule 40 PVC Diameter: 2" Slot Size: .010" End Cap: Schedule 40 PVC <b>FILTER PACK</b> Interval: 50.5'-63' Type: FilterSil Quantity: 3.5-50 lbs bags <b>FILTER PACK SEAL</b> Interval: 46'-50.5' Type: 3/8" Uncoated Pel-Plug Quantity: 1-5 gallon bucket <b>ANNULUS SEAL</b> Interval: 0'-46' Type: AquaGuard Bentonite Grout Quantity: Approximately 85 gallons  <b>NOTES</b>
55		55.00 - 60.00 (GNEISS), BEDROCK; biotite, feldspar, quartz, light gray to white, well foliated, poorly jointed, veing quartz, fine to medium grain, fresh to slightly weathered, strong rock, local zones of fine-grained biotite	BR		55.00	7	ROTO SONIC	5.00 5.00		
60		60.00 - 65.00 (GNEISS), BEDROCK; biotite, feldspar, quartz, light gray to white, well foliated, poorly jointed, veing quartz, fine-to medium-grained, fresh to slightly weathered, strong rock, local zones of fine grained biotite	BR		60.00	8	ROTO SONIC	4.00 5.00		
65		Boring completed at 65.00 ft								
70										
75										
80										
85										
90										
95										
100										

BOREHOLE RECORD MCDONOUGH MASTER LIST (2).GPJ PIEDMONT.GDT 2/3/21

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Fred Dorse

GA INSPECTOR: Michael Boatman, PG  
CHECKED BY: Timothy Richards, PG  
DATE: 2/3/21





# RECORD OF BOREHOLE B-113D











SHEET 1 of 3

PROJECT: Plant McDonough  
PROJECT NUMBER: 166849621  
DRILLED DEPTH: 85.00 ft  
LOCATION: Offset of B-72

DRILL RIG: TS1 150CC  
DATE STARTED: 3/22/21  
DATE COMPLETED: 3/30/21

NORTHING: 1,391,264.6  
EASTING: 2,200,719.2  
GS ELEVATION: 758.87  
TOC ELEVATION: 758.22 ft

DEPTH W.L.: 1.46  
ELEVATION W.L.: 756.76  
DATE W.L.: 4/12/2021  
TIME W.L.: 12:00

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			PIEZOMETER DIAGRAM and NOTES	PIEZOMETER CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	PHOTO	REC		
0		0.00 - 3.00 CL, Silty CLAY, low plasticity; red-brown; soft, dry to moist, W<PL	CL		755.9 3.00				8" Flush Mount	<b>WELL CASING</b> Interval: 0-74.4' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 74.4-84.4' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: 84.4-84.7'  <b>FILTER PACK</b> Interval: 72.4-84.7' Type: #1 Filter Sand Quantity: 3.5 - 50 lbs bags  <b>FILTER PACK SEAL</b> Interval: 68.0-72.4' Type: 3/8" Uncoated Pel-Plug Quantity: 1 - 5 gallon bucket  <b>ANNULUS SEAL</b> Interval: 0-68.0' Type: AquaGuard Bentonite Grout Quantity: Approximately 80 gallons  <b>WELL COMPLETION</b> Pad: 4'x4'x4" Concrete Protective Casing: 8" Flush Mount  <b>DRILLING METHODS</b> Soil Drill: Rotosonic (6 inch casing by 4 inch core barrel) Rock Drill: Rotosonic Sample Type: Rotosonic
755		3.00 - 10.00 ML, Clayey SILT, non to low plasticity; dark brown to brown; soft, moist to wet (with depth), W<PL	ML			Hand Auger		0.00 10.00		
750		10.00 - 15.50 ML, Clayey SILT with some sand, low plasticity; dark brown to brown; soft to firm, dry to moist, W<PL	ML		748.9 10.00					
745										
15		15.50 - 20.00 TWR, Transitional Weathered Rock; breaks down to a ML, Clayey SILT with some sand, low plasticity; dark brown to brown; soft to firm, dry to moist, W<PL	TWR		743.4 15.50	1		7.60 10.00		
740										
20		20.00 - 30.00 Highly weathered, poorly foliated, poorly jointed, gray to black, fine-medium grained, very weak to weak, quartz-feldspar-biotite-muscovite SCHIST; locally contains vein quartz and water staining	BR		738.9 20.00	2		3.80 10.00		
735										
25		30.00 - 35.15 Highly weathered, poorly foliated, poorly jointed, gray to black, fine-medium grained, very weak to weak, quartz-feldspar-biotite-muscovite SCHIST; locally contains vein quartz, water staining, and garnets	BR		728.9 30.00					
730										
30		35.15 - 50.00 Fresh to slightly weathered, poorly foliated, white to pink and green, very fine to medium grained, medium strong to very strong, muscovite-plagioclase-k-spar-quartz GNEISS; locally contains vein quartz, epidote, and garnets	BR		723.7 35.15	3		7.00 10.00	AquaGuard Grout	
725										
35										
720										
40		Log continued on next page								

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Tommy Ardito

INSPECTOR: Michael Boatman, PG  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/24/21



BOREHOLE RECORD 166849621.GPJ PIEDMONT.GDT 5/24/21

# RECORD OF BOREHOLE B-113D

SHEET 2 of 3

PROJECT: Plant McDonough  
PROJECT NUMBER: 166849621  
DRILLED DEPTH: 85.00 ft  
LOCATION: Offset of B-72

DRILL RIG: TSi 150CC  
DATE STARTED: 3/22/21  
DATE COMPLETED: 3/30/21

NORTHING: 1,391,264.6  
EASTING: 2,200,719.2  
GS ELEVATION: 758.87  
TOC ELEVATION: 758.22 ft

DEPTH W.L.: 1.46  
ELEVATION W.L.: 756.76  
DATE W.L.: 4/12/2021  
TIME W.L.: 12:00

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			PIEZOMETER DIAGRAM and NOTES	PIEZOMETER CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	PHOTO	REC		
40		35.15 - 50.00 Fresh to slightly weathered, poorly foliated, white to pink and green, very fine to medium grained, medium strong to very strong, muscovite-plagioclase-k-spar-quartz GNEISS; locally contains vein quartz, epidote, and garnets (Continued)	BR							<b>WELL CASING</b> Interval: 0-74.4' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 74.4-84.4' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: 84.4-84.7'  <b>FILTER PACK</b> Interval: 72.4-84.7' Type: #1 Filter Sand Quantity: 3.5 - 50 lbs bags  <b>FILTER PACK SEAL</b> Interval: 68.0-72.4' Type: 3/8" Uncoated Pel-Plug Quantity: 1 - 5 gallon bucket  <b>ANNULUS SEAL</b> Interval: 0-68.0' Type: AquaGuard Bentonite Grout Quantity: Approximately 80 gallons  <b>WELL COMPLETION</b> Pad: 4'x4'x4" Concrete Protective Casing: 8" Flush Mount  <b>DRILLING METHODS</b> Soil Drill: Rotosonic (6 inch casing by 4 inch core barrel) Rock Drill: Rotosonic Sample Type: Rotosonic
45	715					4		6.50 10.00		
50		50.00 - 60.00 Fresh, weakly foliated, poorly jointed, light gray to greenish white, fine to medium grained, medium strong to strong, epidote-muscovite-biotite-feldspar-quartz GNEISS; locally contains garnets and pyrite.	BR		708.9 50.00					
55	710					5		10.00 10.00		
60		60.00 - 76.00 Fresh, weakly foliated, poorly jointed, green to white to gray, fine to medium grained, medium strong to strong, GNEISS; locally contains vein quartz and garnets	BR		698.9 60.00					
65	705					6		7.50 10.00		
70			BR							
75	695					7		8.70 10.00		
80		76.00 - 85.00 Fresh to slightly weathered, weak to moderately foliated, poorly jointed, greenish white to gray, fine to medium grained, strong, GNEISS; locally contains folds, vein quartz, and garnets; rock becomes schistose in localized areas.	BR		682.9 76.00					

Log continued on next page

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Tommy Ardito

INSPECTOR: Michael Boatman, PG  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/24/21



BOREHOLE RECORD 166849621.GPJ PIEDMONT.GDT 5/24/21

# RECORD OF BOREHOLE B-113D




SHEET 3 of 3

PROJECT: Plant McDonough  
PROJECT NUMBER: 166849621  
DRILLED DEPTH: 85.00 ft  
LOCATION: Offset of B-72

DRILL RIG: TSi 150CC  
DATE STARTED: 3/22/21  
DATE COMPLETED: 3/30/21

NORTHING: 1,391,264.6  
EASTING: 2,200,719.2  
GS ELEVATION: 758.87  
TOC ELEVATION: 758.22 ft

DEPTH W.L.: 1.46  
ELEVATION W.L.: 756.76  
DATE W.L.: 4/12/2021  
TIME W.L.: 12:00

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			PIEZOMETER DIAGRAM and NOTES	PIEZOMETER CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	PHOTO	REC		
80		76.00 - 85.00 Fresh to slightly weathered, weak to moderately foliated, poorly jointed, greenish white to gray, fine to medium grained, strong, GNEISS; locally contains folds, vein quartz, and garnets; rock becomes schistose in localized areas. <i>(Continued)</i>	BR			8		$\frac{4.50}{5.00}$	<div>0.010" Slotted Schedule 40 PVC</div> <div>Sump</div> 	<b>WELL CASING</b> Interval: 0-74.4' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 74.4-84.4' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: 84.4-84.7'  <b>FILTER PACK</b> Interval: 72.4-84.7' Type: #1 Filter Sand Quantity: 3.5 - 50 lbs bags  <b>FILTER PACK SEAL</b> Interval: 68.0-72.4' Type: 3/8" Uncoated Pel-Plug Quantity: 1 - 5 gallon bucket  <b>ANNULUS SEAL</b> Interval: 0-68.0' Type: AquaGuard Bentonite Grout Quantity: Approximately 80 gallons  <b>WELL COMPLETION</b> Pad: 4'x4'x4" Concrete Protective Casing: 8" Flush Mount  <b>DRILLING METHODS</b> Soil Drill: Rotosonic (6 inch casing by 4 inch core barrel) Rock Drill: Rotosonic Sample Type: Rotosonic
675		Boring completed at 85.00 ft			673.9					
85										
670										
90										
665										
95										
660										
100										
655										
105										
650										
110										
645										
115										
640										
120										

BOREHOLE RECORD 166849621.GPJ PIEDMONT.GDT 5/24/21

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Tommy Ardito

INSPECTOR: Michael Boatman, PG  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/24/21



# RECORD OF BOREHOLE B-115D

SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 166849621  
DRILLED DEPTH: 80.00 ft  
LOCATION: South of overflow parking

DRILL RIG: TSi 150CC  
DATE STARTED: 3/19/21  
DATE COMPLETED: 3/20/21

NORTHING: 1,391,265.3  
EASTING: 2,202,580.7  
GS ELEVATION: 786.43  
TOC ELEVATION: 789.17 ft

DEPTH W.L.: 19.32  
ELEVATION W.L.: 769.85  
DATE W.L.: 4/7/2021  
TIME W.L.: 14:15

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			PIEZOMETER DIAGRAM AND NOTES	PIEZOMETER CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	PHOTO	REC		
0	785	0.00 - 10.00 FILL- Backfilled with cuttings from air knife clearance								<b>WELL CASING</b> Interval: 0-69.2' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 69.2-79.2' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: 79.2-79.5'  <b>FILTER PACK</b> Interval: 66.7-79.5' Type: #1 Filter Sand Quantity: 4 - 50 lbs bags  <b>FILTER PACK SEAL</b> Interval: 62.5-66.7' Type: 3/8" Uncoated Pel-Plug Quantity: 1 - 5 gallon bucket  <b>ANNULUS SEAL</b> Interval: 0-62.5' Type: AquaGuard Bentonite Grout Quantity: Approximately 100 gallons  <b>WELL COMPLETION</b> Pad: 4'x4'x4" Concrete Protective Casing: 4"x4" Aluminium  <b>DRILLING METHODS</b> Soil Drill: Rotosonic (6 inch casing by 4 inch core barrel) Rock Drill: Rotosonic Sample Type: Rotosonic
5	780				776.4		Air Knife	0.00 10.00		
10	775	10.00 - 13.00 CL, Silty CLAY with trace organics, low to moderate plasticity; dark brown; fill; soft to firm, moist, W<PL	CL		10.00					
15	770	13.00 - 18.00 SC, Clayey SAND, low plasticity, fine to coarse; dark red brown to red brown; fill; soft/loose, dry to moist, W<PL	SC		773.4	13.00		10.00		
20	765	18.00 - 20.00 ML, Clayey SILT, low plasticity; tan; soft, moist, W<PL	ML		768.4	18.00		10.00		
25	760	20.00 - 25.00 TWR, Transitional Weathered Rock; breaks down to a ML, Sandy SILT with trace coobles, non to low plasticity; light brown to brown; soft/loose, moist, W<PL	TWR		766.4	20.00				
30	755	25.00 - 30.00 Highly to moderately weathered, well foliated, well jointed, dark gray to black, fine to medium grained, very weak to weak, muscovite SCHIST; locally is water stained	BR		761.4	25.00		8.50 10.00		
35	750	30.00 - 50.00 Fresh to moderately weathered, well foliated, well jointed, green to gray to black, fine to medium grained, very weak to medium strong, muscovite SCHIST; locally interlayered with a epidote- quartz-muscovite schistose GNEISS	BR		756.4	30.00		7.50 10.00	AquaGuard - Grout	
40		Log continued on next page								

BOREHOLE RECORD 166849621.GPJ PIEDMONT.GDT 5/24/21

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Tommy Ardito

INSPECTOR: Michael Boatman, PG  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/24/21



# RECORD OF BOREHOLE B-115D

SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 166849621  
DRILLED DEPTH: 80.00 ft  
LOCATION: South of overflow parking

DRILL RIG: TSi 150CC  
DATE STARTED: 3/19/21  
DATE COMPLETED: 3/20/21

NORTHING: 1,391,265.3  
EASTING: 2,202,580.7  
GS ELEVATION: 786.43  
TOC ELEVATION: 789.17 ft

DEPTH W.L.: 19.32  
ELEVATION W.L.: 769.85  
DATE W.L.: 4/7/2021  
TIME W.L.: 14:15

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			PIEZOMETER DIAGRAM and NOTES	PIEZOMETER CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	PHOTO	REC		
40		30.00 - 50.00 Fresh to moderately weathered, well foliated, well jointed, green to gray to black, fine to medium grained, very weak to medium strong, muscovite SCHIST; locally interlayered with a epidote-quartz-muscovite schistose GNEISS (Continued)	BR							
745						4		6.50 10.00		
45										
740										
50		50.00 - 70.00 Fresh to slightly weathered, well foliated, well jointed, light gray to green, fine to medium grained, weak to strong, chlorite-quartz-muscovite SCHIST	BR		736.4 50.00					
735						5		6.50 10.00		
55										
730										
60			BR							
725										
65						6		8.00 10.00		
720										
70		70.00 - 80.00 Fresh to Slightly weathered, weak to moderately foliated, poorly jointed, gray to black, fine grained, medium strong to strong, quartz-biotite-muscovite SCHIST; locally contains pyrite and garnets	BR		716.4 70.00					
715						7		10.00 10.00		
75										
710										
80		Boring completed at 80.00 ft			706.4					

**WELL CASING**  
Interval: 0-69.2'  
Material: Schedule 40 PVC  
Diameter: 2"  
Joint Type: Flush/Screw

**WELL SCREEN**  
Interval: 69.2-79.2'  
Material: Schedule 40 PVC  
Diameter: 2"  
Slot Size: 0.010"  
End Cap: 79.2-79.5'

**FILTER PACK**  
Interval: 66.7-79.5'  
Type: #1 Filter Sand  
Quantity: 4 - 50 lbs bags

**FILTER PACK SEAL**  
Interval: 62.5-66.7'  
Type: 3/8" Uncoated Pel-Plug  
Quantity: 1 - 5 gallon bucket

**ANNULUS SEAL**  
Interval: 0-62.5'  
Type: AquaGuard Bentonite Grout  
Quantity: Approximately 100 gallons

**WELL COMPLETION**  
Pad: 4'x4'x4" Concrete  
Protective Casing: 4'x4" Aluminium

**DRILLING METHODS**  
Soil Drill: Rotosonic (6 inch casing by 4 inch core barrel)  
Rock Drill: Rotosonic  
Sample Type: Rotosonic

Bentonite Seal

#1 Filter Sand

0.010" Slotted Schedule 40 PVC

Sump



LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Tommy Ardito

INSPECTOR: Michael Boatman, PG  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/24/21

BOREHOLE RECORD 166849621.GPJ PIEDMONT.GDT 5/24/21



# RECORD OF BOREHOLE B-116D














SHEET 1 of 3

PROJECT: Plant McDonough  
PROJECT NUMBER: 166849621  
DRILLED DEPTH: 90.00 ft  
LOCATION: Offset DGWC-70A

DRILL RIG: TS1 150CC  
DATE STARTED: 3/7/21  
DATE COMPLETED: 3/8/21

NORTHING: 1,390,483.7  
EASTING: 2,200,611.0  
GS ELEVATION: 805.31  
TOC ELEVATION: 807.82 ft

DEPTH W.L.: 40.82  
ELEVATION W.L.: 767.00  
DATE W.L.: 4/6/2021  
TIME W.L.: 15:11

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			PIEZOMETER DIAGRAM AND NOTES	PIEZOMETER CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	PHOTO	REC		
0	805	0.00 - 3.00 CL, Silty CLAY, low plasticity; red brown; soft to firm, moist, W<PL	CL		802.3	Hand Auger				<b>WELL CASING</b> Interval: 0-79.2' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw
		3.00 - 6.00 ML, Clayey SILT with trace to some fine to coarse sand, non plasticity; brown; soft/ loose, dry to moist, W<PL	ML		3.00					
5	800	6.00 - 10.00 SM, SILTY SAND, non to low plasticity; yellow-brown to tan; loose, dry, W<PL	SM		6.00					
					799.3	1		0.00 10.00		<b>WELL SCREEN</b> Interval: 79.2-89.2' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: 89.2-89.5'
		10.00 - 11.00 CL, Silty CLAY with some silt, low plasticity; red brown to brown; soft, moist, W<PL	CL		10.00					
10	795	11.00 - 20.00 ML, Clayey SILT, non plasticity; brown to gray-brown; soft/ loose, moist, W<PL; locally contains books of muscovite	ML		11.00					
					795.3	2		13.50 10.00		<b>FILTER PACK</b> Interval: 75.5-89.5' Type: #1 Filter Sand Quantity: 4.5 - 50 lbs bag
		20.00 - 21.50 CL, Silty CLAY with some fine sand, low plasticity; orange brown; soft, moist, W~PL	CL		20.00					
15	790	21.50 - 30.00 ML, Clayey SILT with trace clay and fine sand, non plasticity; brown to gray-brown; soft/ loose, moist, W<PL; locally contains books of muscovite	ML		21.50					
					785.3	3		15.00 10.00		<b>FILTER PACK SEAL</b> Interval: 70.6-75.5' Type: 3/8" Uncoated Pel-Plug Quantity: 1 - 5 gallon bucket
20	785	30.00 - 40.00 ML, Clayey SILT with trace fine sand and trace to some clay, non to low plasticity; gray; soft, moist, W<PL to W~PL	ML		30.00					
					783.8					
					775.3	3		12.00 10.00	AquaGuard - Grout	<b>ANNULUS SEAL</b> Interval: 0-70.6' Type: AquaGuard Bentonite Grout Quantity: Approximately 120 gallons
25	780				775.3					
30	775				765.3					
35	770									<b>WELL COMPLETION</b> Pad: 4'x4'x4" Concrete Protective Casing: 4"x4" Aluminium
40		Log continued on next page								

BOREHOLE RECORD 166849621.GPJ PIEDMONT.GDT 5/24/21

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Tommy Ardito

INSPECTOR: Michael Boatman, PG  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/24/21



# RECORD OF BOREHOLE B-116D

SHEET 2 of 3

PROJECT: Plant McDonough  
PROJECT NUMBER: 166849621  
DRILLED DEPTH: 90.00 ft  
LOCATION: Offset DGWC-70A

DRILL RIG: TSi 150CC  
DATE STARTED: 3/7/21  
DATE COMPLETED: 3/8/21

NORTHING: 1,390,483.7  
EASTING: 2,200,611.0  
GS ELEVATION: 805.31  
TOC ELEVATION: 807.82 ft

DEPTH W.L.: 40.82  
ELEVATION W.L.: 767.00  
DATE W.L.: 4/6/2021  
TIME W.L.: 15:11

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			PIEZOMETER DIAGRAM and NOTES	PIEZOMETER CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	PHOTO	REC		
					DEPTH (ft)					
40	765	40.00 - 50.00 ML, Clayey SILT with some fine to coarse sand, non to low plasticity; gray to gray-brown; soft (becoming firm to stiff with depth), moist to wet, W<PL	ML		40.00	4		12.00 10.00		<b>WELL CASING</b> Interval: 0-79.2' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 79.2-89.2' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: 89.2-89.5'  <b>FILTER PACK</b> Interval: 75.5-89.5' Type: #1 Filter Sand Quantity: 4.5 - 50 lbs bag  <b>FILTER PACK SEAL</b> Interval: 70.6-75.5' Type: 3/8" Uncoated Pel-Plug Quantity: 1 - 5 gallon bucket  <b>ANNULUS SEAL</b> Interval: 0-70.6' Type: AquaGuard Bentonite Grout Quantity: Approximately 120 gallons  <b>WELL COMPLETION</b> Pad: 4'x4'x4" Concrete Protective Casing: 4"x4" Aluminium  <b>DRILLING METHODS</b> Soil Drill: Rotosonic (6 inch casing by 4 inch core barrel) Rock Drill: Rotosonic Sample Type: Rotosonic
45	760									
50	755	50.00 - 54.90 TWR, Transitional Weathered Rock; breaks down to a ML, Clayey SILT with some fine to coarse sand, non to low plasticity; gray to gray-brown; soft (becoming firm to stiff with depth), moist to wet, W<PL	TWR		755.3 50.00	5		5.10 10.00		
55	750	54.90 - 90.00 Fresh to slightly weathered, well foliated, well jointed, gray to black, fine to medium grained, weak to medium strong, garnet-chlorite-quartz-biotite-muscovite SCHIST	BR		750.4 54.90					
60	745					6		7.00 10.00		
65	740									
70	735					7		8.00 10.00		
75	730									
80		Log continued on next page								

BOREHOLE RECORD 166849621.GPJ PIEDMONT.GDT 5/24/21

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Tommy Ardito

INSPECTOR: Michael Boatman, PG  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/24/21



# RECORD OF BOREHOLE B-116D

SHEET 3 of 3

PROJECT: Plant McDonough  
PROJECT NUMBER: 166849621  
DRILLED DEPTH: 90.00 ft  
LOCATION: Offset DGWC-70A

DRILL RIG: TS1 150CC  
DATE STARTED: 3/7/21  
DATE COMPLETED: 3/8/21

NORTHING: 1,390,483.7  
EASTING: 2,200,611.0  
GS ELEVATION: 805.31  
TOC ELEVATION: 807.82 ft

DEPTH W.L.: 40.82  
ELEVATION W.L.: 767.00  
DATE W.L.: 4/6/2021  
TIME W.L.: 15:11

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			PIEZOMETER DIAGRAM and NOTES	PIEZOMETER CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	PHOTO	REC		
80	725	54.90 - 90.00 Fresh to slightly weathered, well foliated, well jointed, gray to black, fine to medium grained, weak to medium strong, garnet-chlorite-quartz-biotite-muscovite SCHIST ( <i>Continued</i> )	BR		715.3	8		9.00 10.00	<div>0.010" Slotted Schedule 40 PVC</div> <div>#1 Filter Sand</div> <div>Sump</div>	<p><b>WELL CASING</b> Interval: 0-79.2' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw</p> <p><b>WELL SCREEN</b> Interval: 79.2-89.2' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: 89.2-89.5'</p> <p><b>FILTER PACK</b> Interval: 75.5-89.5' Type: #1 Filter Sand Quantity: 4.5 - 50 lbs bag</p> <p><b>FILTER PACK SEAL</b> Interval: 70.6-75.5' Type: 3/8" Uncoated Pel-Plug Quantity: 1 - 5 gallon bucket</p> <p><b>ANNULUS SEAL</b> Interval: 0-70.6' Type: AquaGuard Bentonite Grout Quantity: Approximately 120 gallons</p> <p><b>WELL COMPLETION</b> Pad: 4'x4'x4" Concrete Protective Casing: 4"x4" Aluminium</p> <p><b>DRILLING METHODS</b> Soil Drill: Rotosonic (6 inch casing by 4 inch core barrel) Rock Drill: Rotosonic Sample Type: Rotosonic</p>
85	720									
90	715	Boring completed at 90.00 ft								
95	710									
100	705									
105	700									
110	695									
115	690									
120										

BOREHOLE RECORD 166849621.GPJ PIEDMONT.GDT 5/24/21

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Tommy Ardito

INSPECTOR: Michael Boatman, PG  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/24/21





# RECORD OF BOREHOLE B-117D

SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 166849621  
DRILLED DEPTH: 75.00 ft  
LOCATION: Offset of DGWC-71

DRILL RIG: TSi 150CC  
DATE STARTED: 3/17/21  
DATE COMPLETED: 3/17/21

NORTHING: 1,393,963.8  
EASTING: 2,201,727.3  
GS ELEVATION: 861.23  
TOC ELEVATION: 863.82 ft

DEPTH W.L.: 27.88  
ELEVATION W.L.: 835.94  
DATE W.L.: 4/7/2021  
TIME W.L.: 9:35

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			PIEZOMETER DIAGRAM and NOTES	PIEZOMETER CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	PHOTO	REC		
0	860	0.00 - 10.00 FILL- Backfilled with cuttings from air knife clearance								<b>WELL CASING</b> Interval: 0-64.7' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 64.7-74.7' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: 74.7-75'  <b>FILTER PACK</b> Interval: 62.5- 75' Type: #1 Filter Sand Quantity: 4 - 50 lbs bags  <b>FILTER PACK SEAL</b> Interval: 58.5-62.5' Type: 3/8" Uncoated Pel-Plug Quantity: 1 - 5 gallon bucket  <b>ANNULUS SEAL</b> Interval: 0-58.5' Type: AquaGuard Bentonite Grout Quantity: Approximately 80 gallons  <b>WELL COMPLETION</b> Pad: 4'x4'x4" Concrete Protective Casing: 4'x4' Aluminium  <b>DRILLING METHODS</b> Soil Drill: Rotasonic (6 inch casing by 4 inch core barrel) Rock Drill: Rotasonic Sample Type: Rotasonic
5	855				851.2					
10	850	10.00 - 16.00 SM, SILTY SAND, low plasticity; red brown; soft/loose, moist, W<PL	SM		10.00	1		7.00 9.00		
15	845	16.00 - 19.00 ML, Clayey SILT with trace sand, low plasticity; light gray to white; soft, moist, W<PL	ML		845.2 16.00					
20	840	19.00 - 29.00 SM, SILTY SAND, low plasticity, very fine; light gray to tannish white; soft, moist, W<PL			842.2 19.00					
25	835		SM			2		9.50 10.00		
30	830	29.00 - 39.00 SM, SILTY SAND with trace gravels, low plasticity, fine to coarse; light gray to tannish white; soft, moist (becoming dry with depth), W<PL			832.2 29.00					
35	825		SM			3		10.00 10.00	AquaGuard Grout	
40			SM		822.2 39.00	4		9.00 10.00		

Log continued on next page

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Tommy Ardito

INSPECTOR: Michael Boatman, PG  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/24/21



BOREHOLE RECORD 166849621.GPJ PIEDMONT.GDT 5/24/21

# RECORD OF BOREHOLE B-117D

SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 166849621  
DRILLED DEPTH: 75.00 ft  
LOCATION: Offset of DGWC-71

DRILL RIG: TSi 150CC  
DATE STARTED: 3/17/21  
DATE COMPLETED: 3/17/21

NORTHING: 1,393,963.8  
EASTING: 2,201,727.3  
GS ELEVATION: 861.23  
TOC ELEVATION: 863.82 ft

DEPTH W.L.: 27.88  
ELEVATION W.L.: 835.94  
DATE W.L.: 4/7/2021  
TIME W.L.: 9:35

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			PIEZOMETER DIAGRAM and NOTES	PIEZOMETER CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	PHOTO	REC		
40	820	39.00 - 41.00 SM, SILTY SAND with trace gravels, low plasticity, fine to coarse; light gray to tannish white; compact/dense to firm/stiff, moist (becoming dry with depth), W<PL (Continued)	SM		820.2 41.00					<b>WELL CASING</b> Interval: 0-64.7' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 64.7-74.7' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: 74.7-75'  <b>FILTER PACK</b> Interval: 62.5- 75' Type: #1 Filter Sand Quantity: 4 - 50 lbs bags  <b>FILTER PACK SEAL</b> Interval: 58.5-62.5' Type: 3/8" Uncoated Pel-Plug Quantity: 1 - 5 gallon bucket  <b>ANNULUS SEAL</b> Interval: 0-58.5' Type: AquaGuard Bentonite Grout Quantity: Approximately 80 gallons  <b>WELL COMPLETION</b> Pad: 4'x4'x4" Concrete Protective Casing: 4'x4' Aluminium  <b>DRILLING METHODS</b> Soil Drill: Rotosonic (6 inch casing by 4 inch core barrel) Rock Drill: Rotosonic Sample Type: Rotosonic
45	815	41.00 - 49.00 TWR, Transitional Weathered Rock; breaks down to abreaks down to aSM, SILTY SAND with trace gravels, low plasticity, fine to coarse; light gray to tannish white; compact/dense to firm/stiff, moist (becoming dry with depth), W<PL	TWR			4		9.00 10.00		
50	810	49.00 - 75.00 Fresh to moderately weathered, well foliated, moderately jointed, gray to dark gray, fine to medium grained, medium strong, biotite-quartz-feldspar GNEISS; locally contains pegmatite and quartz veins			812.2 49.00					
55	805					5		7.50 10.00		
60	800		BR			6		8.50 10.00	Bentonite Seal	
65	795									
70	790					7		4.50 6.00	#1 Filter Sand  0.010" Slotted Schedule 40 PVC	
75	785	Boring completed at 75.00 ft			786.2					
80										

BOREHOLE RECORD 166849621.GPJ PIEDMONT.GDT 5/24/21

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Tommy Ardito

INSPECTOR: Michael Boatman, PG  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/24/21



# RECORD OF BOREHOLE B-118















SHEET 1 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 166849621  
DRILLED DEPTH: 75.00 ft  
LOCATION: West of gas pipeline

DRILL RIG: TSi 150CC  
DATE STARTED: 3/8/21  
DATE COMPLETED: 3/9/21

NORTHING: 1,391,219.3  
EASTING: 2,200,449.7  
GS ELEVATION: 804.99  
TOC ELEVATION: 807.70 ft

DEPTH W.L.: 50.65  
ELEVATION W.L.: 757.05  
DATE W.L.: 4/6/2021  
TIME W.L.: 9:36

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			PIEZOMETER DIAGRAM AND NOTES	PIEZOMETER CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	PHOTO	REC		
					DEPTH (ft)					
0	805	0.00 - 3.00 CL, Silty CLAY with trace to some fine sand, low plasticity; dark red; soft, dry to moist, W,PL	CL		802	Hand Auger				<b>WELL CASING</b> Interval: 0-64.85' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 64.85-74.85' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: 74.85-75.15'  <b>FILTER PACK</b> Interval: 61.8-75.15 Type: #1 Filter Sand Quantity: 4 - 50 lbs bags  <b>FILTER PACK SEAL</b> Interval: 56.6-61.8' Type: 3/8" Uncoated Pel-Plug Quantity: 1 - 5 gallon bucket  <b>ANNULUS SEAL</b> Interval: 0-56.6' Type: AquaGuard Bentonite Grout Quantity: Approximately 80 gallons  <b>WELL COMPLETION</b> Pad: 4'x4'x4" Concrete Protective Casing: 4"x4" Aluminium  <b>DRILLING METHODS</b> Soil Drill: Rotasonic (6 inch casing by 4 inch core barrel) Rock Drill: Rotasonic Sample Type: Rotasonic
5	800	3.00 - 10.00 SP, SAND, non plasticity, uniformly graded; yellow-orange; loose, dry to moist, W<PL	SP		3.00					
10	795	10.00 - 18.50 CL, Silty CLAY with trace to some fine sand, low plasticity; red-orange and white; soft, moist, W,PL	CL		795 10.00	1				
15	790									
20	785	18.50 - 20.00 ML, Clayey SILT with trace sand and fine gravels, non plasticity; olive brown to brown; loose, dry, W<PL	ML		786.5 18.50					
		20.00 - 25.00 SP, SAND, non plasticity, fine to coarse, poorly graded; tannish-orange; loose, moist, W<PL	SP		785 20.00					
25	780	25.00 - 30.00 SM, SILTY SAND, low plasticity, fine to medium; orange to tan; loose/soft, moist, W<PL	SM		780 25.00	2		7.50 10.00		
30	775	30.00 - 32.00 ML, Sandy SILT, non plasticity; brown to dark brown; soft, moist, W<PL	ML		775 30.00	3		2.50 2.00		
35	770	32.00 - 40.00 TWR, Transitional Weathered Rock; breaks down to a SW-SM, SAND AND SILT with some gravels, non to low plasticity, fine to coarse; white; loose, wet, W<PL	TWR		773 32.00	4		1.00 6.00		
40	765				765	5		1.50 2.00		
Log continued on next page										

BOREHOLE RECORD 166849621.GPJ PIEDMONT.GDT 5/24/21

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Tommy Ardito

INSPECTOR: Michael Boatman, PG  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/24/21



# RECORD OF BOREHOLE B-118

SHEET 2 of 2

PROJECT: Plant McDonough  
PROJECT NUMBER: 166849621  
DRILLED DEPTH: 75.00 ft  
LOCATION: West of gas pipeline

DRILL RIG: TSi 150CC  
DATE STARTED: 3/8/21  
DATE COMPLETED: 3/9/21

NORTHING: 1,391,219.3  
EASTING: 2,200,449.7  
GS ELEVATION: 804.99  
TOC ELEVATION: 807.70 ft

DEPTH W.L.: 50.65  
ELEVATION W.L.: 757.05  
DATE W.L.: 4/6/2021  
TIME W.L.: 9:36

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			PIEZOMETER DIAGRAM and NOTES	PIEZOMETER CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	PHOTO	REC		
40	765	40.00 - 50.00 Slightly to moderately weathered, well foliated, moderately jointed, tan to white to gray, fine to medium grained, medium strong, plagioclase-K-spar-biotite-quartz GNEISS	BR		40.00					<b>WELL CASING</b> Interval: 0-64.85' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 64.85-74.85' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: 74.85-75.15'  <b>FILTER PACK</b> Interval: 61.8-75.15 Type: #1 Filter Sand Quantity: 4 - 50 lbs bags  <b>FILTER PACK SEAL</b> Interval: 56.6-61.8' Type: 3/8" Uncoated Pel-Plug Quantity: 1 - 5 gallon bucket  <b>ANNULUS SEAL</b> Interval: 0-56.6' Type: AquaGuard Bentonite Grout Quantity: Approximately 80 gallons  <b>WELL COMPLETION</b> Pad: 4'x4'x4" Concrete Protective Casing: 4"x4" Aluminium  <b>DRILLING METHODS</b> Soil Drill: Rotasonic (6 inch casing by 4 inch core barrel) Rock Drill: Rotasonic Sample Type: Rotasonic
45	760					6		4.80 10.00		
50	755	50.00 - 60.00 Moderately weathered, well foliated, well jointed, tan to white to brown, fine to medium grained, weak to medium strong, plagioclase-K-spar-biotite-quartz GNEISS			755 50.00					
55	750		BR			7		2.50 10.00		
60	745	60.00 - 75.00 Fresh to slightly weathered, well foliated, poorly jointed, greenish gray to gray, fine to medium grained, medium strong, epidote-biotite-feldspar-quartz GNEISS			745 60.00					
65	740		BR			8		0.00 10.00		
70	735					9		2.50 5.00		
75	730	Boring completed at 75.00 ft			730					
80	725									

BOREHOLE RECORD 166849621.GPJ PIEDMONT.GDT 5/24/21

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Tommy Ardito

INSPECTOR: Michael Boatman, PG  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/24/21



# RECORD OF BOREHOLE B-119D















SHEET 1 of 3

PROJECT: Plant McDonough  
PROJECT NUMBER: 166849621  
DRILLED DEPTH: 105.00 ft  
LOCATION: Offset of B-118

DRILL RIG: TS1 150CC  
DATE STARTED: 3/10/21  
DATE COMPLETED: 3/16/21

NORTHING: 1,391,236.4  
EASTING: 2,200,446.6  
GS ELEVATION: 804.53  
TOC ELEVATION: 807.15 ft

DEPTH W.L.: 49.94  
ELEVATION W.L.: 757.21  
DATE W.L.: 4/5/2021  
TIME W.L.: 13:37

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			PIEZOMETER DIAGRAM and NOTES	PIEZOMETER CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	PHOTO	REC		
0		0.00 - 12.50 CL, Sandy CLAY, low plasticity, fine to coarse; red to red-orange; soft/loose, dry to moist, W<PL	CL							<b>WELL CASING</b> Interval: 0-94.7' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 94.7-104.7' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: 104.7-105'  <b>FILTER PACK</b> Interval: 91.5-105' Type: #1 Filter Sand Quantity: 4.5 - 50 lbs bags  <b>FILTER PACK SEAL</b> Interval: 86.5-91.5' Type: 3/8" Uncoated Pel-Plug Quantity: 1 - 5 gallon bucket  <b>ANNULUS SEAL</b> Interval: 0-86.5' Type: AquaGuard Bentonite Grout Quantity: Approximately 160 gallons  <b>WELL COMPLETION</b> Pad: 4'x4'x4" Concrete Protective Casing: 4"x4" Aluminium  <b>DRILLING METHODS</b> Soil Drill: Rotosonic (6 inch casing by 4 inch core barrel) Rock Drill: Rotosonic Sample Type: Rotosonic
5	800					Hand Auger		0.00 10.00		
10	795				792					
15	790	12.50 - 18.00 ML, Clayey SILT with some fine sand, low plasticity; pink-brown to tan; loose, dry to moist, W<PL	ML		12.50	1		7.50 9.00		
20	785	18.00 - 19.00 SP, SAND with trace to some silt, low plasticity, uniformly graded; white to tan; loose, dry, W<PL	SP		18.00					
		19.00 - 20.00 SC, CLAYEY SAND, moderate plasticity, fine to medium; dark brown; soft, moist, W~PL	SC		19.00					
		20.00 - 21.50 SP, SAND with some silt, low plasticity, fine; white to tan to gray; loose, dry to moist, W<PL	SP		20.00					
		21.50 - 23.50 SM, SILTY SAND, low plasticity; beige brown; soft, moist to wet, W~PL	SM		21.50					
25	780	23.50 - 27.50 ML, Clayey SILT with some fine sand, moderate plasticity; light to dark brown; soft/loose, dry to moist, W<PL	ML		23.50	2		9.50 10.00		
		27.50 - 29.00 SP, SAND with trace to some silt, non plasticity, fine to coarse; white to beige; loose, dry, W<PL	SP		27.50					
30	775	29.00 - 39.00 ML, Sandy SILT with trace gravels, low plasticity, fine; tan to light brown; loose, dry to moist, W<PL	ML		29.00					
					777					
35	770				775.5					
					765.5					
40	765		ML		39.00	4		4.50 6.00		

Log continued on next page

AquaGuard  
Grout

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Tommy Ardito

INSPECTOR: Michael Boatman, PG  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/24/21



BOREHOLE RECORD 166849621.GPJ PIEDMONT.GDT 5/24/21



# RECORD OF BOREHOLE B-119D

SHEET 2 of 3

PROJECT: Plant McDonough  
PROJECT NUMBER: 166849621  
DRILLED DEPTH: 105.00 ft  
LOCATION: Offset of B-118

DRILL RIG: TSi 150CC  
DATE STARTED: 3/10/21  
DATE COMPLETED: 3/16/21

NORTHING: 1,391,236.4  
EASTING: 2,200,446.6  
GS ELEVATION: 804.53  
TOC ELEVATION: 807.15 ft

DEPTH W.L.: 49.94  
ELEVATION W.L.: 757.21  
DATE W.L.: 4/5/2021  
TIME W.L.: 13:37

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			PIEZOMETER DIAGRAM and NOTES	PIEZOMETER CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	PHOTO	REC		
40		39.00 - 45.00 ML, Sandy SILT with trace gravels and cobbles, low plasticity, fine; tan to light brown; loose, dry to wet, W<PL <i>(Continued)</i>	ML			4		4.50 6.00		<b>WELL CASING</b> Interval: 0-94.7' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 94.7-104.7' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: 104.7-105'  <b>FILTER PACK</b> Interval: 91.5-105' Type: #1 Filter Sand Quantity: 4.5 - 50 lbs bags  <b>FILTER PACK SEAL</b> Interval: 86.5-91.5' Type: 3/8" Uncoated Pel-Plug Quantity: 1 - 5 gallon bucket  <b>ANNULUS SEAL</b> Interval: 0-86.5' Type: AquaGuard Bentonite Grout Quantity: Approximately 160 gallons  <b>WELL COMPLETION</b> Pad: 4'x4'x4" Concrete Protective Casing: 4'x4" Aluminium  <b>DRILLING METHODS</b> Soil Drill: Rotosonic (6 inch casing by 4 inch core barrel) Rock Drill: Rotosonic Sample Type: Rotosonic
45	760	45.00 - 50.00 TWR, Transitional Weathered Rock; breaks down to a SM, SILTY SAND with trace gravels(weatherd gneiss) low plasticity; light gray to tan; firm/compact, moist to wet, W<PL	TWR		759.5 45.00	5		6.00 5.00		
50	755	50.00 - 53.40 Slightly to moderately weathered, well foliated, moderately jointed, gray to brown, fine grained, weak to medium strong, muscovite-quartz-feldspar-biotite GNEISS	BR		754.5 50.00					
55	750	53.40 - 60.00 TWR, Transitional Weathered Rock; breaks down to a SM, SILTY SAND, low plasticity; grayish brown to gray; loose, dry to moist, W<PL	TWR		751.1 53.40	6		6.20 10.00		
60	745	60.00 - 67.00 Slightly to moderately weathered, well foliated, moderately jointed, gray to brown, fine grained, weak to medium strong, muscovite-quartz-feldspar-biotite GNEISS	BR		744.5 60.00	7		4.00 10.00		
65	740									
70	735	67.00 - 87.00 Fresh to slightly weathered, moderately foliated, poorly jointed, dark gray to black, very fine to fine grained, medium strong, feldspar-quartz-biotite GNEISS	BR		737.5 67.00	8		8.50 10.00		
75	730									
80	725									

Log continued on next page

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Tommy Ardito

INSPECTOR: Michael Boatman, PG  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/24/21



BOREHOLE RECORD 166849621.GPJ PIEDMONT.GDT 5/24/21

# RECORD OF BOREHOLE B-119D

SHEET 3 of 3

PROJECT: Plant McDonough  
PROJECT NUMBER: 166849621  
DRILLED DEPTH: 105.00 ft  
LOCATION: Offset of B-118

DRILL RIG: TS1 150CC  
DATE STARTED: 3/10/21  
DATE COMPLETED: 3/16/21

NORTHING: 1,391,236.4  
EASTING: 2,200,446.6  
GS ELEVATION: 804.53  
TOC ELEVATION: 807.15 ft

DEPTH W.L.: 49.94  
ELEVATION W.L.: 757.21  
DATE W.L.: 4/5/2021  
TIME W.L.: 13:37

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			PIEZOMETER DIAGRAM and NOTES	PIEZOMETER CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	PHOTO	REC		
80		67.00 - 87.00 Fresh to slightly weathered, moderately foliated, poorly jointed, dark gray to black, very fine to fine grained, medium strong, feldspar-quartz-biotite GNEISS ( <i>Continued</i> )	BR							<b>WELL CASING</b> Interval: 0-94.7' Material: Schedule 40 PVC Diameter: 2" Joint Type: Flush/Screw  <b>WELL SCREEN</b> Interval: 94.7-104.7' Material: Schedule 40 PVC Diameter: 2" Slot Size: 0.010" End Cap: 104.7-105'  <b>FILTER PACK</b> Interval: 91.5-105' Type: #1 Filter Sand Quantity: 4.5 - 50 lbs bags  <b>FILTER PACK SEAL</b> Interval: 86.5-91.5' Type: 3/8" Uncoated Pel-Plug Quantity: 1 - 5 gallon bucket  <b>ANNULUS SEAL</b> Interval: 0-86.5' Type: AquaGuard Bentonite Grout Quantity: Approximately 160 gallons  <b>WELL COMPLETION</b> Pad: 4'x4'x4" Concrete Protective Casing: 4"x4" Aluminium  <b>DRILLING METHODS</b> Soil Drill: Rotosonic (6 inch casing by 4 inch core barrel) Rock Drill: Rotosonic Sample Type: Rotosonic
85	720				717.5	9		7.00 10.00		
		87.00 - 90.00 Fresh to slightly weathered, poor to moderately foliated, poorly jointed, dark gray to black, medium grained, medium strong, chlorite-epidote-quartz-feldspar-biotite GNEISS	BR		87.00					
90	715				714.5				Bentonite Seal # 1 Filter Sand	
		90.00 - 105.00 Fresh to slightly weathered, foliated, poorly jointed, light gray to dark gray, fine to medium grained, medium strong to strong, feldspar-biotite-quartz GNEISS; locally contains garnets and k-spar augens	BR		90.00					
95	710					10		9.00 10.00		0.010" Slotted Schedule 40 PVC  Sump -
100	705									
						11		4.90 5.00		
105	700	Boring completed at 105.00 ft			699.5					
110	695									
115	690									
120	685									

BOREHOLE RECORD 166849621.GPJ PIEDMONT.GDT 5/24/21

LOG SCALE: 1 in = 5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Tommy Ardito

INSPECTOR: Michael Boatman, PG  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/24/21



# RECORD OF BOREHOLE B-123D

SHEET 1 of 4

PROJECT: SCS Plant McDonough  
PROJECT NUMBER: GL166849621  
DRILLED DEPTH: 160.00 ft  
LOCATION: Smyrna, GA

DRILL RIG: Terra Sonic 150T  
Truck-Mounted Sonic  
DATE STARTED: 3/25/22  
DATE COMPLETED: 4/4/22

NORTHING: 1,391,234.4  
EASTING: 2,202,608.4  
GS ELEVATION: 778.85  
TOC ELEVATION: 781.80 ft

DEPTH W.L.:13.2  
ELEVATION W.L.:765.65  
DATE W.L.:4/4/22  
TIME W.L.:14:55

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	PHOTO	REC		
0		0.00 - 10.00 FILL, CL, SILTY CLAY, moist, micaceous, trace of organics; Air knifed for utility clearance							Aquaguard - Grout	<b>WELL CASING</b> Interval: 0'-110' Material: Schedule 40 PVC Diameter: 2" Joint Type: Threaded  <b>WELL SCREEN</b> Interval: 110'-160' Material: 0.010" Slotted Diameter: 2" Slot Size: 0.010" End Cap: 3"  <b>FILTER PACK</b> Interval: 107.3'-160' Type: Filter Sil - Filtration sand and gravel, industrial quartz Quantity: 16 x 50 lb bag  <b>FILTER PACK SEAL</b> Interval: 62.5'-107.3' Type: Pel Plug Bentonite Pellets / Haliburton Bentonite Chips 3/8" Quantity: 3 x 50 lb bucket, 10 bags chips  <b>ANNULUS SEAL</b> Interval: 0'-55.5' Type: Aquaguard bentonite grout Quantity: 2.5 batches of 2 bags Aquaguard + 40 gal water  <b>WELL COMPLETION</b> Pad: 4' x 4' Protective Casing: Aluminum  <b>DRILLING METHODS</b> Soil Drill: Sonic Rock Drill: Sonic Sample Type: Sonic
775			CL			1		NA		
5								10.00		
770					768.9					
10		10.00 - 20.00 ML-CH, SILT and CLAY, moist, red, orange, brown, some fine sand, trace of fine schist gravel, micaceous			10.00					
765			ML-CH			2		9.75		
15								10.00		
760					758.9					
20		20.00 - 28.00 Same as above			20.00					
755			ML-CH			3		8.50		
25								10.00		
750		28.00 - 30.00 ML, sandy SILT, moist, gray, fine, trace of coarse gravel			750.9					
30			ML		28.00					
		30.00 - 31.50 Same as above			748.9					
			ML		30.00					
		31.50 - 40.00 muscovite biotite SCHIST, fine grained, strong, slightly to moderately weathered, slight, fractured, some iron staining			747.4					
745					31.50					
35						4		9.75		
740								10.00		
40		40.00 - 50.00 muscovite biotite garnet SCHIST, fine to coarse grained, strong, fresh to slightly weathered, slightly fractured, traces iron staining			738.9					
735					40.00					
45						5		7.50		
730								10.00		
50		Log continued on next page			728.9					

BOREHOLE RECORD PLANT MCDONOUGH\_DGWC-121, B-122D, B-123D.GPJ PIEDMONT.GDT 5/13/22

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Corey Franklin

GA INSPECTOR: Connor Mikilitus  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/10/22

**wsp** GOLDER



# RECORD OF BOREHOLE B-123D

SHEET 2 of 4

PROJECT: SCS Plant McDonough  
PROJECT NUMBER: GL166849621  
DRILLED DEPTH: 160.00 ft  
LOCATION: Smyrna, GA

DRILL RIG: Terra Sonic 150T  
Truck-Mounted Sonic  
DATE STARTED: 3/25/22  
DATE COMPLETED: 4/4/22

NORTHING: 1,391,234.4  
EASTING: 2,202,608.4  
GS ELEVATION: 778.85  
TOC ELEVATION: 781.80 ft

DEPTH W.L.:13.2  
ELEVATION W.L.:765.65  
DATE W.L.:4/4/22  
TIME W.L.:14:55

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	PHOTO	REC		
50		50.00 - 60.00 muscovite biotite SCHIST, fine to coarse grained, strong, fresh to slightly weathered, slightly fractured, traces of iron staining			50.00				Pel Plug - Pellets	<b>WELL CASING</b> Interval: 0'-110' Material: Schedule 40 PVC Diameter: 2" Joint Type: Threaded  <b>WELL SCREEN</b> Interval: 110'-160' Material: 0.010" Slotted Diameter: 2" Slot Size: 0.010" End Cap: 3"  <b>FILTER PACK</b> Interval: 107.3'-160' Type: Filter Sil - Filtration sand and gravel, industrial quartz Quantity: 16 x 50 lb bag  <b>FILTER PACK SEAL</b> Interval: 62.5'-107.3' Type: Pel Plug Bentonite Pellets / Haliburton Bentonite Chips 3/8" Quantity: 3 x 50 lb bucket, 10 bags chips  <b>ANNULUS SEAL</b> Interval: 0'-55.5' Type: Aquaguard bentonite grout Quantity: 2.5 batches of 2 bags Aquaguard + 40 gal water  <b>WELL COMPLETION</b> Pad: 4' x 4' Protective Casing: Aluminum  <b>DRILLING METHODS</b> Soil Drill: Sonic Rock Drill: Sonic Sample Type: Sonic
725						6		9.30 10.00		
55									Haliburton Bentonite - Chips 3/8"	
720										
60		60.00 - 70.00 muscovite biotite chlorite SCHIST, fine to coarse grained, strong, fresh, unfractured to slightly fractured, trace of iron staining			718.9 60.00					
715						7		9.50 10.00		
65										
710										
70		70.00 - 80.00 muscovite biotite SCHIST, fine to coarse grained, strong, fresh, unfractured to slightly weathered, slightly fractured, secondary mineralization of fractures, trace of iron staining			708.9 70.00					
705						8		9.50 10.00		
75										
700										
80		80.00 - 90.00 muscovite biotite SCHIST, fine to coarse grained, strong, fresh, unfractured to slightly weathered, slightly fractured, secondary mineralization of fractures, trace of iron staining			698.9 80.00					
695						9		7.50 10.00		
85										
690										
90		90.00 - 100.00 muscovite biotite SCHIST, fine to coarse grained, strong, fresh, fresh to slightly weathered, unfractured to slightly fractured			688.9 90.00					
685						10		8.00 10.00		
95										
680										
100		Log continued on next page			678.9					

BOREHOLE RECORD PLANT MCDONOUGH\_DGWC-121, B-122D, B-123D.GPJ PIEDMONT.GDT 5/13/22

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Corey Franklin

GA INSPECTOR: Connor Mikilitus  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/10/22

wsp GOLDER

# RECORD OF BOREHOLE B-123D


SHEET 3 of 4

PROJECT: SCS Plant McDonough  
PROJECT NUMBER: GL166849621  
DRILLED DEPTH: 160.00 ft  
LOCATION: Smyrna, GA

DRILL RIG: Terra Sonic 150T  
Truck-Mounted Sonic  
DATE STARTED: 3/25/22  
DATE COMPLETED: 4/4/22

NORTHING: 1,391,234.4  
EASTING: 2,202,608.4  
GS ELEVATION: 778.85  
TOC ELEVATION: 781.80 ft

DEPTH W.L.:13.2  
ELEVATION W.L.:765.65  
DATE W.L.:4/4/22  
TIME W.L.:14:55

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE				SAMPLES			MONITORING WELL DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV. DEPTH (ft)	SAMPLE NO.	PHOTO	REC		
100		100.00 - 110.00 muscovite biotite SCHIST, fine to coarse grained, strong, fresh, fresh to slightly weathered, unfractured to slightly fractured			100.00					<b>WELL CASING</b> Interval: 0'-110' Material: Schedule 40 PVC Diameter: 2" Joint Type: Threaded  <b>WELL SCREEN</b> Interval: 110'-160' Material: 0.010" Slotted Diameter: 2" Slot Size: 0.010" End Cap: 3"  <b>FILTER PACK</b> Interval: 107.3'-160' Type: Filter Sil - Filtration sand and gravel, industrial quartz Quantity: 16 x 50 lb bag  <b>FILTER PACK SEAL</b> Interval: 62.5'-107.3' Type: Pel Plug Bentonite Pellets / Haliburton Bentonite Chips 3/8" Quantity: 3 x 50 lb bucket, 10 bags chips  <b>ANNULUS SEAL</b> Interval: 0'-55.5' Type: Aquaguard bentonite grout Quantity: 2.5 batches of 2 bags Aquaguard + 40 gal water  <b>WELL COMPLETION</b> Pad: 4' x 4' Protective Casing: Aluminum  <b>DRILLING METHODS</b> Soil Drill: Sonic Rock Drill: Sonic Sample Type: Sonic
675						11		9.75 10.00		
105										
670										
110		110.00 - 120.00 muscovite Biotite SCHIST, fine to coarse grained, strong, fresh to slightly weathered, slightly fractured, secondary mineralization of fractures with calcite @ 114' bgs, measured -0.018 gallons per minute (gpm) from borehole geophysics heat-pulse flow meter (HPFM), trace vein quartz			668.9 110.00					
665						12		8.25 10.00		
115										
660										
120		120.00 - 130.00 Same as above. Water producing fracture at 129.5' identified using borehole geophysics			658.9 120.00					
655						13		9.75 10.00		
125										
650										
130		130.00 - 140.00 Same as above; Trace secondary mineralization of calcite within fractures @ 131 bgs, water producing fracture at 130.5' identified using borehole geophysics, measured -0.027 gallons per minute (gpm) from HPFM			648.9 130.00					
645						14		9.00 10.00		
135										
640										
140		140.00 - 150.00 muscovite biotite, garnet SCHIST, fine to coarse grained, strong, fresh to slightly weathered, slightly fractured, calcite precipitation @ 145' bgs			638.9 140.00					
635						15		9.00 10.00		
145										
630										
150		Log continued on next page			628.9					

BOREHOLE RECORD PLANT MCDONOUGH\_DGWC-121, B-122D, B-123D.GPJ PIEDMONT.GDT 5/13/22

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Corey Franklin

GA INSPECTOR: Connor Mikilitus  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/10/22

wsp GOLDER

# RECORD OF BOREHOLE B-123D




SHEET 4 of 4

PROJECT: SCS Plant McDonough  
PROJECT NUMBER: GL166849621  
DRILLED DEPTH: 160.00 ft  
LOCATION: Smyrna, GA

DRILL RIG: Terra Sonic 150T  
Truck-Mounted Sonic  
DATE STARTED: 3/25/22  
DATE COMPLETED: 4/4/22

NORTHING: 1,391,234.4  
EASTING: 2,202,608.4  
GS ELEVATION: 778.85  
TOC ELEVATION: 781.80 ft

DEPTH W.L.:13.2  
ELEVATION W.L.:765.65  
DATE W.L.:4/4/22  
TIME W.L.:14:55

DEPTH (ft)	ELEVATION (ft)	SOIL PROFILE			SAMPLES			MONITORING WELL DIAGRAM and NOTES	WELL CONSTRUCTION DETAILS	
		DESCRIPTION	USCS	GRAPHIC LOG	ELEV.	SAMPLE NO.	PHOTO			REC
					DEPTH (ft)					
150		150.00 - 160.00 Same as above; calcite @ 157.5' bgs			150.00					<b>WELL CASING</b> Interval: 0'-110' Material: Schedule 40 PVC Diameter: 2" Joint Type: Threaded  <b>WELL SCREEN</b> Interval: 110'-160' Material: 0.010" Slotted Diameter: 2" Slot Size: 0.010" End Cap: 3"  <b>FILTER PACK</b> Interval: 107.3'-160' Type: Filter Sil - Filtration sand and gravel, industrial quartz Quantity: 16 x 50 lb bag  <b>FILTER PACK SEAL</b> Interval: 62.5'-107.3' Type: Pel Plug Bentonite Pellets / Haliburton Bentonite Chips 3/8" Quantity: 3 x 50 lb bucket, 10 bags chips  <b>ANNULUS SEAL</b> Interval: 0'-55.5' Type: Aquaguard bentonite grout Quantity: 2.5 batches of 2 bags Aquaguard + 40 gal water  <b>WELL COMPLETION</b> Pad: 4' x 4' Protective Casing: Aluminum  <b>DRILLING METHODS</b> Soil Drill: Sonic Rock Drill: Sonic Sample Type: Sonic
625						16		9.75 10.00		
155										
620										
160		Boring completed at 160.00 ft			618.9					
615										
165										
610										
170										
605										
175										
600										
180										
595										
185										
590										
190										
585										
195										
580										
200										

BOREHOLE RECORD PLANT MCDONOUGH\_DGWC-121, B-122D, B-123D.GPJ, PIEDMONT.GDT 5/13/22

LOG SCALE: 1 in = 6.5 ft  
DRILLING COMPANY: Cascade Drilling  
DRILLER: Corey Franklin

GA INSPECTOR: Connor Mikilitus  
CHECKED BY: Rachel Kirkman, PG  
DATE: 5/10/22



## DRILLER BONDS



**CLIENT'S COPY**

**SURETY BOND CONTINUATION CERTIFICATE**

TO: State of Georgia  
Division of Environmental Protection  
2 Martin Luther King Jr. Drive SE  
Suite 1252  
Atlanta, GA 30334

To be attached to and form a part of: Performance Bond for Well Contractors and Drillers

Principal on the Bond: Michael C. Rice/Cascade Drilling, L.P.

Surety Bond Number: K08315607

Bond Amount: Twenty Thousand and 00/100 Dollars ( \$20,000.00)

In consideration of the agreed premium charged for this bond, it is understood and agreed that the following change shall be made to this obligation:

**[ x ] CONTINUATION CERTIFICATE**

This certificate extends the life of the bond to June 30, 2017. It is executed upon the express condition that the surety's liability under said bond, together with this and all previous continuation certificates, shall not be cumulative and shall in no event exceed the amount specifically set forth in said bond or any existing certificate changing the amount of said bond.

Signed, sealed and dated this 26th day of May , 2015 .

Westchester Fire Insurance Company

By: Katie S

Katie Snider, Attorney-in-Fact

Surety of Record: Westchester Fire Insurance Company  
436 Walnut Street  
Philadelphia, PA 19106  
Phone: (415) 547-4513

Agent of Record: Kibble & Prentice, a USI Company  
601 Union Street, Suite 1000  
Seattle, WA 98101  
Phone: (206) 441-6300



# Power of Attorney

## WESTCHESTER FIRE INSURANCE COMPANY

Know all men by these presents: That WESTCHESTER FIRE INSURANCE COMPANY, a corporation of the Commonwealth of Pennsylvania pursuant to the following Resolution, adopted by the Board of Directors of the said Company on December 11, 2006, to wit:

"RESOLVED, that the following authorizations relate to the execution, for and on behalf of the Company, of bonds, undertakings, recognizances, contracts and other written commitments of the Company entered into the ordinary course of business (each a "Written Commitment"):

- (1) Each of the Chairman, the President and the Vice Presidents of the Company is hereby authorized to execute any Written Commitment for and on behalf of the Company, under the seal of the Company or otherwise.
- (2) Each duly appointed attorney-in-fact of the Company is hereby authorized to execute any Written Commitment for and on behalf of the Company, under the seal of the Company or otherwise, to the extent that such action is authorized by the grant of powers provided for in such persons written appointment as such attorney-in-fact.
- (3) Each of the Chairman, the President and the Vice Presidents of the Company is hereby authorized, for and on behalf of the Company, to appoint in writing any person the attorney-in-fact of the Company with full power and authority to execute, for and on behalf of the Company, under the seal of the Company or otherwise, such Written Commitments of the Company as may be specified in such written appointment, which specification may be by general type or class of Written Commitments or by specification of one or more particular Written Commitments.
- (4) Each of the Chairman, the President and Vice Presidents of the Company is hereby authorized, for and on behalf of the Company, to delegate in writing any other officer of the Company the authority to execute, for and on behalf of the Company, under the Company's seal or otherwise, such Written Commitments of the Company as are specified in such written delegation, which specification may be by general type or class of Written Commitments or by specification of one or more particular Written Commitments.
- (5) The signature of any officer or other person executing any Written Commitment or appointment or delegation pursuant to this Resolution, and the seal of the Company, may be affixed by facsimile on such Written Commitment or written appointment or delegation.

FURTHER RESOLVED, that the foregoing Resolution shall not be deemed to be an exclusive statement of the powers and authority of officers, employees and other persons to act for and on behalf of the Company, and such Resolution shall not limit or otherwise affect the exercise of any such power or authority otherwise validly granted or vested.

Does hereby nominate, constitute and appoint Heather Allen, Holly E Ulfers, Katie Snider, Nancy N Hill, Roxana Palacios, Steven W Palmer, all of the City of SEATTLE, Washington, each individually if there be more than one named, its true and lawful attorney-in-fact, to make, execute, seal and deliver on its behalf, and as its act and deed any and all bonds, undertakings, recognizances, contracts and other writings in the nature thereof in penalties not exceeding Fifteen million dollars & zero cents (\$15,000,000.00) and the execution of such writings in pursuance of these presents shall be as binding upon said Company, as fully and amply as if they had been duly executed and acknowledged by the regularly elected officers of the Company at its principal office,

IN WITNESS WHEREOF, the said Stephen M. Haney, Vice-President, has hereunto subscribed his name and affixed the Corporate seal of the said WESTCHESTER FIRE INSURANCE COMPANY this 22 day of December 2014.

WESTCHESTER FIRE INSURANCE COMPANY



Stephen M. Haney, Vice President

COMMONWEALTH OF PENNSYLVANIA  
COUNTY OF PHILADELPHIA ss.

On this 22 day of December, AD. 2014 before me, a Notary Public of the Commonwealth of Pennsylvania in and for the County of Philadelphia came Stephen M. Haney, Vice-President of the WESTCHESTER FIRE INSURANCE COMPANY to me personally known to be the individual and officer who executed the preceding instrument, and he acknowledged that he executed the same, and that the seal affixed to the preceding instrument is the corporate seal of said Company; that the said corporate seal and his signature were duly affixed by the authority and direction of the said corporation, and that Resolution, adopted by the Board of Directors of said Company, referred to in the preceding instrument, is now in force.

IN TESTIMONY WHEREOF, I have hereunto set my hand and affixed my official seal at the City of Philadelphia the day and year first above written.



COMMONWEALTH OF PENNSYLVANIA  
NOTARIAL SEAL  
KAREN E. BRANDT, Notary Public  
City of Philadelphia, Phila. County  
My Commission Expires Sept. 26, 2018

Notary Public

I, the undersigned Assistant Secretary of the WESTCHESTER FIRE INSURANCE COMPANY, do hereby certify that the original POWER OF ATTORNEY, of which the foregoing is a substantially true and correct copy, is in full force and effect.

In witness whereof, I have hereunto subscribed my name as Assistant Secretary, and affixed the corporate seal of the Corporation, this 26<sup>th</sup> day of May, 2015.



William L. Kelly, Assistant Secretary

THIS POWER OF ATTORNEY MAY NOT BE USED TO EXECUTE ANY BOND WITH AN INCEPTION DATE AFTER December 22, 2016.





CONTINUATION  
CERTIFICATE

SAFECO Insurance Company of America

, Surety upon

a certain Bond No. 4993104

dated effective June 30, 1987  
(MONTH-DAY-YEAR)

on behalf of Southern Company Services, Inc.  
(PRINCIPAL)

and in favor of Georgia - Dept. of Natural Resources  
(OBLIGEE)

does hereby continue said bond in force for the further period

beginning on June 30, 2016  
(MONTH-DAY-YEAR)

and ending on June 30, 2017  
(MONTH-DAY-YEAR)

Amount of bond \$10,000.00

Description of bond Water Well Contractors & Drillers

**PROVIDED:** That this continuation certificate does not create a new obligation and is executed upon the express condition and provision that the Surety's liability under said bond and this and all Continuation Certificates issued in connection therewith shall not be cumulative and that the said Surety's aggregate liability under said bond and this and all such Continuation Certificates on account of all defaults committed during the period (regardless of the number of years) said bond had been and shall be in force, shall not in any event exceed the amount of said bond as hereinbefore set forth.

Signed and dated on April 07, 2016  
(MONTH-DAY-YEAR)

SAFECO Insurance Company of America

By 

D-Ann Kleidosty, Attorney-in-Fact

**THIS POWER OF ATTORNEY IS NOT VALID UNLESS IT IS PRINTED ON RED BACKGROUND.**

This Power of Attorney limits the acts of those named herein, and they have no authority to bind the Company except in the manner and to the extent herein stated.

Certificate No. 7310252

First National Insurance Company of America  
General Insurance Company of America  
Safeco Insurance Company of America

**POWER OF ATTORNEY**

KNOWN ALL PERSONS BY THESE PRESENTS: That First National Insurance Company of America, General Insurance Company of America, and Safeco Insurance Company of America are corporations duly organized under the laws of the State of New Hampshire (herein collectively called the "Companies"), pursuant to and by authority herein set forth, does hereby name, constitute and appoint, Brooke A. Sharp; Christine Doczy; D-Ann Kleidosty; Gary D. Eklund; Sharon J. Potts; Sylvia M. Ogle; William G. Moody

all of the city of Atlanta, state of GA each individually if there be more than one named, its true and lawful attorney-in-fact to make, execute, seal, acknowledge and deliver, for and on its behalf as surety and as its act and deed, any and all undertakings, bonds, recognizances and other surety obligations, in pursuance of these presents and shall be as binding upon the Companies as if they have been duly signed by the president and attested by the secretary of the Companies in their own proper persons.

IN WITNESS WHEREOF, this Power of Attorney has been subscribed by an authorized officer or official of the Companies and the corporate seals of the Companies have been affixed thereto this 1st day of April, 2016.



First National Insurance Company of America  
General Insurance Company of America  
Safeco Insurance Company of America

By: David M. Carey  
David M. Carey, Assistant Secretary

STATE OF PENNSYLVANIA ss  
COUNTY OF MONTGOMERY

On this 1st day of April, 2016, before me personally appeared David M. Carey, who acknowledged himself to be the Assistant Secretary of First National Insurance Company of America, General Insurance Company of America, and Safeco Insurance Company of America, and that he, as such, being authorized so to do, execute the foregoing instrument for the purposes therein contained by signing on behalf of the corporations by himself as a duly authorized officer.

IN WITNESS WHEREOF, I have hereunto subscribed my name and affixed my notarial seal at Plymouth Meeting, Pennsylvania, on the day and year first above written.



COMMONWEALTH OF PENNSYLVANIA  
Notarial Seal  
Teresa Pastella, Notary Public  
Plymouth Twp., Montgomery County  
My Commission Expires March 28, 2017  
Member, Pennsylvania Association of Notaries

By: Teresa Pastella  
Teresa Pastella, Notary Public

This Power of Attorney is made and executed pursuant to and by authority of the following By-law and Authorizations of First National Insurance Company of America, General Insurance Company of America, and Safeco Insurance Company of America, which are now in full force and effect reading as follows:

**ARTICLE IV - OFFICERS** - Section 12. Power of Attorney. Any officer or other official of the Corporation authorized for that purpose in writing by the Chairman or the President, and subject to such limitation as the Chairman or the President may prescribe, shall appoint such attorneys-in-fact, as may be necessary to act in behalf of the Corporation to make, execute, seal, acknowledge and deliver as surety any and all undertakings, bonds, recognizances and other surety obligations. Such attorneys-in-fact, subject to the limitations set forth in their respective powers of attorney, shall have full power to bind the Corporation by their signature and executed, such instruments shall be as binding as if signed by the President and attested to by the Secretary. Any power or authority granted to any representative or attorney-in-fact under the provisions of this article may be revoked at any time by the Board, the Chairman, the President or by the officer or officers granting such power or authority.

**Certificate of Designation** - The President of the Company, acting pursuant to the Bylaws of the Company, authorizes David M. Carey, Assistant Secretary to appoint such attorneys-in-fact as may be necessary to act on behalf of the Company to make, execute, seal, acknowledge and deliver as surety any and all undertakings, bonds, recognizances and other surety obligations.

**Authorization** - By unanimous consent of the Company's Board of Directors, the Company consents that facsimile or mechanically reproduced signature of any assistant secretary of the Company, wherever appearing upon a certified copy of any power of attorney issued by the Company in connection with surety bonds, shall be valid and binding upon the Company with the same force and effect as though manually affixed.

I, Gregory W. Davenport, the undersigned, Assistant Secretary, of First National Insurance Company of America, General Insurance Company of America, and Safeco Insurance Company of America do hereby certify that the original power of attorney of which the foregoing is a full, true and correct copy of the Power of Attorney executed by said Companies, is in full force and effect and has not been revoked.

IN TESTIMONY WHEREOF, I have hereunto set my hand and affixed the seals of said Companies this 7th day of April, 2016.



By: Gregory W. Davenport  
Gregory W. Davenport, Assistant Secretary



CONTINUATION  
CERTIFICATE

SAFECO Insurance Company of America

, Surety upon

a certain Bond No. 4993104

dated effective June 30, 1987  
(MONTH-DAY-YEAR)

on behalf of Southern Company Services, Inc.  
(PRINCIPAL)

and in favor of Georgia - Dept. of Natural Resources  
(OBLIGEE)

does hereby continue said bond in force for the further period

beginning on June 30, 2016  
(MONTH-DAY-YEAR)

and ending on June 30, 2017  
(MONTH-DAY-YEAR)

Amount of bond \$10,000.00

Description of bond Water Well Contractors & Drillers

**PROVIDED:** That this continuation certificate does not create a new obligation and is executed upon the express condition and provision that the Surety's liability under said bond and this and all Continuation Certificates issued in connection therewith shall not be cumulative and that the said Surety's aggregate liability under said bond and this and all such Continuation Certificates on account of all defaults committed during the period (regardless of the number of years) said bond had been and shall be in force, shall not in any event exceed the amount of said bond as hereinbefore set forth.

Signed and dated on April 07, 2016  
(MONTH-DAY-YEAR)

SAFECO Insurance Company of America

By 

D-Ann Kleidosty, Attorney-in-Fact

**THIS POWER OF ATTORNEY IS NOT VALID UNLESS IT IS PRINTED ON RED BACKGROUND.**

This Power of Attorney limits the acts of those named herein, and they have no authority to bind the Company except in the manner and to the extent herein stated.

Certificate No. 7310252

First National Insurance Company of America  
General Insurance Company of America  
Safeco Insurance Company of America

**POWER OF ATTORNEY**

KNOWN ALL PERSONS BY THESE PRESENTS: That First National Insurance Company of America, General Insurance Company of America, and Safeco Insurance Company of America are corporations duly organized under the laws of the State of New Hampshire (herein collectively called the "Companies"), pursuant to and by authority herein set forth, does hereby name, constitute and appoint, Brooke A. Sharp; Christine Doczy; D-Ann Kleidosty; Gary D. Eklund; Sharon J. Potts; Sylvia M. Ogle; William G. Moody

all of the city of Atlanta, state of GA each individually if there be more than one named, its true and lawful attorney-in-fact to make, execute, seal, acknowledge and deliver, for and on its behalf as surety and as its act and deed, any and all undertakings, bonds, recognizances and other surety obligations, in pursuance of these presents and shall be as binding upon the Companies as if they have been duly signed by the president and attested by the secretary of the Companies in their own proper persons.

IN WITNESS WHEREOF, this Power of Attorney has been subscribed by an authorized officer or official of the Companies and the corporate seals of the Companies have been affixed thereto this 1st day of April, 2016.



First National Insurance Company of America  
General Insurance Company of America  
Safeco Insurance Company of America

By: David M. Carey  
David M. Carey, Assistant Secretary

STATE OF PENNSYLVANIA ss  
COUNTY OF MONTGOMERY

On this 1st day of April, 2016, before me personally appeared David M. Carey, who acknowledged himself to be the Assistant Secretary of First National Insurance Company of America, General Insurance Company of America, and Safeco Insurance Company of America, and that he, as such, being authorized so to do, execute the foregoing instrument for the purposes therein contained by signing on behalf of the corporations by himself as a duly authorized officer.

IN WITNESS WHEREOF, I have hereunto subscribed my name and affixed my notarial seal at Plymouth Meeting, Pennsylvania, on the day and year first above written.



COMMONWEALTH OF PENNSYLVANIA  
Notarial Seal  
Teresa Pastella, Notary Public  
Plymouth Twp., Montgomery County  
My Commission Expires March 28, 2017  
Member, Pennsylvania Association of Notaries

By: Teresa Pastella  
Teresa Pastella, Notary Public

This Power of Attorney is made and executed pursuant to and by authority of the following By-law and Authorizations of First National Insurance Company of America, General Insurance Company of America, and Safeco Insurance Company of America, which are now in full force and effect reading as follows:

**ARTICLE IV - OFFICERS** - Section 12. Power of Attorney. Any officer or other official of the Corporation authorized for that purpose in writing by the Chairman or the President, and subject to such limitation as the Chairman or the President may prescribe, shall appoint such attorneys-in-fact, as may be necessary to act in behalf of the Corporation to make, execute, seal, acknowledge and deliver as surety any and all undertakings, bonds, recognizances and other surety obligations. Such attorneys-in-fact, subject to the limitations set forth in their respective powers of attorney, shall have full power to bind the Corporation by their signature and executed, such instruments shall be as binding as if signed by the President and attested to by the Secretary. Any power or authority granted to any representative or attorney-in-fact under the provisions of this article may be revoked at any time by the Board, the Chairman, the President or by the officer or officers granting such power or authority.

**Certificate of Designation** - The President of the Company, acting pursuant to the Bylaws of the Company, authorizes David M. Carey, Assistant Secretary to appoint such attorneys-in-fact as may be necessary to act on behalf of the Company to make, execute, seal, acknowledge and deliver as surety any and all undertakings, bonds, recognizances and other surety obligations.

**Authorization** - By unanimous consent of the Company's Board of Directors, the Company consents that facsimile or mechanically reproduced signature of any assistant secretary of the Company, wherever appearing upon a certified copy of any power of attorney issued by the Company in connection with surety bonds, shall be valid and binding upon the Company with the same force and effect as though manually affixed.

I, Gregory W. Davenport, the undersigned, Assistant Secretary, of First National Insurance Company of America, General Insurance Company of America, and Safeco Insurance Company of America do hereby certify that the original power of attorney of which the foregoing is a full, true and correct copy of the Power of Attorney executed by said Companies, is in full force and effect and has not been revoked.

IN TESTIMONY WHEREOF, I have hereunto set my hand and affixed the seals of said Companies this 7th day of April, 2016.



By: Gregory W. Davenport  
Gregory W. Davenport, Assistant Secretary

Not valid for mortgage, note, loan, letter of credit,  
currency rate, interest rate or residual value guarantees.

To confirm the validity of this Power of Attorney call  
1-610-832-8240 between 9:00 am and 4:30 pm EST on any business day.

GENERAL PURPOSE RIDER

To be attached to and form part of Bond Number 09157828 effective June 30, 2015 issued by the Fidelity and Deposit Company of Maryland in the amount of Twenty Thousand and No/100 (\$20,000.00), on behalf of Craig Penton dba Terracon Consultants, Inc. as Principal, and in favor of Director of the Environmental Protection Division, Department of Natural Resources, State of Georgia as Obligee:

NOW Therefore, it is agreed that:

**The expiration date of the bond is hereby amended to:**

**June 30, 2017**

It is further understood and agreed that all other terms and conditions of this bond shall remain unchanged.

This rider is to be effective the 30th day of June , 2015 .

Signed, sealed and dated this 4th day of November , 2015 .

Craig Penton dba Terracon Consultants, Inc.  
Principal

\_\_\_\_\_

Fidelity and Deposit Company of Maryland  
Surety

\_\_\_\_\_

Christy M. Braile, Attorney-in-Fact

6/4/14 sent to  
Craig Penton  
(Stacy Adams)

FOR YOUR RECORDS

Bond Number 09157828

**Performance Bond For Water Well Contractors And Drillers**

Name of Water Well Contractor or Driller Craig Penton dba Terracon Consultants, Inc.

Know All Men By These Present

That we Craig Penton dba Terracon Consultants, Inc. AND ANY AND ALL EMPLOYEES, OFFICERS AND PARTNERS, as Principal, and Fidelity and Deposit Company of Maryland as Surety, are held and firmly bound unto the Director of the Environmental Protection Division (Director), Department of Natural Resources, State of Georgia and his or her Successor or Successors in office, as Obligee, in the full sum of **TWENTY THOUSAND AND NO/00 DOLLARS (\$20,000.00)** for the payment of which will and truly to be made, we bind ourselves, our heir, administrators, successors and assigns, jointly and severally, by the present.

WHEREAS, the WATER WELL STANDARDS ACT OF 1985 (Ga. Laws 1985, p. 1192) (the "ACT") requires that water well contractors and drillers file performance bonds with the director to ensure compliance with the ACT; and WHEREAS the above bound PRINCIPAL is subject to the terms and provisions of said ACT. NOW, THEREFORE, the conditions of this obligation are such that if the above bound PRINCIPAL shall fully and faithfully perform the duties and in all things comply with the procedures and standards set forth in the ACT as now and hereafter amended, and the rules and regulations promulgated pursuant thereto, including but not limited to the correction of any violation of such procedures and standards upon discovery, irrespective of whether such discovery is made before completion of any well subject to this bond, then this obligation shall be void; otherwise of full force and effect.

And Surety, for value received, agrees that no amendment to existing laws, rules or regulations, or adoption of new laws, rules or regulations shall in anyway discharge its obligation on this bond, and does hereby waive notice of any such amendment, adoption or modification.

This bond shall be effective from date of issuance and shall continue in effect until terminated by expiration, mutual agreement or cancellation upon sixty (60) days written notice to Principal and Obligee; provided that the rights of the obligee and beneficiaries under this bond which arose prior to such termination shall continue.

The bond is effective June 4, 2014 and unless sooner terminated, this bond shall terminate June 30, 2015. In Witness Whereof the Principal and Surety have caused these present to be duly signed and sealed, this 4th day of, June 20 14.

PRINCIPAL, BY \_\_\_\_\_ (L.S.) TITLE: \_\_\_\_\_

SURETY BY: Christy M. McCart, Attorney-in-Fact

GEORGIA REGISTERED AGENT N/A SEAL: \_\_\_\_\_

Revised December 2012

**COPY**

CONTINUATION  
CERTIFICATE

Atlantic Specialty Insurance Company

, Surety upon

a certain Bond No. **800031223**

dated effective June 30, 2017  
(MONTH-DAY-YEAR)

on behalf of Michael C. Rice and Cascade Drilling, L.P., any and all employees, officers and partners  
(PRINCIPAL)

and in favor of State of Georgia  
(OBLIGEE)

does hereby continue said bond in force for the further period

beginning on June 30, 2019  
(MONTH-DAY-YEAR)

and ending on June 30, 2021  
(MONTH-DAY-YEAR)

Amount of bond Thirty Thousand and Zero/100 (\$30,000.00)

Description of bond Water Well Contractor Performance Bond

Premium: \$1,200.00

**PROVIDED:** That this continuation certificate does not create a new obligation and is executed upon the express condition and provision that the Surety's liability under said bond and this and all Continuation Certificates issued in connection therewith shall not be cumulative and that the said Surety's aggregate liability under said bond and this and all such Continuation Certificates on account of all defaults committed during the period (regardless of the number of years) said bond had been and shall be in force, shall not in any event exceed the amount of said bond as hereinbefore set forth.

Signed and dated on May 9, 2019  
(MONTH-DAY-YEAR)  
Atlantic Specialty Insurance Company

By  
Attorney-in-Fact Elizabeth R. Hahn

Parker, Smith & Feek, Inc.  
Agent

2233 112th Ave NE Bellevue, WA 98004  
Address of Agent

(425) 709-3600  
Telephone Number of Agent

## Power of Attorney

KNOW ALL MEN BY THESE PRESENTS, that ATLANTIC SPECIALTY INSURANCE COMPANY, a New York corporation with its principal office in Plymouth, Minnesota, does hereby constitute and appoint: **Deanna M. French, Susan B. Larson, Elizabeth R. Hahn, Jana M. Roy, Scott McGilvray, Mindee L. Rankin, Ronald J. Lange, John R. Claeys, Roger Kaltenbach, Guy Armfield, Scott Fisher, Andrew P. Larsen, Nicholas Fredrickson**, each individually if there be more than one named, its true and lawful Attorney-in-Fact, to make, execute, seal and deliver, for and on its behalf as surety, any and all bonds, recognizances, contracts of indemnity, and all other writings obligatory in the nature thereof; provided that no bond or undertaking executed under this authority shall exceed in amount the sum of: **sixty million dollars (\$60,000,000)** and the execution of such bonds, recognizances, contracts of indemnity, and all other writings obligatory in the nature thereof in pursuance of these presents, shall be as binding upon said Company as if they had been fully signed by an authorized officer of the Company and sealed with the Company seal. This Power of Attorney is made and executed by authority of the following resolutions adopted by the Board of Directors of ATLANTIC SPECIALTY INSURANCE COMPANY on the

Resolved: That the President, any Senior Vice President or Vice-President (each an "Authorized Officer") may execute for and in behalf of the Company any and all bonds, recognizances, contracts of indemnity, and all other writings obligatory in the nature thereof, and affix the seal of the Company thereto; and that the Authorized Officer may appoint and authorize an Attorney-in-Fact to execute on behalf of the Company any and all such instruments and to affix the Company seal thereto; and that the Authorized Officer may at any time remove any such Attorney-in-Fact and revoke all power and authority given to any such Attorney-in-Fact.

Resolved: That the Attorney-in-Fact may be given full power and authority to execute for and in the name and on behalf of the Company any and all bonds, recognizances, contracts of indemnity, and all other writings obligatory in the nature thereof, and any such instrument executed by any such Attorney-in-Fact shall be as binding upon the Company as if signed and sealed by an Authorized Officer and, further, the Attorney-in-Fact is hereby authorized to verify any affidavit required to be attached to bonds, recognizances, contracts of indemnity, and all other writings obligatory in the nature thereof.

This power of attorney is signed and sealed by facsimile under the authority of the following Resolution adopted by the Board of Directors of ATLANTIC SPECIALTY INSURANCE COMPANY on the twenty-fifth day of September, 2012:

Resolved: That the signature of an Authorized Officer, the signature of the Secretary or the Assistant Secretary, and the Company seal may be affixed by facsimile to any power of attorney or to any certificate relating thereto appointing an Attorney-in-Fact for purposes only of executing and sealing any bond, undertaking, recognizance or other written obligation in the nature thereof, and any such signature and seal where so used, being hereby adopted by the Company as the original signature of such officer and the original seal of the Company, to be valid and binding upon the Company with the same force and effect as though manually affixed.

IN WITNESS WHEREOF, ATLANTIC SPECIALTY INSURANCE COMPANY has caused these presents to be signed by an Authorized Officer and the seal of the Company to be affixed this twenty-sixth day of October, 2017.

STATE OF MINNESOTA  
HENNEPIN COUNTY

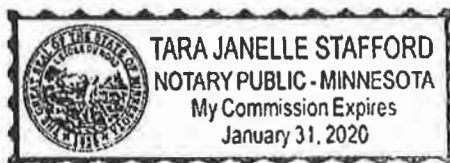


By



Paul J. Brehm, Senior Vice President

On this twenty-sixth day of October, 2017, before me personally came Paul J. Brehm, Senior Vice President of ATLANTIC SPECIALTY INSURANCE COMPANY, to me personally known to be the individual and officer described in and who executed the preceding instrument, and he acknowledged the execution of the same, and being by me duly sworn, that he is the said officer of the Company aforesaid, and that the seal affixed to the preceding instrument is the seal of said Company and that the said seal and the signature as such officer was duly affixed and subscribed to the said instrument by the authority and at the direction of the Company.




Notary Public

I, the undersigned, Secretary of ATLANTIC SPECIALTY INSURANCE COMPANY, a New York Corporation, do hereby certify that the foregoing power of attorney is in full force and has not been revoked, and the resolutions set forth above are now in force.

Signed and sealed. Dated 9 day of May, 2019

This Power of Attorney expires  
October 1, 2019



Christopher V. Jerry, Secretary

CONTINUATION  
CERTIFICATE

SAFECO Insurance Company of America

, Surety upon

a certain Bond No. **4993104**

dated effective June 30, 1987  
(MONTH-DAY-YEAR)

on behalf of Southern Company Services, Inc.  
(PRINCIPAL)

and in favor of Georgia Department of Natural Resources, Environmental Protection Division  
(OBLIGEE)

does hereby continue said bond in force for the further period

beginning on June 30, 2021  
(MONTH-DAY-YEAR)

and ending on June 30, 2022  
(MONTH-DAY-YEAR)

Amount of bond Fifteen Thousand Dollars and 00/100 (\$15,000.00)

Description of bond Water Well Contractors & Drillers

Premium: \$100.00

**PROVIDED:** That this continuation certificate does not create a new obligation and is executed upon the express condition and provision that the Surety's liability under said bond and this and all Continuation Certificates issued in connection therewith shall not be cumulative and that the said Surety's aggregate liability under said bond and this and all such Continuation Certificates on account of all defaults committed during the period (regardless of the number of years) said bond had been and shall be in force, shall not in any event exceed the amount of said bond as hereinbefore set forth.

Signed and dated on 05/06/2021  
(MONTH-DAY-YEAR)  
SAFECO Insurance Company of America  
175 Berkeley Street, Boston, MA 02116

By   
Attorney-in-Fact Jeffrey M. Wilson, Attorney-in-Fact

McGriff Insurance Services, Inc.  
Agent

2211 7th Avenue South, Birmingham, AL 35233  
Address of Agent

(205) 252-9871  
Telephone Number of Agent





This Power of Attorney limits the acts of those named herein, and they have no authority to bind the Company except in the manner and to the extent herein stated.

American States Insurance Company  
First National Insurance Company of America  
General Insurance Company of America  
Safeco Insurance Company of America

Certificate No: **8205019-016032**


## POWER OF ATTORNEY

**KNOWN ALL PERSONS BY THESE PRESENTS:** That American States Insurance Company is a corporation duly organized under the laws of the State of Indiana, that First National Insurance Company of America, General Insurance Company of America, and Safeco Insurance Company of America are corporations duly organized under the laws of the State of New Hampshire (herein collectively called the "Companies"), pursuant to and by authority herein set forth, does hereby name, constitute and appoint, Alisa B. Ferris; Anna Childress; Jeffrey M. Wilson; Mark W. Edwards II; Richard H. Mitchell; Robert R. Freel; Sam Audia; William M. Smith

all of the city of Birmingham state of AL each individually if there be more than one named, its true and lawful attorney-in-fact to make, execute, seal, acknowledge and deliver, for and on its behalf as surety and as its act and deed, any and all undertakings, bonds, recognizances and other surety obligations, in pursuance of these presents and shall be as binding upon the Companies as if they have been duly signed by the president and attested by the secretary of the Companies in their own proper persons.

**IN WITNESS WHEREOF**, this Power of Attorney has been subscribed by an authorized officer or official of the Companies and the corporate seals of the Companies have been affixed thereto this 11th day of March, 2021.

American States Insurance Company  
First National Insurance Company of America  
General Insurance Company of America  
Safeco Insurance Company of America

By:   
David M. Carey, Assistant Secretary




State of PENNSYLVANIA ss  
County of MONTGOMERY

On this 11th day of March, 2021 before me personally appeared David M. Carey, who acknowledged himself to be the Assistant Secretary of American States Insurance Company, First National Insurance Company of America, General Insurance Company of America, and Safeco Insurance Company of America, and that he, as such, being authorized so to do, execute the foregoing instrument for the purposes therein contained by signing on behalf of the corporations by himself as a duly authorized officer.

**IN WITNESS WHEREOF**, I have hereunto subscribed my name and affixed my notarial seal at King of Prussia, Pennsylvania, on the day and year first above written.



Commonwealth of Pennsylvania - Notary Seal  
Teresa Pastella, Notary Public  
Montgomery County  
My commission expires March 28, 2025  
Commission number 1126044  
Member, Pennsylvania Association of Notaries

By:   
Teresa Pastella, Notary Public

This Power of Attorney is made and executed pursuant to and by authority of the following By-law and Authorizations of American States Insurance Company, First National Insurance Company of America, General Insurance Company of America, and Safeco Insurance Company of America, which are now in full force and effect reading as follows:

### ARTICLE IV - OFFICERS: Section 12. Power of Attorney.

Any officer or other official of the Corporation authorized for that purpose in writing by the Chairman or the President, and subject to such limitation as the Chairman or the President may prescribe, shall appoint such attorneys-in-fact, as may be necessary to act in behalf of the Corporation to make, execute, seal, acknowledge and deliver as surety any and all undertakings, bonds, recognizances and other surety obligations. Such attorney-in-fact, subject to the limitations set forth in their respective powers of attorney, shall have full power to bind the Corporation by their signature and executed, such instruments shall be as binding as if signed by the President and attested to by the Secretary. Any power or authority granted to any representative or attorney-in-fact under the provisions of this article may be revoked at any time by the Board, the Chairman, the President or by the officer or officers granting such power or authority.

**Certificate of Designation** - The President of the Company, acting pursuant to the Bylaws of the Company, authorizes David M. Carey, Assistant Secretary to appoint such attorneys-in-fact as may be necessary to act on behalf of the Company to make, execute, seal, acknowledge and deliver as surety any and all undertakings, bonds, recognizances and other surety obligations.

**Authorization** - By unanimous consent of the Company's Board of Directors, the Company consents that facsimile or mechanically reproduced signature of any assistant secretary of the Company, wherever appearing upon a certified copy of any power of attorney issued by the Company in connection with surety bonds, shall be valid and binding upon the Company with the same force and effect as though manually affixed.

I, Renee C. Llewellyn, the undersigned, Assistant Secretary, of American States Insurance Company, First National Insurance Company of America, General Insurance Company of America, and Safeco Insurance Company of America do hereby certify that the original power of attorney of which the foregoing is a full, true and correct copy of the Power of Attorney executed by said Companies, is in full force and effect and has not been revoked.

**IN TESTIMONY WHEREOF**, I have hereunto set my hand and affixed the seals of said Companies this 6th day of May, 2021.



By:   
Renee C. Llewellyn, Assistant Secretary

Not valid for mortgage, note, loan, letter of credit, currency rate, interest rate or residual value guarantees.

For bond and/or Power of Attorney (POA) verification inquiries, please call 610-832-8240 or email HOSUR@libertymutual.com.

CONTINUATION  
CERTIFICATE

SAFECO Insurance Company of America

, Surety upon

a certain Bond No. **4993104**

dated effective June 30, 1987  
(MONTH-DAY-YEAR)

on behalf of Southern Company Services, Inc.  
(PRINCIPAL)

and in favor of Georgia Department of Natural Resources, Environmental Protection Division  
(OBLIGEE)

does hereby continue said bond in force for the further period

beginning on June 30, 2022  
(MONTH-DAY-YEAR)

and ending on June 30, 2023  
(MONTH-DAY-YEAR)

Amount of bond Fifteen Thousand Dollars and 00/100 (\$15,000.00)

Description of bond Water Well Contractors & Drillers

Premium: \$100.00

**PROVIDED:** That this continuation certificate does not create a new obligation and is executed upon the express condition and provision that the Surety's liability under said bond and this and all Continuation Certificates issued in connection therewith shall not be cumulative and that the said Surety's aggregate liability under said bond and this and all such Continuation Certificates on account of all defaults committed during the period (regardless of the number of years) said bond had been and shall be in force, shall not in any event exceed the amount of said bond as hereinbefore set forth.

Signed and dated on 05/06/2021  
(MONTH-DAY-YEAR)

SAFECO Insurance Company of America

175 Berkeley Street, Boston, MA 02116

By

Jeffrey M. Wilson, Attorney-in-Fact

McGriff Insurance Services, Inc.

Agent

2211 7th Avenue South, Birmingham, AL 35233

Address of Agent

(205) 252-9871

Telephone Number of Agent



This Power of Attorney limits the acts of those named herein, and they have no authority to bind the Company except in the manner and to the extent herein stated.

American States Insurance Company  
First National Insurance Company of America  
General Insurance Company of America  
Safeco Insurance Company of America

Certificate No: **8205019-016032**


## POWER OF ATTORNEY

**KNOWN ALL PERSONS BY THESE PRESENTS:** That American States Insurance Company is a corporation duly organized under the laws of the State of Indiana, that First National Insurance Company of America, General Insurance Company of America, and Safeco Insurance Company of America are corporations duly organized under the laws of the State of New Hampshire (herein collectively called the "Companies"), pursuant to and by authority herein set forth, does hereby name, constitute and appoint, Alisa B. Ferris; Anna Childress; Jeffrey M. Wilson; Mark W. Edwards II; Richard H. Mitchell; Robert R. Freel; Sam Audia; William M. Smith

all of the city of Birmingham state of AL each individually if there be more than one named, its true and lawful attorney-in-fact to make, execute, seal, acknowledge and deliver, for and on its behalf as surety and as its act and deed, any and all undertakings, bonds, recognizances and other surety obligations, in pursuance of these presents and shall be as binding upon the Companies as if they have been duly signed by the president and attested by the secretary of the Companies in their own proper persons.

**IN WITNESS WHEREOF**, this Power of Attorney has been subscribed by an authorized officer or official of the Companies and the corporate seals of the Companies have been affixed thereto this 11th day of March, 2021.

American States Insurance Company  
First National Insurance Company of America  
General Insurance Company of America  
Safeco Insurance Company of America

By:   
David M. Carey, Assistant Secretary




State of PENNSYLVANIA ss  
County of MONTGOMERY

On this 11th day of March, 2021 before me personally appeared David M. Carey, who acknowledged himself to be the Assistant Secretary of American States Insurance Company, First National Insurance Company of America, General Insurance Company of America, and Safeco Insurance Company of America, and that he, as such, being authorized so to do, execute the foregoing instrument for the purposes therein contained by signing on behalf of the corporations by himself as a duly authorized officer.

**IN WITNESS WHEREOF**, I have hereunto subscribed my name and affixed my notarial seal at King of Prussia, Pennsylvania, on the day and year first above written.



Commonwealth of Pennsylvania - Notary Seal  
Teresa Pastella, Notary Public  
Montgomery County  
My commission expires March 28, 2025  
Commission number 1126044  
Member, Pennsylvania Association of Notaries

By:   
Teresa Pastella, Notary Public

This Power of Attorney is made and executed pursuant to and by authority of the following By-law and Authorizations of American States Insurance Company, First National Insurance Company of America, General Insurance Company of America, and Safeco Insurance Company of America, which are now in full force and effect reading as follows:

### ARTICLE IV - OFFICERS: Section 12. Power of Attorney.

Any officer or other official of the Corporation authorized for that purpose in writing by the Chairman or the President, and subject to such limitation as the Chairman or the President may prescribe, shall appoint such attorneys-in-fact, as may be necessary to act in behalf of the Corporation to make, execute, seal, acknowledge and deliver as surety any and all undertakings, bonds, recognizances and other surety obligations. Such attorney-in-fact, subject to the limitations set forth in their respective powers of attorney, shall have full power to bind the Corporation by their signature and executed, such instruments shall be as binding as if signed by the President and attested to by the Secretary. Any power or authority granted to any representative or attorney-in-fact under the provisions of this article may be revoked at any time by the Board, the Chairman, the President or by the officer or officers granting such power or authority.

**Certificate of Designation** - The President of the Company, acting pursuant to the Bylaws of the Company, authorizes David M. Carey, Assistant Secretary to appoint such attorneys-in-fact as may be necessary to act on behalf of the Company to make, execute, seal, acknowledge and deliver as surety any and all undertakings, bonds, recognizances and other surety obligations.

**Authorization** - By unanimous consent of the Company's Board of Directors, the Company consents that facsimile or mechanically reproduced signature of any assistant secretary of the Company, wherever appearing upon a certified copy of any power of attorney issued by the Company in connection with surety bonds, shall be valid and binding upon the Company with the same force and effect as though manually affixed.

I, Renee C. Llewellyn, the undersigned, Assistant Secretary, of American States Insurance Company, First National Insurance Company of America, General Insurance Company of America, and Safeco Insurance Company of America do hereby certify that the original power of attorney of which the foregoing is a full, true and correct copy of the Power of Attorney executed by said Companies, is in full force and effect and has not been revoked.

**IN TESTIMONY WHEREOF**, I have hereunto set my hand and affixed the seals of said Companies this 6th day of May, 2021.



By:   
Renee C. Llewellyn, Assistant Secretary

Not valid for mortgage, note, loan, letter of credit, currency rate, interest rate or residual value guarantees.

For bond and/or Power of Attorney (POA) verification inquiries, please call 610-832-8240 or email HOSUR@libertymutual.com.

# CERTIFIED WELL SURVEY REPORT





1469 HIGHWAY 20 WEST • McDONOUGH, GA 30253  
phone: 770-707-0777 fax: 770-707-0755  
WWW.METRO-ENGINEERING.COM

## SURVEYOR'S REPORT

### SCOPE OF WORK:

Field survey of existing monitoring wells at Georgia Power Company, Plant McDonough in Smyrna, GA.

Horizontal and vertical datum was derived from RTK GPS observations with corrections from the eGPS network and conventional surveying equipment. Horizontal datum is Georgia State Plane, West Zone, NAD83(2011) and vertical datum is NAVD88.

### EQUIPMENT USED TO ESTABLISH THE MONITORING WELL LOCATIONS:

Trimble R8 Dual Frequency GPS Receiver  
Leica TS16 Total Station  
Leica DNA10 Digital Level

### CERTIFICATION:

I hereby certify that the center of well casing (PVC) has a horizontal accuracy of 0.5+/- feet or better using a Trimble R8 Dual Frequency RTK (survey-grade) global positioning system receiver referencing the Georgia State Plane, west zone, NAD83(2011) coordinate system in US survey feet. The top of well casing (PVC) elevation data was determined in feet above mean sea level based on the NAVD88 vertical datum. Vertical data was confirmed to be accurate within 0.01 foot through establishment of a closed level check loop with a Leica DNA10 digital level having a published accuracy of 0.9mm per dual-traverse kilometer.

  
James R. Green R.L.S. No. 2543



Date: 8/10/20

Plant McDonough  
Monitoring Well Locations  
August 7, 2020

Well ID	LATITUDE	LONGITUDE	NAIL NORTHING	NAIL EASTING	NAIL ELEV	PVC NORTHING	PVC EASTING	TOP PVC ELEV	ELEV AT BASE
B-100	N33.821507	W84.477304	1390255.7	2202241.1	775.32	1390254.8	2202242.1	777.95	775.3
B-16	N33.827948	W84.473793	1392595.3	2203314.4	823.54	1392595.1	2203315.4	826.47	823.6
B-18	N33.827740	W84.475241	1392520.2	2202876.1	823.89	1392521.0	2202875.5	826.56	823.9
B-24	N33.827616	W84.479935	1392479.7	2201451.1	819.19	1392479.9	2201450.0	822.11	819.3
B-25	N33.828532	W84.479765	1392813.0	2201503.9	833.41	1392813.3	2201502.7	836.54	833.5
B-26	N33.829336	W84.479610	1393105.5	2201551.4	850.61	1393105.6	2201550.4	853.60	850.6
B-28	N33.826209	W84.479175	1391968.5	2201678.9	813.28	1391967.4	2201679.2	816.08	813.3
B-29	N33.825994	W84.480021	1391891.0	2201421.4	813.47	1391890.0	2201422.0	816.43	813.5
B-3	N33.831925	W84.476784	1394044.3	2202412.0	834.86	1394045.1	2202411.5	837.78	835.0
B-31	N33.826387	W84.481648	1392034.9	2200928.0	794.84	1392034.3	2200928.5	797.47	794.9
B-41	N33.823333	W84.478925	1390921.5	2201751.1	792.40	1390920.8	2201751.9	795.20	792.4
B-50	N33.825358	W84.478639	1391656.0	2201840.9	806.49	1391657.1	2201841.0	809.67	809.2
B-51	N33.822173	W84.481705	1390500.7	2200905.6	763.29	1390501.2	2200906.5	765.92	763.3
B-52	N33.827143	W84.480378	1392307.3	2201314.3	820.18	1392308.3	2201314.8	822.89	820.3
B-54	N33.832971	W84.474387	1394422.3	2203141.2	782.54	1394423.5	2203140.7	785.46	782.6
B-55	N33.832207	W84.471067	1394142.2	2204146.8	822.86	1394142.6	2204147.9	825.12	822.9
B-56	N33.831700	W84.470934	1393957.6	2204186.8	820.95	1393957.9	2204187.8	823.59	821.0
B-57	N33.824649	W84.475687	1391397.5	2202736.1	786.03	1391396.3	2202736.9	789.04	786.0
B-58	N33.823902	W84.476706	1391126.5	2202426.0	785.20	1391125.7	2202426.5	788.17	785.2
B-59	N33.832766	W84.474846	1394348.1	2203001.5	785.41	1394349.1	2203001.1	788.00	785.5
B-6	N33.832961	W84.473972	1394420.5	2203266.5	786.45	1394419.5	2203266.5	789.47	786.5
B-60	N33.823839	W84.475205	1391101.4	2202882.2	779.25	1391100.7	2202881.6	782.13	779.2
B-61	N33.823442	W84.476443	1390958.4	2202506.9	778.95	1390957.8	2202505.8	782.09	779.0
B-62	N33.820331	W84.478719	N.A.	N.A.	N.A.	1389828.1	2201811.2	760.08	760.4
B-63	N33.823559	W84.474888	1390998.7	2202977.5	777.37	1390999.1	2202978.1	777.10	777.3
B-64	N33.832856	W84.474746	1394382.3	2203030.6	785.98	1394381.9	2203031.3	785.83	786.1
B-65	N33.832862	W84.471389	N.A.	N.A.	N.A.	1394381.2	2204050.8	821.95	822.3
B-66	N33.831427	W84.470638	1393859.2	2204277.7	813.33	1393858.2	2204277.5	815.90	813.3

Plant McDonough  
Monitoring Well Locations  
August 7, 2020

B-68	N33.824362	W84.482346	1391298.8	2200715.2	759.05	1391298.2	2200714.2	758.68	759.0
B-7	N33.832841	W84.472887	1394375.6	2203596.0	806.04	1394374.6	2203596.1	809.16	806.1
B-76	N33.822783	W84.475614	1390716.5	2202756.0	760.87	1390717.4	2202756.9	760.53	766.5
B-77	N33.823420	W84.475007	1390949.4	2202941.4	777.12	1390948.7	2202942.0	776.86	777.1
B-78	N33.832708	W84.474987	1394327.3	2202958.7	787.79	1394328.2	2202958.2	790.75	788.0
B-79	N33.833068	W84.474116	1394457.8	2203223.6	785.84	1394458.6	2203223.0	788.66	785.9
B-80	N33.832834	W84.473091	1394373.5	2203533.9	801.73	1394372.6	2203533.9	804.47	801.8
B-81	N33.832815	W84.472409	1394365.8	2203741.3	817.64	1394364.9	2203741.1	820.56	817.7
B-82	N33.831129	W84.470701	1393750.1	2204256.8	807.55	1393750.0	2204258.1	810.07	807.5
B-83	N33.822832	W84.475816	1390735.9	2202695.1	777.17	1390735.5	2202695.6	776.98	777.1
B-84	N33.821939	W84.477307	1390411.2	2202242.5	776.52	1390411.9	2202241.9	776.34	776.6
B-85	N33.832998	W84.474407	1394432.8	2203134.8	782.71	1394433.4	2203134.5	782.54	782.7
B-86	N33.833127	W84.474170	1394479.5	2203207.0	784.52	1394480.0	2203206.6	784.29	784.6
B-87	N33.832915	W84.473100	1394400.8	2203531.3	800.32	1394401.9	2203531.3	803.37	800.4
B-88	N33.832914	W84.472419	1394399.9	2203738.1	816.80	1394401.1	2203738.3	820.07	817.0
B-89	N33.832910	W84.471394	1394398.7	2204048.6	822.53	1394398.4	2204049.4	822.36	822.6
B-90	N33.833185	W84.474151	1394500.4	2203212.8	784.16	1394501.0	2203212.6	784.00	784.2
B-91	N33.833036	W84.474442	N.A.	N.A.	N.A.	1394447.1	2203123.9	782.98	783.1
B-92	N33.832887	W84.474761	1394393.2	2203026.4	785.30	1394392.7	2203026.7	785.08	785.3
B-93	N33.832763	W84.475024	1394348.1	2202947.0	789.19	1394348.7	2202946.7	789.07	789.2
B-94	N33.832915	W84.473158	1394400.9	2203513.8	799.12	1394402.0	2203513.7	801.74	799.2
B-95	N33.833233	W84.474299	1394519.5	2203167.2	784.18	1394518.6	2203167.7	784.00	784.3
B-96	N33.833122	W84.474524	1394479.4	2203098.8	785.19	1394478.7	2203099.3	784.92	785.3
B-97	N33.832988	W84.474823	1394430.6	2203008.0	786.50	1394430.0	2203008.3	786.29	786.6
B-98	N33.832883	W84.475066	1394392.7	2202934.6	789.81	1394392.5	2202934.0	789.67	789.8
B-99	N33.833247	W84.474573	1394524.7	2203084.9	782.57	1394524.2	2203084.5	782.39	782.6
DGWA-53	N33.830346	W84.479224	1393473.5	2201667.7	841.37	1393472.8	2201668.8	844.26	841.3
DGWA-70A	N33.822116	W84.482741	1390480.2	2200591.7	805.67	1390481.4	2200591.6	808.52	805.8
DGWA-71	N33.831695	W84.479078	1393964.3	2201714.7	861.22	1393963.3	2201714.8	863.84	861.2
DGWC-8	N33.832699	W84.471944	1394323.0	2203882.3	824.02	1394322.2	2203882.1	826.38	824.1



Plant McDonough  
Monitoring Well Locations  
August 7, 2020

DGWC-37	N33.822121	W84.481661	1390483.0	2200920.7	763.64	1390482.2	2200919.8	766.21	763.7
DGWC-10	N33.831317	W84.470889	1393818.1	2204200.0	820.82	1393818.3	2204201.1	823.55	820.9
DGWC-11	N33.830571	W84.471001	1393546.9	2204167.3	797.99	1393547.1	2204166.2	800.57	798.1
DGWC-12	N33.829478	W84.471122	1393149.8	2204127.3	771.10	1393149.4	2204128.3	773.86	771.2
DGWC-13	N33.828740	W84.471263	1392880.8	2204085.7	791.20	1392881.1	2204084.6	794.10	791.3
DGWC-14	N33.827896	W84.471495	1392574.5	2204014.4	789.69	1392574.2	2204013.3	792.40	789.8
DGWC-15	N33.827810	W84.472595	1392544.2	2203677.9	821.43	1392544.1	2203679.0	824.50	821.5
DGWC-17	N33.828084	W84.474664	1392645.0	2203050.2	834.14	1392645.6	2203051.0	837.05	834.2
DGWC-19	N33.827248	W84.476143	1392341.8	2202601.5	822.87	1392342.6	2202601.0	825.46	822.9
DGWC-2	N33.831683	W84.477745	1393957.1	2202119.4	848.17	1393958.0	2202119.5	850.88	848.3
DGWC-20	N33.826754	W84.477079	1392163.7	2202316.3	819.66	1392164.5	2202315.6	822.14	819.8
DGWC-21	N33.826487	W84.477911	1392066.4	2202063.3	813.47	1392067.5	2202063.5	816.28	813.5
DGWC-22	N33.826647	W84.478805	1392125.2	2201791.7	813.69	1392126.3	2201791.9	816.59	813.7
DGWC-23	N33.826957	W84.479498	1392240.4	2201582.8	815.63	1392239.7	2201582.0	818.37	815.7
DGWC-38	N33.821795	W84.480906	1390363.6	2201149.0	754.67	1390362.7	2201148.6	757.43	754.7
DGWC-39	N33.821635	W84.479616	1390302.5	2201539.8	756.93	1390303.6	2201540.1	759.89	757.0
DGWC-4	N33.832275	W84.475959	1394170.6	2202662.7	812.06	1394171.5	2202662.4	814.85	812.1
DGWC-40	N33.822523	W84.478678	1390625.1	2201826.7	776.12	1390625.7	2201825.9	779.06	776.2
DGWC-42	N33.824453	W84.478540	1391327.4	2201869.1	801.98	1391327.8	2201870.2	804.68	802.0
DGWC-47	N33.825080	W84.476104	1391553.1	2202611.3	794.35	1391553.8	2202610.5	797.45	794.3
DGWC-48	N33.824420	W84.477157	1391314.2	2202289.2	785.21	1391314.6	2202290.2	788.33	785.2
DGWC-5	N33.832647	W84.474964	1394305.3	2202965.3	788.64	1394306.3	2202965.1	791.75	788.7
DGWC-67	N33.823417	W84.481959	1390953.6	2200830.0	766.80	1390953.8	2200830.7	766.70	767.0
DGWC-68A	N33.824370	W84.482278	1391300.9	2200733.4	765.06	1391301.2	2200734.9	765.33	765.4
DGWC-69	N33.825150	W84.482537	1391583.9	2200657.2	763.99	1391585.0	2200657.1	763.75	764.0
DGWC-9	N33.831969	W84.470993	1394055.6	2204168.9	821.86	1394055.9	2204170.0	824.35	821.8



1469 HIGHWAY 20 WEST • McDONOUGH, GA 30253  
phone: 770-707-0777 fax: 770-707-0755  
WWW.METRO-ENGINEERING.COM

## SURVEYOR'S REPORT

### SCOPE OF WORK:

Field survey of existing monitoring wells at Georgia Power Company, Plant McDonough in Smyrna, GA.

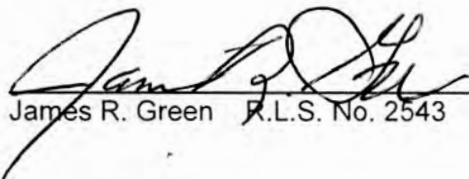
Horizontal and vertical datum was derived from RTK GPS observations with corrections from the eGPS network and conventional surveying equipment. Horizontal datum is Georgia State Plane, West Zone, NAD83(2011) and vertical datum is NAVD88.

### EQUIPMENT USED TO ESTABLISH THE MONITORING WELL LOCATIONS:

Trimble R8 Dual Frequency GPS Receiver  
Leica TS16 Total Station  
Leica DNA10 Digital Level

### CERTIFICATION:

I hereby certify that the center of well casing (PVC) has a horizontal accuracy of 0.5+/- feet or better using a Trimble R8 Dual Frequency RTK (survey-grade) global positioning system receiver referencing the Georgia State Plane, west zone, NAD83(2011) coordinate system in US survey feet. The top of well casing (PVC) elevation data was determined in feet above mean sea level based on the NAVD88 vertical datum. Vertical data was confirmed to be accurate within 0.01 foot through establishment of a closed level check loop with a Leica DNA10 digital level having a published accuracy of 0.9mm per dual-traverse kilometer.

  
James R. Green R.L.S. No. 2543

Date: 1/6/21



Plant McDonough  
Monitoring Well Locations  
January 6, 2021

Well ID	LATITUDE	LONGITUDE	NAIL NORTHING	NAIL EASTING	NAIL ELEV	PVC NORTHING	PVC EASTING	TOP PVC ELEV	ELEV AT BASE
B-101D	N33.831990	W84.470999	1394063.3	2204167.1	821.24	1394063.6	2204168.2	824.29	821.2
B-102D	N33.831344	W84.470891	1393828.2	2204199.0	820.64	1393828.4	2204200.4	823.42	820.6
B-103D	N33.825052	W84.476091	1391542.8	2202615.0	793.77	1391543.5	2202614.4	795.96	793.8
B-104D	N33.824431	W84.477129	1391317.9	2202297.4	785.31	1391318.3	2202298.5	787.90	785.3
B-105D	N33.822547	W84.478659	1390633.9	2201832.7	776.03	1390634.5	2201831.9	779.01	776.0
B-106D	N33.832712	W84.471987	1394328.3	2203869.6	823.39	1394327.1	2203869.2	826.21	823.5
B-107D	N33.827226	W84.476158	1392333.6	2202597.0	820.44	1392334.5	2202596.4	823.38	820.6
B-108D	N33.826733	W84.477091	1392155.6	2202313.1	818.33	1392156.1	2202312.5	821.13	818.4
B-109D	N33.831682	W84.477720	1393956.4	2202127.0	847.78	1393957.5	2202127.0	850.73	847.8
B-110D	N33.824352	W84.482274	1391294.0	2200734.6	764.55	1391294.4	2200736.0	764.61	764.7
B-111D	N33.832640	W84.474992	1394302.6	2202956.5	789.04	1394303.4	2202956.4	791.87	789.1
B-72	N33.824206	W84.482307	1391241.2	2200724.9	758.45	1391241.4	2200725.9	758.46	758.5
B-73	N33.824509	W84.482395	1391351.5	2200698.5	759.16	1391351.8	2200699.4	759.21	759.2
B-74	N33.824311	W84.482504	1391278.9	2200666.3	759.18	1391279.9	2200666.1	759.06	759.2
DW-D1	N33.832657	W84.474840	NA	NA	NA	1394309.5	2203002.8	786.78	786.2
DW-D2	N33.832842	W84.473838	NA	NA	NA	1394375.8	2203307.1	788.53	788.3
DW-D3	N33.832812	W84.472368	NA	NA	NA	1394363.7	2203753.5	817.50	817.2
DW-D4	N33.831941	W84.470988	NA	NA	NA	1394045.5	2204171.7	820.68	820.4

STAFF GAGE	LATITUDE	LONGITUDE	T/POST NORTHING	T/POST EASTING	TOP T/POST ELEV	TOP GAGE ELEV @ 8'	ELEV AT GRD
WT-1	N33.825586	W84.482522	1391743.6	2200662.1	759.85	759.32	755.3
WT-3	N33.824028	W84.482353	1391176.9	2200711.8	757.80	756.92	752.6
WT-4	N33.822014	W84.481690	1390443.3	2200910.8	754.13	753.21	749.2
WT-5	N33.821283	W84.480144	1390175.9	2201379.5	749.01	749.07	744.9
ET-1	N33.832761	W84.474439	1394347.0	2203124.5	NA	779.94	775.9



1469 Highway 20 West • McDonough, GA 30253  
phone: 770-707-0777 fax: 770-707-0755  
WWW.METRO-ENGINEERING.COM

## **SURVEYOR'S REPORT**

### **SCOPE OF WORK:**

Field survey of existing monitoring wells at Georgia Power Company, Plant McDonough in Smyrna, GA.

Horizontal and vertical datum was derived from RTK GPS observations with corrections from the eGPS network and conventional surveying equipment. Horizontal datum is Georgia State Plane, West Zone, NAD83(2011) and vertical datum is NAVD88.

### **EQUIPMENT USED TO ESTABLISH THE MONITORING WELL LOCATIONS:**

Trimble R8 Dual Frequency GPS Receiver  
Leica TS16 Total Station  
Leica DNA10 Digital Level

### **CERTIFICATION:**

I hereby certify that the center of well casing (PVC) has a horizontal accuracy of 0.5+/- feet or better using a Trimble R8 Dual Frequency RTK (survey-grade) global positioning system receiver referencing the Georgia State Plane, west zone, NAD83(2011) coordinate system in US survey feet. The top of well casing (PVC) elevation data was determined in feet above mean sea level based on the NAVD88 vertical datum. Vertical data was confirmed to be accurate within 0.01 foot through establishment of a closed level check loop with a Leica DNA10 digital level having a published accuracy of 0.9mm per dual-traverse kilometer.

  
James R. Green R.L.S. No. 2543

Date: 5/11/21



Plant McDonough  
Monitoring Well Locations  
April 11, 2021

Well ID	LATITUDE	LONGITUDE	NAIL NORTHING	NAIL EASTING	NAIL ELEV	PVC NORTHING	PVC EASTING	TOP PVC ELEV	ELEV AT BASE
B-111D	N33.832640	W84.474992	1394302.7	2202956.6	788.99	1394303.6	2202956.4	791.84	789.0
B-112D	N33.825093	W84.482513	1391564.0	2200663.1	765.98	1391564.2	2200664.1	765.58	766.1
B-113D	N33.824270	W84.482329	1391264.7	2200720.2	758.87	1391264.6	2200719.2	758.22	758.8
B-115D	N33.824287	W84.476200	1391266.0	2202580.1	786.43	1391265.3	2202580.7	789.17	786.4
B-116D	N33.822123	W84.482677	1390483.0	2200611.0	805.31	1390483.7	2200611.0	807.82	805.3
B-117D	N33.831696	W84.479036	1393964.7	2201727.1	861.23	1393963.8	2201727.3	863.82	861.2
B-118	N33.824143	W84.483216	1391220.2	2200449.5	804.99	1391219.3	2200449.7	807.70	805.0
B-119D	N33.824190	W84.483226	1391237.5	2200446.4	804.53	1391236.4	2200446.6	807.15	804.5
B-120D	N33.831931	W84.476702	1394046.4	2202436.8	834.03	1394047.2	2202436.4	836.42	834.0





1469 HIGHWAY 20 WEST • McDONOUGH, GA 30253  
phone: 770-707-0777 fax: 770.707-0755  
WWW.METRO-ENGINEERING.COM

## SURVEYOR'S REPORT

### SCOPE OF WORK:

Field survey of existing monitoring wells at Georgia Power Company, Plant McDonough in Smyrna, GA.


Horizontal and vertical datum was derived from RTK GPS observations with corrections received via a cellular modem utilizing the Leica "Smartnet" RTK Network and conventional surveying equipment. Horizontal datum is Georgia State Plane, West Zone, NAD83(2011) and vertical datum is NAVD88.

### EQUIPMENT USED TO ESTABLISH THE MONITORING WELL LOCATIONS:

Leica GS18T GPS Receiver  
Leica TS16 Total Station  
Leica DNA10 Digital Level

### CERTIFICATION:

I hereby certify that the center of well casing (PVC) has a horizontal accuracy of 0.5+/- feet or better using a Leica GS18T GPS (survey-grade) global positioning system receiver referencing the Georgia State Plane, West Zone, NAD83(2011) coordinate system in US survey feet. The top of well casing (PVC) elevation data was determined in feet above mean sea level based on the NAVD88 vertical datum. Vertical data was confirmed to be accurate within 0.01 foot through establishment of a closed level check loop with a Leica DNA10 digital level having a published accuracy of 0.9mm per dual-traverse kilometer.

  
James R. Green R.L.S. No. 2543

Date: 5/10/22



Plant McDonough  
Monitoring Well Locations  
May 9, 2022

Well ID	LATITUDE	LONGITUDE	NAIL NORTHING	NAIL EASTING	NAIL ELEV	PVC NORTHING	PVC EASTING	TOP PVC ELEV	ELEV AT BASE
B-122D	N33.823541	W84.474897	1390992.06	2202975.35	777.32	1390992.8	2202975.4	777.03	777.3
B-123D	N33.824203	W84.476108	1391233.80	2202608.91	778.85	1391234.4	2202608.4	781.80	779.0
DWGC121	N33.822829	W84.481895	1390739.51	2200848.27	764.52	1390739.7	2200849.4	764.16	764.6





1469 HIGHWAY 20 WEST • McDONOUGH, GA 30253  
phone: 770-707-0777 fax: 770-707-0755  
WWW.METRO-ENGINEERING.COM

## SURVEYOR'S REPORT

### SCOPE OF WORK:

Field survey of existing monitoring wells at Georgia Power Company, Plant McDonough in Smyrna, GA.

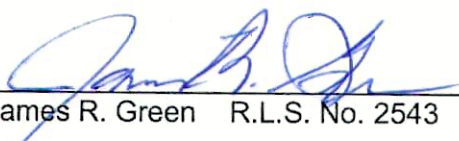
Horizontal and vertical datum was derived from RTK GPS observations with corrections received via a cellular modem utilizing the Leica "Smartnet" RTK Network and conventional surveying equipment. Horizontal datum is Georgia State Plane, West Zone, NAD83(2011) and vertical datum is NAVD88.

### EQUIPMENT USED TO ESTABLISH THE MONITORING WELL LOCATIONS:

Leica GS18T GPS Receiver  
Leica TS16 Total Station  
Leica DNA10 Digital Level

### CERTIFICATION:

I hereby certify that the center of well casing (PVC) has a horizontal accuracy of 0.5+/- feet or better using a Leica GS18T GPS (survey-grade) global positioning system receiver referencing the Georgia State Plane, West Zone, NAD83(2011) coordinate system in US survey feet. The top of well casing (PVC) elevation data was determined in feet above mean sea level based on the NAVD88 vertical datum. Vertical data was confirmed to be accurate within 0.01 foot through establishment of a closed level check loop with a Leica DNA10 digital level having a published accuracy of 0.9mm per dual-traverse kilometer.

  
James R. Green R.L.S. No. 2543

Date: 5/8/23

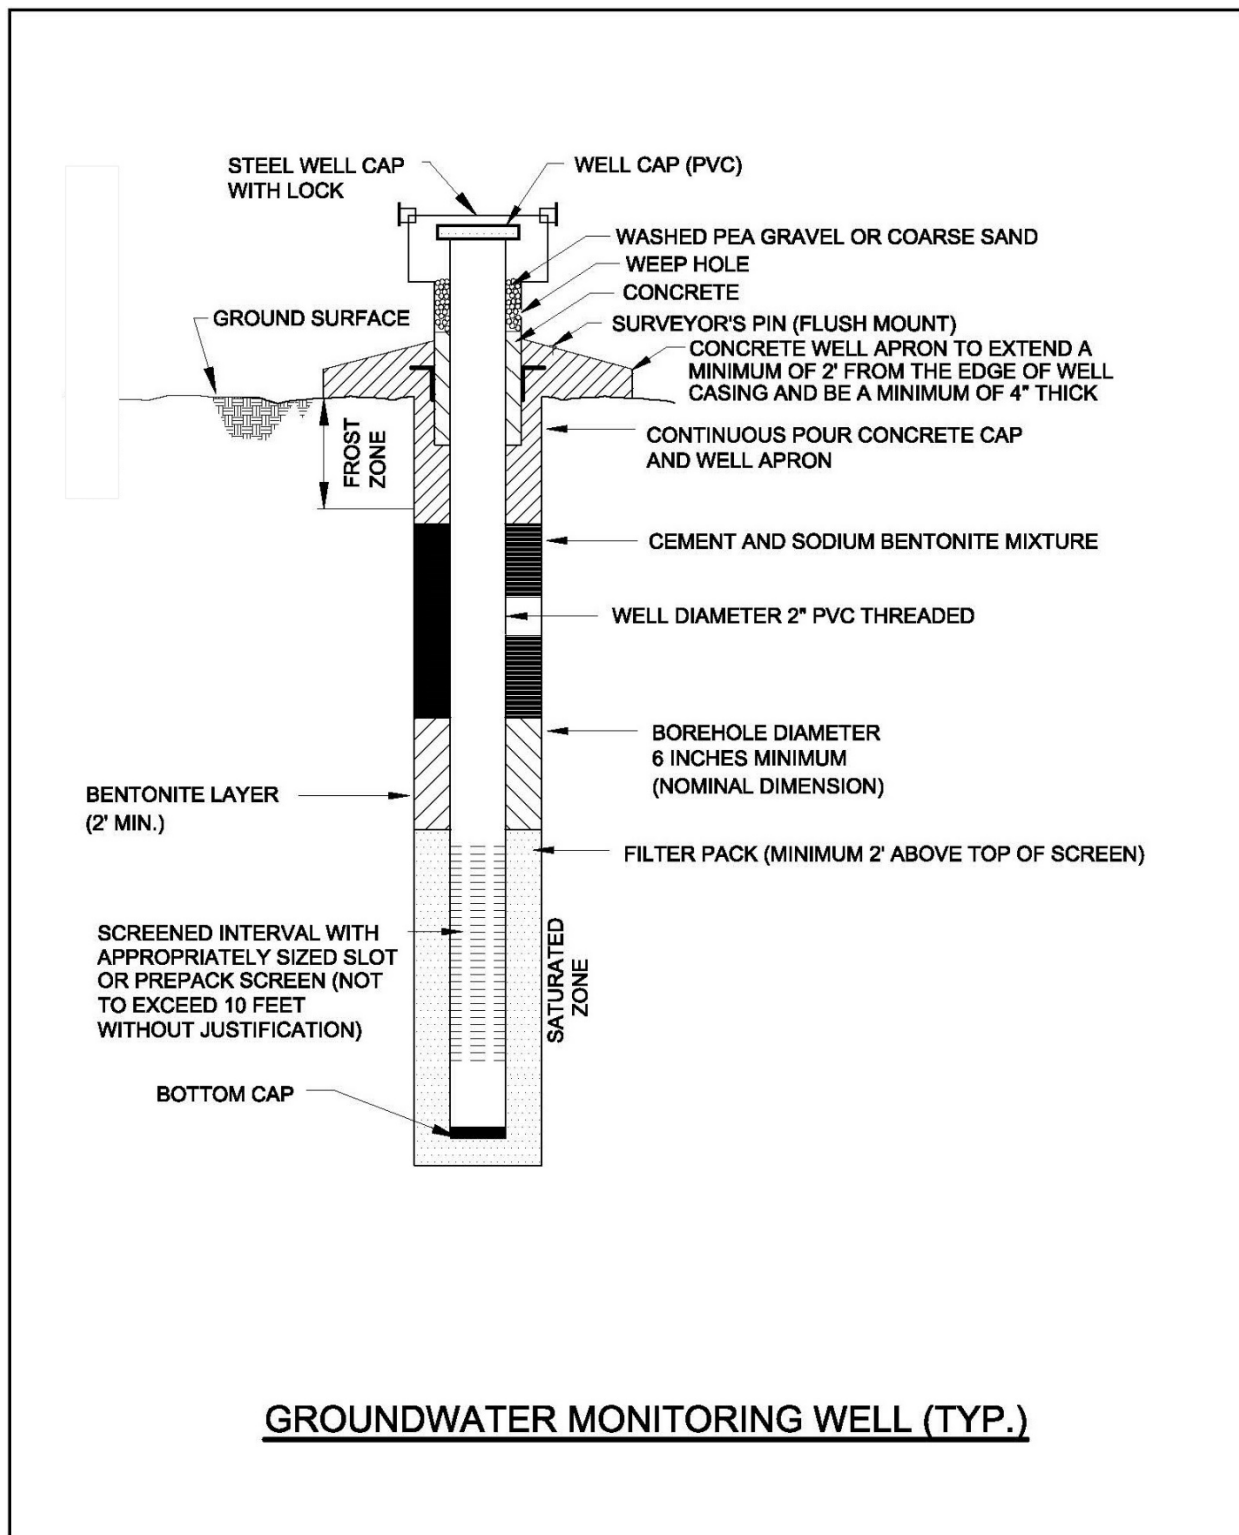


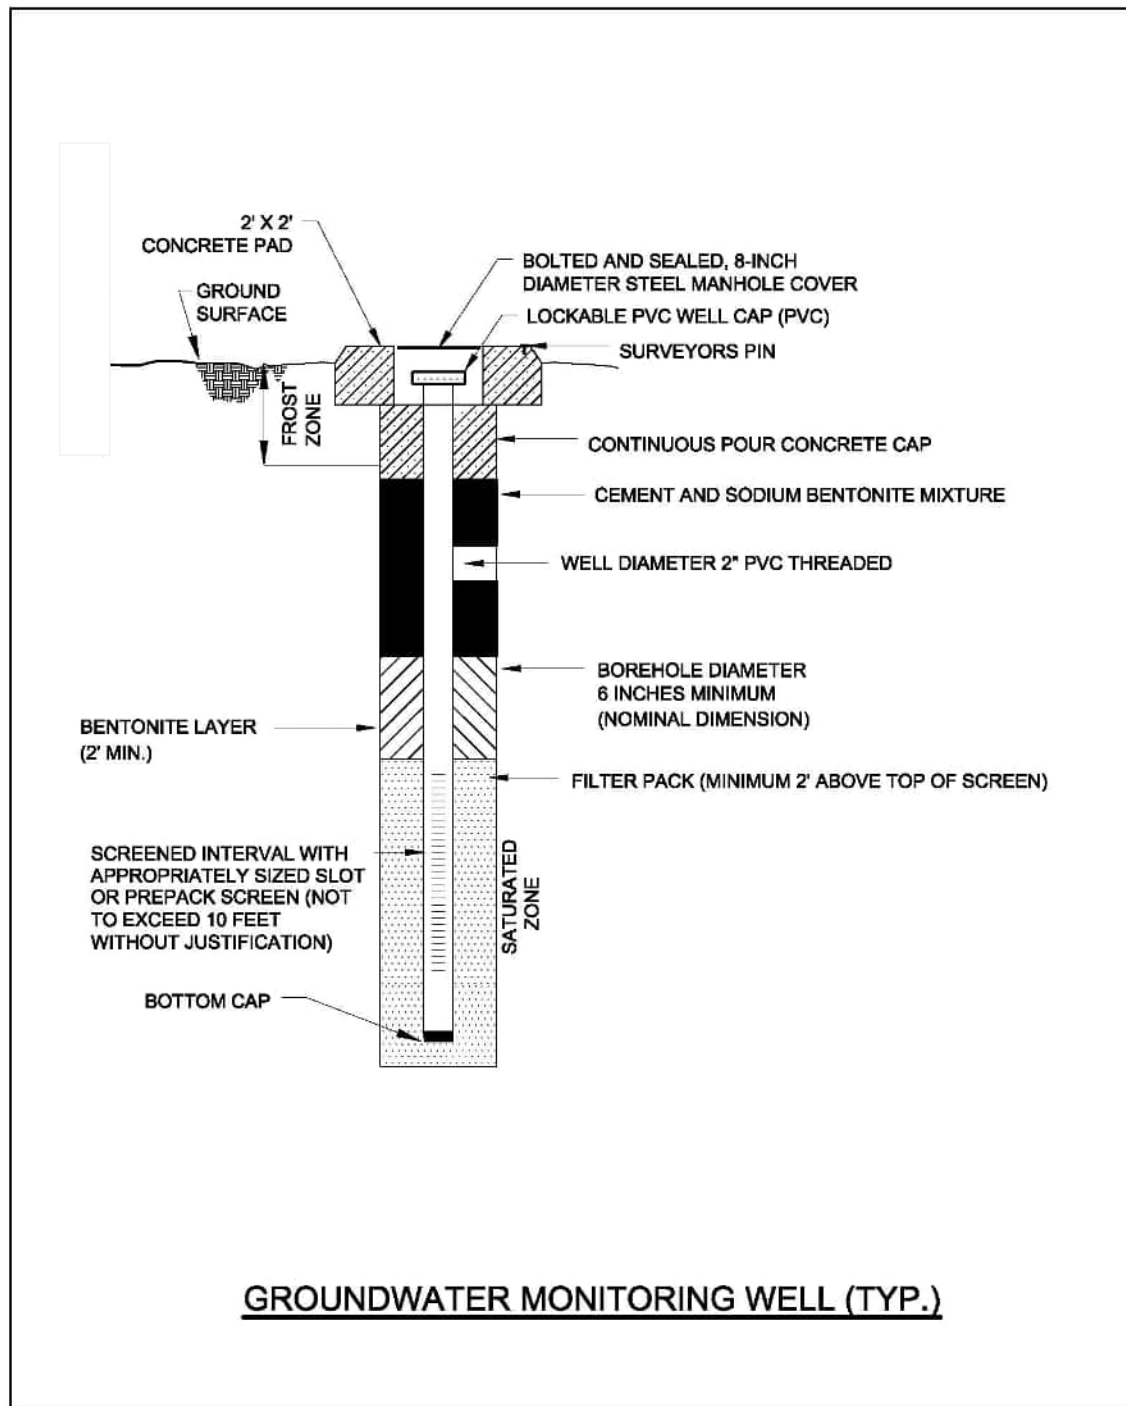
Plant McDonough  
Monitoring Well Locations  
May 4, 2023

Well ID	LATITUDE	LONGITUDE	NAIL NORTHING	NAIL EASTING	NAIL ELEV	PVC NORTHING	PVC EASTING	TOP PVC ELEV	ELEV AT BASE
B-125D	N33.832109	W84.476228	1394111.1	2202580.9	819.15	1394111.6	2202580.7	821.70	819.1

**APPENDIX B**

# GROUNDWATER MONITORING WELL DETAILS

**APPENDIX B. GROUNDWATER MONITORING WELL DETAIL**

**APPENDIX B. GROUNDWATER MONITORING WELL DETAIL-FLUSH MOUNT WELL**

**APPENDIX C**

# GROUNDWATER SAMPLING PROCEDURES

## APPENDIX C. GROUNDWATER SAMPLING PROCEDURES

Groundwater sampling will be conducted using the most current United States Environmental Protection Agency (US EPA) Region 4 Field Quality and Technical Procedures as a guide. The following procedures describe the general methods associated with groundwater sampling at the Site. Prior to sampling, the well must be evacuated (purged) to ensure that representative groundwater is obtained. To accomplish this objective, low-flow purging from the screened interval is recommended until target parameters listed below are stabilized and then, representative groundwater flowing from the geologic formation is collected. Any item coming in contact with the inside of the well casing, or the well water will be kept in a clean container and handled only with gloved hands. Field logbooks and forms shall be kept for each sampling event, and should include, but not be limited to, the following: well signage, well access, sampling and purging equipment condition, and any site conditions that may affect sampling.

The sampling team will follow the procedures below at each well to ensure that a representative sample is collected:

- 1) Check the well, the lock, and the locking cap for damage or evidence of tampering. Record observations and notify Georgia Power if it appears that the well has been compromised.
- 2) Measure and record the depth to water in all wells to be sampled prior to purging. Static water levels will be measured from each well, within a 24-hour period. The water level measuring device will consist of a probe and measuring tape capable of measuring water levels with accuracy to 0.01 feet.
- 3) Install Pump: If a dedicated pump is not present, slowly lower the pump into the well to the midpoint of the well screen or a depth otherwise approved by the hydrogeologist or project scientist. The pump intake must be kept at least two (2) feet above the bottom of the well to prevent disturbance and suspension of any sediment present in the bottom of the well. Record the depth to which the pump is lowered. Non-dedicated pumps and wiring will be decontaminated before use and between well locations using procedures described in the latest version of the Region 4 U.S. Environmental Protection Agency Laboratory Services and Applied Science Division *Operating Procedure for Field Equipment Cleaning and Decontamination* as a guide.
- 4) Measure Water Level: Immediately prior to purging, measure the water level again with the pump in the well. Leave the water level measuring device in the well.
- 5) Purge Well: Begin pumping the well at approximately 100 to 500 milliliters per minute (ml/min). Monitor the water level continually. Maintain a steady flow rate that results in a stabilized water level with 0.3 ft. or less of variability. Avoid entraining air in the tubing. Record each adjustment made to the pumping rate and the water level measured immediately after each adjustment.
- 6) Monitor Indicator Parameters: Monitor and record the field indicator parameters (turbidity, temperature, specific conductance, pH, oxidation reduction potential (ORP), and dissolved oxygen (DO)) approximately every three to five minutes. The well is considered stabilized and ready for sample collection when the indicator parameters have stabilized for three consecutive readings at a minimum:
  - $\pm 0.1$  S.U. for pH
  - $\pm 5\%$  for specific conductance (conductivity)



- $\pm 10\%$  or 0.2 milligrams per liter (mg/L) for DO where DO>0.5 mg/L. If DO<0.5 mg/L no stabilization criteria apply
  - $\leq 5$  nephelometric turbidity units (NTUs) for turbidity
  - Temperature – Record only, not used for stabilization criteria
  - ORP – Record only, not used for stabilization criteria
- 7) Collect samples at a low -flow rate according to the most current version of US EPA Region 4 Laboratory Services and Applied Science Division (LSASD) guidance document, *Operating Procedure: Groundwater Sampling* (US EPA, LSASDPROC-301-R6 and updates and such that drawdown of the water level within the well is stable. Flow rate must be reduced if excessive drawdown is observed during sampling. Sample containers should be filled with minimal turbulence by allowing the groundwater to flow from the tubing gently down the inside of the container. Sample collection should be performed according to the most current version of US EPA Region 4 LSASD, *Operating Procedure: Groundwater Sampling* (US EPA LSASDPROC-301-R6) (US EPA 2023b).
  - 8) Compliance samples will be unfiltered; however, to determine if turbidity is affecting sample results, duplicate samples may be filtered in the field prior to being placed in a sample container, clearly marked as filtered and preserved. Filtering will be accomplished by the use of 0.45-micron filters on the sampling line. At least two filter volumes of sample will pass through before filling sample containers. Filtered samples are not considered compliance samples and are only used to evaluate the effects of turbidity. A new filter must be used for each well and each sampling event.
  - 9) Sample bottles will be filled, capped, and placed in an ice containing cooler immediately after sampling where temperature control is required. Samples that do not require temperature control will be placed in a clean and secure container.
  - 10) Sample containers and preservative will be appropriate for the analytical method being used.
  - 11) Information contained on sample container labels will include:
    - a) Name of facility
    - b) Date and time of sampling
    - c) Sample description (well number)
    - d) Sampler's initials
    - e) Preservatives
    - f) Analytical method(s)
  - 12) After the samples are collected, samplers will remove non-dedicated equipment. Upon completion of field activity, the well will be closed and locked.
  - 13) Non-dedicated equipment will be decontaminated between wells in general accordance with US EPA LSASDPROC-205-R4 (US EPA, 2020).
  - 14) Samples will be delivered to the laboratory following appropriate chain-of-custody (COC) and temperature control requirements. The goal for sample delivery will be within 48 hours of collection.

Throughout the sampling process new nitrile gloves will be worn by the sampling personnel. A clean pair of new, disposable gloves will be worn each time a different location is sampled, and new gloves donned prior to filling sample bottles. Gloves will be discarded after sampling each well and before sampling the next well.

The goal when sampling is to attain a turbidity of less than 5 NTUs however, samples may be collected where turbidity is less than 10 NTUs and the stabilization criteria described above are met.

If sample turbidity is greater than 5 NTUs and other stabilization criteria have been met, samplers will continue purging for 3 additional hours in order to reduce the turbidity to 5 NTUs or less.

- If turbidity remains above 5 NTUs but is less than 10 NTUs, and other parameters are stabilized, the well can be sampled.
- Where turbidity remains above 10 NTUs, an unfiltered sample will be collected followed by a filtered sample that has passed through an in-line 0.45-micron filter attached to the discharge (sample collection) tube. Data from filtered samples will only be used to quantify the effects of turbidity on sample results.

Samplers will identify the sample bottle as containing a filtered sample on the sample bottle label and on COC form.

A brief overview of purging and sampling methodologies, including the type of sampling equipment used will be provided in routine monitoring reports.

**APPENDIX D**

# **SURFACE WATER SAMPLING PROCEDURES**

## APPENDIX D SURFACE WATER SAMPLING PROCEDURES

Surface water samples will be collected in accordance with the general procedures outlined below if flowing water is observed at each sampling location. These procedures were developed using field sampling guidelines described in the *US EPA Region 4 Field Branches Quality System and Technical Procedures* (<https://www.epa.gov/quality/quality-system-and-technical-procedures-sesd-field-branches>) and U.S. Environmental Protection Agency, Laboratory Services and Applied Science Division, *Surface Water Sampling, (LSASDPROC-201-R6)*, (US EPA, 2023a). Surface water samples will be analyzed for the field parameters and Appendix IV constituents contained in Table 5.

If a dipper or other transfer vessel other than the sample container is used, it must be composed of a non-porous inert material such as glass, PVC, polyethylene, or stainless steel. The following procedures will be used to collect surface water samples:

- Hold the bottle near the base with one hand, and with the other, remove the cap.
- Rinse the sample container with the water to be sampled prior to filling the container, unless the sample containers are pre-preserved. Pre-preserved sample containers should not be rinsed prior to sampling.
- Hold the container underneath the water surface and allow the container to be filled with water. Remove the container from underneath the surface and place the cap back on the container.
- Label the sample container, at a minimum, include Sample Number, Name of Collector, Date and Time of Collection, and Place/Point of Collection.
- Place the samples in a cooler containing water-ice, if required, for courier or hand delivery to the laboratory within the sample hold times.
- Follow COC and temperature protocols.

The minimum sampling frequency for surface water will be semi-annual, provided water is present and flowing in the surface water feature.



[wsp.com](http://wsp.com)