


257.83 (b) (2)	REPORT OF ANNUAL INSPECTION OF CCR SURFACE IMPOUNDMENT		
	FACILITY NAME: Plant Hammond CCR Surface Impoundment AP-1, Permit 057-023D (CCR) OWNER/OPERATOR OF FACILITY: Georgia Power Company INSPECTION DATE: October 15, 2025 INSPECTING ENGINEER: Jacob A. Jordan, P.E. (Georgia P.E. License #28586)		
(i)	ANY CHANGES IN GEOMETRY OF THE IMPOUNDING STRUCTURE SINCE THE PREVIOUS ANNUAL INSPECTION?		No
	(IF YES, DESCRIBE):		
(ii)	LOCATION AND TYPE OF EXISTING INSTRUMENTATION		See Attached Plan
(iii)	MAXIMUM RECORDED READING OF EACH INSTRUMENT SINCE PREVIOUS ANNUAL INSPECTION		See Attached Table
(iii)	APPROXIMATE MINIMUM, MAXIMUM AND PRESENT DEPTH AND ELEVATION OF THE IMPOUNDED WATER SINCE PREVIOUS ANNUAL INSPECTION		
	MIN. DEPTH: 0 ft	MAX. DEPTH: 0 ft	PRESENT DEPTH: 0 ft ⁽¹⁾
	MIN. ELEVATION: N/A	MAX. ELEVATION: N/A	PRESENT. ELEVATION: N/A
(iv)	APPROXIMATE STORAGE CAPACITY OF IMPOUNDING STRUCTURE AT TIME OF INSPECTION.		845,000 yd ³
(v)	APPROXIMATE VOLUME OF IMPOUNDED WATER AND CCR AT TIME OF INSPECTION		WATER: 0 yd ³ ⁽¹⁾ CCR: 0 yd ³ ⁽²⁾
(vi)	ANY APPEARANCE OF AN ACTUAL OR POTENTIAL STRUCTURAL WEAKNESS OF THE CCR UNIT, IN ADDITION TO ANY EXISTING CONDITIONS THAT ARE DISRUPTING OR HAVE THE POTENTIAL TO DISRUPT THE OPERATION AND SAFETY OF THE CCR UNIT AND APPURTENANT STRUCTURES?		No
	(IF YES, DESCRIBE):		
(vii)	ANY OTHER CHANGE(S) WHICH MAY HAVE AFFECTED THE STABILITY OR OPERATION SINCE THE PREVIOUS ANNUAL INSPECTION?		No
(IF YES, DESCRIBE):			

(1) Stormwater may temporarily collect within AP-1 in low areas where it either evaporates or is pumped to the water treatment system.

(2) CCR removal was completed in August 2025.



INSTRUMENTATION PLAN
PLANT HAMMOND ASH POND 1

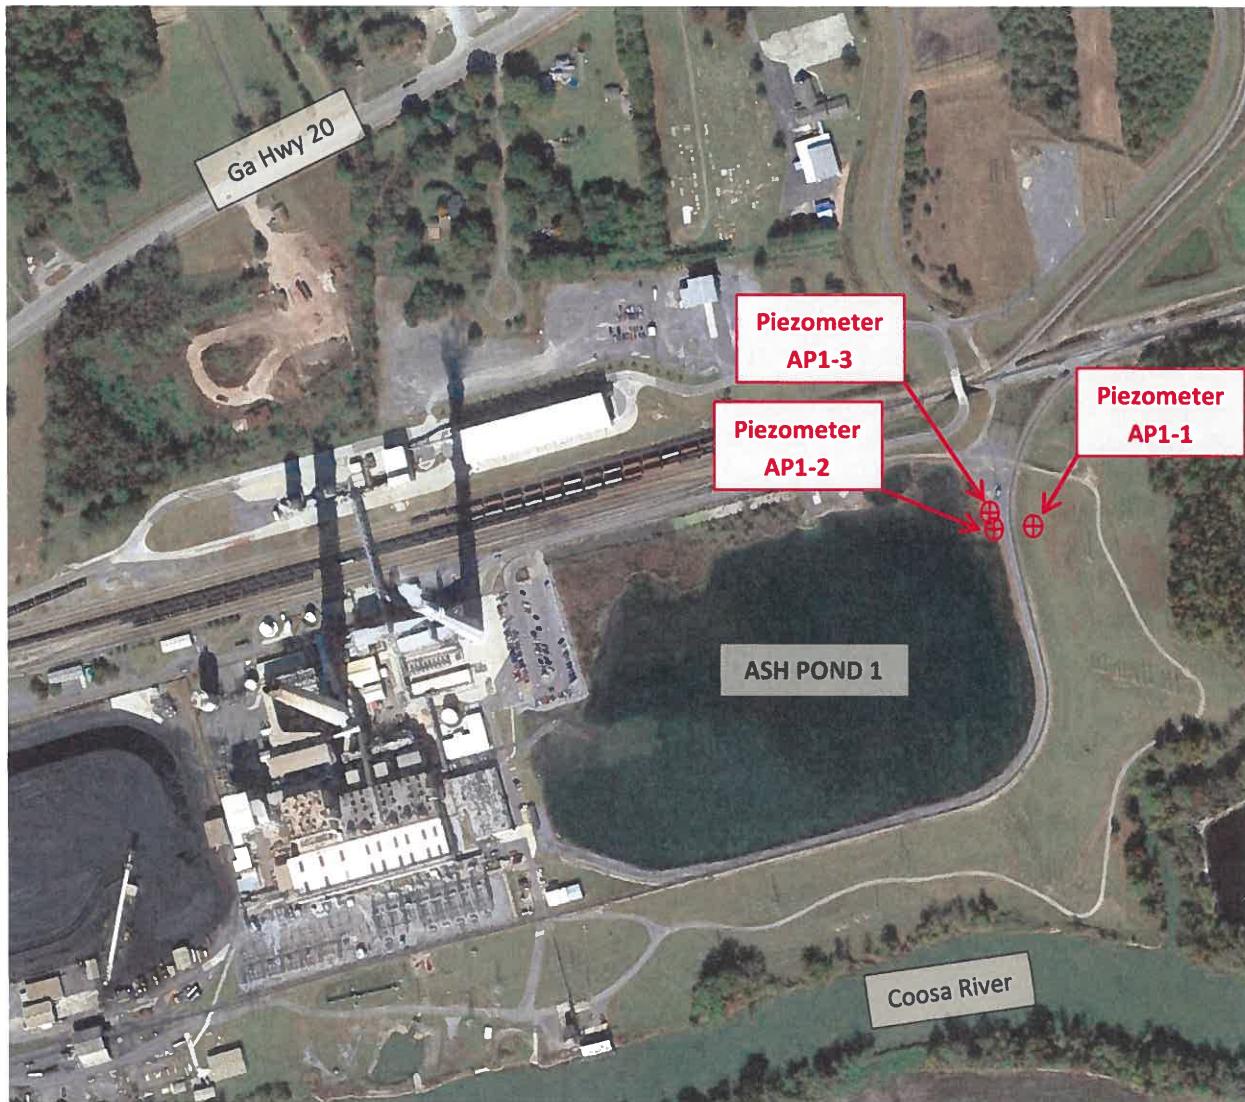

MAXIMUM RECORDED READINGS OF INSTRUMENTATION
PLANT HAMMOND ASH POND 1

PIEZOMETER NUMBER	MAXIMUM RECORDED READING ⁽¹⁾
AP1-1	EL 568
AP1-2	EL 566
AP1-3	EL 576

(1) Maximum recorded reading since last annual inspection; rounded to the nearest foot.

