


# PLANT WANSLEY ASH POND 1 CLOSURE BY REMOVAL


## HEARD AND CARROLL COUNTIES, GEORGIA

### CCR PERMIT DRAWINGS

#### NOVEMBER 2025

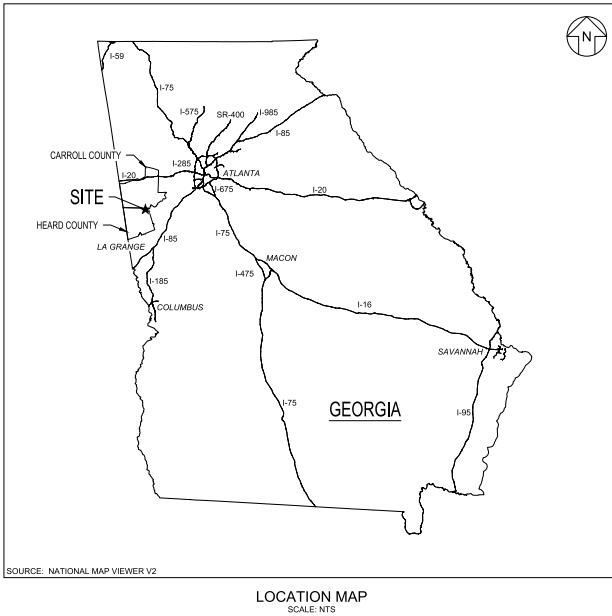

| LIST OF DRAWINGS |   |             |            |
|------------------|---|-------------|------------|
| DWG NO.          | DWG TITLE   | CURRENT REV | DATE       |
| 01               | COVER SHEET   | 2           | 11/10/2025 |
| 02               | LEGENDS, SYMBOLS, AND ABBREVIATIONS                       | 1           | 11/10/2025 |
| 03               | PROPERTY BOUNDARY SURVEY AND LEGAL DESCRIPTION            | 1           | 7/9/2025   |
| 04               | SITE GROUNDWATER MONITORING PLAN                          | 2           | 11/10/2025 |
| 05               | EXISTING SITE CONDITIONS - TOPOGRAPHY AND AP-1 BATHYMETRY | 2           | 11/10/2025 |
| 06               | CCR REMOVAL PLAN - OVERVIEW                               | 2           | 11/10/2025 |
| 07               | CCR REMOVAL PLAN - I                                      | 0           | 2/6/2025   |
| 08               | CCR REMOVAL PLAN - II                                     | 0           | 2/6/2025   |
| 09               | CCR REMOVAL PLAN - III                                    | 1           | 11/10/2025 |
| 10               | CCR REMOVAL PLAN - IV                                     | 0           | 2/6/2025   |
| 11               | CCR REMOVAL PLAN - V                                      | 1           | 7/9/2025   |
| 12               | SITE RESTORATION GRADING PLAN                             | 2           | 11/10/2025 |
| 13               | SEPARATOR DIKE PLAN                                       | 1           | 11/10/2025 |
| 14               | SITE SECTIONS - I   | 0           | 2/6/2025   |
| 15               | SITE SECTIONS - II  | 0           | 2/6/2025   |
| 16               | SEPARATOR DIKE SECTIONS                                   | 1           | 11/10/2025 |
| 17               | CONSTRUCTION SEQUENCING PLAN - I                          | 1           | 11/10/2025 |
| 18               | CONSTRUCTION SEQUENCING PLAN - II                         | 1           | 11/10/2025 |
| 19               | FINAL STORMWATER AND ESC PLAN                             | 2           | 11/10/2025 |
| 20               | STORMWATER AND ESC DETAILS - I                            | 1           | 11/10/2025 |
| 21               | STORMWATER AND ESC DETAILS - II                           | 1           | 11/10/2025 |
| 22               | STORMWATER AND ESC DETAILS - III                          | 1           | 11/10/2025 |

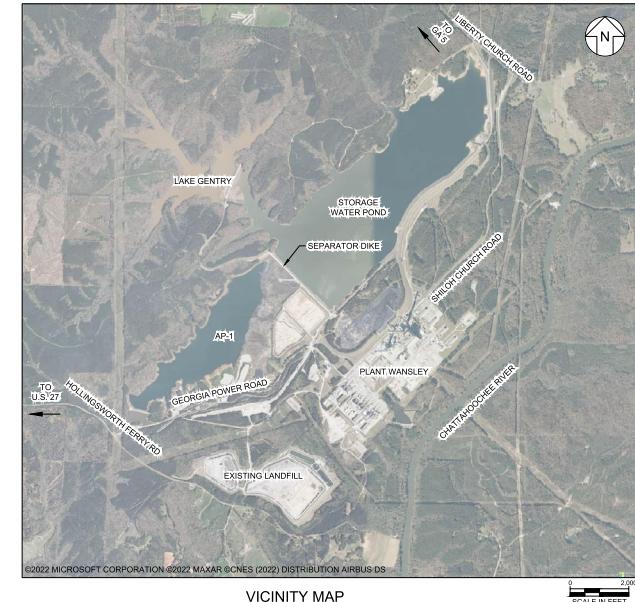

PREPARED FOR:



GEORGIA POWER ENVIRONMENTAL AFFAIRS  
241 RALPH MCGILL BOULEVARD NE  
ATLANTA, GEORGIA 30308-3374  
TELEPHONE: 404.506.6505  
EMAIL: GPCENV@SOUTHERNCO.COM

PHYSICAL SITE ADDRESS:  
PLANT WANSLEY  
1371 LIBERTY CHURCH ROAD  
CARROLLTON, GA 30116

PREPARED BY:



1255 ROBERTS BOULEVARD NW, SUITE 200  
KENNESAW, GEORGIA 30144-3694  
TELEPHONE: 678.202.9500



Approved  
Solid Waste Management Program  
Approved by: Tammy Bushill


*[Signature]*  
Digitally signed by  
Jeremy Gaiser  
Date: 2025.11.10  
15:37:20 -04'00'


|  |               |   |     |     |
|--|---------------|---|-----|-----|
| 2  | 11/10/25      | MINOR PERMIT MOD 2 - REVISION TO AP-1 DESIGN          | WSA | JMG |
| 1  | 07/09/25      | MINOR PERMIT MOD 1 - REVISION TO AP-1 PERMIT BOUNDARY | WSA | JMG |
| 0  | 02/06/25      | GA EPD CCR PERMIT DRAWINGS                            | RJ  | JMG |
| REV  | DATE          | DESCRIPTION   | DRN | APP |
| COVER SHEET  |               |   |     |     |
| PLANT WANSLEY ASH POND CLOSURE BY REMOVAL<br>HEARD AND CARROLL COUNTIES, GEORGIA                                 |               |   |     |     |
| <b>Geosyntec</b><br>consultants  |               | Georgia Power   |     |     |
| 1255 ROBERTS BOULEVARD, NW, SUITE 200<br>KENNESAW, GEORGIA 30144 USA<br>PHONE: 678.202.9500<br>WWW.GEOSYNTEC.COM |               | PROJECT NO. GW9155 DWG. GW7306.13-C01 EDIT 11/10/25   |     |     |
| SCALE  | AS SHOWN      | DRAWING 01 OF 22                                      |     |     |
| DATE   | NOVEMBER 2025 |   |     |     |

| LINETYPE LEGEND   |                                    | HATCH PATTERN LEGEND |                               | ABBREVIATIONS  |   | REFERENCE NOTES   |  |
|---|------------------------------------|----------------------|-------------------------------|--|---|---|--|
| <b>EXISTING</b>   | BATHYMETRY                         | <b>SYMBOL</b>        | <b>COMPONENT</b>              | % PERCENT OR PERCENTILE                              | AASHTO AMERICAN ASSOCIATION OF STATE HIGHWAY AND TRANSPORTATION OFFICIALS | <b>GENERAL NOTES:</b>   |  |
| —   | BAFFLE WALL                        |                      | CCR CONCRETE                  | AC ACRES   | AP-1 ASH POND 1   | 1. GRID COORDINATE SYSTEM CORRESPONDS TO NAD83, GEORGIA WEST ZONE.  |  |
| —   | BOTTOM OF CCR                      |                      | CONTRACTOR LAY DOWN AREA      | APP APPROVED BY                                      | APPROX APPROXIMATE  | 2. ELEVATIONS PRESENTED ARE IN FEET, NAVD88.  |  |
| —   | BOTTOM OF NATIVE SOIL (SAPROLITE)  |                      | DEEP SOIL MIX ZONE            | ASTM AMERICAN SOCIETY FOR TESTING AND MATERIALS      | BMP BEST MANAGEMENT PRACTICE  | 3. TOPOGRAPHY (I.E. EXISTING GROUND CONTOURS) IS BASED ON A LIDAR SURVEY PERFORMED BY ARC SURVEYING AND MAPPING, LLC IN OCTOBER 2021, SUPPLEMENTED WITH DESIGN GRADES FOR FEATURES CONTAINED IN THE AP-1 PERMIT. THE SURVEY WAS PERFORMED AND PROVIDED BY GEOSYNTEC IN SEPTEMBER 2024. BATHYMETRY (I.E. BOTTOM OF POND CONTOURS) WAS OBTAINED BY A MULTIBEAM HYDROGRAPHIC SURVEY COMPLETED AND PROVIDED BY ARC SURVEYING AND MAPPING, LLC IN NOVEMBER 2019.   |  |
| —   | BOTTOM OF PARTIALLY WEATHERED ROCK |                      | HYDROSEED/GRASS STABILIZATION | CER CENTERLINE                                       | CCR COAL COMBUSTION RESIDUALS   | 4. BATHYMETRY REFLECTS THE CONDITIONS AT THE TIME OF THE SURVEY AND MAY NOT REFLECT CURRENT CONDITIONS.   |  |
| —   | FENCE                              |                      | PROTECTIVE SOIL LAYER         | DIA DIAMETER   | CQA CONSTRUCTION QUALITY ASSURANCE  | 5. PLANNED FEATURES AND PROPERTY BOUNDARY ARE APPROXIMATE AND WERE OBTAINED FROM ELECTRONIC FILES PROVIDED BY SCS IN NOVEMBER 2016 AND JUNE 2025.   |  |
| —   | FINISHED GRADE                     |                      | RIPRAP                        | DRN DRAWN BY   | EASTING   | 6. THE LATERAL LIMIT OF CCR IS APPROXIMATE BASED ON DRAWINGS PROVIDED BY SCS AND FIELD DISCUSSIONS WITH WALTERS WATERSHALEY STAFF. FIELD VERIFICATION OF THE ACTUAL LIMIT OF CCR DURING CONSTRUCTION WILL BE REQUIRED.  |  |
| —   | GEOMEMBRANE                        |                      | RIPRAP - SEEPAGE BERM         | DWG DRAWING  | E.G. FOR EXAMPLE  | 7. THE LATERAL LIMIT OF WATER SURFACE WITHIN AP-1 IS BASED ON A POOL ELEVATION OF 781.5 FT, WHICH MAY FLUCTUATE WITH SEASONAL VARIATIONS.   |  |
| —   | GEOTEXTILE SEPARATOR/CUSHION       |                      | SAND                          | EL ELEVATION   | FT FEET   | 8. THE BOTTOM OF CCR SURFACE WAS APPROXIMATED BASED ON A TOPOGRAPHIC SURVEY, PERFORMED FOLLOWING THE CONSTRUCTION OF THE SEPARATOR DIKE AND PRIOR TO RECEIPT OF CCR IN THE SURFACE IMPOUNDMENT (SHEET G-1020, DATED 01 MARCH 1978, PROVIDED BY SCS). IN AREAS WHERE THE POSITION OF THE CCR SURFACE IS UNKNOWN, THE POSITION OF THE HORIZONTAL LINE AT THE BOTTOM OF CCR SURFACE WAS ASSUMED TO BE THE ELEVATION OF THE BATHYMETRIC SURFACE. GEOTECHNICAL DATA FROM 24 BORINGS COLLECTED BY GEOSYNTEC IN SPRING 2017 AND 30 CPTS COLLECTED BY GEOSYNTEC IN SPRING 2019 ALONG THE PROPOSED CONTAINMENT STRUCTURE ALIGNMENT WERE INTEGRATED INTO THE BOTTOM OF CCR SURFACE. BOTTOM OF CCR IS TO BE FIELD VERIFIED WITHIN THE CLOSURE BY REMOVAL AREA. |  |
| —   | LIMIT OF EXISTING CCR              |                      | WATER SURFACE                 | GA EPD GEORGIA ENVIRONMENTAL PROTECTION DIVISION     | I.E. THAT IS  | 9. TOP OF EXISTING CCR WAS ASSUMED AS THE BATHYMETRIC SURFACE IN AREAS COVERED BY WATER AND EXISTING GROUND IN DRY AREAS.   |  |
| —   | LIMIT OF WATER SURFACE             |                      |                               | GDOT GEORGIA DEPARTMENT OF TRANSPORTATION            | ID IDENTIFIER   | 10. SUBGRADE SURFACES (NATIVE SOIL, PVR, AND ROCK) WERE DEVELOPED FROM HISTORICAL BORINGS AND SITE DATA: (I) COLLECTED BY GEOSYNTEC CONSULTANTS IN 2016, 2017, AND 2019; AND (II) PROVIDED BY SCS IN 2016.  |  |
| —   | OVERHEAD POWER TRANSMISSION LINES  |                      |                               | GPC GEORGIA POWER COMPANY                            | IN. INCH  | 11. NO WORK SHALL SIGNIFICANTLY IMPACT THE EXISTING SEPARATOR DIKE BETWEEN AP-1 AND THE STORAGE WATER POND.   |  |
| —   | PERMIT BOUNDARY                    |                      |                               | GSWCC GEORGIA SOIL AND WATER CONSERVATION COMMISSION | INV INVERT  | 12. DEWATERING OF CCR DURING CLOSURE CONSTRUCTION WILL BE PERFORMED IN ACCORDANCE WITH THE ASH POND WATER MANAGEMENT PLAN (SECTION 3 OF PART B OF THIS PERMIT APPLICATION).   |  |
| —   | PROPERTY BOUNDARY                  |                      |                               | H/V HORIZONTAL TO VERTICAL LENGTH RATIO FOR A SLOPE  | LBS POUNDS  | 13. CONTACT WATERMAN AP-1 DURING CLOSURE CONSTRUCTION TO RECEIVE SPECIFICATIONS TO DISCHARGE TREATMENT APPARATUS (TAA) TO THE CLOSURE FEATURES. SPECIFICATIONS PROVIDED IN THE ASH POND WATERING PLAN, NPDES PERMIT NO. GA02677R, WHICH WAS APPROVED BY GA EPD ON NOVEMBER 28, 2021.  |  |
| —   | POTENIOMETRIC SURFACE              |                      |                               | HDPE HIGH DENSITY POLYETHYLENE                       | LLDPE LINEAR LOW DENSITY POLYETHYLENE                                     | 14. DUST CONTROL WILL BE MANAGED AS SPECIFIED IN THE FUGITIVE DUST CONTROL PLAN SECTION OF THE CLOSURE PLAN (SECTION 7 OF PART A WITHIN THIS PERMIT APPLICATION).   |  |
| —   | RAILROAD                           |                      |                               | HECP HYDRAULIC EROSION CONTROL PRODUCTS              | LOD LIMITS OF DISTURBANCE   | 15. PERMIT BOUNDARY WAS DEVELOPED BY ESTABLISHING A MINIMUM 200-FT OFFSET UPGRADE OF AP-1, WHICH INCORPORATES ALL DOWNGRADIENT MONITORING WELLS, AND GENERALLY FOLLOWS THE PLANT ROAD ALONG THE SOUTH SIDE OF AP-1.   |  |
| —   | SURFACE WATER PIPE                 |                      |                               | I.E. THAT IS   | MAX MAXIMUM   | 16. MONITORING WELL AND PIROMETER COORDINATES WERE OBTAINED FROM THE GROUNDWATER MONITORING PLAN (SECTION 7 OF PART A WITHIN THIS PERMIT APPLICATION).  |  |
| —   | TURBIDITY CURTAIN                  |                      |                               | ID IDENTIFIER  | MIL ONE-THOUSANDTH OF AN INCH   | 17. ACCESS ROADS, ACCESS RAMPS, AND ASSOCIATED STORMWATER FEATURES WILL BE EVALUATED AS PART OF THE DETAILED DESIGN.  |  |
|   |                                    |                      |                               | IN. INCH   | MINIMUM   |   |  |
|   |                                    |                      |                               | INV INVERT   | N NITROGEN / NORTH / NORTHING   |   |  |
|   |                                    |                      |                               | LBS POUNDS   | NAD83 NORTH AMERICAN DATUM OF 1983  |   |  |
|   |                                    |                      |                               | LLDPE LINEAR LOW DENSITY POLYETHYLENE                | NAVD88 NORTH AMERICAN VERTICAL DATUM OF 1988                              |   |  |
|   |                                    |                      |                               | LOD LIMITS OF DISTURBANCE                            | NO NUMBER   |   |  |
|   |                                    |                      |                               | MAX MAXIMUM  | NPDES NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM                     |   |  |
|   |                                    |                      |                               | MIL ONE-THOUSANDTH OF AN INCH                        | N-P-K NITROGEN-PHOSPHORUS-POTASSIUM                                       |   |  |
|   |                                    |                      |                               | MINIMUM  | NSA NATIONAL STONE ASSOCIATION  |   |  |
|   |                                    |                      |                               | INV INVERT   | NTS NOT TO SCALE  |   |  |
|   |                                    |                      |                               | NW NORTHWEST   | NW NORTHWEST  |   |  |
|   |                                    |                      |                               | OC ON CENTER   | OC ON CENTER  |   |  |
|   |                                    |                      |                               | PC PERIMETER CHANNEL                                 | PC PERIMETER CHANNEL  |   |  |
|   |                                    |                      |                               | PPM PARTS PER MILLION                                | PPM PARTS PER MILLION   |   |  |
|   |                                    |                      |                               | PROJ PROJECT   | PROJ PROJECT  |   |  |
|   |                                    |                      |                               | PWR PARTIALLY WEATHERED ROCK                         | PWR PARTIALLY WEATHERED ROCK  |   |  |
|   |                                    |                      |                               | PZ PIEZOMETER  | PZ PIEZOMETER   |   |  |
|   |                                    |                      |                               | RECp ROLLED EROSION CONTROL PRODUCTS                 | RECp ROLLED EROSION CONTROL PRODUCTS                                      |   |  |
|   |                                    |                      |                               | REV REVISION   | REV REVISION  |   |  |
|   |                                    |                      |                               | SCS SOUTHERN COMPANY SERVICES                        | SCS SOUTHERN COMPANY SERVICES   |   |  |
|   |                                    |                      |                               | SF SILT FENCE  | SF SILT FENCE   |   |  |
|   |                                    |                      |                               | SQ FT SQUARE FEET                                    | SQ FT SQUARE FEET   |   |  |
|   |                                    |                      |                               | STA STATION  | STA STATION   |   |  |
|   |                                    |                      |                               | Typ TYPICAL  | Typ TYPICAL   |   |  |
|   |                                    |                      |                               | W.S. WATER SURFACE                                   | W.S. WATER SURFACE  |   |  |
| <b>DETAIL AND SECTION IDENTIFICATION LEGEND</b>   |                                    |                      |                               |  |   |   |  |
| <p>EXAMPLE: DETAIL NUMBER 4 WHICH IS PRESENTED ON DRAWING NO. 6 WAS FIRST REFERENCED ON DRAWING NO. 3.</p> <p>ABOVE SYSTEM ALSO APPLIES TO SECTION IDENTIFICATIONS.</p>   |                                    |                      |                               |  |   |   |  |
| <p>SECTION LETTER ON WHICH ABOVE DETAIL WAS FIRST REFERENCED</p> <p>SECTION LETTER</p> <p>SECTION TITLE</p> <p>SCALE: 1" = 10' (HORIZONTAL); 1" = 20' (VERTICAL)</p> <p>EXAMPLE: SECTION LETTER "A" WHICH IS PRESENTED ON DRAWING NO. 6 WAS FIRST REFERENCED ON DRAWING NO. 3.</p> <p>NOTE: CONVENTION PROVIDED ABOVE IS APPLICABLE</p>   |                                    |                      |                               |  |   |   |  |
| <b>CONTOUR LEGEND</b>   |                                    |                      |                               |  |   |   |  |
| <b>EXISTING</b>   |                                    |                      |                               | <b>PROPOSED</b>                                      |   |   |  |
| 400   |                                    |                      |                               | BATHYMETRIC ELEVATION (FEET)                         |   |   |  |
| 750   |                                    |                      |                               | EXISTING GROUND ELEVATION (FEET)                     |   |   |  |
| 430   |                                    |                      |                               | FINISHED GRADE ELEVATION (FEET)                      |   |   |  |
| <p><b>GEORGIA</b><br/>Department of Natural Resources<br/>ENVIRONMENTAL PROTECTION DIVISION<br/><b>Approved</b><br/>Solid Waste Management Program<br/>Approved by: Tammy Buchi<br/>Date: 11/16/2024</p>  |                                    |                      |                               |  |   |   |  |
| <b>LEGENDS, SYMBOLS, AND ABBREVIATIONS</b>  |                                    |                      |                               |  |   |   |  |
| PLANT WALTERS ASH POND CLOSURE BY REMOVAL<br>HEARD AND CARROLL COUNTIES, GEORGIA  |                                    |                      |                               |  |   |   |  |
| <p>Digitally signed by<br/>Jeremy Gossler<br/>on 2024-11-10<br/>13:03:07 -05'00"</p> <p><b>GEORGIA</b><br/>No PERMIT ISSUED<br/>Engineering<br/>Jeremy Gossler</p>  |                                    |                      |                               |  |   |   |  |
| <p>UPDATED REFERENCES TO<br/>EXISTING LATERAL SURVEYS<br/>AND DESIGN GRADES</p> <p><b>Geosyntec</b><br/>consultants</p> <p>1056 ROBERTS BOULEVARD, NW, SUITE 200<br/>KENNESAW, GEORGIA 30144 USA<br/>PHONE: 678.202.9500<br/>WWW.GEOSYNTEC.COM</p> <p>PROJ. NO.: GW9155 DWG. GW730K13-C02 EDIT 9/18/25<br/>SCALE AS SHOWN DRAWING NO. 02 OF 22<br/>DATE NOVEMBER 2025</p> <p><b>Georgia Power</b></p> |                                    |                      |                               |  |   |   |  |






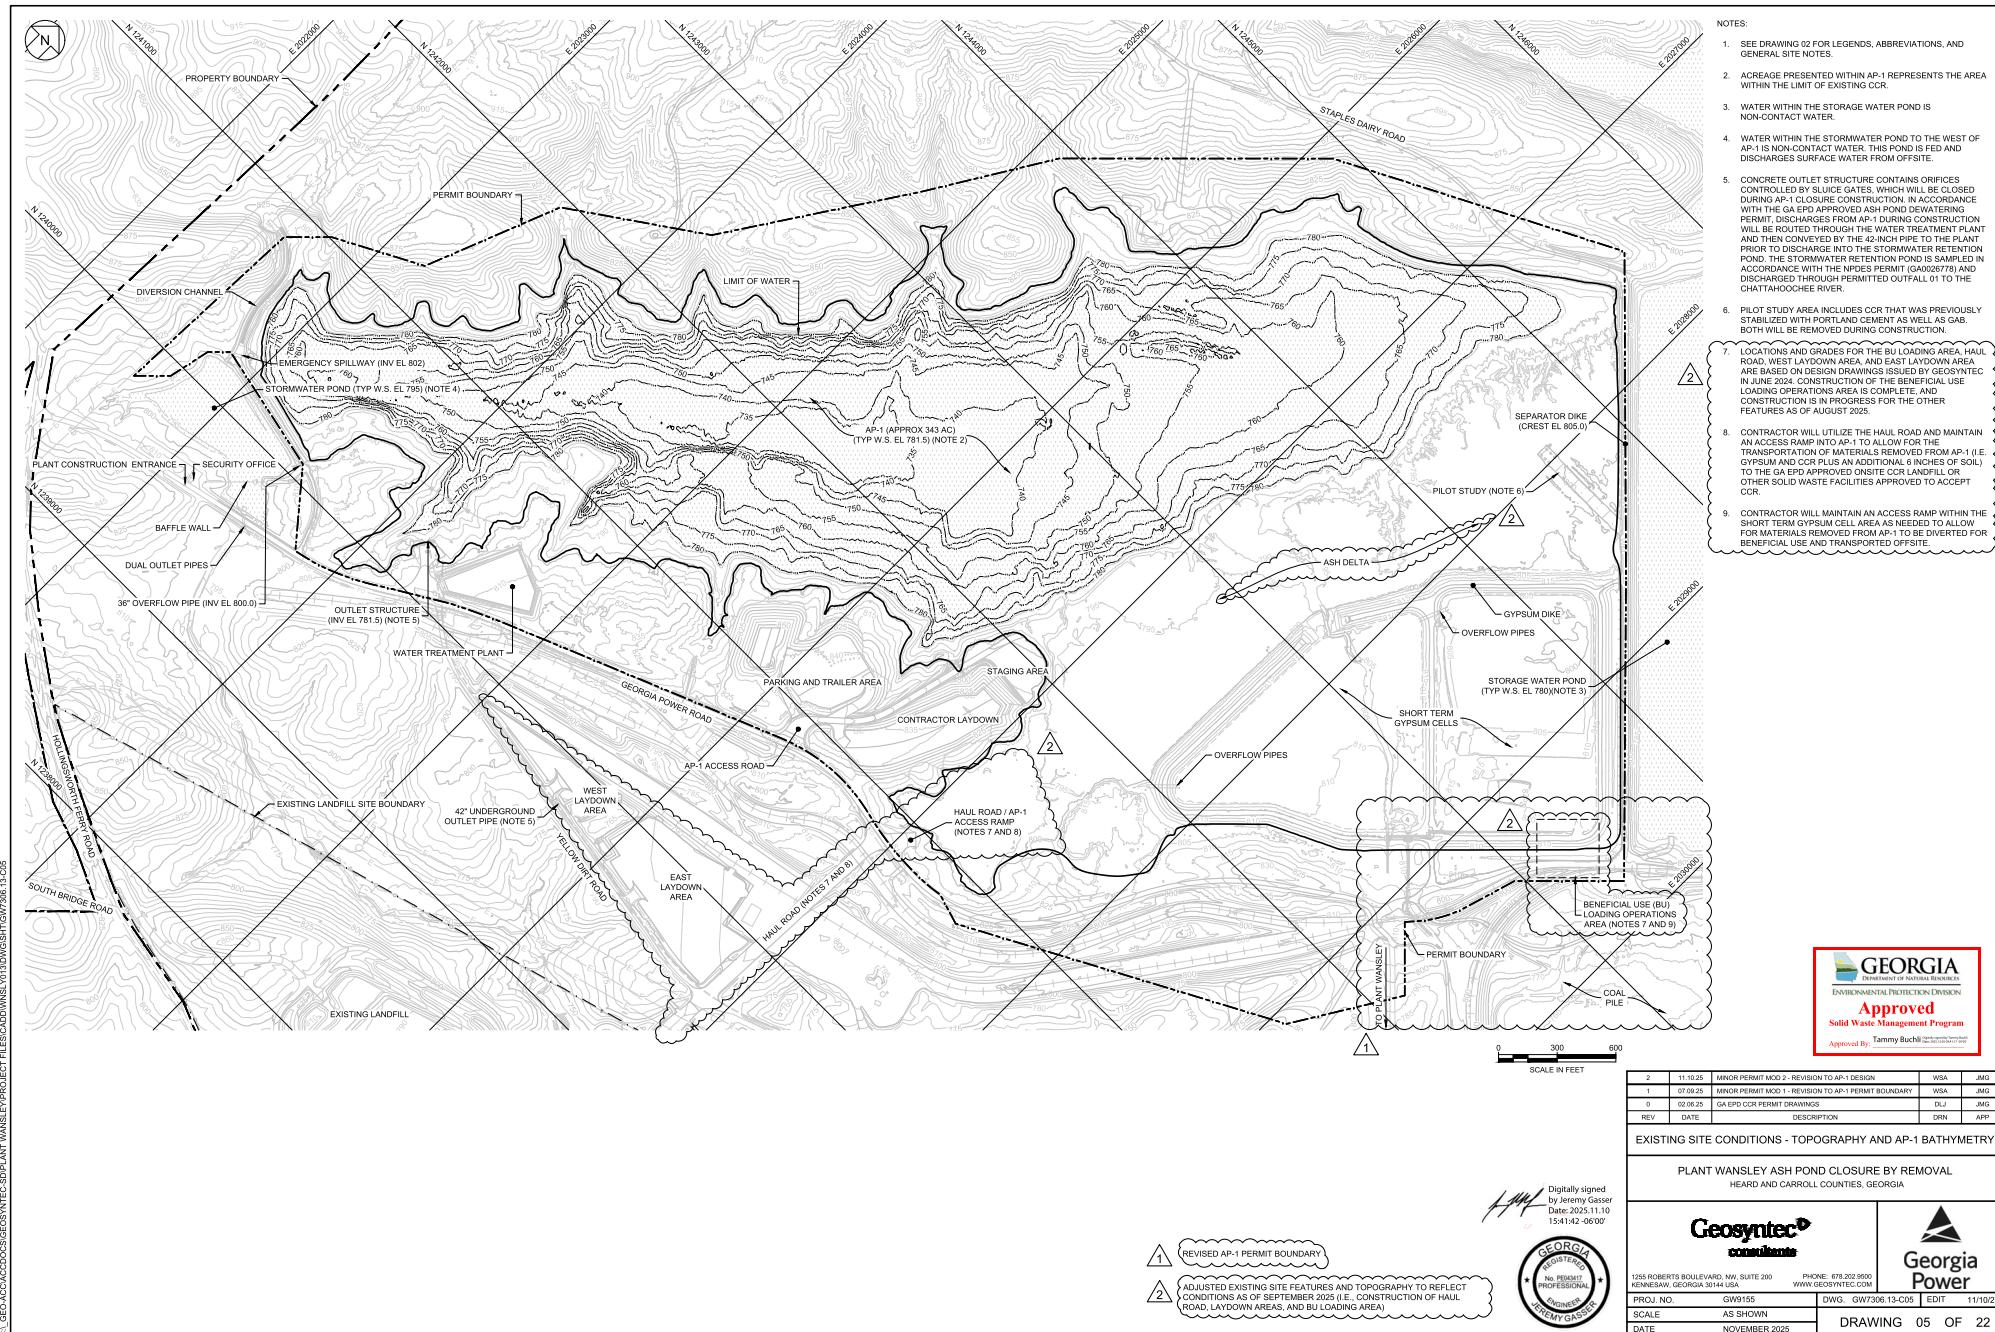

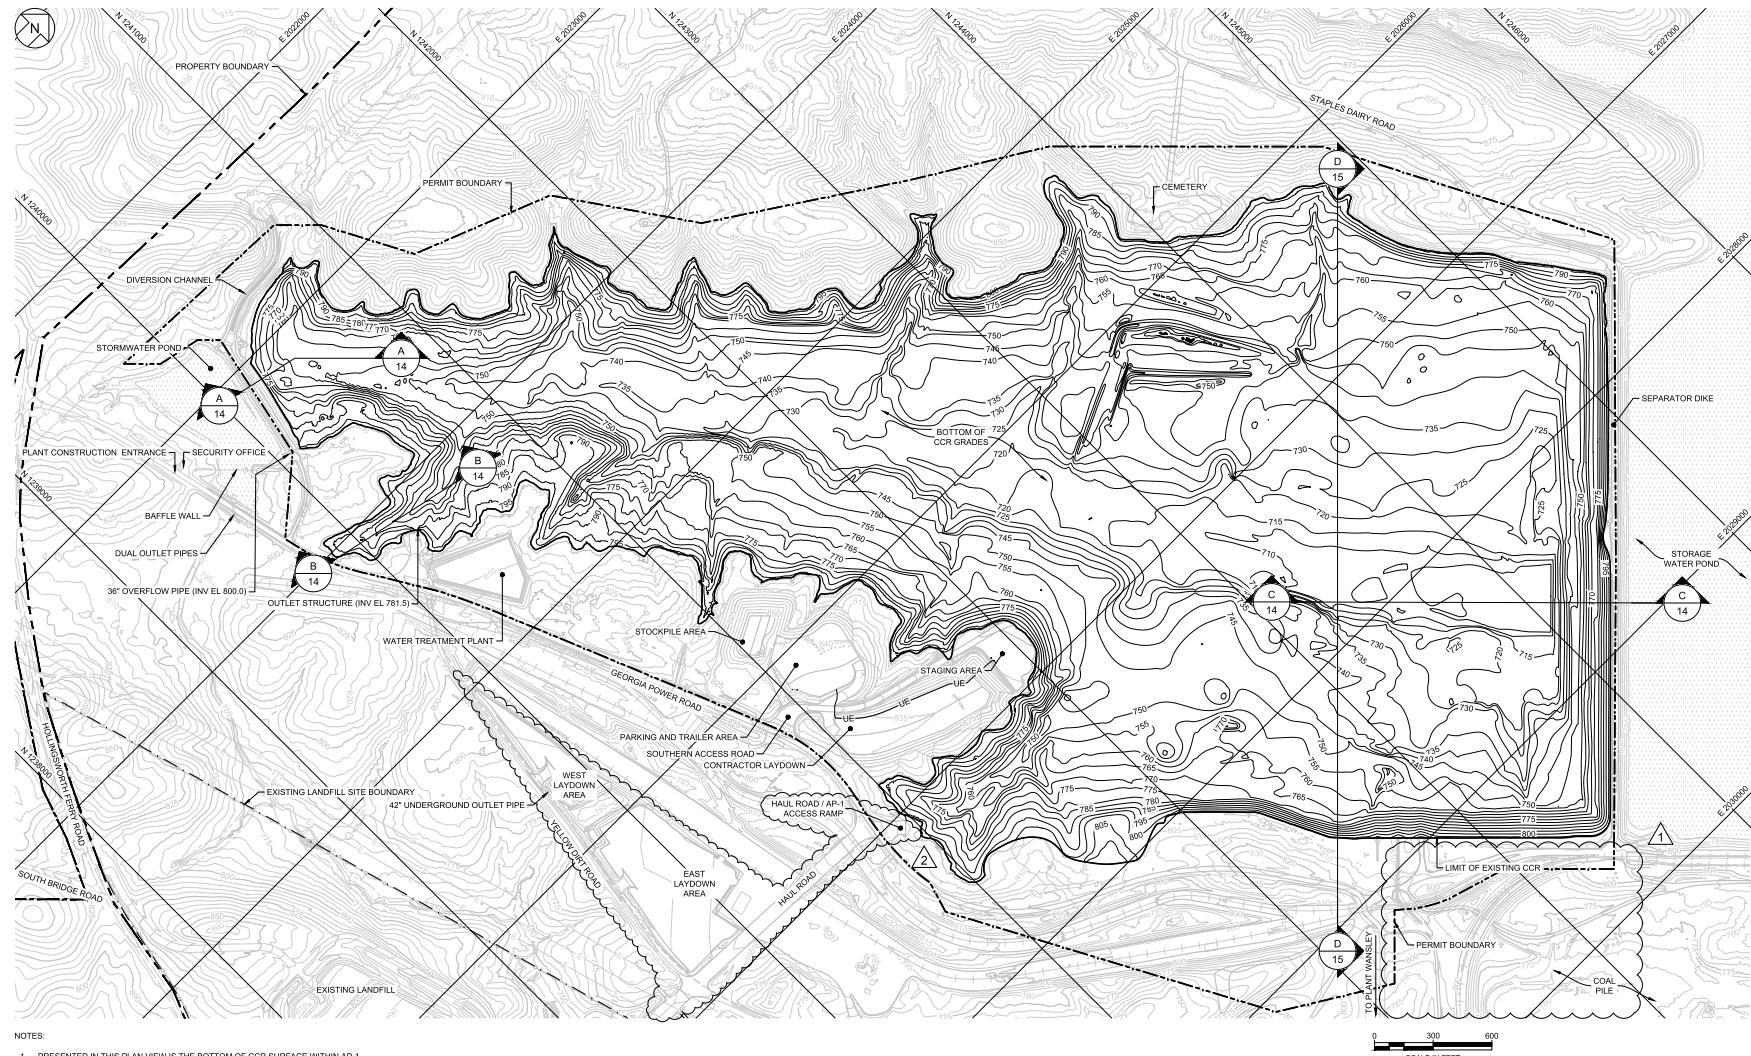

## NOTES:

- PRESSENTED IN THIS PLAN VIEW IS THE BOTTOM OF CCR SURFACE WITHIN AP-1. ADDITIONAL 6-INCHES OF REMOVAL NOT SHOWN FOR CLARITY.
- LATERAL AND VERTICAL LIMIT OF THE BOTTOM OF CCR IS APPROXIMATE AND IS TO BE FIELD VERIFIED DURING CONSTRUCTION.
- BULK OF CCR REMOVAL MAY BE ACHIEVED BY CONTRACTOR MEANS AND METHODS (E.G., CONVENTIONAL EXCAVATION OR DREDGING). FINAL REMOVAL OF CCR AND VERIFICATION OF REMOVAL WILL BE COMPLETED IN THE DRY VIA CONVENTIONAL EXCAVATION.
- SHRINK REQUIREMENTS FOR INTERM CUT SLOPES TO MAINTAIN STABILITY OF CCR DURING CONSTRUCTION WILL BE ESTABLISHED AS PART OF THE DETAILED DESIGN AND CONTRACTOR WORK PLANS.
- CCR VERIFICATION OF REMOVAL WILL BE COMPLETED BY THE COA CONSULTANT ON A 100'-FT BY 100'-FT GRID SYSTEM. FOLLOWING VERIFICATION OF CCR REMOVAL, THE CONTRACTOR WILL REMOVE 6-INCHES OF NATIVE SOIL AND COA CONSULTANT WILL AGAIN COMPLETE THE VERIFICATION PROCESS TO CERTIFY CCR REMOVAL.
- 100'-FT BY 100'-FT GRID SYSTEM IS NOT SHOWN ON THIS DRAWING FOR CLARITY. SEE DRAWINGS 07 THROUGH 11.

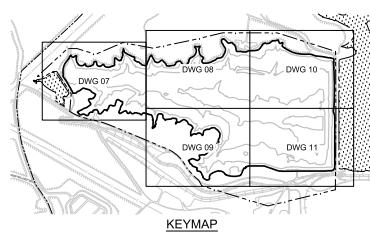



Digitally signed by Jeremy Gasser  
Date: 2025.11.10  
15:42:29 -06'00'

**GEORGIA**  
REGISTERED  
PROFESSIONAL  
ENGINEER  
JEREMY GASSER

- ① REVISED AP-1 PERMIT BOUNDARY  
② ADJUSTED EXISTING SITE FEATURES AND TOPOGRAPHY TO REFLECT CONDITIONS AS OF SEPTEMBER 2025 (I.E., CONSTRUCTION OF HAUL ROAD AND LAYDOWN AREAS)


|   |               |   |               |                  |
|---|---------------|---|---------------|------------------|
| 2   | 11-10-05      | MINOR PERMIT MOD 2 - REVISION TO AP-1 DESIGN          | WSA           | JMG              |
| 1   | 02-09-05      | MINOR PERMIT MOD 1 - REVISION TO AP-1 PERMIT BOUNDARY | WSA           | JMG              |
| 0   | 02-09-25      | GA EPD COR PERMIT DRAWINGS                            | RJL           | JMG              |
| REV DATE DESCRIPTION DRN APP  |               |   |               |                  |
| <b>CCR REMOVAL PLAN - OVERVIEW</b>  |               |   |               |                  |
| PLANT WANSLEY ASH POND CLOSURE BY REMOVAL<br>HEARD AND CARROLL COUNTIES, GEORGIA                                |               |   |               |                  |
| <b>Geosyntec</b> consultants  |               |   |               |                  |
| Georgia Power   |               |   |               |                  |
| 1255 ROBERTS BOULEVARD, NW SUITE 200<br>KENNESAW, GEORGIA 30144 USA<br>PHONE: 678.502.9000<br>WWW.GEOSYNTEC.COM |               |   |               |                  |
| PROJ. NO.   | GW9155        | DWG.  | GW7306-13-C06 | EDIT 11/10/25    |
| SCALE   | AS SHOWN      |   |               |                  |
| DATE  | NOVEMBER 2025 |   |               | DRAWING 06 OF 22 |

- NOTES:
- PRESSENTED IN THIS PLAN VIEW IS THE BOTTOM OF CCR SURFACE WITHIN AP-1. ADDITIONAL 6-INCHES OF REMOVAL NOT SHOWN FOR CLARITY.
  - LATERAL AND VERTICAL LIMIT OF THE BOTTOM OF CCR IS APPROXIMATE AND IS TO BE FIELD VERIFIED DURING CONSTRUCTION.
  - BULK OF CCR REMOVAL MAY BE ACHIEVED BY CONTRACTOR MEANS AND METHODS (E.G., CONVENTIONAL EXCAVATION OR DREDGING). FINAL REMOVAL OF CCR AND VERIFICATION OF REMOVAL WILL BE COMPLETED IN THE DRY VIA CONVENTIONAL EXCAVATION.
  - GRADING REQUIREMENTS FOR INTERIM CUT SLOPES TO MAINTAIN STABILITY OF CCR DURING CONSTRUCTION WILL BE ESTABLISHED AS PART OF THE DETAILED DESIGN AND CONTRACTOR WORK PLANS.
  - CCR VERIFICATION OF REMOVAL WILL BE COMPLETED BY THE CQA CONSULTANT ON A 100-Ft BY 100-Ft GRID SYSTEM. FOLLOWING VERIFICATION OF CCR REMOVAL, THE CONTRACTOR WILL REMOVE 6-INCHES OF NATIVE SOIL AND CQA CONSULTANT WILL AGAIN COMPLETE THE VERIFICATION PROCESS TO CERTIFY CCR REMOVAL.

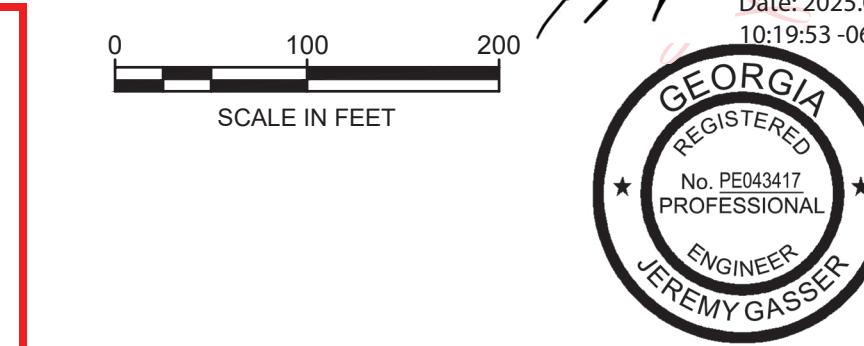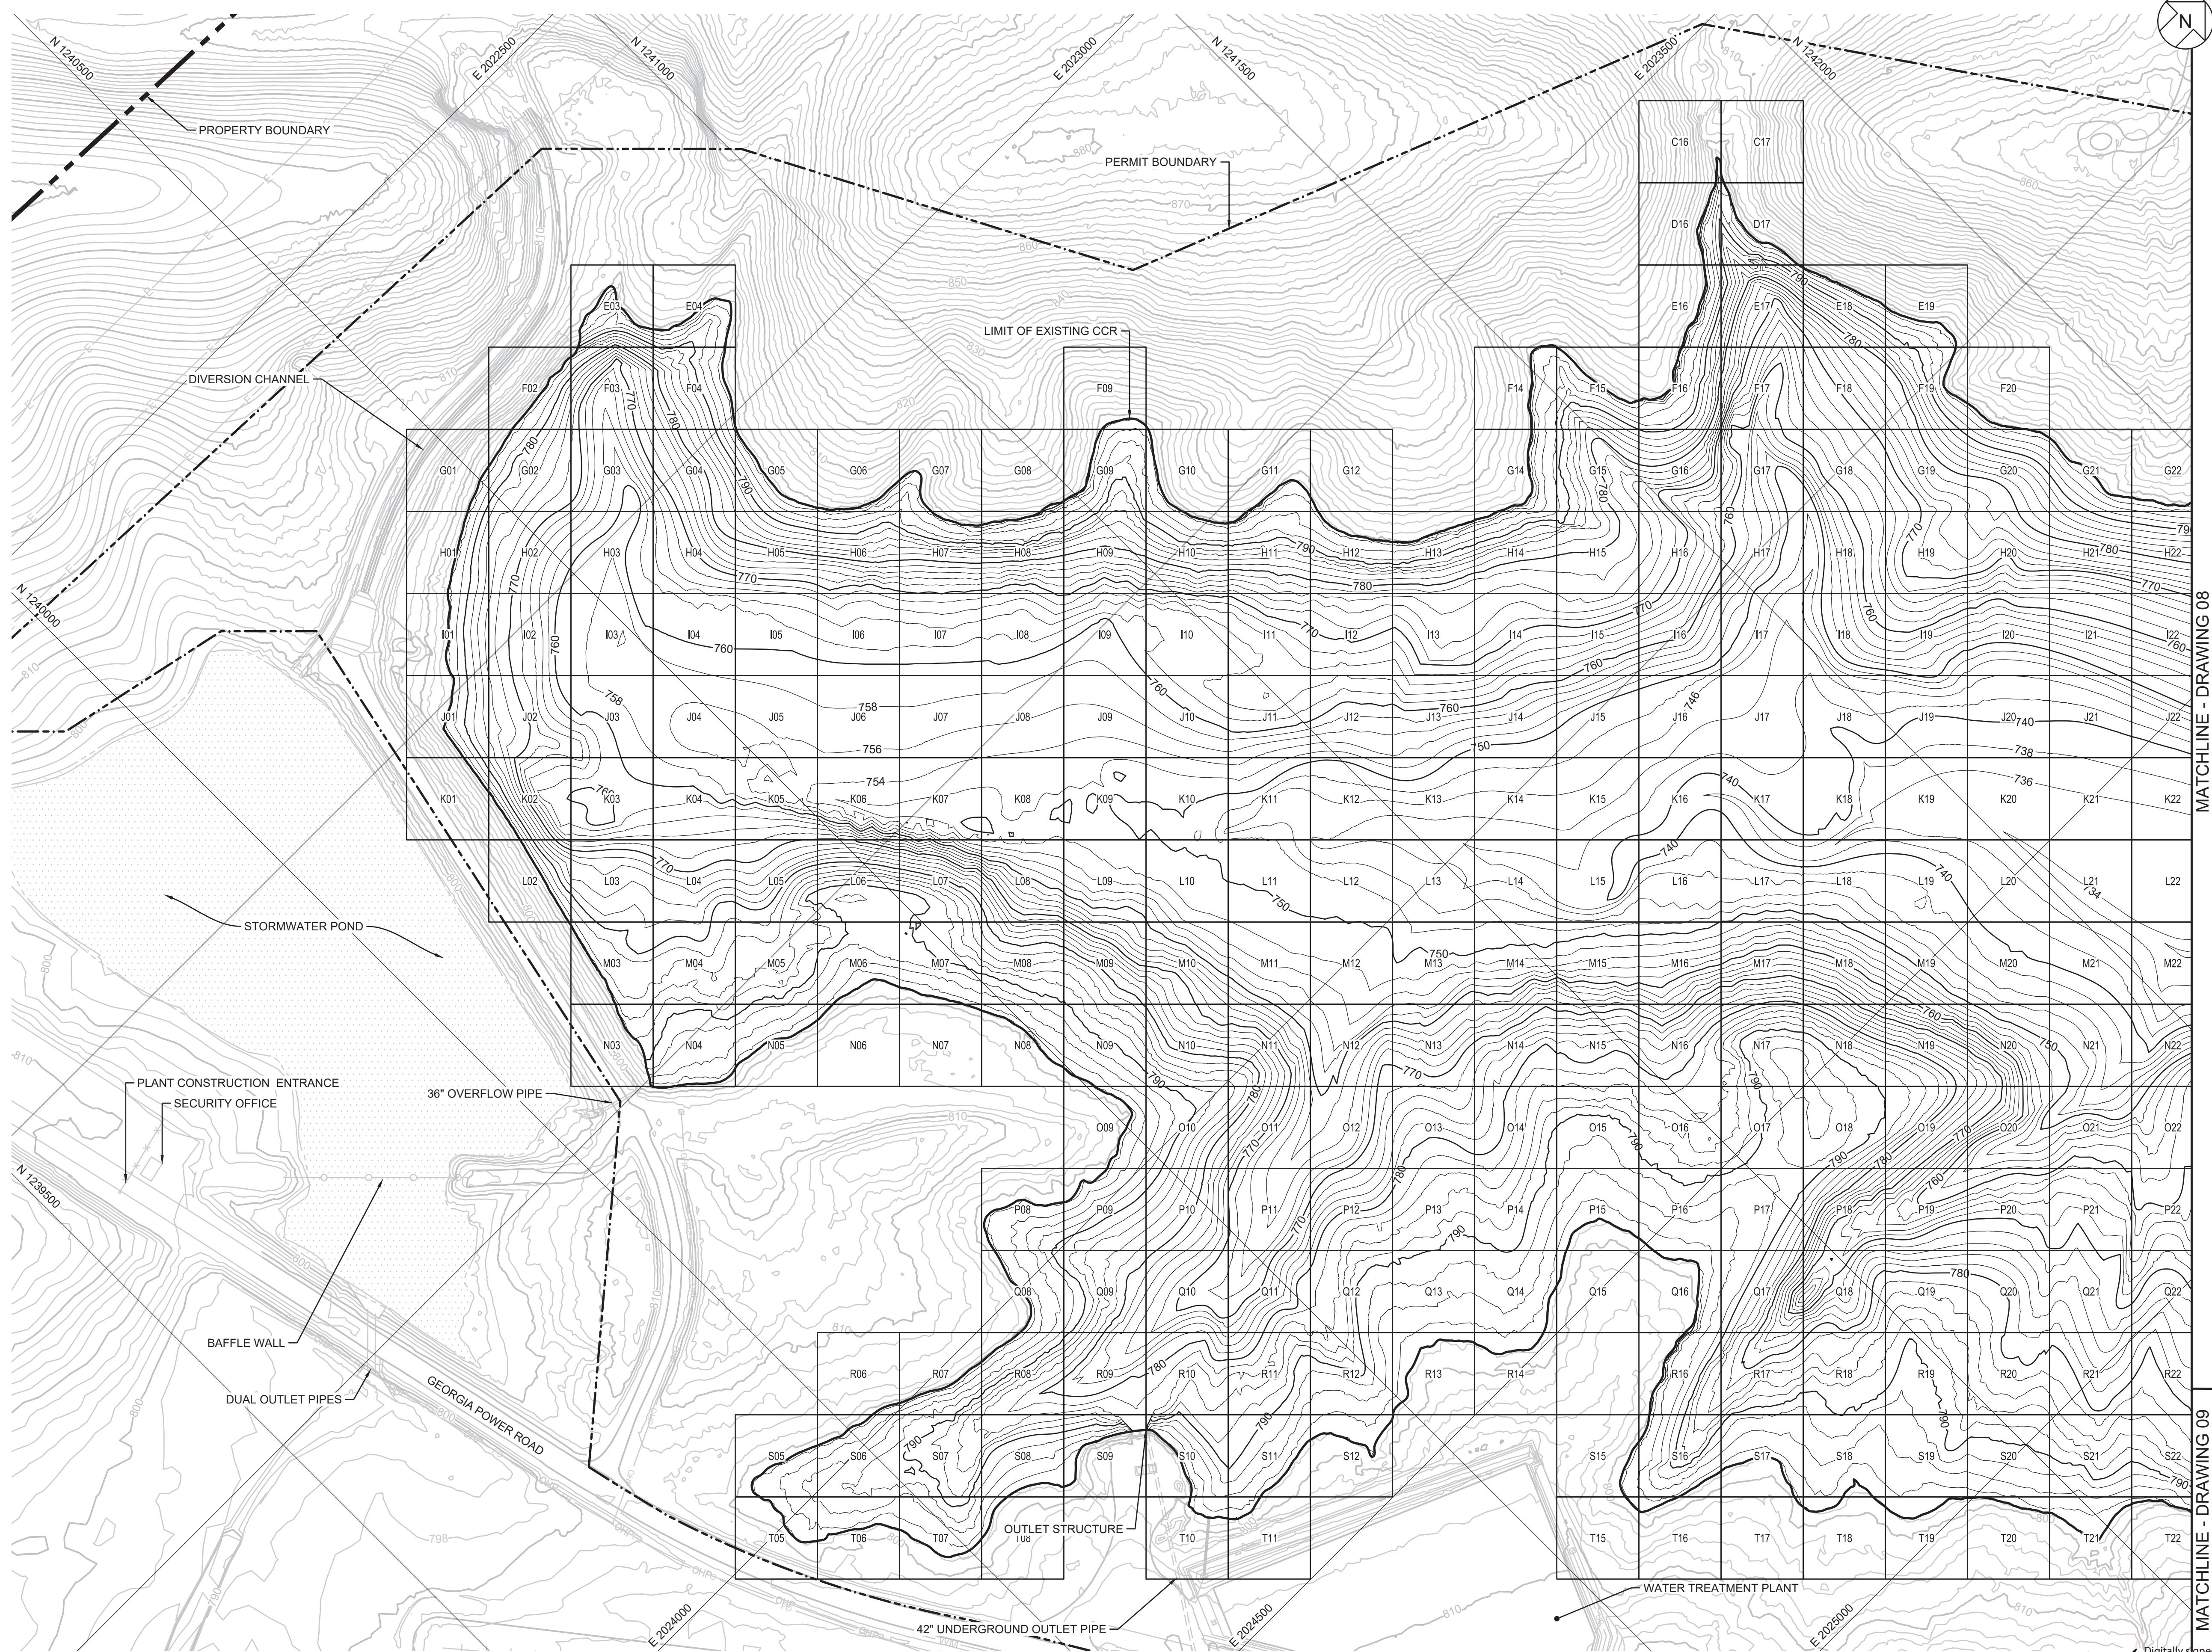

| 0  | 02.06.25      | GA EPD CCR PERMIT DRAWINGS | DLJ  | JMG    |
|--|---------------|----------------------------|------|--------|
| REV  | DATE          | DESCRIPTION                | DRN  | APP    |
| <b>CCR REMOVAL PLAN - I</b>  |               |                            |      |        |
| <b>PLANT WANSLEY ASH POND CLOSURE BY REMOVAL</b><br>HEARD AND CARROLL COUNTIES, GEORGIA  |               |                            |      |        |
| <b>Geosyntec</b> consultants<br><br><b>Georgia Power</b><br> |               |                            |      |        |
| PROJ. NO.  | GW9155        | DWG. GW7306.13-C07         | EDIT | 5/2/24 |
| SCALE  | AS SHOWN      |                            |      |        |
| DATE   | FEBRUARY 2025 | DRAWING                    | 07   | OF 22  |


- NOTES:
- PRESSENTED IN THIS PLAN VIEW IS THE BOTTOM OF CCR SURFACE WITHIN AP-1. ADDITIONAL 6-INCHES OF REMOVAL NOT SHOWN FOR CLARITY.
  - LATERAL AND VERTICAL LIMIT OF THE BOTTOM OF CCR IS APPROXIMATE AND IS TO BE FIELD VERIFIED DURING CONSTRUCTION.
  - BULK OF CCR REMOVAL MAY BE ACHIEVED BY CONTRACTOR MEANS AND METHODS (E.G., CONVENTIONAL EXCAVATION OR DREDGING). FINAL REMOVAL OF CCR AND VERIFICATION OF REMOVAL WILL BE COMPLETED IN THE DRY VIA CONVENTIONAL EXCAVATION.
  - GRADING REQUIREMENTS FOR INTERIM CUT SLOPES TO MAINTAIN STABILITY OF CCR DURING CONSTRUCTION WILL BE ESTABLISHED AS PART OF THE DETAILED DESIGN AND CONTRACTOR WORK PLANS.
  - CCR VERIFICATION OF REMOVAL WILL BE COMPLETED BY THE CQA CONSULTANT ON A 100-FT BY 100-FT GRID SYSTEM. FOLLOWING VERIFICATION OF CCR REMOVAL, THE CONTRACTOR WILL REMOVE 6-INCHES OF NATIVE SOIL AND CQA CONSULTANT WILL AGAIN COMPLETE THE VERIFICATION PROCESS TO CERTIFY CCR REMOVAL.

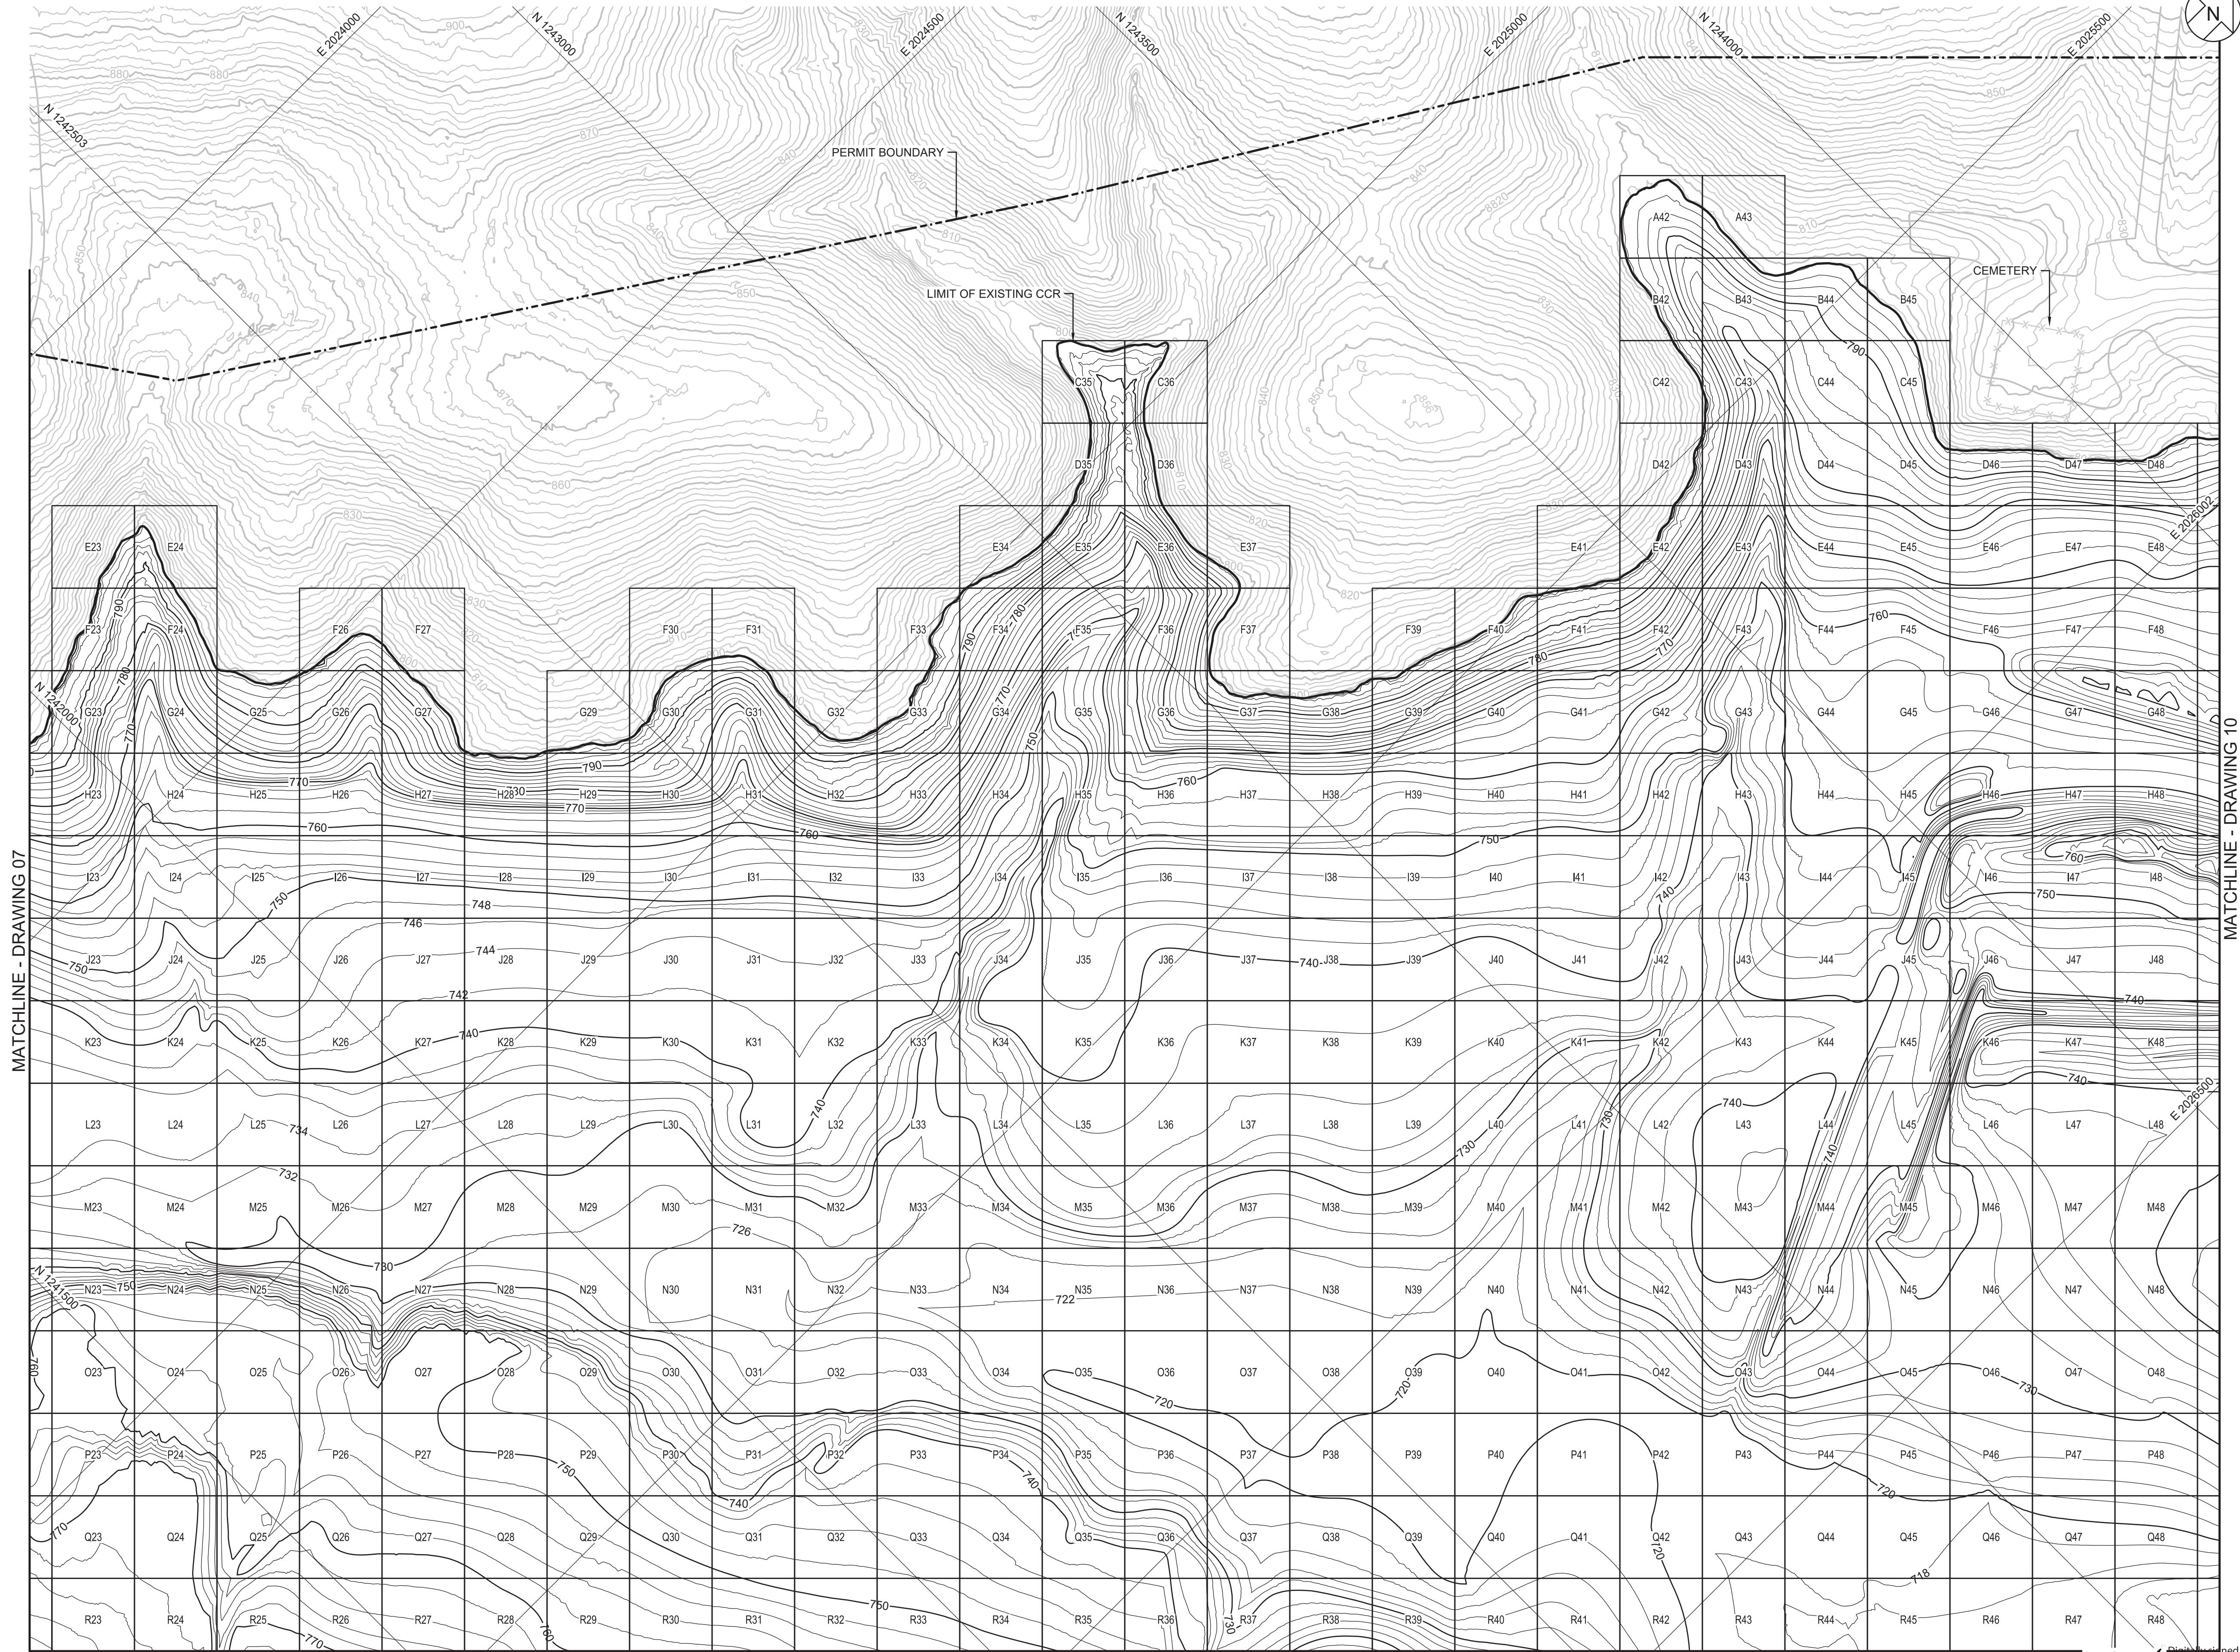


| 0  | 02.06.25 | GA EPD CCR PERMIT DRAWINGS | DLJ | JMG |
|--|----------|----------------------------|-----|-----|
| REV  | DATE     | DESCRIPTION                | DRN | APP |
| CCR REMOVAL PLAN - II  |          |                            |     |     |
| PLANT WANSLEY ASH POND CLOSURE BY REMOVAL<br>HEARD AND CARROLL COUNTIES, GEORGIA |          |                            |     |     |

|  |                    |
|--|--------------------|
| Geosyntec<br>consultants   | Georgia<br>Power   |
| 1255 ROBERTS BOULEVARD, NW, SUITE 200<br>KENNESAW, GEORGIA 30144 USA<br>PHONE: 678.202.9500<br>WWW.GEOSYNTEC.COM |                    |
| PROJ. NO. GW9155   | DWG. GW7306.13-C08 |
| SCALE AS SHOWN   | EDIT 5/2/24        |
| DATE FEBRUARY 2025   | DRAWING 08 OF 22   |



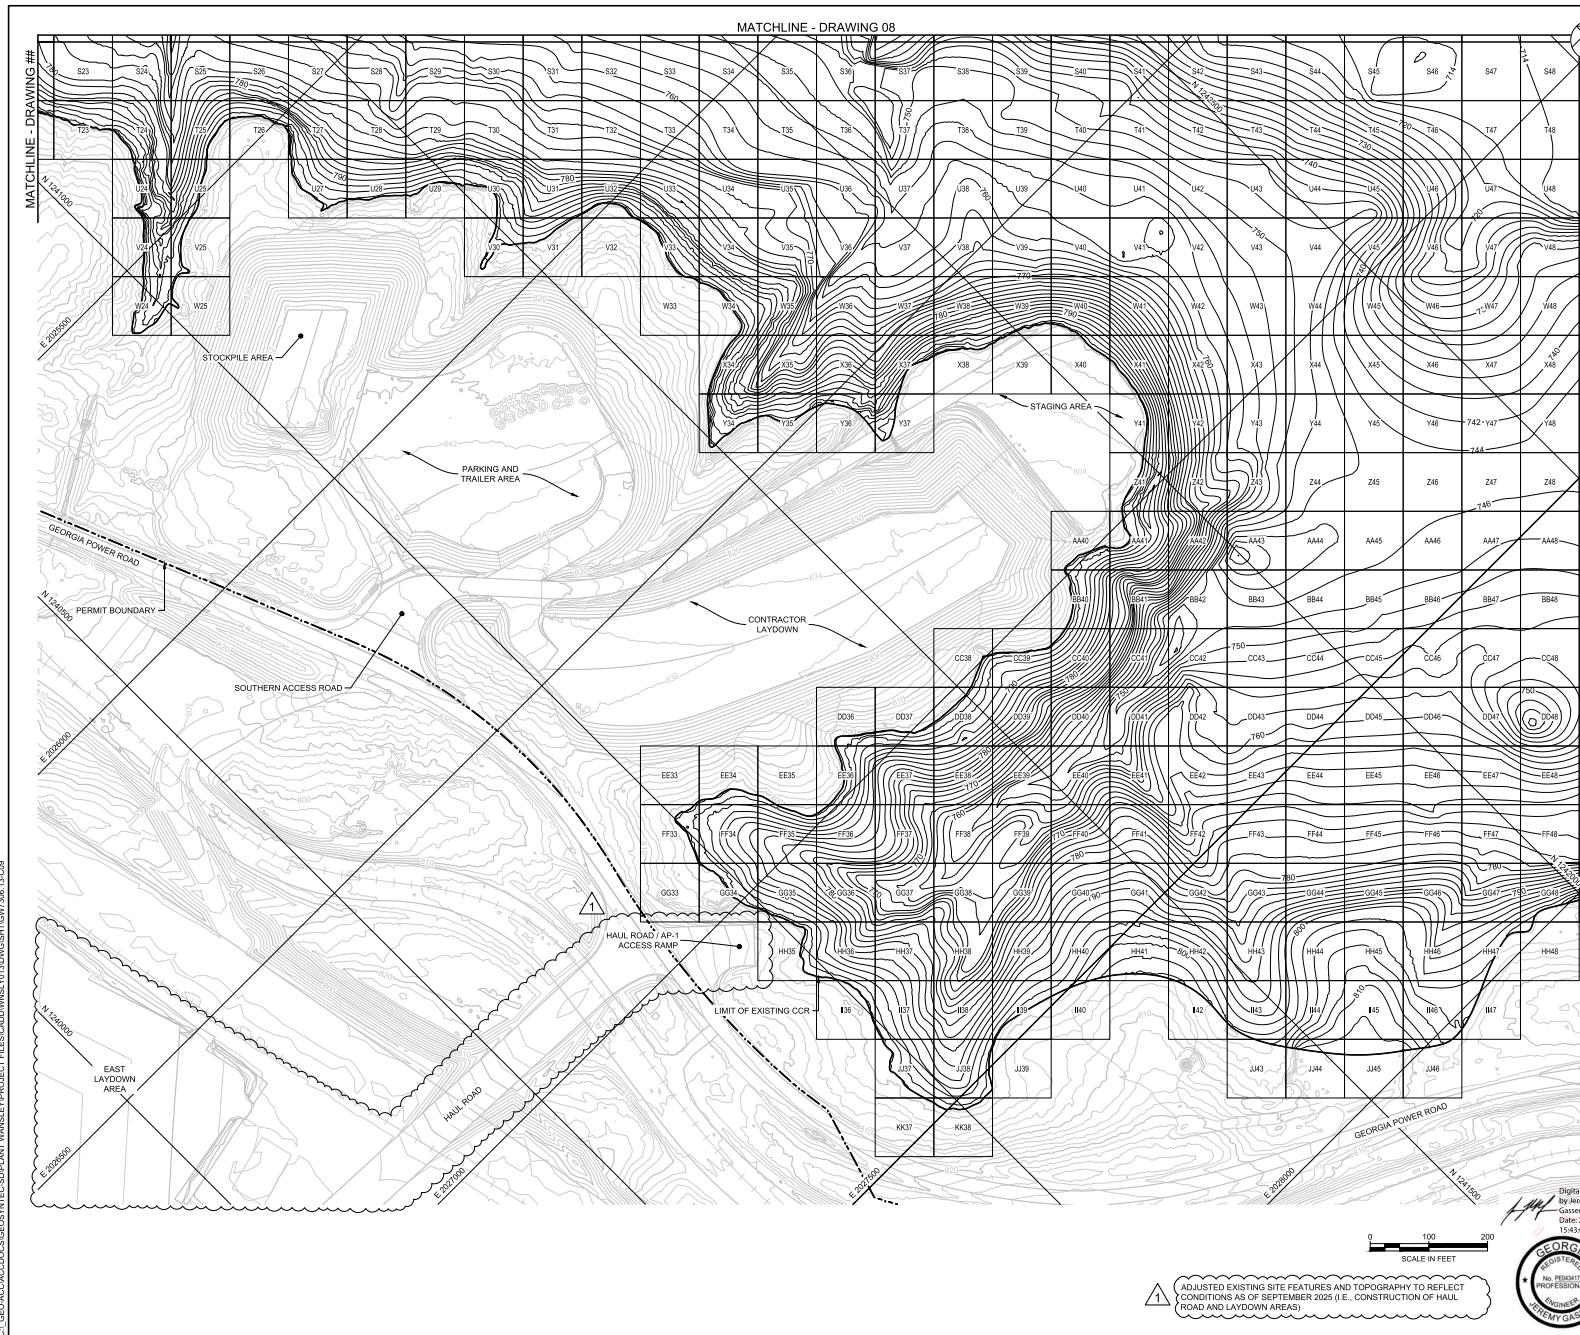


## MATCHLINE - DRAWING 08

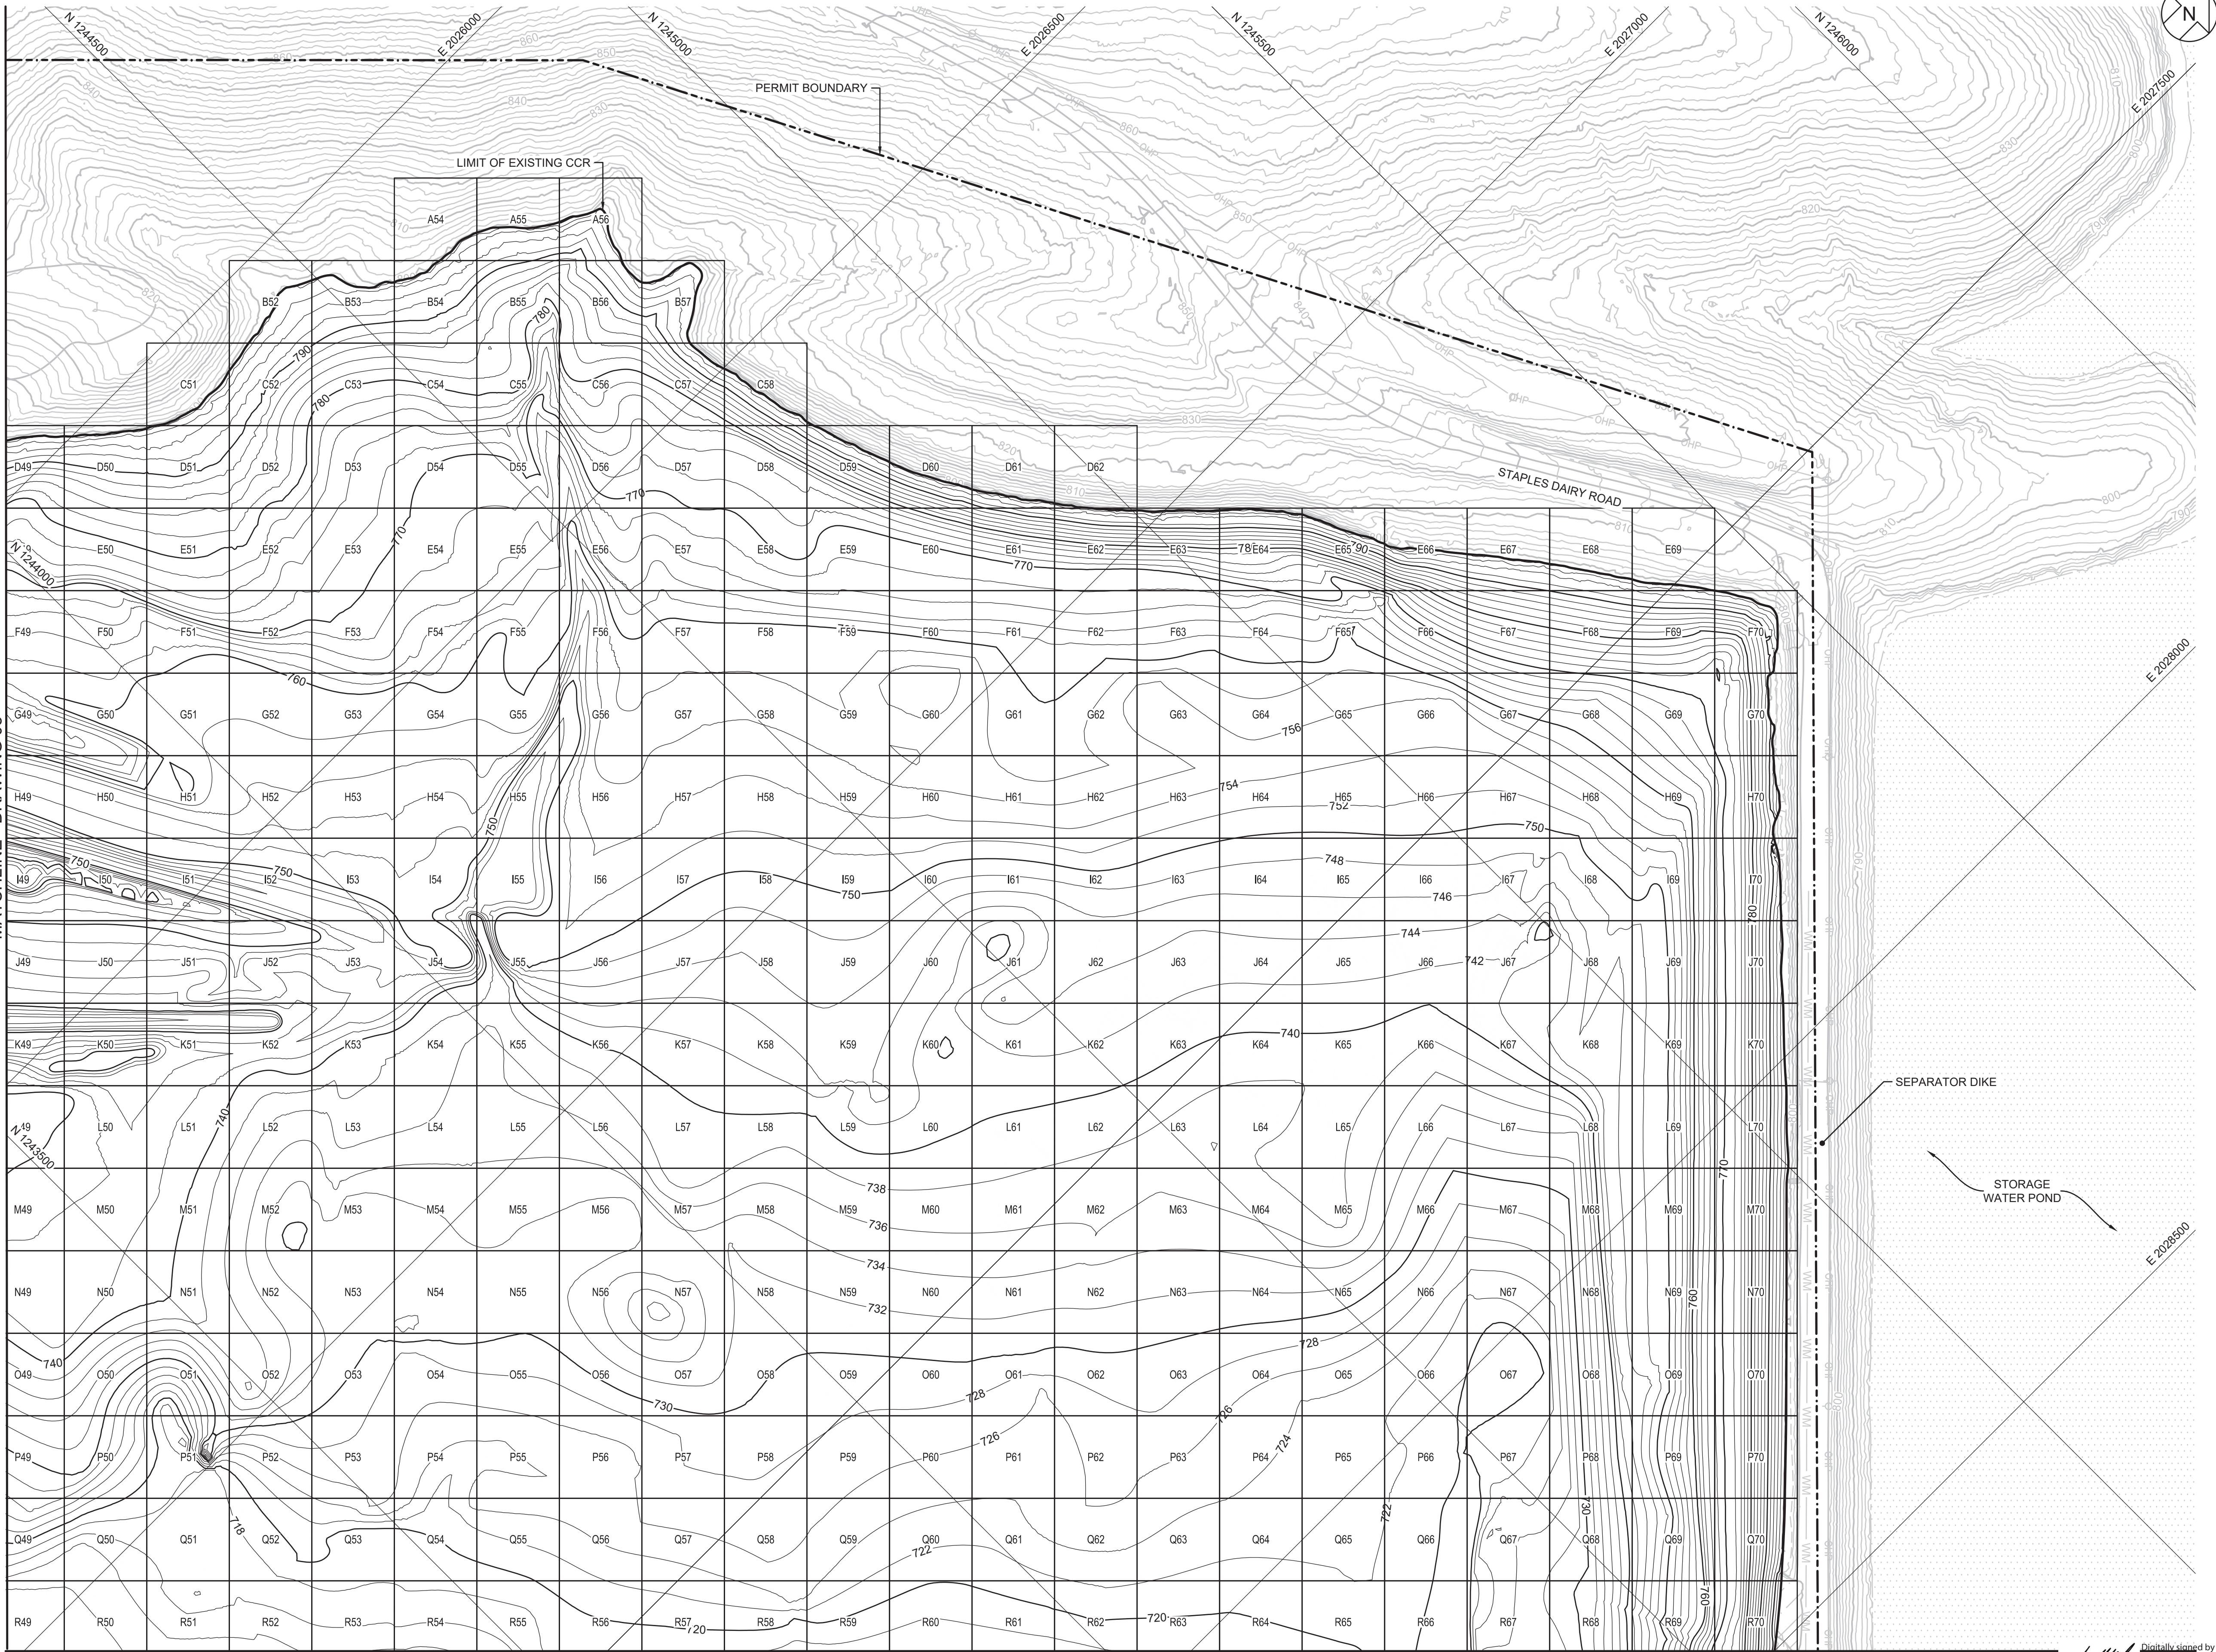

| 0  | 02.06.25 | GA EPD CCR PERMIT DRAWINGS | DLJ | JMG |
|--|----------|----------------------------|-----|-----|
| REV  | DATE     | DESCRIPTION                | DRN | APP |
| CCR REMOVAL PLAN - IV  |          |                            |     |     |
| PLANT WANSLEY ASH POND CLOSURE BY REMOVAL<br>HEARD AND CARROLL COUNTIES, GEORGIA |          |                            |     |     |

|  |  |  |
|--|--|--|
| <br><b>Approved</b><br><b>Solid Waste Management Program</b><br><small>Approved By: Keith Stevens</small>                          | <br><small>No. PE093417<br/>Date: 2025.02.07<br/>10:21:40 - 06:00'</small> | <br><b>Geosyntec</b><br><b>consultants</b>                             |
| <small>1255 ROBERTS BOULEVARD, NW, SUITE 200<br/>KENNESAW, GEORGIA 30144 USA<br/>PHONE: 678.202.9500<br/>WWW.GEOSYNTEC.COM</small> | <small>PROJ. NO. GW9155<br/>SCALE AS SHOWN<br/>DATE FEBRUARY 2025</small>  | <small>DWG. GW7306.13-C10<br/>EDIT 5/2/24<br/>DRAWING 10 OF 22</small> |


- NOTES:
- PRESENTED IN THIS PLAN VIEW IS THE BOTTOM OF CCR SURFACE WITHIN AP-1. ADDITIONAL 6-INCHES OF REMOVAL NOT SHOWN FOR CLARITY.
  - LATERAL AND VERTICAL LIMIT OF THE BOTTOM OF CCR IS APPROXIMATE AND IS TO BE FIELD VERIFIED DURING CONSTRUCTION.
  - BULK OF CCR REMOVAL MAY BE ACHIEVED BY CONTRACTOR MEANS AND METHODS (E.G., CONVENTIONAL EXCAVATION OR DREDGING). FINAL REMOVAL OF CCR AND VERIFICATION OF REMOVAL WILL BE COMPLETED IN THE DRY VIA CONVENTIONAL EXCAVATION.
  - GRADING REQUIREMENTS FOR INTERIM CUT SLOPES TO MAINTAIN STABILITY OF CCR DURING CONSTRUCTION WILL BE ESTABLISHED AS PART OF THE DETAILED DESIGN AND CONTRACTOR WORK PLANS.
  - CCR VERIFICATION OF REMOVAL WILL BE COMPLETED BY THE CQA CONSULTANT ON A 100-FT BY 100-FT GRID SYSTEM. FOLLOWING VERIFICATION OF CCR REMOVAL, THE CONTRACTOR WILL REMOVE 6-INCHES OF NATIVE SOIL AND CQA CONSULTANT WILL AGAIN COMPLETE THE VERIFICATION PROCESS TO CERTIFY CCR REMOVAL.

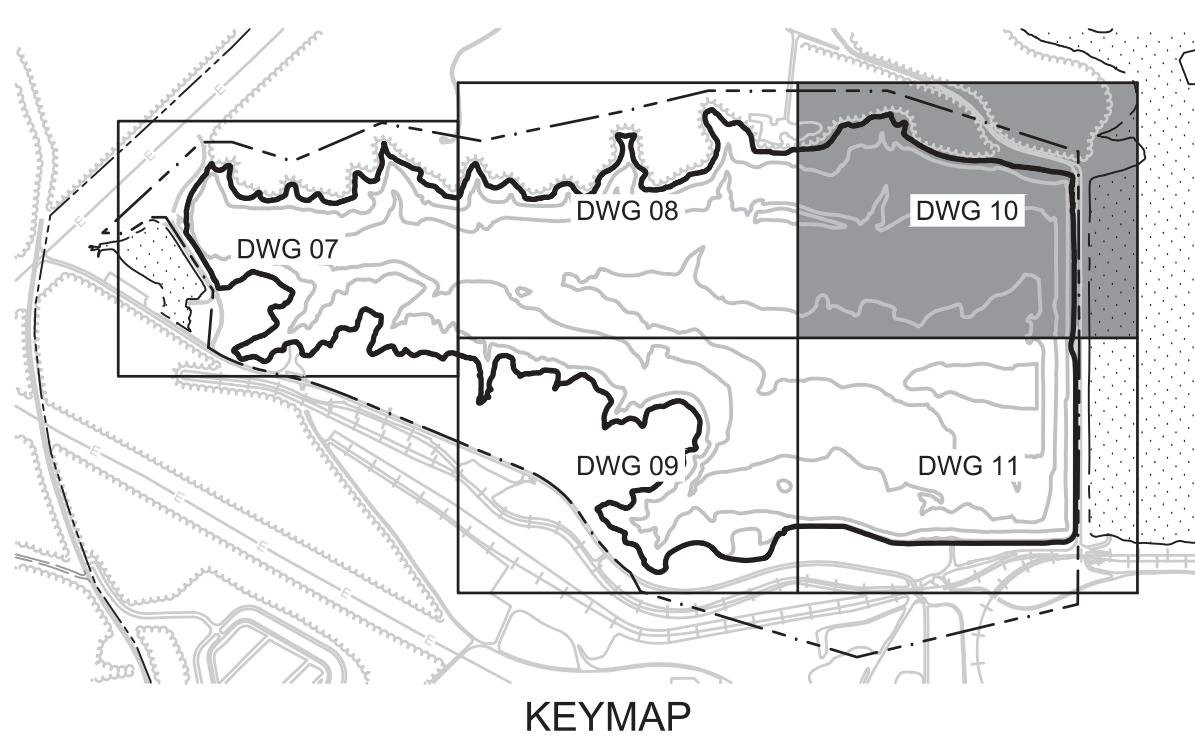

## MATCHLINE - DRAWING 10

MATCHLINE - DRAWING 09

C:\GEO\ACC\CCB\OS\GEO\SYNT\TEC\SDPLANT\WANSLEY\PROJECT FILES\CADD\WNSLY013DWG\SHUTGW7306.13-C11

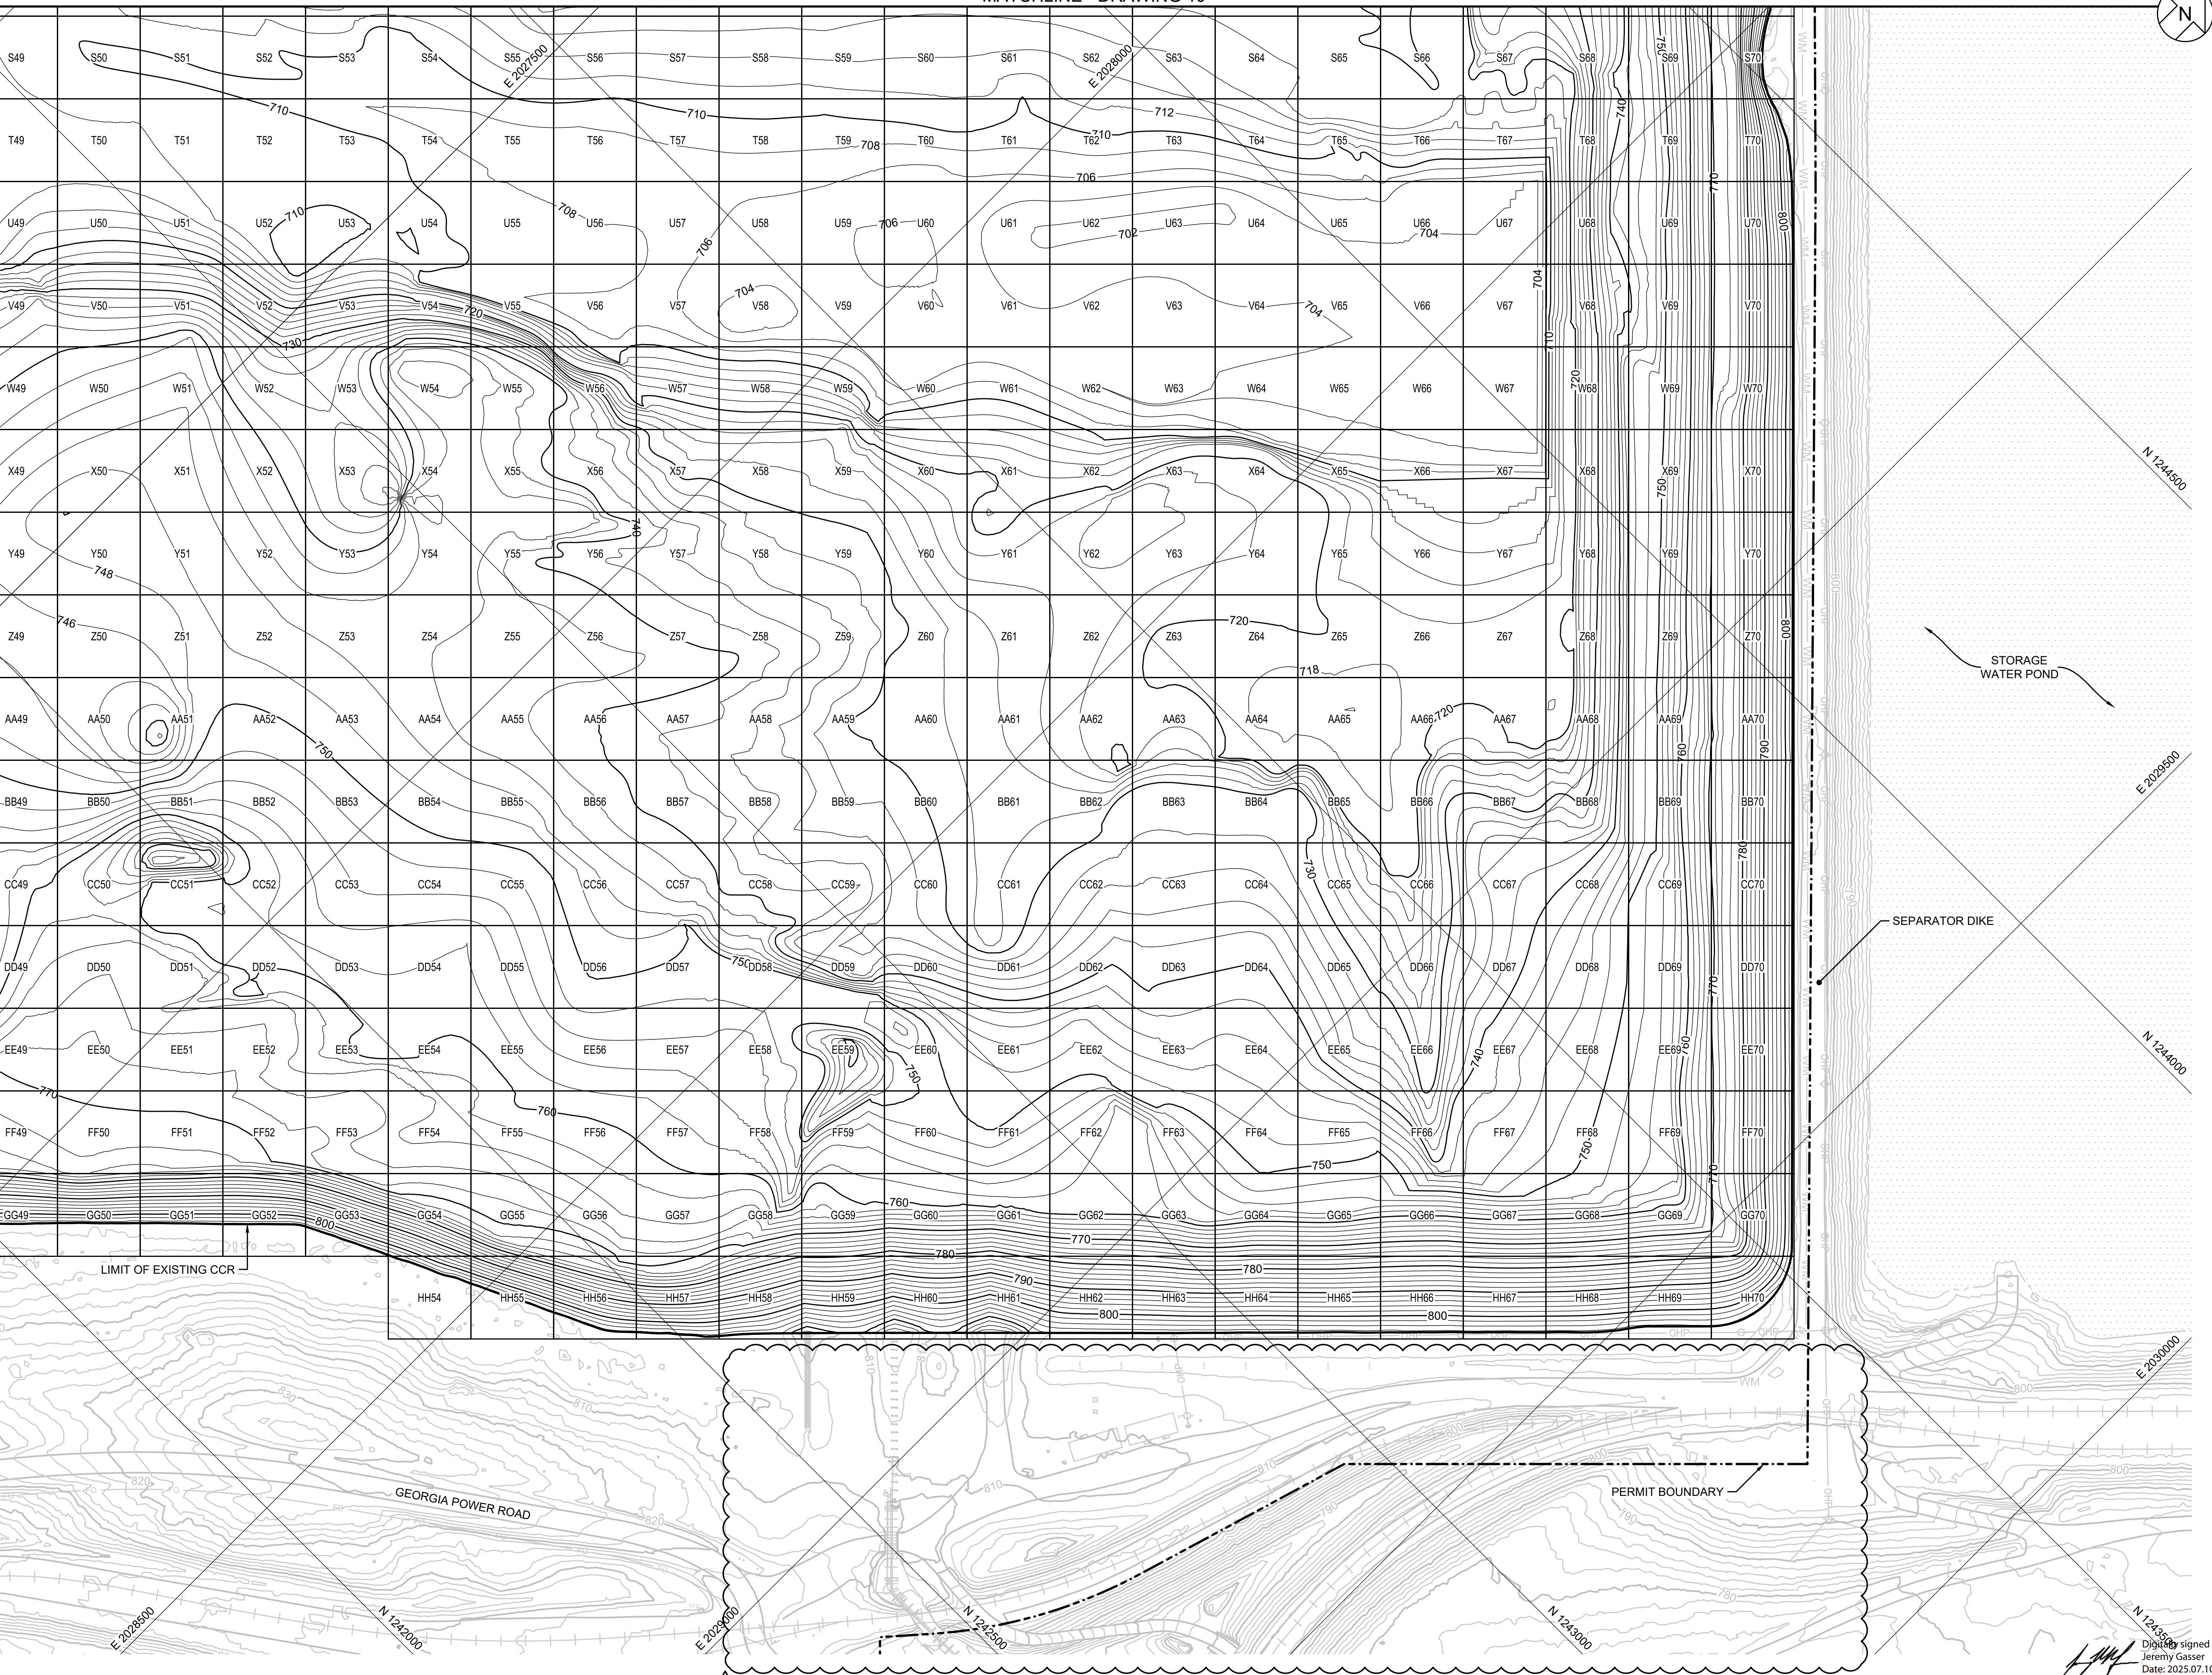

## NOTES:


- PRESSENTED IN THIS PLAN VIEW IS THE BOTTOM OF CCR SURFACE WITHIN AP-1. ADDITIONAL 6-INCHES OF REMOVAL NOT SHOWN FOR CLARITY.
- LATERAL AND VERTICAL LIMIT OF THE BOTTOM OF CCR IS APPROXIMATE AND IS TO BE FIELD VERIFIED DURING CONSTRUCTION.
- BULK OF CCR REMOVAL MAY BE ACHIEVED BY CONTRACTOR MEANS AND METHODS (E.G., CONVENTIONAL EXCAVATION OR DREDGING). FINAL REMOVAL OF CCR AND VERIFICATION OF REMOVAL WILL BE COMPLETED IN THE DRY VIA CONVENTIONAL EXCAVATION.
- GRADING REQUIREMENTS FOR INTERIM CUT SLOPES TO MAINTAIN STABILITY OF CCR DURING CONSTRUCTION WILL BE ESTABLISHED AS PART OF THE DETAILED DESIGN AND CONTRACTOR WORK PLANS.
- CCR VERIFICATION OF REMOVAL WILL BE COMPLETED BY THE CQA CONSULTANT ON A 100-FT BY 100-FT GRID SYSTEM. FOLLOWING VERIFICATION OF CCR REMOVAL, THE CONTRACTOR WILL REMOVE 6-INCHES OF NATIVE SOIL AND CQA CONSULTANT WILL AGAIN COMPLETE THE VERIFICATION PROCESS TO CERTIFY CCR REMOVAL.


|     |          |   |     |     |  |
|-----|----------|---|-----|-----|--|
| 1   | 07.09.25 | MINOR PERMIT MOD 1 - REVISION TO AP-1 PERMIT BOUNDARY | WSA | JMG |  |
| 0   | 02.06.25 | GA EPD CCR PERMIT DRAWINGS                            | DLJ | JMG |  |
| REV | DATE     | DESCRIPTION   |     |     |  |
|     |          | DRN APP   |     |     |  |

## CCR REMOVAL PLAN - V

PLANT WANSLEY ASH POND CLOSURE BY REMOVAL  
HEARD AND CARROLL COUNTIES, GEORGIA

|           |               |                    |      |        |
|-----------|---------------|--------------------|------|--------|
| PROJ. NO. | GW9155        | DWG. GW7306.13-C11 | EDIT | 7/9/25 |
| SCALE     | AS SHOWN      |                    |      |        |
| DATE      | FEBRUARY 2025 | DRAWING            | 11   | OF 22  |

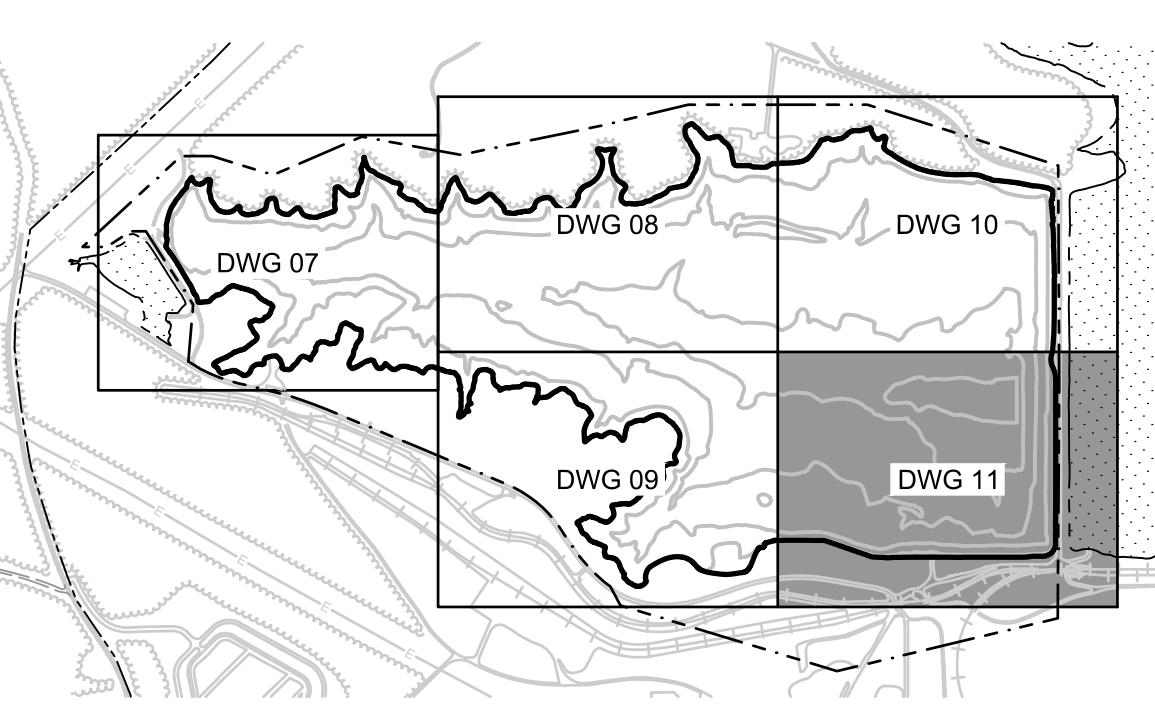

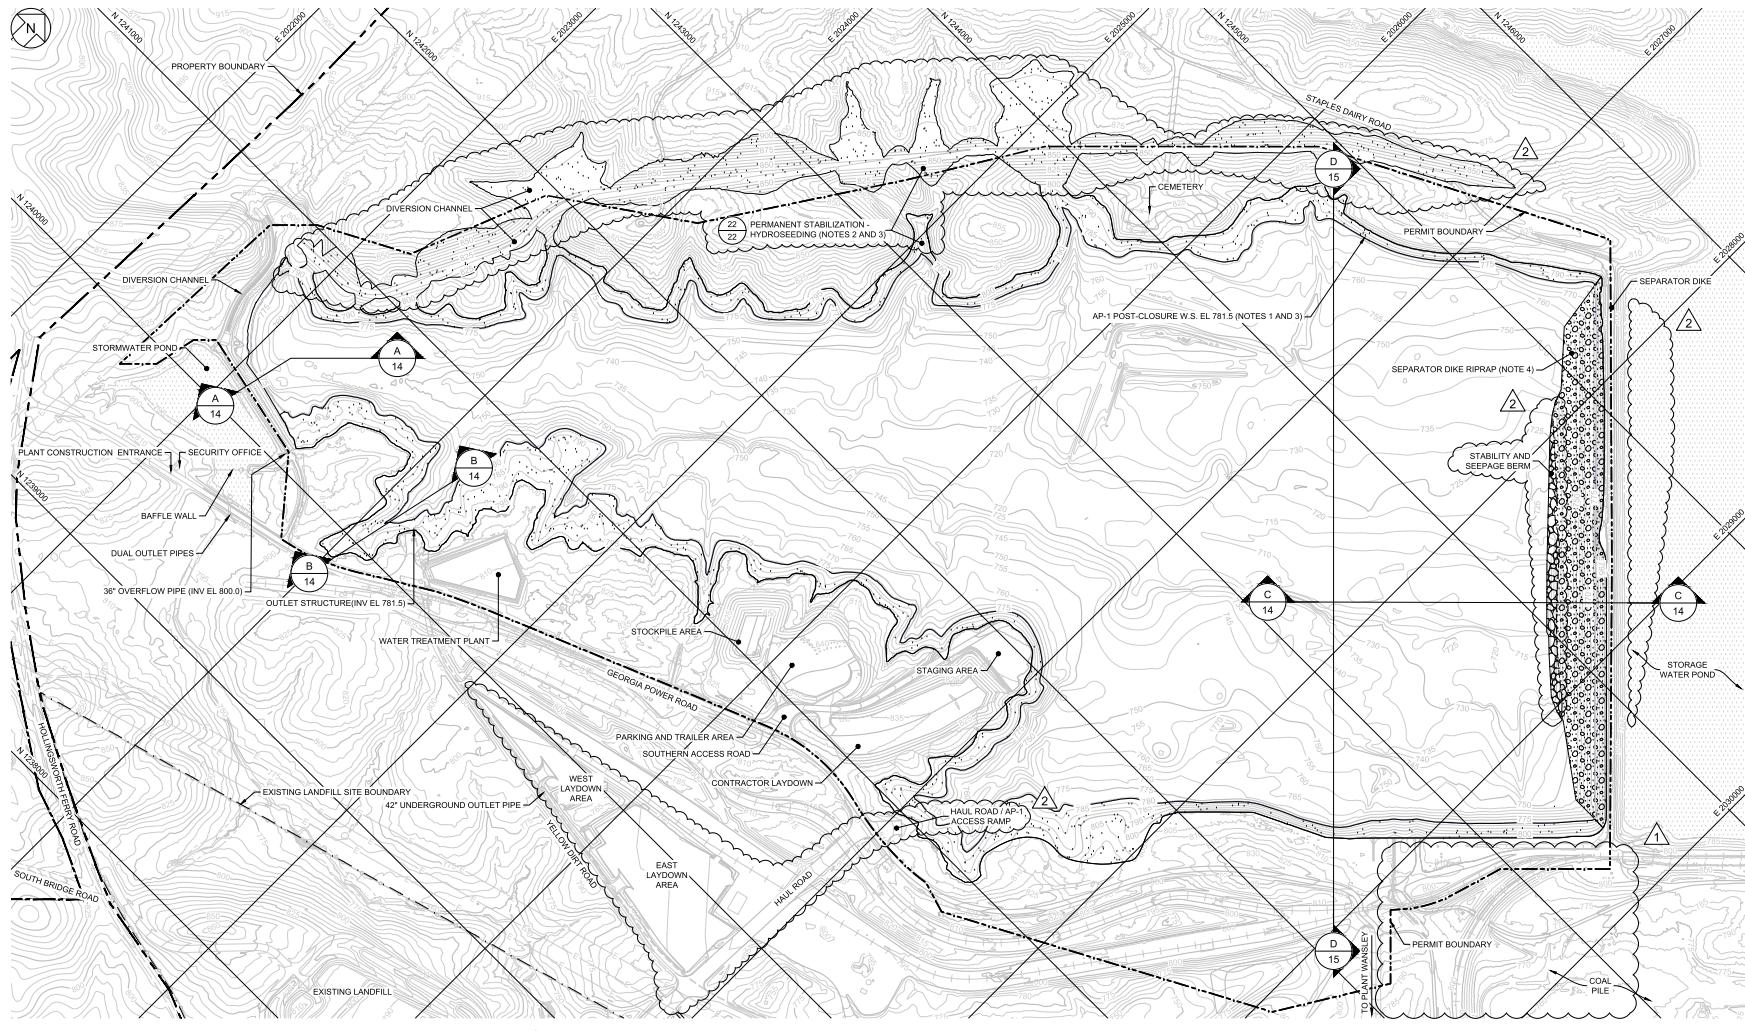

- NOTES:
- FOLLOWING COMPLETION OF CONTRACTOR'S WORK, THE FORMER AP-1 WILL NATURALLY REFILL WITH WATER TO A LEVEL OF 781.5 FT. ANY DIVERSION BERMS THAT THE CONTRACTOR CONSTRUCTS DURING CONSTRUCTION WILL NEED TO BE REMOVED OR BREACHED BY THE CONTRACTOR AS NECESSARY TO NOT RETAIN WATER. AT A MINIMUM, THIS WILL INCLUDE THE BREACHING OF THE DIVERSION CHANNEL PRESENTED IN THE CONSTRUCTION SEQUENCING PLAN (DRAWINGS 16 AND 17).
  - UPON VERIFICATION OF CCR REMOVAL AND AN ADDITIONAL 6 INCHES OF SOIL WITHIN AP-1, FINAL GRADES ABOVE 781.5 FT MAY RECEIVE HYDROSEEDING OR STABILIZED, TO BE COMPLETED IN PHASES AS THE VERIFICATION AND REMOVAL PROGRESSES. ANY AREAS OUTSIDE THE LIMITED CCR THAT ARE DISTURBED PART OF THIS WORK MUST ALSO BE HYDROSEEDED OR OTHERWISE STABILIZED IN ACCORDANCE WITH APPLICABLE CONSTRUCTION STORMWATER PERMITS AND DETAILED DESIGN DRAWINGS.
  - TEMPORARY STABILIZATION WILL BE UTILIZED ON AN AS-NEEDED BASIS BELOW 781.5 FT ACCORDING TO THE EROSION AND SEDIMENT CONTROL (ESC) PLAN ON DRAWING 19.
  - UPON VERIFICATION OF CCR REMOVAL AND AN ADDITIONAL 6 INCHES OF SOIL WITHIN AP-1, CONTRACTOR SHALL PLACE RIPRAP DETAILED ALONG THE ENTIRETY OF THE UPGRADIENT (AP-1) SIDE OF THE SEPARATOR DIKE.

1 REVISED AP-1 PERMIT BOUNDARY

2 ADJUSTED EXISTING SITE FEATURES AND TOPOGRAPHY TO REFLECT CONDITIONS AS OF SEPTEMBER 2024 (I.E., CONSTRUCTION OF HAUL ROAD, LAYDOWN AREAS, AND BU LOADING AREA).

REVISED NOTES RELATED TO HYDROSEEDING REQUIREMENTS.

REMOVED THE RIPRAP BUTTRESS WITHIN THE STORAGE WATER POND

AND REVISED THE STABILITY AND SEEPAGE BERM EXTENTS.

ADDED GRADES AND APPROXIMATE EXTENTS FOR THE DIVERSION CHANNEL.



Approved  
Solid Waste Management Program  
Approved By: Tammy Buchi

Digitally signed  
by Jeremy Gasser  
Date: 2025.11.10  
15:43:42 -05'00"

|   |          |   |     |     |
|---|----------|---|-----|-----|
| 2 | 11-10-25 | MINOR PERMIT MOD 2 - REVISION TO AP-1 DESIGN          | WSA | APP |
| 1 | 07-09-25 | MINOR PERMIT MOD 1 - REVISION TO AP-1 PERMIT BOUNDARY | WSA | APP |
| 0 | 02-09-25 | GA EPD COR PERMIT DRAWINGS                            | RJL | JMG |

#### SITE RESTORATION GRADING PLAN




PLANT WANSLEY ASH POND CLOSURE BY REMOVAL  
HEARD AND CARROLL COUNTIES, GEORGIA



|           |               |      |               |      |          |
|-----------|---------------|------|---------------|------|----------|
| PROJ. NO. | GW9155        | DWG. | GW7306-13-C12 | EDIT | 10/23/25 |
| SCALE     | AS SHOWN      |      |               |      |          |
| DATE      | NOVEMBER 2025 |      |               |      |          |

1255 ROBERTS BOULEVARD, NW, SUITE 200  
KENNESAW, GEORGIA 30144 USA  
PHONE: 678.562.8500  
WWW.GEOSYNTEC.COM



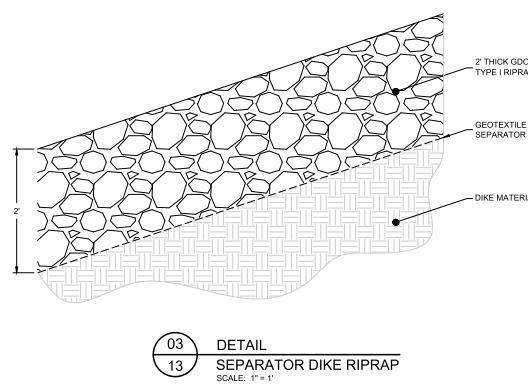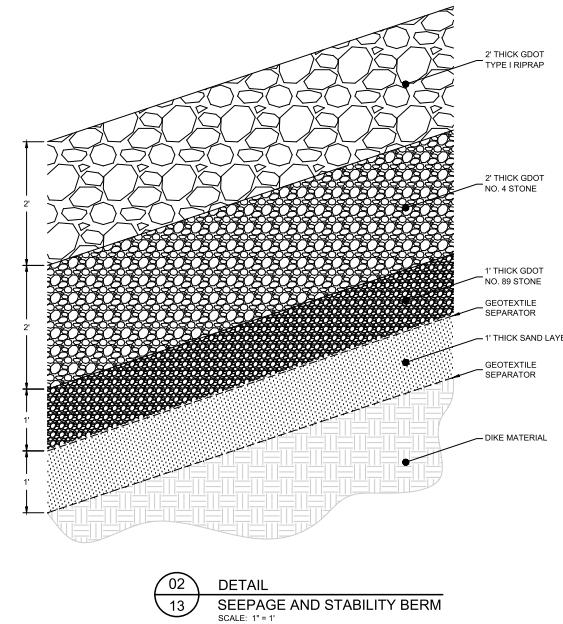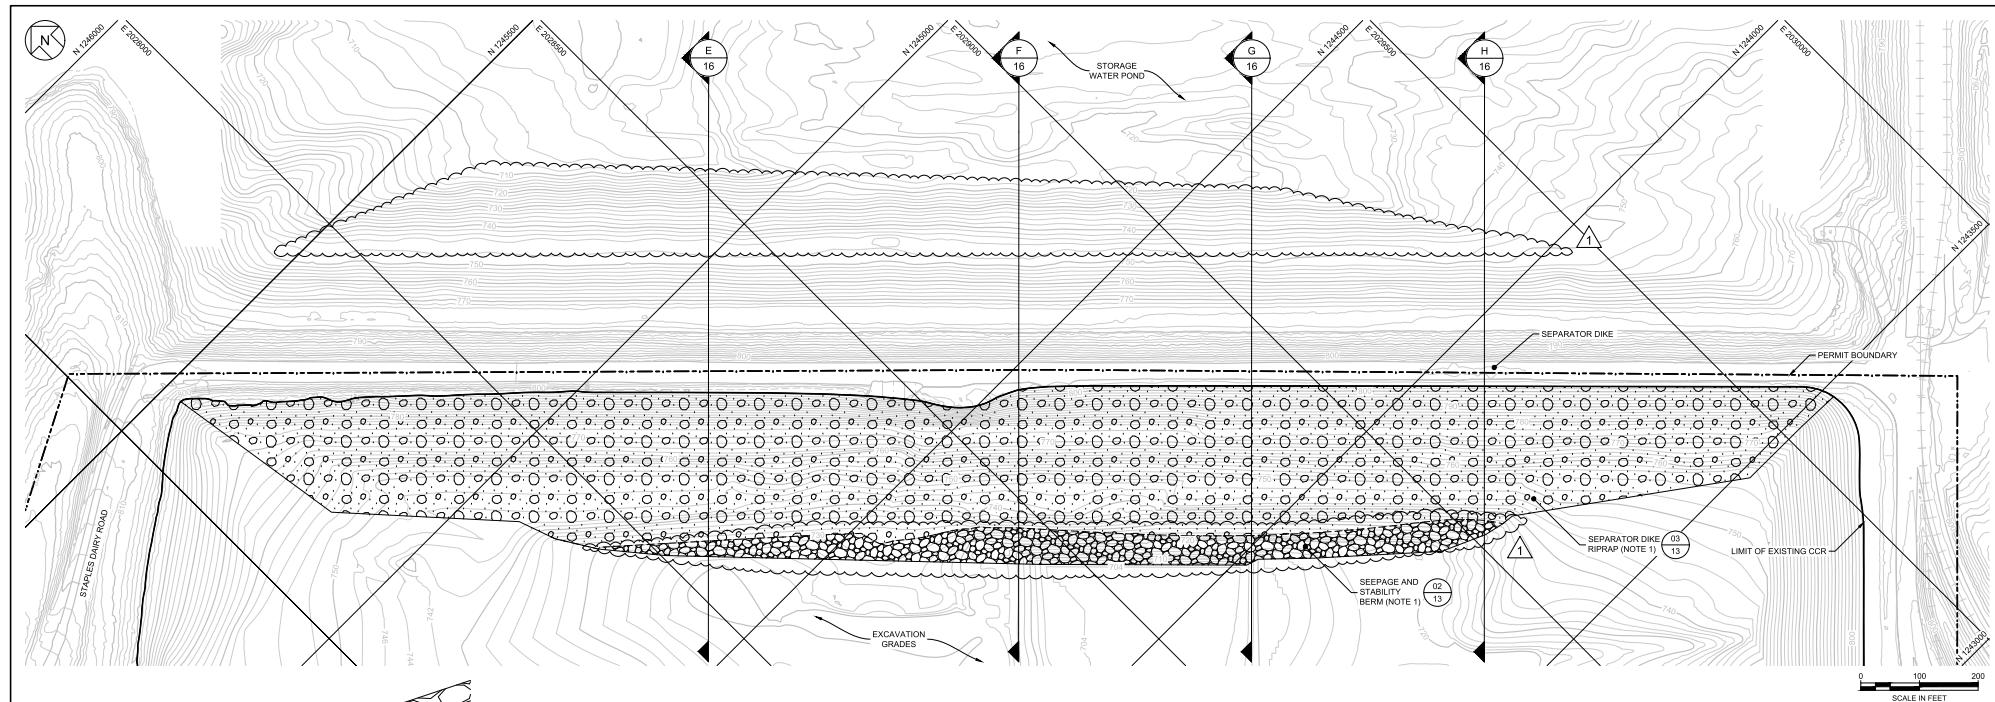




NOTES:  
1. ON THE AP-1 SIDE OF THE SEPARATOR DIKE, FOLLOWING VERIFICATION OF CCR REMOVAL AND ADDITIONAL 6 INCHES OF SOIL REMOVAL, CONTRACTOR SHALL INSTALL SEEPAGE BERM AT THE BASE OF THE SEPARATOR DIKE AND RIPRAP ON THE TOP OF SEPARATOR DIKE.

1  
11-10-25  
MINOR PERMIT MOD-2 - Revision to AP-1 DESIGN  
0  
02 06.25  
GA EPD CCR PERMIT DRAWINGS  
REV DATE  
DESCRIPTION DRN APP

SEPARATOR DIKE PLAN

PLANT WANSLEY ASH POND CLOSURE BY REMOVAL  
HEARD AND CARROLL COUNTIES, GEORGIA



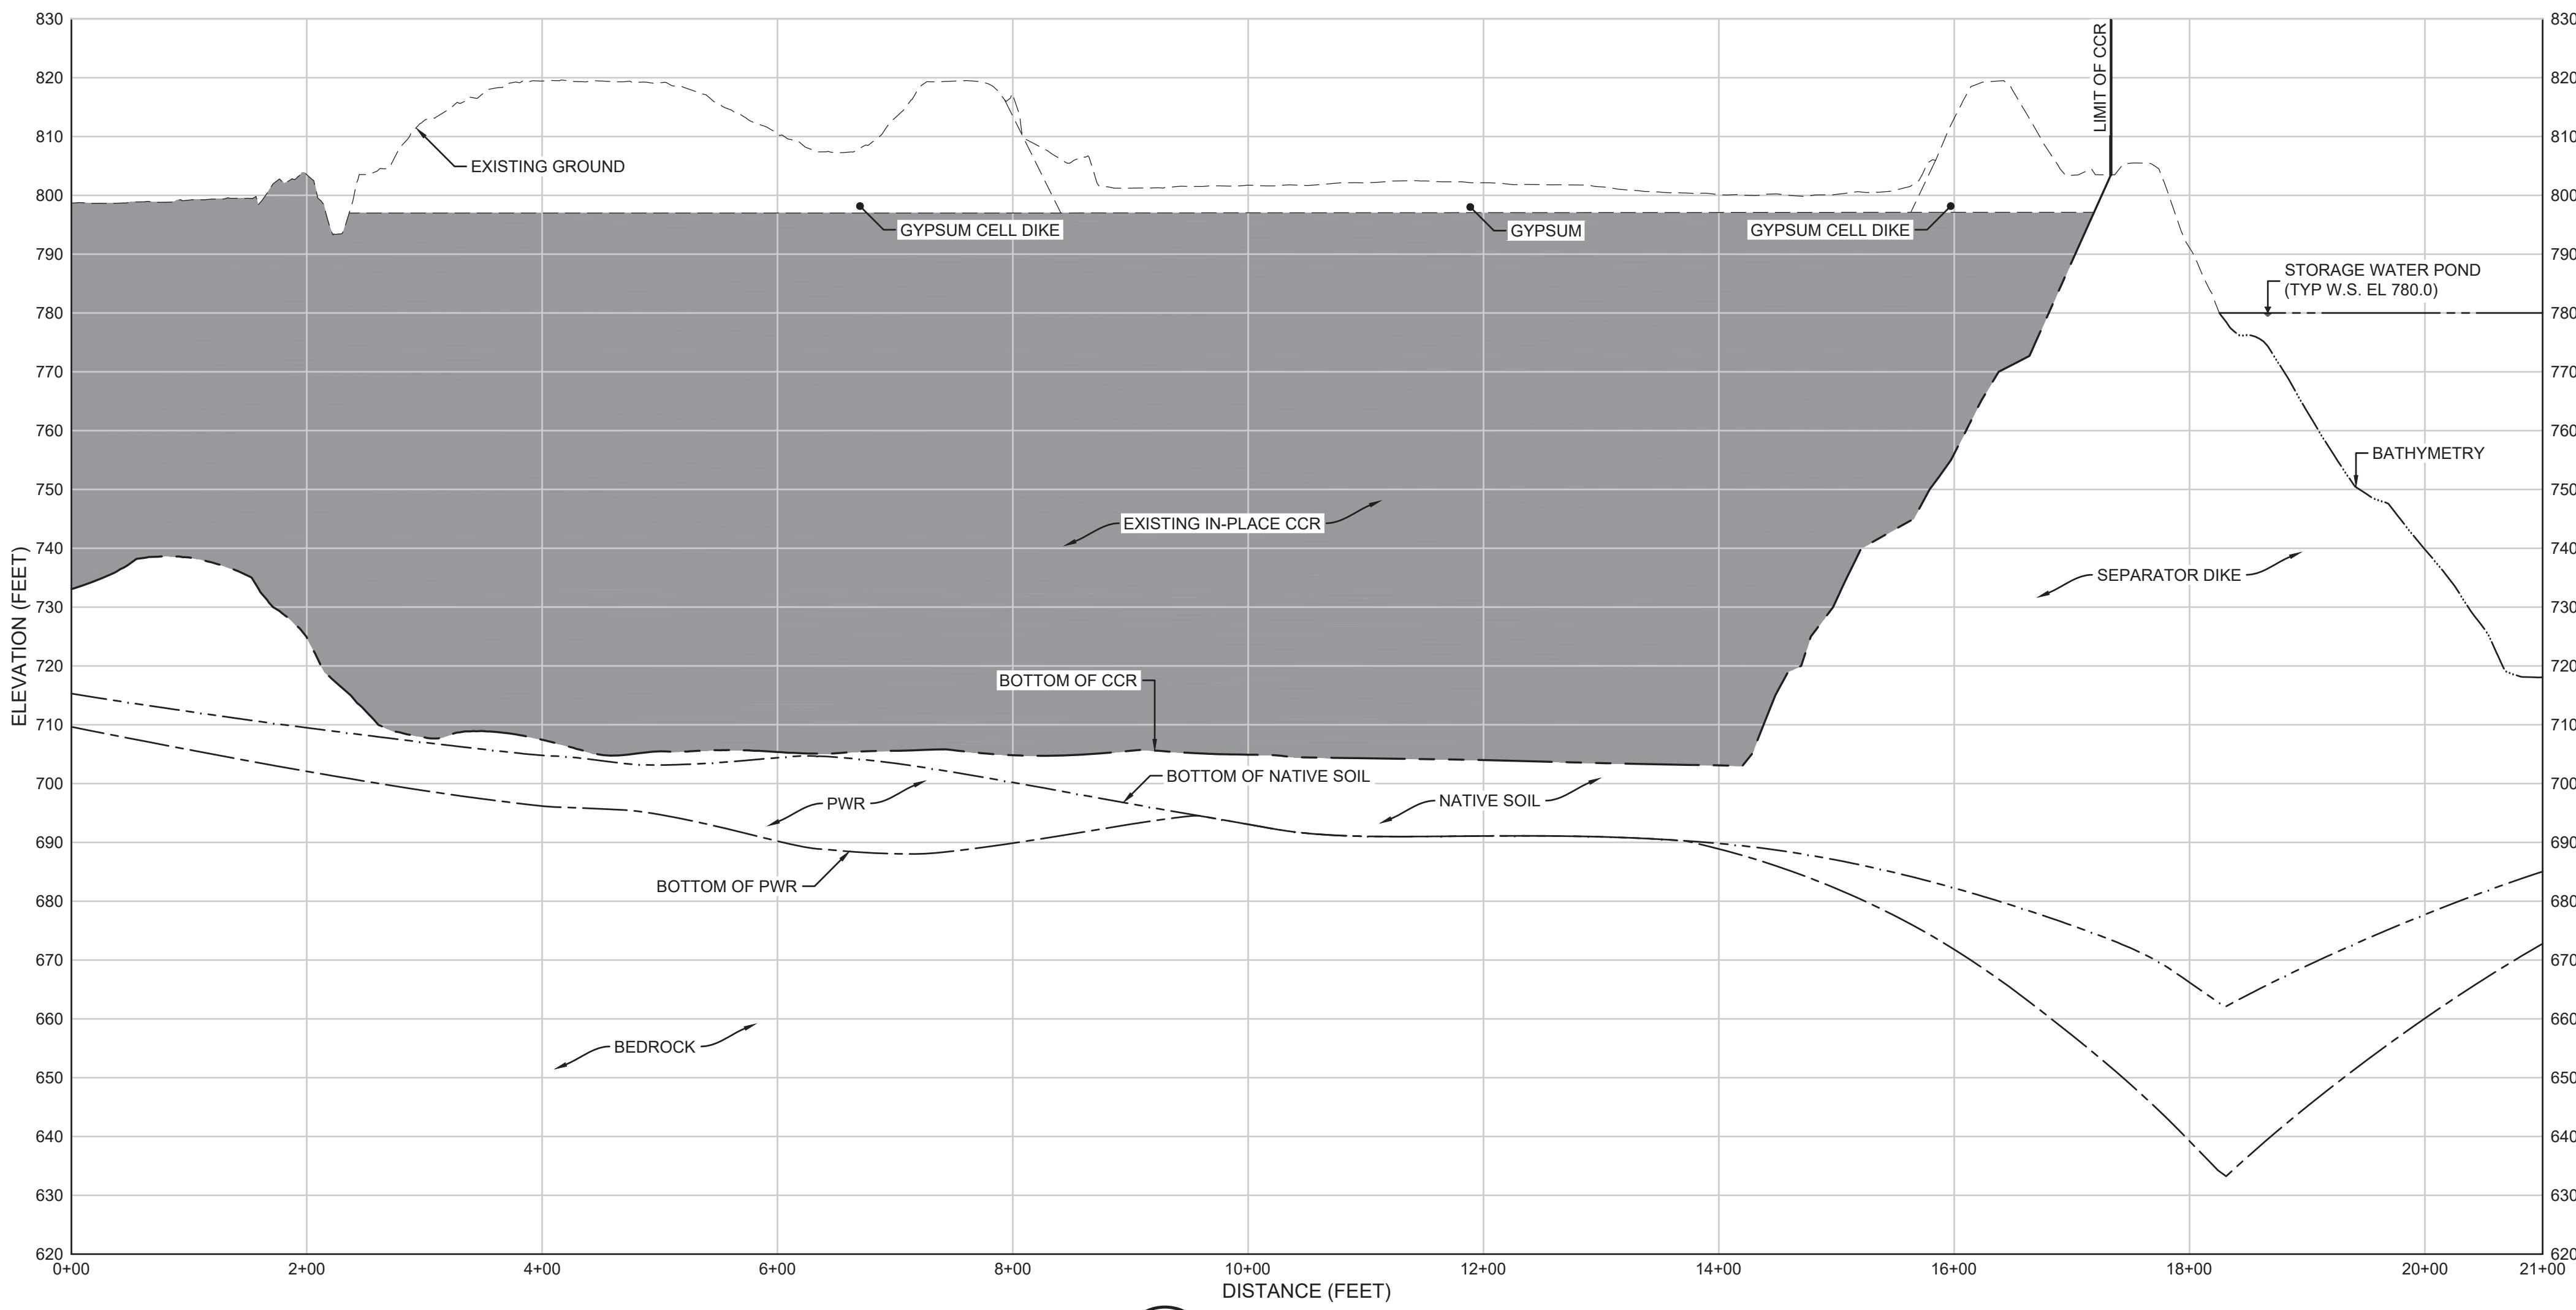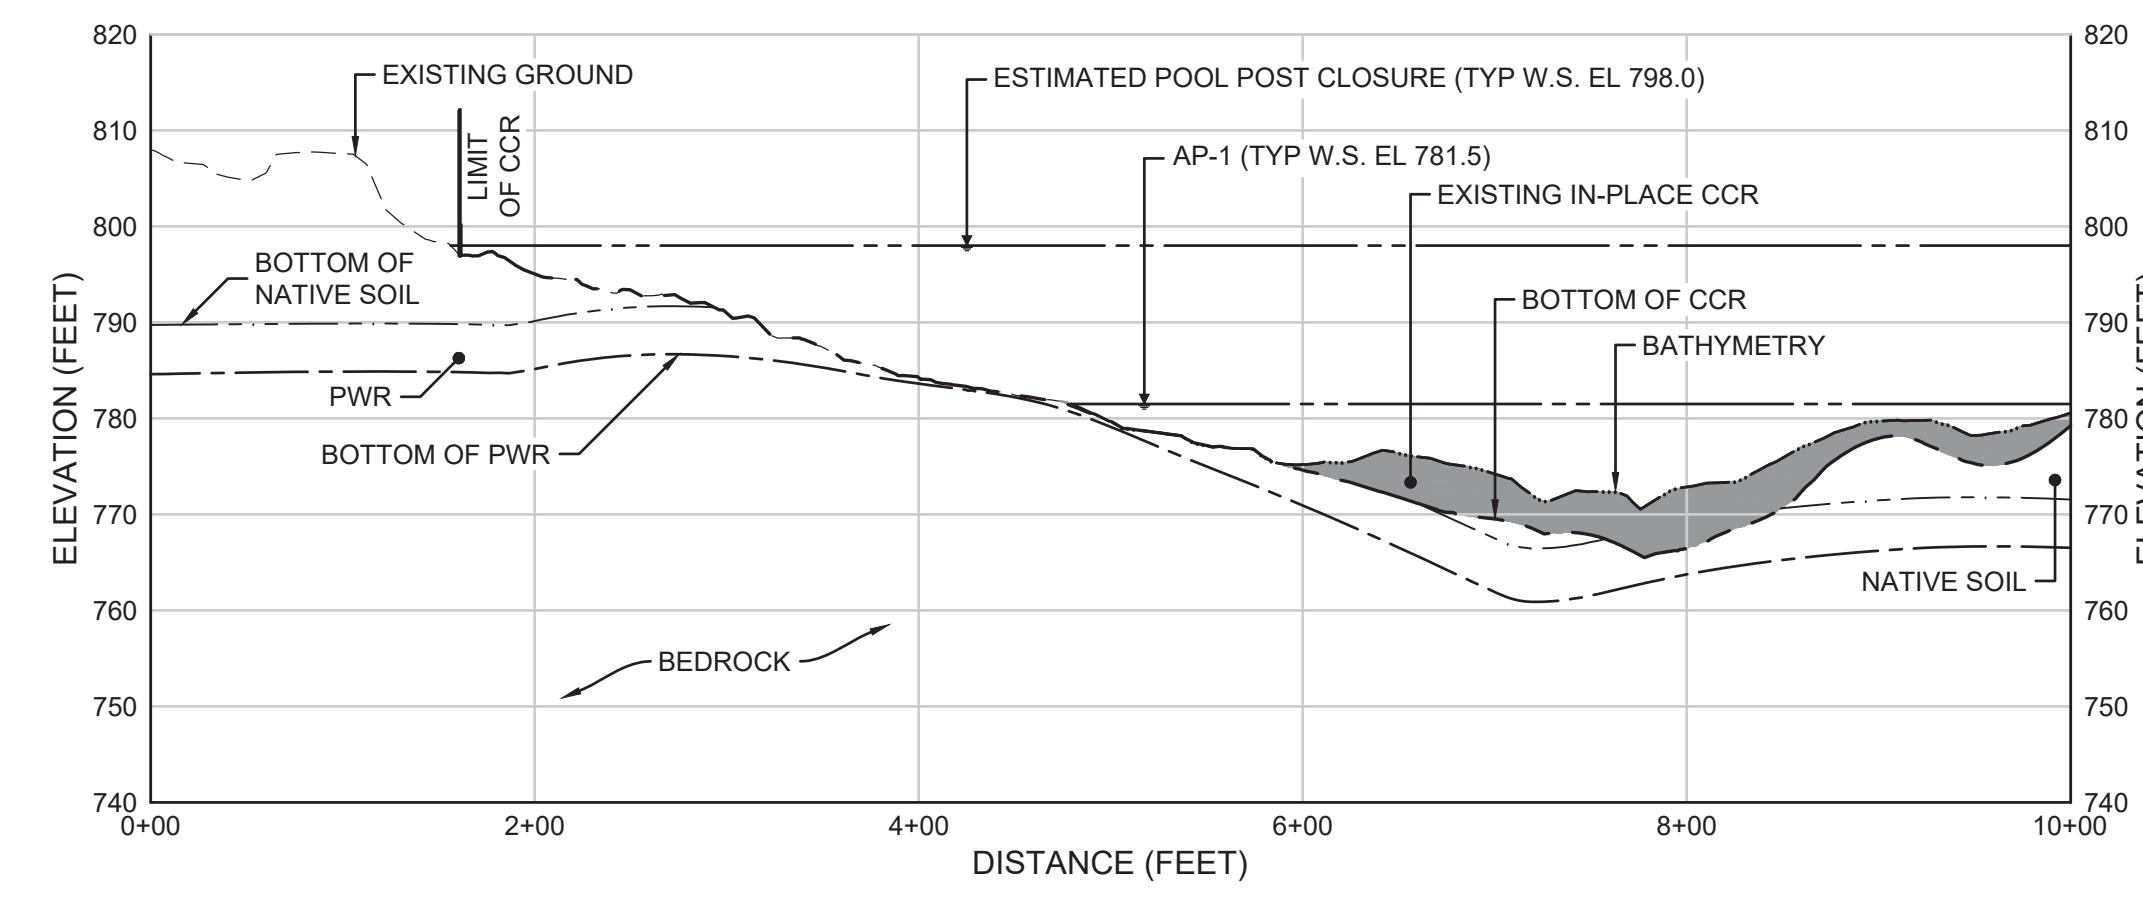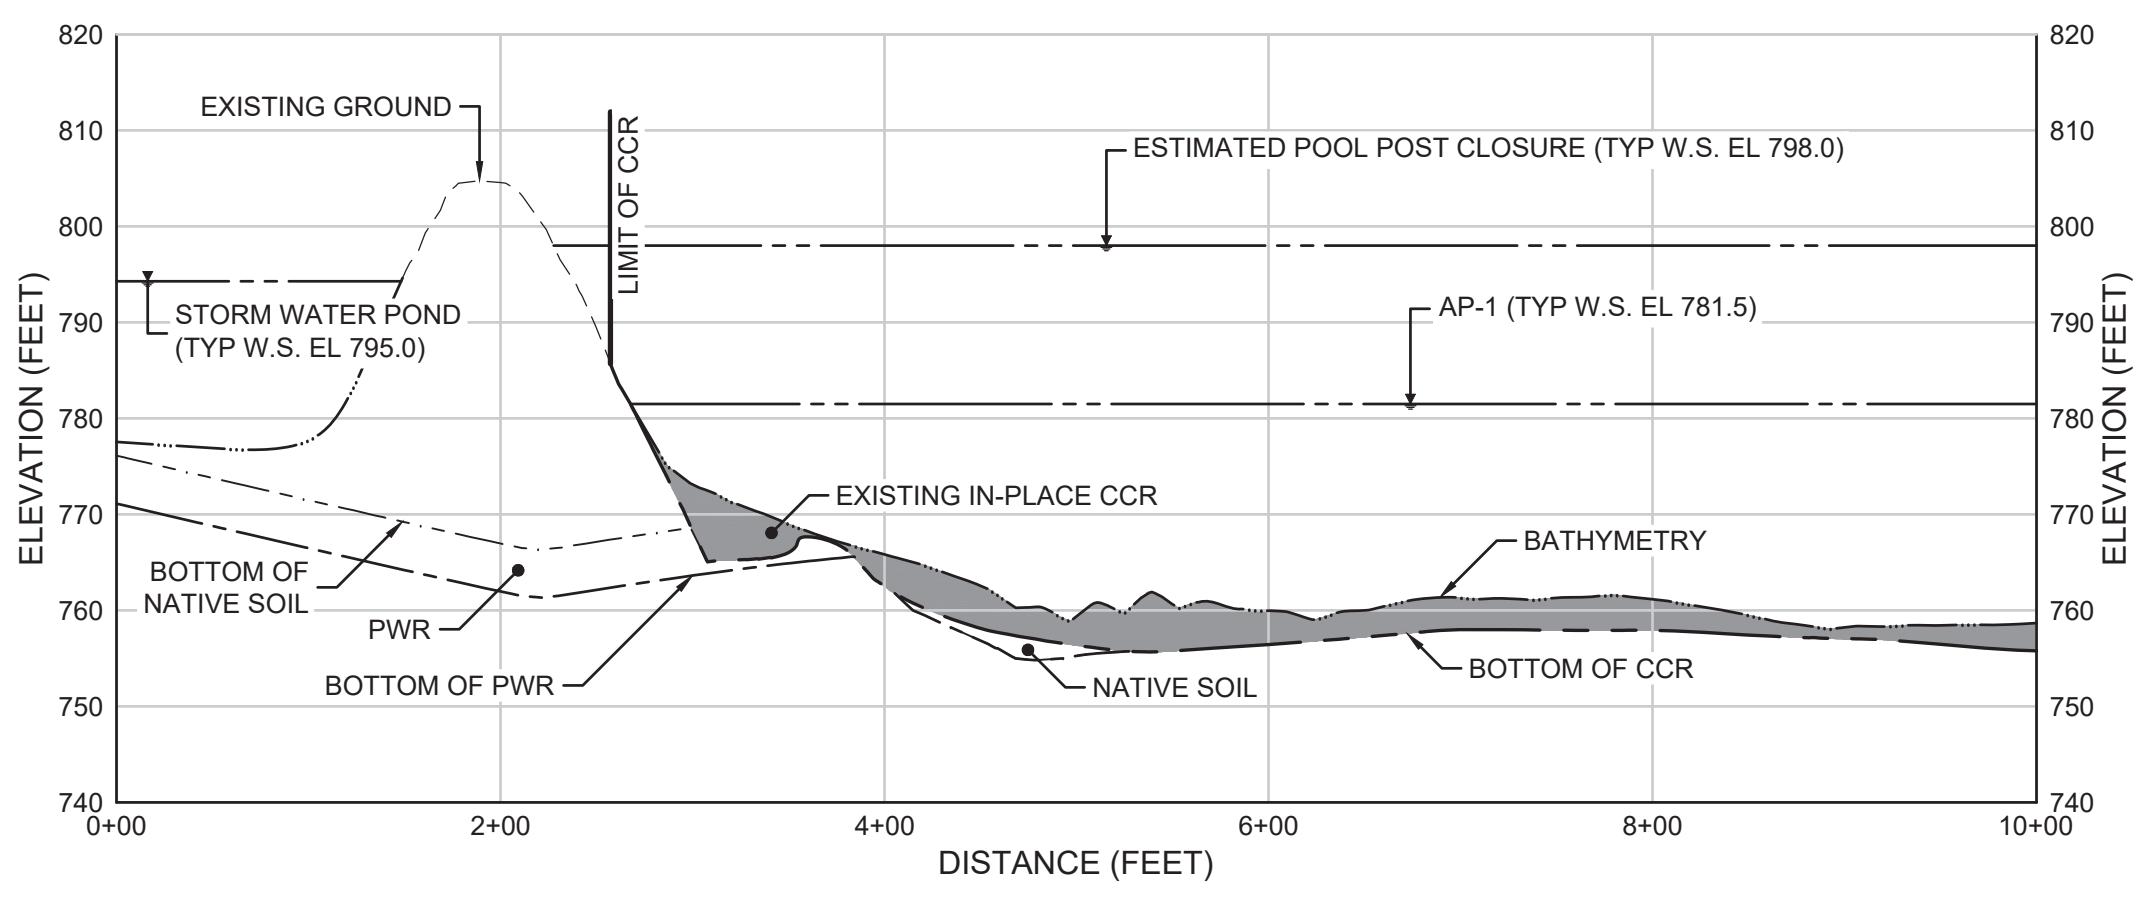


- NOTES:
1. BOTTOM OF CCR SURFACE IS SHOWN IN THESE SECTIONS. EXCAVATION SURFACE IS NOT SHOWN FOR CLARITY AND WILL BE 6 INCHES BELOW THE BOTTOM OF CCR SURFACE.
  2. BATHYMETRY WITHIN THE STORMWATER POND IS ESTIMATED AND NOT SURVEYED.

0 100 200 0 20 40  
SCALE IN FEET (H) SCALE IN FEET (V)



| 0   | 02.06.25 | GA EPD CCR PERMIT DRAWINGS | DLJ | JMG |
|-----|----------|----------------------------|-----|-----|
| REV | DATE     | DESCRIPTION                | DRN | APP |

SITE SECTIONS - I


PLANT WANSLEY ASH POND CLOSURE BY REMOVAL  
HEARD AND CARROLL COUNTIES, GEORGIA

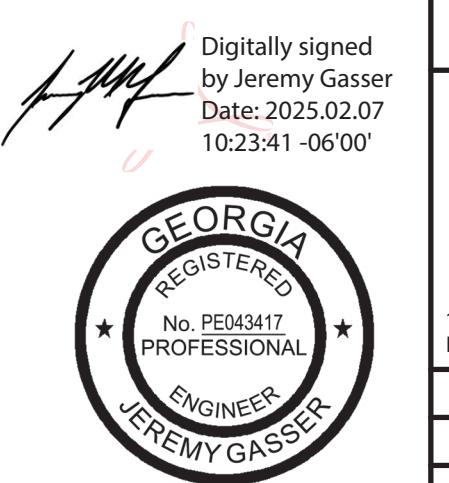

|           |               |                    |      |        |
|-----------|---------------|--------------------|------|--------|
| PROJ. NO. | GW9155        | DWG. GW7306.13-C14 | EDIT | 5/2/24 |
| SCALE     | AS SHOWN      |                    |      |        |
| DATE      | FEBRUARY 2025 | DRAWING            | 14   | OF 22  |

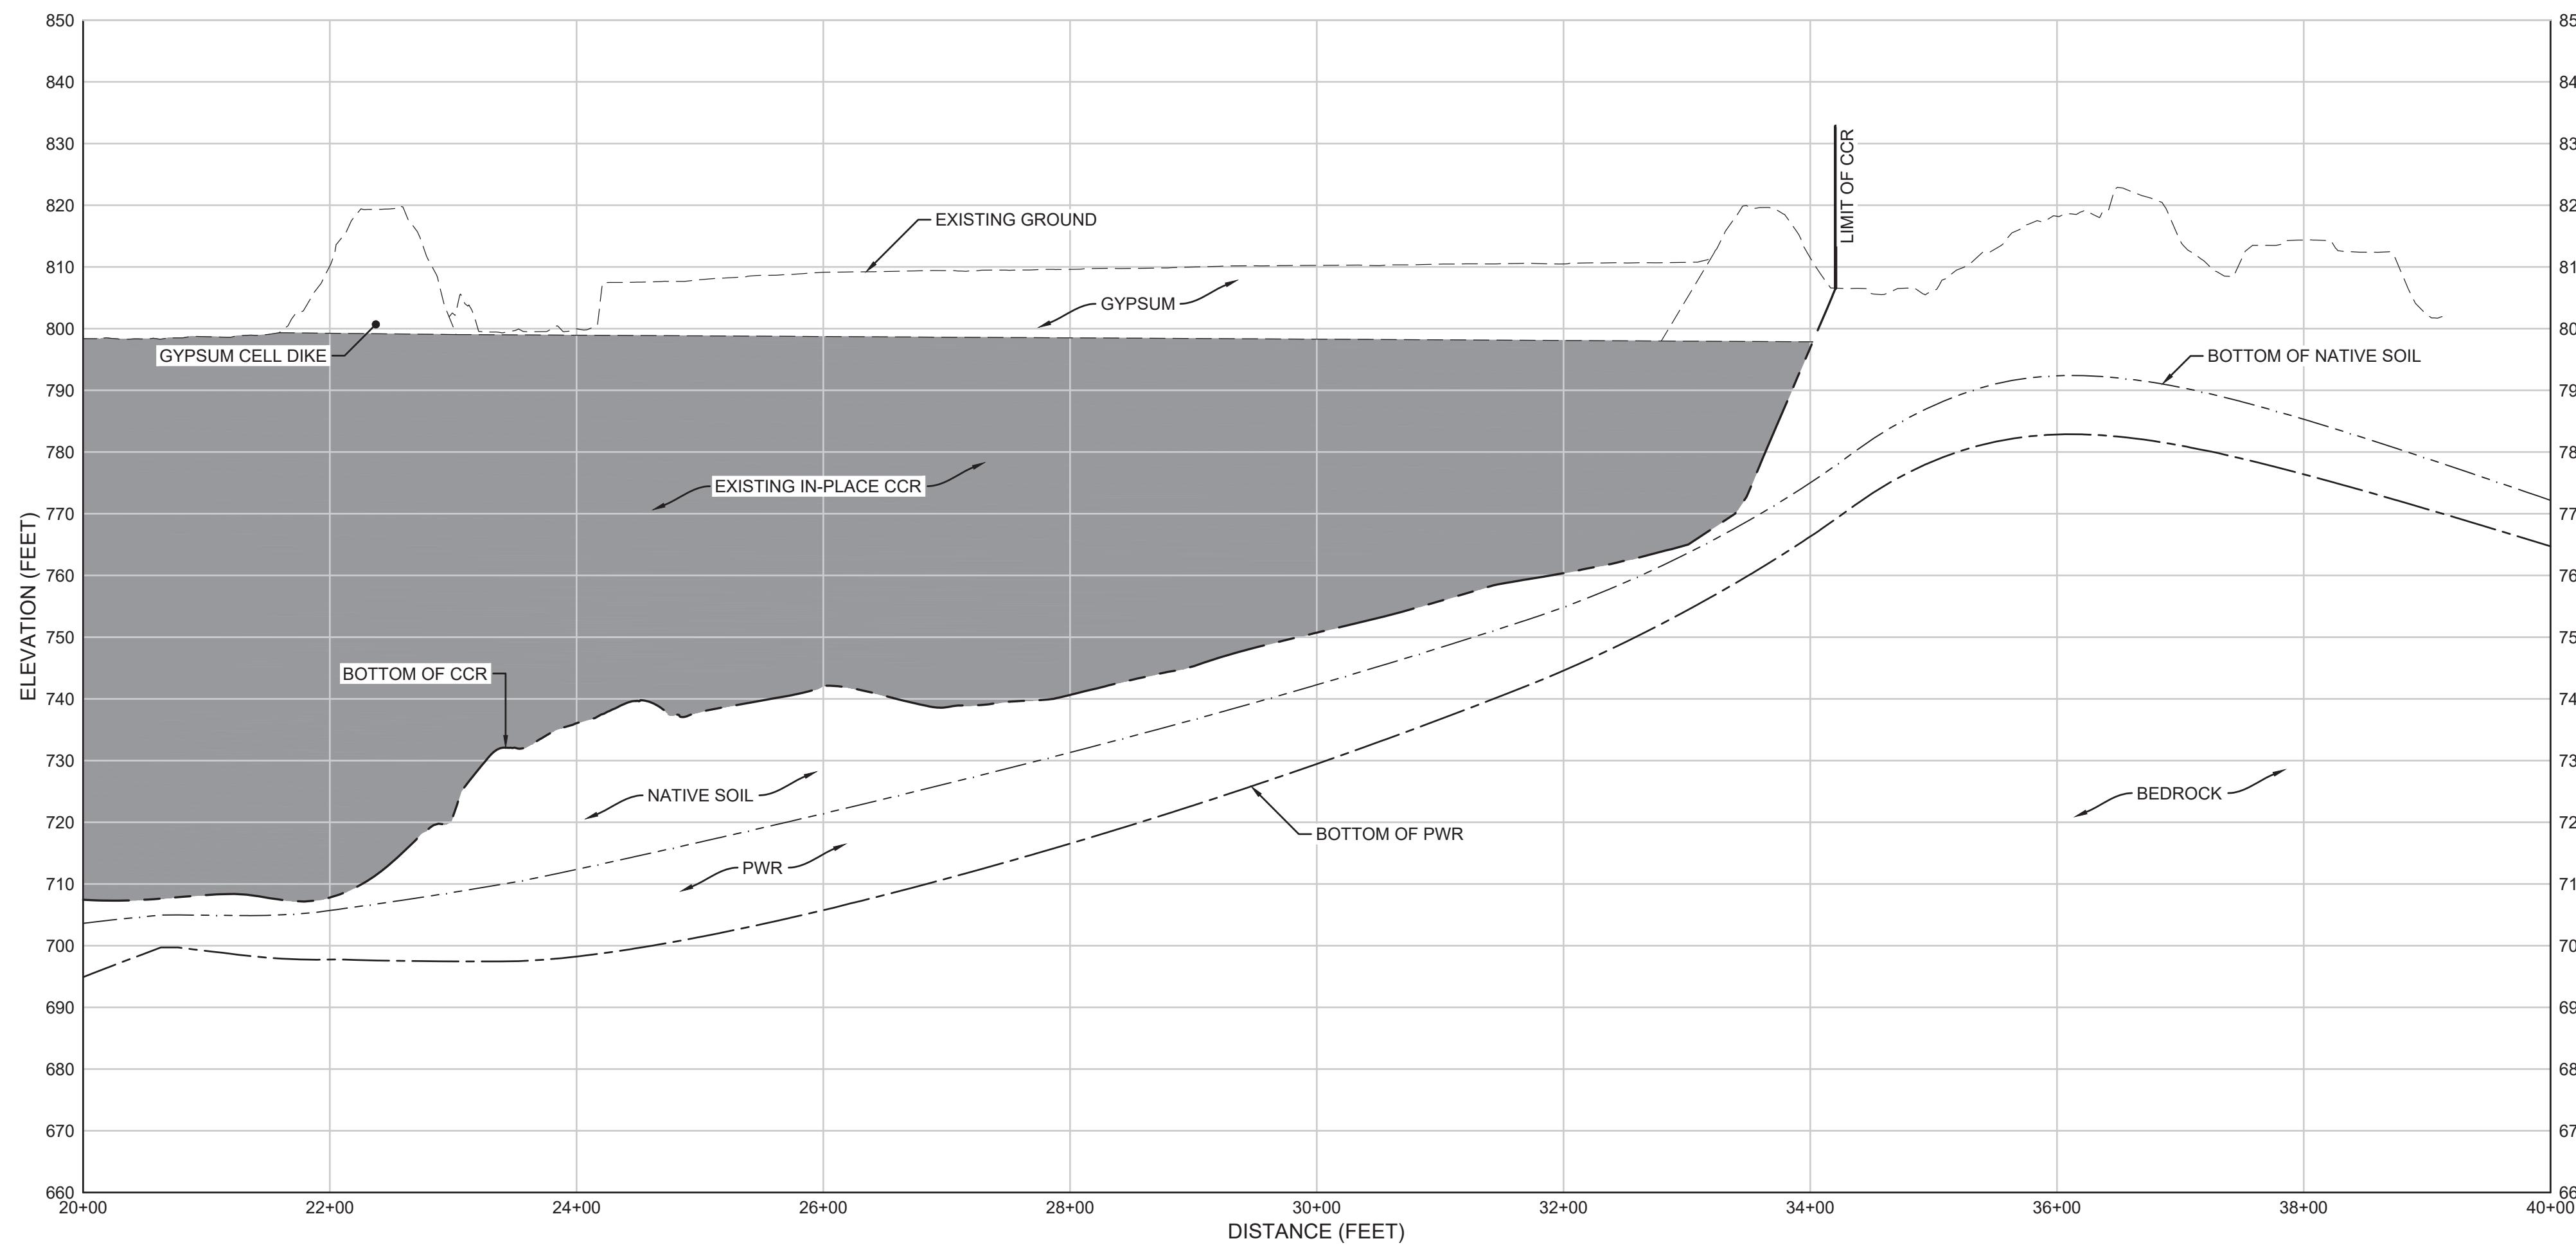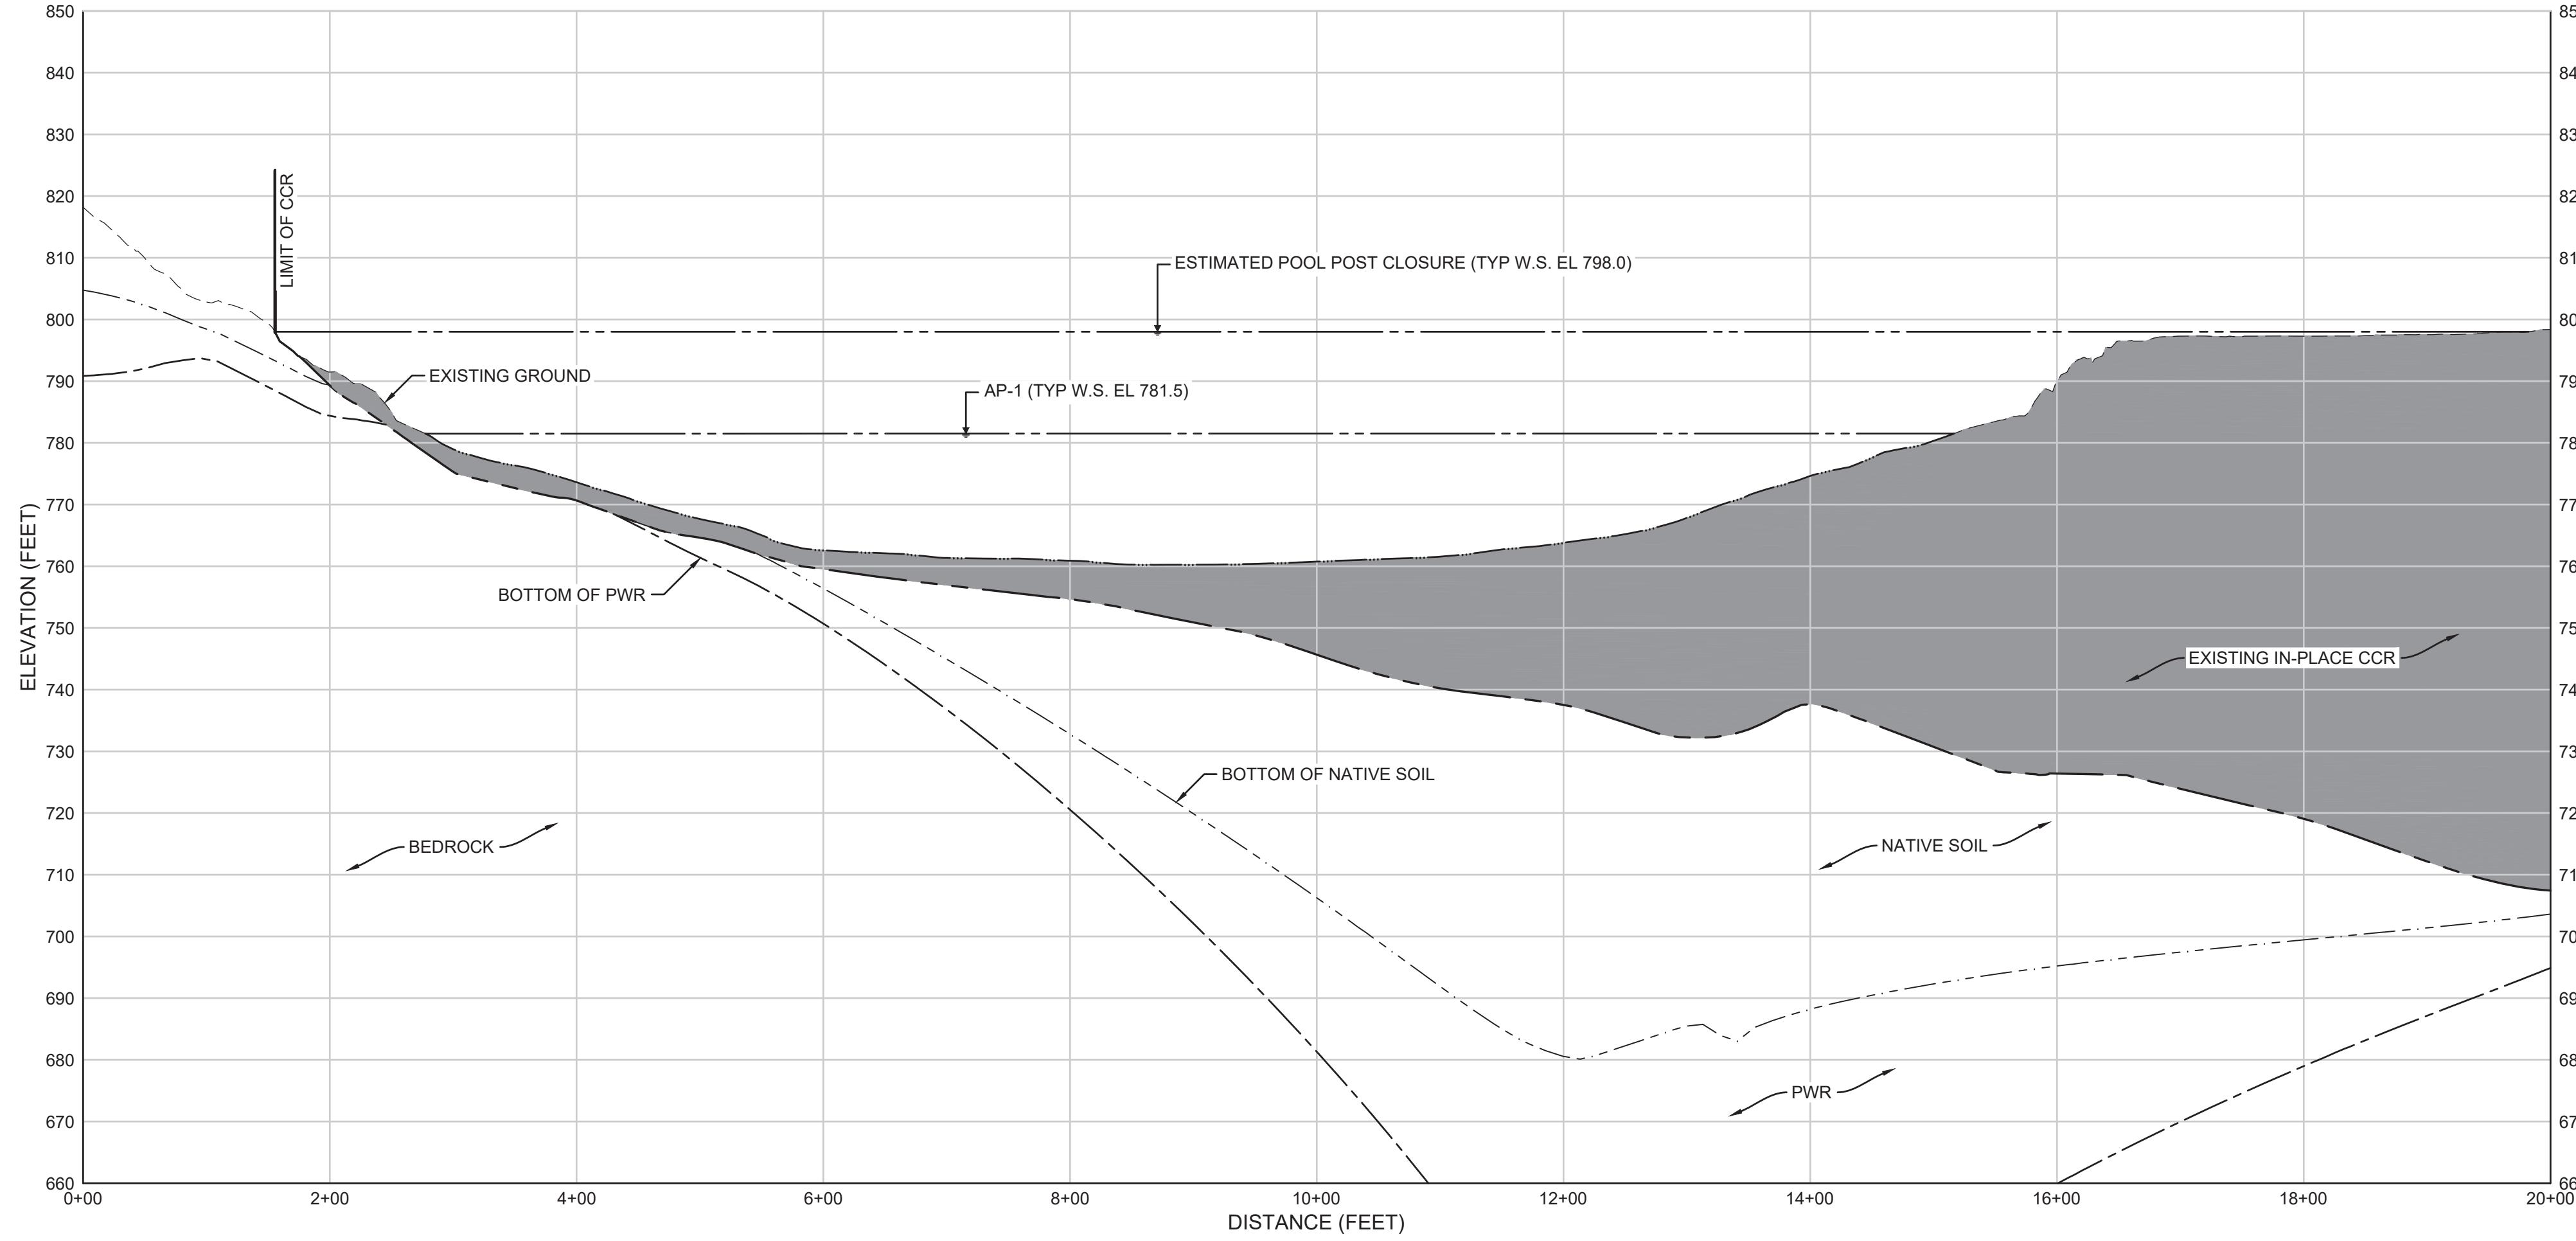

**SECTION**  
06  
**SITE SECTION - D**  
SCALE: 1" = 100' (H); 1" = 20' (V)




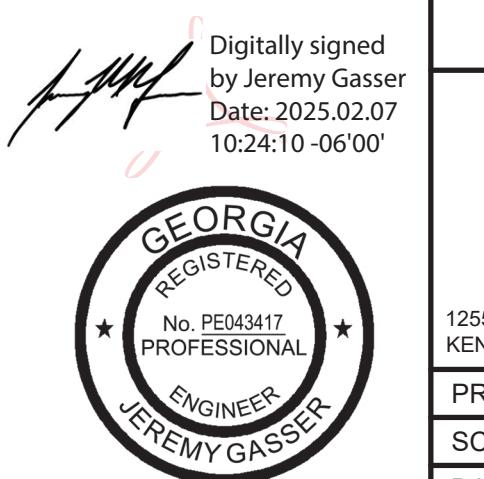


| 0   | 02.06.25         | GA EPD CCR PERMIT DRAWINGS | DLJ              | JMG              |
|---|------------------|----------------------------|------------------|------------------|
| REV   | DATE             | DESCRIPTION                | DRN              | APP              |
| <b>SITE SECTIONS - II</b>   |                  |                            |                  |                  |
| <b>PLANT WANSLEY ASH POND CLOSURE BY REMOVAL</b><br>HEARD AND CARROLL COUNTIES, GEORGIA |                  |                            |                  |                  |
| 0   | 02.06.25         | GA EPD CCR PERMIT DRAWINGS | DLJ              | JMG              |
| REV   | DATE             | DESCRIPTION                | DRN              | APP              |
| GW9155  | GW9155           | GW9155                     | GW9155           | GW9155           |
| AS SHOWN  | AS SHOWN         | AS SHOWN                   | AS SHOWN         | AS SHOWN         |
| FEBRUARY 2025   | FEBRUARY 2025    | FEBRUARY 2025              | FEBRUARY 2025    | FEBRUARY 2025    |
| DRAWING 15 OF 22  | DRAWING 15 OF 22 | DRAWING 15 OF 22           | DRAWING 15 OF 22 | DRAWING 15 OF 22 |

NOTES:  
1. BOTTOM OF CCR SURFACE IS SHOWN IN THESE SECTIONS.  
EXCAVATION SURFACE IS NOT SHOWN FOR CLARITY AND WILL BE 6  
INCHES BELOW THE BOTTOM OF CCR SURFACE.

0 100 200  
SCALE IN FEET (H)  
0 20 40  
SCALE IN FEET (V)



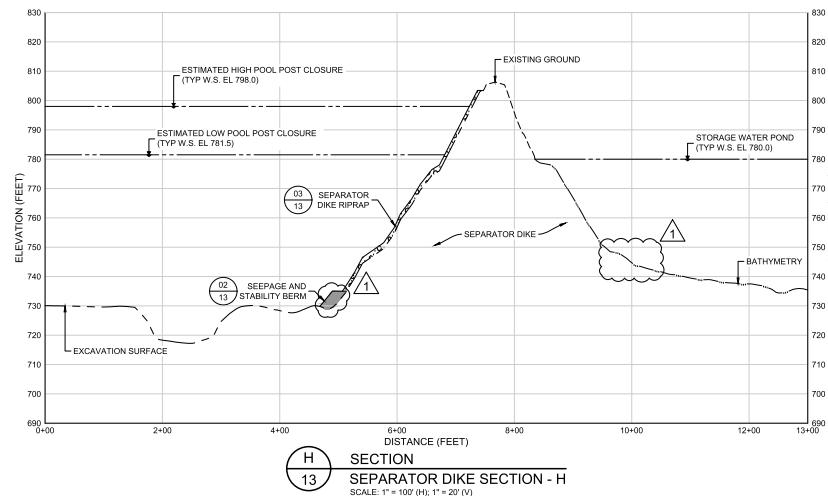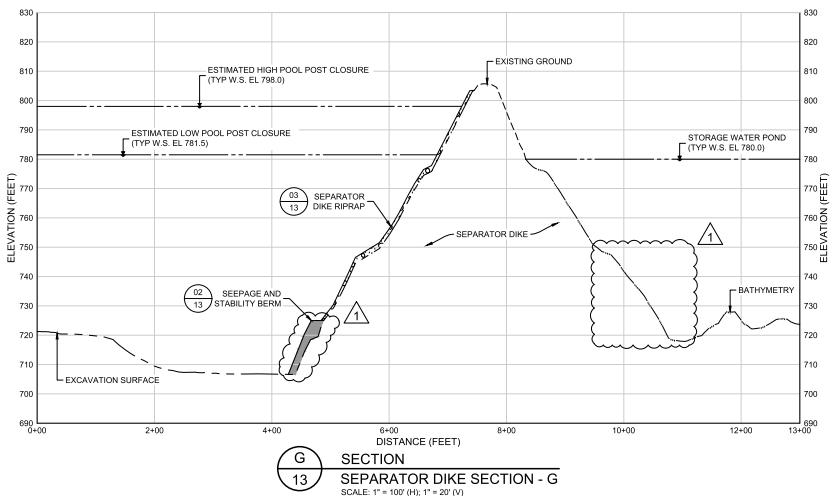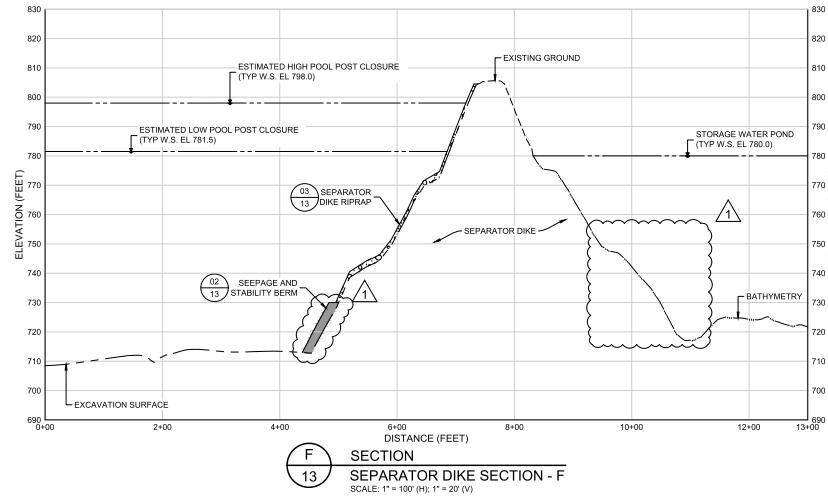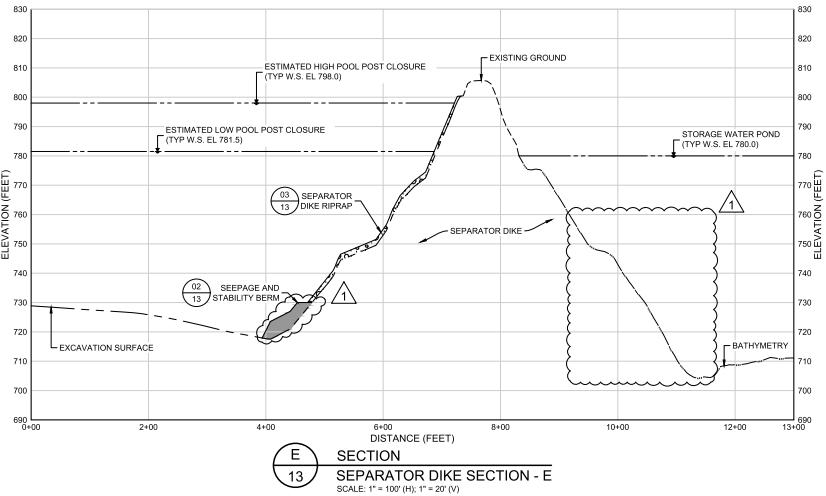

NOTES:

- SEE DETAILS ON DRAWING 13 FOR PLACEMENT OF MATERIALS ON THE AP-1 SIDE OF THE SEPARATOR DIKE.





|   |               |  |               |                  |
|---|---------------|--|---------------|------------------|
| 1   | 11-10-25      | MINOR PERMIT MOD 2 - REVISION TO AP-1 DESIGN | WSA           | MS               |
| 0   | 02/06/25      | GA EPD COR PERMIT DRAWINGS                   | DRJ           | JMG              |
| REV   | DATE          |  | DESCRIPTION   | DRN APP          |
| SEPARATOR DIKE SECTIONS   |               |  |               |                  |
| PLANT WANSLEY ASH POND CLOSURE BY REMOVAL<br>HEARD AND CARROLL COUNTIES, GEORGIA                                |               |  |               |                  |
|   |               |  |               |                  |
| Digitally signed<br>by Jeremy Gasser<br>Date: 2025.11.10<br>15:45:20 -05'00"                                    |               |  |               |                  |
| 125 ROBERTS BOULEVARD, NW, SUITE 200<br>KENNESAW, GEORGIA 30144 USA<br>PHONE: 678.562.8600<br>WWW.GEOSYNTEC.COM |               |  |               |                  |
| PROJ. NO.   | GW9155        | DWG  | GW7306-13-C16 | EDIT             |
| SCALE   | AS SHOWN      |  |               | 9/18/25          |
| DATE  | NOVEMBER 2025 |  |               | DRAWING 16 OF 22 |





REMOVED THE RIPRAP BUTTRESS WITHIN THE STORAGE WATER POND.  
REVISED SEEPAGE AND STABILITY BERM GEOMETRY.

0 100 200  
SCALE IN FEET (H)

0 20 40  
SCALE IN FEET (V)



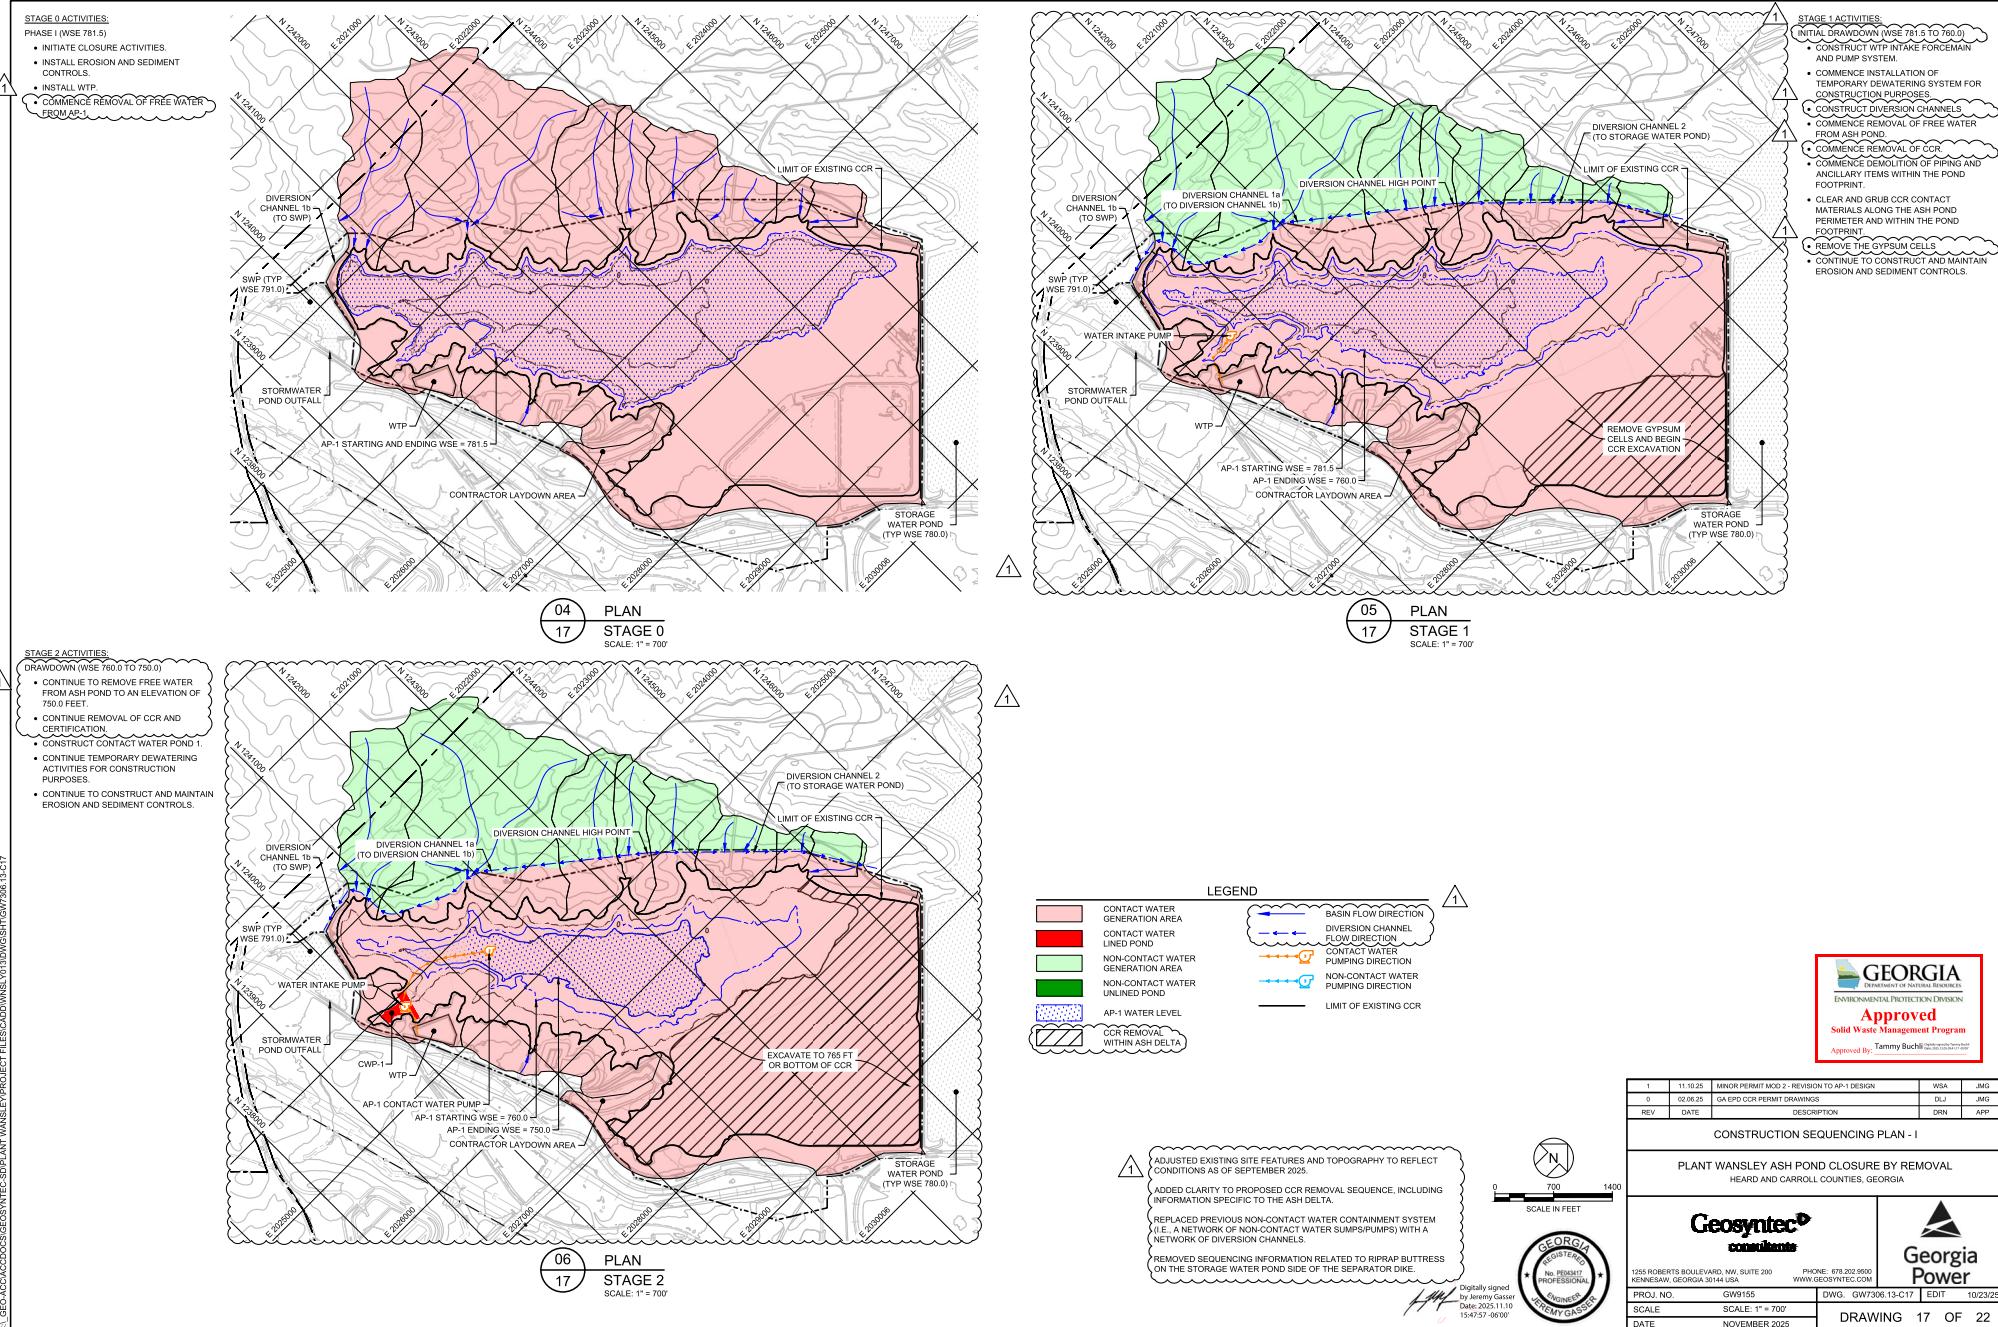


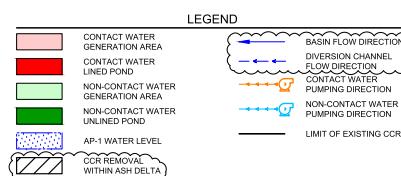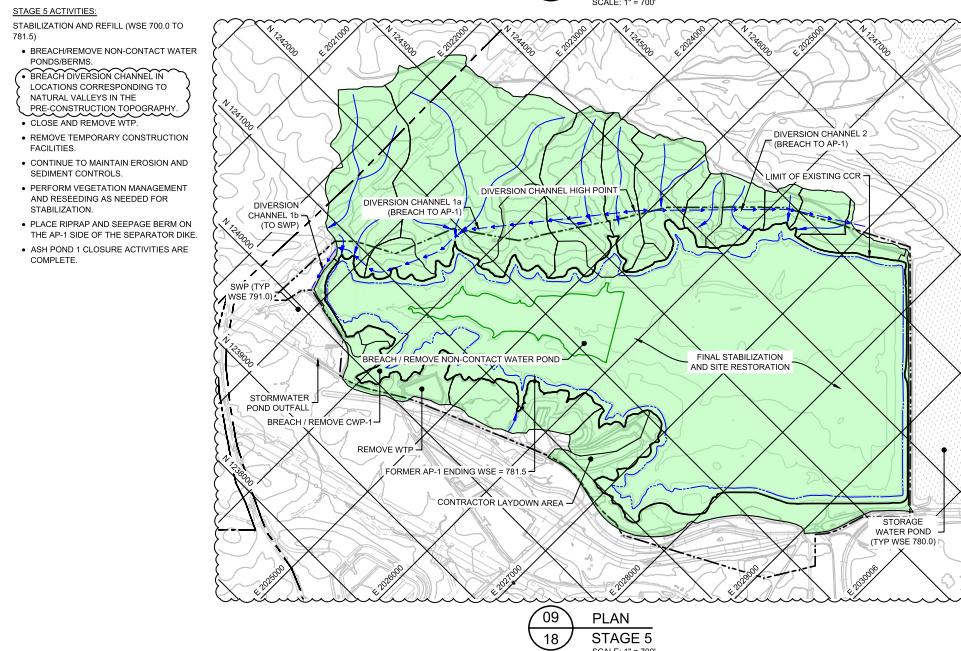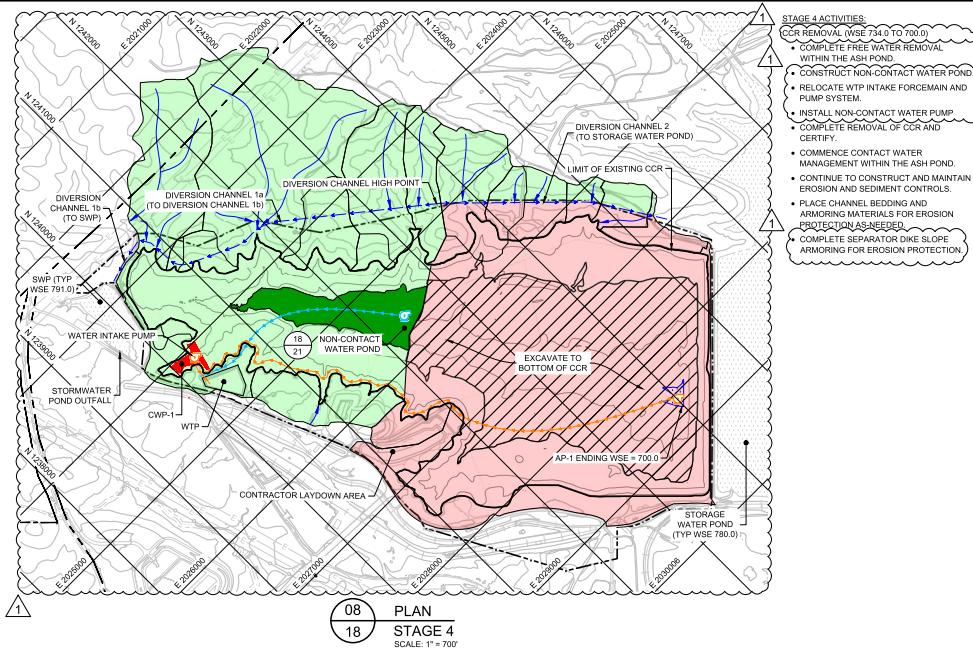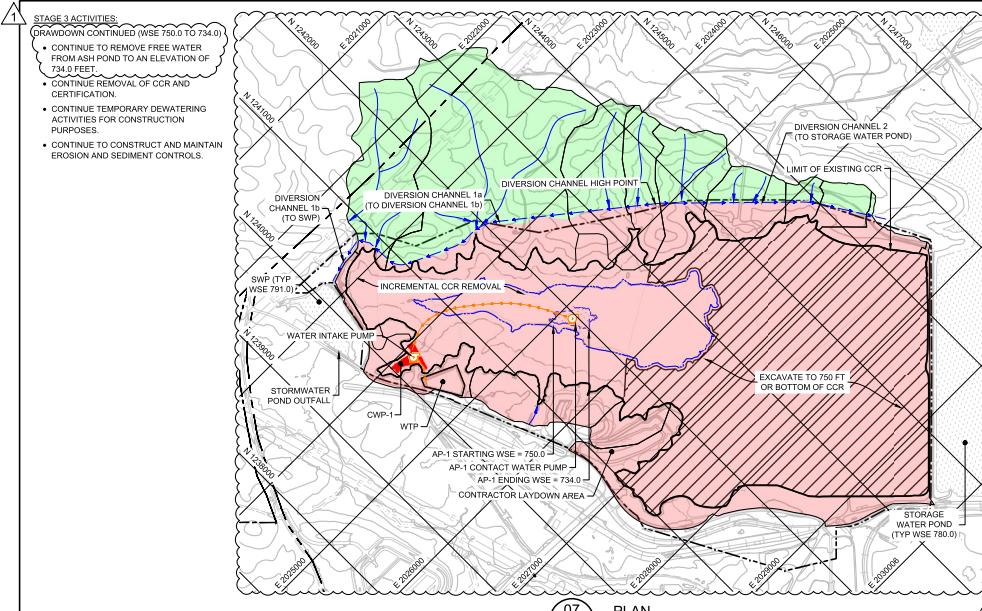

ADJUSTED EXISTING SITE FEATURES AND TOPOGRAPHY TO REFLECT CONDITIONS AS OF SEPTEMBER 2025.  
ADDED CLARITY TO PROPOSED CCR REMOVAL SEQUENCE, INCLUDING INFORMATION SPECIFIC TO THE ASH DELTA.  
REPLACED PREVIOUS NON-CONTACT WATER CONTAINMENT SYSTEM (A NETWORK OF NON-CONTACT WATER SUMPS/PUMPS) WITH A NETWORK OF DIVERSION CHANNELS.  
REMOVED SEQUENCING INFORMATION RELATED TO RIPRAP BUTTRESS ON THE STORAGE WATER POND SIDE OF THE SEPARATOR DIKE.

Digital signature by Jeremy Goyer  
Date: 2023.11.10  
154843-00107

|  |          |   |     |     |
|--|----------|---|-----|-----|
| 1  | 11-10-25 | MINOR PERMIT MOD 2 - BREACH TO AP-1 DESIGN                              | DRN | REG |
| 0  | 02/06/25 | GA EPD CCR PERMIT DRAWINGS  | DRN | JMG |
| REV  | DATE     | DESCRIPTION   | DRN | APP |
| CONSTRUCTION SEQUENCING PLAN - II  |          |   |     |     |
| PLANT WANSLEY ASH POND CLOSURE BY REMOVAL<br>HEARD AND CARROLL COUNTIES, GEORGIA                                 |          |   |     |     |
| <b>Geosyntec</b><br>consultants  |          | Georgia Power   |     |     |
| 1255 ROBERTS BOULEVARD, NW, SUITE 200<br>KENNESAW, GEORGIA 30144 USA<br>PHONE: 678.562.8900<br>WWW.GEOSYNTEC.COM |          | PROJECT NO. GW9155<br>SCALE: 1" = 700' DWG. GW7306.13-C18 EDIT 10/23/23 |     |     |
| DATE NOVEMBER 2025   |          | DRAWING 18 OF 22  |     |     |

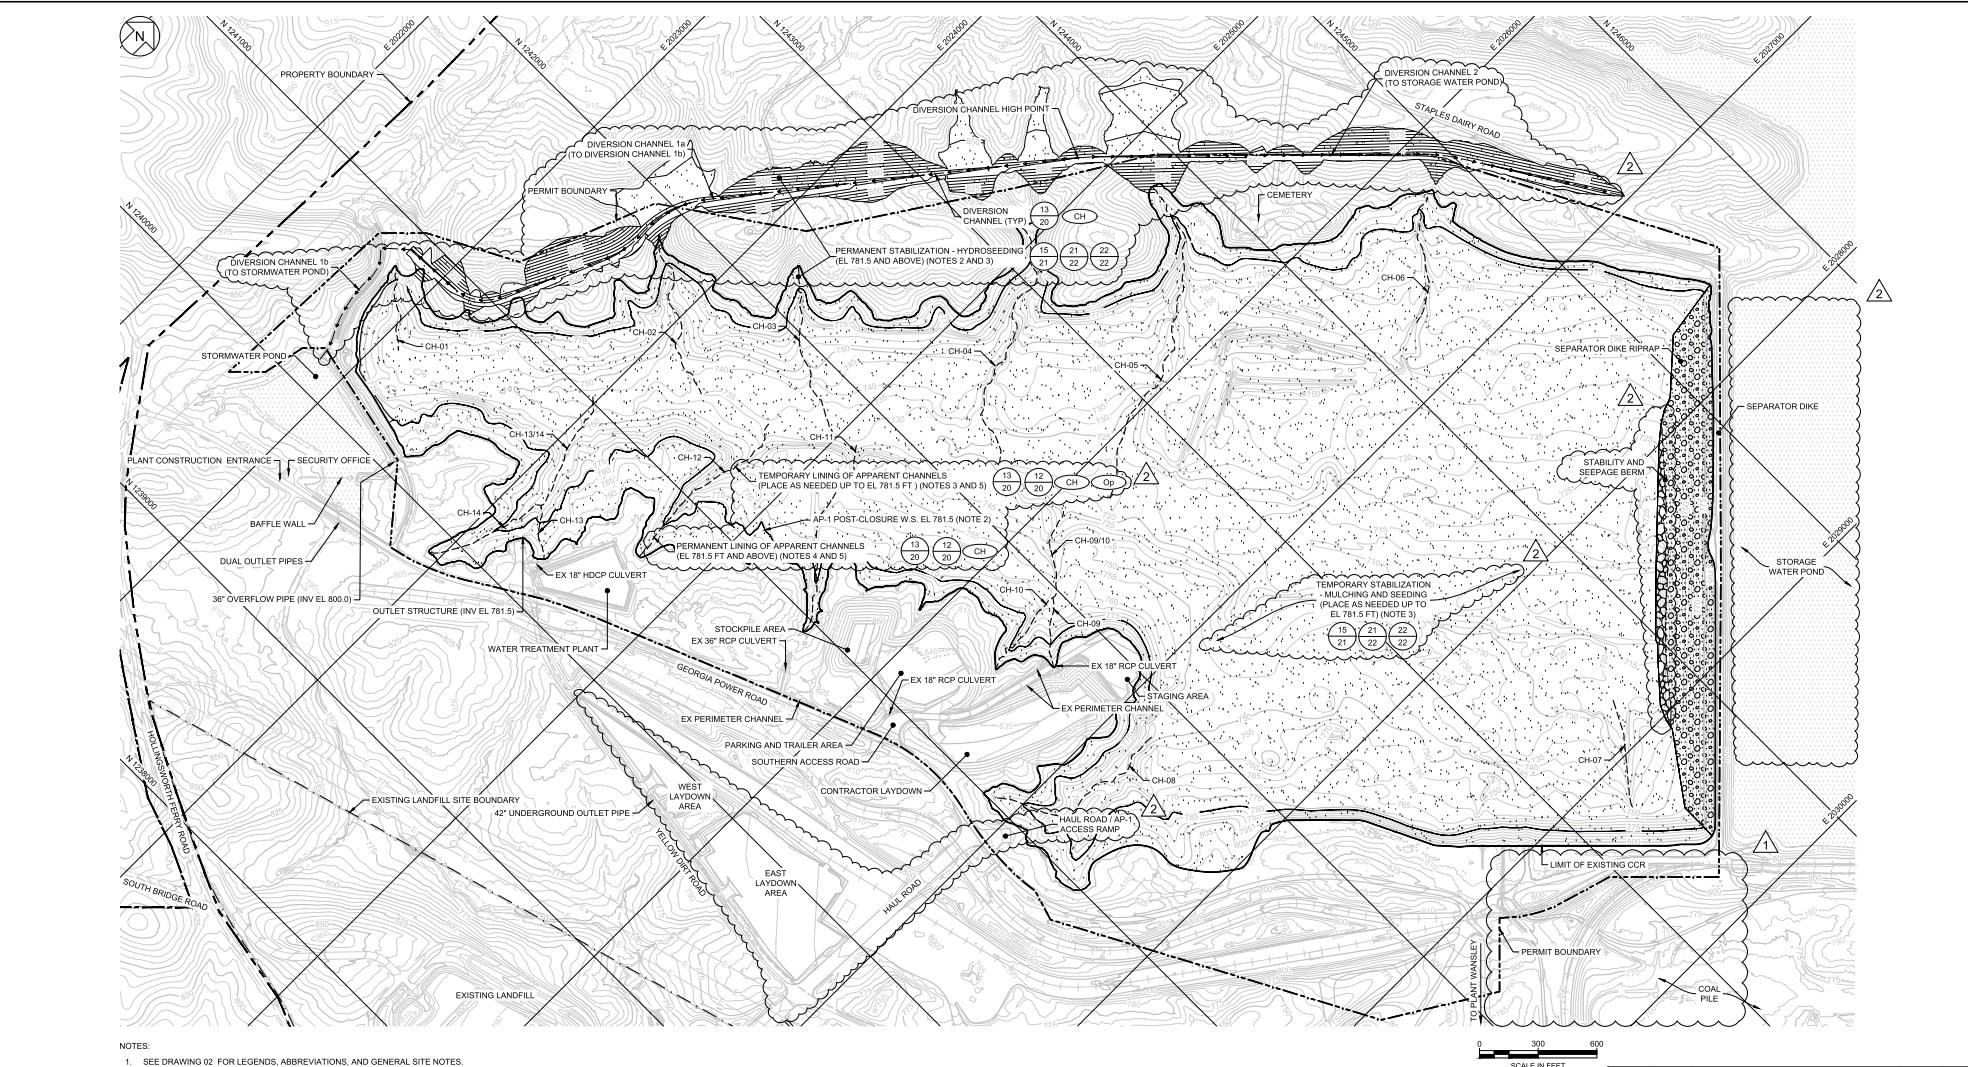

## NOTES:

1. SEE DRAWING 02 FOR LEGENDS, ABBREVIATIONS, AND GENERAL SITE NOTES.
2. FOLLOWING COMPLETION OF CONTRACTOR'S WORK, THE FORMER AP-1 WILL NATURALLY REFILL WITH WATER TO A LEVEL OF 781.5 FT. ANY DIVERSION BERMS THAT THE CONTRACTOR CONSTRUCTS DURING CONSTRUCTION WILL NEED TO BE REMOVED OR BREACHED BY THE CONTRACTOR AS NECESSARY TO NOT RETAIN WATER OR DRAIN OUTSIDE OF THE FORMER AP-1 POOL AT A MINIMUM. THIS WILL INCLUDE THE BREACHING OF THE DIVERSION CHANNEL PRESENTED IN THE CONSTRUCTION SEQUENCING PLAN (DRAWINGS 16 AND 17).
3. WITH THE EXCEPTION OF THE SEPARATOR DIKE STONE LINING, STORMWATER FEATURES AND STABILIZATION MEASURES BELOW 781.5 FT ARE INTERIM BEST MANAGEMENT PRACTICES (BMPs) AND SHALL BE MAINTAINED ON AN AS-NEEDED BASIS AS CCR EXCAVATION WITHIN AP-1 ADVANCES (I.E., AFTER VERIFICATION OF CCR REMOVAL AND ADDITIONAL 6 INCHES OF SOIL). BMPS INCLUDE, BUT ARE NOT LIMITED TO, MULCHING, SEEDING, GRASSING, CHANNEL LINING, OUTLET PROTECTION, CHECK DAMS, AND ROCK FILTER DAMS (SEE DRAWINGS DRAWING 20 THROUGH 22). CONTRACTOR IS RESPONSIBLE FOR SELECTING, INSTALLING, AND MAINTAINING THESE FEATURES IN A MANNER THAT:

  - 3.1. PREVENTS RILL FORMATION, SEDIMENT MIGRATION, AND SUSPENDED SOLID MIGRATION THAT WOULD IMPEDE CCR REMOVAL ACTIVITIES OR EXCEED OPERATIONAL REQUIREMENTS OF THE WATER TREATMENT SYSTEM; AND,
  - 3.2. MEETS REQUIREMENTS OF NPDES PERMIT GA0208778 AND OTHER APPLICABLE CONSTRUCTION STORMWATER PERMITS.

4. STABILIZATION MEASURES ABOVE 781.5 FT ARE PERMANENT, INCLUDING RIPRAP LINING FOR THE DIVERSION CHANNELS, RIPRAP AND GRASS LINING FOR THE APPARENT CHANNELS WITHIN AP-1, AND HYDROSEEDING (SEE LIMITS ON DRAWING 12). THESE FEATURES SHALL BE MAINTAINED IN THE INTERIM CONDITION ACCORDING TO THE SAME REQUIREMENTS IN NOTE 3.
5. APPARENT LOCATIONS OF CHANNELS FORCED BY THE BOTTOM OF CCR SURFACE WERE DETERMINED BASED ON THE MARCH 1976 SURVEY. THE CHANNELS ARE SUBJECT TO MODIFICATION DUE TO CCR REMOVAL AND REWORK. ALLOWANCE IS MADE TO CHANGE AND WILL BE EVALUATED AS CCR REMOVAL PROGRESS ACCORDING TO THE METHODOLOGY IN DETAIL 13 OF DRAWING 20.

1 REVISED AP-1 PERMIT BOUNDARY  
2 ADJUSTED EXISTING SITE FEATURES AND TOPOGRAPHY TO REFLECT CONDITIONS AS OF SEPTEMBER 2024 (I.E., CONSTRUCTION OF HAUL ROAD, LAYDOWN AREAS, AND BU LOADING AREA).

**Approved**  
Solid Waste Management Program  
Approved By: Tammy Buchli

Digitally signed by Jennifer L. Buchli  
on 2024.09.11 10:15:04.42 -04'00"

|     |          |   |     |     |
|-----|----------|---|-----|-----|
| 2   | 11-10-25 | MINOR PERMIT MOD 2 - REVISION TO AP-1 DESIGN          | WSA | APP |
| 1   | 07-09-25 | MINOR PERMIT MOD 1 - REVISION TO AP-1 PERMIT BOUNDARY | WSA | APP |
| 0   | 02-06-25 | GA EPD COR PERMIT DRAWINGS                            | BUJ | APP |
| REV | DATE     | DESCRIPTION   | DRN | APP |

FINAL STORMWATER AND ESC PLAN

PLANT WANSLY ASH POND CLOSURE BY REMOVAL  
HEAD AND CARROLL COUNTIES, GEORGIA

**Geosyntec** consultants


Georgia Power

1255 ROBERTS BOULEVARD, NW, SUITE 200  
KENNESAW, GEORGIA 30144 USA  
PHONE: 678.562.9500  
WWW.GEOSYNTEC.COM

PROJ. NO. GW9155 DWG. GW7306.13-C19 EDIT 9/18/25

SCALE AS SHOWN

DATE NOVEMBER 2025 DRAWING 19 OF 22

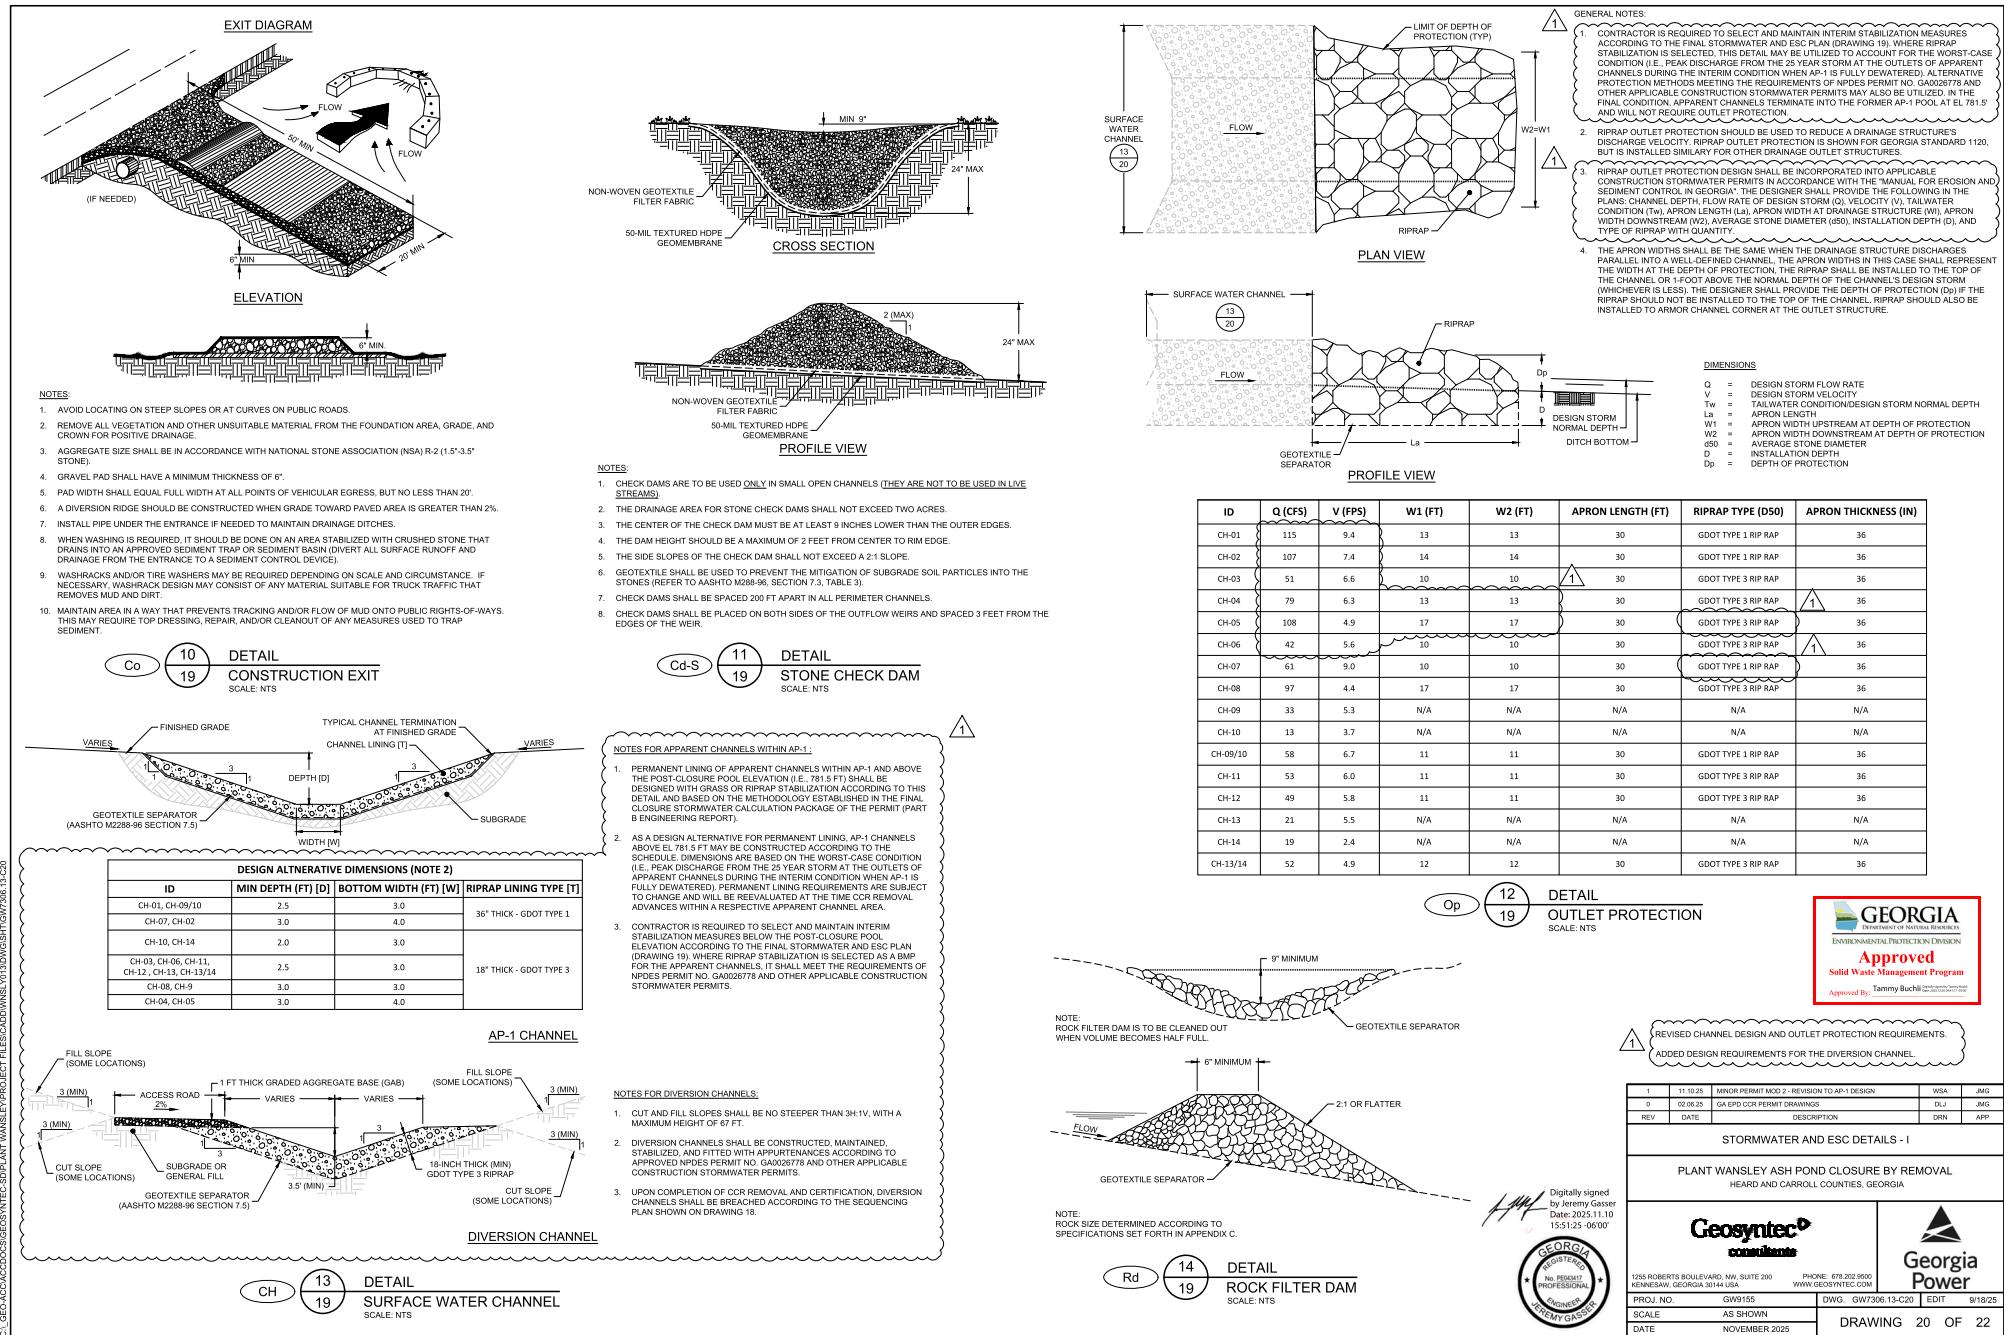

**PLANT, PLANTING RATE & PLANTING DATE FOR TEMPORARY SEEDING**

| BROADCAST                          | SPECIES    | RATES | PLANTING DATES |   |   |   |   |   |   |   |   |   |   |   |
|------------------------------------|------------|-------|----------------|---|---|---|---|---|---|---|---|---|---|---|
|                                    |            |       | J              | F | M | A | M | J | J | A | S | O | N | D |
| BARLEY ALONE                       | 144 LBS/AC |       |                |   |   |   |   |   |   |   |   |   |   |   |
| BARLEY IN MIXTURE                  | 24 LBS/AC  |       |                |   |   |   |   |   |   |   |   |   |   |   |
| LESPEDIZA, ANNUAL ALONE            | 40 LBS/AC  |       |                |   |   |   |   |   |   |   |   |   |   |   |
| LESPEDIZA, ANNUAL IN MIXTURE       | 10 LBS/AC  |       |                |   |   |   |   |   |   |   |   |   |   |   |
| LOVEGRASS, WEEPING ALONG LOW SITES | 4 LBS/AC   |       |                |   |   |   |   |   |   |   |   |   |   |   |
| LOVEGRASS, WEEPING IN MIXTURE      | 2 LBS/AC   |       |                |   |   |   |   |   |   |   |   |   |   |   |
| MILLET, BROWNTOP ALONE             | 40 LBS/AC  |       |                |   |   |   |   |   |   |   |   |   |   |   |
| MILLET, BROWNTOP IN MIXTURE        | 10 LBS/AC  |       |                |   |   |   |   |   |   |   |   |   |   |   |
| MILLET, PEARL ALONE                | 50 LBS/AC  |       |                |   |   |   |   |   |   |   |   |   |   |   |
| OATS ALONE                         | 128 LBS/AC |       |                |   |   |   |   |   |   |   |   |   |   |   |
| OATS IN MIXTURE                    | 32 LBS/AC  |       |                |   |   |   |   |   |   |   |   |   |   |   |
| RYE ALONE                          | 168 LBS/AC |       |                |   |   |   |   |   |   |   |   |   |   |   |
| RYE IN MIXTURE                     | 28 LBS/AC  |       |                |   |   |   |   |   |   |   |   |   |   |   |
| RYEGRASS, ANNUAL ALONE             | 40 LBS/AC  |       |                |   |   |   |   |   |   |   |   |   |   |   |
| SUDANGRASS ALONE                   | 60 LBS/AC  |       |                |   |   |   |   |   |   |   |   |   |   |   |
| TRITCALE ALONE                     | 144 LBS/AC |       |                |   |   |   |   |   |   |   |   |   |   |   |
| TRITCALE IN MIXTURE                | 24 LBS/AC  |       |                |   |   |   |   |   |   |   |   |   |   |   |
| WHEAT ALONE                        | 180 LBS/AC |       |                |   |   |   |   |   |   |   |   |   |   |   |
| WHEAT WITH OTHER PERENNIALS        | 30 LBS/AC  |       |                |   |   |   |   |   |   |   |   |   |   |   |

SOLID LINES INDICATE OPTIMUM DATES. DOTTED LINES INDICATE PERMISSIBLE BUT MARGINAL DATES.

**DEFINITION**  
THE ESTABLISHMENT OF TEMPORARY VEGETATION COVER WITH FAST GROWING SEEDINGS FOR SEASONAL PROTECTION ON DISTURBED OR DENUDED AREAS.

**CONDITIONS**  
TEMPORARY VEGETATIVE MEASURES SHOULD BE COORDINATED WITH PERMANENT PLANTING PLANS AND NOT BE USED AS A STANDALONE STABILIZATION. MOST TYPES OF TEMPORARY VEGETATION ARE IDEAL TO USE AS COMPANION CROPS UNTIL THE PERMANENT VEGETATION IS ESTABLISHED. NOTE: SOME SPECIES OF TEMPORARY VEGETATION ARE NOT APPROPRIATE FOR USE ON SITES WHERE THEY MAY BECOME AGGRESSIVE AND OUT-COMPETE THE DESIRED SPECIES (E.G. ANNUAL RYEGRASS). CONTACT NATURAL RESOURCE CONSERVATION SERVICE OR THE LOCAL SOIL WATER CONSERVATION DISTRICT FOR MORE INFORMATION.

**SPECIFICATIONS**  
GRAZING AND SHAPING  
EXCESSIVE WATER RUNOFF SHALL BE REDUCED BY PROPERLY DESIGNED AND INSTALLED EROSION CONTROL PRACTICES SUCH AS CLOSED DRAINS, DITCHES, DIKES, DIVERSIONS, SEDIMENT BARRIERS AND OTHERS. NO SHARING OF GRAZING IS REQUIRED IF SLOPES CAN BE STABILIZED BY HAND-SEEDED VEGETATION OR IF HYDRAULIC SEEDING EQUIPMENT IS TO BE USED.

SEEDBED PREPARATION  
WHEN A HYDRAULIC SEEDER IS USED, SEEDBED PREPARATION IS NOT REQUIRED. WHEN USING CONVENTIONAL OR HAND-SEEDED, SEEDBED PREPARATION IS NOT REQUIRED IF THE SOIL MATERIAL IS LOOSE AND NOT SEALED BY RAINFALL. WHEN SOIL HAS BEEN SEALED BY RAINFALL OR CONSTRUCTION OF SMOOTH CUT SLOPES, THE SOIL SHALL BE PITTED, TRENCHED, OR OTHERWISE SCARIFIED TO PROVIDE A PLACE FOR SEED TO LEDGE AND GERMINATE.

LIME AND FERTILIZER  
AGRICULTURAL LIME IS REQUIRED UNLESS SOIL TESTS INDICATE OTHERWISE. APPLY AGRICULTURAL LIME AT A RATE DETERMINED BY SOIL TEST FOR pH.

**Ds2 15 19 DETAIL DISTURBED AREA STABILIZATION (WITH TEMPORARY SEEDING)**  
SOURCE: GSWC

**Tac 17 19 DETAIL TACKIFIER**  
SCALE: NTS  
SOURCE: GSWC

**REvised Stormwater Pond Requirements to Reflect the Replacement of the Previous Non-Contact Water Containment System (i.e. a network of non-contact water sums/pumps) (Wansley Ash Pond Closure Plan)**

**TYPICAL INSTALLATION GUIDELINES FOR ROLLED EROSION CONTROL PRODUCTS (RECP)**

**BLANKET AND MATTING CROSS-SECTIONS**

**SLOPE STABILIZATION**  
SLOPE STABILIZATION CAN BE APPLIED TO FLAT AREAS OR SLOPES WHERE THE EROSION HAZARD IS HIGH AND SLOPE PROTECTION IS NEEDED DURING THE ESTABLISHMENT OF VEGETATION.

**PERFORMANCE EVALUATION**  
FOR A PROJECT TO BE APPROVED AS SLOPE STABILIZATION, THAT PRODUCE OR PRACTICE MUST HAVE A DOCUMENTED C-FACTOR OF 0.010, AS SPECIFIED BY GSWC. FOR COMPLETE TEST PROCEDURE AND APPROVED PRODUCTS LIST PLEASE VISIT [WWW.GSWC.GEORGIA.GOV](http://WWW.GSWC.GEORGIA.GOV)

**PLANNING CONSIDERATIONS**  
CARE MUST BE TAKEN TO CHOOSE THE TYPE OF SLOPE STABILIZATION PRODUCT THAT IS APPROPRIATE FOR THE SPECIFIC NEEDS OF A PROJECT. TWO GENERAL TYPES OF SLOPE STABILIZATION PRODUCTS ARE DISCUSSED WITHIN THIS SPECIFICATION.

**ROLLED EROSION CONTROL PRODUCTS (RECP)**  
A NATURAL FIBER BLANKET WITH SINGLE OR DOUBLE POLYPROPYLENE FIBERS HELD TOGETHER BY A SCOUR BINDING AGENT WHICH WORKS TO STABILIZE SOIL PARTICLES. PAPER MULCH SHOULD NOT BE USED FOR EROSION CONTROL.

**HYDRAULIC EROSION CONTROL PRODUCTS (HECP)**  
HECP SHALL UTILIZE STRAW, COTTON, WOOL OR OTHER NATURAL BASED FIBERS HELD TOGETHER BY A SCOUR BINDING AGENT WHICH WORKS TO STABILIZE SOIL PARTICLES. PAPER MULCH SHOULD NOT BE USED FOR EROSION CONTROL.

**Criteria**

- ROLLED EROSION CONTROL PRODUCTS (RECPs) AND HYDRAULIC EROSION CONTROL PRODUCTS (HECPs)
- INSTALLATION AND STAPLING OF RECPs AND APPLICATION RATES FOR THE HECPs SHALL CONFORM TO MANUFACTURER'S GUIDELINES
- PRODUCTS SHALL HAVE A MAXIMUM C-FACTOR (ASTM D4590) FOR THE FOLLOWING GRADE: C-FACTOR (MAX) 3.1 OR GREATER

**Site Preparation**  
AFTER THE SITE HAS BEEN SHAPED AND GRADED TO THE APPROVED DESIGN, PREPARE A FRAMED AREA FOR THE SLOPE STABILIZATION CLADS AND STAKE MATS. THE CLADS SHOULD BE ONE INCH IN DIAMETER, AND ANY FOREIGN MATERIAL THAT WILL PREVENT CONTACT OF THE SOIL STABILIZATION MAT WITH THE SOIL SURFACE. SURFACE MUST BE SMOOTH TO ENSURE PROPER ADHESION OF BLANKETS OR MATTING TO THE SOIL SURFACE. IF NECESSARY, REDIRECT ANY RUNOFF FROM THE DITCH OR SLOPE DURING INSTALLATION.

**Detail Slope Protection**  
Slope protection details show a cross-section of a slope with a maximum operating level of 15'. It shows a top of the berm, spillway elevation, existing ground, excavation surface, cutoff trench (note 1), and an excavated ccr area. Notes provide dimensions and requirements for the cutoff trench.

**METHODS AND MATERIALS**

**A. TEMPORARY METHODS**

MULCHES SEE STANDARD D41 - DISTURBED AREA STABILIZATION (WITH MULCHING ONLY). SYNTHETIC RESINS MAY BE USED INSTEAD OF ASPHALT TO BIND MULCH MATERIAL. REFER TO SPECIFICATION TAG-TACKIFIERS IN THE MANUAL FOR EROSION AND SEDIMENT CONTROL IN GEORGIA, LATEST EDITION. RESINS SUCH AS CURASOL OR TERRATAKK SHOULD BE USED ACCORDING TO MANUFACTURER'S RECOMMENDATIONS.

**B. PERMANENT METHODS**

PERMANENT VEGETATION, SEE SPECIFICATION D43 - DISTURBED AREA STABILIZATION (WITH PERMANENT VEGETATION) IN THE MANUAL FOR EROSION AND SEDIMENT CONTROL IN GEORGIA, LATEST EDITION. EXISTING TREES AND LARGE SHRUBS MAY AFFORD VALUABLE PROTECTION IF LEFT IN PLACE.

**Topsoiling**  
THIS ENTAILS COVERING THE SURFACE WITH LESS EROSIONAL SOIL MATERIAL. SEE SPECIFICATION TP - TOPSOILING IN THE MANUAL FOR EROSION AND SEDIMENT CONTROL IN GEORGIA, LATEST EDITION.

**Conditions**  
THIS PRACTICE IS APPLICABLE TO AREAS SUBJECT TO SURFACE AND AIR MOVEMENT OF DUST WHERE ON AND OFF-SITE DAMAGE MAY OCCUR WITHOUT TREATMENT.

**Du 18 19 DETAIL STORMWATER PONDS**  
SCALE: NTS  
SOURCE: GSWC

**Du 19 19 DETAIL DUST CONTROL ON DISTURBED AREAS**  
SCALE: NTS  
SOURCE: GSWC

**The following measures shall be implemented to minimize CCR from becoming airborne at the facility, including CCR fugitive dust originating from CCR units, roads, and other CCR management and material handling activities:**

- FUGITIVE DUST ORIGINATING FROM THE CLOSURE OF AP-1 WILL BE CONTROLLED USING WATER SUPPRESSION, COMPACTION, SYNTHETIC OR VEGETATIVE COVERS, OR DUST SUPPRESSION AGENTS.
- CCR THAT IS TRANSPORTED VIA TRUCK TO THE EXISTING ON SITE LANDFILL WILL BE CONDITIONED TO APPROPRIATE MOISTURE CONTENT TO REDUCE THE POTENTIAL FOR FUGITIVE DUST.
- WATER SUPPRESSION WILL BE USED, AS NEEDED, TO CONTROL FUGITIVE DUST ON FACILITY ROADS USED TO TRANSPORT CCR AND OTHER CCR MANAGEMENT AREAS.
- SPEED LIMITS WILL BE USED TO REDUCE THE POTENTIAL FOR FUGITIVE DUST.
- TRUCKS USED TO TRANSPORT CCR WILL BE FILLED TO OR UNDER CAPACITY TO REDUCE THE POTENTIAL FOR MATERIAL SPILLAGE.

GPC PERSONNEL AND/OR THEIR CONTRACTORS SHALL PERFORM VISUAL OBSERVATIONS OF AP-1 AND SURROUNDING AREAS. APPROPRIATE CORRECTIVE ACTIONS FOR FUGITIVE DUST WILL BE IMPLEMENTED AS NECESSARY. LOGS WILL BE USED TO RECORD THE USE OF WATER SUPPRESSION. AMENDMENTS TO THE FUGITIVE DUST CONTROL PLAN MAY BE MADE AT ANY TIME AS REQUIRED DUE TO A CHANGE IN CONDITIONS THAT WOULD AFFECT THE IN-PLACE PLAN. ALL REVISIONS TO THE FUGITIVE DUST CONTROL PLAN WILL BE DOCUMENTED AND PLACED IN THE OPERATING RECORD. REFER TO THE CLOSURE PLAN SECTION 6.3.

**Stormwater and Esc Details - II**

**Plant Wansley Ash Pond Closure by Removal**  
HARD AND CARROLL COUNTIES, GEORGIA

**Geosyntec**  
REGISTERED PROFESSIONAL ENGINEER  
JEREMY GAESER

**Georgia Power**

135 ROBERTS BOULEVARD, NW, SUITE 200  
KENNESAW, GEORGIA 30144 USA  
PHONE: 678.552.9500  
WWW.GEOSYNTEC.COM

PROJ. NO. GW19155 DWG. GW7306.13-C21 EDIT 9/16/25  
SCALE AS SHOWN DRAWING 21 OF 22  
DATE NOVEMBER 2025

**CUBIC YARDS OF TOPSOIL REQUIRED FOR APPLICATION TO VARIOUS DEPTHS**

|   | PER 1,000 SQUARE FEET | PER ACRE |
|---|-----------------------|----------|
| 1 | 3.1                   | 334      |
| 2 | 6.2                   | 668      |
| 3 | 9.3                   | 992      |
| 4 | 12.4                  | 1337     |
| 5 | 15.5                  | 1671     |
| 6 | 18.6                  | 1905     |

**CONDITIONS**  
THIS PRACTICE IS RECOMMENDED FOR SITES OF 2:1 OR FLATTER SLOPES WHERE:  
1. THE TEXTURE OF THE EXPOSED SUBSOIL, OR PARENT MATERIAL, IS NOT SUITABLE TO PRODUCE ADEQUATE VEGETATIVE GROWTH.  
2. THE SOIL MATERIAL IS SO SHALLOW THAT THE ROOTING ZONE IS NOT DEEP ENOUGH TO SUPPORT PLANTS WITH CONTINUING SUPPLIES OF MOISTURE AND FOOD.  
3. THE SOIL TO BE VEGETATED CONTAINS MATERIAL TOXIC TO PLANT GROWTH.

**SPECIFICATIONS**  
MATERIAL REQUIREMENTS  
TOPSOIL SHOULD BE FRIABLE AND LOAMY, FREE OF DEBRIS, OBJECTIONAL WEEDS AND STONES, AND CONTAIN NO TOXIC SUBSTANCE THAT MAY BE HARMFUL TO PLANT GROWTH. A pH RANGE OF 5.0-7.5 IS ACCEPTABLE. SOLUBLE SALTS SHOULD NOT EXCEED 500 ppm.

**TESTING**  
FIELD EXPLORATION SHOULD BE MADE TO DETERMINE WHETHER THE QUANTITY AND QUALITY OF SURFACE SOIL JUSTIFIES STRIPPING.

**STRIPPING**  
STRIPPING SHOULD BE CONFINED TO THE IMMEDIATE CONSTRUCTION AREA. A 4 TO 6 INCH STRIPPING DEPTH IS COMMON, BUT MAY VARY DEPENDING ON THE PARTICULAR SOIL.

**TOPSOIL pH**  
IF pH LEVEL IS LESS THAN 6.0, LIME SHALL BE APPLIED AND INCORPORATED WITH THE TOPSOIL TO ADJUST THE pH TO 6.5 OR HIGHER. TOPSOILS CONTAINING SOLUBLE SALTS GREATER THAN 500 PARTS PER MILLION SHALL NOT BE USED.

**SITE PREPARATION (WHERE TOPSOIL IS TO BE ADDED)**  
TOPSOILING - WHEN TOPSOILING, MAINTAIN NEEDED EROSION CONTROL PRACTICES SUCH AS DIVERSIONS, GRADE STABILIZATION STRUCTURES, BERMS, DIKES, LEVEL SPREADERS, WATERWAYS, SEDIMENT BASINS, ETC.

**GRADING** - GRADES ON THE AREAS TO BE TOPSOILED WHICH HAVE BEEN PREVIOUSLY ESTABLISHED SHALL BE MAINTAINED.

**LIMING - SOIL TESTS** SHOULD BE USED TO DETERMINE THE pH OF THE SOIL. WHERE THE pH OF THE SUBSOIL IS 5.0 OR LESS OR COMPOSED OF HEAVY CLAYS, AGRICULTURAL LIMESTONE SHALL BE SPREAD AT THE RATE OF 100 POUNDS PER 1,000 SQUARE FEET. LIME SHALL BE DISTRIBUTED UNIFORMLY OVER DESIGNATED AREAS AND WORKED INTO THE SOIL IN CONJUNCTION WITH TILLAGE OPERATIONS AS DESCRIBED IN THE FOLLOWING PROCEDURE:

BONDING - USE ONE OF THE FOLLOWING METHODS TO INDUCE BONDING OF TOPSOIL AND SUBSOIL:  
1. TILLING AFTER THE AREAS TO BE TOPSOILED HAVE BEEN BROUGHT TO GRADE, AND IMMEDIATELY PRIOR TO DUMPING AND SPREADING THE TOPSOIL, THE SUBGRADE SHALL BE LOOSENERED BY DISCING OR SCRAPPING TO A DEPTH OF AT LEAST 3 INCHES TO PERMIT BONDING OF THE TOPSOIL TO THE SUBSOIL.  
2. TRACHING, PASSING A BULLDOZER OVER THE ENTIRE SURFACE AREA OF THE SLOPE TO LEAVE HORIZONTAL DEPRESSIONS.

**APPLYING TOPSOIL**  
1. TOPSOIL SHOULD BE HANDLED ONLY WHEN IT IS DRY ENOUGH TO WORK WITHOUT DAMAGING THE SOIL STRUCTURE.  
2. A UNIFORM APPLICATION OF 6 INCHES (UNSETTLED) IS RECOMMENDED, BUT MAY BE ADJUSTED AT THE DISCRETION OF THE ENGINEER OR LANDSCAPE ARCHITECT.

**TOPOGRAPHIC SURVEY**  
TOPOGRAPHIC SURVEYS SHALL BE MADE TO DETERMINE THE ELEVATION OF THE EXPOSED AREAS. THE SURVEYS SHALL BE MADE IN ACCORDANCE WITH THE GEORGIA STATE SURVEYING STANDARDS AND PRACTICES.

**DEFINITION**  
APPLYING PLANT RESIDUES OR OTHER SUITABLE MATERIALS, PRODUCED ON THE SITE IF POSSIBLE, TO THE SOIL SURFACE.

**CONDITIONS**  
MULCH OR TEMPORARY GRASSING SHALL BE APPLIED TO ALL EXPOSED AREAS WITHIN 14 DAYS OF DISTURBANCE. MULCH CAN BE USED AS A SINGULAR EROSION CONTROL DEVICE FOR UP TO SIX MONTHS, BUT IT SHALL BE APPLIED AT THE APPROPRIATE DEPTH (DEPENDING ON THE MATERIAL USED), ANCHORED, AND HAVE A CONTINUOUS 90% COVER OR GREATER OF THE SOIL SURFACE.

Maintenance SHALL BE REQUIRED TO MAINTAIN APPROPRIATE DEPTH AND 90% COVER. TEMPORARY VEGETATION MAY BE EMPLOYED INSTEAD OF MULCH IF THE AREA WILL REMAIN UNDISTURBED FOR LESS THAN SIX MONTHS.

IF ANY AREA WILL REMAIN UNDISTURBED FOR GREATER THAN SIX MONTHS, PERMANENT VEGETATIVE TECHNIQUES SHALL BE EMPLOYED. REFER TO **9e2-DISTURBED AREA STABILIZATION (WITH PERMANENT VEGETATION)**.

**SPECIFICATIONS**  
NO TACKING OUT SEEDING:  
THIS STANDARD APPLIES TO GRADED OR CLEARED AREAS WHERE SEEDINGS MAY NOT HAVE A SUITABLE GROWING SEASON TO PRODUCE AN EROSION RETARDANT COVER, BUT CAN BE STABILIZED WITH A MULCH COVER.

**SITE PREPARATION**  
1. GRADE TO PERMIT THE USE OF EQUIPMENT FOR APPLYING AND ANCHORING MULCH.  
2. INSTALL NEEDED EROSION CONTROL MEASURES AS REQUIRED SUCH AS DIKES, DIVERSIONS, BERMS, TERRACES, AND SEDIMENT BARRIERS.  
3. LOOSEN COMPACT SOIL TO A MINIMUM DEPTH OF 3 INCHES.

**MULCHING MATERIALS**  
SELECT ONE OF THE FOLLOWING MATERIALS AND APPLY AT THE DEPTH INDICATED:  
1. DRY STRAW OR HAY SHALL BE APPLIED AT A DEPTH OF 2 TO 3 INCHES PROVIDING COMPLETE SOIL COVERAGE. ONE ADVANTAGE OF THIS MATERIAL IS EASY APPLICATION.  
2. WOOD WASTE (CHIPS, SAWDUST OR BARK) SHALL BE APPLIED AT A DEPTH OF 2 TO 3 INCHES. ORGANIC MATERIAL FROM THE CLEARING STAGE OF DEVELOPMENT REMAINING ON SITE CAN BE CHIPPED AND APPLIED AS MULCH. THIS METHOD OF MULCHING CAN GREATLY REDUCE EROSION CONTROL COSTS.  
3. POLYETHYLENE FILM SHALL BE SECURED OVER BANKS OR STOCKPILED SOIL MATERIAL FOR TEMPORARY PROTECTION. THIS MATERIAL CAN BE SALVAGED AND RE-USED.

**AFTER MULCHING**  
1. DRY STRAW OR HAY SHALL BE APPLIED TO PROVIDE FULL COVERAGE OF THE EXPOSED AREA.  
2. IF THE AREA WILL EVENTUALLY BE COVERED WITH PERENNIAL VEGETATION, 20-30 POUNDS OF NITROGEN PER ACRE, IN ADDITION TO THE NORMAL AMOUNT, SHALL BE APPLIED TO OFFSET THE UPTAKE OF NITROGEN CAUSED BY THE DECOMPOSITION OF THE ORGANIC MULCHES.

**ANCHORING MULCH**  
1. STRAW OR HAY MULCH CAN BE PRESSED INTO THE SOIL WITH A DISK HARROW WITH THE DISK SET STRAIGHT OR WITH A SPECIAL "PACKER DISK" DISKS MAY BE SMOOTH OR BURRED AND SHOULD BE ANCHORED IMMEDIATELY AFTER APPLICATION. STRAW OR HAY MULCH SPREAD WITH SPECIAL BLOWER-TYPE EQUIPMENT MAY BE ANCHORED.  
2. TACKIFIERS, BINDERS, AND HYDRAULIC MULCH WITH TACKIFIER SPECIFICALLY DESIGNED FOR TACKING STRAW OR HAY MULCH CAN BE SUBSTITUTED FOR EMULSIFIED ASPHALT. REFER TO MANUAL FOR EROSION AND SEDIMENT CONTROL AND EROSION RETARDANT COVER SPECIFICATION - TAC-TACKIFIERS. PLASTIC MESH OF NETTING WITH MESH NO LARGER THAN ONE INCH BY ONE INCH SHALL BE INSTALLED ACCORDING TO MANUFACTURER'S SPECIFICATIONS.

2. NETTING OF THE APPROPRIATE SIZE SHALL BE USED TO ANCHOR WOOD WASTE. OPENINGS OF THE NETTING SHALL NOT BE LARGER THAN THE AVERAGE SIZE OF THE WOOD WASTE CHIPS.

**FERTILIZER REQUIREMENTS**

| WARM SEASON GRASSES |                                     |
|---------------------|-------------------------------------|
| YEAR                | EQUIVALENT N-P-K ANALYSIS OR RATE   |
| FIRST               | 1150 LBS/AAC<br>85-100 LBS/AAC 2/8' |
| SECOND              | 800 LBS/AAC<br>65-100 LBS/AAC 2/8'  |
| MAINTENANCE         | 400 LBS/AAC<br>30 LBS/AAC           |

| COLD SEASON GRASSES |                                   |
|---------------------|-----------------------------------|
| YEAR                | EQUIVALENT N-P-K ANALYSIS OR RATE |
| FIRST               | 1100 LBS/AAC<br>30 LBS/AAC        |
| SECOND              | 1000 LBS/AAC<br>30 LBS/AAC        |
| MAINTENANCE         | 400 LBS/AAC<br>—                  |

**PLANT, PLANTING RATE & PLANTING DATE FOR PERMANENT COVER**

| SPECIES  | BROADCAST RATES | PLANTING DATES |     |     |     |     |     |     |     |     |     |     |  | PLANTING DATE REMARKS |
|--|-----------------|----------------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|-----------------------|
|  |                 | J              | F   | M   | A   | M   | J   | J   | A   | S   | O   | N   | D  |                       |
| LESPEDEZA SERICEA SCARIFIED                          | 60 LBS/AC       | ...            | ... | ... | ... | ... | ... | ... | ... | ... | ... | ... | WIDEY ADAPTED. LOW MAINTENANCE. MIX WITH COMMON BERMUDA OR TALL FESCUE. INOCULATE SEED WITH EL INOCULANT.  |                       |
| LESPEDEZA SERICEA UNSCARIFIED                        | 75 LBS/AC       | ...            | ... | ... | ... | ... | ... | ... | ... | ... | ... | ... | MIX WITH TALL FESCUE.  |                       |
| BERMUDA BAHIA ALONE OR WITH TEMPORARY COVER          | 60 LBS/AC       | ...            | ... | ... | ... | ... | ... | ... | ... | ... | ... | ... | LOW GROWING, SOFT FORMING. SLOW TO ESTABLISH. PLANT WITH A COMPANION CROP. WILL SPREAD INTO BERMUDA, PASTURES, AND LAWNS. MIX WITH SERICEA LESPEDEZA.                        |                       |
| WILLOW HERB-BAHIA WITH OTHER PERENNIALS              | 30 LBS/AC       | ...            | ... | ... | ... | ... | ... | ... | ... | ... | ... | ... | USE ALONE ONLY ON BETTER SITES. MIX WITH SERICEA LESPEDEZA OR CROWNVETCH. APPLY TOP DRESSING IN SPRING FOLLOWING FALL PLANTINGS. NOT FOR HEAVY USE AREAS OR ATHLETIC FIELDS. |                       |
| TALL FESCUE ALONE                                    | 50 LBS/AC       | ...            | ... | ... | ... | ... | ... | ... | ... | ... | ... | ... | ...  |                       |
| TALL FESCUE WITH OTHER PERENNIALS                    | 30 LBS/AC       | ...            | ... | ... | ... | ... | ... | ... | ... | ... | ... | ... | ...  |                       |
| REED CANARY GRASS ALONE OR WITH OTHER PERENNIALS     | 50 LBS/AC       | ...            | ... | ... | ... | ... | ... | ... | ... | ... | ... | ... | GROWS SIMILAR TO TALL FESCUE.  |                       |
| COMMON BERMUDA UNHOLLOWED SEED WITH TEMPORARY COVER  | 10 LBS/AC       | ...            | ... | ... | ... | ... | ... | ... | ... | ... | ... | ... | PLANT WITH WINTER ANNUALS.   |                       |
| COMMON BERMUDA UNHOLLOWED SEED WITH OTHER PERENNIALS | 6 LBS/AC        | ...            | ... | ... | ... | ... | ... | ... | ... | ... | ... | ... | PLANT WITH TALL FESCUE.  |                       |

SOLID LINES INDICATE OPTIMUM DATES, DOTTED LINES INDICATE PERMISSIBLE BUT MARGINAL DATES.

**DEFINITION**  
TREPPING OF PERENNIAL VEGETATION SUCH AS TREES, SHRUBS, VINES, GRASSES, OR LEGUMES ON EXPOSED AREAS FOR FINAL PERMANENT STABILIZATION. PERMANENT PERENNIAL VEGETATION SHALL BE USED TO ACHIEVE FINAL STABILIZATION.

**CONDITIONS**  
PERMANENT PERENNIAL VEGETATION IS USED TO PROVIDE A PROTECTIVE COVER ON EXPOSED AREAS INCLUDING CUTS, FILLS, DAMS, AND OTHER DENUDED AREAS.

**SPECIFICATIONS**  
GRADING AND SHAPING  
GRADING AND SHAPING MAY NOT BE REQUIRED WHERE HYDRAULIC SEEDING AND FERTILIZING EQUIPMENT IS USED TO USE VERTICALLY BANKS SHALLOW SLOPES TO EASILY ALLOW A ESTABLISHMENT WHICH CORRESPONDING SEEDING AND FERTILIZING ARE TO BE DONE. GRADE AND SHAPE WHERE FEASIBLE AND PRACTICAL, SO THAT EQUIPMENT CAN BE USED SAFELY AND EFFICIENTLY DURING CONSTRUCTION. GRADE AND SHAPE TO ENSURE PROTECTION OF THE VEGETATION. CONCENTRATIONS OF WATER THAT WILL CAUSE EXCESSIVE SOIL EROSION SHALL BE DIVERTED TO A SAFE OUTLET. DIVERSIONS AND OTHER TREATMENT PRACTICES SHALL CONFORM WITH THE APPROPRIATE STANDARDS AND SPECIFICATIONS.

**SEEDING PREPARATION**  
SEEDING PREPARATION MAY NOT BE REQUIRED WHERE HYDRAULIC SEEDING AND FERTILIZING EQUIPMENT IS TO BE USED (BUT IS STRONGLY RECOMMENDED FOR ANY SEEDED PROCESS, WHEN POSSIBLE). WHEN CONVENTIONAL SEEDED, SEEDED PREPARATION IS TO BE USED, SEEDED PREPARATION WILL BE DONE AS FOLLOWS:

**BROADCAST PLANTINGS**  
1. TILLAGE, AT A MINIMUM, SHALL ADEQUATELY LOOSEN THE SOIL TO A DEPTH OF 4 TO 6 INCHES; ALLEVIATE COMPACTION; INCORPORATE LIME AND FERTILIZER; SMOOTH AND FLAT THE SOIL ALLOWD FOR THE PROPER PLACEMENT OF THE SEED. THE SOIL MUST BE LOOSENED TO ALLOW THE ANCHORING OF STRAW OR HAY MULCH IF A DISK IS TO BE USED.  
2. TILLAGE MAY BE DONE WITH ANY SUITABLE EQUIPMENT.  
3. TILLAGE MAY BE DONE WITH THE CORRECT EQUIPMENT.  
4. ON SLOPES TOO STEEP FOR THE CORRECT OPERATION OF TILLAGE EQUIPMENT, THE SOIL SURFACE SHALL BE PITTED OR TRENCHED ACROSS THE SLOPE WITH APPROPRIATE HAND TOOLS TO PROVIDE TWO PLACES TO ENSURE THE SOIL STAYS IN PLACE. THE SOIL MUST NOT BE LOOSENED OR GERMINATE. HYDRAULIC SEEDED MAY ALSO BE USED.

**NURSERY STOCK PLANTS**  
NURSERY STOCK PLANTS SHALL BE PLANTED AT THE SAME DEPTH OR SLIGHTLY DEEPR THAN THEY GREW AT THE NURSERY. THE TIPS OF VINES AND SPRINGS MUST BE AT OR SLIGHTLY ABOVE THE GROUND SURFACE.

WHERE INDIVIDUAL HOLES ARE DUG, FERTILIZER SHALL BE PLACED IN THE BOTTOM OF THE HOLE. TWO INCHES OF SOIL SHALL BE ADDED, AND THE PLANT SHALL BE SET IN THE HOLE.

**PLANTING**  
HYDRAULIC SEEDED  
MIX THE SEED (INCULCATED IF NEEDED), FERTILIZER, AND WOOD CELLULOSE OR WOOD PULP FIBER WITH WATER AND APPLY IN A SLURRY. THE INGREDIENTS SHOULD BE WELL MIXED. THE SLURRY WILL BE SPREAD UNIFORMLY OVER THE AREA WITHIN ONE HOUR AFTER BEING PLACED IN THE HYDROSEEDER. FINELY GROUND LIMESTONE CAN BE APPLIED IN THE MULCH SLURRY OR IN COMBINATION WITH THE TOP DRESSING. WHEN CONVENTIONAL PLANTING IS TO BE USED, THE SEEDS SHALL BE SPREAD AND PLANTED ACCORDING TO THE FOLLOWING WAYS:  
1. HYDRAULIC SEEDED  
2. SYNTHETIC TACKIFIERS, FINDERS, OR HYDRAULIC MULCH SPECIFICALLY DESIGNED TO TACK STRAW OR HAY MULCH. ALL TACKIFIERS, FINDERS, OR HYDRAULIC MULCH SPECIFICALLY DESIGNED TO TACK STRAW SHOULD BE VERIFIED NONTOXIC THROUGH EPA 2021.0 TESTING. REFER TO TACKIFIERS-FINDERS-TACKER FOR THE MATERIALS AND METHODS OF USE.  
3. RYE OR WHEAT CAN BE PLANTED WITH TALL FESCUE AFTER PLANTINGS TO STABILIZE THE MULCH. THE SEEDS SHALL BE SPREAD AT A RATE OF ONE QUARTER TO ONE HALF PINT PER SQUARE YARD.  
4. PLASTIC MESH OR NETTING WITH MESH NO LARGER THAN ONE INCH BY ONE INCH MAY BE NEEDED TO ANCHOR STRAW OR HAY MULCH ON UNSTABLE SOILS AND CONCENTRATED FLOW AREAS. THESE MATERIALS SHALL BE INSTALLED AND ANCHORED ACCORDING TO MANUFACTURER'S SPECIFICATIONS.

**LINE AND PLATEAU APPLICATION**  
WHEN HYDRAULIC SEEDED EQUIPMENT IS USED, THE INITIAL FERTILIZER SHALL BE MIXED WITH A SLURRY. THE INGREDIENTS, IF NEEDED, SHALL BE MIXED WITH THE SEED PRIOR TO BE PLACED INTO THE HYDROSEEDER. THE INGREDIENTS SHALL BE WELL MIXED. THE SLURRY WILL BE SPREAD UNIFORMLY OVER THE AREA WITHIN ONE HOUR AFTER BEING PLACED IN THE HYDROSEEDER. FINELY GROUND LIMESTONE CAN BE APPLIED IN THE MULCH SLURRY OR IN COMBINATION WITH THE TOP DRESSING. WHEN CONVENTIONAL PLANTING IS TO BE USED, THE SEEDS SHALL BE SPREAD AND PLANTED ACCORDING TO THE FOLLOWING WAYS:  
1. APPLY BEFORE LAND PREPARATION SO THAT IT WILL BE MIXED WITH THE SOIL DURING SEEDING REPARATION.  
2. ANCHOR STRAW OR SOIL USED TO FILL THE HOLES, DISTRIBUTE IN FURROWS.  
3. BROADCAST AFTER STEEP SURFACES ARE SCARIFIED, PITTED, OR TRENCHED.  
4. A FERTILIZER PELLET SHALL BE PLACED AT ROOT DEPTH IN THE CLOSING HOLE BESIDE EACH PINE TREE SEEDLING.

**PLANT SELECTION**  
REFER TO THE MANUAL FOR EROSION AND SEDIMENT CONTROL IN GEORGIA, LATEST EDITION, FOR APPROPRIATE SPECIES. SPECIES NOT LISTED SHALL BE APPROVED BY THE STATE RESOURCE CONSERVATION OF THE NATURAL RESOURCES CONSERVATION SERVICE BEFORE THEY ARE USED. PLANTS SHALL BE SELECTED ON THE BASIS OF SPECIES CHARACTERISTICS, SITE AND SOIL CONDITIONS; PLANTING METHODS; AND THE NEEDS AND DESIRES OF THE LAND OWNER. SOME PERENNIAL SPECIES ARE EASILY PLANTED AND CAN BE PLANTED ANNUALLY. EXAMPLES OF THESE SPECIES ARE EASILY PLANTED AND CAN BE PLANTED ANNUALLY. OTHERS, SUCH AS COMMON GRASS AND SERICEA LESPEDEZA, ARE SLOW TO COME ESTABLISHED AND SHOULD BE PLANTED WITH ANNUAL PERENNIAL SPECIES. THE ADDITIONAL SPECIES WILL PROVIDE QUICK COVER AND AMPLE SOIL PROTECTION UNTIL THE TARGET PERENNIAL SPECIES BECOME ESTABLISHED. FOR EXAMPLE, COMMON SEEDED, HYDRAULIC SEEDED, AND SYNTHETIC TACKIFIERS FINDERS TACKER WILL NOT BE USED ON THE TALL FESCUE WITH SERICEA LESPEDEZA (UNSCARIFIED). PLANT SELECTION MAY ALSO INCLUDE ANNUAL COMPANION CROPS. ANNUAL COMPANION CROPS SHOULD BE USED ONLY WHILE THE PERENNIAL SPECIES IS NOT ESTABLISHED. ANNUAL COMPANION CROPS SHOULD BE PLANTED ON THE BROWN MILLET WITH COMMON BERMUDA IN MID SUMMER. CARE SHOULD BE TAKEN IN SELECTING COMPANION CROP SPECIES AND SEEDING RATES BECAUSE ANNUAL CROPS WILL COMPETE WITH PERENNIAL SPECIES FOR WATER AND NUTRIENTS. ANNUAL CROPS WILL NOT BE USED IN ANY SEEDED MIXTURES CONTAINING PERENNIAL SPECIES DUE TO ITS ABILITY TO OUT-COMPETE DESIRED SPECIES CHOSEN FOR PERMANENT PERENNIAL COVER.

**STORMWATER AND ESC DETAILS - III**  
PLANT WANSLEY ASH POND CLOSURE BY REMOVAL  
HEAD AND CARROLL COUNTIES, GEORGIA

**GEORGIA Department of Natural Resources  
ENVIRONMENTAL PROTECTION DIVISION  
Approved Solid Waste Management Program**  
Approved By: Tammy Butch

**DS3**

**22** **DETAIL**  
**12** **1** DISTURBED AREA STABILIZATION (WITH PERMANENT VEGETATION)

**Ds1** **21** **DETAIL**  
**19** DISTURBED AREA STABILIZATION (WITH MULCHING ONLY)

**SOURCE: GSWCC**

**Digitally signed by  
Date: 2025.11.10  
15:53:14 -06'00'**

**Geosyntec consultants**  
No. 125 Roberts Boulevard, NW, Suite 200  
KENNESAW, GEORGIA 30144 USA  
PHONE: 678.552.9500  
WWW.GEOSYNTEC.COM

**Georgia Power**

**PROJ. NO.** GW9155 **DWG.** GW7306.13-C22 **EDIT** 11/10/25  
**SCALE** AS SHOWN **DATE** NOVEMBER 2025 **DRAWING** 22 OF 22